


May 1975

0-5% Power  
Balancing  
105 Turbine

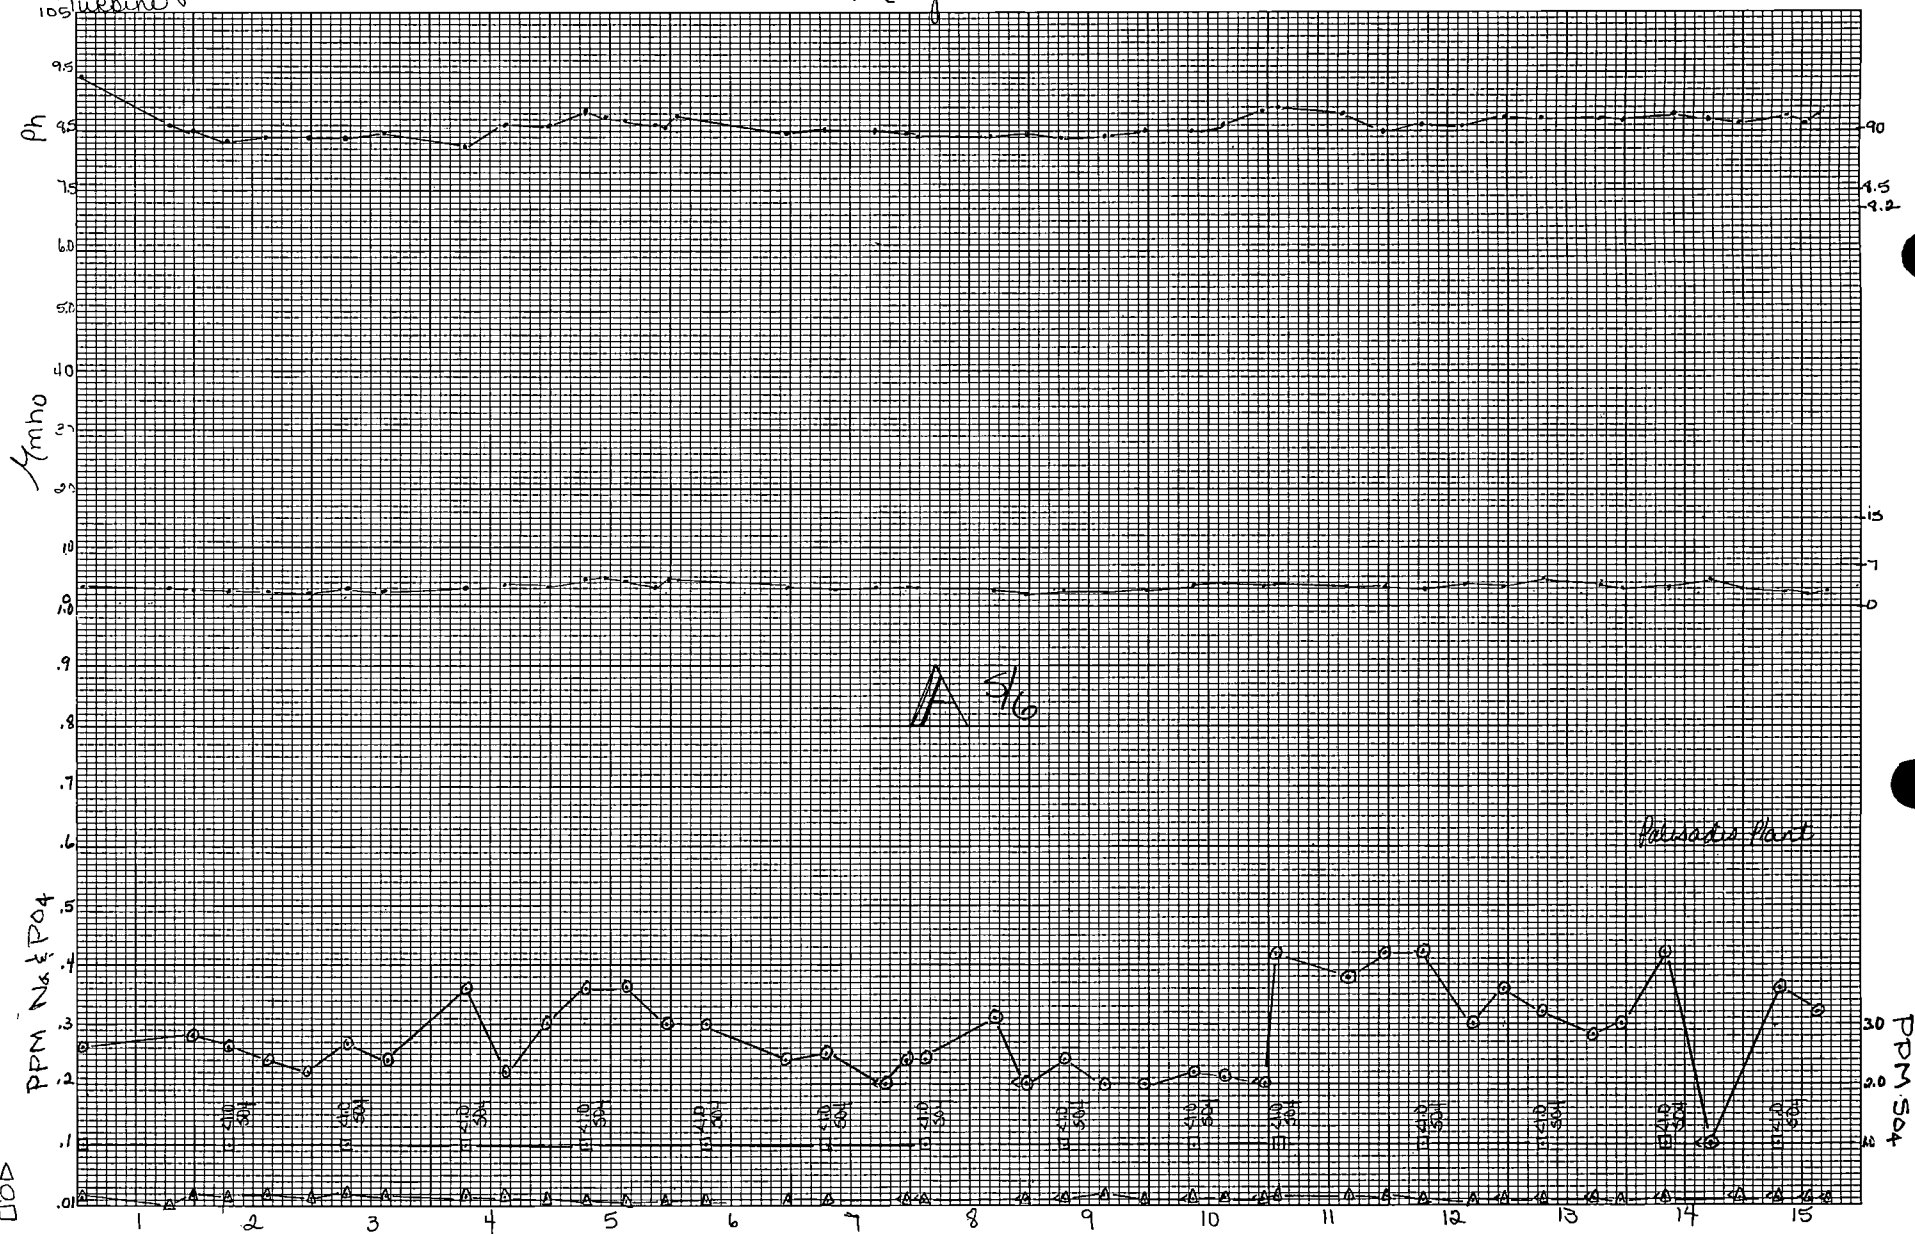

Na Δ  
PO4 □  
SO4 □

PPM SO4

0.590 Power  
Balancing Turbine


May. 1975



Na  $\Delta$   
PO<sub>4</sub>  $\square$   
SO<sub>4</sub>  $\square$

0-5% Power  
balancing  
turbines


May 1975

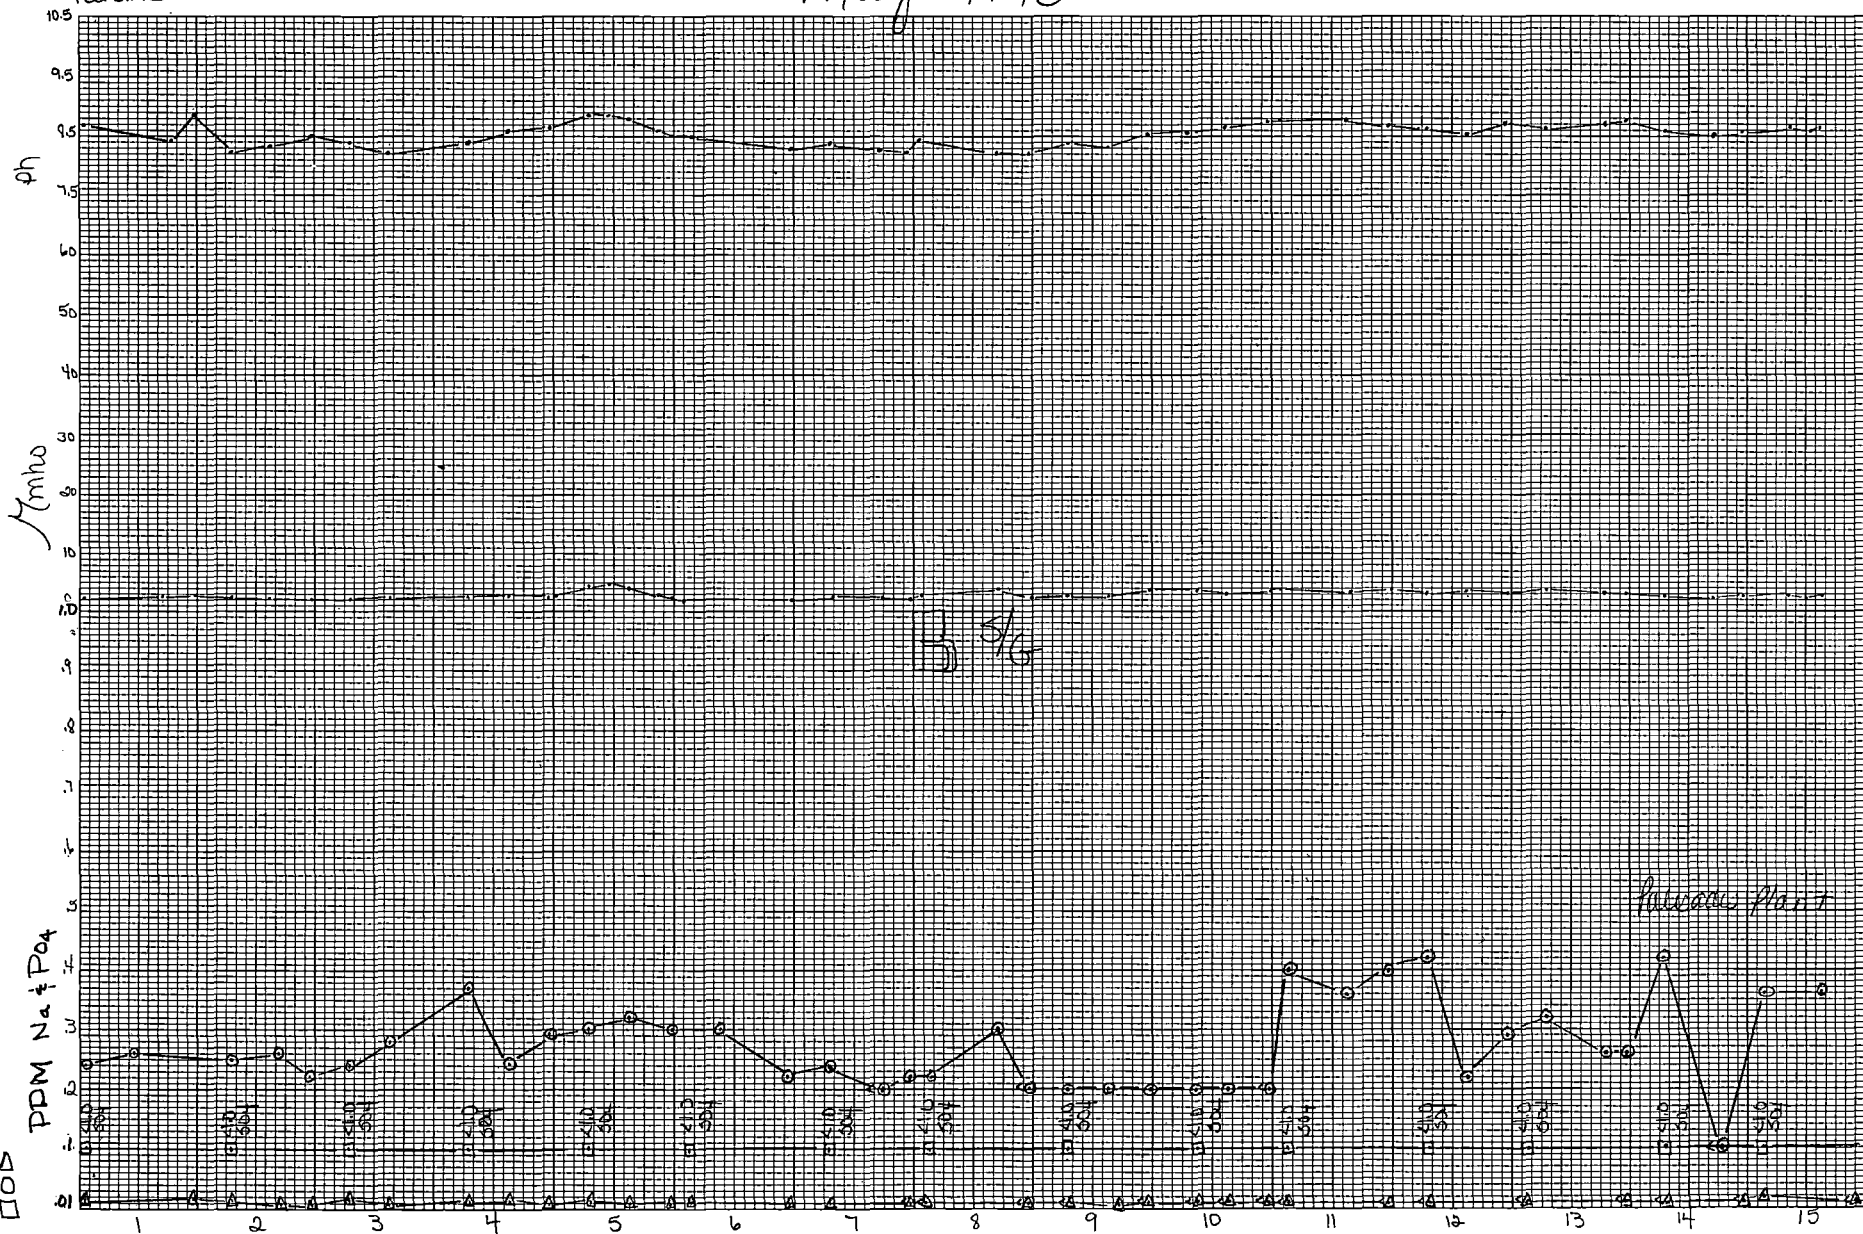

Na+PO4  
SO4  
□ OOD

PPM SO4

May 1975

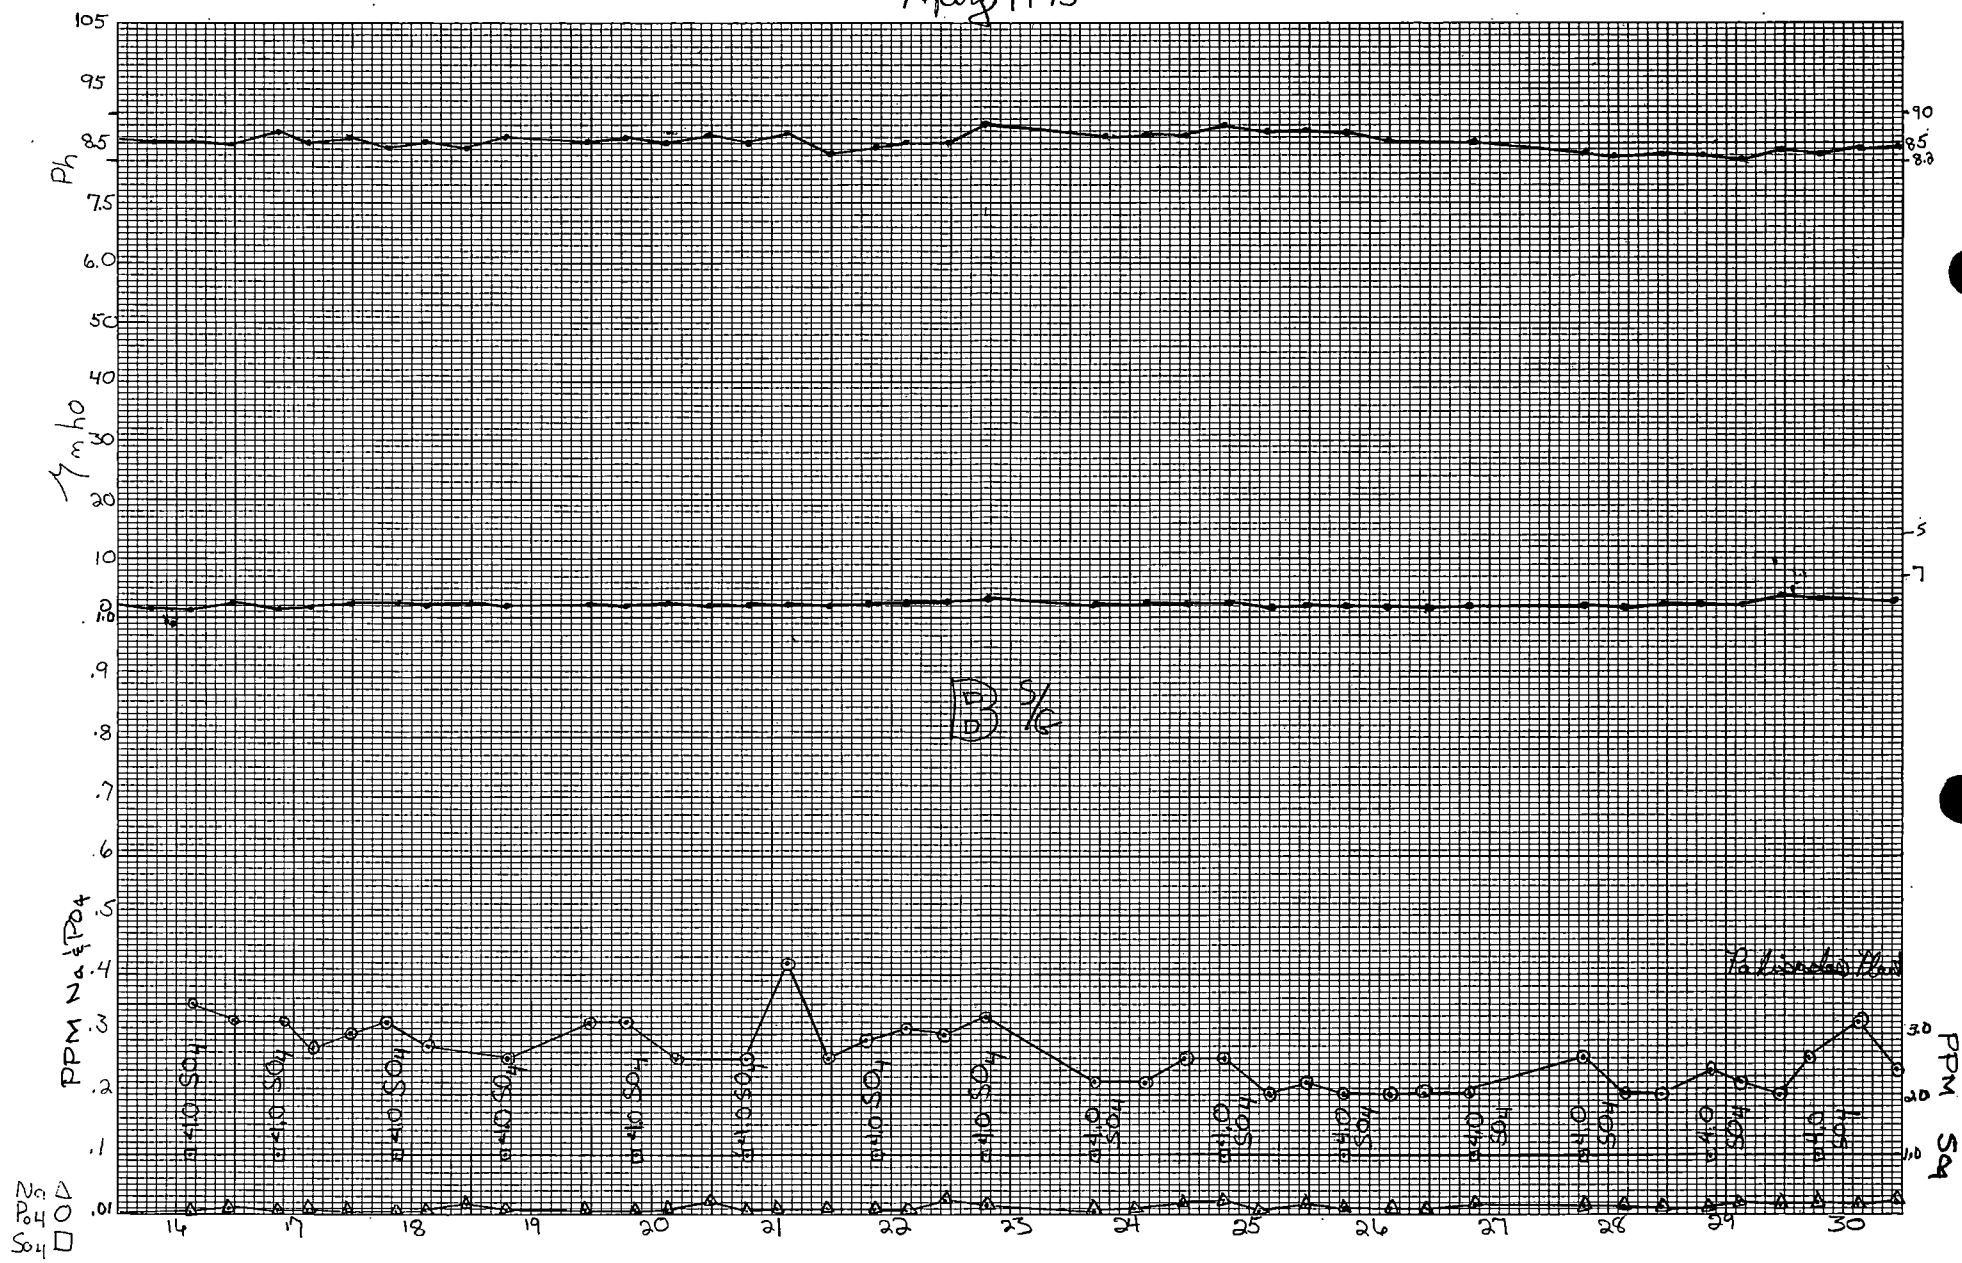

# Phosphate AND Sulfate Removed from the steam Generators

lbs

