

Consumers
Power
Company

General Offices: 212 West Michigan Avenue, Jackson, Michigan 49201 • Area Code 517 788-0550

March 26, 1975

REGULATORY DOCKET FILE COPY

Division of Reactor Licensing
US Nuclear Regulatory Commission
Washington, DC 20555

Re: Docket 50-255
License DPR-20
Palisades Plant
Flushing Report

Gentlemen:

Attached is a corrected Flushing Report No 3 for the Palisades Plant steam generators. There was a typographical error in the total pounds of phosphate for "B" SG. It should have been 299 not 229.


Yours very truly,

Ralph B. Sewell

WGF/smm

Ralph B. Sewell
Nuclear Licensing Administrator

CC: JGKeppler,
USNRC

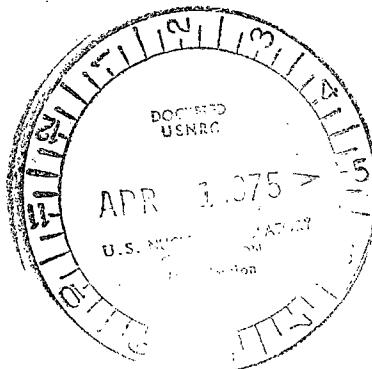

3466

FLUSHING REPORT NO 3

Flushing Report No 3 covers the period from February 3, 1975 through March 6, 1975. At the beginning of this period, the SG were in a wet lay-up condition.

On February 24, 1975, the "A" SG was drained and refilled to wet lay-up condition. The phosphate concentration during this drain was 21 ppm. After refilling, the phosphate concentration was determined to be approximately 6 ppm.

On March 6, 1975, the SG were in wet lay-up with the following chemistry:

	<u>"A" SG</u>	<u>"B" SG</u>
pH	9.95	9.87
Conductivity	70 Micromho/Cm	52 Micromho/Cm
Phosphate	23 ppm	13.2 ppm
Hydrazine	145 ppm	220 ppm

The totals (as of March 6, 1975) of phosphate removed from the steam generators are as follows:

	<u>"A" SG</u>	<u>"B" SG</u>
1B Phosphate	412	299 3/26/75

