




**Consumers  
Power  
Company**

General Offices: 212 West Michigan Avenue, Jackson, Michigan 49201 • Area Code 517 788-0550

July 22, 1976

Regulatory

File Cy

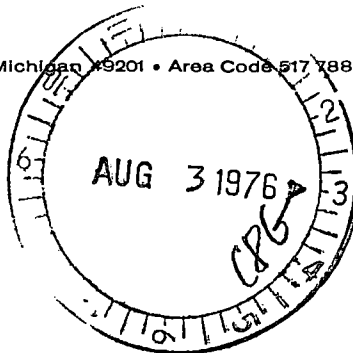

Mr James G. Keppler  
Office of Inspection and Enforcement  
Region III  
US Nuclear Regulatory Commission  
799 Roosevelt Road  
Glen Ellyn, IL 60137

DOCKET 50-255, LICENSE DPR-20  
PALISADES PLANT - ER-76-21  
CONTAINMENT PURGE SUPPLY VALVE

Attached is a reportable occurrence which relates to the Palisades Plant. This occurrence has been classified as a condition leading to operation in a degraded mode permitted by a limiting condition of operation.

David A. Bixel  
Assistant Nuclear Licensing Administrator

**JUL 26 1976**

7763

# LICENSEE EVENT REPORT

CONTROL BLOCK:                  

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE NAME	LICENSE NUMBER	LICENSE TYPE	EVENT TYPE
<span style="border: 1px solid black; padding: 0 5px;">01</span> M I P A L 1	<span style="border: 1px solid black; padding: 0 5px;">00</span> - <span style="border: 1px solid black; padding: 0 5px;">000000</span> - <span style="border: 1px solid black; padding: 0 5px;">00</span>	<span style="border: 1px solid black; padding: 0 5px;">4</span> <span style="border: 1px solid black; padding: 0 5px;">1</span> <span style="border: 1px solid black; padding: 0 5px;">1</span> <span style="border: 1px solid black; padding: 0 5px;">1</span> <span style="border: 1px solid black; padding: 0 5px;">1</span>	<span style="border: 1px solid black; padding: 0 5px;">0</span> <span style="border: 1px solid black; padding: 0 5px;">3</span>
7 8 9	14 15 25	26 30	31 32

REPORT TYPE	REPORT SOURCE	DOCKET NUMBER	EVENT DATE	REPORT DATE
<span style="border: 1px solid black; padding: 0 5px;">01</span> CONT <span style="border: 1px solid black; padding: 0 5px;">L</span>	<span style="border: 1px solid black; padding: 0 5px;">L</span>	<span style="border: 1px solid black; padding: 0 5px;">05</span> <span style="border: 1px solid black; padding: 0 5px;">0</span> - <span style="border: 1px solid black; padding: 0 5px;">0255</span>	<span style="border: 1px solid black; padding: 0 5px;">06</span> <span style="border: 1px solid black; padding: 0 5px;">27</span> <span style="border: 1px solid black; padding: 0 5px;">76</span>	<span style="border: 1px solid black; padding: 0 5px;">07</span> <span style="border: 1px solid black; padding: 0 5px;">22</span> <span style="border: 1px solid black; padding: 0 5px;">76</span>
7 8	57 58 59 60	61 68	69 74	75 80

## EVENT DESCRIPTION

02 The containment purge supply valve (CV-1808) failed to open during the monthly test.

03 This valve has been tagged closed to meet the requirements for containment integrity

04 (1.4(d) all automatic containment isolation valves are operable or are locked

05 closed). (ER-76-21)

06

SYSTEM CODE	CAUSE CODE	COMPONENT CODE	PRIME COMPONENT SUPPLIER	COMPONENT MANUFACTURER	VIOLATION
<span style="border: 1px solid black; padding: 0 5px;">07</span> S D	<span style="border: 1px solid black; padding: 0 5px;">E</span>	<span style="border: 1px solid black; padding: 0 5px;">V A L V E X</span>	<span style="border: 1px solid black; padding: 0 5px;">A</span>	<span style="border: 1px solid black; padding: 0 5px;">C 5 8 7</span>	<span style="border: 1px solid black; padding: 0 5px;">N</span>
7 8 9 10	11	12 17	43	44 47	48

## CAUSE DESCRIPTION

08 Unknown at the present time. The failure will be investigated during a plant outage

09 of sufficient length such that repairs can be made without affecting plant

10 availability.

FACILITY STATUS	% POWER	OTHER STATUS	METHOD OF DISCOVERY	DISCOVERY DESCRIPTION
<span style="border: 1px solid black; padding: 0 5px;">11</span> E	<span style="border: 1px solid black; padding: 0 5px;">100</span>	<span style="border: 1px solid black; padding: 0 5px;">NA</span>	<span style="border: 1px solid black; padding: 0 5px;">b</span>	<span style="border: 1px solid black; padding: 0 5px;">NA</span>
7 8 9	10 12 13	44	45 46	80

FORM OF ACTIVITY RELEASED	CONTENT OF RELEASE	AMOUNT OF ACTIVITY	LOCATION OF RELEASE
<span style="border: 1px solid black; padding: 0 5px;">12</span> Z	<span style="border: 1px solid black; padding: 0 5px;">Z</span>	<span style="border: 1px solid black; padding: 0 5px;">NA</span>	<span style="border: 1px solid black; padding: 0 5px;">NA</span>
7 8 9	10 11	44	45 80

## PERSONNEL EXPOSURES

NUMBER	TYPE	DESCRIPTION
<span style="border: 1px solid black; padding: 0 5px;">13</span> 0 0 0	<span style="border: 1px solid black; padding: 0 5px;">Z</span>	<span style="border: 1px solid black; padding: 0 5px;">NA</span>
7 8 9 11	12	13 80

## PERSONNEL INJURIES

NUMBER	DESCRIPTION
<span style="border: 1px solid black; padding: 0 5px;">14</span> 0 0 0	<span style="border: 1px solid black; padding: 0 5px;">NA</span>
7 8 9 11	12 80

## PROBABLE CONSEQUENCES

15 None, valve failed in the closed position.

## LOSS OR DAMAGE TO FACILITY

TYPE	DESCRIPTION
<span style="border: 1px solid black; padding: 0 5px;">16</span> Z	<span style="border: 1px solid black; padding: 0 5px;">NA</span>
7 8 9 10	80

## PUBLICITY

17 NA

## ADDITIONAL FACTORS

18 A revised report will be issued after this valve has been returned to service.

19