




**Consumers
Power
Company**

General Offices: 212 West Michigan Avenue, Jackson, Michigan 49201 • Area Code 517 788-0550

January 5, 1976

Mr. J. G. Keppler
US Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, IL 60137

DOCKET 50-255, LICENSE DPR-20
PALISADES PLANT

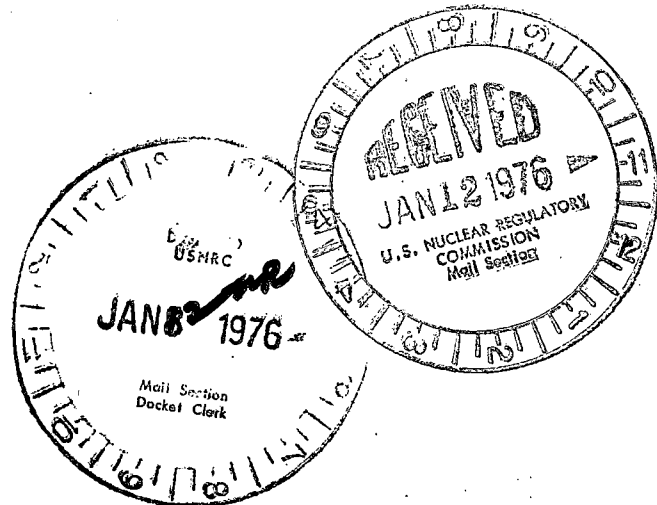

Transmitted attached is a "License Event Report" for the Palisades Plant.

Ralph B. Sewell

Ralph B. Sewell
Nuclear Licensing Administrator

CC: Director of Nuclear
Reactor Regulation,
USNRC

LICENSEE EVENT REPORT

Palisades

(PLEASE PRINT ALL REQUIRED INFORMATION)

(1) CONTROL BLOCK: 1 6									
(2) LICENSEE NAME: J 1 M I P A L 1									
(3) LICENSE NUMBER: 0 0 - 0 0 0 0 0 - 0 0									
(4) LICENSE TYPE: 4 1 1 1 1									
(5) EVENT TYPE: 9 9									
(6) CATEGORY: 0 1 CONT * *									
(7) REPORT TYPE: T									
(8) REPORT SOURCE: L									
(9) DOCKET NUMBER: 0 5 0 - 0 2 5 5									
(10) EVENT DATE: 1 2 2 1 7 5									
(11) REPORT DATE: 0 1 0 5 7 5									

EVENT DESCRIPTION

02	When the 'A' cooling tower pump was removed from service following plant shutdown, the	80
03	water lost to the mixing basin caused the temperature at discharge to be 45.5 degrees	80
04	F. The delta-T was 8.4 degrees F which is above the Tech Spec limit of 5 degrees F.	80
05	Due to the infrequency of occurrence and the negligible impact on environment, a Tech	80
06	Spec Change has been requested to permit short periods of time (continued on Line 18)	80

(13) SYSTEM CODE: H F		(14) CAUSE CODE: B		(15) COMPONENT CODE: V A L V O P				(16) PRIME COMPONENT SUPPLIER: A		(17) COMPONENT MANUFACTURER: B 2 5 0				(18) VIOLATION: Y	
-----------------------	--	--------------------	--	----------------------------------	--	--	--	----------------------------------	--	--------------------------------------	--	--	--	-------------------	--

CAUSE DESCRIPTION

08	The valve closing time is too slow to prevent weir overflow following pump trip.	80
09		80

(20) FACILITY STATUS: G		(21) % POWER: 0 0 0		(22) OTHER STATUS: NA		(23) METHOD OF DISCOVERY: B		(24) DISCOVERY DESCRIPTION: Environmental Monitoring Program			
(25) FORM OF ACTIVITY RELEASED: Z		(26) CONTENT OF RELEASE: Z		(27) AMOUNT OF ACTIVITY: NA				(28) LOCATION OF RELEASE: NA			

PERSONNEL EXPOSURES

13	0 0 0	Z	NA	80
----	-------	---	----	----

PERSONNEL INJURIES

14	0 0 0	Z	NA	80
----	-------	---	----	----

(34)

Probable Consequences

15	No effect on public health and safety.	80
----	--	----

LOSS OR DAMAGE TO FACILITY

16	Z	NA	80
----	---	----	----

PUBLICITY

17	Copies of this report are being sent to MI news media.	80
----	--	----

ADDITIONAL FACTORS

18	with delta-T above 5 degrees F. (AO-75-27)	80
----	--	----

19		80
----	--	----