


**Consumers  
Power  
Company**

General Offices: 212 West Michigan Avenue, Jackson, Michigan 49201 • Area Code 517 788-0550

December 22, 1975

REGULATORY DOCKET FILE COPY

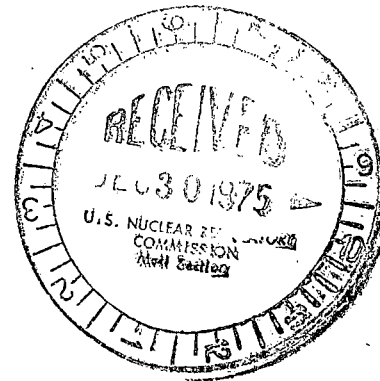


Mr James G. Keppler  
Office of Inspection Enforcement  
Region III  
US Nuclear Regulatory Commission  
799 Roosevelt Road  
Glen Ellyn, IL 60137

DOCKET 50-255, LICENSE DPR-20  
PALISADES PLANT, REPORTABLE OCCURRENCE UE-75-13

Attached is a reportable occurrence which relates to the Palisades Plant and has been classified as a condition leading to operation in a degraded mode. Plant Technical Specifications permit operation to continue for 12 hours with unidentified primary coolant system leakage between 1 and 10 gpm. Leakage was identified at a sample isolation valve.

David A. Bixel  
Assistant Nuclear Licensing Administrator

CC: File

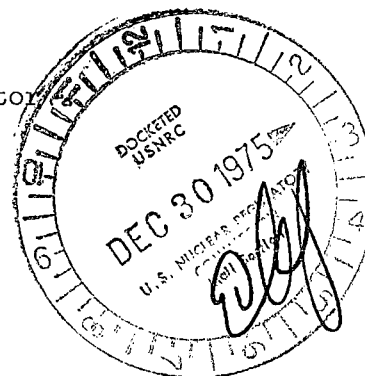

14332

## LICENSEE EVENT REPORT

**CONTROL BLOCK:**

**[PLEASE PRINT ALL REQUIRED INFORMATION]**

LICENSEE NAME					LICENSE NUMBER								LICENSE TYPE					EVENT TYPE					
01	M	I	P	A	L	1	0	0	-	0	0	0	0	-	0	0	4	1	1	1	1		
7	8	9				14	15									25	26					31	32

CATEGORY		REPORT TYPE	REPORT SOURCE	DOCKET NUMBER						EVENT DATE					REPORT DATE										
01	CON'T	*	*	L	L	0	5	0	-	0	2	5	5	1	1	2	2	7	5	1	2	2	2	7	5
7	8	57	58	59	60	61							68	69					74	75					80

[illegible]

02 During normal operation, PCS leakage was observed to be slightly greater than 1 gpm  
7 8 9 80

03 (unidentified) for about two hours. Leakage was subsequently identified at a sample  
7 8 9 80

04 isolation valve. This occurrence was a condition leading to operation in a degraded  
7 8 9 80

05 mode and is permitted for a period of 12 hours with plant operating. Valve repair  
7 8 9 80

06 was completed (UE-75-13).  
7 8 9 80

PRIME

## CAUSE DESCRIPTION

08	Valve leakage. The valve type is SS-64-9-RS-AI-NC. The valve has been temporarily	80
09	capped.	80
10		80

FACILITY STATUS		% POWER		OTHER STATUS		METHOD OF DISCOVERY		DISCOVERY DESCRIPTION	
11	E	079		NA		B		NA	
7	8	9	10	12	13	44	45	46	80
FORM OF ACTIVITY RELEASED		CONTENT OF RELEASE		AMOUNT OF ACTIVITY		LOCATION OF RELEASE			
12	Z	Z		NA				NA	
7	8	9	10	11	44	45			80

## PERSONNEL EXPOSURES

NUMBER				TYPE	DESCRIPTION
1	3	0	0	0	NA

## PERSONNEL INJURIES

NUMBER				DESCRIPTION	
1	4	0	0	0	NA

## PROBABLE CONSEQUENCES

1	5	None.	
7	8	9	80

LOSS OR DAMAGE TO FACILITY

TYPE			DESCRIPTION
1	6	Z	NA

## PUBLICITY

17	NA	
7	8	9
		80

## ADDITIONAL FACTORS

7	8	9	NA	80
---	---	---	----	----

19 | \_\_\_\_\_ 80