


Nebraska Public Power District  
COOPER NUCLEAR STATION  
UPDATED SAFETY ANALYSIS REPORT (USAR)

Fuel Cask Area Holtec Rack A Layout  
Figure X-3-1  
06/03/08


H1406

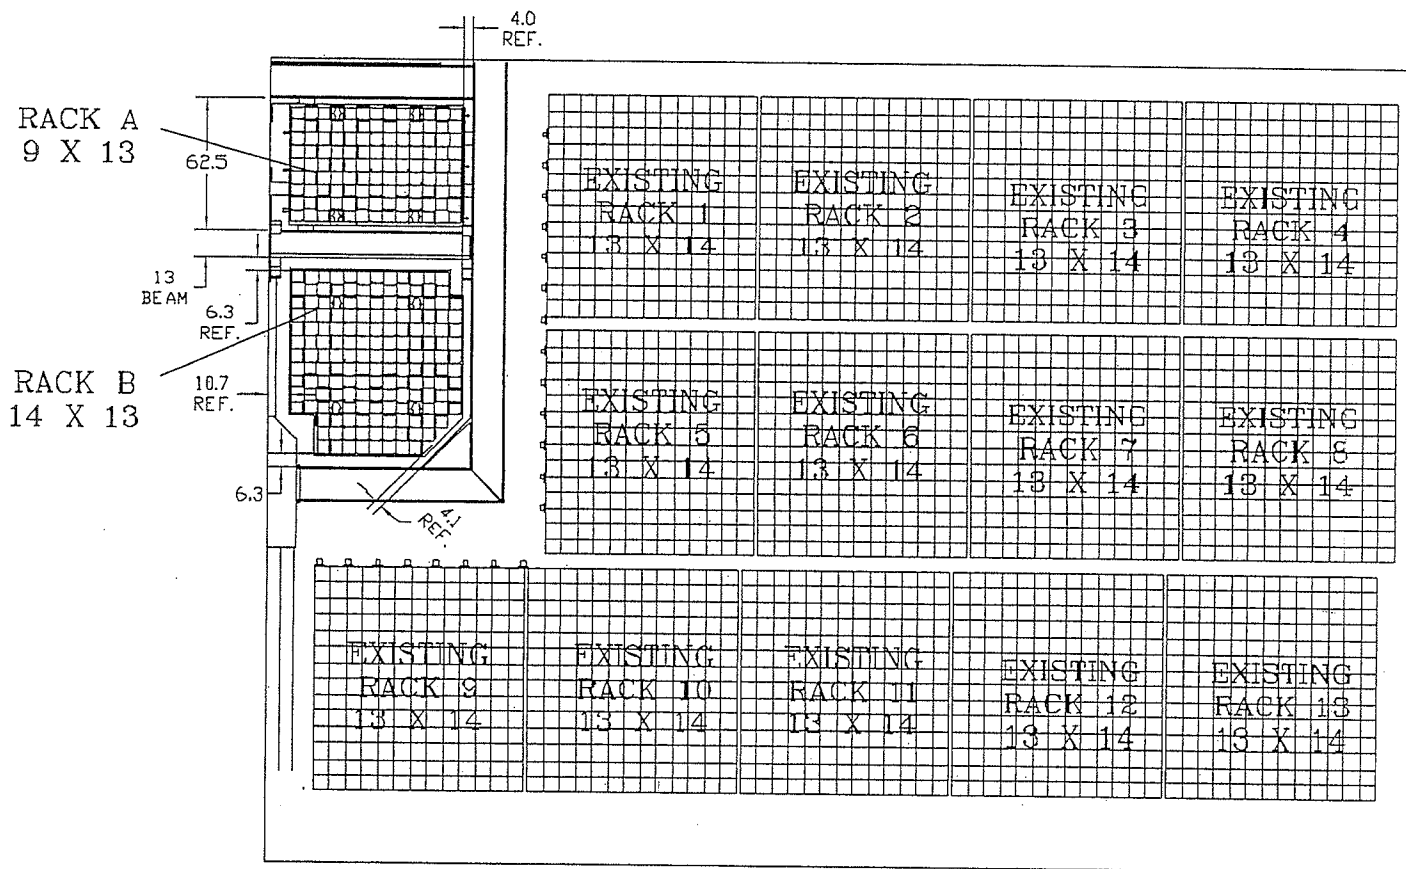

H1406


Nebraska Public Power District  
COOPER NUCLEAR STATION  
UPDATED SAFETY ANALYSIS REPORT (USAR)

Fuel Cask Area Holtec Rack B Layout  
Figure X-3-2  
06/03/08

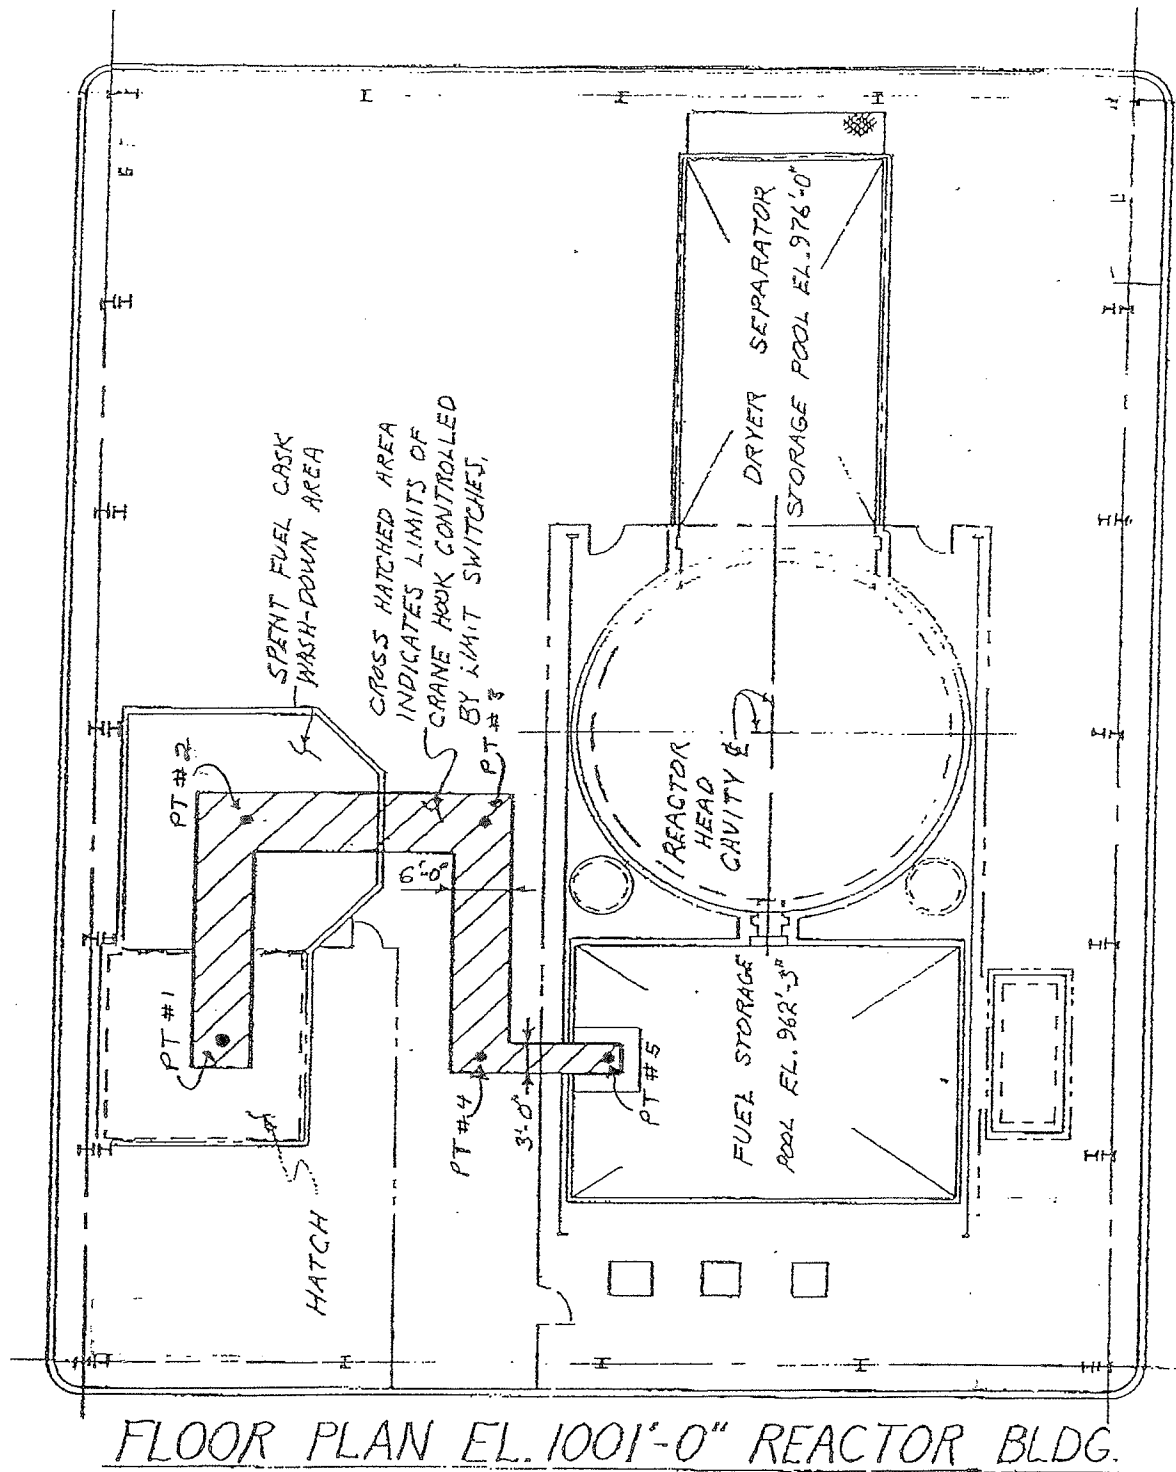

Nebraska Public Power District  
**COOPER NUCLEAR STATION**  
**UPDATED SAFETY ANALYSIS REPORT (USAR)**

Horizontal Controlled Path of  
 Spent Fuel Cask  
 Figure X-4-10  
 02/10/17

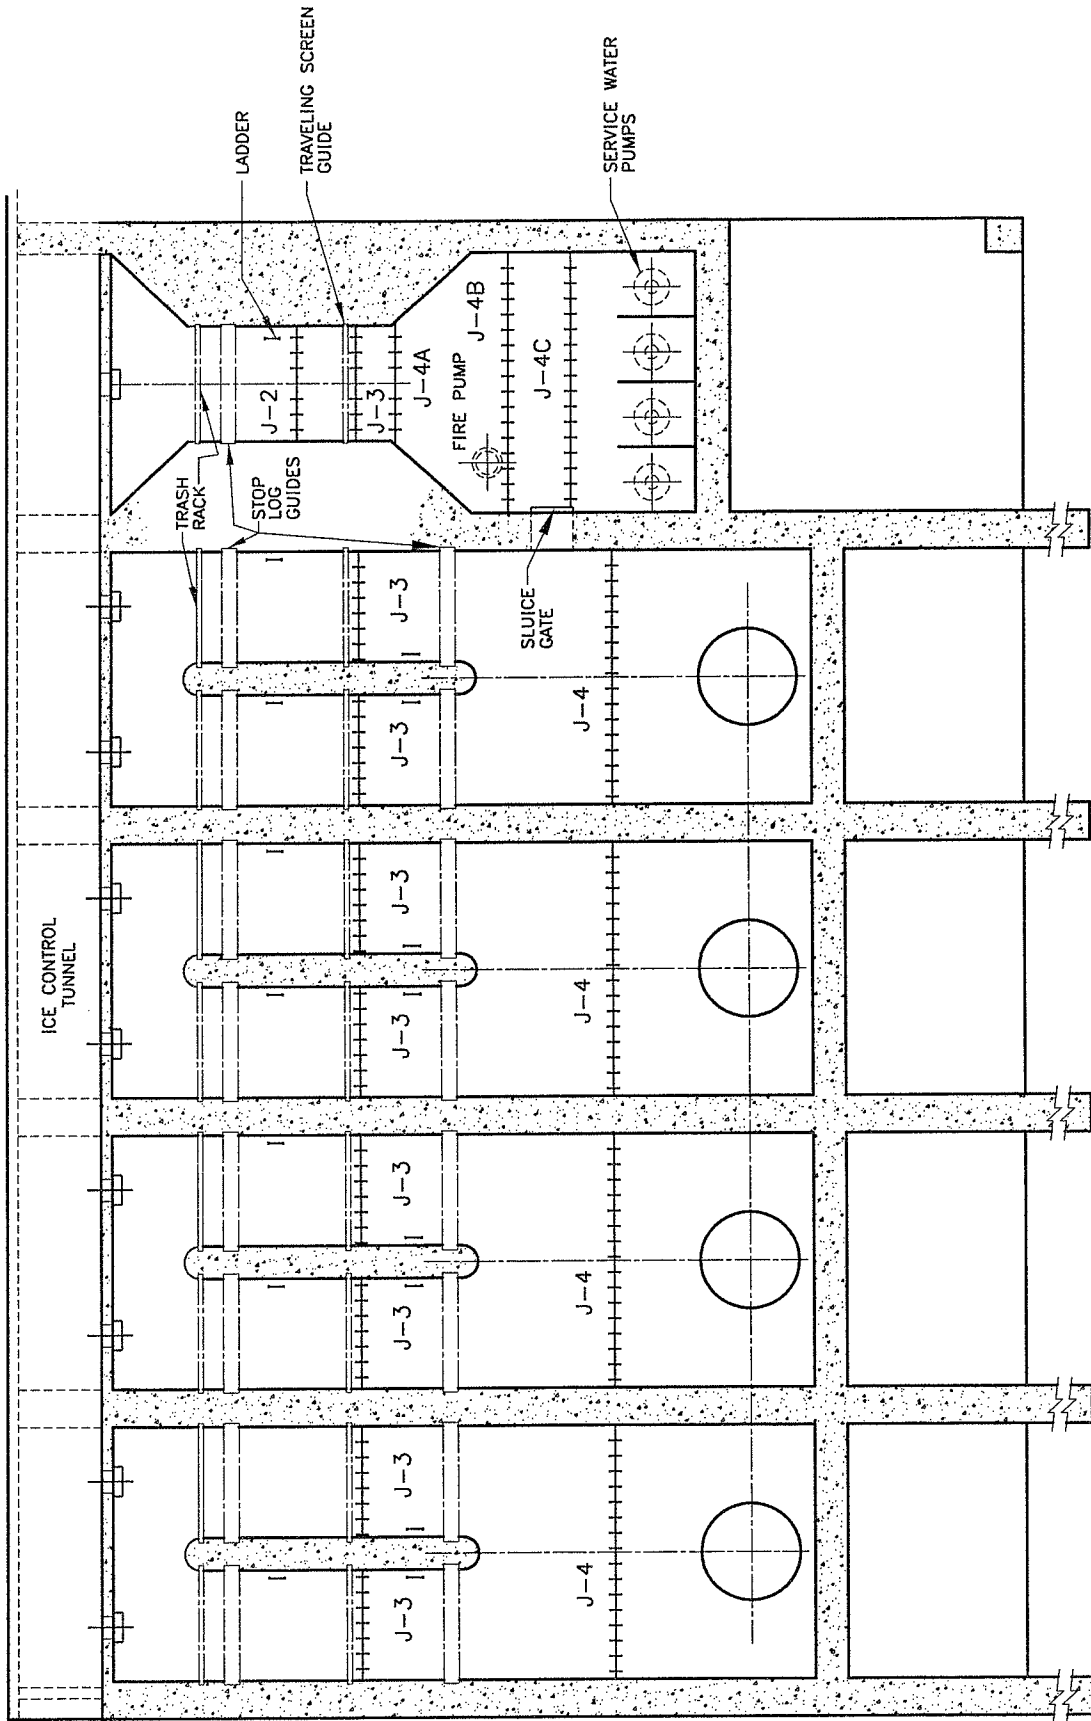

Nebraska Public Power District  
COOPER NUCLEAR STATION  
UPDATED SAFETY ANALYSIS REPORT (USAR)

## WATER JET SPRAYING SYSTEM AT BOTTOM OF INTAKE STRUCTURE

FIGURE X-8-4  
11/23/11