

**Florida
Power**
CORPORATION

October 2, 1979

File: 3-0-3-a-3

Mr. Robert W. Reid, Chief
Operating Reactors Branch No. 4
Division of Operating Reactors
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

SUBJECT: Crystal River Unit 3
Docket No. 50-302
Operating License No. DPR-72

Dear Mr. Reid:

On September 19, 1979, Florida Power Corporation received your letter dated September 7, 1979 requesting additional information concerning the upgrade of the anticipatory reactor trips on turbine trip or loss of main feedwater at Crystal River Unit 3.

You specifically requested Florida Power Corporation to provide the additional information identified in the enclosure of your letter and evaluate the possibility of improving the installation schedule for the safety grade anticipatory trips previously identified in our response to IE Bulletin 79-05B.

In that regard, enclosed is our response to Items 1-9 identified in the enclosure of your letter.

Our previous implementation schedule for this design modification was approximately 12 months following NRC approval of our proposed design. This schedule was based on the long lead times necessary for the manufacture, delivery and installation of safety grade equipment. As indicated in our response to Item 5, we have been able to locate some existing qualified equipment from a utility who is experiencing delays in construction of its nuclear plant. These components can be delivered to CR#3 within 22 weeks from the time of NRC approval of our proposed design. The installation of this equipment would be accomplished at the first refueling outage or outage of sufficient duration to permit installation, following receipt of the equipment on site. We believe that this improved schedule is consistent with your September 7, 1979 letter.

1138 038

7910010 361

Mr. Robert W. Reid


Page Two

October 2, 1979

Please contact us if you wish to discuss our response further.

Very truly yours,

FLORIDA POWER CORPORATION

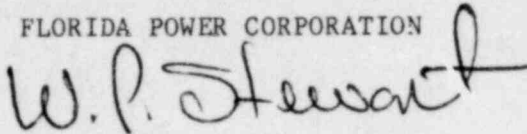A handwritten signature in dark ink, appearing to read "W. P. Stewart". The signature is fluid and cursive, with a long horizontal stroke extending to the right.

W. P. Stewart
Manager, Nuclear Operations


ECShewT01
D88N

1138 039


STATE OF FLORIDA

COUNTY OF PINELLAS

W. P. Stewart states that he is the Manager, Nuclear Operations, of Florida Power Corporation; that he is authorized on the part of said company to sign and file with the Nuclear Regulatory Commission the information attached hereto; and that all such statements made and matters set forth therein are true and correct to the best of his knowledge, information and belief.

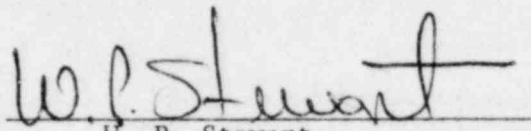
W. P. Stewart

Subscribed and sworn to before me, a Notary Public in and for the State and County above named, this 2nd day of October, 1979.


Notary Public

Notary Public, State of Florida at Large,
My Commission Expires: August 8, 1983

CameronNotary 3(D12)

1138 040

QUESTION 1. For your proposed design, state the degree of conformance with the acceptance criteria listed in Column 7.2 of Table 7-1 ("ACCEPTANCE CRITERIA FOR CONTROLS") of the Standard Review Plan. Justify any non-conformance.

QUESTION 2. Provide a discussion of the following:

- a. design basis information required by Section 3 of IEEE-279-1971, and
- b. conformance with the design requirements of Section 4 of IEEE-279-1971.

RESPONSE TO QUESTIONS 1 AND 2:

The proposed design for safety grade anticipatory trips contains four redundant and independent channels which monitor the main feedwater pumps and the turbine. This equipment will initiate an RPS reactor trip on the tripping of both main feedwater pumps or on a turbine trip. The cabinet mounted equipment will be installed in and become an integral part of the existing four channel RPS-1. As such, the additional equipment will meet or exceed the design bases of the RPS at CR #3 and will meet or exceed the acceptance criteria and design requirements of the RPS. The description of the conformance of the RPS with the acceptance criteria and design requirements of Crystal River Unit 3 can be found in Section 7.1 of the FSAR.

QUESTION 3. Provide a description of any changes to and/or interfaces with the existing protection system. Include diagrams (block, location, functional and/or elementary wiring), as necessary, to clearly depict the changes and/or interfaces. In addition, provide an analysis which demonstrates that these changes and/or interfaces will not degrade the existing protection system.

RESPONSE TO QUESTION 3:

The anticipatory trip equipment will be added to the RPS cabinets and will interface as new trips in the present bistable trip string. Figures 1 and 2 of the Attachment I show the functional interface of the added equipment with the RPS. Drawings 51079DBG-1 and 51079MLG-1 of the attachment describe the inputs, outputs, and logic of the new trip functions. The added modules will consist of contact buffers, bistables, and auxiliary relays, which have been tested and qualified for use in the safety system. Existing RPS power supplies, flux signals, interlock circuits, and indicators will be used as required by the added equipment. The requirements for the RPS, e.g., cooling, power, seismic, environmental, will be the same for the system with anticipatory trips as the requirements prior to addition of the new trips.

A failure analysis of the RPS-1 was performed and is contained in Topical Report BAW-10003, "Qualification Testing of Protection System Instrumentation." This failure analysis was predicated on the use of qualified

RESPONSE TO QUESTION 3 (Cont'd)

modules and concluded that any single failure in the RPS will not prevent performance of its protection action when required. The added equipment uses qualified modules and the failure analysis of BAW-10003 is still applicable to the RPS containing anticipatory trips.

The anticipatory trips provide additional protection and conservatism beyond that provided by the rest of the RPS. No credit is taken for any of these trips in the FSAR accident analyses. The sensors will be redundant, separated, and designed such that a single failure will not prevent them from performing their intended function. The sensors are anticipatory to other diverse parameters which will cause a reactor trip. Thus, the protection system will not be degraded by these trips since functioning of the anticipatory trips is not required to provide safety action and contact isolation of 500 volts is provided. The sensor contacts are closed during normal operation and open to cause a reactor trip when either the main feedwater pumps trip or the turbine trips. The contacts serve to interrupt power to cause a reactor trip. Loss of power to the trip circuitry will also initiate a reactor trip.

QUESTION 4. Identify equipment which is identical to equipment utilized in existing safety-grade systems. For the equipment which is not identical, briefly describe the differences.

RESPONSE TO QUESTION 4:

The equipment to be used are bistables, contact buffers, and auxiliary relays. These modules are updated versions of modules already in use in B&W safety systems of the operating plants. Significant changes are: the bistable output to the RPS trip string has been converted from a relay contact to a solid state output; the contact buffer now uses one transformer with a rectified output to monitor the field contacts instead of two transformers with AC outputs; and transistor buffer amplifiers for driving relay coils from current limited grounded input signals have been added to the auxiliary relay. These changes were made to improve the performance of the modules.

QUESTION 5. For all critical components, provide an expected delivery date.

RESPONSE TO QUESTION 5:

The Reactor Protection System components, contact buffers, bistables, and auxiliary relays, which are the critical path components in this design, are available from existing systems which have been delayed in construction. These components can be delivered to CR #3 within 22 weeks from the time of NRC approval of our proposed design.

QUESTION 6. In general, the equipment shall be seismically and environmentally qualified. Therefore, provide the following descriptive information for the qualification test program:

- a. equipment, design specification requirements,
- b. test plan,
- c. test setup,
- d. test procedures, and
- e. acceptability goals and requirements.

RESPONSE TO QUESTION 6:

The modules to be used have been qualified for use in B&W safety systems. Attachment II contains the seismic and environmental summary reports for each module which describe the test programs and report the acceptability of the modules. The detailed test procedures and test data are available for audit.

QUESTION 7. Identify the portion(s) of the design which are within the scope of supply of B&W and/or other contractors.

RESPONSE TO QUESTION 7:

The B&W scope of supply is limited to the RPS modules, i.e., contact buffers, bistables, and auxiliary relays contained within the RPS system cabinets. The cable, relays, and pressure switches used in the design will be purchased by Florida Power Corporation directly.

QUESTION 8. Provide the criteria for the overall reactor protection system installation testing which will demonstrate that the new trip has been installed properly. If this information is not available at this time, provide a schedule for its submittal.

RESPONSE TO QUESTION 8:

Detailed installation instructions and test procedures will be provided to ensure that the anticipatory trip equipment is properly installed and performs the functions described. In addition, the cabinet mounted equipment to be supplied by B&W will be fully testable from the RPS cabinets. The equipment will have provision for simulating input signals and verifying the proper response of the RPS channel. This testing will be similar to that presently performed on the RPS and will be integrated into the periodic testing of the cabinets.

Overall reactor protection system installation testing to be performed by the utility could include actuation of the new sensors and verification of proper response at the CRDCS cabinets.

QUESTION 9. The safety evaluations for the anticipatory trips are either missing or are incomplete. Submit supporting analysis to justify the proposed trip signals by addressing the following items:

- a. Provide an analysis that quantifies the improvement in the time-to-reactor-trip for both the turbine trip and the loss of main feedwater signals;
- b. Address the need to bypass these trips at 20% power versus bypass at a lower power (approximately 10%);
- c. Discuss the adequacy of the proposed trip signals for loss of main feedwater for a variety of failure scenarios (such as feedwater valve closures), i.e., see the Oconee 1 transients of 6/11/79; and
- d. Provide an evaluation of why a reactor trip on low steam generator level is not a viable anticipatory trip signal when the other signals are bypassed, i.e., see the Crystal River 3 transient of 8/2/79.

RESPONSE TO QUESTION 9:

- a. The primary purpose of anticipatory reactors trips (ARTs) is to reduce the probability of lifting the PORV for turbine trip/loss of main feedwater type events. For a reactor high pressure trip setpoint of 2300 psig, it was shown in References 1 and 2 that the PORV would not lift with a setpoint of >2400 psig. The margin to the PORV setpoint can be increased, however, by use of ARTs. Figure 9a-1 shows the pressure increase from nominal operating pressure as a function of time to trip for the loss of main feedwater event. From this figure, it can be seen that an ART that detects and trips the plant at 4 seconds results in a peak pressure increase of 60 psi; whereas the high R.C. pressure trip which would occur at 8 seconds results in a peak pressure increase of 184 psi. The anticipatory trip signals which have been selected will initiate a reactor trip in less than one second. As seen on Figure 9a-1, a one second time to trip results in a 12 psi pressure increase, compared to a 184 psi pressure increase for the high pressure trip at 8 seconds.

The analyses presented above are for a loss of main feedwater event which produces higher peak pressures than turbine trips produce. The time to reactor trip after a turbine trip from full power is, however, approximately the same as that for a loss of main feedwater.

- b. Sensitivity studies on time to reach the PORV setpoint vs. power level for a loss of feedwater event have been performed. Table 9B-1 displays the results of these analyses. The results are for a trip on high RC pressure since that gives the shortest time to steam generator

RESPONSE TO QUESTION 9 (Cont'd)

dryout assuming no auxiliary feedwater. For power levels <25% FP, it can be seen that sufficient time for operator action exists to initiate feedwater and any bypass setpoint below this value should be a matter of providing sufficient operational flexibility.

For the turbine trip event, the system has sufficient responsiveness such that, at lower power levels (<25%), a reactor trip is not anticipated if the turbine trips. The power level >25% for which the turbine trip-reactor trip may be bypassed is plant specific, and is dependent on the condenser bypass and atmospheric dump valve capacities.

- c. The Oconee 1 transient of 6/11/79 was a reactor startup situation with 1 MFWP reset and not operating. When the operating feedwater pump tripped, the reactor did not automatically trip on loss of feedwater because the low discharge pressure trip on the reset MFWP was not reached prior to the operator manually tripping the plant. There are two important points to be made with respect to the above situation. First of all, a reactor trip based on feed pump operation, such as the proposed safety grade trips will be, would have detected this loss of feedwater event. Secondly, at a startup condition such as this transient occurred at the ARTs would have been bypassed. However, as discussed in response to b. above, there is sufficient operator action time.

It should also be noted that the purpose of ARTs is to decrease the probability of PORV actuation on turbine trip/loss of main feedwater type events. Since it has been demonstrated (1,2) that with a reactor trip of 2300 psig and PORV setpoint >2400 psig, no lifting of the PORV will occur, the addition of ARTs only increase the margin to PORV setpoint pressure.

- d. The Crystal River transient of 8/2/79 was similar to the Oconee transient briefly described in c. above, only the operating pump lost flow slowly and the reactor trip was by automatic control grade trip on low steam generator level instead of a manual trip. The RC pressure rise (~2255 psig at time of trip) would have tripped the plant had the level trip not functioned. As was shown in Response 9b, an ART in this power level is not really needed, although it may indeed trip the plant before the high RC pressure trip.

REFERENCES:

1. B&W Report to the NRC, May 1, 1979, "Evaluation of Transient Behavior and Small Reactor Coolant System Breaks in the 177 Fuel Assembly Plant."
2. Toledo Edison Report to the NRC, May 15, 1979, "Evaluation of Transient Behavior and Small Reactor Coolant System Breaks in the 177 Fuel Assembly Plant, Volume 3."

ATTACHMENT I

NEW SAFETY-GRADE REACTOR
TRIPS FOR RPS-I

CABINET MOUNTED EQUIPMENT FOR ADDITION OF RPS
TRIPS ON LOSS OF MAIN FEEDWATER AND TURBINE TRIP

3 Contact Buffers

2 Bistables

Per Channel

2 Auxiliary Relays

Modules will be installed in a pre-fabricated mounting case and tested as a unit prior to shipment. The mounting case is to be installed in an empty row of each RPS channel and connections made to the RPS wiring.

Trip response time of the RPS cabinet mounted equipment will be ≤ 150 ms.

Isolation of the contact buffer module is 600 volts with the contact input lines not grounded.

Customer contact input requirements:

Continuous 90 ma, P-P

Surge 250 ma, P-P

Voltage 118 VAC

Closed contact indicates pump running

Open contact indicates pump tripped

1132 047

This report describes the implementation of safety-grade reactor trips into the RPS-I for loss of main feedwater and turbine trip.

Loss of Main Feedwater Trip - Control oil pressure switches on both main feedwater pumps will input an open indication to the RPS on feedwater pump trip. Contact buffers in the RPS will sense the contact inputs and initiate an RPS trip when both pumps have tripped. This trip will be bypassed below a predetermined flux level, typically 20% FP. Reference Figure 1.

Turbine Trip - Contact outputs from the main turbine electro-hydraulic control unit will input an open indication to the RPS on turbine trip. Contact buffers in the RPS will sense the contact inputs and initiate an RPS trip when a turbine trip is indicated. This trip will be bypassed below a predetermined flux level, typically 20% FP. Reference Figure 2.


Pressure switches for both trips will be supplied by the customer. B&W will supply all RPS cabinet mounted equipment. Attachment 1 lists the cabinet mounted equipment and gives the trip response time. Attachment 1 also gives the contact buffer isolation voltage and the customer requirements for the contact inputs.

Figure 1 is a simplified drawing of the main feedwater pump trip.

Figure 2 is a simplified drawing of the turbine trip.

Drawing 51079DGB-1 shows the generic logic for the new trips.

Drawing 51079MLG-1 is a legend for the generic logic drawing.

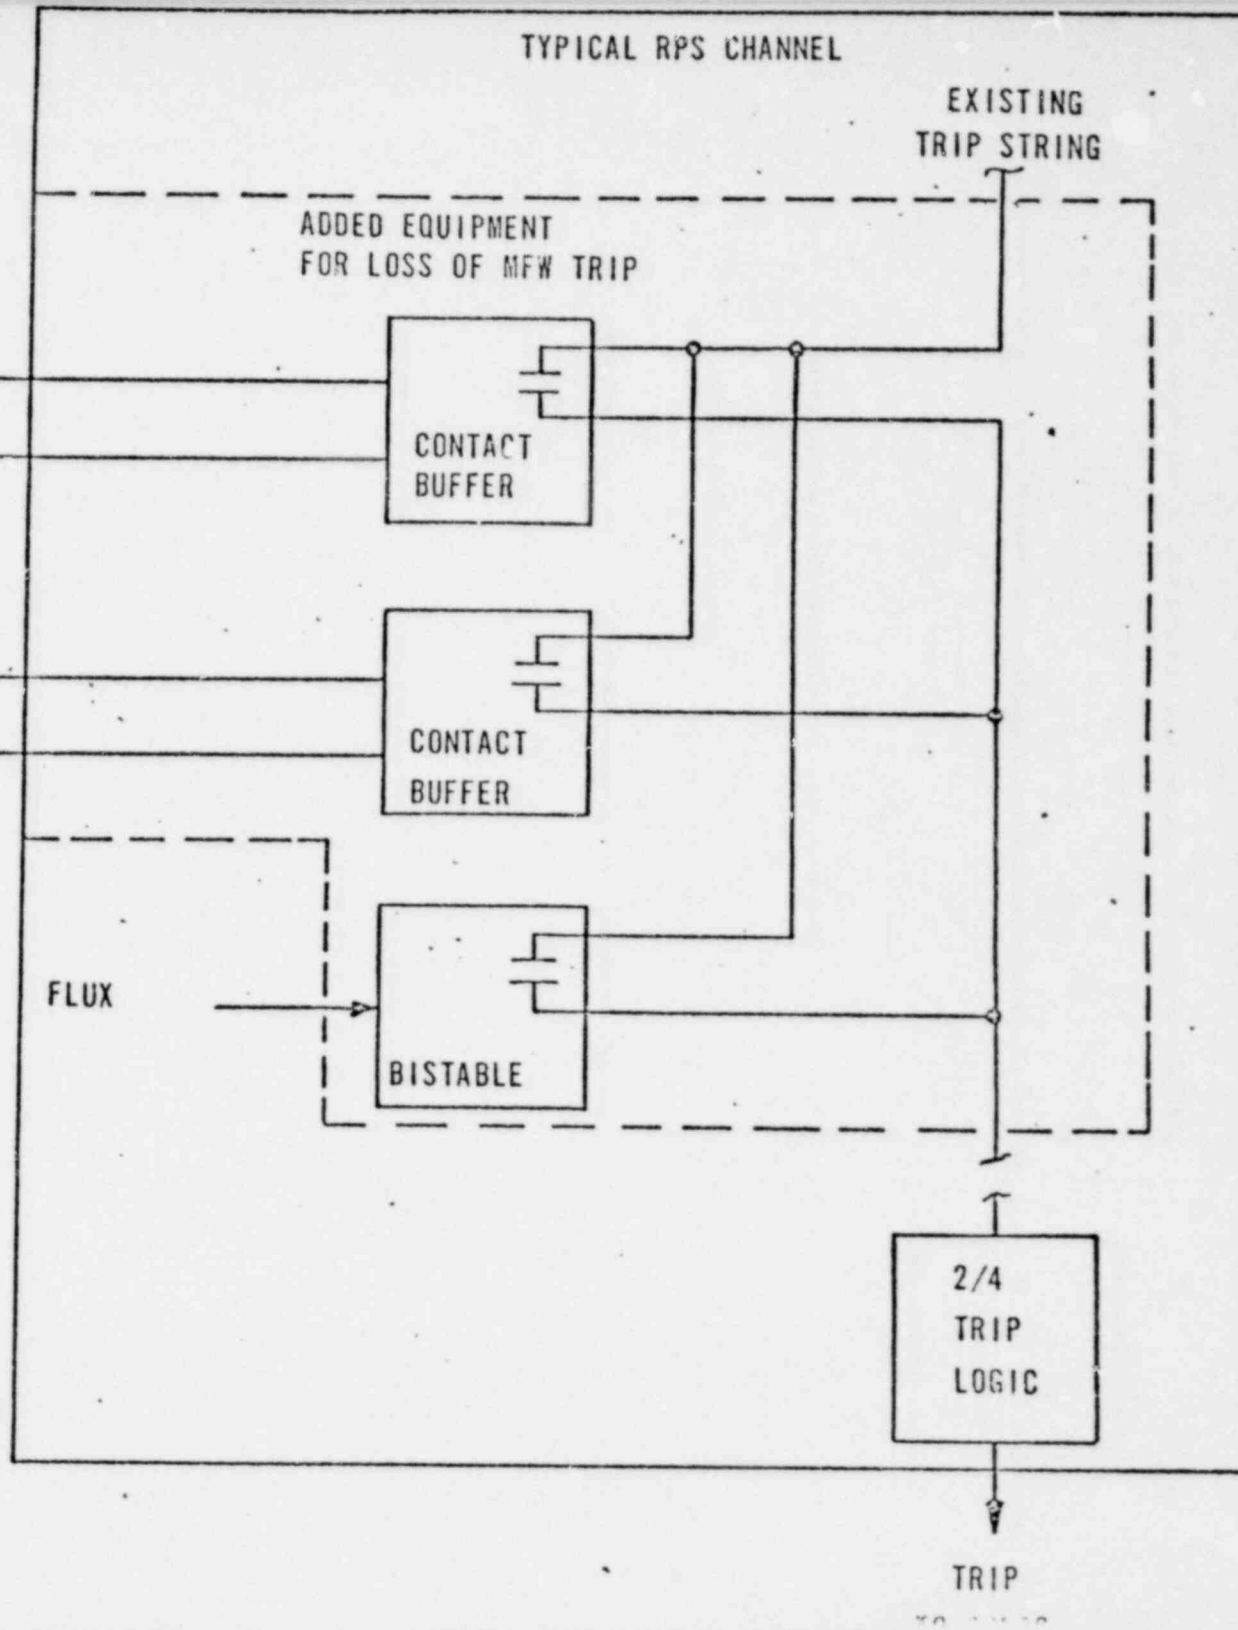


RPS TRIP ON LOSS OF MAIN FEEDWATER
(SIMPLIFIED)


Figure 1

1138 049

1138 050

RPS TRIP ON TURBINE TRIP
(SIMPLIFIED) Figure 2

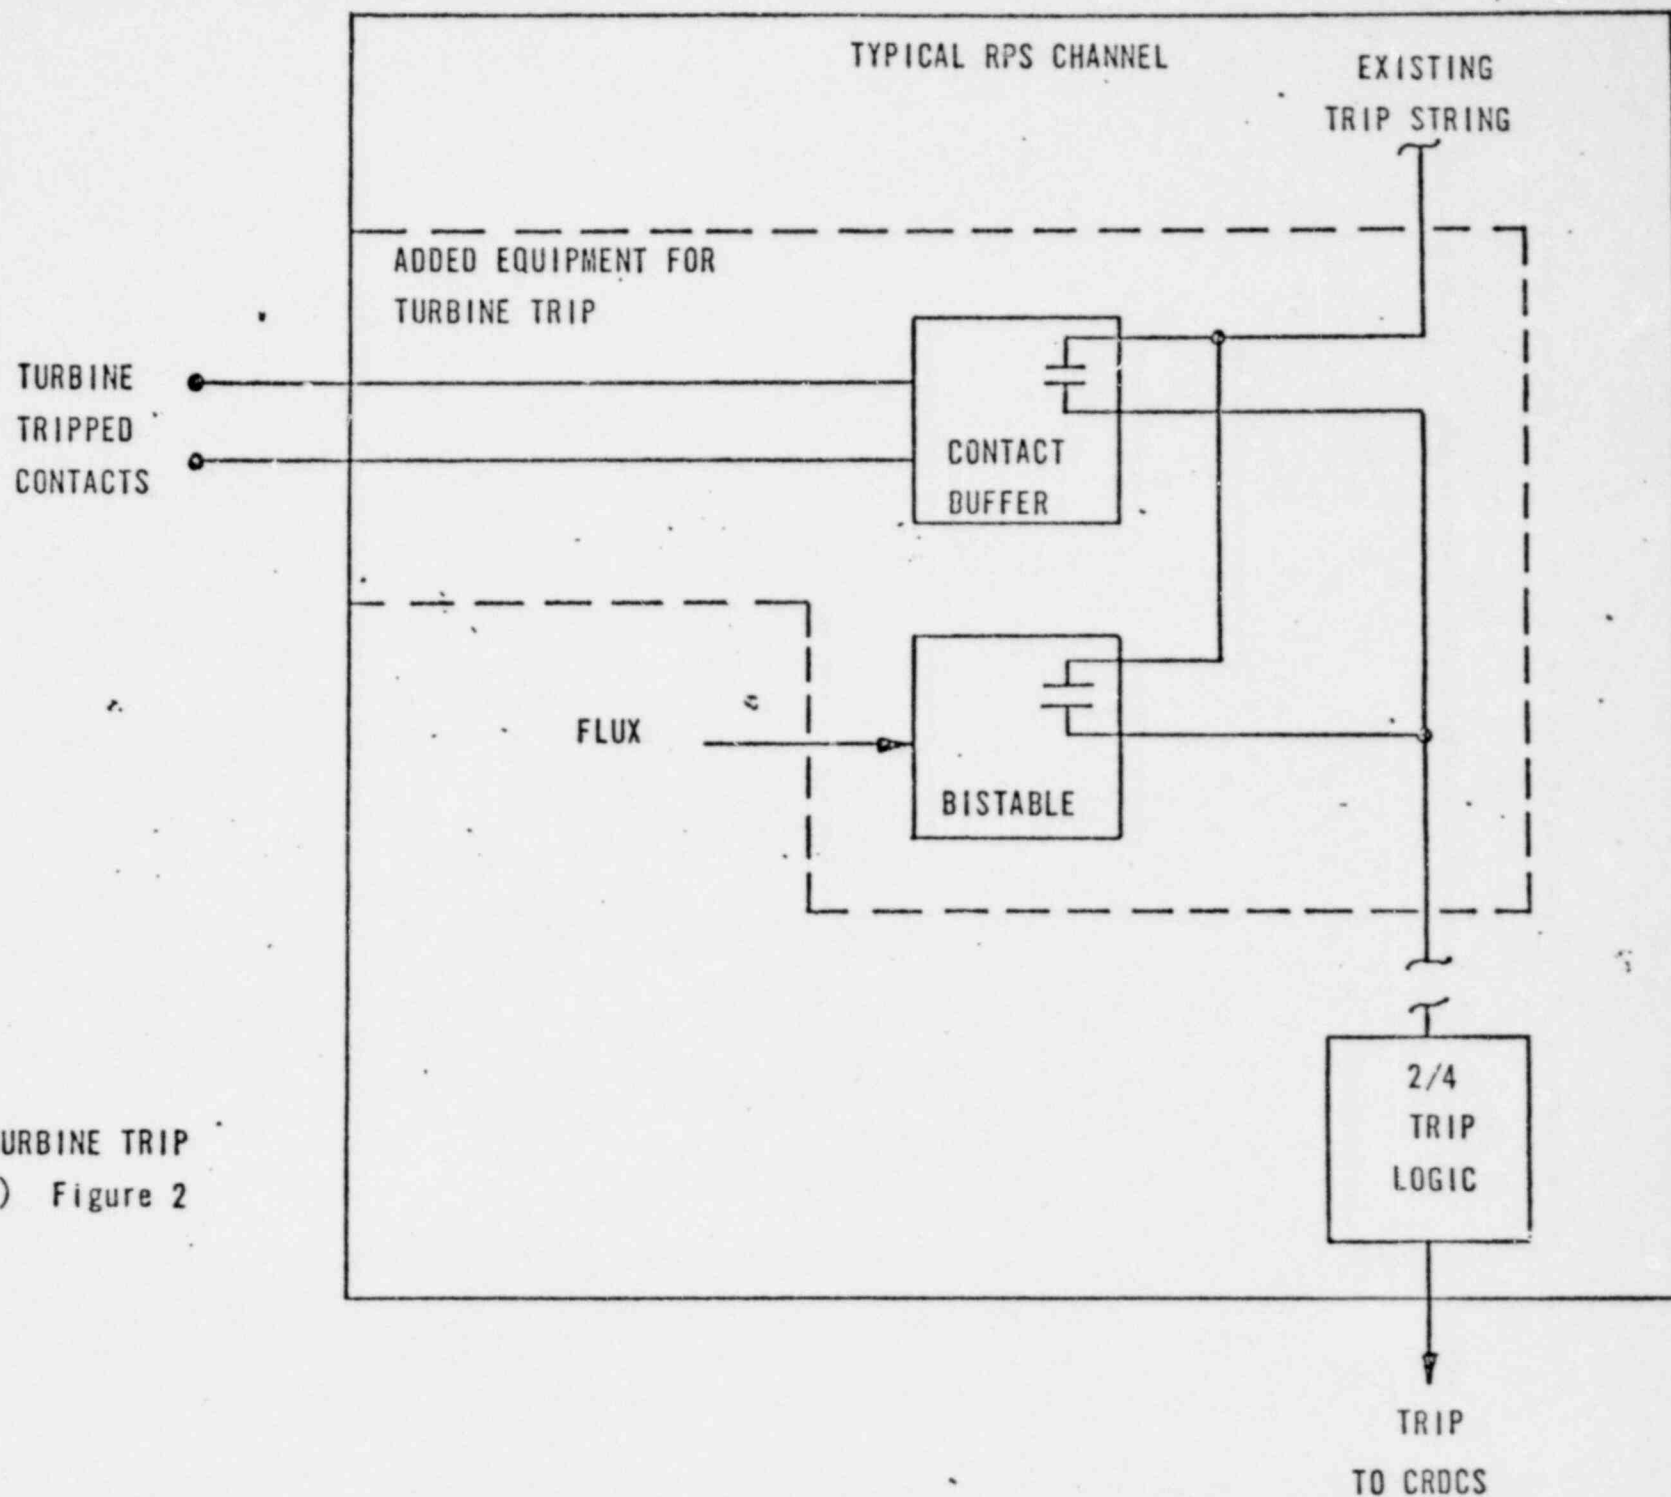

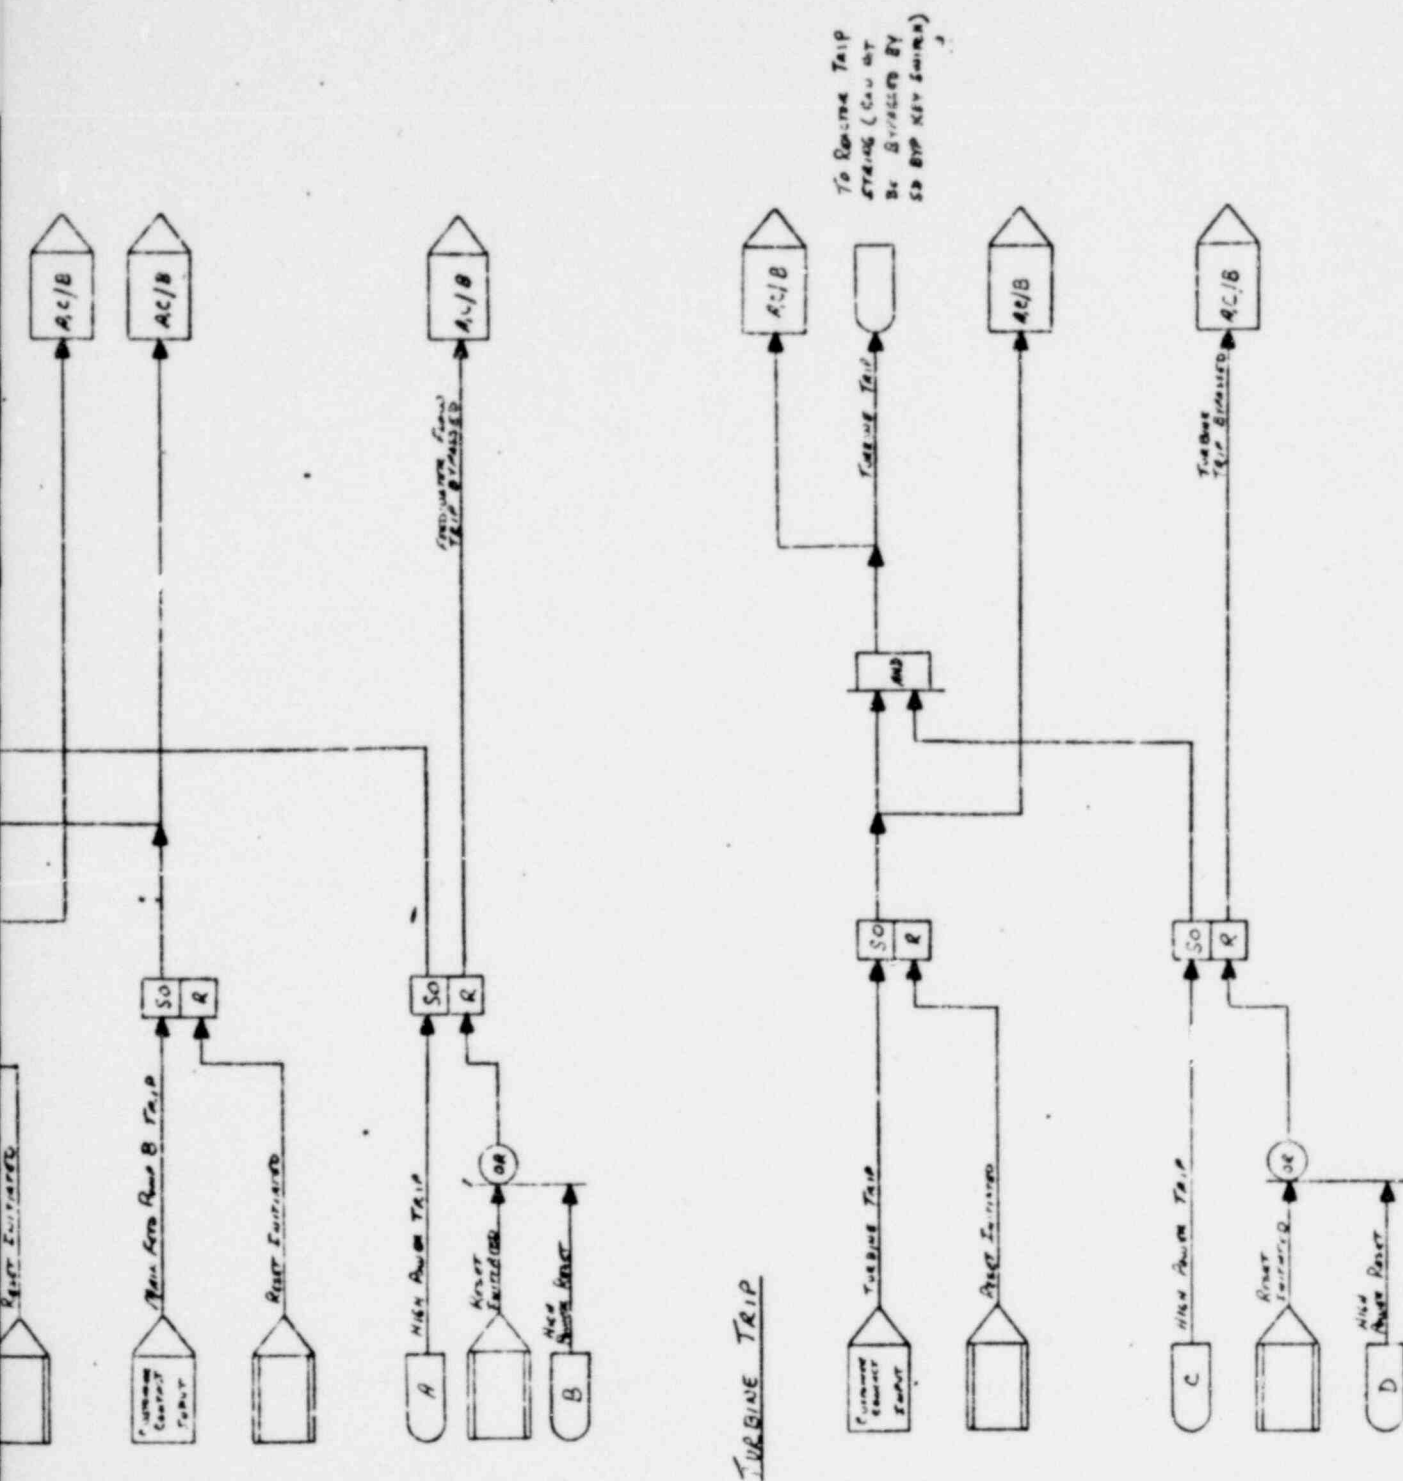

TURBINE TRIP

POOR ORIGINAL

1138 051

GENERAL LOGS
SAFETY GRADE TRIPS

CUSTOMER:
PLANT:
CONTRACTING ENG.:
S.C. CO. JOB NO.:

CUST. ORDER NO.

Babcock & Wilcox
Bailey Controls Company

D 5107926B-

10-000000

THIS DRAWING IS THE PROPERTY OF BAILEY CONTROLS COMPANY. NEITHER THE DRAWING, NOR REPRODUCTIONS OF IT, NOR INFORMATION DERIVED FROM IT IS TO BE GIVEN TO OTHERS. NO USE IS TO BE MADE OF IT WHICH IS NOT IN ACCORDANCE WITH THE POLICY OF BAILEY CONTROLS COMPANY.

958

CHASSIS


2298

●


1

POOR ORIGINAL

ANALOG LOGIC

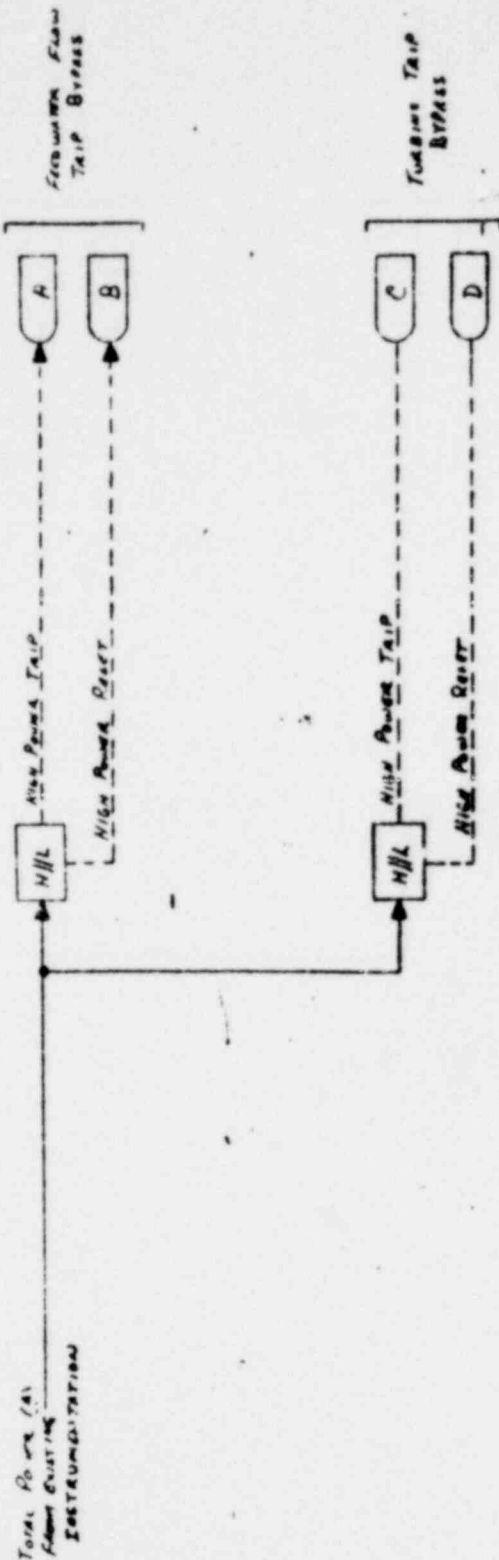

DIGITAL LOGIC

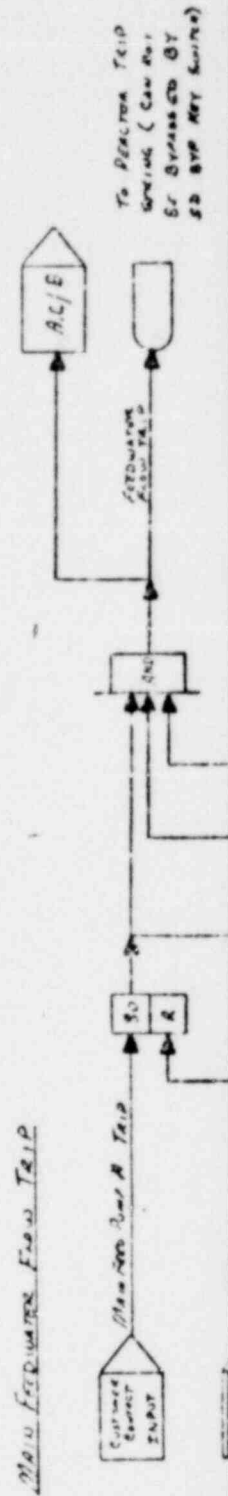

1138 052

POOR ORIGINAL

1138 053

HEATING OF LOCAL POINT

WATER SUPPLY, HEATING

AUTOMATIC SIGNAL WORKING

SYSTEM INPUT
(INPUT IS OTHER SYSTEM TYPE)

SYSTEM INPUT
(INPUT IS OTHER SYSTEM TYPE)

SYSTEM OUTPUT
(INPUT COMMUNICATION TYPE)

SYSTEM INPUT
(INPUT COMMUNICATION TYPE)

BREAK POINT

RESUMPTION POINT

BREAK POINT

HEATING POINT

HEATING

WATER LINE

AND

OR
(EXCLUSIVE)

THE SYMBOL REPRESENTS ACTUAL INPUTS FROM
A LOGIC OUTPUT TO A LOGIC OR ANOTHER
SYSTEM.

THE SYMBOL REPRESENTS ACTUAL INPUTS FROM
AN ACTUAL OUTPUT TO THE LOGIC.

THE SYMBOL DENOTES BREAKS AND RESUMPTIONS
OF SIGNAL LINES ON A SINGLE PAGE OF LOGIC
AND/OR MULTIPLE PAGES OF LOGIC. (ANALOG
LOGIC TO DIGITAL LOGIC DRAWING.)

THE SYMBOL DENOTES BREAKS AND RESUMPTIONS
OF SIGNAL LINES ON A SINGLE PAGE OF LOGIC
AND/OR MULTIPLE PAGES OF LOGIC. (ANALOG
LOGIC TO DIGITAL LOGIC DRAWING.)

THE ABOVE SYMBOL SHOWS DIRECTION OF
FLOW OF A SIGNAL LINE.

THE ABOVE LINE SYMBOL SHOWS ANALOG SIGNAL
LINES OR DIGITAL LOGIC DRAWING OF DIGITAL
SIGNAL LINES ON AN ANALOG LOGIC DRAWING.

THE OUTPUT IS A LOGIC ONE IF ALL OF THE
INPUT SIGNALS ARE LOGIC ONE.

THE OUTPUT IS A LOGIC ONE IF THERE IS ONE
OR MORE LOGIC ONE INPUTS.

TABLE 2

SYMBOLS FOR LOGIC DRAWING

001	SYSTEM INPUT CHAMBER
002	SYSTEM INPUT CHAMBER
003	COMPENSATION CHAMBER
004	COMPENSATION CHAMBER
005	COMPENSATION CHAMBER
006	COMPENSATION CHAMBER
007	COMPENSATION CHAMBER
008	COMPENSATION CHAMBER
009	COMPENSATION CHAMBER
010	COMPENSATION CHAMBER
011	COMPENSATION CHAMBER
012	COMPENSATION CHAMBER
013	COMPENSATION CHAMBER
014	COMPENSATION CHAMBER
015	COMPENSATION CHAMBER
016	COMPENSATION CHAMBER
017	COMPENSATION CHAMBER
018	COMPENSATION CHAMBER
019	COMPENSATION CHAMBER
020	COMPENSATION CHAMBER
021	COMPENSATION CHAMBER
022	COMPENSATION CHAMBER
023	COMPENSATION CHAMBER
024	COMPENSATION CHAMBER
025	COMPENSATION CHAMBER
026	COMPENSATION CHAMBER
027	COMPENSATION CHAMBER
028	COMPENSATION CHAMBER
029	COMPENSATION CHAMBER
030	COMPENSATION CHAMBER
031	COMPENSATION CHAMBER
032	COMPENSATION CHAMBER
033	COMPENSATION CHAMBER
034	COMPENSATION CHAMBER
035	COMPENSATION CHAMBER
036	COMPENSATION CHAMBER
037	COMPENSATION CHAMBER
038	COMPENSATION CHAMBER
039	COMPENSATION CHAMBER
040	COMPENSATION CHAMBER
041	COMPENSATION CHAMBER
042	COMPENSATION CHAMBER
043	COMPENSATION CHAMBER
044	COMPENSATION CHAMBER
045	COMPENSATION CHAMBER
046	COMPENSATION CHAMBER
047	COMPENSATION CHAMBER
048	COMPENSATION CHAMBER
049	COMPENSATION CHAMBER
050	COMPENSATION CHAMBER
051	COMPENSATION CHAMBER
052	COMPENSATION CHAMBER
053	COMPENSATION CHAMBER
054	COMPENSATION CHAMBER
055	COMPENSATION CHAMBER
056	COMPENSATION CHAMBER
057	COMPENSATION CHAMBER
058	COMPENSATION CHAMBER
059	COMPENSATION CHAMBER
060	COMPENSATION CHAMBER
061	COMPENSATION CHAMBER
062	COMPENSATION CHAMBER
063	COMPENSATION CHAMBER
064	COMPENSATION CHAMBER
065	COMPENSATION CHAMBER
066	COMPENSATION CHAMBER
067	COMPENSATION CHAMBER
068	COMPENSATION CHAMBER
069	COMPENSATION CHAMBER
070	COMPENSATION CHAMBER
071	COMPENSATION CHAMBER
072	COMPENSATION CHAMBER
073	COMPENSATION CHAMBER
074	COMPENSATION CHAMBER
075	COMPENSATION CHAMBER
076	COMPENSATION CHAMBER
077	COMPENSATION CHAMBER
078	COMPENSATION CHAMBER
079	COMPENSATION CHAMBER
080	COMPENSATION CHAMBER
081	COMPENSATION CHAMBER
082	COMPENSATION CHAMBER
083	COMPENSATION CHAMBER
084	COMPENSATION CHAMBER
085	COMPENSATION CHAMBER
086	COMPENSATION CHAMBER
087	COMPENSATION CHAMBER
088	COMPENSATION CHAMBER
089	COMPENSATION CHAMBER
090	COMPENSATION CHAMBER
091	COMPENSATION CHAMBER
092	COMPENSATION CHAMBER
093	COMPENSATION CHAMBER
094	COMPENSATION CHAMBER
095	COMPENSATION CHAMBER
096	COMPENSATION CHAMBER
097	COMPENSATION CHAMBER
098	COMPENSATION CHAMBER
099	COMPENSATION CHAMBER
100	COMPENSATION CHAMBER

001	SYSTEM INPUT CHAMBER
002	SYSTEM INPUT CHAMBER
003	COMPENSATION CHAMBER
004	COMPENSATION CHAMBER
005	COMPENSATION CHAMBER
006	COMPENSATION CHAMBER
007	COMPENSATION CHAMBER
008	COMPENSATION CHAMBER
009	COMPENSATION CHAMBER
010	COMPENSATION CHAMBER
011	COMPENSATION CHAMBER
012	COMPENSATION CHAMBER
013	COMPENSATION CHAMBER
014	COMPENSATION CHAMBER
015	COMPENSATION CHAMBER
016	COMPENSATION CHAMBER
017	COMPENSATION CHAMBER
018	COMPENSATION CHAMBER
019	COMPENSATION CHAMBER
020	COMPENSATION CHAMBER
021	COMPENSATION CHAMBER
022	COMPENSATION CHAMBER
023	COMPENSATION CHAMBER
024	COMPENSATION CHAMBER
025	COMPENSATION CHAMBER
026	COMPENSATION CHAMBER
027	COMPENSATION CHAMBER
028	COMPENSATION CHAMBER
029	COMPENSATION CHAMBER
030	COMPENSATION CHAMBER
031	COMPENSATION CHAMBER
032	COMPENSATION CHAMBER
033	COMPENSATION CHAMBER
034	COMPENSATION CHAMBER
035	COMPENSATION CHAMBER
036	COMPENSATION CHAMBER
037	COMPENSATION CHAMBER
038	COMPENSATION CHAMBER
039	COMPENSATION CHAMBER
040	COMPENSATION CHAMBER
041	COMPENSATION CHAMBER
042	COMPENSATION CHAMBER
043	COMPENSATION CHAMBER
044	COMPENSATION CHAMBER
045	COMPENSATION CHAMBER
046	COMPENSATION CHAMBER
047	COMPENSATION CHAMBER
048	COMPENSATION CHAMBER
049	COMPENSATION CHAMBER
050	COMPENSATION CHAMBER
051	COMPENSATION CHAMBER
052	COMPENSATION CHAMBER
053	COMPENSATION CHAMBER
054	COMPENSATION CHAMBER
055	COMPENSATION CHAMBER
056	COMPENSATION CHAMBER
057	COMPENSATION CHAMBER
058	COMPENSATION CHAMBER
059	COMPENSATION CHAMBER
060	COMPENSATION CHAMBER
061	COMPENSATION CHAMBER
062	COMPENSATION CHAMBER
063	COMPENSATION CHAMBER
064	COMPENSATION CHAMBER
065	COMPENSATION CHAMBER
066	COMPENSATION CHAMBER
067	COMPENSATION CHAMBER
068	COMPENSATION CHAMBER
069	COMPENSATION CHAMBER
070	COMPENSATION CHAMBER
071	COMPENSATION CHAMBER
072	COMPENSATION CHAMBER
073	COMPENSATION CHAMBER
074	COMPENSATION CHAMBER
075	COMPENSATION CHAMBER
076	COMPENSATION CHAMBER
077	COMPENSATION CHAMBER
078	COMPENSATION CHAMBER
079	COMPENSATION CHAMBER
080	COMPENSATION CHAMBER
081	COMPENSATION CHAMBER
082	COMPENSATION CHAMBER
083	COMPENSATION CHAMBER
084	COMPENSATION CHAMBER
085	COMPENSATION CHAMBER
086	COMPENSATION CHAMBER
087	COMPENSATION CHAMBER
088	COMPENSATION CHAMBER
089	COMPENSATION CHAMBER
090	COMPENSATION CHAMBER
091	COMPENSATION CHAMBER
092	COMPENSATION CHAMBER
093	COMPENSATION CHAMBER
094	COMPENSATION CHAMBER
095	COMPENSATION CHAMBER
096	COMPENSATION CHAMBER
097	COMPENSATION CHAMBER
098	COMPENSATION CHAMBER
099	COMPENSATION CHAMBER
100	COMPENSATION CHAMBER

TABLE 3

SYMBOLS FOR LOGIC DRAWING

Σ	SUMMING	THE OUTPUT EQUALS THE ALGEBRAIC SUM OF THE INPUTS.
Δ	DIFFERENCE	THE OUTPUT EQUALS THE ALGEBRAIC DIFFERENCE BETWEEN THE TWO INPUTS.
K	PROPORTIONAL	THE OUTPUT IS PROPORTIONAL TO THE INPUT.
d/dt	DERIVATIVE	THE OUTPUT IS PROPORTIONAL TO THE RATE OF CHANGE (DERIVATIVE) OF THE INPUT.
∫	ROOT EXTRACTION	THE OUTPUT EQUALS THE ROOT (1/2, 1/3, 1/4, 1/5, 1/6, 1/7, 1/8, 1/9, 1/10, 1/11, 1/12, 1/13, 1/14, 1/15, 1/16, 1/17, 1/18, 1/19, 1/20, 1/21, 1/22, 1/23, 1/24, 1/25, 1/26, 1/27, 1/28, 1/29, 1/30, 1/31, 1/32, 1/33, 1/34, 1/35, 1/36, 1/37, 1/38, 1/39, 1/40, 1/41, 1/42, 1/43, 1/44, 1/45, 1/46, 1/47, 1/48, 1/49, 1/50, 1/51, 1/52, 1/53, 1/54, 1/55, 1/56, 1/57, 1/58, 1/59, 1/60, 1/61, 1/62, 1/63, 1/64, 1/65, 1/66, 1/67, 1/68, 1/69, 1/70, 1/71, 1/72, 1/73, 1/74, 1/75, 1/76, 1/77, 1/78, 1/79, 1/80, 1/81, 1/82, 1/83, 1/84, 1/85, 1/86, 1/87, 1/88, 1/89, 1/90, 1/91, 1/92, 1/93, 1/94, 1/95, 1/96, 1/97, 1/98, 1/99, 1/100, 1/101, 1/102, 1/103, 1/104, 1/105, 1/106, 1/107, 1/108, 1/109, 1/110, 1/111, 1/112, 1/113, 1/114, 1/115, 1/116, 1/117, 1/118, 1/119, 1/120, 1/121, 1/122, 1/123, 1/124, 1/125, 1/126, 1/127, 1/128, 1/129, 1/130, 1/131, 1/132, 1/133, 1/134, 1/135, 1/136, 1/137, 1/138, 1/139, 1/140, 1/141, 1/142, 1/143, 1/144, 1/145, 1/146, 1/147, 1/148, 1/149, 1/150, 1/151, 1/152, 1/153, 1/154, 1/155, 1/156, 1/157, 1/158, 1/159, 1/160, 1/161, 1/162, 1/163, 1/164, 1/165, 1/166, 1/167, 1/168, 1/169, 1/170, 1/171, 1/172, 1/173, 1/174, 1/175, 1/176, 1/177, 1/178, 1/179, 1/180, 1/181, 1/182, 1/183, 1/184, 1/185, 1/186, 1/187, 1/188, 1/189, 1/190, 1/191, 1/192, 1/193, 1/194, 1/195, 1/196, 1/197, 1/198, 1/199, 1/200, 1/201, 1/202, 1/203, 1/204, 1/205, 1/206, 1/207, 1/208, 1/209, 1/210, 1/211, 1/212, 1/213, 1/214, 1/215, 1/216, 1/217, 1/218, 1/219, 1/220, 1/221, 1/222, 1/223, 1/224, 1/225, 1/226, 1/227, 1/228, 1/229, 1/230, 1/231, 1/232, 1/233, 1/234, 1/235, 1/236, 1/237, 1/238, 1/239, 1/240, 1/241, 1/242, 1/243, 1/244, 1/245, 1/246, 1/247, 1/248, 1/249, 1/250, 1/251, 1/252, 1/253, 1/254, 1/255, 1/256, 1/257, 1/258, 1/259, 1/260, 1/261, 1/262, 1/263, 1/264, 1/265, 1/266, 1/267, 1/268, 1/269, 1/270, 1/271, 1/272, 1/273, 1/274, 1/275, 1/276, 1/277, 1/278, 1/279, 1/280, 1/281, 1/282, 1/283, 1/284, 1/285, 1/286, 1/287, 1/288, 1/289, 1/290, 1/291, 1/292, 1/293, 1/294, 1/295, 1/296, 1/297, 1/298, 1/299, 1/300, 1/301, 1/302, 1/303, 1/304, 1/305, 1/306, 1/307, 1/308, 1/309, 1/310, 1/311, 1/312, 1/313, 1/314, 1/315, 1/316, 1/317, 1/318, 1/319, 1/320, 1/321, 1/322, 1/323, 1/324, 1/325, 1/326, 1/327, 1/328, 1/329, 1/330, 1/331, 1/332, 1/333, 1/334, 1/335, 1/336, 1/337, 1/338, 1/339, 1/340, 1/341, 1/342, 1/343, 1/344, 1/345, 1/346, 1/347, 1/348, 1/349, 1/350, 1/351, 1/352, 1/353, 1/354, 1/355, 1/356, 1/357, 1/358, 1/359, 1/360, 1/361, 1/362, 1/363, 1/364, 1/365, 1/366, 1/367, 1/368, 1/369, 1/370, 1/371, 1/372, 1/373, 1/374, 1/375, 1/376, 1/377, 1/378, 1/379, 1/380, 1/381, 1/382, 1/383, 1/384, 1/385, 1/386, 1/387, 1/388, 1/389, 1/390, 1/391, 1/392, 1/393, 1/394, 1/395, 1/396, 1/397, 1/398, 1/399, 1/400, 1/401, 1/402, 1/403, 1/404, 1/405, 1/406, 1/407, 1/408, 1/409, 1/410, 1/411, 1/412, 1/413, 1/414, 1/415, 1/416, 1/417, 1/418, 1/419, 1/420, 1/421, 1/422, 1/423, 1/424, 1/425, 1/426, 1/427, 1/428, 1/429, 1/430, 1/431, 1/432, 1/433, 1/434, 1/435, 1/436, 1/437, 1/438, 1/439, 1/440, 1/441, 1/442, 1/443, 1/444, 1/445, 1/446, 1/447, 1/448, 1/449, 1/450, 1/451, 1/452, 1/453, 1/454, 1/455, 1/456, 1/457, 1/458, 1/459, 1/460, 1/461, 1/462, 1/463, 1/464, 1/465, 1/466, 1/467, 1/468, 1/469, 1/470, 1/471, 1/472, 1/473, 1/474, 1/475, 1/476, 1/477, 1/478, 1/479, 1/480, 1/481, 1/482, 1/483, 1/484, 1/485, 1/486, 1/487, 1/488, 1/489, 1/490, 1/491, 1/492, 1/493, 1/494, 1/495, 1/496, 1/497, 1/498, 1/499, 1/500, 1/501, 1/502, 1/503, 1/504, 1/505, 1/506, 1/507, 1/508, 1/509, 1/510, 1/511, 1/512, 1/513, 1/514, 1/515, 1/516, 1/517, 1/518, 1/519, 1/520, 1/521, 1/522, 1/523, 1/524, 1/525, 1/526, 1/527, 1/528, 1/529, 1/530, 1/531, 1/532, 1/533, 1/534, 1/535, 1/536, 1/537, 1/538, 1/539, 1/540, 1/541, 1/542, 1/543, 1/544, 1/545, 1/546, 1/547, 1/548, 1/549, 1/550, 1/551, 1/552, 1/553, 1/554, 1/555, 1/556, 1/557, 1/558, 1/559, 1/560, 1/561, 1/562, 1/563, 1/564, 1/565, 1/566, 1/567, 1/568, 1/569, 1/570, 1/571, 1/572, 1/573, 1/574, 1/575, 1/576, 1/577, 1/578, 1/579, 1/580, 1/581, 1/582, 1/583, 1/584, 1/585, 1/586, 1/587, 1/588, 1/589, 1/590, 1/591, 1/592, 1/593, 1/594, 1/595, 1/596, 1/597, 1/598, 1/599, 1/600, 1/601, 1/602, 1/603, 1/604, 1/605, 1/606, 1/607, 1/608, 1/609, 1/610, 1/611, 1/612, 1/613, 1/614, 1/615, 1/616, 1/617, 1/618, 1/619, 1/620, 1/621, 1/622, 1/623, 1/624, 1/625, 1/626, 1/627, 1/628, 1/629, 1/630, 1/631, 1/632, 1/633, 1/634, 1/635, 1/636, 1/637, 1/638, 1/639, 1/640, 1/641, 1/642, 1/643, 1/644, 1/645, 1/646, 1/647, 1/648, 1/649, 1/650, 1/651, 1/652, 1/653, 1/654, 1/655, 1/656, 1/657, 1/658, 1/659, 1/660, 1/661, 1/662, 1/663, 1/664, 1/665, 1/666, 1/667, 1/668, 1/669, 1/670, 1/671, 1/672, 1/673, 1/674, 1/675, 1/676, 1/677, 1/678, 1/679, 1/680, 1/681, 1/682, 1/683, 1/684, 1/685, 1/686, 1/687, 1/688, 1/689, 1/690, 1/691, 1/692, 1/693, 1/694, 1/695, 1/696, 1/697, 1/698, 1/699, 1/700, 1/701, 1/702, 1/703, 1/704, 1/705, 1/706, 1/707, 1/708, 1/709, 1/710, 1/711, 1/712, 1/713, 1/714, 1/715, 1/716, 1/717, 1/718, 1/719, 1/720, 1/721, 1/722, 1/723, 1/724, 1/725, 1/726, 1/727, 1/728, 1/729, 1/730, 1/731, 1/732, 1/733, 1/734, 1/735, 1/736, 1/737, 1/738, 1/739, 1/740, 1/741, 1/742, 1/743, 1/744, 1/745, 1/746, 1/747, 1/748, 1/749, 1/750, 1/751, 1/752, 1/753, 1/754, 1/755, 1/756, 1/757, 1/758, 1/759, 1/760, 1/761, 1/762, 1/763, 1/764, 1/765, 1/766, 1/767, 1/768, 1/769, 1/770, 1/771, 1/772, 1/773, 1/774, 1/775, 1/776, 1/777, 1/778, 1/779, 1/780, 1/781, 1/782, 1/783, 1/784, 1/785, 1/786, 1/787, 1/788, 1/789, 1/790, 1/791, 1/792, 1/793, 1/794, 1/795, 1/796, 1/797, 1/798, 1/799, 1/800, 1/801, 1/802, 1/803, 1/804, 1/805, 1/806, 1/807, 1/808, 1/809, 1/810, 1/811, 1/812, 1/813, 1/814, 1/815, 1/816, 1/817, 1/818, 1/819, 1/820, 1/821, 1/822, 1/823, 1/824, 1/825, 1/826, 1/827, 1/8

ATTACHMENT II

SEISMIC AND ENVIRONMENTAL
SUMMARY REPORTS

1138 055

Equipment: The Bailey Controls Company Solid State Bistable module P/N 6628492A1 was environmentally tested providing type test data. The Solid State Bistable is a standard 2-unit-wide module designed for plug-in mounting.

Brief Summary of Test Results: Tests were performed to verify that the performance characteristics of the Solid State Bistable Module qualify it for use in a Nuclear Power Generating Facility. The test unit failed to meet the acceptance criteria for output load voltages during humidity effect testing. Engineering replaced a reference amplifier. Upon retest, the module met specified acceptance criteria. Based on the test data, the Solid State Bistable meeting all the design range requirements.

1138 057

Test title sequence	Set up conditions	Environment conditions	Acceptance criteria	Units tested	Units acceptable
<u>Solid State Bistable</u>					
1. Repeatability of set point trip conditions	a. Normal input/output configuration b. Power supplies $\pm 15V$ dc, $\pm 5\%$ c. Load: 3K ohms	Standard test conditions Temperature: $75^{\circ}F \pm .5\%$ Humidity: $50\% \pm 20\%$ RH	$<0.02\%$ set point span	2	2
2. Power supply effect	Same as test No. 1 except power supplies: ± 15 dc with $\pm 1\%$ varia- tion from references repeated using $\pm 5\%$ variations	Standard test conditions	For $\pm 1\%$ variation $<0.02\%$ set point span For $\pm 5\%$ variation $<0.1\%$ set point span	2	2
3. Ambient temperature effect	Same as test No. 1 except set internal set point to 8.00 V dc and apply external set point voltage	Temperature: $40^{\circ}F$ to $140^{\circ}F$ Humidity: RH $<50\%$	For $40^{\circ}F$ to $140^{\circ}F$ Trip point accuracy $<0.1\%$ set point span shift Response Time: >32 ms-low lvl contact volt. $<0.5V$ dc High lvl contact volt. $<2.0V$ dc	2	2
4. Ambient relative humidity effect	Same as temperature tests	Temperature: $110^{\circ}F$ Humidity: 80% RH for 96 h 90% RH for 24 h	Trip point accy: $<0.1\%$ set point span chge in internal set point $<0.1\%$ low lvl con- tact $<0.5V$ dc-hi lvl con- tact $<2.0V$ dc Response Time: <32 ms	2	2
5. Drift, long term (30 day)	Same as test No. 1 except setpoint ad- justed to 9.00V dc	Standard test conditions	Change in trip accuracy $<0.07\%$ setpoint span	2	2

Equipment: The Bailey Controls Company Solid State Bistable Module, P/N 6628492A1, was seismically tested providing type test data.

Test Mounting: The Solid State Bistable Module was mounted in a standard Module Mounting Case with backplate. A standard 32-blue ribbon connector was utilized to interface the module with the signal source. The standard Module Mounting Case was then securely attached to the Seismic Test Mounting Box. The Seismic Test Mounting Box was attached to the Qualification Test Lab 45° Biaxial Test Table. The use of the 45° Biaxial Table results in equal horizontal and vertical components. Electrical interface, hardware, and mounting were equivalent to field installation.

Seismic Testing:

Exploratory Testing: The resonant survey consisted of a sinusoidal vibration input of 0.2 g's vertical peak acceleration at frequencies from 1 to 35 Hz and back to 1 Hz. The resonant survey was conducted at a sweep rate of 1 octave/minute. The constant input was applied to the 45° Biaxial Table and continuously monitored.

Proof Testing: A biaxial multifrequency excitation was applied to the Solid State Bistable for a period of 30 seconds. Each 30-second event consisted of dependent biaxial pseudorandom excitation. The random input frequencies were adjusted in 1/3-octave bandwidths until the Test Response Spectrum (TRS) enveloped the Required Response Spectrum (RRS) within the limits of the biaxial table displacement. A damping of 5 percent (Q of 10) was utilized for the control accelerometer in testing. The TRS did not envelope the RRS (below 6.0 Hz worst case) in the low-frequency range. No resonant frequencies exist in the range not enveloped during test; therefore, this is an acceptable deviation.

Test Monitoring:

Seismic: The Solid State Bistable Module was monitored with accelerometers through appropriate signal conditioning to determine its mechanical response. The location of the monitoring accelerometers is delineated in the seismic report. The control accelerometer was mounted directly to the biaxial test table for controlled input.

Electrical: The unit's outputs were monitored and documented on a strip chart recorder during these events.

Brief Summary of Test Results: The Solid State Bistable Module was within the specifications cited in the module test procedure acceptance criteria section during and after the SSE tests. Consequently, the Solid State Bistable Modules are considered qualified for nuclear applications.

Specified Features Demonstrated by Test: The purpose of this test was to satisfy seismic level testing requirements before, during, and after test of the Solid State Bistable.

Module functional operability and solid-state relay state were maintained throughout the exploratory and seismic events.

Structural integrity of enclosures was maintained.

1138 058

Equipment: The Bailey Controls Company Contract Buffer, P/N 6628908A1 was environmentally tested providing type test data.

The Contact Buffer module is a 2-unit-wide module designed for plug-in mounting. Electrical connections are made through a standard 32-pin Blue Ribbon connector at the rear of the module. The vital bus uses a separate plug-in connector.

Brief Summary of Test Results: Tests were performed to verify that the performance characteristics of the Contact Buffer module qualify it for use in a Nuclear Power Generating Facility.

Based on the test data, the Contact Buffer module meets all the design range requirements.

Type Test Justification: Because of the nature of application, this product consists of various types, versions, or ranges. A worst case representative sampling has been tested by BCCo Qualification Test Laboratory to verify that this product performs the required functions within the required operating and environmental conditions.

<u>Part Number</u>	<u>Nature of Difference</u>
6628908A2	Variation of Frontplate Silkscreening

Contact Buffer

<u>Test title sequence</u>	<u>Set up conditions</u>	<u>Environment conditions</u>	<u>Acceptance criteria</u>	<u>Units Tested</u>	<u>Units acceptable</u>
1. Functional test	a. Normal input/output configuration b. Power supply: 118 V ac c. Load	Standard test conditions Temperature: $75^{\circ}\text{F} \pm 5^{\circ}\text{F}$ Humidity: $50\% \pm 20\% \text{ RH}$	No faulty operation	2	2
2. Power supply effect	Same as test No. 1 except power supplies: Minimum: 105 V ac Maximum: 130 V ac	Standard test conditions	Same as test No. 1	2	2
3. Ambient tempera- ture	Same as test No. 1 for function test Vac = 106 for re- sponse time test	Temperature: 40°F to 140°F Humidity: RH $<50\%$	No fault operation for function test. $<12 \text{ ms.}$ for response time test	2	2
4. Ambient relative humidity effect	Same as test No. 3	Temperature: 110°F Humidity: 80% RH for 96 h 90% RH for 24 h	Same as test No. 3	2	2
5. Drift, long term (30 day)	Same as test No. 1 with both relays energized during drift test	Standard test conditions	Relays do not change state during drift period	2	2

1138 060

Equipment: The Bailey Controls Company Contact Buffer Module, P/N 6628908A1, was seismically tested providing type test data.

Test Mounting: The Contact Buffer Module was mounted in a standard Module Mounting Case with backplate. A standard 32-pin blue ribbon connector and a separate standard 2-prong connector for the vital bus were utilized to interface the module with the signal source. The standard Module Mounting Case was then securely attached to the Seismic Test Mounting Box. The Seismic Test Mounting Box was attached to the Qualification Test Lab 45° Biaxial Test Table. The use of the 45° Biaxial Table results in equal horizontal and vertical components. Electrical interface, hardware, and mounting were equivalent to field installation.

Seismic Testing:

Exploratory Testing: The resonant survey consisted of a sinusoidal vibration input of 0.2 g's vertical peak acceleration at frequencies from 1 to 35 Hz and back to 1 Hz. The resonant survey was conducted at a sweep rate of 1 octave/minute. The constant input was applied to the 45° Biaxial Table and continuously monitored.

Proof Testing: A biaxial multifrequency excitation was applied to the Contact Buffer Module for a period of 30 seconds. Each 30-second event consisted of dependent biaxial pseudorandom excitation. The random input frequencies were adjusted in 1/3-octave bandwidths until the Test Response Spectrum (TRS) enveloped the Required Response Spectrum (RRS) within the limits of the biaxial table displacement. A damping of 5 percent (Q of 10) was utilized for the control accelerometer in testing. The TRS did not envelope the RRS (below 5.0 Hz worst case) in the low-frequency range. No resonant frequencies exist in the range not enveloped during test; therefore, this is an acceptable deviation.

Test Monitoring:

Seismic: The Contact Buffer was monitored with accelerometers through appropriate signal conditioning to determine its mechanical response. The location of the monitoring accelerometers is delineated in the seismic report. The control accelerometer was mounted directly to the biaxial test table for controlled input.

Electrical: The unit's outputs were monitored by chatter detectors per MIL-STD-202D, Method 310.

Results: The Contact Buffer was within the specifications cited in the module test procedure acceptance criteria section during and after the SSE tests. Consequently, the Contact Buffer Modules are considered qualified for nuclear applications.

Specified Features Demonstrated by Test: The purpose of this test was to satisfy seismic level testing requirements before, during, and after test of the Contact Buffer. Module functional operability and predetermined relay state were maintained throughout the exploratory and seismic events. Structural integrity of enclosures was maintained.

1138 061

Equipment: The Bailey Controls Company Auxiliary Relay, P/N 6628807
B1 was environmentally tested providing type test data. The Auxiliary Relay Module is a 2-unit-wide module designed for plug-in mounting.

Brief Summary of Test Results: Tests were performed to verify that the performance characteristics of the Auxiliary Relay qualify it for use in a Nuclear Power Generating Facility. Based on the test data, the Auxiliary Relay meets all the design range requirements.

Auxiliary Relay P/N 6628807 B1

<u>Test title sequence</u>	<u>Set up conditions</u>	<u>Environment conditions</u>	<u>Acceptance criteria</u>	<u>Unit tested</u>	<u>Units acceptable</u>
1. Functional verification	a. Normal input/output configuration b. Power supplies -15 V dc c. Load: none	Standard test conditions Temperature: $75^{\circ}\text{F} \pm 5^{\circ}\text{F}$ Humidity: $50\% \pm 20\%$ RH	Proper operation of relays	1	1
2. Power supply effect (DC)	Same as test No. 1 except power supplies: from -13.5 V dc to -16.5 V dc	Standard test conditions	Same as test 1	1	1
3. Ambient temperature effect	Same as test No. 1	Temperature: 40°F to 140°F Humidity: RH $\leq 50\%$	Same as test 1	1	1
4. Ambient relative humidity effect	Same as test No. 1	Temperature: 110°F Humidity: 80% RH for 96 h 90% RH for 24 h	Same as test 1	1	1
5. Drift, long term (30 day)	Same as test No. 1	Standard test conditions	Same as test 1	1	1

1138 063

Equipment: The Bailey Controls Company Auxiliary Relay, P/N 6628807B1, was seismically tested providing type test data.

Test Mounting: The Auxiliary Relay Module was mounted in a standard Module Mounting Case with backplate. Two standard 32-pin blue ribbon connectors were utilized to interface the module with the voltage source. The standard Module Mounting Case was then securely attached to the Seismic Test Mounting Box. The Seismic Test Mounting Box was attached to the Qualification Test Lab 45° Biaxial Test Table. The use of the 45° Biaxial Table results in equal horizontal and vertical components. Electrical interface, hardware, and mounting were equivalent to field installation.

Seismic Test:

Exploratory Testing: The resonant survey consisted of a sinusoidal vibration input of 0.2 g's vertical peak acceleration at frequencies from 1 to 35 Hz and back to 1 Hz. The resonant survey was conducted at a sweep rate of 1 octave/minute. The constant input was applied to the 45° Biaxial Table and continuously monitored.

Proof Testing: A biaxial multifrequency excitation was applied to the Auxiliary Relay Module for a period of 30 seconds. Each 30-second event consisted of dependent biaxial pseudorandom excitation. The random input frequencies were adjusted in 1/3 octave bandwidths until the Test Response Spectrum (TRS) enveloped the Required Response Spectrum (RRS) within the limits of the biaxial table displacement. A damping of 5 percent (Q of 10) was utilized for the control accelerometer in testing. The TRS did not envelope the RRS (below 7.0 Hz worst case) in the lowfrequency range. No resonant frequencies exist in the range not enveloped during test; therefore, this is an acceptable deviation.

Test Monitoring:

Seismic: The Auxiliary Relay Module was monitored with accelerometers through appropriate signal conditioning to determine its mechanical response. The location of the monitoring accelerometers is delineated in the seismic report. The control accelerometer was mounted directly to the biaxial test table for controlled input.

Electrical: The unit's outputs were monitored with chatter detectors per MIL-STD-202D, Method 310 during these events.


Brief Summary of Test Results: The Auxiliary Relay Module was within the specifications cited in the module test procedure acceptance criteria section during and after the SSE tests. Consequently, the Auxiliary Relays are considered qualified for nuclear applications.

Specified Features Demonstrated by Test: The purpose of this test was to satisfy seismic level testing requirements before, during, and after test of the Auxiliary Relay Module.

Module functional operability and predetermined relay state were maintained throughout the exploratory and seismic events.

1138 064

CHANGE IN REACTOR COOLANT SYSTEM
PRESSURE VS TIME TO TRIP FOR
A LOSS OF MAIN FEEDWATER
FROM 100% POWER

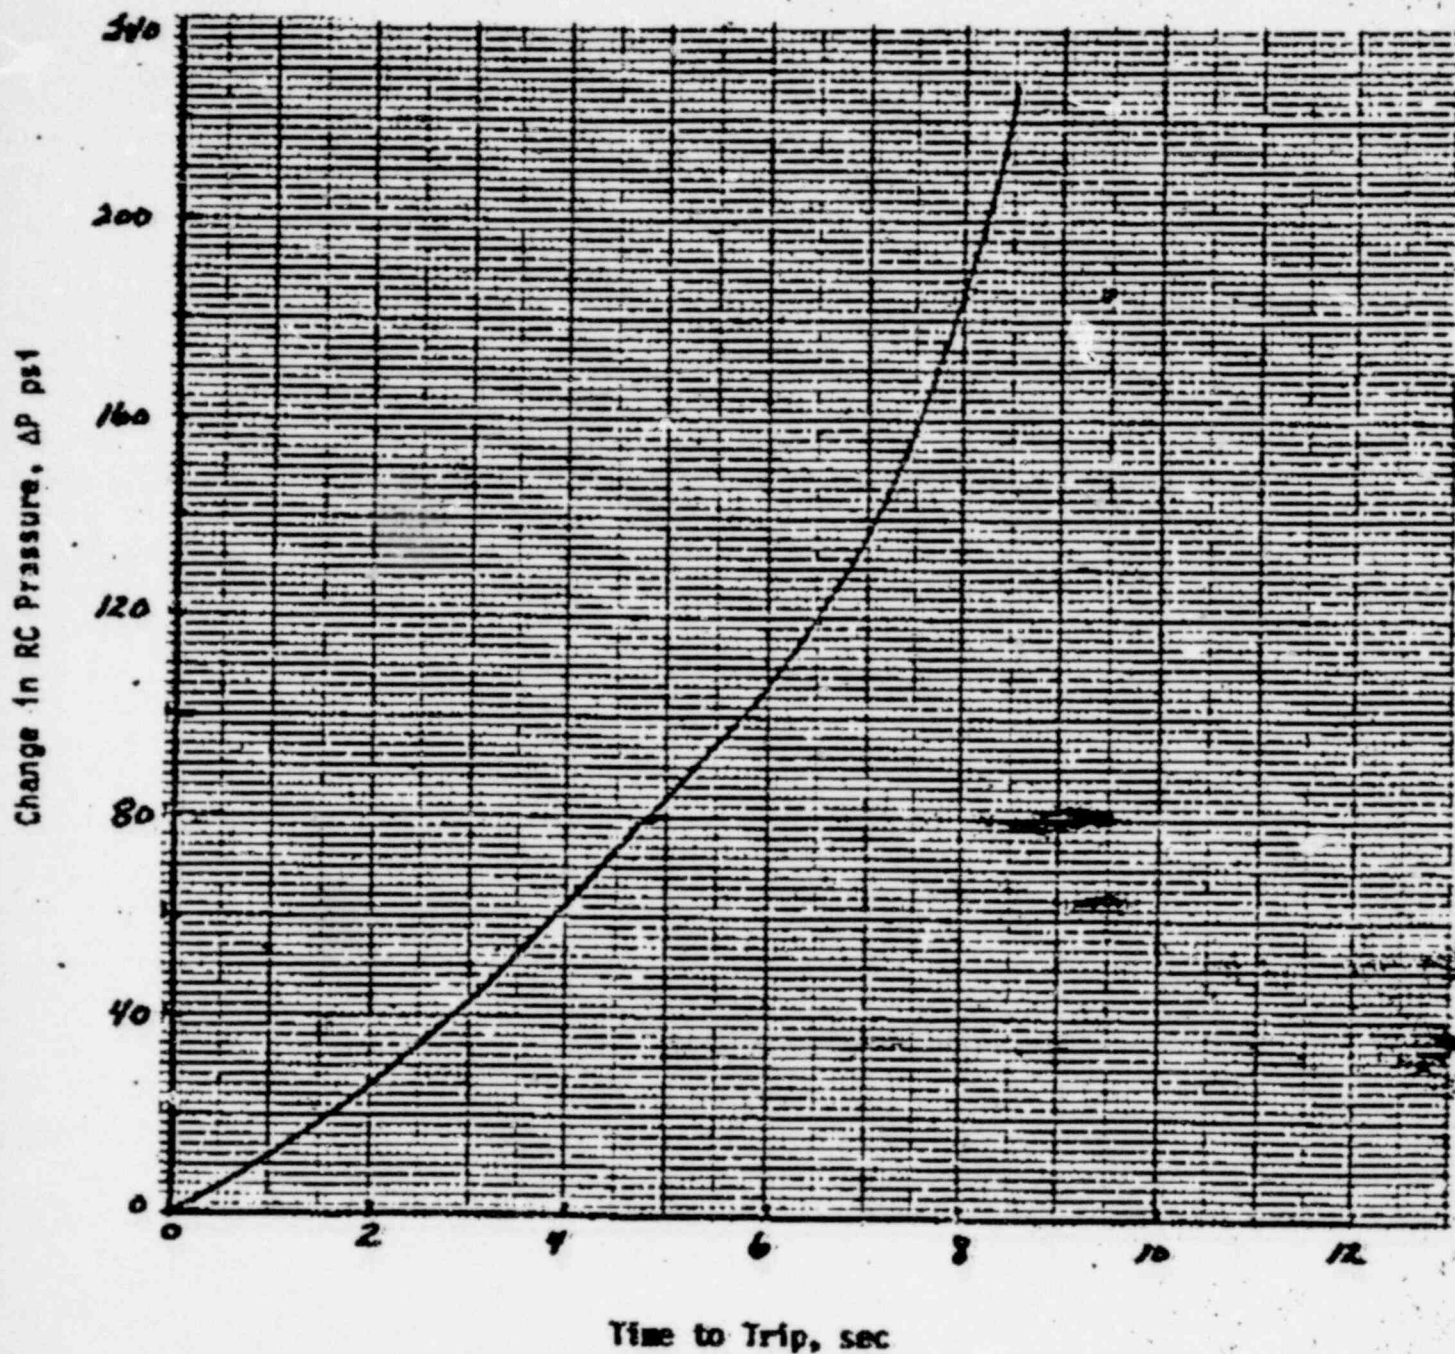

POOR ORIGINAL

FIGURE 9a-1

1138 065

TABLE 9B-1

POWER LEVEL SENSITIVITY

<u>POWER LEVEL</u>	<u>TIME TO REACH PORV SETPOINT</u>	<u>TIME TO FILL PRESSURIZER</u>
100%	3 min.	10 min.
75%	6 min.	11 min.
50%	12.3 min.	13 min.
25%	>>15 min.	16.6 min.

NOTE: RESULTS ARE FOR THE CASE OF NO AUXILIARY FEEDWATER
INITIATION WHICH RESULTS IN THE SHORTEST ACTUATION
TIMES. REACTOR TRIPS ON HIGH RC PRESSURE TRIP (2300 psig).