

Alabama Power Company
600 North 18th Street
Post Office Box 2641
Birmingham, Alabama 35291
Telephone 205 323-5341

USNRC REGION II
ATLANTA, GEORGIA

F. L. CLAYTON, JR.
Senior Vice President

June
~~79 MAY 1~~ A8:55



May 29, 1979

Docket No. 50-348 & 364
NRC IE Bulletin No. 79-11

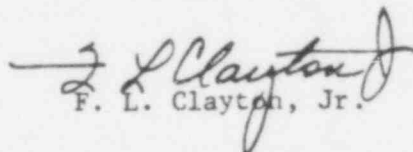
Mr. James P. O'Reilly
U. S. Nuclear Regulatory Commission
Region II
101 Marietta Street, N. W.
Suite 3100
Atlanta, Georgia 30303

Dear Mr. O'Reilly:

In response to IE Bulletin 79-11, Faulty Overcurrent Trip Device in Circuit Breakers for Engineered Safety Systems, dated May 22, 1979, Alabama Power Company submits the following response for Farley Units 1 and 2.

Westinghouse circuit breakers type DB-50 and DB-75 with overcurrent time delay dashpots are not used at Farley Units 1 or 2. Items 2 through 4 do not apply because this type of breaker is not used.

Yours very truly,


F. L. Clayton, Jr.

FLCJr/KAP/mmb

cc: Mr. R. A. Thomas
Mr. G. F. Trowbridge

7907180172

349 262

790234
OFFICIAL COPY