



Metropolitan Edison Company  
Post Office Box 542  
Reading Pennsylvania 19640  
215 929-3601

Writer's Direct Dial Number

July 5, 1979  
GQL 0842

Director of Nuclear Reactor Regulation  
Attn: R. W. Reid, Chief  
Operating Reactors Branch No. 4  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

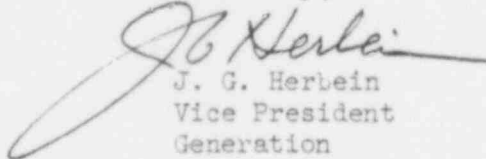
Dear Sir:

Three Mile Island Nuclear Station, Unit 1 (TMI-1)  
Operating License No. DPR-50  
Docket No. 50-289  
Fire Protection Program

This letter concerns Fire Protection Safety Evaluation Report Item  
3.2.11, Interior Hose Station Standpipes Less Than Four Inch Diameter.

Calculations have been performed which confirm that interior hose  
stations served by standpipes less than four (4) inches in nominal  
diameter are capable of delivering 100 gpm at a residual pressure of  
at least 65 psig at the hose station outlet.

Sincerely,

  
J. G. Herbein  
Vice President  
Generation

JGH:WSS:mrm

311 220

Acc'd  
5/10