

Vepco

USNRC REGION II
ATLANTA, GEORGIA
VIRGINIA ELECTRIC AND POWER COMPANY, RICHMOND, VIRGINIA 23261

June 19, 1979 AIO: 19

Mr. James P. O'Reilly, Director
Office of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Region II
101 Marietta Street, Suite 3100
Atlanta, Georgia 30303

Serial No. 481
PSE&C/GLP:mac:wang

Docket Nos. 50-404
50-405

Dear Mr. O'Reilly:

I.E. BULLETIN 79-09
NORTH ANNA UNITS 3 AND 4

We have reviewed the electrical equipment to be used in North Anna Units 3 and 4 and we are responding to each of the items under "Action to be taken by licensee."


1. G.E. type AK-2-25 circuit breakers are used in the Control Rod Drive Control Systems, they are used as Reactor Trip Breakers.
 2. The Reactor Trip Breakers will be in a preventive maintenance program which will be a means for insuring the most reliable service from these breakers. The program will consist of the following:
 - a) The torque required to operate the trip shaft will be checked every 3 months, at that time freedom of the U.V. trip mechanism will be verified.
 - b) Every 6 months, preventive maintenance, as described in SAL 175 (CPDD) 9.3 items 1-5, will be performed by personnel trained in the operation of these circuit breakers.
- 3a,b,c. We will perform maintenance using qualified personnel and we will make the use of the breaker instruction manual a part of the preventive maintenance procedure for these breakers.

405 336

7908610 683 9
79056
OFFICIAL COPY

This is our final response to this Bulletin. Should you require further information on this matter, please contact this office.

Very truly yours,

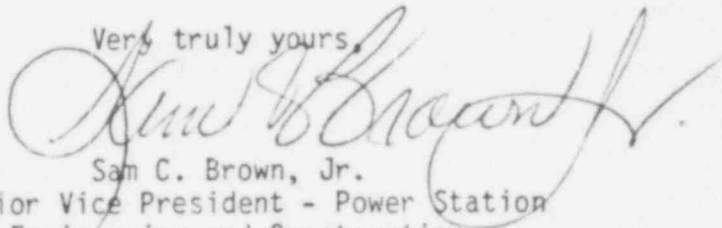

Sam C. Brown, Jr.
Senior Vice President - Power Station
Engineering and Construction

cc: Mr. John G. Davis, Acting Director
Office of Inspection & Enforcement

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation