

SNUPPS

Standardized Nuclear Unit  
Power Plant System

5 Choke Cherry Road  
Rockville, Maryland 20850  
(301) 869-8010

Nicholas A. Petrick  
Executive Director

July 24, 1979

SLNRC 79-12 FILE: 0278.10  
SUBJ: IE Bulletin 79-11: Faulty  
Overcurrent Trip Device in  
Circuit Breakers for Engineered  
Safety Systems.

Mr. Boyce Grier  
Director, Region I  
Office of Inspection and Enforcement  
U.S. Nuclear Regulatory Commission  
631 Park Avenue  
King of Prussia, Pennsylvania 19406

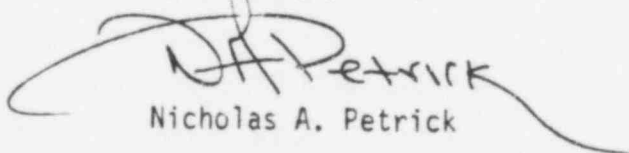
Docket Nos: STN 50-482, STN 50-483, STN 50-484,  
STN 50-485, and STN 50-486.

Dear Mr. Grier:

This letter is submitted in response to the subject IE Bulletin for the SNUPPS Utilities, Kansas Gas and Electric Company, Union Electric Company, Northern States Power Company, and Rochester Gas and Electric Corporation.

The SNUPPS design does not include Westinghouse type DB-50 or -75 circuit breakers in any safety-related applications.

Very truly yours,

  
Nicholas A. Petrick

RLS:heg

cc: Mr. James G. Keppler, Director, Region III, USNRC.  
Mr. Karl V. Seyfreit, Director, Region IV, USNRC.  
Mr. Victor Stello, Jr., Director, Office of Inspection  
and Enforcement, USNRC, Washington, D.C.

771351

JUL 25 1979

7908200 006