

~~LICENSE~~ AUTHOR BY FILE COPY

TECHNICAL SPECIFICATIONS

Appendix "A"

FLORIDA POWER & LIGHT COMPANY
TURKEY POINT PLANT
UNITS NO. 3 & 4

JUL 19 1972

INDEX

TURKEY POINT - UNITS 3 & 4

INDEX

DEFINITIONS

<u>SECTION</u>	<u>PAGE</u>
1.0 DEFINITIONS	1.0
1.1 ACTION.....	1-1
1.2 ACTUATION LOGIC TEST	1-1
1.3 ANALOG CHANNEL OPERATIONAL TEST	1-1
1.4 AXIAL FLUX DIFFERENCE	1-1
1.5 CHANNEL CALIBRATION	1-1
1.6 CHANNEL CHECK	1-1
1.7 CONTAINMENT INTEGRITY	1-2
1.8 CONTROLLED LEAKAGE	1-2
1.9 CORE ALTERATIONS	1-2
1.10 CORE OPERATING LIMITS REPORT	1-2
1.11 DIGITAL CHANNEL OPERATIONAL TEST	1-2
1.12 DOSE EQUIVALENT I-131	1-3
1.13 DOSE EQUIVALENT XE-133	1-3
1.14 FREQUENCY NOTATION	1-3
1.15 GAS DECAY TANK SYSTEM	1-3
1.16 IDENTIFIED LEAKAGE	1-3
1.16A INSERVICE TESTING PROGRAM.....	1-3
1.17 OPERABLE – OPERABILITY	1-4
1.18 OPERATIONAL MODE – MODE	1-4
1.19 PHYSICS TESTS.....	1-4
1.20 PRESSURE BOUNDARY LEAKAGE	1-4
1.21 PURGE – PURGING.....	1-4
1.22 QUADRANT POWER TILT RATIO	1-5
1.23 RATED THERMAL POWER	1-5
1.24 SHUTDOWN MARGIN.....	1-5
1.25 SITE BOUNDARY	1-5

INDEX

DEFINITIONS

<u>SECTION</u>	<u>PAGE</u>
1.26 SOURCE CHECK	1-5
1.27 STAGGERED TEST BASIS	1-5
1.28 THERMAL POWER	1-6
1.29 TRIP ACTUATING DEVICE OPERATIONAL TEST	1-6
1.30 UNIDENTIFIED LEAKAGE	1-6
1.31 UNRESTRICTED AREA	1-6
1.32 VENTING	1-6
TABLE 1.1 FREQUENCY NOTATION	1-7
TABLE 1.2 OPERATIONAL MODES	1-8

INDEX

SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

<u>SECTION</u>	<u>PAGE</u>
<u>2.1 SAFETY LIMITS</u>	
2.1.1 REACTOR CORE	2-1
2.1.2 REACTOR COOLANT SYSTEM PRESSURE.....	2-1
<u>2.2 LIMITING SAFETY SYSTEM SETTINGS</u>	
2.2.1 REACTOR TRIP SYSTEM INSTRUMENTATION SETPOINTS.....	2-2
TABLE 2.2-1 REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS	2-3

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.0 APPLICABILITY</u>	3/4 0-1
<u>3/4.1 REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL	
Shutdown Margin - T_{avg} Greater Than 200°F	3/4 1-1
Shutdown Margin - T_{avg} Less Than or Equal to 200°F.....	3/4 1-3
Moderator Temperature Coefficient.....	3/4 1-4
Minimum Temperature for Criticality.....	3/4 1-6
3/4.1.2 BORATION SYSTEMS	
Flow Path - Shutdown	3/4 1-7
Flow Paths - Operating.....	3/4 1-8
Charging Pumps - Operating.....	3/4 1-10
Borated Water Source - Shutdown.....	3/4 1-11
Borated Water Sources - Operating	3/4 1-13
FIGURE 3.1-2 BORIC ACID TANK MINIMUM VOLUME.....	3/4 1-14
3/4.1.3 MOVABLE CONTROL ASSEMBLIES	
Group Height	3/4 1-16
TABLE 3.1-1 ACCIDENT ANALYSES REQUIRING REEVALUATION IN THE EVENT OF AN INOPERABLE FULL-LENGTH ROD	3/4 1-18
Position Indication Systems - Operating.....	3/4 1-19
TABLE 4.1-1 ROD POSITION INDICATOR SURVEILLANCE REQUIREMENTS	3/4 1-22
Position Indication System - Shutdown	3/4 1-23
Rod Drop Time	3/4 1-24
Shutdown Rod Insertion Limit.....	3/4 1-25
Control Rod Insertion Limits	3/4 1-26

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1	AXIAL FLUX DIFFERENCE 3/4 2-1
3/4.2.2	HEAT FLUX HOT CHANNEL FACTOR 3/4 2-3
3/4.2.3	NUCLEAR ENTHALPY RISE HOT CHANNEL FACTOR 3/4 2-9
3/4.2.4	QUADRANT POWER TILT RATIO 3/4 2-11
3/4.2.5	DNB PARAMETERS 3/4 2-14
<u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1	REACTOR TRIP SYSTEM INSTRUMENTATION 3/4 3-1
TABLE 3.3-1	REACTOR TRIP SYSTEM INSTRUMENTATION 3/4 3-2
TABLE 4.3-1	REACTOR TRIP SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS..... 3/4 3-8
3/4.3.2	ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION 3/4 3-13
TABLE 3.3-2	ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION 3/4 3-14
TABLE 3.3-3	ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION TRIP SETPOINTS 3/4 3-23
TABLE 4.3-2	ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS..... 3/4 3-32
3/4.3.3	MONITORING INSTRUMENTATION Radiation Monitoring For Plant Operations 3/4 3-39

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
TABLE 3.3-4 RADIATION MONITORING INSTRUMENTATION FOR PLANT OPERATIONS.....	3/4 3-40
TABLE 4.3-3 RADIATION MONITORING INSTRUMENTATION FOR PLANT OPERATIONS SURVEILLANCE REQUIREMENTS.....	3/4 3-43
Movable Incore Detectors.....	3/4 3-44
Accident Monitoring Instrumentation	3/4 3-45
TABLE 3.3-5 ACCIDENT MONITORING INSTRUMENTATION	3/4 3-46
TABLE 4.3-4 ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-50
DELETED	3/4 3-51
TABLE 3.3-8 DELETED	3/4 3-52
TABLE 4.3-6 DELETED	3/4 3-53

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>		<u>PAGE</u>
<u>3/4.4 REACTOR COOLANT SYSTEM</u>		
3/4.4.1	REACTOR COOLANT LOOPS AND COOLANT CIRCULATION	
	Startup and Power Operation	3/4 4-1
	Hot Standby	3/4 4-2
	Hot Shutdown	3/4 4-3
	Cold Shutdown - Loops Filled	3/4 4-5
	Cold Shutdown - Loops Not Filled	3/4 4-6
3/4.4.2	SAFETY VALVES	
	Shutdown	3/4 4-7
	Operating	3/4 4-8
3/4.4.3	PRESSURIZER	3/4 4-9
3/4.4.4	RELIEF VALVES	3/4 4-10
3/4.4.5	STEAM GENERATOR (SG) TUBE INTEGRITY	3/4 4-12
3/4.4.6	REACTOR COOLANT SYSTEM LEAKAGE	
	Leakage Detection Systems	3/4 4-13
	Operational Leakage	3/4 4-14
TABLE 3.4-1	REACTOR COOLANT SYSTEM PRESSURE ISOLATION VALVES	3/4 4-17
3/4.4.7	DELETED	
TABLE 3.4-2	DELETED	
TABLE 4.4-3	DELETED	
3/4.4.8	SPECIFIC ACTIVITY	3/4 4-21
TABLE 4.4-4	REACTOR COOLANT SPECIFIC ACTIVITY SAMPLE AND ANALYSIS	3/4 4-22

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
3/4.4.9 PRESSURE/TEMPERATURE LIMITS Reactor Coolant System	3/4 4-23
FIGURE 3.4-2 TURKEY POINT UNITS 3&4 REACTOR COOLANT SYSTEM HEATUP LIMITATIONS (Heatup Rates of 60 and 100°F/hr) APPLICABLE FOR 48 EFPY (Without Margins for Instrumentation Errors).....	3/4 4-25
FIGURE 3.4-3 TURKEY POINT UNITS 3&4 REACTOR COOLANT SYSTEM COOLDOWN LIMITATIONS (Cooldown Rates of 0, 20, 40, 60 and 100°F/hr) APPLICABLE FOR 48 EFPY(Without Margins for Instrumentation Errors)	3/4 4-25
Pressurizer	3/4 4-26
Overpressure Mitigating Systems.....	3/4 4-27
3/4.4.10 DELETED	
3/4.4.11 REACTOR COOLANT SYSTEM VENTS	3/4 4-29
<u>3/4.5 EMERGENCY CORE COOLING SYSTEMS</u>	
3/4.5.1 ACCUMULATORS	3/4 5-1
3/4.5.2 ECCS SUBSYSTEMS - T_{avg} GREATER THAN OR EQUAL TO 350°F.....	3/4 5-3
FIGURE 3.5-1 DELETED	3/4 5-6
3/4.5.3 ECCS SUBSYSTEMS - T_{avg} LESS THAN 350°F	3/4 5-9
3/4.5.4 REFUELING WATER STORAGE TANK.....	3/4 5-10

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>		<u>PAGE</u>
<u>3/4.6 CONTAINMENT SYSTEMS</u>		
3/4.6.1	PRIMARY CONTAINMENT	
	Containment Integrity	3/4 6-1
	Containment Leakage	3/4 6-2
	Containment Air Locks	3/4 6-3
	Internal Pressure	3/4 6-5
	Air Temperature.....	3/4 6-6
	Containment Structural Integrity	3/4 6-7
	Containment Ventilation System	3/4 6-11
3/4.6.2	DEPRESSURIZATION AND COOLING SYSTEMS	
	Containment Spray System.....	3/4 6-12
	Emergency Containment Cooling System.....	3/4 6-14
	Recirculation pH Control System.....	3/4 6-15
3/4.6.3	DELETED	
3/4.6.4	CONTAINMENT ISOLATION VALVES	3/4 6-16
3/4.6.5	DELETED	
3/4.6.6	DELETED	

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.7 PLANT SYSTEMS</u>	
3/4.7.1	TURBINE CYCLE
	Safety Valves..... 3/4 7-1
TABLE 3.7-1	MAXIMUM ALLOWABLE POWER LEVEL WITH INOPERABLE STEAM LINE SAFETY VALVES DURING THREE LOOP OPERATION 3/4 7-2
TABLE 3.7-2	STEAM LINE SAFETY VALVES PER LOOP 3/4 7-2
	Auxiliary Feedwater System..... 3/4 7-3
TABLE 3.7-3	DELETED 3/4 7-5
	Condensate Storage Tank..... 3/4 7-6
	Specific Activity..... 3/4 7-8
TABLE 4.7-1	SECONDARY COOLANT SYSTEM SPECIFIC ACTIVITY SAMPLE AND ANALYSIS 3/4 7-9
	Main Steam Line Isolation Valves 3/4 7-10
	DELETED 3/4 7-11
	Feedwater Isolation 3/4 7-13
3/4.7.2	COMPONENT COOLING WATER SYSTEM..... 3/4 7-14
3/4.7.3	INTAKE COOLING WATER SYSTEM 3/4 7-16
3/4.7.4	ULTIMATE HEAT SINK..... 3/4 7-17
3/4.7.5	CONTROL ROOM EMERGENCY VENTILATION SYSTEM 3/4 7-18
3/4.7.6	SNUBBERS 3/4 7-22
3/4.7.7	SEALED SOURCE CONTAMINATION..... 3/4 7-23
3/4.7.8	DELETED 3/4 7-25
3/4.7.9	DELETED 3/4 7-26

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.8 ELECTRICAL POWER SYSTEMS</u>	
3/4.8.1	AC SOURCES
	Operating 3/4 8-1
	Shutdown 3/4 8-11
3/4.8.2	DC SOURCES
	Operating 3/4 8-13
TABLE 4.8-2	BATTERY SURVEILLANCE REQUIREMENTS..... 3/4 8-16
	Shutdown 3/4 8-17
3/4.8.3	ONSITE POWER DISTRIBUTION
	Operating 3/4 8-18
TABLE 3.8-1	APPLICABLE TO UNIT 3 BASED ON UNIT 4 LOAD CENTERS AND MOTOR CONTROL CENTERS INOPERABLE ALLOWABLE OUTAGE TIMES 3/4 8-21
TABLE 3.8-2	APPLICABLE TO UNIT 4 BASED ON UNIT 3 LOAD CENTERS AND MOTOR CONTROL CENTERS INOPERABLE ALLOWABLE OUTAGE TIMES 3/4 8-22
	Shutdown 3/4 8-23

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.9 REFUELING OPERATIONS</u>	
3/4.9.1 BORON CONCENTRATION	3/4 9-1
3/4.9.2 INSTRUMENTATION	3/4 9-2
3/4.9.3 DECAY TIME.....	3/4 9-3
3/4.9.4 CONTAINMENT BUILDING PENETRATIONS	3/4 9-4
3/4.9.5 DELETED	
3/4.9.6 DELETED	
3/4.9.7 DELETED	
3/4.9.8 RESIDUAL HEAT REMOVAL AND COOLANT CIRCULATION	
High Water Level	3/4 9-7
Low Water Level.....	3/4 9-8

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>		<u>PAGE</u>
3/4.9.9	CONTAINMENT VENTILATION ISOLATION SYSTEM.....	3/4 9-9
3/4.9.10	REFUELING CAVITY WATER LEVEL	3/4 9-10
3/4.9.11	WATER LEVEL – STORAGE POOL.....	3/4 9-11
3/4.9.12	DELETED	
3/4.9.13	RADIATION MONITORING.....	3/4 9-12
3/4.9.14	SPENT FUEL STORAGE.....	3/4 9-13

3/4.10 SPECIAL TEST EXCEPTIONS

3/4.10.1	SHUTDOWN MARGIN	3/4 10-1
3/4.10.2	GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS	3/4 10-2
3/4.10.3	PHYSICS TESTS	3/4 10-3
3/4.10.4	(THIS SPECIFICATION NUMBER IS NOT USED)	
3/4.10.5	POSITION INDICATION SYSTEM - SHUTDOWN	3/4 10-4

INDEX

DESIGN FEATURES

SECTION	PAGE
<u>5.1 SITE</u>	
5.1.1 SITE LOCATION.....	5-1
<u>5.2 DELETED</u>	
<u>5.3 REACTOR CORE</u>	
5.3.1 FUEL ASSEMBLIES	5-1
5.3.2 CONTROL ROD ASSEMBLIES	5-1
<u>5.4 DELETED</u>	
<u>5.5 FUEL STORAGE</u>	
5.5.1 CRITICALITY	5-2
5.5.2 DRAINAGE	5-3
5.5.3 CAPACITY	5-3
TABLE 5.5-1 BLANKETED FUEL – MINIMUM REQUIRED FUEL ASSEMBLY BURNUP (Bu) AS A FUNCTION OF ENRICHMENT (En) AND COOLING TIME (Ct) ..	5-4
TABLE 5.5-2 NON-BLANKETED FUEL – MINIMUM REQUIRED FUEL ASSEMBLY BURNUP (Bu) AS A FUNCTION OF ENRICHMENT (En) AND COOLING TIME (Ct)	5-5
TABLE 5.5-3 FUEL CATEGORIES RANKED BY REACTIVITY	5-6
TABLE 5.5-4 IFBA REQUIREMENTS FOR FUEL CATEGORY I-2	5-6
FIGURE 5.5-1 ALLOWABLE REGION I STORAGE ARRAYS	5-7
FIGURE 5.5-2 ALLOWABLE REGION II STORAGE ARRAYS	5-8
FIGURE 5.5-3 INTERFACE RESTRICTIONS BETWEEN REGION I AND REGION II ARRAYS.....	5-9

INDEX

ADMINISTRATIVE CONTROLS

<u>SECTION</u>	<u>PAGE</u>
<u>6.1 RESPONSIBILITY</u>	6-1
<u>6.2 ORGANIZATION</u>	6-1
6.2.1 ONSITE AND OFFSITE ORGANIZATION.....	6-1
6.2.2 PLANT STAFF	6-2
TABLE 6.2-1 MINIMUM SHIFT CREW COMPOSITION	6-3
6.2.3 SHIFT TECHNICAL ADVISOR FUNCTION.....	6-4
<u>6.3 FACILITY STAFF QUALIFICATIONS</u>	6-4
<u>6.4 DELETED</u>	
<u>6.5 DELETED</u>	

INDEX

ADMINISTRATIVE CONTROLS

<u>SECTION</u>	<u>PAGE</u>
<u>6.6 DELETED</u>	
<u>6.7 DELETED</u>	
<u>6.8 PROCEDURES AND PROGRAMS</u>	6-5
<u>6.9 REPORTING REQUIREMENTS</u>	6-15
6.9.1 ROUTINE REPORTS	6-15
DELETED Report	6-15
DELETED Report	6-15
Annual Radiological Environmental Operating Report	6-16
Annual Radioactive Effluent Release Report	6-16
Peaking Factor Limit Report	6-17
Core Operating Limits Report	6-17
Steam Generator Tube Inspection Report	6-20
6.9.2 SPECIAL REPORTS	6-20
<u>6.10 DELETED</u>	
<u>6.11 DELETED</u>	
<u>6.12 HIGH RADIATION AREA</u>	6-21
<u>6.13 DELETED</u>	
<u>6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM)</u>	6-22

SECTION 1.0
DEFINITIONS

1.0 DEFINITIONS

The defined terms of this section appear in capitalized type and are applicable throughout these Technical Specifications.

ACTION

1.1 ACTION shall be that part of a Technical Specification which prescribes remedial measures required under designated conditions.

ACTUATION LOGIC TEST

1.2 An ACTUATION LOGIC TEST shall be the application of various simulated input combinations in conjunction with each possible interlock logic state and verification of the required logic output. The ACTUATION LOGIC TEST shall include a continuity check, as a minimum, of output devices.

ANALOG CHANNEL OPERATIONAL TEST

1.3 An ANALOG CHANNEL OPERATIONAL TEST shall be the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY of alarm, interlock and/or trip functions. The ANALOG CHANNEL OPERATIONAL TEST shall include adjustments, as necessary, of the alarm, interlock and/or Trip Setpoints such that the setpoints are within the required range and accuracy.

AXIAL FLUX DIFFERENCE

1.4 AXIAL FLUX DIFFERENCE shall be the difference in normalized flux signals between the top and bottom halves of a two section excore neutron detector.

CHANNEL CALIBRATION

1.5 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel such that it responds within the required range and accuracy to known values of input. The CHANNEL CALIBRATION shall encompass the entire channel including the sensors and alarm, interlock and/or trip functions and may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is calibrated.

CHANNEL CHECK

1.6 A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

DEFINITIONS

CONTAINMENT INTEGRITY

1.7 CONTAINMENT INTEGRITY shall exist when:

- a. All penetrations required to be closed during accident conditions are either:
 - 1) Capable of being closed by an OPERABLE containment automatic isolation valve system, or
 - 2) Closed by manual valves, blind flanges, or deactivated automatic valves secured in their closed positions, except as provided in Specification 3.6.4.
- b. The equipment hatch is closed and sealed,
- c. Each air lock is in compliance with the requirements of Specification 3.6.1.3,
- d. The containment leakage rates are within the limits of Specification 3.6.1.2, and
- e. The sealing mechanism associated with each penetration (e.g., welds, bellows, or O-rings) is OPERABLE.

CONTROLLED LEAKAGE

1.8 CONTROLLED LEAKAGE shall be that seal water flow supplied to the reactor coolant pump seals.

CORE ALTERATIONS

1.9 CORE ALTERATIONS shall be the movement of any fuel, sources, reactivity control components, or other components affecting reactivity within the reactor vessel with the vessel head removed and fuel in the vessel. Suspension of CORE ALTERATIONS shall not preclude completion of movement of a component to a safe position.

CORE OPERATING LIMITS REPORT

1.10 The CORE OPERATING LIMITS REPORT (COLR) is the unit-specific document that provides core operating limits for the current operating reload cycle. These cycle-specific core operating limits shall be determined for each reload cycle in accordance with NRC approved methodology. Unit operation within these operating limits is addressed in individual specifications. The COLR is submitted to the NRC in accordance with the requirements of 6.9.1.7.

DIGITAL CHANNEL OPERATIONAL TEST

1.11 A DIGITAL CHANNEL OPERATIONAL TEST shall be the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY of alarm, interlock, and/or trip functions.

DEFINITIONS

DOSE EQUIVALENT I-131

1.12 DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microCuries per gram) that alone would produce the same dose when inhaled as the combined activities of iodine isotopes I-131, I-132, I-133, I-134, and I-135 actually present. The determination of DOSE EQUIVALENT I-131 shall be performed using thyroid dose conversion factors from Table 2.1 of EPA Federal Guidance Report No. 11, 1988, "Limiting values of Radionuclide Intake and Air Concentration and Dose Conversion Factors for Inhalation, Submersion, and Ingestion."

DOSE EQUIVALENT XE - 133

1.13 DOSE EQUIVALENT XE-133 shall be that concentration of Xe-133 (microcuries per gram) that alone would produce the same acute dose to the whole body as the combined activities of noble gas nuclides Kr-85m, Kr-85, Kr-87, Kr-88, Xe-131m, Xe-133m, Xe-133, Xe-135m, Xe-135, and Xe-138 actually present. If a specific noble gas nuclide is not detected, it should be assumed to be present at the minimum detectable activity. The determination of DOSE EQUIVALENT XE-133 shall be performed using effective dose conversion factors for air submersion listed in Table III.1 of EPA Federal Guidance Report No. 12, 1993, "External Exposure to Radionuclides in Air, Water, and Soil."

FREQUENCY NOTATION

1.14 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 1.1.

GAS DECAY TANK SYSTEM

1.15 A GAS DECAY TANK SYSTEM shall be any system designed and installed to reduce radioactive gaseous effluents by collecting Reactor Coolant System off gases from the Reactor Coolant System and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

IDENTIFIED LEAKAGE

1.16 IDENTIFIED LEAKAGE shall be:

- a. Leakage (except CONTROLLED LEAKAGE) into closed systems, such as pump seal or valve packing leaks that are captured and conducted to a sump or collecting tank, or
- b. Leakage into the containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of Leakage Detection Systems or not to be PRESSURE BOUNDARY LEAKAGE, or
- c. Reactor Coolant System leakage through a steam generator to the Secondary Coolant System (primary-to-secondary leakage).

INSERVICE TESTING PROGRAM

1.16A The INSERVICE TESTING PROGRAM is the licensee program that fulfills the requirements of 10 CFR 50.55a(f).

DEFINITIONS

OPERABLE - OPERABILITY

1.17 A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).

OPERATIONAL MODE - MODE

1.18 An OPERATIONAL MODE (i.e., MODE) shall correspond to any one inclusive combination of core reactivity condition, power level, and average reactor coolant temperature specified in Table 1.2.

PHYSICS TESTS

1.19 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation: (1) described in Chapter 13.5 of the FSAR, (2) authorized under the provisions of 10 CFR 50.59, or (3) otherwise approved by the Commission.

PRESSURE BOUNDARY LEAKAGE

1.20 PRESSURE BOUNDARY LEAKAGE shall be leakage (except primary-to-secondary leakage) through a nonisolable fault in a Reactor Coolant System component body, pipe wall, or vessel wall.

PURGE - PURGING

1.21 PURGE or PURGING shall be any controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

DEFINITIONS

QUADRANT POWER TILT RATIO

1.22 QUADRANT POWER TILT RATIO shall be the ratio of the maximum upper excore detector calibrated output to the average of the upper excore detector calibrated outputs, or the ratio of the maximum lower excore detector calibrated output to the average of the lower excore detector calibrated outputs, whichever is greater. With one excore detector inoperable, the remaining three detectors shall be used for computing the average.

RATED THERMAL POWER

1.23 RATED THERMAL POWER shall be a total reactor core heat transfer rate to the reactor coolant of 2644 MWt.

SHUTDOWN MARGIN

1.24 SHUTDOWN MARGIN shall be the instantaneous amount of reactivity by which the reactor is subcritical or would be subcritical from its present condition assuming all full-length rod cluster assemblies (shutdown and control) are fully inserted except for the single rod cluster assembly of highest reactivity worth which is assumed to be fully withdrawn.

SITE BOUNDARY

1.25 The SITE BOUNDARY shall mean that line beyond which the land or property is not owned, leased, or otherwise controlled by the licensee.

SOURCE CHECK

1.26 A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.

STAGGERED TEST BASIS

1.27 A STAGGERED TEST BASIS shall consist of:

- a. A test schedule for n systems, subsystems, trains, or other designated components obtained by dividing the specified test interval into n equal subintervals, and
- b. The testing of one system, subsystem, train, or other designated component at the beginning of each subinterval.

DEFINITIONS

THERMAL POWER

1.28 THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

TRIP ACTUATING DEVICE OPERATIONAL TEST

1.29 A TRIP ACTUATING DEVICE OPERATIONAL TEST shall consist of operating the Trip Actuating Device and verifying OPERABILITY of alarm, interlock and/or trip functions. The TRIP ACTUATING DEVICE OPERATIONAL TEST shall include adjustment, as necessary, of the Trip Actuating Device such that it actuates at the required setpoint within the required accuracy.

UNIDENTIFIED LEAKAGE

1.30 UNIDENTIFIED LEAKAGE shall be all leakage which is not IDENTIFIED LEAKAGE or CONTROLLED LEAKAGE.

UNRESTRICTED AREA

1.31 An UNRESTRICTED AREA shall mean an area, access to which is neither limited nor controlled by the licensee.

VENTING

1.32 VENTING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration, or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.

TABLE 1.1
FREQUENCY NOTATION

<u>NOTATION</u>	<u>FREQUENCY</u>
S	At least once per 12 hours.
D	At least once per 24 hours.
W	At least once per 7 days.
M	At least once per 31 days.
Q	At least once per 92 days.
SA	At least once per 184 days.
R	At least once per 18 months.
S/U	Prior to each reactor startup.
N.A.	Not applicable.
P	Completed prior to each release.
SFCP	In accordance with the Surveillance Frequency Control Program

TABLE 1.2
OPERATIONAL MODES

<u>MODE</u>	<u>REACTIVITY CONDITION, K_{eff}</u>	<u>% RATED THERMAL POWER*</u>	<u>AVERAGE COOLANT TEMPERATURE</u>
1. POWER OPERATION	≥ 0.99	$> 5\%$	$\geq 350^{\circ}\text{F}$
2. STARTUP	≥ 0.99	$\leq 5\%$	$\geq 350^{\circ}\text{F}$
3. HOT STANDBY	< 0.99	0	$\geq 350^{\circ}\text{F}$
4. HOT SHUTDOWN	< 0.99	0	$350^{\circ}\text{F} > T_{avg}$ $> 200^{\circ}\text{F}$
5. COLD SHUTDOWN	< 0.99	0	$\leq 200^{\circ}\text{F}$
6. REFUELING**	≤ 0.95	0	$\leq 140^{\circ}\text{F}$

*Excluding decay heat.

**Fuel in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

SECTION 2.0
SAFETY LIMITS
AND
LIMITING SAFETY SYSTEM SETTINGS

2.0 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

2.1 SAFETY LIMITS

REACTOR CORE

2.1.1 The combination of THERMAL POWER, pressurizer pressure, and the highest operating loop coolant temperature (T_{avg}) shall not exceed the limits specified in the COLR, for 3 loop operation; and the following Safety Limits shall not be exceeded:

- a. The departure from nucleate boiling ratio (DNBR) shall be maintained ≥ 1.17 for the WRB-1 DNB correlation.
- b. The peak fuel centerline temperature shall be maintained $< 5080^{\circ}\text{F}$, decreasing by 9°F per 10,000 MWD/MTU of burnup.

APPLICABILITY: MODES 1 and 2.

ACTION:

Whenever the point defined by the combination of the highest operating loop average temperature and THERMAL POWER has exceeded the appropriate pressurizer pressure line, be in HOT STANDBY within 1 hour.

REACTOR COOLANT SYSTEM PRESSURE

2.1.2 The Reactor Coolant System pressure shall not exceed 2735 psig.

APPLICABILITY: MODES 1, 2, 3, 4, and 5.

ACTION:

MODES 1 and 2:

Whenever the Reactor Coolant System pressure has exceeded 2735 psig, be in HOT STANDBY with the Reactor Coolant System pressure within its limit within 1 hour.

MODES 3, 4 and 5:

Whenever the Reactor Coolant System pressure has exceeded 2735 psig, reduce the Reactor Coolant System pressure to within its limit within 5 minutes.

SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

2.2 LIMITING SAFETY SYSTEM SETTINGS

REACTOR TRIP SYSTEM INSTRUMENTATION SETPOINTS

2.2.1 The Reactor Trip System Instrumentation and Interlock Setpoints shall be set consistent with the Trip Setpoint values shown in Table 2.2-1.

APPLICABILITY: As shown for each channel in Table 3.3-1.

Action:

- a. With a Reactor Trip System Instrumentation or Interlock Setpoint less conservative than the value shown in the Trip Setpoint column but more conservative than the value shown in the Allowable Value column of Table 2.2-1, adjust the setpoint consistent with the Trip setpoint value within permissible calibration tolerance.
- b. With the Reactor Trip System Instrumentation or Interlock Setpoint less conservative than the value shown in the Allowable Values column of Table 2.2-1, either:
 1. Adjust the Setpoint consistent with the Trip Setpoint value of Table 2.2-1 and determine within 12 hours that the affected channel is OPERABLE; or
 2. Declare the channel inoperable and apply the applicable ACTION statement requirement of Specification 3.3.1 until the channel is restored to OPERABLE status with its setpoint adjusted consistent with the Trip Setpoint value.

TABLE 2.2-1

REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
1. Manual Reactor Trip	N.A.	N.A.
2. Power Range, Neutron Flux		
a. High Setpoint	$\leq 108.6\%$ of RTP**	108.0% of RTP**
b. Low Setpoint	$\leq 28.0\%$ of RTP**	$\leq 25\%$ of RTP**
3. Intermediate Range, Neutron Flux	$\leq 31.0\%$ of RTP**	$\leq 25\%$ of RTP**
4. Source Range, Neutron Flux	$\leq 1.4 \times 10^5$ cps	$\leq 10^5$ cps
5. Overtemperature ΔT	See Note 2	See Note 1
6. Overpower ΔT	See Note 4	See Note 3
7. Pressurizer Pressure-Low	≥ 1817 psig	≥ 1835 psig
8. Pressurizer Pressure-High	≤ 2403 psig	≤ 2385 psig
9. Pressurizer Water Level-High	$\leq 92.2\%$ of instrument span	$\leq 92\%$ of instrument span
10. Reactor Coolant Flow-Low	$\geq 89.6\%$ of loop design flow*	90% of loop design flow*
11. Steam Generator Water Level Low-Low	$\geq 15.5\%$ of narrow range instrument span	16% of narrow range instrument span

* Loop design flow = 86,900 gpm

** RTP = Rated Thermal Power

TABLE 2.2-1 (Continued)

REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
12. Steam/Feedwater Flow Mismatch Coincident with Steam Generator Water Level-Low	Feed Flow \leq 20.7% below rated Steam Flow \geq 15.5% of narrow range instrument span	Feed Flow 20% below rated Steam Flow 16% of narrow range instrument span
13. Undervoltage – 4.16 kV Busses A and B	\geq 69% bus voltage	\geq 70% bus voltage
14. Underfrequency – Trip of Reactor Coolant Pump Breaker(s) Open	\geq 55.9 Hz	\geq 56.1 Hz
15. Turbine Trip		
a. Emergency Trip Header Pressure	\geq 901 psig	1000 psig
b. Turbine Stop Valve Closure	Fully Closed***	Fully Closed***
16. Safety Injection Input from ESF	N.A.	N.A.
17. Reactor Trip System Interlocks		
a. Intermediate Range Neutron Flux, P-6	$\geq 6.0 \times 10^{-11}$ amps	Nominal 1×10^{-10} amps

*** Limit switch is set when Turbine Stop Valves are fully closed.

TABLE 2.2-1 (Continued)

REACTOR TRIP SYSTEM INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
b. Low Power Reactor Trips Block, P-7		
1) P-10 input	$\leq 13.0\% \text{ RTP}^{**}$	Nominal 10% of RTP ^{**}
2) Turbine Inlet Pressure	$\leq 13.0\% \text{ Turbine Power}$	Nominal 10% Turbine Power
c. Power Range Neutron Flux, P-8	$\leq 48.0\% \text{ RTP}^{**}$	Nominal 45% of RTP ^{**}
d. Power Range Neutron Flux, P-10	$\geq 7.0\% \text{ RTP}^{**}$	Nominal 10% of RTP ^{**}
18. Reactor Coolant Pump Breaker Position Trip	N.A.	N.A.
19. Reactor Trip Breakers	N.A.	N.A.
20. Automatic Trip and Interlock Logic	N.A.	N.A.

^{**} RTP = RATED THERMAL POWER

TABLE 2.2-1 (Continued)
TABLE NOTATIONS

NOTE 1: OVERTEMPERATURE ΔT (Those values denoted with [*] are specified in the COLR.)

$$\Delta T \frac{(1+\tau_1 S)}{(1+\tau_2 S)} \left(\frac{1}{1+\tau_3 S} \right) \leq \Delta T_0 \left\{ K_1 - K_2 \frac{(1+\tau_4 S)}{(1+\tau_5 S)} \left[T \frac{1}{(1+\tau_6 S)} - T' \right] + K_3(P - P') - f_1(\Delta I) \right\}$$

Where: ΔT = Measured ΔT by RTD Instrumentation

$\frac{1+\tau_1 S}{1+\tau_2 S}$ = Lead/Lag compensator on measured ΔT ; $\tau_1 = [*]s$, $\tau_2 = [*]s$

$\frac{1}{1+\tau_3 S}$ = Lag compensator on measured ΔT ; $\tau_3 = [*]s$

ΔT_0 = Indicated ΔT at RATED THERMAL POWER

K_1 = [*];

K_2 = [*]/°F;

$\frac{1+\tau_4 S}{1+\tau_5 S}$ = The function generated by the lead-lag compensator for T_{avg} dynamic compensation;

τ_4, τ_5 = Time constants utilized in the lead-lag compensator for T_{avg} , $\tau_4 = [*]s$, $\tau_5 = [*]s$;

T = Average temperature, °F;

$\frac{1}{1+\tau_6 S}$ = Lag compensator on measured T_{avg} ; $\tau_6 = [*]s$

T' ≤ [*]°F (Indicated Loop T_{avg} at RATED THERMAL POWER);

K_3 = [*]/psi;

P = Pressurizer pressure, psig;

TABLE 2.2-1 (Continued)TABLE NOTATIONS (Continued)

NOTE 1: (Continued)

$$P' \geq [*] \text{ psig (Nominal RCS operating pressure);}$$

$$S = \text{Laplace transform operator, } s^{-1};$$

And $f_1(\Delta I)$ is a function of the indicated difference between top and bottom detectors of the power-range neutron ion chambers; with gains to be selected based on measured instrument response during plant startup tests such that:

- (1) For $q_t - q_b$ between $-[*]\%$ and $+[*]\%$, $f_1(\Delta I) = 0$, where q_t and q_b are percent RATED THERMAL POWER in the top and bottom halves of the core respectively, and $q_t + q_b$ is total THERMAL POWER in percent of RATED THERMAL POWER;
- (2) For each percent that the magnitude of $q_t - q_b$ exceeds $-[*]\%$, the ΔT Trip Setpoint shall be automatically reduced by $[\ast]\%$ of its value at RATED THERMAL POWER; and
- (3) For each percent that the magnitude of $q_t - q_b$ exceeds $+[*]\%$, the ΔT Trip Setpoint shall be automatically reduced by $[\ast]\%$ of its value at RATED THERMAL POWER.

NOTE 2: The Overtemperature ΔT function Allowable Value shall not exceed the nominal trip setpoint by more than 0.5% ΔT span for the ΔT channel, 0.2% ΔT span for the Pressurizer Pressure channel, and 0.4% ΔT span for the $f(\Delta I)$ channel. No separate Allowable Value is provided for T_{avg} because this function is part of the ΔT value.

TABLE 2.2-1 (Continued)

TABLE NOTATIONS (Continued)

NOTE 3: OVERPOWER ΔT (Those values denoted with [\star] are specified in the COLR.)

$$\Delta T \frac{(1+\tau_1 S)}{(1+\tau_2 S)} \left(\frac{1}{1+\tau_3 S} \right) \leq \Delta T_0 \left\{ K_4 - K_5 \frac{\tau_7 S}{1+\tau_7 S} \left(\frac{1}{1+\tau_6 S} \right) T - K_6 \left[T \frac{1}{1+\tau_6 S} - T'' \right] - f_2(\Delta I) \right\}$$

Where: ΔT = As defined in Note 1,

$\frac{1+\tau_1 S}{1+\tau_2 S}$ = As defined in Note 1,

$\frac{1}{1+\tau_3 S}$ = As defined in Note 1,

ΔT_0 = As defined in Note 1,

K_4 = [\star],

K_5 \geq [\star]/°F for increasing average temperature and [\star]/°F for decreasing average temperature,

$\frac{\tau_7 S}{1+\tau_7 S}$ = The function generated by the lead-lag compensator for T_{avg} dynamic compensation;

τ_7 = Time constants utilized in the lead-lag compensator for T_{avg} , $\tau_7 \geq [\star]$ s,

$\frac{1}{1+\tau_6 S}$ = As defined in Note 1,

TABLE 2.2-1 (Continued)TABLE NOTATIONS (Continued)

NOTE 3: (Continued)

K_6	=	$[^{\circ}\text{F}]$ for $T > T''$
	=	$[^{\circ}\text{F}]$ for $T \leq T''$,
T	=	As defined in Note 1,
T''	\leq	$[^{\circ}\text{F}]$ (Indicated Loop T_{avg} at RATED THERMAL POWER)
S	=	As defined in Note 1, and
$f_2(\Delta I)$	=	$[^{\circ}\text{F}]$

NOTE 4: The Overpower ΔT function Allowable Value shall not exceed the nominal trip setpoint by more than 0.5% ΔT span for the ΔT channel. No separate Allowable Value is provided for T_{avg} because this function is part of the ΔT value.

SECTIONS 3.0 AND 4.0
LIMITING CONDITIONS FOR OPERATION
AND
SURVEILLANCE REQUIREMENTS

3/4 LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

3/4.0 APPLICABILITY

LIMITING CONDITIONS FOR OPERATION

- 3.0.1 LCOs shall be met during the MODES or other specified conditions in the Applicability, except as provided in LCO 3.0.2.
- 3.0.2 Upon discovery of a failure to meet an LCO, the ACTIONS shall be met, except as provided in LCO 3.0.6 and LCO 3.0.7. If the LCO is met or is no longer applicable prior to expiration of the specified time interval, completion of the ACTION(S) is not required unless otherwise stated.
- 3.0.3 When a Limiting Condition for Operation is not met, except as provided in the associated ACTION requirements, within 1 hour action shall be initiated to place the unit, as applicable, in:
- a. At least HOT STANDBY within the next 6 hours,
 - b. At least HOT SHUTDOWN within the following 6 hours, and
 - c. At least COLD SHUTDOWN within the subsequent 24 hours.

Where corrective measures are completed that permit operation under the ACTION requirements, the action may be taken in accordance with the specified time limits as measured from the time of failure to meet the Limiting Condition for Operation. Exceptions to these requirements are stated in the individual specifications.

This specification is not applicable in MODES 5 or 6.

- 3.0.4 When an LCO is not met, entry into a MODE or other specified condition in the Applicability shall only be made:
- a. When the associated ACTIONS to be entered permit continued operation in the MODE or other specified condition in the Applicability for an unlimited period of time;
 - b. After performance of a risk assessment addressing inoperable systems and components, consideration of the results, determination of the acceptability of entering the MODE or other specified condition in the Applicability, and establishment of risk management actions, if appropriate; exceptions to this Specification are stated in the individual Specifications, or
 - c. When an allowance is stated in the individual value, parameter, or other Specification.

This Specification shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

APPLICABILITY

LIMITING CONDITIONS FOR OPERATION (Continued)

- 3.0.5 Limiting Conditions for Operation including the associated ACTION requirements shall apply to each unit individually unless otherwise indicated as follows:
- a. Whenever the Limiting Conditions for Operation refers to systems or components which are shared by both units, the ACTION requirements will apply to both units simultaneously.
 - b. Whenever the Limiting Conditions for Operation applies to only one unit, this will be identified in the APPLICABILITY section of the specification; and
 - c. Whenever certain portions of a specification contain operating parameters, Setpoints, etc., which are different for each unit, this will be identified in parentheses, footnotes or body of the requirement.
- 3.0.6 Equipment removed from service or declared inoperable to comply with ACTION requirements may be returned to service under administrative controls solely to perform testing required to demonstrate its OPERABILITY or the OPERABILITY of other equipment. This is an exception to LCO 3.0.1 and 3.0.2 for the system returned to service under administrative control to perform the testing required to demonstrate OPERABILITY.
- 3.0.7 When a supported system LCO is not met solely due to a support system LCO not being met, the ACTIONS associated with this supported system are not required to be entered. Only the support system LCO ACTIONS are required to be entered. This is an exception to LCO 3.0.2 for the supported system. In this event, an evaluation shall be performed in accordance with Specification 6.8.4.q, "Safety Function Determination Program (SFDP)." If a loss of safety function is determined to exist by this program, the appropriate ACTIONS of the LCO in which the loss of safety function exists are required to be entered.

When a support system's ACTION directs a supported system to be declared inoperable or directs entry into the ACTIONS for a supported system, the applicable ACTIONS shall be entered in accordance with LCO 3.0.2.

APPLICABILITY

SURVEILLANCE REQUIREMENTS

- 4.0.1 Surveillance Requirements shall be met during the OPERATIONAL MODES or other conditions specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Specification 4.0.2, shall constitute noncompliance with the OPERABILITY requirements for a Limiting Condition for Operation. Surveillance Requirements do not have to be performed on inoperable equipment.
- 4.0.2 Each Surveillance Requirement shall be performed within the specified time interval with a maximum allowable extension not to exceed 25% of the surveillance interval. If an ACTION item requires periodic performance on a "once per . . ." basis, the above frequency extension applies to each performance after the initial performance. Exceptions to this Specification are stated in the individual Specifications.
- 4.0.3 If it is discovered that a Surveillance was not performed within its specified frequency, then compliance with the requirement to declare the Limiting Condition of Operation not met may be delayed, from the time of discovery, up to 24 hours or up to the limit of the specified frequency, whichever is greater. This delay period is permitted to allow performance of the Surveillance. A risk evaluation shall be performed for any Surveillance delayed greater than 24 hours and the risk impact shall be managed.

If the surveillance is not performed within the delay period, the Limiting Condition of Operation must immediately be declared not met, and the applicable ACTION(s) must be entered.

When the Surveillance is performed within the delay period and the Surveillance is not met, the Limiting Condition of Operation must immediately be declared not met, and the applicable ACTION(s) must be entered.

- 4.0.4 Entry into a MODE or other specified condition in the Applicability of an LCO shall only be made when the LCO's Surveillances have been met within their specified frequency, except as provided by Specification 4.0.3. When an LCO is not met due to Surveillances not having been met, entry into a MODE or other specified condition in the Applicability shall only be made in accordance with Specification 3.0.4.

This provision shall not prevent entry into MODES or other specified conditions in the Applicability that are required to comply with ACTIONS or that are part of a shutdown of the unit.

4.0.5 DELETED

- a. DELETED

APPLICABILITY

SURVEILLANCE REQUIREMENTS (CONTINUED)

- b. DELETED
- c. DELETED
- d. DELETED
- e. DELETED
- f. DELETED

4.0.6 Surveillance Requirements shall apply to each unit individually unless otherwise indicated as stated in Specification 3.0.5 for individual specifications or whenever certain portions of a specification contain surveillance parameters different for each unit, which will be identified in parentheses, footnotes or body of the requirement.

3/4.1 REACTIVITY CONTROL SYSTEMS

3/4.1.1 BORATION CONTROL

SHUTDOWN MARGIN - T_{avg} GREATER THAN 200°F

LIMITING CONDITION FOR OPERATION

3.1.1.1 The SHUTDOWN MARGIN shall be within the limits specified in the COLR.

APPLICABILITY: MODES 1, 2*, 3, and 4.

ACTION:

With the SHUTDOWN MARGIN not within limits, immediately initiate and continue boration at greater than or equal to 16 gpm of a solution containing greater than or equal to 3.0 wt% (5245 ppm) boron or equivalent until the required SHUTDOWN MARGIN is restored.

SURVEILLANCE REQUIREMENTS

4.1.1.1.1 The SHUTDOWN MARGIN shall be determined to be within the limits specified in the COLR:

- a. Within 1 hour after detection of an inoperable control rod(s) and at least once per 12 hours thereafter while the rod(s) is inoperable. If the inoperable control rod is immovable or untrippable, the above required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or untrippable control rod(s);
- b. When in MODE 1 or MODE 2 with K_{eff} greater than or equal to 1 by verifying that control bank withdrawal is within the limits of Specification 3.1.3.6 in accordance with the Surveillance Frequency Control Program;
- c. When in MODE 2 with K_{eff} less than 1, within 4 hours prior to achieving reactor criticality by verifying that the predicted critical control rod position is within the limits of Specification 3.1.3.6;
- d. Prior to initial operation above 5% RATED THERMAL POWER after each fuel loading, by consideration of the factors of Specification 4.1.1.1.1e. below, with the control banks at the maximum insertion limit of Specification 3.1.3.6; and

*See Special Test Exceptions Specification 3.10.1.

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- e. In accordance with the Surveillance Frequency Control Program, when in MODE 3 or 4 by consideration of the following factors:
- 1) Reactor Coolant System boron concentration,
 - 2) Control rod position,
 - 3) Reactor Coolant System average temperature,
 - 4) Fuel burnup based on gross thermal energy generation,
 - 5) Xenon concentration, and
 - 6) Samarium concentration.

4.1.1.1.2 When in Mode 1 or 2, the overall core reactivity balance shall be compared to predicted values to demonstrate agreement within $\pm 1\% \Delta k/k$ in accordance with the Surveillance Frequency Control Program. This comparison shall consider at least those factors stated in Specification 4.1.1.1.1e, above. The predicted reactivity values shall be adjusted (normalized) to correspond to the actual core conditions prior to exceeding a fuel burnup of 60 EFPD after each fuel loading.

REACTIVITY CONTROL SYSTEMS

SHUTDOWN MARGIN - T_{avg} LESS THAN OR EQUAL TO 200°F

LIMITING CONDITION FOR OPERATION

3.1.1.2 The SHUTDOWN MARGIN shall be within the limit specified in the COLR.

APPLICABILITY: MODE 5.

ACTION:

With the SHUTDOWN MARGIN not within limits, immediately initiate and continue boration at greater than or equal to 16 gpm of a solution containing greater than or equal to 3.0 wt% (5245 ppm) boron or equivalent until the required SHUTDOWN MARGIN is restored.

SURVEILLANCE REQUIREMENTS

4.1.1.2 The SHUTDOWN MARGIN shall be determined to be within the limit specified in the COLR:

- a. Within 1 hour after detection of an inoperable control rod(s) and at least once per 12 hours thereafter while the rod(s) is inoperable. If the inoperable control rod is immovable or untrippable, the SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or untrippable control rod(s); and
- b. In accordance with the Surveillance Frequency Control Program by consideration of the following factors:
 - 1) Reactor Coolant System boron concentration,
 - 2) Control rod position,
 - 3) Reactor Coolant System average temperature,
 - 4) Fuel burnup based on gross thermal energy generation,
 - 5) Xenon concentration, and
 - 6) Samarium concentration.

REACTIVITY CONTROL SYSTEMS

MODERATOR TEMPERATURE COEFFICIENT

LIMITING CONDITION FOR OPERATION

3.1.1.3 The moderator temperature coefficient (MTC) shall be within the limits specified in the COLR. The maximum upper limit shall be less positive than or equal to $+5.0 \times 10^{-5} \Delta k/k/^{\circ}F$ for all the rods withdrawn, beginning of cycle life (BOL), for power levels up to 70% RATED THERMAL POWER with a linear ramp to 0 $\Delta k/k/^{\circ}F$ at 100 % RATED THERMAL POWER.

APPLICABILITY: Beginning of cycle life (BOL) - MODES 1 and 2* only**.
 End of life (EOL) - MODES 1, 2, and 3 only**.

ACTION:

- a. With the MTC more positive than the BOL limit specified in the COLR, operation in MODES 1 and 2 may proceed provided:
 1. Control rod withdrawal limits are established and maintained sufficient to restore the MTC to less positive or equal to the BOL limit specified in the COLR within 24 hours or be in HOT STANDBY within the next 6 hours. These withdrawal limits shall be in addition to the insertion limits of Specification 3.1.3.6;
 2. The control rods are maintained within the withdrawal limits established above until a subsequent calculation verifies that the MTC has been restored to within its limit for the all rods withdrawn condition.

* With K_{eff} greater than or equal to 1.

** See Special Test Exceptions Specification 3.10.3.

REACTIVITY CONTROL SYSTEMS

LIMITING CONDITION FOR OPERATION

ACTION: (Continued)

- b. With the MTC more negative than the EOL limit specified in the COLR, be in HOT SHUTDOWN within 12 hours.

SURVEILLANCE REQUIREMENTS

4.1.1.3 The MTC shall be determined to be within its limits during each fuel cycle as follows:

- a. The MTC shall be measured and compared to the BOL limit specified in the COLR, prior to initial operation above 5% of RATED THERMAL POWER, after each fuel loading; and
- b. The MTC shall be measured at any THERMAL POWER and compared to the 300 ppm surveillance limit specified in the COLR (all rods withdrawn, RATED THERMAL POWER condition) within 7 EFPD after reaching an equilibrium boron concentration of 300 ppm*. In the event this comparison indicates the MTC is more negative than the 300 ppm surveillance limit specified in the COLR, the MTC shall be remeasured, and compared to the EOL MTC limit specified in the COLR, at least once per 14 EFPD during the remainder of the fuel cycle.

* Measurement of the MTC in accordance with Surveillance Requirement 4.1.1.3.b may be suspended provided that the benchmark criteria in WCAP-13749-P-A and the Revised Prediction specified in the COLR are satisfied.

REACTIVITY CONTROL SYSTEMS

MINIMUM TEMPERATURE FOR CRITICALITY

LIMITING CONDITION FOR OPERATION

3.1.1.4 The Reactor Coolant System lowest operating loop temperature (T_{avg}) shall be greater than or equal to 541°F.

APPLICABILITY: MODES 1 and 2* **.

ACTION:

With a Reactor Coolant System operating loop temperature (T_{avg}) less than 541°F, restore T_{avg} to within its limit within 15 minutes or be in HOT STANDBY within the next 15 minutes.

SURVEILLANCE REQUIREMENTS

4.1.1.4 The Reactor Coolant System temperature (T_{avg}) shall be determined to be greater than or equal to 541°F:

- a. Within 15 minutes prior to achieving reactor criticality, and
- b. At least once per 30 minutes when the reactor is critical and the Reactor Coolant System T_{avg} is less than 547°F with the $T_{avg} - T_{ref}$ Deviation Alarm not reset.

* With K_{eff} greater than or equal to 1.

** See Special Test Exceptions Specification 3.10.3.

REACTIVITY CONTROL SYSTEMS

3/4.1.2 BORATION SYSTEMS

FLOW PATH - SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.1.2.1 As a minimum, one of the following boron injection flow paths shall be OPERABLE and capable of being powered from an OPERABLE emergency power source:

- a. A flow path from the boric acid storage tanks via a boric acid transfer pump and a charging pump to the Reactor Coolant System if the boric acid storage tank in Specification 3.1.2.4a. is OPERABLE, or
- b. The flow path from the refueling water storage tank via a charging pump to the Reactor Coolant System if the refueling water storage tank in Specification 3.1.2.4b. is OPERABLE.

APPLICABILITY: MODES 5 and 6.

ACTION:

With none of the above flow paths OPERABLE or capable of being powered from an OPERABLE emergency power source, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

SURVEILLANCE REQUIREMENTS

4.1.2.1 At least one of the above required flow paths shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying that the temperature of the rooms containing flow path components is greater than or equal to 62°F when a flow path from the boric acid tanks is used, and
- b. In accordance with the Surveillance Frequency Control Program by verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.

REACTIVITY CONTROL SYSTEMS

FLOW PATHS - OPERATING

LIMITING CONDITION FOR OPERATION

3.1.2.2 The following boron injection flow paths shall be OPERABLE:

- a. The source path from a boric acid storage tank via a boric acid transfer pump to the charging pump suction*, and
- b. At least one of the two source paths from the refueling water storage tank to the charging pump suction; and,
- c. The flow path from the charging pump discharge to the Reactor Coolant System via the regenerative heat exchanger.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With no boration source path from a boric acid storage tank OPERABLE,
 1. Demonstrate the OPERABILITY of the second source path from the refueling water storage tank to the charging pump suction by verifying the flow path valve alignment; and
 2. Restore the boration source path from a boric acid storage tank to OPERABLE status within 70 hours or be in at least HOT STANDBY and borated to a boron concentration equivalent to at least the required SHUTDOWN MARGIN at COLD SHUTDOWN at 200°F within the next 8 hours; restore the boration source path from a boric acid storage tank to OPERABLE status within the next 72 hours or be in COLD SHUTDOWN within the next 30 hours.
- b. With only one boration source path OPERABLE or the regenerative heat exchanger flow path to the RCS inoperable, restore the required flow paths to OPERABLE status within 70 hours or be in at least HOT STANDBY and borated to a boron concentration equivalent to at least the required SHUTDOWN MARGIN at COLD SHUTDOWN at 200°F within the next 8 hours; restore at least two boration source paths to OPERABLE status within the next 72 hours or be in COLD SHUTDOWN within the next 30 hours.
- c. With the boration source path from a boric acid storage tank and the charging pump discharge path via the regenerative heat exchanger inoperable, within one hour initiate boration to a boron concentration equivalent to the required SHUTDOWN MARGIN at COLD SHUTDOWN at 200°F and go to COLD SHUTDOWN as soon as possible within the limitations of the boration and pressurizer level control functions of the CVCS.

* The flow required in Specification 3.1.2.2.a above shall be isolated from the other unit from the boric acid transfer pump discharge to the charging pump suction.

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS

4.1.2.2 The above required flow paths shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying that the temperature of the rooms containing flow path components is greater than or equal to 62°F when a flow path from the boric acid tanks is used;
- b. In accordance with the Surveillance Frequency Control Program by verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position;
- c. In accordance with the Surveillance Frequency Control Program by verifying that the flow path required by Specification 3.1.2.2a. and c. delivers at least 16 gpm to the RCS.

REACTIVITY CONTROL SYSTEMS

CHARGING PUMPS - OPERATING

LIMITING CONDITION FOR OPERATION

3.1.2.3 At least two charging pumps shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With only one charging pump OPERABLE, restore at least two charging pumps to OPERABLE status within 70 hours or be in at least HOT STANDBY and borated to a boron concentration equivalent to at least the required SHUTDOWN MARGIN at COLD SHUTDOWN at 200°F within 8 hours; restore at least two charging pumps to OPERABLE status within 72 hours or be in COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

4.1.2.3.1 The required charging pumps shall be demonstrated OPERABLE by testing in accordance with the INSERVICE TESTING PROGRAM. The provisions of Specification 4.0.4 are not applicable for entry into MODES 3 and 4.

REACTIVITY CONTROL SYSTEMS

BORATED WATER SOURCE - SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.1.2.4 As a minimum, one of the following borated water sources shall be OPERABLE:

- a. A Boric Acid Storage System with:
 - 1) A minimum indicated borated water volume of 2,900 gallons per unit,
 - 2) A boron concentration between 3.0 wt% (5245 ppm) and 4.0 wt.% (6993 ppm), and
 - 3) A minimum boric acid tanks room temperature of 62°F.
- b. The refueling water storage tank (RWST) with:
 - 1) A minimum indicated borated water volume of 20,000 gallons,
 - 2) A boron concentration between 2400 ppm and 2600 ppm, and
 - 3) A minimum solution temperature of 39°F.

APPLICABILITY: MODES 5 and 6.

ACTION:

With no borated water source OPERABLE, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

SURVEILLANCE REQUIREMENTS

4.1.2.4 The above required borated water source shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying the boron concentration of the water,
 - 2) Verifying the indicated borated water volume, and
 - 3) Verifying that the temperature of the boric acid tanks room is greater than or equal to 62°F, when it is the source of borated water.

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- b. By verifying the RWST temperature is above its limit whenever the outside air temperature is less than 39° at the following frequencies:
 - 1) Within one hour when the outside temperature is below 39° for 23 consecutive hours, and
 - 2) At least once per 24 hours when the outside temperature is below 39°.

REACTIVITY CONTROL SYSTEMS

BORATED WATER SOURCES - OPERATING

LIMITING CONDITION FOR OPERATION

3.1.2.5 The following borated water sources shall be OPERABLE:

- a. A Boric Acid Storage System with:
 - 1) A minimum indicated borated water volume in accordance with Figure 3.1-2,
 - 2) A boron concentration in accordance with Figure 3.1-2. and
 - 3) A minimum boric acid tanks room temperature of 62°F.
- b. The refueling water storage tank (RWST) with:
 - 1) A minimum indicated borated water volume of 320,000 gallons,
 - 2) A boron concentration between 2400 ppm and 2600 ppm.
 - 3) A minimum solution temperature of 39°F, and
 - 4) A maximum solution temperature of 100°F.


APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With the required Boric Acid Storage System inoperable verify that the RWST is OPERABLE; restore the system to OPERABLE status within 70 hours or be in at least HOT STANDBY within the next 8 hours* and borated to a boron concentration equivalent to at least the required SHUTDOWN MARGIN at COLD SHUTDOWN at 200°F; restore the Boric Acid Storage System to OPERABLE status within the next 72 hours or be in COLD SHUTDOWN within the next 30 hours.
- b. With the RWST inoperable, restore the tank to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With the boric acid tank inventory concentration greater than 4.0 wt%, verify that the boric acid solution temperature for boration sources and flow paths is greater than the solubility limit for the concentration.

* If this action applies to both units simultaneously, be in at least HOT STANDBY within the next sixteen hours.

Figure 3.1-2
BORIC ACID TANK MINIMUM VOLUME (1)
Modes 1, 2, 3 and 4

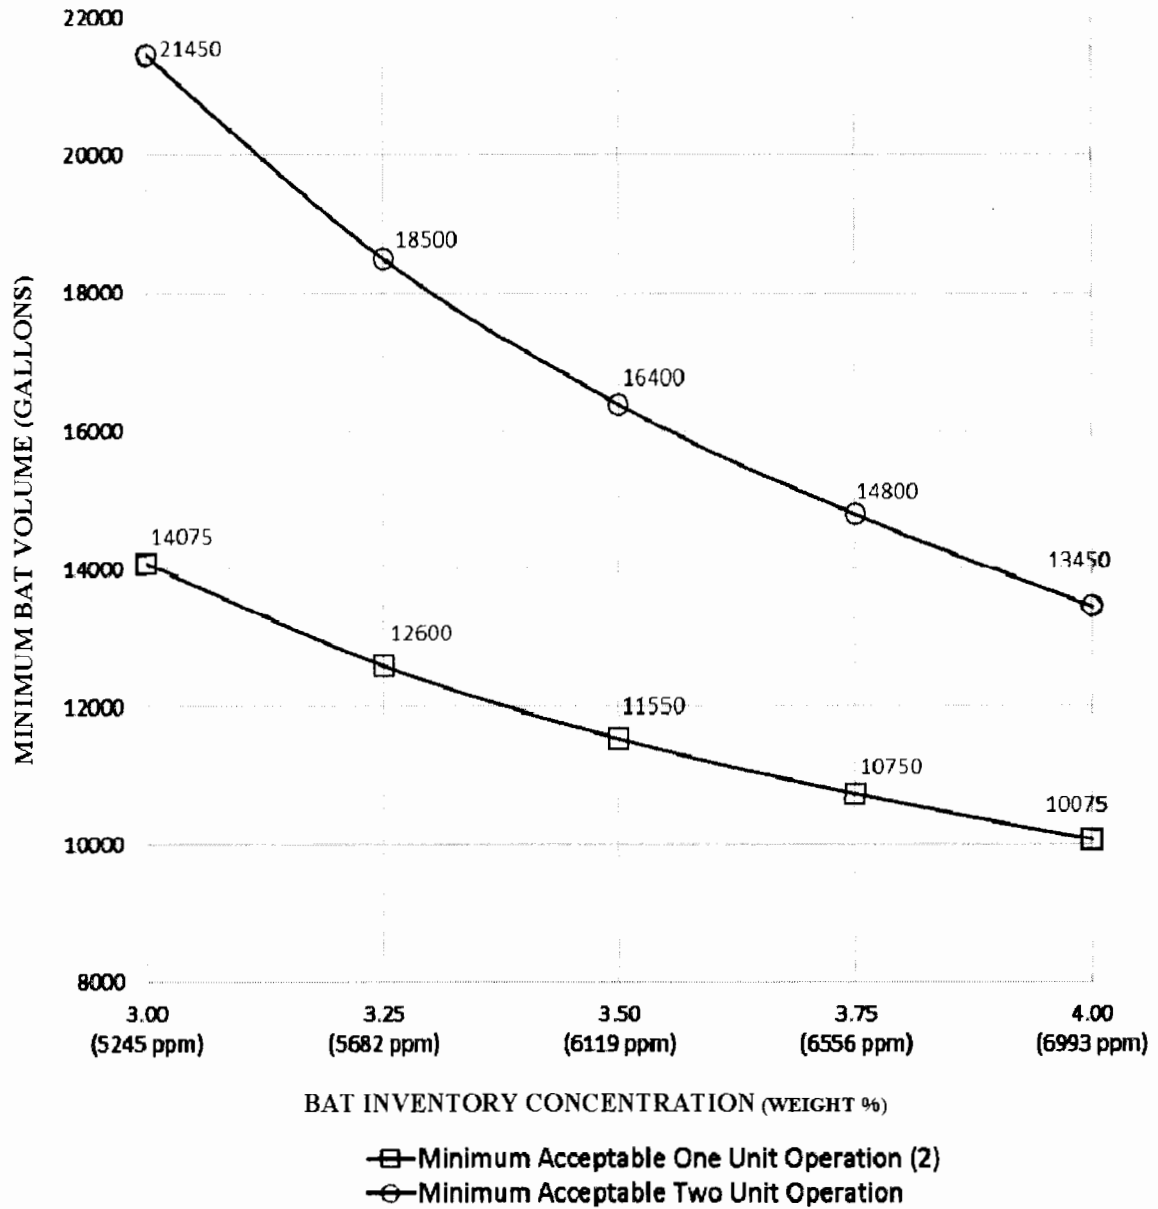

Notes:

- (1) Combined volume of all available boric acid tanks assuming RWST boron concentration between 2400 ppm and 2600 ppm.
- (2) Includes 2900 gallons for the shutdown unit.

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS

4.1.2.5 Each borated water source shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying the boron concentration in the water,
 - 2) Verifying the indicated borated water volume of the water source, and
 - 3) Verifying that the temperature of the boric acid tanks room is greater than or equal to 62°F, when it is the source of borated water.
- b. By verifying the RWST temperature is within limits whenever the outside air temperature is less than 39°F or greater than 100°F at the following frequencies:
 - 1) Within one hour upon the outside temperature exceeding its limit for 23 consecutive hours, and
 - 2) At least once per 24 hours while the outside temperature exceeds its limits.

REACTIVITY CONTROL SYSTEMS

3/4.1.3 MOVABLE CONTROL ASSEMBLIES

GROUP HEIGHT

LIMITING CONDITION FOR OPERATION

3.1.3.1 All full length (shutdown and control) rods shall be OPERABLE and positioned within the Allowed Rod Misalignment between the Analog Rod Position Indication and the group step counter demand position within one hour after rod motion. The Allowed Rod Misalignment shall be defined as:

- a. for THERMAL POWER less than or equal to 90% of RATED THERMAL POWER, the Allowed Rod Misalignment is ± 18 steps, and
- b. for THERMAL POWER greater than 90% of RATED THERMAL POWER, the Allowed Rod Misalignment is ± 12 steps.

APPLICABILITY: MODES 1* and 2*

ACTION:

- a. With one or more full length rods inoperable due to being immovable as a result of excessive friction or mechanical interference or known to be untrippable, determine that the SHUTDOWN MARGIN requirement of Specification 3.1.1.1 is satisfied within 1 hour and be in HOT STANDBY within 6 hours.
- b. With more than one full length rod inoperable or misaligned from the group step counter demand position by more than ± 12 steps and THERMAL POWER greater than 90% of RATED THERMAL POWER, within 1 hour either:
 - 1. Restore all indicated rod positions to within the Allowed Rod Misalignment, or
 - 2. Reduce THERMAL POWER to less than 90% of RATED THERMAL POWER and confirm that all indicated rod positions are within the Allowed Rod Misalignment, or
 - 3. Be in HOT STANDBY within the following 6 hours.
- c. With more than one full length rod inoperable or misaligned from the group step counter demand position by more than ± 18 steps and THERMAL POWER less than or equal to 90% of RATED THERMAL POWER, within 1 hour either:
 - 1. Restore all indicated rod positions to within the Allowed Rod Misalignment, or
 - 2. Be in HOT STANDBY within the following 6 hours.

* See Special Test Exceptions 3.10.2 and 3.10.3.

REACTIVITY CONTROL SYSTEMS
LIMITING CONDITION FOR OPERATION (Continued)

- d. With one full length rod inoperable due to causes other than addressed by ACTION a, above, or misaligned from its group step counter demand position by more than the Allowed Rod Misalignment of Specification 3.1.3.1, POWER OPERATION may continue provided that within one hour either:
1. The rod is restored to OPERABLE status within the Allowed Rod Misalignment of Specification 3.1.3.1, or
 2. The remainder of the rods in the bank with the inoperable rod are aligned to within the Allowed Rod Misalignment of Specification 3.1.3.1 of the inoperable rod while maintaining the rod sequence and insertion limits of Specification 3.1.3.6; the THERMAL POWER level shall be restricted pursuant to Specification 3.1.3.6 during subsequent operation, or
 3. The rod is declared inoperable and the SHUTDOWN MARGIN requirement of Specification 3.1.1.1 is satisfied. POWER OPERATION may then continue provided that:
 - a) The THERMAL POWER level is reduced to less than or equal to 75% of RATED THERMAL POWER within one hour and within the next 4 hours the power range neutron flux high trip setpoint is reduced to less than or equal to 85% of RATED THERMAL POWER. THERMAL POWER shall be maintained less than or equal to 75% of RATED THERMAL POWER until compliance with ACTIONS 3.1.3.1.d.3.c and 3.1.3.1.d.3.d below are demonstrated, and
 - b) The SHUTDOWN MARGIN requirement of Specification 3.1.1.1 is determined at least once per 12 hours, and
 - c) A power distribution map is obtained from the movable incore detectors and $F_Q(Z)$ and $F_{\Delta H}^N$ are verified to be within their limits within 72 hours, and
 - d) A reevaluation of each accident analysis of Table 3.1-1 is performed within 5 days; this reevaluation shall confirm that the previously analyzed results of these accidents remain valid for the duration of operation under these conditions.

SURVEILLANCE REQUIREMENTS

4.1.3.1.1 The position of each full length rod shall be determined to be within the Allowed Rod Misalignment of the group step counter demand position in accordance with the Surveillance Frequency Control Program (allowing for one hour thermal soak after rod motion) except during time intervals when the Rod Position Deviation Monitor is inoperable, then verify the group positions at least once per 4 hours.

4.1.3.1.2 Each full length rod not fully inserted in the core shall be determined to be OPERABLE by movement of at least 10 steps in any one direction in accordance with the Surveillance Frequency Control Program.

TABLE 3.1-1

ACCIDENT ANALYSES REQUIRING REEVALUATION
IN THE EVENT OF AN INOPERABLE FULL-LENGTH ROD

Rod Cluster Control Assembly Insertion Characteristics

Rod Cluster Control Assembly Misalignment

Loss of Reactor Coolant from Small Ruptured Pipes or from Cracks in Large Pipes Which Actuates the Emergency Core Cooling System

Single Rod Cluster Control Assembly Withdrawal at Full Power

Major Reactor Coolant System Pipe Ruptures (Loss-of-Coolant Accident)

Major Secondary Coolant System Pipe Rupture

Rupture of a Control Rod Drive Mechanism Housing (Rod Cluster Control Assembly Ejection)

REACTIVITY CONTROL SYSTEMS

POSITION INDICATION SYSTEMS - OPERATING

LIMITING CONDITION FOR OPERATION (Continued)

3.1.3.2 The Analog Rod Position Indication System and the Demand Position Indication System shall be OPERABLE and capable of determining the respective actual and demanded shutdown and control rod positions as follows:

- a. Analog rod position indicators, within one hour after rod motion (allowance for thermal soak);

All Shutdown Banks: within the Allowed Rod Misalignment of Specification 3.1.3.1 of the group demand counters for withdrawal ranges of 0-30 steps and 200-All Rods Out as defined in the Core Operating Limits Report.

Control Bank A and B: within the Allowed Rod Misalignment of Specification 3.1.3.1 of the group demand counters for withdrawal ranges of 0-30 steps and 200-All Rods Out as defined in the Core Operating Limits Report.

Control Banks C and D: within the Allowed Rod Misalignment of Specification 3.1.3.1 of the group demand counters for withdrawal range of 0-All Rods Out as defined in the Core Operating Limits Report.
- b. Group demand counters; ± 2 steps.

APPLICABILITY: MODES 1 and 2.

ACTION:

- a. With a maximum of one analog rod position indicator per bank inoperable either:
 - 1. Determine the position of the non-indicating rod(s) indirectly by the movable incore detectors at least once per 8 hours and within one hour after any motion of the non-indicating rod which exceeds 24 steps in one direction since the last determination of the rod's position, or
 - 2**
 - a). Determine the position of the non-indicating rod indirectly by the movable incore detectors within 8 hours and once every 31 Effective Full Power Days thereafter, and within 1 hour if rod control system parameters indicate unintended movement, or if the rod with an inoperable position indicator is moved greater than 12 steps, and
 - b). Review the parameters of the rod control system for indications of unintended rod movement for the rod with an inoperable indicator within 8 hours and once per 8 hours thereafter, and
 - c). Determine the position of the non-indicating rod indirectly by the movable incore detectors prior to increasing THERMAL POWER above 50% RATED THERMAL POWER and within 8 hours of reaching 100% RATED THERMAL POWER, or
 - 3. Reduce THERMAL POWER to less than 75% of RATED THERMAL POWER within 8 hours.

REACTIVITY CONTROL SYSTEMS

POSITION INDICATION SYSTEMS - OPERATING

LIMITING CONDITION FOR OPERATION (Continued)

ACTION (Continued):

- b. With a maximum of one demand position indicator per bank inoperable either:
 - 1. Verify that all analog rod position indicators for the affected bank are OPERABLE and that the most withdrawn rod and the least withdrawn rod of the bank are within the Allowed Rod Misalignment of Specification 3.1.3.1 at least once per 8 hours, or
 - 2. Reduce THERMAL POWER to less than 75% of RATED THERMAL POWER within 8 hours.

**Rod position monitoring by Actions a.2.a), a.2.b), and a.2.c) may only be applied to one inoperable rod position indicator per unit and shall only be allowed until an entry into MODE 3.

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS

4.1.3.2.1 Each analog rod position indicator shall be determined to be OPERABLE by verifying that the Demand Position Indication System and the Analog Rod Position Indication System agree within the Allowed Rod Misalignment of Specification 3.1.3.1 (allowing for one hour thermal soak after rod motion) in accordance with the Surveillance Frequency Control Program except during time intervals when the Rod Position Deviation Monitor is inoperable, then compare the Demand Position Indication System and the Analog Rod Position Indication System at least once per 4 hours.

4.1.3.2.2 Each of the above required analog rod position indicator(s) shall be determined to be OPERABLE by performance of a CHANNEL CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST performed in accordance with the Table 4.1-1.

TABLE 4.1-1

ROD POSITION INDICATOR SURVEILLANCE REQUIREMENTS

<u>Functional Unit</u>	<u>Check</u>	<u>Calibration</u>	<u>Operational Test</u>	
Individual Rod Position	SFCP	SFCP	SFCP	
Demand Position	SFCP	N/A	SFCP	

REACTIVITY CONTROL SYSTEMS

POSITION INDICATION SYSTEM - SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.1.3.3 The group step counter demand position indicator shall be OPERABLE and capable of determining within ± 2 steps the demand position for each shutdown and control rod not fully inserted.

APPLICABILITY: MODES 3* **, 4* **, and 5* **

ACTION:

With less than the above required group step counter demand position indicator(s) OPERABLE, open the reactor trip system breakers.

SURVEILLANCE REQUIREMENTS

4.1.3.3.1 Each of the above required group step counter demand position indicator(s) shall be determined to be OPERABLE by movement of the associated control rod at least 10 steps in any one direction in accordance with the Surveillance Frequency Control Program.

4.1.3.3.2 OPERABILITY of the group step counter demand position indicator shall be verified in accordance with Table 4.1-1.

* With the Reactor Trip System breakers in the closed position.

** See Special Test Exceptions Specification 3.10.5.

REACTIVITY CONTROL SYSTEMS

ROD DROP TIME

LIMITING CONDITION FOR OPERATION

3.1.3.4 The individual full-length (shutdown and control) rod drop time from the fully withdrawn position shall be less than or equal to 2.4 seconds from beginning of decay of stationary gripper coil voltage to dashpot entry with:

- a. T_{avg} greater than or equal to 500°F, and
- b. All reactor coolant pumps operating.

APPLICABILITY: MODES 1 and 2.

ACTION:

With the drop time of any full-length rod determined to exceed the above limit, restore the rod drop time to within the above limit prior to proceeding to MODE 1 or 2.

SURVEILLANCE REQUIREMENTS

4.1.3.4 The rod drop time of full-length rods shall be demonstrated through measurement prior to reactor criticality:

- a. For all rods following each removal of the reactor vessel head,
- b. For specifically affected individual rods following any maintenance on or modification to the Control Rod Drive System which could affect the drop time of those specific rods, and
- c. In accordance with the Surveillance Frequency Control Program.

REACTIVITY CONTROL SYSTEMS

SHUTDOWN ROD INSERTION LIMIT

LIMITING CONDITION FOR OPERATION

3.1.3.5 All shutdown rods shall be fully withdrawn.

APPLICABILITY: MODES 1* and 2* **

ACTION:

With a maximum of one shutdown rod not fully withdrawn, except for surveillance testing pursuant to Specification 4.1.3.1.2, within 1 hour either:

- a. Fully withdraw the rod, or
- b. Declare the rod to be inoperable and apply Specification 3.1.3.1.

SURVEILLANCE REQUIREMENTS

4.1.3.5 Each shutdown rod shall be determined to be fully withdrawn:

- a. Within 15 minutes prior to withdrawal of any rods in control banks A, B, C, or D during an approach to reactor criticality, and
- b. In accordance with the Surveillance Frequency Control Program thereafter.

*See Special Test Exceptions Specifications 3.10.2 and 3.10.3.

**With K_{eff} greater than or equal to 1.0

REACTIVITY CONTROL SYSTEMS

CONTROL ROD INSERTION LIMITS

LIMITING CONDITION FOR OPERATION

3.1.3.6 The control banks shall be limited in physical insertion specified in the Rod Bank Insertion Limits curve, defined in the CORE OPERATING LIMITS REPORT.

APPLICABILITY: MODES 1* and 2* **

ACTION:

With the control banks inserted beyond the above insertion limits, except for surveillance testing pursuant to Specification 4.1.3.1.2 either:

- a. Restore the control banks to within the limits within 2 hours, or
- b. Reduce THERMAL POWER within two hours to less than or equal to that fraction of RATED THERMAL POWER which is allowed by the bank position specified in the Rod Bank Insertion Limits curve, defined in the CORE OPERATING LIMITS REPORT, or
- c. Be in at least HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

4.1.3.6 The position of each control bank shall be determined to be within the insertion limits in accordance with the Surveillance Frequency Control Program, except during time intervals when the Rod Insertion Limit Monitor is inoperable, then verify the individual rod positions at least once per 4 hours.

* See Special Test Exceptions Specifications 3.10.2 and 3.10.3.

** With K_{eff} greater than or equal to 1.0

3/4.2 POWER DISTRIBUTION LIMITS

3/4.2.1 AXIAL FLUX DIFFERENCE

LIMITING CONDITION FOR OPERATION

3.2.1 The indicated AXIAL FLUX DIFFERENCE (AFD) shall be maintained within:

- a. the allowed Relaxed Axial Offset Control (RAOC) operational space as defined in the CORE OPERATING LIMITS REPORT (COLR), or
- b. within a +/- 2% or +/- 3% target band about the target flux difference during Base Load operation.

APPLICABILITY: MODE 1, above 50% of RATED THERMAL POWER*.

ACTION***:

- a. For RAOC operation with the indicated AFD outside of the limits specified in the COLR, either
 1. Restore the indicated AFD to within the RAOC limits within 15 minutes, or
 2. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within 30 minutes and reduce the Power Range Neutron Flux - High Trip setpoint to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours.
- b. For Base Load operation above P_T^{**} with the indicated AFD outside of the applicable target band about the target flux difference, either
 1. Restore the indicated AFD to within the Peaking Factor Limit Report target band limits within 15 minutes, or
 2. Reduce THERMAL POWER to less than P_T and discontinue Base Load operation within 30 minutes.
- c. THERMAL POWER shall not be increased above 50% of RATED THERMAL POWER unless indicated AFD is within the limits specified in the COLR.

* See Special Test Exceptions Specification 3.10.2.

** P_T = Reactor Power at which predicted F_Q would exceed its limit
(consistent with Specification 4.2.2.1).

*** The indicated AFD shall be considered outside of its target band when two or more OPERABLE excore channels are indicating the AFD to be outside the target band.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS

4.2.1.1 The indicated AFD shall be determined to be within its limits during POWER OPERATION above 50% of RATED THERMAL POWER by:

- a. Monitoring the indicated AFD for each OPERABLE excore channel:
 - 1) In accordance with the Surveillance Frequency Control Program when the alarm used to monitor the AFD is OPERABLE, and
 - 2) At least once per hour for the first 6 hours after restoring the alarm used to monitor the AFD to OPERABLE status.*
- b. Monitoring and logging the indicated AFD for each OPERABLE excore channel at least once per hour for the first 24 hours and at least once per 30 minutes thereafter, when the alarm used to monitor the AFD is inoperable. The logged values of the indicated AFD shall be assumed to exist during the interval preceding each logging.

4.2.1.2 The target flux difference of each OPERABLE excore channel shall be determined by measurement in accordance with the Surveillance Frequency Control Program. The provisions of Specification 4.0.4 are not applicable.

4.2.1.3 In accordance with the Surveillance Frequency Control Program, the target flux difference shall be updated by either determining the target flux difference pursuant to Specification 4.2.1.2 above or by linear interpolation between the most recently measured value and the predicted value at the end of the cycle life. The provisions of Specification 4.0.4 are not applicable.

* Performance of a functional test to demonstrate OPERABILITY of the alarm used to monitor the AFD may be substituted for this requirement.

POWER DISTRIBUTION LIMITS

3/4.2.2 HEAT FLUX HOT CHANNEL FACTOR - $F_Q^{(Z)}$

LIMITING CONDITION FOR OPERATION

3.2.2 $F_Q^L(Z)$ shall be limited by the following relationships:

$$F_Q^M(Z) \leq \frac{[F_Q]^L}{P} [K(Z)] \text{ for } P > 0.5$$

$$F_Q^M(Z) \leq \frac{[F_Q]^L}{0.5} [K(Z)] \text{ for } P \leq 0.5$$

where: $[F_Q]^L = F_Q$ limit at RATED THERMAL POWER as specified in the CORE OPERATING LIMITS REPORT

$$P = \frac{\text{Thermal Power}}{\text{Rated Thermal Power}},$$

$[F_Q]^M =$ The Measured Value, and

$K(Z)$ for a given core height, is specified in the $K(Z)$ curve, defined in the CORE OPERATING LIMITS REPORT.

APPLICABILITY: MODE 1

ACTION:

With the measured value of $F_Q^M(Z)$ exceeding its limit:

- a. Reduce THERMAL POWER at least 1% for each 1% $F_Q^M(Z)$ exceeds $F_Q^L(Z)$ within 15 minutes and similarly reduce the Power Range Neutron Flux-High Trip Setpoints within the next 4 hours: POWER OPERATION may proceed for up to a total of 72 hours; subsequent POWER OPERATION may proceed provided the Overpower Delta-T Trip Setpoints (value of K_4) have been reduced at least 1% for each 1% $F_Q^M(Z)$ exceeds the $F_Q^L(Z)$; and
- b. Identify and correct the cause of the out-of-limit condition prior to increasing THERMAL POWER above the reduced power limit required by ACTION a., above; THERMAL POWER may then be increased provided $F_Q^M(Z)$ is demonstrated through incore mapping to be within its limit.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS

4.2.2.1 If $[F_Q]^P$ as predicted by approved physics calculations is greater than $[F_Q]^L$ and P is greater than P_T^* as defined in 4.2.2.2, $F_Q(Z)$ shall be evaluated by MIDS (Specification 4.2.2.2), BASE LOAD (Specification 4.2.2.3) or RADIAL BURNDOWN (Specification 4.2.2.4) to determine if F_Q is within its limit $[F_Q]^P = \text{Predicted } F_Q$.

If $[F_Q]^P$ is less than $[F_Q]^L$ or P is less than P_T , $F_Q(Z)$ shall be evaluated to determine if $F_Q(Z)$ is within its limit as follows:

- a. Using the movable incore detectors to obtain power distribution map at any THERMAL POWER greater than 5% of RATED THERMAL POWER.
- b. Increasing the measured $F_Q(Z)$ component of the power distribution map by 3% to account for manufacturing tolerances and further increasing the value by 5% to account for measurement uncertainties. Verifying that the requirements of Specification 3.2.2 are satisfied.

c. $F_Q^M(Z) \leq F_Q^L(Z)$

Where $F_Q^M(Z)$ is the measured $F_Q(Z)$ increased by the allowance for manufacturing tolerances and measurement uncertainty and $F_Q^L(Z)$ is the F_Q limit defined in 3.2.2.

- d. Measuring $F_Q^M(Z)$ according to the following schedule:
 1. Prior to exceeding 75% of RATED THERMAL POWER,** after refueling,
 2. In accordance with the Surveillance Frequency Control Program.
- e. With the relationship specified in Specification 4.2.2.1.c above not being satisfied:
 - 1) Calculate the percent $F_Q^M(Z)$ exceeds its limit by the following expression:

$$\left[\left[\frac{F_Q^M(Z)}{[F_Q]^L \times K(Z)/P} \right] - 1 \right] \times 100 \text{ for } P \geq 0.5$$
$$\left[\left[\frac{F_Q^M(Z)}{[F_Q]^L \times K(Z)/0.5} \right] - 1 \right] \times 100 \text{ for } P < 0.5$$

* P_T = Reactor power level at which predicted F_Q would exceed its limit.

** During power escalation at the beginning of each cycle, power level may be increased until a power level for extended operation has been achieved and power distribution map obtained.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- 2) The following action shall be taken:
 - a) Comply with the requirements of Specification 3.2.2 for $F_Q^M(Z)$ exceeding its limit by the percent calculated above.

4.2.2.2 MIDS

Operation is permitted at power above P_T where P_T equals the ratio of $[F_Q]^L$ divided by $[F_Q]^P$ if the following Augmented Surveillance (Movable Incore Detection System, MIDS) requirements are satisfied:

- a. The axial power distribution shall be measured by MIDS when required such that the limit of $[F_Q]^L/P$ times $K(Z)$ is not exceeded. $F_j(Z)$ is the normalized axial power distribution from thimble j at core elevation (Z).
 - 1) If $F_j(Z)$ exceeds $[F_j(Z)]_s^*$ as defined in the bases by $\leq 4\%$, immediately reduce thermal power one percent for every percent by which $[F_j(Z)]_s$ is exceeded.
 - 2) If $F_j(Z)$ exceeds $[F_j(Z)]_s$ by $> 4\%$ immediately reduce thermal power below P_T . Corrective action to reduce $F_j(Z)$ below the limit will permit return to thermal power not to exceed current P_L^{**} as defined in the bases.
- b. $F_j(Z)$ shall be determined to be within limits by using MIDS to monitor the thimbles required per Specification 4.2.2.2.c at the following frequencies.
 1. In accordance with the Surveillance Frequency Control Program, and
 2. Immediately following and as a minimum at 2, 4 and 8 hours following the events listed below and in accordance with the Surveillance Frequency Control Program thereafter.
 - 1) Raising the thermal power above P_T , or
 - 2) Movement of control-bank D more than an accumulated total of 15 steps in any one direction.
- c. MIDS shall be operable when the thermal power exceeds P_T with:
 - 1) At least two thimbles available for which \bar{R}_j and σ_j as defined in the bases have been determined.

* $[F_j(Z)]_s$ is the alarm setpoint for MIDS.

** P_L is reactor thermal power expressed as a fraction of the Rated Thermal Power that is used to calculate $[F_j(Z)]_s$.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

2. At least two movable detectors available for mapping $F_j(Z)$.
3. The continued accuracy and representativeness of the selected thimbles shall be verified by using the most recent flux map to update the \bar{R} for each selected thimble. The flux map must be updated in accordance with the Surveillance Frequency Control Program.

where:

\bar{R} = Total peaking factor from a full flux map ratioed to the axial peaking factor in a selected thimble.

j - The thimble location selected for monitoring.

4.2.2.3 Base Load

Base Load operation is permitted at powers above P_T if the following requirements are satisfied:

- a. Either of the following preconditions for Base Load operation must be satisfied.
 1. For entering Base Load operation with power less than P_T ,
 - a) Maintain THERMAL POWER between $P_T/1.05$ and P_T for at least 24 hours,
 - b) Maintain the AFD (Delta-I) to within a $\pm 2\%$ or $\pm 3\%$ target band for at least 23 hours per 24-hour period.
 - c) After 24 hours have elapsed, take a full core flux map to determine $F_Q^M(Z)$ unless a valid full core flux map was taken within the time period specified in 4.2.2.1d.
 - d) Calculate P_{BL} per 4.2.2.3b.
 2. For entering Base Load operation with power greater than P_T ,
 - a) Maintain THERMAL POWER between P_T and the power limit determined in 4.2.2.2 for at least 24 hours, and maintain Augmented Surveillance requirements of 4.2.2.2 during this period.
 - b) Maintain the AFD (Delta-I) to within a $\pm 2\%$ or $\pm 3\%$ target band for at least 23 hours per 24-hour period,

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

- c) After 24 hours have elapsed, take a full core flux map to determine $F_Q^M(Z)$ unless a valid full core flux map was taken within the time period specified in 4.2.2.1d.
- d) Calculate P_{BL} per 4.2.2.3b.
- b. Base Load operation is permitted provided:
 - 1. THERMAL POWER is maintained between P_T and P_{BL} or between P_T and 100% (whichever is most limiting).
 - 2. AFD (Delta-I) is maintained within a $\pm 2\%$ or $\pm 3\%$ target band.
 - 3. Full core flux maps are taken at least once per 31 effective Full Power Days.

P_{BL} and P_T are defined as:

$$P_{BL} = \frac{[F_Q]^L \times K(Z)}{F_Q^M(Z) \times W(Z)_{BL} \times 1.09}$$

$$P_T = [F_Q]^L / [F_Q]^P$$

where: $F_Q^M(Z)$ is the measured $F_Q(Z)$ with no allowance for manufacturing tolerances or measurement uncertainty. For the purpose of this Specification $[F_Q^M(Z)]$ shall be obtained between elevations bounded by 10% and 90% of the active core height. $[F_Q]^L$ is the F_Q limit. $K(Z)$ is given in the CORE OPERATING LIMITS REPORT. $W(Z)_{BL}$ is the cycle dependent function that accounts for limited power distribution transients encountered during base load operation.

The function is given in the Peaking Factor Limit Report as per Specification 6.9.1.6. The 9% uncertainty factor accounts for manufacturing tolerance, measurement error, rod bow and any burnup and power dependent peaking factor increases.

- c. During Base Load operation, if the THERMAL Power is decreased below P_T , then the conditions of 4.2.2.3.a shall be satisfied before re-entering Base Load operation.
- d. If any of the conditions of 4.2.2.3b are not maintained, reduce THERMAL POWER to less than or equal to P_T , or, within 15 minutes initiate the Augmented Surveillance (MIDS) requirements of 4.2.2.2.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS (Continued)

4.2.2.4 RADIAL BURNDOWN

Operation is permitted at powers above P_T if the following Radial Burndown conditions are satisfied:

- a. Radial Burndown operation is restricted to use at powers between P_T and P_{RB} or P_T and 1.00 (whichever is most limiting). The maximum relative power permitted under Radial Burndown operation, P_{RB} , is equal to minimum value of the ratio of $[F_Q^L(Z)]/[F_Q(Z)]_{RB}$ Meas.

where: $[F_Q(Z)]_{RB}$ Meas. $= [F_{xy}(Z)]_{Map}$ Meas. $\times F_z(Z) \times 1.09$ and

$[F_Q^L(Z)]$ is equal to $[F_Q^L] \times K(Z)$.

- b. A full core flux map to determine $[F_{xy}(Z)]_{Map}$ Meas. shall be taken within the time period specified in Section 4.2.2.1d.2. For the purpose of the specification, $[F_{xy}(Z)]_{Map}$ Meas. shall be obtained between the elevations bounded by 10% and 90% of the active core height.
- c. The function $F_z(Z)$, provided in the Peaking Factor Limit Report (6.9.1.6), is determined analytically and accounts for the most perturbed axial power shapes which can occur under axial power distribution control. The uncertainty factor of 9% accounts for manufacturing tolerances, measurement error, rod bow, and any burnup dependent peaking factor increases.
- d. Radial Burndown operation may be utilized at powers between P_T and P_{RB} , or P_T and 1.00 (whichever is most limiting) provided that the AFD (Delta-I) is within $\pm 5\%$ of the target axial offset.
- e. If the requirements of Section 4.2.2.4d are not maintained, then the power shall be reduced to less than or equal to P_T , or within 15 minutes Augmented Surveillance of hot channel factors shall be initiated if the power is above P_T .

4.2.2.5 When $F_Q(Z)$ is measured for reasons other than meeting the requirements of Specifications 4.2.2.1, 4.2.2.2, 4.2.2.3 or 4.2.2.4 an overall measured $F_Q(Z)$ shall be obtained from a power distribution map and increased by 3% to account for manufacturing tolerances and further increased by 5% to account for measurement uncertainty.

POWER DISTRIBUTION LIMITS

3/4.2.3 NUCLEAR ENTHALPY RISE HOT CHANNEL FACTOR

LIMITING CONDITION FOR OPERATION

3.2.3 $F_{\Delta H}^N$ shall be limited by the following relationship:

$$F_{\Delta H}^N \leq F_{\Delta H}^{RTP} [1.0 + PF_{\Delta H} (1-P)],$$

Where: $F_{\Delta H}^{RTP}$ = $F_{\Delta H}$ limit at RATED THERMAL POWER as specified in the
CORE OPERATING LIMITS REPORT

$PF_{\Delta H}$ = Power Factor Multiplier for $F_{\Delta H}$ as specified in the CORE OPERATING LIMITS
REPORT

$$P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$$

APPLICABILITY: MODE 1.

ACTION:

With $F_{\Delta H}^N$ exceeding its limit:

- a. Within 2 hours either:
 1. Restore $F_{\Delta H}^N$ to within the above limit, or
 2. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER and reduce the Power Range Neutron Flux - High Trip Setpoint to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours.
- b. Within 24 hours of initially being outside the above limit, verify through incore flux mapping that $F_{\Delta H}^N$ has been restored to within the above limit, or reduce THERMAL POWER to less than 5% of RATED THERMAL POWER within the next 2 hours.
- c. Identify and correct the cause of the out-of-limit condition prior to increasing THERMAL POWER above the reduced THERMAL POWER limit required by ACTION a.2. and /or b., above; subsequent POWER OPERATION may proceed provided that $F_{\Delta H}^N$ is demonstrated, through incore flux mapping, to be within the limit of acceptable operation prior to exceeding the following THERMAL POWER levels:
 1. A nominal 50% of RATED THERMAL POWER,
 2. A nominal 75% of RATED THERMAL POWER, and
 3. Within 24 hours of attaining greater than or equal to 95% of RATED THERMAL POWER.

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS

4.2.3.1 The provisions of Specification 4.0.4 are not applicable.

4.2.3.2 When a measurement of $F_{\Delta H}^N$ is taken, the measured $F_{\Delta H}^N$ shall be increased by 4% to account for measurement error.

4.2.3.3 This corrected $F_{\Delta H}^N$ shall be determined to be within its limit through incore flux mapping:

- a. Prior to operation above 75% of RATED THERMAL POWER after each fuel loading, and
- b. In accordance with the Surveillance Frequency Control Program.

POWER DISTRIBUTION LIMITS

3/4.2.4 QUADRANT POWER TILT RATIO

LIMITING CONDITION FOR OPERATION

3.2.4 The QUADRANT POWER TILT RATIO shall not exceed 1.02.

APPLICABILITY: MODE 1, above 50% of RATED THERMAL POWER*.

ACTION:

- a. With the QUADRANT POWER TILT RATIO determined to exceed 1.02 but less than or equal to 1.09:
 1. Calculate the QUADRANT POWER TILT RATIO at least once per hour until either:
 - a) The QUADRANT POWER TILT RATIO is reduced to within its limit, or
 - b) THERMAL POWER is reduced to less than 50% of RATED THERMAL POWER.
 2. Within 2 hours either:
 - a) Reduce the QUADRANT POWER TILT RATIO to within its limit, or
 - b) Reduce THERMAL POWER at least 3% from RATED THERMAL POWER for each 1% of indicated QUADRANT POWER TILT RATIO in excess of 1 and similarly reduce the Power Range Neutron Flux-High Trip Setpoints within the next 4 hours.
 3. Verify that the QUADRANT POWER TILT RATIO is within its limit within 24 hours after exceeding the limit or reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within the next 2 hours and reduce the Power Range Neutron Flux-High Trip Setpoints to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours; and
 4. Identify and correct the cause of the out-of-limit condition prior to increasing THERMAL POWER; subsequent POWER OPERATION above 50% of RATED THERMAL POWER may proceed provided that the QUADRANT POWER TILT RATIO is verified within its limit at least once per hour for 12 hours or until verified acceptable at 95% or greater RATED THERMAL POWER.

*See Special Test Exceptions Specification 3.10.2.

POWER DISTRIBUTION LIMITS

LIMITING CONDITION FOR OPERATION (Continued)

ACTION (Continued)

- b. With the QUADRANT POWER TILT RATIO determined to exceed 1.09 due to misalignment of either a shutdown or control rod:
 - 1. Calculate the QUADRANT POWER TILT RATIO at least once per hour until either:
 - a) The QUADRANT POWER TILT RATIO is reduced to within its limit, or
 - b) THERMAL POWER is reduced to less than 50% of RATED THERMAL POWER.
 - 2. Reduce THERMAL POWER at least 3% from RATED THERMAL POWER for each 1% of indicated QUADRANT POWER TILT RATIO in excess of 1, within 30 minutes;
 - 3. Verify that the QUADRANT POWER TILT RATIO is within its limit within 2 hours after exceeding the limit or reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within the next 2 hours and reduce the Power Range Neutron Flux-High Trip Setpoints to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours; and
 - 4. Identify and correct the cause of the out-of-limit condition prior to increasing THERMAL POWER; subsequent POWER OPERATION above 50% of RATED THERMAL POWER may proceed provided that the QUADRANT POWER TILT RATIO is verified within its limit at least once per hour for 12 hours or until verified acceptable at 95% or greater RATED THERMAL POWER.
- c. With the QUADRANT POWER TILT RATIO determined to exceed 1.09 due to causes other than the misalignment of either a shutdown or control rod:
 - 1. Calculate the QUADRANT POWER TILT RATIO at least once per hour until either:
 - a) The QUADRANT POWER TILT RATIO is reduced to within its limit, or
 - b) THERMAL POWER is reduced to less than 50% of RATED THERMAL POWER.

POWER DISTRIBUTION LIMITS

LIMITING CONDITION FOR OPERATION (Continued)

ACTION (Continued)

2. Reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within 2 hours and reduce the Power Range Neutron Flux-High Trip Setpoints to less than or equal to 55% of RATED THERMAL POWER within the next 4 hours; and
3. Identify and correct the cause of the out-of-limit condition prior to increasing THERMAL POWER; subsequent POWER OPERATION above 50% of RATED THERMAL POWER may proceed provided that the QUADRANT POWER TILT RATIO is verified within its limit at least once per hour for 12 hours or until verified at 95% or greater RATED THERMAL POWER.

SURVEILLANCE REQUIREMENTS

- 4.2.4.1 The QUADRANT POWER TILT RATIO shall be determined to be within the limit above 50% of RATED THERMAL POWER by:
- a. Calculating the ratio in accordance with the Surveillance Frequency Control Program when the Power Range Upper Detector High Flux Deviation and Power Range Lower Detector High Flux Deviation Alarms are OPERABLE, and
 - b. Calculating the ratio at least once per 12 hours during steady-state operation when either alarm is inoperable.
- 4.2.4.2 The QUADRANT POWER TILT RATIO shall be determined to be within the limit when above 75% of RATED THERMAL POWER with one Power Range channel inoperable by using the movable incore detectors to confirm that the normalized symmetric power distribution, obtained either from two sets of four symmetric thimble locations or full-core flux map, or by incore thermocouple map is consistent with the indicated QUADRANT POWER TILT RATIO in accordance with the Surveillance Frequency Control Program.

POWER DISTRIBUTION LIMITS

3/4.2.5 DNB PARAMETERS

LIMITING CONDITION FOR OPERATION

3.2.5 The following DNB-related parameters shall be maintained within the following limits:

- a. Reactor Coolant System T_{avg} is less than or equal to the limit specified in the COLR
- b. Pressurizer Pressure is greater than or equal to the limit specified in the COLR*, and
- c. Reactor Coolant System Flow $\geq 270,000$ gpm

APPLICABILITY: MODE 1.

ACTION:

With any of the above parameters exceeding its limit, restore the parameter to within its limit within 2 hours or reduce THERMAL POWER to less than 5% of RATED THERMAL POWER within the next 4 hours.

SURVEILLANCE REQUIREMENTS

4.2.5.1 Reactor Coolant System T_{avg} and Pressurizer Pressure shall be verified to be within their limits in accordance with the Surveillance Frequency Control Program

4.2.5.2 RCS flow rate shall be monitored for degradation in accordance with the Surveillance Frequency Control Program.

4.2.5.3 The RCS flow rate indicators shall be subjected to a CHANNEL CALIBRATION in accordance with the Surveillance Frequency Control Program.

4.2.5.4 After each fuel loading, and in accordance with the Surveillance Frequency Control Program, the RCS flow rate shall be determined by precision heat balance after exceeding 90% RATED THERMAL POWER. The measurement instrumentation shall be calibrated within 90 days prior to the performance of the calorimetric flow measurement. The provisions of 4.0.4 are not applicable for performing the precision heat balance flow measurement.

* Limit not applicable during either a THERMAL POWER ramp in excess of 5% of RATED THERMAL POWER per minute or a THERMAL POWER step in excess of 10% of RATED THERMAL POWER.

3/4.3 INSTRUMENTATION

3/4.3.1 REACTOR TRIP SYSTEM INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.1 As a minimum, the Reactor Trip System instrumentation channels and interlocks of Table 3.3-1 shall be OPERABLE.

APPLICABILITY: As shown in Table 3.3-1.

ACTION:

As shown in Table 3.3-1.

SURVEILLANCE REQUIREMENTS

4.3.1.1 Each Reactor Trip System instrumentation channel and interlock and the automatic trip logic shall be demonstrated OPERABLE by the performance of the Reactor Trip System Instrumentation Surveillance Requirement specified in Table 4.3-1.

TABLE 3.3-1

REACTOR TRIP SYSTEM INSTRUMENTATION

FUNCTIONAL UNIT	TOTAL NO. OF CHANNELS	CHANNELS TO TRIP	MINIMUM CHANNELS OPERABLE	APPLICABLE MODES	ACTION
1. Manual Reactor Trip	2 2	1 1	2 2	1, 2 3*, 4*, 5*	1 9
2. Power Range, Neutron Flux					
a. High Setpoint	4	2	3	1, 2	2
b. Low Setpoint	4	2	3	1##, 2	2
3. Intermediate Range, Neutron Flux	2	1	2	1##, 2	3
4. Source Range, Neutron Flux					
a. Startup	2	1	2	2#	4
b. Shutdown**	2	0	2	3, 4, 5	5
c. Shutdown	2	1	2	3*, 4*, 5*	9
5. Overtemperature ΔT	3	2	2	1, 2	13
6. Overpower ΔT	3	2	2	1, 2	13
7. Pressurizer Pressure--Low (Above P-7)	3	2	2	1	6
8. Pressurizer Pressure--High	3	2	2	1, 2	6
9. Pressurizer Water Level--High (Above P-7)	3	2	2	1	13
10. Reactor Coolant Flow--Low					
a. Single Loop (Above P-8)	3/loop	2/loop	2/loop	1	6
b. Two Loops (Above P-7 and below P-8)	3/loop	2/loop	2/loop	1	6

TURKEY POINT - UNITS 3 & 4

3/4 3-2

AMENDMENT NOS. 140 AND 135
APR 23 1991

TABLE 3.3-1 (Continued)

REACTOR TRIP SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
11. Steam Generator Water Level--Low-Low	3/stm. gen.	2/stm. gen.	2/stm. gen.	1, 2	6
12. Steam Generator Water Level-- Low Coincident With Steam/ Feedwater Flow Mismatch	2 stm. gen. level and 2 stm./feed- water flow mismatch in each stm. gen.	1 stm. gen. level coin- cident with 1 stm./feed- water flow mismatch in same stm. gen.	1 stm. gen. level and 2 stm./feed- water flow mismatch in same stm. gen. or 2 stm. gen. level and 1 stm./feedwater flow mismatch in same stm. gen.	1, 2	6
13. Undervoltage--4.16 KV Busses A and B (Above P-7)	2/bus	1/bus on both busses	2/bus	1	12
14. Underfrequency-Trip of Reactor Coolant Pump Breaker(s) Open (Above P-7)	2/bus	1 to trip RCPs***	2/bus	1	11
15. Turbine Trip (Above P-7)					
a. Emergency Trip Header Pressure	3	2	2	1	12
b. Turbine Stop Valve Closure	2	2	2	1	12

|

TABLE 3.3-1 (Continued)

REACTOR TRIP SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
16. Safety Injection Input from ESF	2	1	2	1, 2	8
17. Reactor Trip System Interlocks					
a. Intermediate Range Neutron Flux, P-6	2	1	2	2#	7
b. Low Power Reactor Trips Block, P-7					
P-10 Input	4	2	3	1	7
or					
Turbine Inlet Pressure	2	1	2	1	7
c. Power Range Neutron Flux, P-8	4	2	3	1	7
d. Power Range Neutron Flux, P-10	4	2	3	1, 2	7
18. Reactor Coolant Pump Breaker Position Trip					
a. Above P-8	1/breaker	1	1/breaker	1	11
b. Above P-7 and below P-8	1/breaker	2	1/breaker	1	11
19. Reactor Trip Breakers	2	1	2	1, 2	8, 10
	2	1	2	3*, 4*, 5*	9
20. Automatic Trip and Interlock logic	2	1	2	1, 2	8
	2	1	2	3*, 4*, 5*	9

TABLE 3.3-1 (Continued)

TABLE NOTATION

- * When the Reactor Trip System breakers are in the closed position and the Control Rod Drive System is capable of rod withdrawal.
- ** When the Reactor Trip System breakers are in the open position, one or both of the backup NIS instrumentation channels may be used to satisfy this requirement. For backup NIS testing requirements, see Specification 3/4.3.3.3, ACCIDENT MONITORING.
- *** Reactor Coolant Pump breaker A is tripped by underfrequency sensor UF-3A1(UF-4A1) or UF-3B1(UF-4B1). Reactor Coolant Pump breakers B and C are tripped by underfrequency sensor UF-3A2(UF-4A2) or UF-3B2(UF-4B2).
- # Below the P-6 (Intermediate Range Neutron Flux Interlock) Setpoint.
- ## Below the P-10 (Low Setpoint Power Range Neutron Flux Interlock) Setpoint.

ACTION STATEMENTS

ACTION 1 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or in accordance with the Risk Informed Completion Time Program, or be in HOT STANDBY within the next 6 hours.

ACTION 2 - With the number of OPERABLE channels one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may proceed provided the following conditions are satisfied:

- a. The inoperable channel is placed in the tripped condition within 6 hours,
- b. The Minimum Channels OPERABLE requirement is met; however, the inoperable channel may be bypassed for up to 4 hours for surveillance testing of other channels per Specification 4.3.1.1, and
- c. Either, THERMAL POWER is restricted to less than or equal to 75% of RATED THERMAL POWER and the Power Range Neutron Flux Trip Setpoint is reduced to less than or equal to 85% of RATED THERMAL POWER within 4 hours; or, the QUADRANT POWER TILT RATIO is monitored per Specification 4.2.4.2.

TABLE 3.3-1 (Continued)

ACTION STATEMENTS (Continued)

- ACTION 3 -** With the number of channels OPERABLE one less than the Minimum Channels OPERABLE requirement and with the THERMAL POWER level:
- a. Below the P-6 (Intermediate Range Neutron Flux Interlock) Setpoint, restore the inoperable channel to OPERABLE status prior to increasing THERMAL POWER above the P-6 Setpoint, and
 - b. Above P-6 (Intermediate Range Neutron Flux Interlock) Setpoint but below 10% of RATED THERMAL POWER, restore the inoperable channel to OPERABLE status prior to increasing THERMAL POWER above 10% of RATED THERMAL POWER.
- ACTION 4 -** With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, suspend all operations involving positive reactivity changes.
- ACTION 5 -** With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, suspend all operations involving positive reactivity changes and verify compliance with the SHUTDOWN MARGIN requirements of Specification 3.1.1.1 or 3.1.1.2, as applicable, within 1 hour and at least once per 12 hours thereafter.
- ACTION 6 -** With the number of OPERABLE channels one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may proceed until performance of the next required ANALOG CHANNEL OPERATIONAL TEST provided the inoperable channel is placed in the tripped condition within 6 hours.
- ACTION 7 -** With less than the Minimum Number of Channels OPERABLE, within 1 hour determine by observation of the associated permissive annunciator window(s) that the interlock is in its required state for the existing plant condition, or apply Specification 3.0.3.
- ACTION 8 -** With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 6 hours; however, one channel may be bypassed for up to 2 hours for surveillance testing per Specification 4.3.1.1, provided the other channel is OPERABLE.
- ACTION 9 -** With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or open the Reactor Trip System breakers within the next hour.
- ACTION 10-** With one of the diverse trip features (undervoltage or shunt trip attachment) inoperable, restore it to OPERABLE status within 48 hours or in accordance with the Risk Informed Completion Time Program, or declare the breaker inoperable and apply ACTION 8. The breaker shall not be bypassed while one of the diverse trip features is inoperable, except for the time required for performing maintenance to restore the breaker to OPERABLE status.

TABLE 3.3-1 (Continued)

ACTION STATEMENTS (Continued)

- ACTION 11 -** With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 6 hours.
- ACTION 12 -** With the number of OPERABLE channels one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may proceed until performance of the next required ACTUATION LOGIC TEST provided the inoperable channel is placed in the tripped condition within 6 hours.
- ACTION 13 -** With the number of OPERABLE channels one less than the Total number of channels, STARTUP and/or POWER OPERATION may proceed provided the inoperable channel is placed in the tripped condition within 6 hours. For subsequent required DIGITAL CHANNEL OPERATIONAL TESTS the inoperable channel may be placed in bypass status for up to 4 hours.

TABLE 4.3-1

REACTOR TRIP SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. Manual Reactor Trip	N.A.	N.A.	N.A.	SFCP(11)	N.A.	1, 2, 3*, 4*, 5*
2. Power Range, Neutron Flux						
a. High Setpoint	SFCP	SFCP(2, 4), SFCP(3, 4), SFCP(4, 6) ^{(a), (b)} , SFCP(4) ^{(a), (b)}	SFCP ^{(a), (b)}	N.A.	N.A.	1, 2
b. Low Setpoint	SFCP	SFCP(4)	S/U(1)	N.A.	N.A.	1***, 2
3. Intermediate Range, Neutron Flux	SFCP	SFCP(4)	S/U(1)	N.A.	N.A.	1***, 2
4. Source Range, Neutron Flux	SFCP	SFCP(4)	S/U(1), SFCP(9)	N.A.	N.A.	2**, 3, 4, 5
5. Overtemperature ΔT	SFCP	SFCP ^{(a), (b)}	SFCP ^{(a), (b)}	N.A.	N.A.	1, 2
6. Overpower ΔT	SFCP	SFCP ^{(a), (b)}	SFCP ^{(a), (b)}	N.A.	N.A.	1, 2
7. Pressurizer Pressure--Low	SFCP	SFCP	SFCP	N.A.	N.A.	1
8. Pressurizer Pressure--High	SFCP	SFCP	SFCP	N.A.	N.A.	1, 2
9. Pressurizer Water Level--High	SFCP	SFCP	SFCP	N.A.	N.A.	1
10. Reactor Coolant Flow--Low	SFCP	SFCP ^{(a), (b)}	SFCP ^{(a), (b)}	N.A.	N.A.	1
11. Steam Generator Water Level--Low-Low	SFCP	SFCP ^{(a), (b)}	SFCP ^{(a), (b)}	N.A.	N.A.	1, 2

TABLE 4.3-1

REACTOR TRIP SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
12. Steam Generator Water Level--Low Coincident with Steam/Feedwater Flow Mismatch	SFCP	SFCP ^{(a), (b)}	SFCP ^{(a), (b)}	N.A.	N.A.	1, 2
13. Undervoltage – 4.16 kV Busses A and B	N.A.	SFCP	N.A.	N.A.	N.A.	1
14. Underfrequency – Trip of Reactor Coolant Pump Breakers(s) Open	N.A.	SFCP	N.A.	N.A.	N.A.	1
15. Turbine Trip						
a. Emergency Trip Header Pressure	N.A.	SFCP ^{(a), (b)}	N.A.	S/U(1, 10)	N.A.	1
b. Turbine Stop Valve Closure	N.A.	SFCP	N.A.	S/U(1, 10)	N.A.	1
16. Safety Injection Input from ESF	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2
17. Reactor Trip System Interlocks						
a. Intermediate Range Neutron Flux, P-6	N.A.	SFCP(4)	SFCP	N.A.	N.A.	2**
b. Low Power Reactor Trips Block, P-7 (includes P-10 input and Turbine Inlet Pressure)	N.A.	SFCP(4)	SFCP	N.A.	N.A.	1
c. Power Range Neutron Flux, P-8	N.A.	SFCP(4)	SFCP	N.A.	N.A.	1

TABLE 4.3-1REACTOR TRIP SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
17. Reactor Trip System Interlocks (Continued)						
d. Power Range Neutron Flux, P-10	N.A.	SFCP(4)	SFCP	N.A.	N.A.	1, 2
18. Reactor Coolant Pump Breaker Position Trip	N.A.	N.A.	N.A.	SFCP	N.A.	1
19. Reactor Trip Breaker	N.A.	N.A.	N.A.	SFCP(7, 11)	N.A.	1, 2, 3*, 4*, 5*
20. Automatic Trip and Inter- lock Logic	N.A.	N.A.	N.A.	N.A.	SFCP(7,14)	1, 2, 3*, 4*, 5*
21. Reactor Trip Bypass Breaker	N.A.	N.A.	N.A.	SFCP(13), SFCP(15)	N.A.	1, 2, 3*, 4*, 5*

TABLE 4.3-1 (Continued)

TABLE NOTATIONS

- * When the Reactor Trip System breakers are closed and the Control Rod Drive System is capable of rod withdrawal.
- ** Below P-6 (Intermediate Range Neutron Flux Interlock) Setpoint.
- *** Below P-10 (Low Setpoint Power Range Neutron Flux Interlock) Setpoint.
- (a) If the as-found channel setpoint is outside its predefined as-found tolerance, then the channel shall be evaluated to verify that it is functioning as required before returning the channel to service.
- (b) The instrument channel setpoint shall be reset to a value that is within the as-left tolerance around the Nominal Trip Setpoint (NTS) at the completion of the surveillance; otherwise, the channel shall be declared inoperable. Setpoints more conservative than the NTS are acceptable provided that the as-found and as-left tolerances apply to the actual setpoint implemented in the surveillance procedures (field settings) to confirm channel performance. The NTS and methodologies used to determine the as-found and the as-left tolerances are specified in UFSAR Section 7.2.
- (1) If not performed in previous 31 days.
- (2) Comparison of calorimetric to excore power level indication above 15% of RATED THERMAL POWER (RTP). Adjust excore channel gains consistent with calorimetric power level if the absolute difference is greater than 2%. Below 70% RTP, downward adjustments of NIS excore channel gains to match a lower calorimetric power level are not required. The provisions of Specification 4.0.4 are not applicable for entry into MODE 2 or 1.
- (3) Single point comparison of incore to excore AXIAL FLUX DIFFERENCE above 15% of RATED THERMAL POWER. Recalibrate if the absolute difference is greater than or equal to 3%. The provisions of Specification 4.0.4 are not applicable for entry into MODE 2 or 1.
- (4) Neutron detectors may be excluded from CHANNEL CALIBRATION.
- (5) This table Notation number is not used.
- (6) Incore-Excore Calibration, above 75% of RATED THERMAL POWER (RTP). If the quarterly surveillance requirement coincides with sustained operation between 30% and 75% of RTP, calibration shall be performed at this lower power level. The provisions of Specification 4.0.4 are not applicable for entry into MODE 2 or 1.
- (7) Each train shall be tested in accordance with the Surveillance Frequency Control Program. |
- (8) DELETED
- (9) Quarterly surveillance in MODES 3*, 4*, and 5* shall also include verification that permissive P-6 and P-10 are in their required state for existing plant conditions by observation of the permissive annunciator window. Quarterly surveillance shall include verification of the High Flux at Shutdown Alarm Setpoint of 1/2 decade above the existing count rate.
- (10) Setpoint verification is not applicable.
- (11) The TRIP ACTUATING DEVICE OPERATIONAL TEST shall include independent verification of the OPERABILITY of the undervoltage and shunt trip attachment of the Reactor Trip Breakers.

TABLE 4.3-1 (Continued)

TABLE NOTATIONS

- (12) NOT USED.
- (13) Remote manual undervoltage trip when breaker placed in service.
- (14) Interlock Logic Test shall consist of verifying that the interlock is in its required state by observing the permissive annunciator window.
- (15) Automatic undervoltage trip.

INSTRUMENTATION

3/4.3.2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.2 The Engineered Safety Feature Actuation System (ESFAS) instrumentation channels and interlocks shown in Table 3.3-2 shall be OPERABLE with their Trip Setpoints set consistent with the values shown in the Trip Setpoint column of Table 3.3-3.

APPLICABILITY: As shown in Table 3.3-2.

ACTION:

- a. With an ESFAS Instrumentation or Interlock Trip Setpoint less conservative than the value shown in the Trip Setpoint column but more conservative than the value shown in the Allowable Value column of Table 3.3-3, adjust the Setpoint consistent with the Trip Setpoint value within permissible calibration tolerance.
- b. With an ESFAS Instrumentation or Interlock Trip Setpoint less conservative than the value shown in the Allowable Value column of Table 3.3-3, either:
 1. Adjust the Setpoint consistent with the Trip Setpoint value of Table 3.3-3 and determine within 12 hours that the affected channel is OPERABLE; or
 2. Declare the channel inoperable and apply the applicable ACTION statement requirements of Table 3.3-2 until the channel is restored to OPERABLE status with its setpoint adjusted consistent with the Trip Setpoint value.
- c. With an ESFAS instrumentation channel or interlock inoperable, take the ACTION shown in Table 3.3-2.

SURVEILLANCE REQUIREMENTS

4.3.2.1 Each ESFAS instrumentation channel and interlock and the automatic actuation logic and relays shall be demonstrated OPERABLE by performance of the ESFAS Instrumentation Surveillance Requirements specified in Table 4.3-2.

TABLE 3.3-2ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
1. Safety Injection					
a. Manual Initiation	2	1	2	1 2, 3, 4	27
b. Automatic Actuation Logic and Actuation Relays	2	1	2	1 2, 3, 4	14
c. Containment Pressure - High	3	2	2	1 2, 3	26
d. Pressurizer Pressure - Low	3	2	2	1 2, 3#	26
e. High Differential Pressure Between the Steam Line Header and any Steam Line	3/steam line	2/steam line in any steam line	2/steam line	1 2, 3#	26

TABLE 3.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>	
f. Steam Line flow--High Coincident with:	2/steam line	1/steam line in any two steam lines	1/steam line in any two steam lines	1, 2, 3*	26	
Steam Generator Pressure--Low	1/steam generator	1/steam generator in any two steam lines	1/steam generator in any two steam lines	1, 2, 3*	26	
or T _{avg} --Low	1/loop	1/loop in any two loops	1/loop in any two loops	1, 2, 3*	25	.
2. Containment Spray						
a. Automatic Actuation Logic and Actuation Relays	2	1	2	1, 2, 3, 4	14	
b. Containment Pressure-- High-High Coincident with: Containment Pressure-- High	3	2	2	1, 2, 3	26	
	3	2	2	1, 2, 3	26	
3. Containment Isolation						
a. Phase "A" Isolation						
1) Manual Initiation	2	1	2	1, 2, 3, 4	27	
2) Automatic Actuation Logic and Actuation Relays	2	1	2	1, 2, 3, 4	14	

TABLE 3.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
3. Containment Isolation (Continued)					
3) Safety Injection	See Item 1. above for all Safety Injection initiating functions and requirements. (Manual S.I. initiation will not initiate Phase A Isolation.)				
b. Phase "B" Isolation					
1) Manual Initiation	2	2 (Both buttons must be pushed simultaneously to actuate)	2	1, 2, 3, 4	17
2) Automatic Actuation Logic and Actuation Relays	2	1	2	1, 2, 3, 4	14
3) Containment Pressure--High-High Coincident with: Containment Pressure--High	3	2	2	1, 2, 3	15
	3	2	2	1, 2, 3	15
c. Containment Ventilation Isolation					
1) Containment Isolation Manual Phase A or Manual Phase B	See Items 3.a.1 and 3.b.1 above for all Manual Containment Ventilation functions and requirements.				

TABLE 3.3-2 (Continued)
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
3. Containment Isolation (Continued)					
2) Automatic Actuation 2 Logic and Actuation Relays		1	2	1, 2, 3, 4	16
3) Safety Injection	See Item 1. above for all Safety Injection initiating functions requirements.				
4) Containment Radioactivity-High	2##	1	1	1, 2, 3, 4	16
4. Steam Line Isolation					
a. Manual Initiation (individual)	1/operating steam line	1/operating steam line	1/operating steam line	1, 2, 3	21
b. Automatic Actuation Logic and Actuation Relays	2	1	2	1, 2, 3	20
c. Containment Pressure-- High-High	3	2	2	1, 2, 3	15
Coincident with: Containment Pressure-- High	3	2	2	1, 2, 3	15

TABLE 3.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
4. Steam Line Isolation (Continued)					
d. Steam Line Flow--High Coincident with: Steam Generator Pressure--Low	2/steam line	1/steam line in any two steam lines	1/steam line in any two steam lines	1, 2, 3	15
	1/steam generator	1/steam generator in any two steam lines	1/steam generator in any two steam lines	1, 2, 3	15
or T _{avg} --Low	1/Loop	1/loop in any two loops	1/loop in any two loops	1, 2, 3	25
5. Feedwater Isolation					
a. Automatic Actua- tion Logic and Actuation Relays	2	1	2	1, 2, 3	22
b. Safety-Injection	See Item 1. above for all Safety Injection initiating functions and requirements.				
c. Steam Generator Water Level -- High-High###	3/steam generator	2/steam generator in any operating steam generator	2/steam generator in any operating steam generator	1, 2, 3	15
6. Auxiliary Feedwater###					
a. Automatic Actua- tion Logic and Actuation Relays	2	1	2	1, 2, 3	20

TABLE 3.3-2 (Continued)
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
6. Auxiliary Feedwater### (Continued)					
b. Stm. Gen. Water Level-- Low-Low	3/steam generator	2/steam generator in any steam generator	2/steam generator	1, 2, 3	26
c. Safety Injection	See Item 1. above for all Safety Injection initiating functions and requirements.				
d. Bus Stripping	1/bus	1/bus	1/bus	1, 2, 3	23(a)
e. Trip of all Main Feed- water Pumps Breakers	1/breaker	(1/breaker) /operating pump	(1/breaker) /operating pump	1, 2	23(b)
7. Loss of Power					
a. 4.16 kV Busses A and B (Loss of Voltage)	2/bus	2/bus	2/bus	1, 2, 3, 4	18
b. 480 V Load Centers 3A, 3B, 3C, 3D and 4A, 4B, 4C, 4D Undervoltage	2 per load center	2 on any load center	2 per load center	1, 2, 3, 4	18
Coincident with: Safety Injection	See Item 1. above for all Safety Injection initiating functions and requirements.				

TABLE 3.3-2 (Continued)
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
7. Loss of Power (Continued)					
c. 480 V Load Centers 3A, 3B, 3C, 3D and 4A, 4B, 4C, 4D Degraded Voltage	2 per load center	2 on any load center	2 per load center	1, 2, 3, 4	18
8. Engineered Safety Features Actuation System Interlocks					
a. Pressurizer Pressure	3	2	2	1, 2, 3	19
b. T _{avg} - Low	3	2	2	1, 2, 3	19
9. Control Room Ventilation Isolation					
a. Automatic Actuation Logic and Actuation Relays	2	1	2	1, 2, 3, 4**	24A, 24B
b. Safety Injection	See Item 1. above for all Safety Injection initiating functions and requirements.				
c. Deleted					
d. Containment Isolation Manual Phase A or Manual Phase B	2	1	2	1, 2, 3, 4	17
e. Control Room Air Intake Radiation Level	2	1	2	All	24A, 24B

TABLE 3.3-2 (Continued)

TABLE NOTATION

- # Trip function may be blocked in this MODE below the Pressurizer Pressure Interlock Setpoint of 2000 psig.
- # # Channels are for particulate radioactivity and for gaseous radioactivity. Either an OPERABLE particulate radioactivity or gaseous radioactivity channel will satisfy the Minimum Channels OPERABLE requirement.
- # # # Auxiliary feedwater manual initiation is included in Specification 3.7.1.2.
- # # # # Steam Generator overfill protection is not part of the Engineered Safety Features Actuation System (ESFAS), and is added to the Technical Specifications only in accordance with NRC Generic Letter 89-19.
- * Trip function may be blocked in this MODE below the T_{avg} -Low Interlock Setpoint.
- ** Only during movement of irradiated fuel within the containment.

ACTION STATEMENTS

- ACTION 14 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 12 hours and in COLD SHUTDOWN within the following 30 hours; however, one channel may be bypassed for up to 8 hours for surveillance testing per Specification 4.3.2.1, provided the other channel is OPERABLE.
- ACTION 15 - With the number of OPERABLE channels one less than the Total Number of Channels, operation may proceed until performance of the next required ANALOG CHANNEL OPERATIONAL TEST or TRIP ACTUATING DEVICE OPERATIONAL TEST provided the inoperable channel is placed in the tripped condition within 6 hours.
- ACTION 16 - With the number of OPERABLE channels less than the Minimum Channels OPERABLE Requirement, operation may continue provided the Containment purge supply, exhaust and instrument air bleed valves are maintained closed. (The instrument air bleed valves may be opened intermittently under administrative controls).
- ACTION 17 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

TABLE 3.3-2 (Continued)

TABLE NOTATION (Continued)

- ACTION 18 - With the number of OPERABLE channels one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may proceed provided the inoperable channel is placed in the tripped condition within 6 hours. Both channels of any one load center may be taken out of service for up to 8 hours in order to perform surveillance testing per Specification 4.3.2.1.
- ACTION 19 - With less than the Minimum Number of Channels OPERABLE, within 1 hour determine by observation of the associated permissive annunciator window(s) that the interlock is in its required state for the existing plant condition, or apply Specification 3.0.3.
- ACTION 20 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 6 hours and in at least HOT SHUTDOWN within the following 6 hours; however, one channel may be bypassed for up to 8 hours for surveillance testing per Specification 4.3.2.1 provided the other channel is OPERABLE.
- ACTION 21 - With the number of OPERABLE channels one less than the Total Number of Channels, restore the inoperable channel to OPERABLE status within 48 hours or declare the associated valve inoperable and take the ACTION required by Specification 3.7.1.5.
- ACTION 22 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, be in at least HOT STANDBY within 6 hours; however, one channel may be bypassed for up to 8 hours for surveillance testing per Specification 4.3.2.1 provided the other channel is OPERABLE.
- ACTION 23 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement:
- (a) Restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
 - (b) Restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours.

TABLE 3.3-2 (Continued)

TABLE NOTATION (Continued)

ACTION 24A -	With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, within 7 days restore the inoperable channel to OPERABLE status or place the Control Room Emergency Ventilation System in the recirculation mode.
ACTION 24B -	<p>With the number of OPERABLE channels two less than the Minimum Channels OPERABLE requirement, either:</p> <ol style="list-style-type: none">1. Immediately place the Control Room Emergency Ventilation System in the recirculation mode with BOTH Control Room emergency recirculation fans operating, OR2. a. Immediately place the Control Room Emergency Ventilation System in the recirculation mode with ONE Control Room emergency recirculating fan operating, AND<ol style="list-style-type: none">b. Restore at least one inoperable channel to OPERABLE status within 7 days, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. If this ACTION applies to both Units simultaneously, then be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours.
ACTION 25 -	With number of OPERABLE channels one less than the Total number of channels, STARTUP and/or POWER OPERATION may proceed provided the inoperable channel is placed in the tripped condition within 6 hours or in accordance with the Risk Informed Completion Time Program. For subsequent required DIGITAL CHANNEL OPERATIONAL TESTS the inoperable channel may be placed in bypass status for up to 4 hours.
ACTION 26 -	With one channel inoperable, operation may proceed until performance of the next required ANALOG CHANNEL OPERATIONAL TEST or TRIP ACTUATING DEVICE OPERATIONAL TEST provided the inoperable channel is place in the tripped condition within 6 hours or in accordance with the Risk Informed Completion Time Program.
ACTION 27 -	With one channel inoperable, restore the inoperable channel to OPERABLE status within 48 hours or in accordance with the Risk Informed Completion Time Program, or be in HOT STANDBY within the next 6 hours and COLD SHUTDOWN within the following 30 hours.

TABLE 3.3-3
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

FUNCTIONAL UNIT	ALLOWABLE VALUE	TRIP SETPOINT
1. Safety Injection		
a. Manual Initiation	N.A.	N.A.
b. Automatic Actuation Logic	N.A.	N.A.
c. Containment Pressure--High	≤4.5 psig	≤4.0 psig
d. Pressurizer Pressure--Low	≥1712 psig	≥1730 psig
e. High Differential Pressure Between the Steam Line Header and any Steam Line.	≤114 psig	≤100 psi
f. Steam Line Flow--High	≤A function defined as follows: A ΔP corresponding to 41.2% steam flow at 0% load increasing linearly from 20% load to a value corresponding to 114.4% steam flow at full load	A function defined as follows: A ΔP corresponding to 40% steam flow at 0% load increasing linearly from 20% load to a value corresponding to 114% steam flow at full load

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
Coincident with: Steam Generator Pressure--Low(4) or T _{avg} --Low	≥607 psig ≥542.5°F	614 psig ≥543°F
2. Containment Spray		
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
b. Containment Pressure--High- High Coincident with: Containment Pressure--High	≤22.6 psig ≤4.5 psig	≤20.0 psig ≤4.0 psig
3. Containment Isolation		
a. Phase "A" Isolation		
1) Manual Initiation	N.A.	N.A.
2) Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
3) Safety Injection	See Item 1 above for all Safety Injection Allowable Values.	See Item 1 above for all Safety Injection Trip Setpoints.
b. Phase "B" Isolation		
1) Manual Initiation	N.A.	N.A.

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
3. Containment Isolation (Continued)		
2) Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
3) Containment Pressure-- High-High	≤ 22.6 psig	≤ 20.0 psig
Coincident with: Containment Pressure--High	≤ 4.5 psig	≤ 4.0 psig
c. Containment Ventilation Isolation		
1) Containment Isolation Manual Phase A or Manual Phase B	N.A.	N.A.
2) Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
3) Safety Injection	See Item 1. above for all Safety Injection Allowable Values.	See Item 1. above for all Safety Injection Trip Setpoints.
4) Containment Radioactivity--High	Particulate (R-11) $\leq 6.8 \times 10^5$ CPM Gaseous (R-12) See Note 2	Particulate (R-11) $\leq 6.1 \times 10^5$ CPM Gaseous (R-12) See Note 2
4. Steam Line Isolation		
a. Manual Initiation	N.A.	N.A.

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
4. Steam Line Isolation (Continued)		
b. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
c. Containment Pressure--High-High Coincident with: Containment Pressure--High	≤ 22.6 psig ≤ 4.5 psig	≤ 20 . psig ≤ 4.0 psig
d. Steam Line Flow--High	\leq A function defined as follows: A ΔP corresponding to 41.2% steam flow at 0% load increasing linearly from 20% load to a value corresponding to 114.4% steam flow at full load.	A function defined as follows: A ΔP corresponding to 40% steam flow at 0% load increasing linearly from 20% load to a value corresponding to 114% steam flow at full load.
Coincident with: Steam Line Pressure--Low(4) or T_{avg} -- Low	≥ 607 psig $\geq 542.5^{\circ}\text{F}$	614 psig $\geq 543^{\circ}\text{F}$
5. Feedwater Isolation		
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
b. Safety Injection	See Item 1. for all Safety Injection Allowable Valves.	See Item 1. above for all Safety Injection Trip Setpoints.

TABLE 3.3-3 (Continued)
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
5. Feedwater Isolation (Continued)		
c. Steam Generator Water Level High-High	≤80.5% of narrow range instrument span	80% of narrow range instrument span
6. Auxiliary Feedwater (3)		
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
b. Steam Generator Water Level—Low-Low	≥15.5% of narrow range instrument span.	16% of narrow range instrument span
c. Safety Injection	See Item 1. for all Safety Injection Allowable Values.	See Item 1. above for all Safety Injection Trip Setpoints.
d. Bus Stripping	See Item 7. below for all Bus Stripping Allowable Values.	See Item 7. below for all Bus Stripping Trip Setpoints.
e. Trip of All Main Feedwater Pump Breakers	N.A.	N.A.
7. Loss of Power		
a. 4.16 kV Busses A and B (Loss of Voltage)	N.A.	N.A.

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE#</u>	<u>TRIP SETPOINT</u>
7. Loss of Power (Continued)		
b. 480V Load Centers Undervoltage		
<u>Load Center</u>		
3A	[]	430V ±3V (10 sec ±1 sec delay)
3B	[]	438V ±3V (10 sec ±1 sec delay)
3C	[]	434V ±3V (10 sec ±1 sec delay)
3D	[]	434V ±3V (10 sec ±1 sec delay)
4A	[]	435V ±3V (10 sec ±1 sec delay)
4B	[]	434V ±3V (10 sec ±1 sec delay)
4C	[]	434V ±3V (10 sec ±1 sec delay)
4D	[]	430V ±3V (10 sec ±1 sec delay)
Coincident with: Safety Injection and	See Item 1. above for all Safety Injection Allowable Values.	See Item 1. above for all Safety Injection Trip Setpoints.
Diesel Generator Breaker Open	N.A.	N.A.

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE#</u>	<u>TRIP SETPOINT</u>
7. Loss of Power (Continued)		
c. 480V Load Centers Degraded Voltage		
<u>Load Center</u>		
3A	[]	424V ±3V (60 sec ±30 sec delay)
3B	[]	427V ±3V (60 sec ±30 sec delay)
3C	[]	437V ±3V (60 sec ±30 sec delay)
3D	[]	435V ±3V (60 sec ±30 sec delay)
4A	[]	430V ±3V (60 sec ±30 sec delay)
4B	[]	436V ±3V (60 sec ±30 sec delay)
4C	[]	434V ±3V (60 sec ±30 sec delay)
4D	[]	434V ±3V (60 sec ±30 sec delay)
Coincident with: Diesel Generator Breaker Open	N.A.	N.A.

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

<u>FUNCTIONAL UNIT</u>	<u>ALLOWABLE VALUE</u>	<u>TRIP SETPOINT</u>
8. Engineering Safety Features Actuation System Interlocks		
a. Pressurizer Pressure	≤ 2018 psig	Nominal 2000 psig
b. Tavg--Low	$\geq 542.5^{\circ}\text{F}$	Nominal 543°F
9. Control Room Ventilation Isolation		
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.
b. Safety Injection	See Item 1. above for all Safety Injection Allowable Values.	See Item 1. above for all Safety Injection Trip Setpoints.
c. Deleted		
d. Containment Isolation Manual Phase A or Manual Phase B	N.A.	N.A.
e. Air Intake Radiation Level	≤ 2.83 mR/hr	≤ 2 mR/hr

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM
INSTRUMENTATION TRIP SETPOINTS

TABLE NOTATIONS

(1) Deleted

(2) Containment Gaseous Monitor Setpoint = $\frac{(3.2 \times 10^4)}{(F)} \text{ CPM}$,

Containment Gaseous Monitor Allowable Value = $\frac{(3.5 \times 10^4)}{(F)} \text{ CPM}$,

Where $F = \frac{\text{Actual Purge Flow}}{\text{Design Purge Flow (35,000 CFM)}}$

Setpoint may vary according to current plant conditions provided that the release rate does not exceed allowable limits provided in the Offsite Dose Calculation Manual.

(3) Auxiliary feedwater manual initiation is included in Specification 3.7.1.2.

(4) Time constants utilized in lead-lag controller for Steam Generator Pressure-Low and Steam Line Pressure-Low are $\tau_1 \geq 50$ seconds and $\tau_2 \leq 5$ seconds. CHANNEL CALIBRATION shall ensure that these time constants are adjusted to these values.

If no Allowable Value is specified, as indicated by [], the trip setpoint shall also be the allowable value.

TABLE 4.3-2

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

<u>CHANNEL FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST #</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. Safety Injection						
a. Manual Initiation	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2, 3
b. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP(1)	1, 2, 3(3)
c. Containment Pressure-- High	N.A.	SFCP	N.A.	N.A.	SFCP(1)	1, 2, 3
d. Pressurizer Pressure-- Low	SFCP	SFCP	SFCP(5)	N.A.	N.A.	1, 2, 3(3)
e. High Differential Pressure Between the Steam Line Header and any Steam Line	SFCP	SFCP	SFCP(5)	N.A.	N.A.	1, 2, 3(3)
f. Steam Line Flow--High Coincident with: Steam Generator Pressure--Low or Tavg--Low	SFCP	SFCP ^{(a)(b)}	SFCP(5) ^{(a)(b)}	N.A.	N.A.	1, 2, 3(3)
	SFCP	SFCP ^{(a)(b)}	SFCP(5) ^{(a)(b)}	N.A.	N.A.	1, 2, 3(3)
	SFCP	SFCP	SFCP(5)	N.A.	N.A.	1, 2, 3(3)

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

<u>CHANNEL FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST #</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
2. Containment Spray						
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP(1)	1, 2, 3, 4
b. Containment Pressure-- High-High Coincident with: Containment Pressure-- High	N.A.	SFCP	N.A.	SFCP	SFCP(1)	1, 2, 3
	N.A.	SFCP	N.A.	SFCP	SFCP(1)	1, 2, 3
3. Containment Isolation						
a. Phase "A" Isolation						
1) Manual Initiation	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2, 3, 4
2) Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP(1)	1, 2, 3, 4
3) Safety Injection	See Item 1. above for all Safety Injection Surveillance Requirements.					
b. Phase "B" Isolation						
1) Manual Initiation	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2, 3, 4
2) Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP(1)	1, 2, 3, 4

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

<u>CHANNEL FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST #</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
3. Containment Isolation (Continued)						
3) Containment Pressure--High-High Coincident with: Containment Pressure--High	N.A.	SFCP	N.A.	SFCP	SFCP(1)	1, 2, 3
	N.A.	SFCP	N.A.	SFCP	SFCP(1)	1, 2, 3
c. Containment Ventilation Isolation						
1) Containment Isolation Manual Phase A or Manual Phase B	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2, 3, 4
2) Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	N.A.	
3) Safety Injection	See Item 1. above for all Safety Injection Surveillance Requirements.					
4) Containment Radioactivity--High	SFCP	SFCP	SFCP	N.A.	N.A.	1, 2, 3, 4
4. Steam Line Isolation						
a. Manual Initiation	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2, 3
b. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP(1)	1, 2, 3(3)

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

<u>CHANNEL FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST #</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
4. Steamline Isolation (Continued)						
c. Containment Pressure-- High-High	N.A.	SFCP	N.A.	SFCP	SFCP(1)	1, 2, 3
Coincident with: Containment Pressure-- High	N.A.	SFCP	N.A.	SFCP	SFCP(1)	1, 2, 3
d. Steam Line Flow--High	SFCP(3)	SFCP ^{(a)(b)}	SFCP(5) ^{(a)(b)}	N.A.	N.A.	1, 2, 3
Coincident with: Steam Generator Pressure--Low	SFCP(3)	SFCP ^{(a)(b)}	SFCP(5) ^{(a)(b)}	N.A.	N.A.	1, 2, 3
or Tavg--Low	SFCP(3)	SFCP	SFCP(5)	N.A.	N.A.	1, 2, 3
5. Feedwater Isolation						
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP	1, 2, 3
b. Safety Injection	See Item 1. above for all Safety Injection Surveillance Requirements.					
c. Steam Generator Water Level--High-High	SFCP	SFCP ^{(a)(b)}	SFCP ^{(a)(b)}	N.A.	N.A.	1, 2, 3
6. Auxiliary Feedwater (2)						
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	SFCP	1, 2, 3
b. Steam Generator Water Level--Low-Low	SFCP	SFCP ^{(a)(b)}	SFCP ^{(a)(b)}	N.A.	N.A.	1, 2, 3

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

<u>CHANNEL FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>TRIP ACTUATING DEVICE OPERATIONAL TEST</u>	<u>ACTUATION LOGIC TEST #</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
6. Auxiliary Feedwater (Continued)						
c. Safety Injection	See Item 1. above for all Safety Injection Surveillance Requirements.					
d. Bus Stripping	N.A.	SFCP	N.A.	SFCP	N.A.	1, 2, 3
e. Trip of All Main Feedwater Pump Breakers.	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2
7. Loss of Power						
a. 4.16 kV busses A and B (Loss of Voltage)	N.A.	SFCP	N.A.	SFCP	N.A.	1, 2, 3, 4
b. 480V Load Centers 3A, 3B, 3C, 3D and 4A, 4B, 4C, 4D Undervoltage	SFCP	SFCP	N.A.	SFCP(1)	N.A.	1, 2, 3, 4
Coincident with: Safety Injection	See Item 1. above for all Safety Injection Surveillance Requirements.					
c. 480V Load Centers 3A, 3B, 3C, 3D and 4A, 4B, 4C, 4D Degraded Voltage	SFCP	SFCP	N.A.	SFCP(1)	N.A.	1, 2, 3, 4

TABLE 4.3-2 (Continued)
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

CHANNEL FUNCTIONAL UNIT	CHANNEL CHECK	CHANNEL CALIBRATION	ANALOG CHANNEL OPERATIONAL TEST	TRIP ACTUATING DEVICE OPERATIONAL TEST	ACTUATION LOGIC TEST #	MODES FOR WHICH SURVEILLANCE IS REQUIRED
8. Engineering Safety Features Actuation System Interlocks						
a. Pressurizer Pressure	N.A.	SFCP	SFCP(5)	N.A.	N.A.	1, 2, 3(3)
b. Tavg--Low	N.A.	SFCP	SFCP(5)	N.A.	N.A.	1, 2, 3(3)
9. Control Room Ventilation Isolation						
a. Automatic Actuation Logic and Actuation Relays	N.A.	N.A.	N.A.	N.A.	N.A.	(4)
b. Safety Injection	See Item 1. above for all Safety Injection Surveillance Requirements.					
c. Deleted						
d. Containment Isolation Manual Phase A or Manual Phase B	N.A.	N.A.	N.A.	SFCP	N.A.	1, 2, 3, 4
e. Control Room Air Intake Radiation Level	SFCP	SFCP	SFCP	N.A.	N.A.	All

TABLE 4.3-2 (Continued)
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

TABLE NOTATIONS

In accordance with the Surveillance Frequency Control Program each Actuation Logic Test shall include energization of each relay and verification of OPERABILITY of each relay.

- (a) If the as-found channel setpoint is outside its predefined as-found tolerance, then the channel shall be evaluated to verify that it is functioning as required before returning the channel to service.
 - (b) The instrument channel setpoint shall be reset to a value that is within the as-left tolerance around the Nominal Trip Setpoint (NTS) at the completion of the surveillance; otherwise, the channel shall be declared inoperable. Setpoints more conservative than the NTS are acceptable provided that the as-found and as-left tolerances apply to the actual setpoint implemented in the surveillance procedures (field settings) to confirm channel performance. The NTS and methodologies used to determine the as-found and the as-left tolerances are specified in UFSAR Section 7.2
- (1) Each train shall be tested in accordance with the Surveillance Frequency Control Program.
 - (2) Auxiliary feedwater manual initiation is included in Specification 3.7.1.2.
 - (3) The provisions of Specification 4.0.4 are not applicable for entering Mode 3, provided that the applicable surveillances are completed within 96 hours from entering Mode 3.
 - (4) Applicable in MODES 1, 2, 3, 4 or during movement of irradiated fuel within the containment.
 - (5) Test of alarm function not required when alarm locked in.

INSTRUMENTATION

3/4.3.3 MONITORING INSTRUMENTATION

RADIATION MONITORING FOR PLANT OPERATIONS

LIMITING CONDITION FOR OPERATION

3.3.3.1 The radiation monitoring instrumentation channels for plant operations shown in Table 3.3-4 shall be OPERABLE with their Alarm/Trip Setpoints within the specified limits.

APPLICABILITY: As shown in Table 3.3-4.

ACTION:

- a. With a radiation monitoring channel Alarm/Trip Setpoint for plant operations exceeding the value shown in Table 3.3-4, adjust the Setpoint to within the limit within 4 hours or declare the channel inoperable.
- b. With one or more radiation monitoring channels for plant operations inoperable, take the ACTION shown in Table 3.3-4.
- c. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.3.1 Each radiation monitoring instrumentation channel for plant operations shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST for the MODES and at the frequencies shown in Table 4.3-3.

TABLE 3.3-4RADIATION MONITORING INSTRUMENTATION FOR PLANT OPERATIONS

<u>FUNCTIONAL UNIT</u>	<u>CHANNELS TO TRIP/ALARM</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ALARM/TRIP SETPOINT</u>	<u>ACTION</u>
1. Containment					
a. Containment Atmosphere Radioactivity-High (Particulate or Gaseous (See Note 1.))	1	1*	All*	Particulate $\leq 6.1 \times 10^5$ CPM Gaseous See Note 2.	26 for MODES 1, 2, 3, 4 or 27 for MODES 5 and 6

TABLE 3.3-4 (Continued)
TABLE NOTATIONS

* During movement of irradiated fuel within the containment, comply with Specification 3/4.9.13.

Note 1 Either the particulate or gaseous channel in the OPERABLE status will satisfy this LCO.

Note 2 Containment Gaseous Monitor Setpoint = $\frac{(3.2 \times 10^4)}{(F)}$ CPM,

Where $F = \frac{\text{Actual Purge Flow}}{\text{Design Purge Flow (35,000 CFM)}}$

Setpoint may vary according to current plant conditions provided that the release rate does not exceed allowable limits provided in the Offsite Dose Calculation Manual.

ACTION STATEMENTS

ACTION 26 - In MODES 1 thru 4: With both the Particulate and Gaseous Radioactivity Monitoring Systems inoperable, comply with the following:

- 1) Table 3.3-2, ACTION 16, and
- 2) Technical Specification 3.4.6.1, ACTION a.

TABLE 3.3-4 (Continued)

ACTION STATEMENTS (Continued)

ACTION 27 - In MODES 5 or 6 (except during or movement of irradiated fuel within the containment): With the number of OPERABLE Channels less than the Minimum Channels OPERABLE requirement perform the following:

- 1) Obtain and analyze appropriate grab samples at least once per 24 hours, and
- 2) Monitor containment atmosphere with area radiation monitors.

Otherwise, isolate all penetrations that provide direct access from the containment atmosphere to the outside atmosphere.

During movement of irradiated fuel within the containment: With the number of OPERABLE Channels less than the Minimum Channels OPERABLE requirements, comply with ACTION statement requirements of Specification 3.9.9 and 3.9.13.

TABLE 4.3-3
RADIATION MONITORING INSTRUMENTATION FOR PLANT
OPERATIONS SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>ANALOG CHANNEL OPERATIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. Containment				
a. Containment Atmosphere Radioactivity--High	SFCP	SFCP	SFCP	All

INSTRUMENTATION

MOVABLE INCORE DETECTORS

LIMITING CONDITION FOR OPERATION

3.3.3.2 The Movable Incore Detection System shall be OPERABLE with:

- a. At least 16 detector thimbles when used for recalibration and check of the Excore Neutron Flux Detection System and monitoring the QUADRANT POWER TILT RATIO*, and at least 38 detector thimbles when used for monitoring $F_{\Delta H}^N$, $F_Q(Z)$ and $F_{xy}(Z)$.
- b. A minimum of two detector thimbles per core quadrant, and
- c. Sufficient movable detectors, drive, and readout equipment to map these thimbles.

APPLICABILITY: When the Movable Incore Detection System is used for:

- a. Recalibration of the Excore Neutron Flux Detection System, or
- b. Monitoring the QUADRANT POWER TILT RATIO*, or
- c. Measurement of $F_{\Delta H}^N$, $F_Q(Z)$ and $F_{xy}(Z)$.

ACTION:

With the Movable Incore Detection System inoperable, do not use the system for the above applicable monitoring or calibration functions. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.3.2 The Movable Incore Detection System shall be demonstrated OPERABLE in accordance with the Surveillance Frequency Control Program by normalizing each detector output when required for:

- a. Recalibration of the Excore Neutron Flux Detection System, or
- b. Monitoring the QUADRANT POWER TILT RATIO*, or
- c. Measurement of $F_{\Delta H}^N$, $F_Q(Z)$ and $F_{xy}(Z)$.

* Exception to the 16 detector thimble requirement of monitoring the QUADRANT POWER TILT RATIO is acceptable when performing Specification 4.2.4.2 using two sets of four symmetric thimbles.

INSTRUMENTATION

ACCIDENT MONITORING INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.3.3 The accident monitoring instrumentation channels shown in Table 3.3-5 shall be OPERABLE.

APPLICABILITY: As shown in Table 3.3-5.

ACTION:

- a. As shown in Table 3.3-5.
- b. Separate Action entry is allowed for each Instrument.

SURVEILLANCE REQUIREMENTS

4.3.3.3 Each accident monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK and CHANNEL CALIBRATION at the frequencies shown in Table 4.3-4.

TABLE 3.3-5

ACCIDENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLI- CABLE MODES</u>	<u>ACTIONS</u>
1. Containment Pressure (Wide Range)	2	1	1, 2, 3	31, 32
2. Containment Pressure (Narrow Range)	2	1	1, 2, 3	36
3. Reactor Coolant Outlet Temperature T _{HOT} (Wide Range)	2-2 Detectors per Channel	1-2 Detectors per Channel	1, 2, 3	31, 32
4. Reactor Coolant Inlet Temperature T _{COLD} (Wide Range)	2-2 Detectors per Channel	1-2 Detectors per Channel	1, 2, 3	31, 32
5. Reactor Coolant Pressure – Wide Range	2	1	1, 2, 3	31, 32
6. Pressurizer Water Level	2	1	1, 2, 3	31, 32
7. Auxiliary Feedwater Flow Rate	2/steam generator	1/steam generator	1, 2, 3	31, 32
8. Reactor Coolant System Subcooling Margin Monitor	2(2)	1(2)	1, 2, 3	31, 32
9. PORV Position Indicator (Primary Detector)	1/valve	1/valve	1, 2, 3	33
10. PORV Block Valve Position Indicator	1/valve	1/valve	1, 2, 3	33
11. Safety Valve Position Indicator (Primary Detector)	1/valve	1/valve	1, 2, 3	32
12. Containment Water Level (Narrow Range)	2	1	1, 2, 3	36
13. Containment Water Level (Wide Range)	2	1	1, 2, 3	31, 32

TABLE 3.3-5 (Continued)

ACCIDENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLI- CABLE MODES</u>	<u>ACTIONS</u>
14. In Core Thermocouples (Core Exit Thermocouples)	4/core quadrant	2/core quadrant	1, 2, 3	31, 32
15. Containment High Range Area Radiation	2	1	1, 2, 3	34
16. Reactor Vessel Level Monitoring System	2(1)	1(1)	1, 2, 3	37, 38
17. Neutron Flux, Backup NIS (Wide Range)	2	1	1, 2, 3	31, 32
18. DELETED				
19. DELETED				
20. RWST Water Level	2	1	1, 2, 3	31, 32
21. Steam Generator Water Level (Narrow Range)	2/stm. Gen.	1/stm. Gen.	1, 2, 3	31, 32
22. Containment Isolation Valve Position Indication*	1/valve	1/valve	1, 2, 3	39

TABLE NOTATIONS

1. A channel is eight sensors in a probe. A channel is OPERABLE if a minimum of four sensors are OPERABLE.
 2. Inputs to this instrument are from instrument items 3, 4, 5 and 14 of this Table.
- * Applicable for containment isolation valve position indication designated as post-accident monitoring instrumentation (containment isolation valves which receive containment isolation Phase A, Phase B, or containment ventilation isolation signals).

TABLE 3.3-5 (Continued)

ACTION STATEMENTS

- ACTION 31 With the number of OPERABLE accident monitoring instrumentation channel(s) less than the Total Number of Channels either restore the inoperable channel(s) to OPERABLE status within 30 days, or submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 14 days outlining the action taken, the cause of the inoperability, and the plans and schedule for restoring the system to OPERABLE status.
- ACTION 32 With the number of OPERABLE accident monitoring instrumentation channels less than the Minimum Channels OPERABLE, either restore the inoperable channel(s) to OPERABLE status within 7 days, or be in at least HOT STANDBY within the next 6 hours and in at least HOT SHUTDOWN within the following 6 hours.
- ACTION 33 Close the associated block valve and open its circuit breaker.
- ACTION 34 With the number of OPERABLE Channels less than required by the Minimum Channels OPERABLE requirements, initiate the preplanned alternate method of monitoring the appropriate parameter(s), within 72 hours, and:
- 1) Either restore the inoperable channel(s) to OPERABLE status within 7 days of the event, or
 - 2) Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 14 days outlining the action taken, the cause of the inoperability, and the plans and schedule for restoring the system to OPERABLE status.
- ACTION 35 DELETED
- ACTION 36 With the number of OPERABLE accident monitoring instrumentation channels less than the Minimum Channel OPERABLE, either restore the inoperable channel to OPERABLE status within 30 days, or be in at least HOT STANDBY within the next 6 hours and in at least HOT SHUTDOWN within the following 6 hours.
- ACTION 37 With the number of OPERABLE channels one less than the Total Number of Channels, restore the system to OPERABLE status within 30 days. If repairs are not feasible without shutting down, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 14 days outlining the action taken, the cause of the inoperability and the plans and schedule for restoring the system to OPERABLE status.

TABLE 3.3-5 (Continued)

ACTION STATEMENTS

- ACTION 38 With the number of OPERABLE channels less than the Minimum Channels OPERABLE requirements, restore the inoperable channel(s) to OPERABLE status within 7 days. If repairs are not feasible without shutting down:
1. Initiate an alternate method of monitoring the reactor vessel inventory; and
 2. Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 14 days outlining the action taken, the cause of the inoperability and the plans and schedule for restoring the system to OPERABLE status; and
 3. Restore at least one channel to OPERABLE status at the next scheduled refueling.
- ACTION 39 With the number of OPERABLE channels less than the Minimum Channels OPERABLE requirement, verify position by an alternate means (e.g. administrative controls, ERDADS, alternate position indication, or visual observation) within 2 hours, and restore the inoperable channel(s) within 7 days, or comply with the provisions of Specification 3.6.4 for an inoperable containment isolation valve.

TABLE 4.3-4

ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>
1. Containment Pressure (Wide Range)	SFCP	SFCP
2. Containment Pressure (Narrow Range)	SFCP	SFCP
3. Reactor Coolant Outlet Temperature - T _{HOT} (Wide Range)	SFCP	SFCP
4. Reactor Coolant Inlet Temperature - T _{COLD} (Wide Range)	SFCP	SFCP
5. Reactor Coolant Pressure - Wide Range	SFCP	SFCP
6. Pressurizer Water Level	SFCP	SFCP
7. Auxiliary Feedwater Flow Rate	SFCP	SFCP
8. Reactor Coolant System Subcooling Margin Monitor	SFCP	SFCP
9. PORV Position Indicator (Primary Detector)	SFCP	SFCP
10. PORV Block Valve Position Indicator	SFCP	SFCP
11. Safety Valve Position Indicator (Primary Detector)	SFCP	SFCP
12. Containment Water Level (Narrow Range)	SFCP	SFCP
13. Containment Water Level (Wide Range)	SFCP	SFCP
14. In Core Thermocouples (Core Exit Thermocouples)	SFCP	SFCP
15. Containment - High Range Area Radiation Monitor	SFCP	SFCP*
16. Reactor Vessel Level Monitoring System	SFCP	SFCP
17. Neutron Flux, Backup NIS (Wide Range)	SFCP	SFCP
18. DELETED		
19. DELETED		
20. RWST Water Level	SFCP	SFCP
21. Steam Generator Water Level (Narrow Range)	SFCP	SFCP
22. Containment Isolation Valve Position Indication	SFCP	SFCP

*Acceptable criteria for calibration are provided in Table II.F.1-3 of NUREG-0737.

INSTRUMENTATION

3/4 3.3.3.6 DELETED

|

TABLE 3.3-8

DELETED

TURKEY POINT – UNITS 3 & 4

3/4 3-52

AMENDMENT NOS. 282 AND 276

TABLE 4.3-6

DELETED

TURKEY POINT - UNITS 3 & 4

3/4 3-53

AMENDMENT NOS. 282 AND 276

3/4.4 REACTOR COOLANT SYSTEM

3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION

STARTUP AND POWER OPERATION

LIMITING CONDITION FOR OPERATION

3.4.1.1 All reactor coolant loops shall be in operation.

APPLICABILITY: MODES 1 and 2.

ACTION:

With less than the above required reactor coolant loops in operation, be in at least HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

4.4.1.1 The above required reactor coolant loops shall be verified in operation and circulating reactor coolant in accordance with the Surveillance Frequency Control Program.

REACTOR COOLANT SYSTEM

HOT STANDBY

LIMITING CONDITION FOR OPERATION

3.4.1.2 All of the reactor coolant loops listed below shall be OPERABLE with all reactor coolant loops in operation when the Reactor Trip breakers are closed and two reactor coolant loops listed below shall be OPERABLE with at least one reactor coolant loop in operation when the Reactor Trip breakers are open:*

- a. Reactor Coolant Loop A and its associated steam generator and reactor coolant pump,
- b. Reactor Coolant Loop B and its associated steam generator and reactor coolant pump, and
- c. Reactor Coolant Loop C and its associated steam generator and reactor coolant pump.

APPLICABILITY: MODE 3

ACTION:

- a. With less than the above required reactor coolant loops OPERABLE, restore the required loops to OPERABLE status within 72 hours or be in HOT SHUTDOWN within the next 12 hours.
- b. With less than three reactor coolant loop in operation and the Reactor Trip breakers in the closed position, within 1 hour open the Reactor Trip breakers.
- c. With no reactor coolant loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required reactor coolant loop to operation.

SURVEILLANCE REQUIREMENTS

4.4.1.2.1 At least the above required reactor coolant pumps, if not in operation, shall be determined OPERABLE by verifying correct breaker alignments and indicated power availability in accordance with the Surveillance Frequency Control Program.

4.4.1.2.2 The required steam generators shall be determined OPERABLE by verifying secondary side water level to be greater than or equal to 10% in accordance with the Surveillance Frequency Control Program.

4.4.1.2.3 The required reactor coolant loops shall be verified in operation and circulating reactor coolant in accordance with the Surveillance Frequency Control Program.

* All reactor coolant pumps may be deenergized for up to 1 hour provided: (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

REACTOR COOLANT SYSTEM

HOT SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.4.1.3 At least two of the loops listed below shall be OPERABLE and at least one of these loops shall be in operation:*

- a. Reactor Coolant Loop A and its associated steam generator and reactor coolant pump,**
- b. Reactor Coolant Loop B and its associated steam generator and reactor coolant pump,**
- c. Reactor Coolant Loop C and its associated steam generator and reactor coolant pump,**
- d. RHR Loop A, and
- e. RHR Loop B.

APPLICABILITY: MODE 4.

ACTION:

- a. With less than the above required loops OPERABLE, immediately initiate corrective action to return the required loops to OPERABLE status as soon as possible; if the remaining OPERABLE loop is an RHR loop, be in COLD SHUTDOWN within 24 hours.
- b. With no loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required loop to operation.

*All reactor coolant pumps and RHR pumps may be deenergized for up to 1 hour provided: (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

**A reactor coolant pump shall not be started with one or more of the Reactor Coolant System cold leg temperatures less than or equal to 275°F unless the secondary water temperature of each steam generator is less than 50°F above each of the Reactor Coolant System cold leg temperatures.

REACTOR COOLANT SYSTEM

SURVEILLANCE REQUIREMENTS

4.4.1.3.1 The required reactor coolant pump(s), if not in operation, shall be determined OPERABLE by verifying correct breaker alignments and indicated power availability in accordance with the Surveillance Frequency Control Program.

4.4.1.3.2 The required steam generator(s) shall be determined OPERABLE by verifying secondary side water level to be greater than or equal to 10% in accordance with the Surveillance Frequency Control Program.

4.4.1.3.3 At least one reactor coolant or RHR loop shall be verified in operation and circulating reactor coolant in accordance with the Surveillance Frequency Control Program.

4.4.1.3.4 Verify required RHR loop locations susceptible to gas accumulation are sufficiently filled with water in accordance with the Surveillance Frequency Control Program.*

* Not required to be performed until 12 hours after entering MODE 4.

REACTOR COOLANT SYSTEM

COLD SHUTDOWN - LOOPS FILLED

LIMITING CONDITION FOR OPERATION

3.4.1.4.1 At least one residual heat removal (RHR) loop shall be OPERABLE and in operation*, and either:

- a. One additional RHR loop shall be OPERABLE**, or
- b. The secondary side water level of at least two steam generators shall be greater than 10%.

APPLICABILITY: MODE 5 with reactor coolant loops filled***.

ACTION:

- a. With one of the RHR loops inoperable or with less than the required steam generator water level, immediately initiate corrective action to return the inoperable RHR loop to OPERABLE status or restore the required steam generator water level as soon as possible.
- b. With no RHR loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required RHR loop to operation.

SURVEILLANCE REQUIREMENTS

4.4.1.4.1.1 The secondary side water level of at least two steam generators when required shall be determined to be within limits in accordance with the Surveillance Frequency Control Program.

4.4.1.4.1.2 At least one RHR loop shall be determined to be in operation and circulating reactor coolant in accordance with the Surveillance Frequency Control Program.

4.4.1.4.1.3 Verify required RHR loop locations susceptible to gas accumulation are sufficiently filled with water in accordance with the Surveillance Frequency Control Program.

* The RHR pump may be deenergized for up to 1 hour provided: (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

** One RHR loop may be inoperable for up to 2 hours for surveillance testing provided the other RHR loop is OPERABLE.

*** A reactor coolant pump shall not be started with one or more of the Reactor Coolant System cold leg temperatures less than or equal to 275°F unless the secondary water temperature of each steam generator is less than 50°F above each of the Reactor Coolant System cold leg temperatures.

REACTOR COOLANT SYSTEM

COLD SHUTDOWN - LOOPS NOT FILLED

LIMITING CONDITION FOR OPERATION

3.4.1.4.2 Two residual heat removal (RHR) loops shall be OPERABLE* and at least one RHR loop shall be in operation.**

APPLICABILITY: MODE 5 with reactor coolant loops not filled.

ACTION:

- a. With less than the above required RHR loops OPERABLE, immediately initiate corrective action to return the required RHR loops to OPERABLE status as soon as possible.
- b. With no RHR loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required RHR loop to operation.

SURVEILLANCE REQUIREMENTS

4.4.1.4.2.1 At least one RHR loop shall be determined to be in operation and circulating reactor coolant in accordance with the Surveillance Frequency Control Program.

4.4.1.4.2.2 Verify RHR loop locations susceptible to gas accumulation are sufficiently filled with water in accordance with the Surveillance Frequency Control Program.

* One RHR loop may be inoperable for up to 2 hours for surveillance testing provided the other RHR loop is OPERABLE.

** The RHR pump may be deenergized for up to 1 hour provided: (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

REACTOR COOLANT SYSTEM

3/4.4.2 SAFETY VALVES

SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.4.2.1 A minimum of one pressurizer Code safety valve shall be OPERABLE* with a lift setting of 2465 psig + 2%, -3%. ** ***

APPLICABILITY: MODES 4 and 5.

ACTION:

With no pressurizer Code safety valve OPERABLE, immediately suspend all operations involving positive reactivity changes and place an OPERABLE RHR loop into operation in the shutdown cooling mode.

SURVEILLANCE REQUIREMENTS

4.4.2.1 No additional requirements other than those required by the INSERVICE TESTING PROGRAM. |

* While in MODE 5, an equivalent size vent pathway may be used provided that the vent pathway is not isolated or sealed.

** The lift setting pressure shall correspond to ambient conditions of the valve at nominal operating temperature and pressure.

*** All valves tested must have "as left" lift setpoints that are within $\pm 1\%$ of the lift setting value.

REACTOR COOLANT SYSTEM

OPERATING

LIMITING CONDITION FOR OPERATION

3.4.2.2 All pressurizer Code safety valves shall be OPERABLE with a lift setting of 2465 psig + 2%, -3%. * **

APPLICABILITY: MODES 1, 2 and 3.

ACTION:

With one pressurizer Code safety valve inoperable, either restore the inoperable valve to OPERABLE status within 15 minutes or be in at least HOT STANDBY within 6 hours and in at least HOT SHUTDOWN within the following 6 hours.

SURVEILLANCE REQUIREMENTS

4.4.2.2 No additional requirements other than those required by the INSERVICE TESTING PROGRAM. |

* The lift setting pressure shall correspond to ambient conditions of the valve at nominal operating temperature and pressure.

** All valves tested must have "as left" lift setpoints that are within $\pm 1\%$ of the lift setting value.

REACTOR COOLANT SYSTEM

3/4.4.3 PRESSURIZER

LIMITING CONDITION FOR OPERATION

3.4.3 The pressurizer shall be OPERABLE with a water volume of less than or equal to 92% of indicated level, and at least two groups of pressurizer heaters each having a capacity of at least 125 kW and capable of being supplied by emergency power.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

- a. With only one group of pressurizer heaters OPERABLE, restore at least two groups to OPERABLE status within 72 hours** or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With the pressurizer otherwise inoperable, be in at least HOT STANDBY with the Reactor Trip System breakers open within 6 hours and in HOT SHUTDOWN within the following 6 hours.

SURVEILLANCE REQUIREMENTS

4.4.3.1 The pressurizer water volume shall be determined to be within its limit in accordance with the Surveillance Frequency Control Program.

4.4.3.2 The capacity of each of the above required groups of pressurizer heaters shall be verified to be at least 125 kw in accordance with the Surveillance Frequency Control Program.

** 14 days if the inoperability is associated with an inoperable diesel generator.

REACTOR COOLANT SYSTEM

3/4.4.4 RELIEF VALVES

LIMITING CONDITION FOR OPERATION

3.4.4 Both power-operated relief valves (PORVs) and their associated block valves shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

- a. With one or both PORVs inoperable because of excessive leakage, within 1 hour either restore the PORV(s) to OPERABLE status or close the associated block valve(s) with power maintained to the block valve(s); otherwise, be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With one PORV inoperable due to causes other than excessive leakage, within 1 hour either restore the PORV to OPERABLE status or close its associated block valve and remove power from the block valve; otherwise, be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- c. With both PORVs inoperable due to causes other than excessive leakage, within 1 hour either restore at least one PORV to OPERABLE status or close each PORV's associated block valve and remove power from the block valve; with both block valves closed with power removed, restore at least one PORV to OPERABLE status within 30 days and restore power to its associated block valve; otherwise, be in at least HOT STANDBY within the next 6 hours and HOT SHUTDOWN within the following 6 hours.
- d. With one or both block valve(s) inoperable, within 1 hour either restore the block valve(s) to OPERABLE status or close the block valve(s) and remove power from the block valve(s); otherwise, place its associated PORV in manual control within the next hour, and be in at least HOT STANDBY within the next 6 hours and HOT SHUTDOWN within the following 6 hours. Restore at least one block valve to OPERABLE status within 30 days if both block valves are inoperable; otherwise, be in at least HOT STANDBY within the next 6 hours and HOT SHUTDOWN within the following 6 hours.

REACTOR COOLANT SYSTEM

RELIEF VALVES

SURVEILLANCE REQUIREMENTS

- 4.4.4 In accordance with the INSERVICE TESTING PROGRAM each block valve shall be demonstrated OPERABLE by operating the valve through one complete cycle of full travel unless the block valve is closed with power removed in order to meet the requirements of Specification 3.4.4 or is closed to provide an isolation function. |

REACTOR COOLANT SYSTEM

3/4.4.5 STEAM GENERATOR (SG) TUBE INTEGRITY

LIMITING CONDITION FOR OPERATION

3.4.5 SG tube integrity shall be maintained

AND

All SG tubes satisfying the tube plugging criteria shall be plugged in accordance with the SG Program.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION*:

- a. With one or more SG tubes satisfying the tube plugging criteria and not plugged in accordance with the Steam Generator Program;
 1. Within 7 days verify tube integrity of the affected tube(s) is maintained until the next refueling outage or SG tube inspection, and
 2. Plug the affected tube(s) in accordance with the Steam Generator Program prior to entering HOT SHUTDOWN following the next refueling outage or SG tube inspection.
- b. With the requirements and associated allowable outage time of Action a above not met or SG tube integrity not maintained, be in HOT STANDBY within 6 hours and in COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.5.1 Verify SG tube integrity in accordance with the Steam Generator Program.

4.4.5.2 Verify that each inspected SG tube that satisfies the tube plugging criteria is plugged in accordance with the Steam Generator Program prior to entering HOT SHUTDOWN following a SG tube inspection.

*Separate Action entry is allowed for each SG tube.

REACTOR COOLANT SYSTEM

3/4.4.6 REACTOR COOLANT SYSTEM LEAKAGE

LEAKAGE DETECTION SYSTEMS

LIMITING CONDITION FOR OPERATION

3.4.6.1 The following Reactor Coolant System Leakage Detection Systems shall be OPERABLE:

- a. The Containment Atmosphere Gaseous or Particulate Radioactivity Monitoring System, and
- b. A Containment Sump Level Monitoring System.

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

- a. With both the Particulate and Gaseous Radioactivity Monitoring Systems inoperable, operation may continue for up to 7 days provided:

- 1) A Containment Sump Level Monitoring System is OPERABLE;
- 2) Appropriate grab samples are obtained and analyzed at least once per 24 hours;
- 3) A Reactor Coolant System water inventory balance is performed at least once per 8* hours except when operating in shutdown cooling mode.

Otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

- b. With no Containment Sump Level Monitoring System operable, restore at least one Containment Sump Level Monitoring System to OPERABLE status within 7 days, or be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.6.1 The Leakage Detection System shall be demonstrated OPERABLE by:

- a. Containment Atmosphere Gaseous and Particulate Monitoring System performance of CHANNEL CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST in accordance with the Surveillance Frequency Control Program, and
- b. Containment Sump Level Monitoring System-performance of CHANNEL CALIBRATION in accordance with the Surveillance Frequency Control Program.

* Not required to be performed until 12 hours after establishment of steady state operation.

REACTOR COOLANT SYSTEM

OPERATIONAL LEAKAGE

LIMITING CONDITION FOR OPERATING

3.4.6.2 Reactor Coolant System operational leakage shall be limited to:

- a. No PRESSURE BOUNDARY LEAKAGE,
- b. 1 GPM UNIDENTIFIED LEAKAGE,
- c. 150 gallons per day primary-to-secondary leakage through any one steam generator (SG),
- d. 10 GPM IDENTIFIED LEAKAGE from the Reactor Coolant System, and
- e. Leakage as specified in Table 3.4-1 up to a maximum of 5 GPM at a Reactor Coolant System pressure of 2235 ± 20 psig from any Reactor Coolant System Pressure Isolation Valve specified in Table 3.4-1.*

APPLICABILITY: MODES 1, 2, 3 and 4.

ACTION:

- a. With any PRESSURE BOUNDARY LEAKAGE, or with primary-to-secondary leakage not within limit, be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With any Reactor Coolant System operational leakage greater than any one of the above limits, excluding primary-to-secondary leakage, PRESSURE BOUNDARY LEAKAGE, and leakage from Reactor Coolant System Pressure Isolation Valves, reduce the leakage rate to within limits within 4 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With any Reactor Coolant System Pressure Isolation Valve leakage greater than allowed by 3.4.6.2.e above operation may continue provided:
 1. Within 4 hours verify that at least two valves in each high pressure line having a non-functional valve are in, and remain in that mode corresponding to the isolated condition, i.e., manual valves shall be locked in the closed position; motor operated valves shall be placed in the closed position and power supplies deenergized. Follow applicable ACTION statement for the affected system, and

* Test pressure less than 2235 psig are allowed. Minimum differential test pressure shall not be less than 150 psid. Observed leakage shall be adjusted for the actual test pressure up to 2235 psig assuming the leakage to be directly proportional to pressure differential to the one-half power.

REACTOR COOLANT SYSTEM
OPERATIONAL LEAKAGE
LIMITING CONDITION FOR OPERATION (Continued)

2. The leakage* from the remaining isolating valves in each high pressure line having a valve not meeting the criteria of Table 3.4-1, as listed in Table 3.4-1, shall be determined and recorded daily. The positions of the other valves located in the high pressure line having the leaking valve shall be recorded daily unless they are manual valves located inside containment.

Otherwise be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

NOTE: Enter applicable ACTIONS for systems made inoperable by an inoperable pressure isolation valve.

- d. With any Reactor Coolant System Pressure Isolation Valve leakage greater than 5 gpm, reduce leakage to below 5 gpm within 1 hour, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

- 4.4.6.2.1 Reactor Coolant System operational leakages shall be demonstrated to be within each of the above limits by:
 - a. Monitoring the containment atmosphere gaseous or particulate radioactivity monitor in accordance with the Surveillance Frequency Control Program.
 - b. Monitoring the containment sump level in accordance with the Surveillance Frequency Control Program.
 - c.** Performance of a Reactor Coolant System water inventory balance in accordance with the Surveillance Frequency Control Program***; and
 - d. Monitoring the Reactor Head Flange Leakoff System in accordance with the Surveillance Frequency Control Program; and
 - e. Verifying primary-to-secondary leakage is ≤ 150 gallons per day through any one SG in accordance with the Surveillance Frequency Control Program***.
- 4.4.6.2.2 Each Reactor Coolant System Pressure Isolation Valve specified in Table 3.4-1 shall be demonstrated OPERABLE by verifying leakage* to be within its limit:
 - a. When tested in accordance with the INSERVICE TESTING PROGRAM.
 - b. Prior to entering MODE 2 whenever the plant has been in COLD SHUTDOWN for 7 days or more and if leakage testing has not been performed in the previous 9 months.
 - c. DELETED

* To satisfy ALARA requirements, leakage may be measured indirectly (as from the performance of pressure indicators) if accomplished in accordance with approved procedures and supported by computations showing that the method is capable of demonstrating valve compliance with the leakage criteria.

** Not applicable to primary-to-secondary leakage.

*** Not required to be performed until 12 hours after establishment of steady state operation.

REACTOR COOLANT SYSTEM

OPERATIONAL LEAKAGE

LIMITING CONDITION FOR OPERATION (Continued)

- d. Following valve actuation due to automatic or manual action or flow through the valve*:
 - 1. Within 24 hours by verifying valve closure, and
 - 2. Prior to entering Mode 2 by verifying leakage rate.

The provisions of Specification 4.0.4 are not applicable for entry into MODE 3 or 4.

* RCS Pressure Isolation Valves actuated during the performance of this surveillance are not required to be tested more than once if a repetitive testing loop cannot be avoided.

TABLE 3.4-1

REACTOR COOLANT SYSTEM PRESSURE ISOLATION VALVES

<u>VALVE NUMBER</u>		<u>FUNCTION</u>
Unit 3	Unit 4	High-Head Safety Injection Check Valves
3-874A	4-874A	Loop A, hot leg cold leg cold leg
3-875A	4-875A	
3-873A	4-873A	
3-874B	4-874B	Loop B, hot leg cold leg cold leg
3-875B	4-875B	
3-873B	4-873B	
3-875C	4-875C	Loop C, cold leg cold leg
3-873C	4-873C	
		Residual Heat Removal Line Check Valves
3-876A	4-876A 4-876E	Loop A, cold leg
3-876B	4-876B	Loop B, cold leg
3-876D	4-876D	
3-876C	4-876C	Loop C, cold leg
3-876E		
		MOV4-750 MOV4-751
		Loop A, hot leg to RHR
MOV3-750 MOV3-751		Loop C, hot leg to RHR

ACCEPTABLE LEAKAGE LIMITS

1. Leakage rates less than or equal to 1.0 gpm are considered acceptable.
2. Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered acceptable provided that the latest measured rate has not exceeded the rate determined by the previous test by an amount that reduces the margin between previously measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
3. Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered unacceptable if the latest measured rate exceeded the rate determined by the previous test by an amount that reduces the margin between previously measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
4. Leakage rates greater than 5.0 gpm are considered unacceptable.

REACTOR COOLANT SYSTEM

3/4.4.7 DELETED

TABLE 3.4-2

DELETED

TABLE 4.4-3

DELETED

REACTOR COOLANT SYSTEM

3/4.4.8 SPECIFIC ACTIVITY

LIMITING CONDITION FOR OPERATION

3.4.8 The specific activity of the primary coolant shall be limited to:

- a. Less than or equal to 0.25 microcuries per gram DOSE EQUIVALENT I-131, and
- b. Less than or equal to 447.7 microcuries per gram DOSE EQUIVALENT XE-133.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

NOTE: LCO 3.0.4.c is applicable to DOSE EQUIVALENT I-131.

- a. With the specific activity of the reactor coolant greater than 0.25 microcuries per gram DOSE EQUIVALENT I-131, verify DOSE EQUIVALENT I-131 is less than or equal to 60 microcuries per gram once per 4 hours.
- b. With the specific activity of the reactor coolant greater than 0.25 microcuries per gram DOSE EQUIVALENT I-131, but less than or equal to 60 microcuries per gram, operation may continue for up to 48 hours while efforts are made to restore DOSE EQUIVALENT I-131 to within the 0.25 microcuries per gram limit.
- c. With the specific activity of the reactor coolant greater than 0.25 microcuries per gram DOSE EQUIVALENT I-131 for greater than or equal to 48 hours during one continuous time interval, or greater than 60 microcuries per gram DOSE EQUIVALENT I-131, be in HOT STANDBY within 6 hours and COLD SHUTDOWN within the next 30 hours.
- d. With the specific activity of the reactor coolant greater than 447.7 microcuries per gram DOSE EQUIVALENT XE-133, operation may continue for up to 48 hours while efforts are made to restore DOSE EQUIVALENT XE-133 to within the 447.7 microcuries per gram limit.
- e. With the specific activity of the reactor coolant greater than 447.7 microcuries per gram DOSE EQUIVALENT XE-133 for greater than or equal to 48 hours during one continuous time interval, be in HOT STANDBY within 6 hours and COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.8 The specific activity of the reactor coolant shall be determined to be within the limits by performing the sampling and analysis described in Table 4.4-4.

TABLE 4.4-4REACTOR COOLANT SPECIFIC ACTIVITY SAMPLE AND ANALYSIS

<u>TYPE OF MEASUREMENT AND ANALYSIS</u>	<u>SAMPLE AND ANALYSIS FREQUENCY</u>	<u>MODES IN WHICH SAMPLE AND ANALYSIS REQUIRED</u>
1. NOT USED		
2. Tritium Activity Determination	SFCP.	1, 2, 3, 4
3. Isotopic Analysis for DOSE EQUIVALENT I-131	a) SFCP. b) One sample between 2 and 6 hours following a THERMAL POWER change exceeding 15% of the RATED THERMAL POWER within a 1 hour period.	1, 2, 3, 4
4. Radiochemical Isotopic Determination Including Gaseous Activity	SFCP	1, 2, 3, 4
5. Isotopic Analysis for DOSE EQUIVALENT XE-133	SFCP	1, 2, 3, 4
6. NOT USED		

REACTOR COOLANT SYSTEM

3/4.4.9 PRESSURE TEMPERATURE LIMITS

REACTOR COOLANT SYSTEM

LIMITING CONDITION FOR OPERATION

3.4.9.1 The Reactor Coolant System (except the pressurizer) temperature and pressure shall be limited in accordance with the limit lines shown on Figures 3.4-2 and 3.4-3 during heatup, cooldown, criticality, and inservice leak and hydrostatic testing with:

- a. A maximum heatup of 100°F in any 1-hour period,
- b. A maximum cooldown of 100°F in any 1-hour period, and
- c. A maximum temperature change of less than or equal to 5°F in any 1-hour period during inservice hydrostatic and leak testing operations above the heatup and cooldown limit curves.

APPLICABILITY: At all times.

ACTION:

With any of the above limits exceeded, restore the temperature and/or pressure to within the limit within 30 minutes; perform an engineering evaluation to determine the effects of the out-of-limit condition on the structural integrity of the Reactor Coolant System; determine that the Reactor Coolant System remains acceptable for continued operation or be in at least HOT STANDBY within the next 6 hours and reduce the RCS T_{avg} and pressure to less than 200°F and 500 psig, respectively, within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.9.1.1 The Reactor Coolant System temperature and pressure shall be determined to be within the limits in accordance with the Surveillance Frequency Control Program during system heatup, cooldown, and inservice leak and hydrostatic testing operations.

4.4.9.1.2 The reactor vessel material irradiation surveillance specimens shall be removed and examined, to determine changes in material properties, as required by 10 CFR Part 50, Appendix H. The results of these examinations shall be used to update Figures 3.4-2 and 3.4-3.

MATERIAL PROPERTY BASIS

LIMITING MATERIALS: Intermediate/Lower Shell Circumferential Weld Seams Ht. # 71249 and Upper Shell Forging

LIMITING ART VALUES AT 48 EFY: 1/4 T, 231°F (Circ Flaw ART), 141°F (Axial Flaw ART)
3/4 T, 192°F (Circ Flaw ART), 124°F (Axial Flaw ART)

FPL/FLA 48 EFY HEATUP CURVES

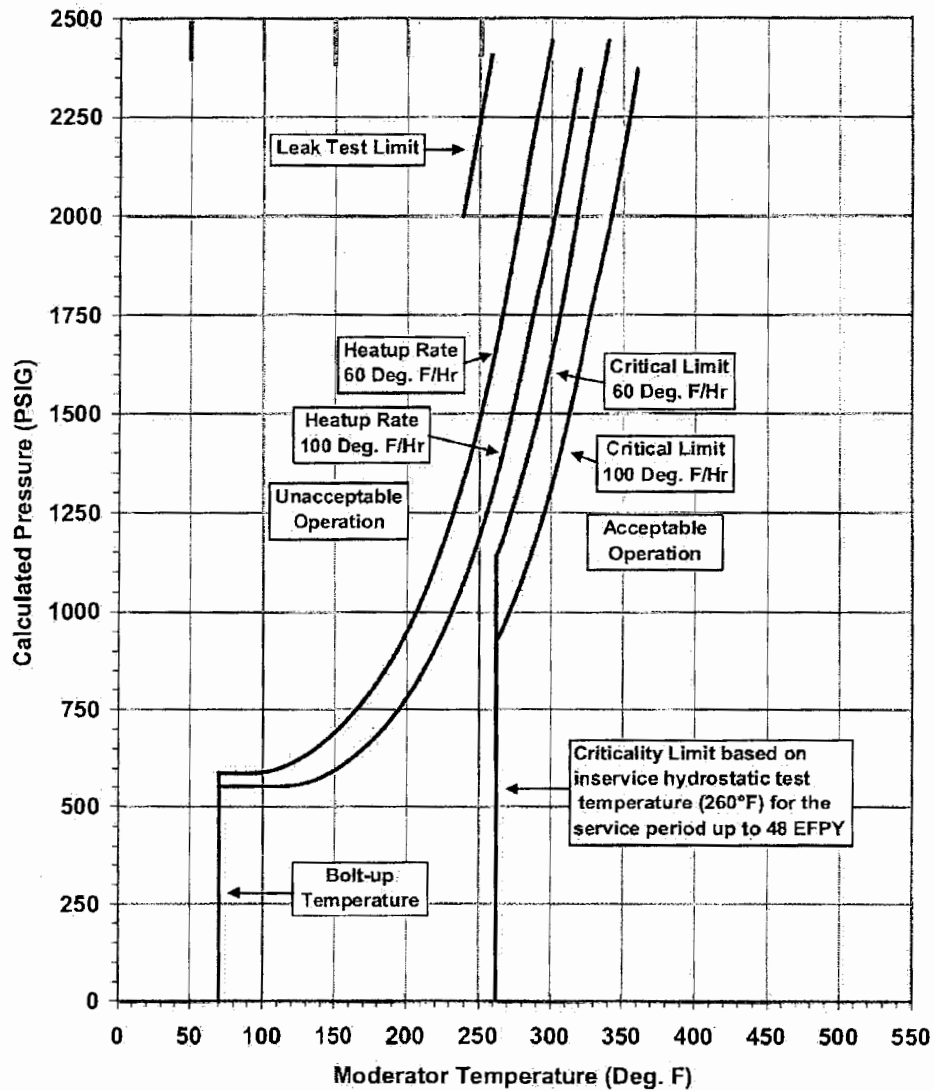


FIGURE 3.4-2 Turkey Point Units 3 & 4 Reactor Coolant System Heatup Limitations (Heatup Rates of 60 and 100°F/hr) Applicable for 48 EFY (Without Margins for Instrumentation Errors)

MATERIAL PROPERTY BASIS

LIMITING MATERIALS: Intermediate/Lower Shell Circumferential Weld Seams Ht. # 71249 and Upper Shell Forging

LIMITING ART VALUES AT 48 EFY: 1/4 T, 231°F (Circ Flaw ART), 141°F (Axial Flaw ART)
3/4 T, 192°F (Circ Flaw ART), 124°F (Axial Flaw ART)

FPL 48 EFY COOLDOWN CURVES

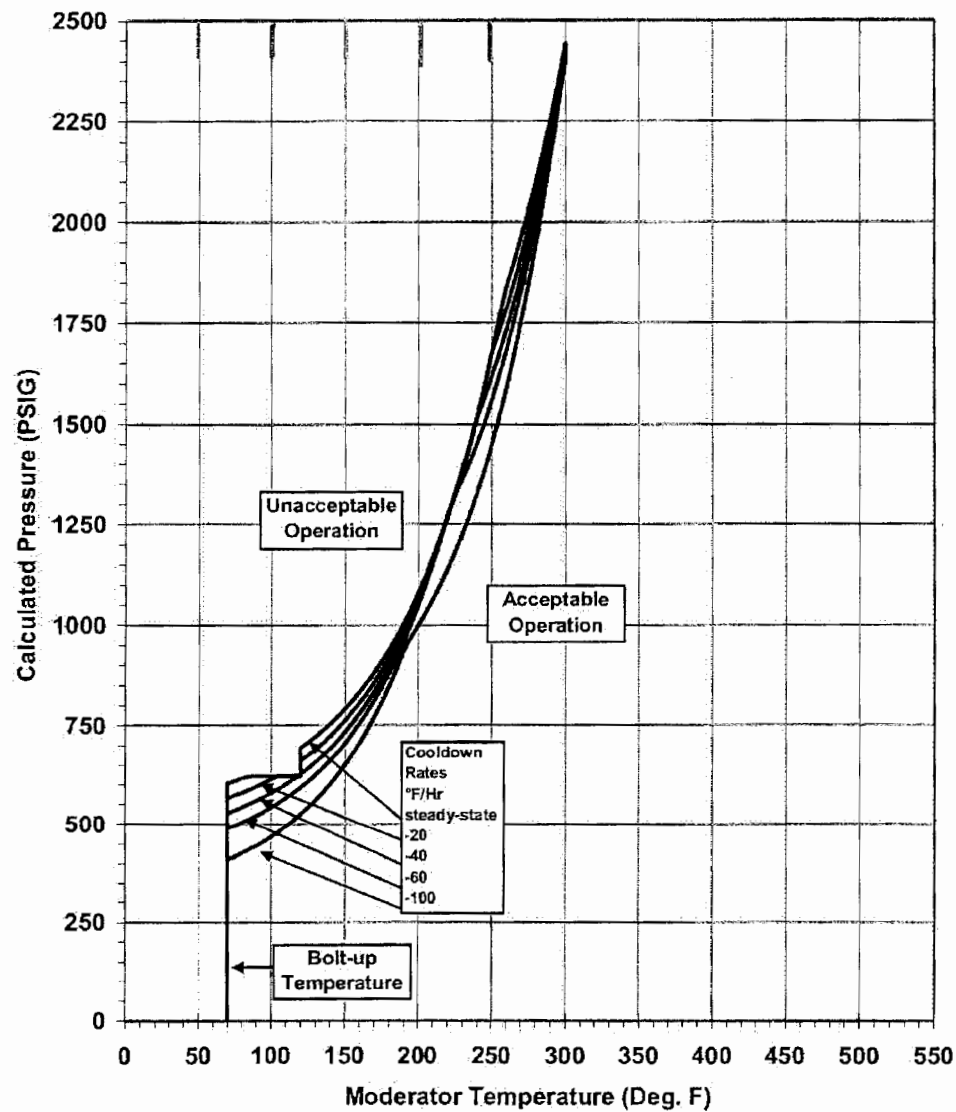


FIGURE 3.4-3 Turkey Point Units 3 & 4 Reactor Coolant System Cooldown Limitations (Cooldown Rates of 0, 20, 40, 60 and 100°F/hr) Applicable for 48 EFY (Without Margins for Instrumentation Errors)

REACTOR COOLANT SYSTEM

PRESSURIZER

LIMITING CONDITION FOR OPERATION

3.4.9.2 The pressurizer temperature shall be limited to:

- a. A maximum heatup of 100°F in any 1-hour period,
- b. A maximum cooldown of 200°F in any 1-hour period, and
- c. A maximum spray water temperature differential of 320°F.

APPLICABILITY: At all times.

ACTION:

With the pressurizer temperature limits in excess of any of the above limits, restore the temperature to within the limits within 30 minutes; perform an engineering evaluation to determine the effects of the out-of-limit condition on the structural integrity of the pressurizer; determine that the pressurizer remains acceptable for continued operation or be in at least HOT STANDBY within the next 6 hours and reduce the pressurizer pressure to less than 500 psig within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.9.2 The pressurizer temperatures shall be determined to be within the limits in accordance with the Surveillance Frequency Control Program during system heatup or cooldown. The spray water temperature differential shall be determined to be within the limit in accordance with the Surveillance Frequency Control Program during auxiliary spray operation.

REACTOR COOLANT SYSTEM

OVERPRESSURE MITIGATING SYSTEMS

LIMITING CONDITION FOR OPERATION

3.4.9.3 The high pressure safety injection flow paths to the Reactor Coolant System (RCS) shall be isolated, and at least one of the following Overpressure Mitigating Systems shall be OPERABLE:

- a. Two power-operated relief valves (PORVs) with a lift setting of ≤ 448 psig, or
- b. The RCS depressurized with a RCS vent of greater than or equal to 2.20 square inches.

APPLICABILITY MODES 4 (when the temperature of any RCS cold leg is less than or equal to 275°F), 5, and 6 with the reactor vessel head on.

ACTION:

NOTE: LCO 3.0.4.b is not applicable when entering MODE 4.

- a. With the high pressure safety injection flow paths to the RCS unisolated, restore isolation of these flow paths within 4 hours.
- b. With one PORV inoperable in MODE 4 (when the temperature of any RCS cold leg is less than or equal to 275°F), restore the inoperable PORV to OPERABLE status within 7 days or depressurize and vent the RCS through at least a 2.20 square inch vent within the next 8 hours.
- c. With one PORV inoperable in Modes 5 or 6 with the reactor vessel head on, either (1) restore the inoperable PORV to OPERABLE status within 24 hours, or (2) complete depressurization and venting of the RCS through at least a 2.20 square inch vent within a total of 32 hours, or (3) complete depressurization and venting of the RCS through at least one open PORV and associated block valve within a total of 32 hours.
- d. With both PORVs inoperable, either restore one PORV to OPERABLE status or complete depressurization and venting of the RCS through at least a 2.20 square inch vent within 24 hours.

REACTOR COOLANT SYSTEM

OVERPRESSURE MITIGATING SYSTEMS

SURVEILLANCE REQUIREMENTS

4.4.9.3.1 Each PORV shall be demonstrated OPERABLE by:

- a. Performance of an ANALOG CHANNEL OPERATIONAL TEST* on the PORV actuation channel, but excluding valve operation, within 31 days prior to entering a condition in which the PORV is required OPERABLE and in accordance with the Surveillance Frequency Control Program thereafter when the PORV is required OPERABLE.
- b. Performance of a CHANNEL CALIBRATION on the PORV actuation channel in accordance with the Surveillance Frequency Control Program; and
- c. Verifying the PORV block valve is open in accordance with the Surveillance Frequency Control Program when the PORV is being used for overpressure protection.
- d. While the PORVs are required to be OPERABLE, the backup nitrogen supply shall be verified OPERABLE in accordance with the Surveillance Frequency Control Program.*

4.4.9.3.2 The 2.20 square inch vent shall be verified to be open in accordance with the Surveillance Frequency Control Program** when the vent(s) is being used for overpressure protection.

4.4.9.3.3 Verify the high pressure injection flow path to the RCS is isolated in accordance with the Surveillance Frequency Control Program by closed valves with power removed or by locked closed manual valves.

* Not required to be met until 12 hours after decreasing RCS cold leg temperature to $\leq 275^{\circ}\text{F}$.

** Except when the vent pathway is provided with a valve which is locked, sealed, or otherwise secured in the open position, then verify these valves open in accordance with the Surveillance Frequency Control Program.

3/4.4.10 DELETED

REACTOR COOLANT SYSTEM

3/4.4.11 REACTOR COOLANT SYSTEM VENTS

LIMITING CONDITION FOR OPERATION

3.4.11 At least one Reactor Coolant System vent path consisting of at least two vent valves in series and powered from emergency busses shall be OPERABLE and closed at each of the following locations:

- a. Reactor vessel head, and
- b. Pressurizer steam space

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With one of the above Reactor Coolant System vent paths inoperable, STARTUP and/or POWER OPERATION may continue provided the inoperable vent path is maintained closed with power removed from the valve actuator of all the vent valves in the inoperable vent path; restore the inoperable vent path to OPERABLE status within 30 days, or, be in HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With both Reactor Coolant System vent paths inoperable; maintain the inoperable vent path closed with power removed from the valve actuators of all the vent valves in the inoperable vent paths, and restore at least one of the vent paths to OPERABLE status within 72 hours or be in HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.4.11 Each Reactor Coolant System vent path shall be demonstrated OPERABLE by:

- a. Verifying all manual isolation valves in each vent path are locked in the open position in accordance with the Surveillance Frequency Control Program,
- b. Cycling each vent valve through at least one complete cycle of full travel from the control room in accordance with the INSERVICE TESTING PROGRAM, and
- c. Verifying flow through the Reactor Coolant System vent paths during venting in accordance with the Surveillance Frequency Control Program.

3/4.5 EMERGENCY CORE COOLING SYSTEMS

3/4.5.1 ACCUMULATORS

LIMITING CONDITION FOR OPERATION

3.5.1 Each Reactor Coolant System (RCS) accumulator shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3*.

ACTION:

- a. With one accumulator inoperable, except as a result of boron concentration not being within limits, restore the inoperable accumulator to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and reduce pressurizer pressure to less than 1000 psig within the following 6 hours.
- b. With one accumulator inoperable due to the boron concentration not being within the limits, restore boron concentration back to the required limits within 72 hours, or be in at least HOT STANDBY within 6 hours and reduce pressurizer pressure to less than 1000 psig within the following 6 hours.

SURVEILLANCE REQUIREMENTS

4.5.1.1 Each accumulator shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying the borated water volume in each accumulator is between 6520 and 6820 gallons, and
 - 2) Verifying that the nitrogen cover pressure in each accumulator is between 600 and 675 psig, and
 - 3) Verifying that each accumulator isolation valve is open by control room indication (power may be restored to the valve operator to perform this surveillance if redundant indicator is inoperable).

*Pressurizer pressure above 1000 psig.

EMERGENCY CORE COOLING SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- b. In accordance with the Surveillance Frequency Control Program and within 6 hours after each solution volume increase of greater than or equal to 1% of tank volume by verifying the boron concentration of the solution in the water-filled accumulator is between 2300 and 2600 ppm;
- c. In accordance with the Surveillance Frequency Control Program, when the RCS pressure is above 1000 psig, by verifying that the power to the isolation valve operator is disconnected by a locked open breaker.
- d. Deleted

EMERGENCY CORE COOLING SYSTEMS

3/4.5.2 ECCS SUBSYSTEMS - T_{avg} GREATER THAN OR EQUAL TO 350°F

LIMITING CONDITION FOR OPERATION

3.5.2 The following Emergency Core Cooling System (ECCS) equipment and flow paths shall be OPERABLE:

- a. Four Safety Injection (SI) pumps, each capable of being powered from its associated OPERABLE diesel generator[#], with discharge flow paths aligned to the RCS cold legs,^{*}
- b. Two RHR heat exchangers,
- c. Two RHR pumps with discharge flow paths aligned to the RCS cold legs,
- d. A flow path capable of taking suction from the refueling water storage tank as defined in Specification 3.5.4, and
- e. Two flow paths capable of taking suction from the containment sump.

APPLICABILITY: MODES 1, 2, and 3^{**}

ACTION:

- a. With one of the following components inoperable:

1. RHR heat exchanger,
2. RHR suction flow path from the containment sump,
3. RHR parallel injection flow path, or
4. SI parallel injection flow path

Restore the inoperable component to OPERABLE status within 72 hours, or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

- b. Deleted
- c. With one of the four required Safety Injection pumps or its associated discharge flow path inoperable and the opposite unit in MODE 1, 2, or 3, restore the pump or flow path to OPERABLE status within 30 days or be in at least HOT STANDBY within the next 12 hours and in HOT SHUTDOWN within the following 6 hours.^{***}

^{*}Only three Safety Injection (SI) pumps (two associated with the unit and one from the opposite unit), each capable of being powered from its associated OPERABLE diesel generator[#], with discharge flow paths aligned to the RCS cold leg are required if the opposite unit is in MODE 4, 5, or 6.

^{**}The provisions of Specification 4.0.4 are not applicable for entry into MODE 3 for the Safety Injection flow paths isolated pursuant to Specification 3.4.9.3 provided that the Safety Injection flow paths are restored to OPERABLE status prior to T_{avg} exceeding 380°F. Safety Injection flow paths may be isolated when T_{avg} is less than 380°F.

^{***}The provisions of Specification 4.0.4 are not applicable.

[#]Inoperability of the required diesel generators does not constitute inoperability of the associated Safety Injection pumps.

EMERGENCY CORE COOLING SYSTEMS

3/4.5.2 ECCS SUBSYSTEMS - T_{avg} GREATER THAN OR EQUAL TO 350°F

LIMITING CONDITION FOR OPERATION

- d. With two of the four required Safety Injection pumps or their associated discharge flow paths inoperable and the opposite unit in MODE 1, 2, or 3, restore one of the two inoperable pumps or flow paths to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 12 hours and in HOT SHUTDOWN within the following 6 hours. This ACTION applies to both units simultaneously.
- e. With one of the three required Safety Injection pumps or its associated discharge flow path inoperable and the opposite unit in MODE 4, 5, or 6, restore the pump or flow path to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- f. With a required Safety Injection pump OPERABLE, but not capable of being powered from its associated diesel generator, restore the capability within 14 days or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- g. With an ECCS subsystem inoperable due to an RHR pump or its associated discharge flow path being inoperable, restore the inoperable RHR pump or its associated discharge flow path to OPERABLE status within 7 days or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- h. With the suction flow path from the refueling water storage tank inoperable, restore the suction flow path to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

EMERGENCY CORE COOLING SYSTEMS

SURVEILLANCE REQUIREMENTS

4.5.2 Each ECCS component and flow path shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying by control room indication that the following valves are in the indicated positions with power to the valve operators removed:

<u>Valve Number</u>	<u>Valve Function</u>	<u>Valve Position</u>
864A and B	Supply from RWST to ECCS	Open
862A and B	RWST Supply to RHR pumps	Open
863A and B	RHR Recirculation	Closed
866A and B	H.H.S.I. to Hot Legs	Closed
HCV-758*	RHR HX Outlet	Open

To permit positive valve position indication for surveillance or maintenance purposes in the event that continuous valve position indication is unavailable in the control room, power may be restored to these valves for a period not to exceed 1 hour.

- b. In accordance with the Surveillance Frequency Control Program by:
- 1) Verifying ECCS locations susceptible to gas accumulation are sufficiently filled with water, and
 - 2) Verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.**
- c. By verifying that each SI and RHR pump's developed head at the test flow point is greater than or equal to the required developed head when tested in accordance with the INSERVICE TESTING PROGRAM.

*Air Supply to HCV-758 shall be verified shut off and sealed closed in accordance with the Surveillance Frequency Control Program.

**Not required to be met for system vent flow paths opened under administrative control.

Figure 3.5-1
DELETED

EMERGENCY CORE COOLING SYSTEMS

SURVEILLANCE REQUIREMENTS

- d. By a visual inspection which verifies that no loose debris (rags, trash, clothing, etc.) is present in the containment which could be transported to the containment sump and cause restriction of the pump suctions during LOCA conditions. The visual inspection shall be performed:
 - 1) For all accessible areas of the containment prior to establishing CONTAINMENT INTEGRITY, and
 - 2) At least once daily of the areas affected within containment by containment entry and during the final entry when CONTAINMENT INTEGRITY is established.
- e. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying automatic isolation and interlock action of the RHR system from the Reactor Coolant System by ensuring that with a simulated or actual Reactor Coolant System pressure signal greater than or equal to 525 psig the interlocks cause the valves to automatically close and prevent the valves from being opened, and
 - 2) Verifying correct interlock action to ensure that the RWST is isolated from the RHR System during RHR System operation and to ensure that the RHR System cannot be pressurized from the Reactor Coolant System unless the above RWST Isolation Valves are closed.
 - 3) A visual inspection of the containment sump and verifying that the suction inlets are not restricted by debris and that the sump components (trash racks, screens, etc.) show no evidence of structural distress or abnormal corrosion.
- f. In accordance with the Surveillance Frequency Control Program, during shutdown, by:
 - 1) Verifying that each automatic valve in the flow path actuates to its correct position on Safety Injection actuation test signal, and
 - 2) Verifying that each of the following pumps start automatically upon receipt of a Safety Injection actuation test signal:
 - a) Safety Injection pump, and
 - b) RHR pump.

EMERGENCY CORE COOLING SYSTEMS

SURVEILLANCE REQUIREMENTS

- g. By verifying the correct position of each electrical and/or mechanical position stop for the following ECCS throttle valves:
- 1) Within 4 hours following completion of each valve stroking operation or maintenance on the valve when the ECCS components are required to be OPERABLE, and
 - 2) In accordance with the Surveillance Frequency Control Program.

RHR System
Valve Number

HCV-*-758

MOV-*-872

EMERGENCY CORE COOLING SYSTEMS

3/4.5.3 ECCS SUBSYSTEMS - T_{avg} LESS THAN 350°F

LIMITING CONDITION FOR OPERATION

3.5.3 As a minimum, the following ECCS components and flow path shall be OPERABLE:

- a. One OPERABLE RHR heat exchanger,
- b. One OPERABLE RHR pump, and
- c. An OPERABLE flow path capable of (1) taking suction from the refueling water storage tank upon being manually realigned and (2) transferring suction to the containment sump during the recirculation phase of operation.

APPLICABILITY: MODE 4.

ACTION:

- a. With no OPERABLE ECCS flow path from the refueling water storage tank, restore at least one ECCS flow path to OPERABLE status within 1 hour or be in COLD SHUTDOWN within the next 24 hours.
- b. With either the residual heat removal heat exchanger or RHR pump inoperable, restore the components to OPERABLE status or maintain the Reactor Coolant System T_{avg} less than 350°F by use of alternate heat removal methods.

SURVEILLANCE REQUIREMENTS

4.5.3 The above ECCS components shall be demonstrated OPERABLE per the applicable requirements of Specification 4.5.2.

EMERGENCY CORE COOLING SYSTEMS

3/4.5.4 REFUELING WATER STORAGE TANK

LIMITING CONDITION FOR OPERATION

3.5.4 For single Unit operation, one refueling water storage tank (RWST) shall be OPERABLE or for dual Unit operation two RWSTs shall be OPERABLE with:

- a. A minimum indicated borated water volume of 320,000 gallons per RWST,
- b. A boron concentration between 2400 ppm and 2600 ppm,
- c. A minimum solution temperature of 39°F, and
- d. A maximum solution temperature of 100°F.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With less than the required number of RWST(s) OPERABLE, restore the tank(s) to OPERABLE status within 1 hour or be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.5.4 The required RWST(s) shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying the indicated borated water volume in the tank, and
 - 2) Verifying the boron concentration of the water.
- b. By verifying the RWST temperature is within limits whenever the outside air temperature is less than 39°F or greater than 100°F at the following frequencies:
 - 1) Within one hour upon the outside temperature exceeding its limit for consecutive 23 hours, and
 - 2) At least once per 24 hours while the outside temperature exceeds its limit.

3/4.6 CONTAINMENT SYSTEMS

3/4.6.1 PRIMARY CONTAINMENT

CONTAINMENT INTEGRITY

LIMITING CONDITION FOR OPERATION

3.6.1.1 Primary CONTAINMENT INTEGRITY shall be maintained.*

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

Without primary CONTAINMENT INTEGRITY, restore CONTAINMENT INTEGRITY within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.1 CONTAINMENT INTEGRITY shall be demonstrated:

- a. In accordance with the Surveillance Frequency Control Program by verifying that all penetrations** not capable of being closed by OPERABLE containment automatic isolation valves and required to be closed during accident conditions are closed by valves, blind flanges, or deactivated automatic valves secured in their closed positions;
- b. By verifying that each containment air lock is in compliance with the requirements of Specification 3.6.1.3.

* Exception may be taken under Administrative Controls for opening of valves and airlocks necessary to perform surveillance, testing requirements and/or corrective maintenance. In addition, Specification 3.6.4 shall be complied with.

** Except valves, blind flanges, and deactivated automatic valves which are located inside the containment and are locked, sealed or otherwise secured in the closed position. These penetrations shall be verified closed during each COLD SHUTDOWN except that such verification need not be performed more often than once per 92 days.

CONTAINMENT SYSTEMS

CONTAINMENT LEAKAGE

LIMITING CONDITION FOR OPERATION

3.6.1.2 Containment leakage rates shall be limited in accordance with the Containment Leakage Rate Testing Program.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the measured overall integrated containment leakage rate exceeding 1.0 L_g within one hour, initiate action to be in HOT STANDBY within the next 6 hours, and COLD SHUTDOWN within the following 30 hours. Restore the overall integrated leakage rate to less than 0.75 L_g and the combined leakage rate for all penetrations subject to Type B and C tests to less than 0.60 L_g prior to increasing the Reactor Coolant System temperature above 200°F.

SURVEILLANCE REQUIREMENTS

4.6.1.2 The containment leakage rates shall be demonstrated at the required test schedule and shall be determined in conformance with the criteria specified in the Containment Leakage Rate Testing Program.

CONTAINMENT SYSTEMS

CONTAINMENT AIR LOCKS

LIMITING CONDITION FOR OPERATION

3.6.1.3 Each containment air lock shall be OPERABLE with:

- a. Both doors closed except when the air lock is being used for normal transit entry and exit through the containment, or during the performance of containment air lock surveillance and/or testing requirements, then at least one air lock door shall be closed, and
- b. An overall air lock leakage rate in accordance with the Containment Leakage Rate Testing Program.

APPLICABILITY: MODES 1, 2, 3, and 4.

NOTE: Enter the ACTION of LCO 3.6.1.2, "Containment Leakage," when air lock leakage results in exceeding the overall containment leakage rate acceptance criteria.

ACTION:

- a. With one containment air lock door inoperable:
 1. Maintain at least the OPERABLE air lock door closed and either restore the inoperable air lock door to OPERABLE status within 24 hours or lock the OPERABLE air lock door closed;
 2. Operation may then continue until performance of the next required overall air lock leakage test provided that the OPERABLE air lock door is verified to be locked closed at least once per 31 days;
 3. Otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With the containment air lock inoperable, except as the result of an inoperable air lock door, maintain at least one air lock door closed; restore the inoperable air lock to OPERABLE status within 24 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS

4.6.1.3 Each containment air lock shall be demonstrated OPERABLE:

- a. Following each closing, at the frequency specified in the Containment Leakage Rate Testing Program, by verifying that the seals have not been damaged and have seated properly by vacuum testing the volume between the door seals in accordance with approved plant procedures.
- b. By conducting overall air lock leakage tests in accordance with the Containment Leakage Rate Testing Program.
- c. In accordance with the Surveillance Frequency Control Program by verifying that only one door in each air lock can be opened at a time.

CONTAINMENT SYSTEMS

INTERNAL PRESSURE

LIMITING CONDITION FOR OPERATION

3.6.1.4 Primary containment internal pressure shall be maintained between -2 and +1 psig.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the containment internal pressure outside of the limits above, restore the internal pressure to within the limits within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.4 The primary containment internal pressure shall be determined to be within the limits in accordance with the Surveillance Frequency Control Program.

CONTAINMENT SYSTEMS

AIR TEMPERATURE

LIMITING CONDITION FOR OPERATION

3.6.1.5 Primary containment average air temperature shall not exceed 125°F and shall not exceed 120°F by more than 336 equivalent hours* during a calendar year.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the containment average air temperature greater than 125°F or greater than 120°F for more than 336 equivalent hours* during a calendar year, reduce the average air temperature to within the applicable limit within 8 hours, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.5 The primary containment average air temperature shall be the arithmetical average of the temperatures at the following locations and shall be determined in accordance with the Surveillance Frequency Control Program:

Approximate Location

- a. 0° Azimuth 58 feet elevation
- b. 120° Azimuth 58 feet elevation
- c. 240° Azimuth 58 feet elevation

* Equivalent hours are determined from actual hours using the time-temperature relationships that support the environmental qualification requirements of 10 CFR 50.49.

CONTAINMENT SYSTEMS

CONTAINMENT STRUCTURAL INTEGRITY

LIMITING CONDITION FOR OPERATION

3.6.1.6 The structural integrity of the containment shall be maintained at a level consistent with the acceptance criteria in Specification 4.6.1.6.

APPLICABILITY MODES 1, 2, 3, and 4.

ACTION:

- a. With more than one tendon with an observed lift-off force between 90% and 95% of the predicted force, or with one tendon below 90% of the predicted force, restore the tendon(s) to the required level of integrity within 15 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With the average of all measured tendon forces for each type of tendon (dome, vertical, and hoop), including those measured in ACTION a., less than the predicted force, restore the tendon(s) to the required level of integrity within 15 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With any abnormal degradation of the structural integrity other than ACTION a. and ACTION b., at a level below the acceptance criteria of Specifications 4.6.1.6.1, 4.6.1.6.2 and 4.6.1.6.3, restore the containment to the required level of integrity within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

- 4.6.1.6.1 Containment Tendons. The containment tendons and the containment exterior surfaces shall be examined in accordance with ASME Boiler and Pressure Vessel Code, Section XI, Subsection IWL, "Requirements for Class CC Concrete Components of Light-Water Cooled Plants," and the modifications presented in 10 CFR 50.55a(b)(2)(viii), "Examination of concrete containments," as modified by approved exemptions. The containment structural integrity shall be demonstrated during the inspection periods specified in IWL-2410 and IWL-2420. The tendons' structural integrity shall be demonstrated by:

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- a. Determining that tendons, selected in accordance with IWL-2521, have the average of all measured tendon forces for each type of tendon (dome, vertical and hoop) equal to or greater than the minimum required prestress specified at the anchorage for that type of tendon.
- b. Assuring that the measured force in each individual tendon is not less than 95% of the predicted force unless the following conditions are satisfied:
 - 1) The measured force in no tendon is below 90% of the predicted force and the measured force in no more than one tendon is between 90% and 95% of the predicted force;
 - 2) The measured force in two tendons located adjacent to the tendon in 1) are not less than 95% of the predicted forces; and
 - 3) The measured forces in all the remaining sample tendons are not less than 95% of the predicted force.

The predicted force for each tendon shall be calculated individually for each inspection prior to the beginning of each inspection, and should consider such factors as:

- Prestressing history;
- Friction losses; and
- Time-dependent losses (creep, shrinkage, relaxation), considering time elapsed from prestressing.

When evaluation of consecutive surveillances of prestressing forces for the same tendon or tendons in a group indicates a trend of prestress loss such that the tendon force(s) would be less than the minimum design prestress requirements before the next inspection interval, an evaluation shall be performed and reported in the Engineering Evaluation Report as prescribed in IWL-3300.

- c. Performing tendon detensioning, examinations, and testing on a sample tendon of each type (dome, vertical, and hoop). A single wire or strand shall be removed from each detensioned tendon. Each removed wire or strand shall be examined over its entire length for corrosion and mechanical damage. Tension tests shall be performed on each removed wire or strand: one at each end, one at mid-length, and one in the location of the most corroded area, if any. The following information shall be obtained from each test:
 - 1) Yield strength;
 - 2) Ultimate tensile strength;
 - 3) Elongation.

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

The condition of wire or strand is acceptable if:

- 1) Samples are free of physical damage;
 - 2) Sample ultimate tensile strength and elongation are not less than minimum specified values.
- d. Performing tendon retensioning of those tendons that have been detensioned to at least the force predicted for the tendon at the time of the test. However, the retensioning force shall not exceed 70% of the specified minimum ultimate tensile strength of the tendon based on the number of effective wires or strands in the tendon at the time of retensioning. During retensioning of these tendons, if the elongation corresponding to a specific load (adjusted for effective wires or strands) differs by more than 10% from that recorded during the last measurement, an evaluation must be performed to determine whether the difference is related to wire failures or slip of wires in anchorage. A difference of more than 10% must be identified in the ISI Summary Report required by IWA-6000.
- e. Performing examination of corrosion protection medium and free water in accordance with IWL-2525, with acceptance standards prescribed in IWL-3221.4. The following conditions, if they occur, shall be reported in the ISI Summary Report required by IWA-6000:
- 1) The sheathing filler grease contains chemically combined water exceeding 10% by weight or the presence of free water;
 - 2) The absolute difference between the amount removed and the amount replaced exceeds 10% of the tendon net duct volume.
 - 3) Grease leakage is detected during general visual examination of the containment surface.
- 4.6.1.6.2 End Anchorages and Containment Concrete Surfaces. The structural integrity of the end anchorages of all tendons inspected pursuant to Specification 4.6.1.6.1 and the containment concrete surfaces shall be demonstrated by performing examination of tendon anchorage areas and containment concrete surfaces in accordance with IWL-2000, with acceptance standards prescribed in IWL-3000. Acceptability of inaccessible areas shall be evaluated when conditions exist in accessible areas that could indicate the presence of or result in degradation to such inaccessible areas. For each inaccessible area identified, the following shall be provided in the ISI Summary Report required by IWA-6000:
- 1) A description of the type and estimated extent of degradation, and the conditions that led to the degradation;
 - 2) An evaluation of each area, and the result of the evaluation; and
 - 3) A description of necessary corrective actions.

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

4.6.1.6.3. Containment Surfaces Inspection for Containment Leakage Rate Testing Program. In accordance with the Containment Leakage Rate Testing Program, a visual inspection of the accessible interior and exterior surfaces of the containment, including the liner plate, shall be performed. The purpose of this inspection shall be to identify any evidence of structural deterioration which may affect containment structural integrity or leaktightness. The visual inspection shall be general in nature; its intent shall be to detect gross areas of widespread cracking, spalling, gouging, rust, weld degradation, or grease leakage. The visual examination may include the utilization of binoculars or other optical devices. Corrective actions taken, and recording of structural deterioration and corrective actions, shall be in accordance with the Containment Leakage Rate Testing Program. Records of previous inspections shall be reviewed to verify no apparent changes in appearance. The first inspection performed will form the baseline for future surveillances.

CONTAINMENT SYSTEMS

CONTAINMENT VENTILATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.6.1.7 Each containment purge supply and exhaust isolation valve shall be OPERABLE and:

- a. The containment purge supply and exhaust isolation valves shall be sealed closed to the maximum extent practicable but may be open for purge system operation for pressure control, for environmental conditions control, for ALARA and respirable air quality considerations for personnel entry and for surveillance tests that require the valve to be open.
- b. The purge supply and exhaust isolation valves shall not be opened wider than 33 or 30 degrees, respectively (90 degrees is fully open).

APPLICABILITY: MODES 1, 2, 3, AND 4.

ACTION:

- a. With a containment purge supply and/or exhaust isolation valve(s) open for reasons other than given in 3.6.1.7.a above, close the open valve(s) or isolate the penetration(s) within 4 hours, otherwise be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With a containment purge supply and/or exhaust isolation valve(s) having a measured leakage rate exceeding the limits of Specification 4.6.1.7.2, restore the inoperable valve(s) to OPERABLE status or isolate the penetrations such that the measured leakage rate does not exceed the limits of Specification 4.6.1.7.2 within 24 hours, otherwise be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.1.7.1 Each containment purge supply and exhaust isolation valve shall be verified to be sealed closed or open in accordance with Specification 3.6.1.7.a in accordance with the Surveillance Frequency Control Program.

4.6.1.7.2 In accordance with the Surveillance Frequency Control Program, each containment purge supply and exhaust isolation valve shall be demonstrated OPERABLE by verifying that the measured leakage rate is less than or equal to $0.05 L_a$ when pressurized to P_a .

4.6.1.7.3 In accordance with the Surveillance Frequency Control Program, the mechanical stop on each containment purge supply and exhaust isolation valve shall be verified to be in place and that the valves will open no more than 33 or 30 degrees, respectively.

CONTAINMENT SYSTEMS

3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS

CONTAINMENT SPRAY SYSTEM

LIMITING CONDITION FOR OPERATION

3.6.2.1 Two independent Containment Spray Systems shall be OPERABLE with each Spray System capable of taking suction from the RWST and manually transferring suction to the containment sump via the RHR System.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With one Containment Spray System inoperable restore the inoperable Spray System to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With two Containment Spray Systems inoperable restore at least one Spray System to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. Restore both Spray Systems to OPERABLE status within 72 hours of initial loss or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.2.1 Each Containment Spray System shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position* and that power is available to flow path components that require power for operation;
- b. By verifying that each Containment Spray pump's developed head at the test flow point is greater than or equal to the required developed head, when tested in accordance with the INSERVICE TESTING PROGRAM.
- c. In accordance with the Surveillance Frequency Control Program by verifying containment spray locations susceptible to gas accumulation are sufficiently filled with water.

* Not required to be met for system vent flow paths opened under administrative control.

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- d. In accordance with the Surveillance Frequency Control Program during shutdown by:
 - 1) Verifying that each automatic valve in the flow path actuates to its correct position on a containment spray actuation test signal, and
 - 2) Verifying that each spray pump starts automatically on a containment spray actuation test signal. The manual isolation valves in the spray lines at the containment shall be locked closed for the performance of these tests.
- e. In accordance with the Surveillance Frequency Control Program by performing an air or smoke flow test through each spray header and verifying each spray nozzle is unobstructed.

CONTAINMENT SYSTEMS

EMERGENCY CONTAINMENT COOLING SYSTEM

LIMITING CONDITION FOR OPERATION

3.6.2.2 Three emergency containment cooling units shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

- a. With one of the above required emergency containment cooling units inoperable restore the inoperable cooling unit to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With two or more of the above required emergency containment cooling units inoperable, restore at least two cooling units to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. Restore all of the above required cooling units to OPERABLE status within 72 hours of initial loss or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.2.2 Each emergency containment cooling unit shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by starting each cooler unit from the control room and verifying that each unit motor reaches the nominal operating current for the test conditions and operates for at least 15 minutes.
- b. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying that two emergency containment cooling units start automatically on a safety injection (SI) test signal, and
 - 2) Verifying a cooling water flow rate of greater than or equal to 2000 gpm to each cooler.

CONTAINMENT SYSTEMS

3/4.6.2.3 RECIRCULATION pH CONTROL SYSTEM

LIMITING CONDITION FOR OPERATION

3.6.2.3 The Recirculation pH Control System shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the Recirculation pH Control System inoperable, restore the buffering agent to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the next 72 hours.

SURVEILLANCE REQUIREMENTS

4.6.2.3 The Recirculation pH Control System shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1. Verifying that the buffering agent baskets are in place and intact;
 - 2. Collectively contain \geq 7500 pounds (154 cubic feet) of sodium tetraborate decahydrate, or equivalent.

3/4.6.3 DELETED

CONTAINMENT SYSTEMS

3/4.6.4 CONTAINMENT ISOLATION VALVES

LIMITING CONDITION FOR OPERATION

3.6.4 Each containment isolation valve shall be OPERABLE with isolation times less than or equal to required isolation times.

APPLICABILITY: MODES 1, 2, 3, and 4.

NOTES:

1. Enter applicable ACTIONS for systems made inoperable by containment isolation valves.
2. Enter the ACTION of LCO 3.6.1.2, "Containment Leakage," when isolation valve leakage results in exceeding the overall containment leakage rate acceptance criteria.

ACTION:

With one or more isolation valves inoperable, maintain at least one isolation valve OPERABLE in each affected penetration that is open and either:

- a. Restore the inoperable valve(s) to OPERABLE status within 4 hours or in accordance with the Risk Informed Completion Time Program, or
- b. Isolate each affected penetration within 4 hours or in accordance with the Risk Informed Completion Time Program, by use of at least one deactivated automatic containment isolation valve secured in the isolation position, or
- c. Isolate each affected penetration within 4 hours or in accordance with the Risk Informed Completion Time Program, by use of at least one closed manual valve or blind flange, or
- d. Be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.6.4.1 The isolation valves shall be demonstrated OPERABLE prior to returning the valve to service after maintenance, repair or replacement work is performed on the valve or its associated actuator, control or power circuit by performance of a cycling test, and verification of isolation time.

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

4.6.4.2 Each isolation valve shall be demonstrated OPERABLE during the COLD SHUTDOWN or REFUELING MODE in accordance with the Surveillance Frequency Control Program by:

- a. Verifying that on a Phase "A" Isolation test signal, each Phase "A" isolation valve actuates to its isolation position;
- b. Verifying that on a Phase "B" Isolation test signal, each Phase "B" isolation valve actuates to its isolation position; and
- c. Verifying that on a Containment Ventilation Isolation test signal, each purge, exhaust and instrument air bleed valve actuates to its isolation position.

4.6.4.3 The isolation time of each power-operated or automatic valve shall be determined to be within its limit when tested in accordance with the INSERVICE TESTING PROGRAM.

3/4.6.5 DELETED

3/4.6.6 DELETED

3/4.7 PLANT SYSTEMS

3/4.7.1 TURBINE CYCLE

SAFETY VALVES

LIMITING CONDITION FOR OPERATION

3.7.1.1 All main steam line Code safety valves associated with each steam generator shall be OPERABLE with lift settings as specified in Table 3.7-2.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

With (3) reactor coolant loops and associated steam generators in operation and with one or more main steam line Code safety valves inoperable, and

- a. in MODES 1 and 2, with a positive Moderator Temperature Coefficient, operation may continue provided that, within 4 hours, either the inoperable valve(s) are restored to OPERABLE status or the Power Range Neutron Flux High Trip Setpoint is reduced to the maximum allowable percent of RATED THERMAL POWER listed in Table 3.7-1; otherwise, be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 12 hours, or
- b. in MODES 1 and 2, with a negative or zero Moderator Temperature Coefficient; or in Mode 3, with a positive, negative or zero Moderator Temperature Coefficient, operation may continue provided that, within 4 hours, either the inoperable valve(s) are restored to OPERABLE status or reactor power is reduced to less than or equal to the maximum allowable percent of RATED THERMAL POWER listed in Table 3.7-1; otherwise, be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 12 hours.

SURVEILLANCE REQUIREMENTS

4.7.1.1 No additional requirements other than those required by the INSERVICE TESTING PROGRAM. The provisions of Specification 4.0.4 are not applicable for entry into MODE 3.

TABLE 3.7-1
MAXIMUM ALLOWABLE POWER LEVEL WITH
INOPERABLE STEAM LINE SAFETY VALVES DURING THREE LOOP OPERATION

<u>MAXIMUM NUMBER OF INOPERABLE SAFETY VALVES ON ANY OPERATING STEAM GENERATOR</u>	<u>MAXIMUM ALLOWABLE POWER LEVEL (PERCENT OF RATED THERMAL POWER)</u>	
1	44	
2	27	
3	10	

TABLE 3.7-2
STEAM LINE SAFETY VALVES PER LOOP

<u>VALVE NUMBER</u>			<u>LIFT SETTING ($\pm 3\%$)* **</u>	<u>ORIFICE SIZE SQUARE INCHES</u>
<u>Loop A</u>	<u>Loop B</u>	<u>Loop C</u>		
1. RV1400	RV1405	RV1410	1085 psig	16
2. RV1401	RV1406	RV1411	1100 psig	16
3. RV1402	RV1407	RV1412	1105 psig	16
4. RV1403	RV1408	RV1413	1105 psig	16

*The lift setting pressure shall correspond to ambient conditions of the valve at nominal operating temperature and pressure.

**All valves tested must have "as left" lift setpoints that are within $\pm 1\%$ of the lift setting value listed in Table 3.7-2.

PLANT SYSTEMS

AUXILIARY FEEDWATER SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.1.2 Two independent auxiliary feedwater trains including 3 steam supply flowpaths, 3 pumps and associated discharge water flowpaths shall be OPERABLE.⁽¹⁾⁽²⁾

APPLICABILITY: MODES 1, 2 and 3

ACTION:

NOTE: LCO 3.0.4.b is not applicable to the required auxiliary feedwater trains when entering Mode 1.

- 1) With one of the two required independent auxiliary feedwater trains inoperable, either restore the inoperable train to an OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or place the affected unit(s) in at least HOT STANDBY within the next 6 hours* and in HOT SHUTDOWN within the following 6 hours.
- 2) With both required auxiliary feedwater trains inoperable, within 2 hours either restore both trains to an OPERABLE status, or restore one train to an OPERABLE status and follow ACTION statement 1 above for the other train. If neither train can be restored to an OPERABLE status within 2 hours, verify that both Standby Feedwater Pumps are capable of providing makeup flow to the steam generators and place the affected unit(s) in at least HOT STANDBY within the next 6 hours* and in HOT SHUTDOWN within the following 6 hours. Otherwise, initiate corrective action to restore at least one auxiliary feedwater train to an OPERABLE status as soon as possible and follow ACTION statement 1 above for the other train.
- 3) With a single auxiliary feedwater pump inoperable, within 4 hours, verify OPERABILITY of two independent auxiliary feedwater trains, or follow ACTION statements 1 or 2 above as applicable. Upon verification of the OPERABILITY of two independent auxiliary feedwater trains, restore the inoperable auxiliary feedwater pump to an OPERABLE status within 30 days, or place the operating unit(s) in at least HOT STANDBY within 6 hours* and in HOT SHUTDOWN within the following 6 hours.
- 4) With a single steam supply flowpath inoperable, within 4 hours verify OPERABILITY of two independent steam supply flowpaths or follow ACTION statement 1 or 2 above as applicable. Upon verification of the OPERABILITY of two independent steam supply flowpaths, restore the inoperable steam supply flowpath to OPERABLE status within 7 days of discovery, or place the affected Unit(s) in at least HOT STANDBY within 6 hours* and in HOT SHUTDOWN within the following 6 hours.

NOTES:

- ⁽¹⁾ One steam supply flowpath shall be OPERABLE in each AFW train and the third steam supply flowpath (via MOV-3-1404 for Unit 3 and MOV-4-1404 for Unit 4) shall be OPERABLE and aligned to either AFW train but not both simultaneously.
- ⁽²⁾ During single and two unit operation, one pump shall be OPERABLE in each train and the third auxiliary feedwater pump shall be OPERABLE and capable of being powered from, and supplying water to either train, except as noted in ACTION 3 of Technical Specification 3.7.1.2. The third auxiliary feedwater pump (normally the "C" pump) can be aligned to either train to restore OPERABILITY in the event one of the required pumps is inoperable.

*If this ACTION applies to both units simultaneously, be in at least HOT STANDBY within the next 12 hours and in HOT SHUTDOWN within the following 6 hours.

PLANT SYSTEMS

AUXILIARY FEEDWATER SYSTEM

SURVEILLANCE REQUIREMENTS

4.7.1.2.1 The required independent auxiliary feedwater trains shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying by control panel indication and visual observation of equipment that each steam turbine-driven pump operates for 15 minutes or greater and develops a flow of greater than or equal to 373 gpm to the entrance of the steam generators. The provisions of Specification 4.0.4 are not applicable for entry into MODES 2 and 3;
 - 2) Verifying by control panel indication and visual observation of equipment that the auxiliary feedwater discharge valves and the steam supply and turbine pressure valves operate as required to deliver the required flow during the pump performance test above;
 - 3) Verifying that each non-automatic valve in the flow path that is not locked, sealed, or otherwise secured in position is in its correct position; and
 - 4) Verifying that power is available to those components which require power for flow path operability.
- b. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying that each automatic valve in the flow path actuates to its correct position upon receipt of each Auxiliary Feedwater Actuation test signal, and
 - 2) Verifying that each auxiliary feedwater pump receives a start signal as designed automatically upon receipt of each Auxiliary Feedwater Actuation test signal.

4.7.1.2.2 An auxiliary feedwater flow path to each steam generator shall be demonstrated OPERABLE following each COLD SHUTDOWN of greater than 30 days prior to entering MODE 1 by verifying normal flow to each steam generator.

TABLE 3.7-3

AUXILIARY FEEDWATER SYSTEM OPERABILITY

DELETED

PLANT SYSTEMS

CONDENSATE STORAGE TANK

LIMITING CONDITION FOR OPERATION

3.7.1.3 The condensate storage tanks (CST) system shall be OPERABLE with:

Opposite Unit in MODES 4, 5 or 6

A minimum indicated water volume of 210,000 gallons in either or both condensate storage tanks.

Opposite Unit in MODES 1, 2 or 3

A minimum indicated water volume of 420,000 gallons.

APPLICABILITY: MODES 1, 2 and 3.

ACTION:

Opposite Unit in MODES 4, 5 or 6

With the CST system inoperable, within 4 hours restore the CST system to OPERABLE status or be in at least HOT STANDBY in the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

Opposite Unit in MODES 1, 2 or 3

- 1) With the CST system inoperable due to indicating less than 420,000 gallons, but greater than or equal to 210,000 gallons indicated, within 4 hours restore the inoperable CST system to OPERABLE status or place one unit in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- 2) With the CST system inoperable with less than 210,000 gallons indicated, within 1 hour restore the CST system to OPERABLE status or be in at least HOT STANDBY within the next 12 hours and in HOT SHUTDOWN within the following 6 hours. This ACTION applies to both units simultaneously.

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

4.7.1.3 The condensate storage tank (CST) system shall be demonstrated OPERABLE by verifying the indicated water volume is within its limit when the tank is the supply source for the auxiliary feedwater pumps in accordance with the Surveillance Frequency Control Program.

PLANT SYSTEMS

SPECIFIC ACTIVITY

LIMITING CONDITION FOR OPERATION

3.7.1.4 The specific activity of the Secondary Coolant System shall be less than or equal to 0.10 microCurie/gram DOSE EQUIVALENT I-131.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the specific activity of the Secondary Coolant System greater than 0.10 microCurie/gram DOSE EQUIVALENT I-131, be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.7.1.4 The specific activity of the Secondary Coolant System shall be determined to be within the limit by performing the sampling and analysis described in Table 4.7-1.

TABLE 4.7-1

SECONDARY COOLANT SYSTEM SPECIFIC ACTIVITYSAMPLE AND ANALYSIS

<u>TYPE OF MEASUREMENT AND ANALYSIS</u>	<u>SAMPLE AND ANALYSIS FREQUENCY</u>
1. Gross Radioactivity Determination	SFCP
2. Isotopic Analysis for DOSE EQUIVALENT I-131 Concentration	a) Once per 31 days, whenever the gross radioactivity determination indicates concentrations greater than 10% of the allowable limit for radioiodines. b) Once per 6 months, whenever the gross radioactivity determination indicates concentrations less than or equal to 10% of the allowable limit for radioiodines.

PLANT SYSTEMS

MAIN STEAM LINE ISOLATION VALVES

LIMITING CONDITION FOR OPERATION

3.7.1.5 Each main steam line isolation valve (MSIV) shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

MODE 1:

With one MSIV inoperable but open, POWER OPERATION may continue provided the inoperable valve is restored to OPERABLE status within 24 hours; otherwise be in MODE 2 within the next 6 hours.

MODES 2 and 3:

With one or more MSIV inoperable, subsequent operation in MODE 2 or 3 may continue provided:

1. The inoperable MSIVs are closed within 8 hours, and
2. The inoperable MSIVs are verified closed once per 7 days.

Otherwise, be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

SURVEILLANCE REQUIREMENTS

4.7.1.5 Each MSIV shall be demonstrated OPERABLE by verifying full closure within 5 seconds when tested in accordance with the INSERVICE TESTING PROGRAM. The provisions of Specification 4.0.4 are not applicable for entry into MODE 3.

PLANT SYSTEMS

3/4 3.7.1.6 DELETED

PLANT SYSTEMS

4.7.1.6.4 DELETED

1

PLANT SYSTEMS

3/4.7.1.7 FEEDWATER ISOLATION

LIMITING CONDITION FOR OPERATION

3.7.1.7 Six Feedwater Control Valves (FCVs) both main and bypass and six Feedwater Isolation Valves (FIVs) both main and bypass shall be OPERABLE.*

APPLICABILITY: MODES 1, 2 and 3**

ACTION:

- a. With one or more FCVs inoperable, restore operability, or close or isolate the inoperable FCVs within 72 hours, and verify that the inoperable valve(s) is closed or isolated at least once per 7 days or be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With one or more FIVs inoperable, restore operability, or close or isolate the inoperable FIV(s) within 72 hours, and verify that the inoperable valve(s) is closed or isolated at least once per 7 days or be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- c. With one or more bypass valves in different steam generator flow paths inoperable, restore operability, or close or isolate the inoperable bypass valve(s) within 72 hours, and verify that the inoperable valve(s) is closed or isolated at least once per 7 days or be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- d. With two valves in the same steam generator flow paths inoperable, restore operability, or isolate the affected flowpath within 8 hours or be in HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours..

SURVEILLANCE REQUIREMENTS

4.7.1.7 Each FCV, FIV and bypass valve shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying that each FCV, FIV and bypass valve actuates to the isolation position on an actual or simulated actuation signal.
- b. In accordance with the INSERVICE TESTING PROGRAM by:
 - 1) Verifying that each FCV, FIV and bypass valve isolation time is within limits.

*Separate Condition entry is allowed for each valve.

**The provisions of specification 4.0.4 are not applicable.

PLANT SYSTEMS

3/4.7.2 COMPONENT COOLING WATER SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.2 The Component Cooling Water System (CCW) shall be OPERABLE with:

- a. Three CCW pumps, and
- b. Two CCW heat exchangers.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

NOTE: Enter applicable ACTIONS of LCO 3.4.1.3, "Reactor Coolant System - Hot Shutdown," for residual heat removal loops made inoperable by CCW.

- a. With only two CCW pumps with independent power supplies OPERABLE, restore the inoperable CCW pump to OPERABLE status within 30 days or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With only one CCW pump OPERABLE or with two CCW pumps OPERABLE but not from independent power supplies, restore two pumps from independent power supplies to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With less than two CCW heat exchangers OPERABLE, restore two heat exchangers to OPERABLE status within 1 hour or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.7.2 The Component Cooling Water System (CCW) shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program, by verifying that two heat exchangers and one pump are capable of removing design basis heat loads.

SURVEILLANCE REQUIREMENTS (Continued)

- b.
 - 1) In accordance with the Surveillance Frequency Control Program verify that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position is in its correct position.
 - 2) In accordance with the Surveillance Frequency Control Program verify by a performance test the heat exchanger surveillance curves.*
- c. In accordance with the Surveillance Frequency Control Program during shutdown, by verifying that:
 - 1) Each automatic valve servicing safety-related equipment actuates to its correct position on a SI test signal, and
 - 2) Each Component Cooling Water System pump starts automatically on a SI test signal.
 - 3) Interlocks required for CCW operability are OPERABLE.

*Technical specification 4.7.2.b.2 is not applicable for entry into MODE 4 or MODE 3, provided that:

- 1) Surveillance 4.7.2.b.2 is performed no later than 72 hours after reaching a Reactor Coolant System Tavg of 547°F, and
- 2) MODE 2 shall not be entered prior to satisfactory performance of this surveillance.

PLANT SYSTEMS

3/4.7.3 INTAKE COOLING WATER SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.3 The Intake Cooling Water System (ICW) shall be OPERABLE with:

- a. Three ICW pumps, and
- b. Two ICW headers.

APPLICABILITY: MODES 1, 2, 3, and 4.

NOTE: Enter applicable ACTIONS of LCO 3.4.1.3, "Reactor Coolant System - Hot Shutdown," for residual heat removal loops made inoperable by ICW.

ACTION:

- a. With only two ICW pumps with independent power supplies OPERABLE, restore the inoperable ICW pump to OPERABLE status within 14 days or in accordance with the Risk Informed Completion Time Program, or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With only one ICW pump OPERABLE or with two ICW pumps OPERABLE, but not from independent power supplies, restore two pumps from independent power supplies to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With only one ICW header OPERABLE, restore two headers to OPERABLE status within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.7.3 The Intake Cooling Water System (ICW) shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position is in its correct position; and
- b. In accordance with the Surveillance Frequency Control Program during shutdown, by verifying that:
 - 1) Each automatic valve servicing safety-related equipment actuates to its correct position on a SI test signal, and
 - 2) Each Intake Cooling Water System pump starts automatically on a SI test signal.
 - 3) Interlocks required for system operability are OPERABLE.

PLANT SYSTEMS

3/4.7.4 ULTIMATE HEAT SINK

LIMITING CONDITION FOR OPERATION

3.7.4 The ultimate heat sink shall be OPERABLE with an average supply water temperature less than or equal to 104°F.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the requirements of the above specification not satisfied, be in at least HOT STANDBY within 12 hours and in COLD SHUTDOWN within the following 30 hours. This ACTION shall be applicable to both units simultaneously.

SURVEILLANCE REQUIREMENTS

4.7.4 The ultimate heat sink shall be determined OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying the average supply water temperature* is less than or equal to 104°F.
- b. At least once per hour by verifying the average supply water temperature* is less than or equal to 104°F, when water temperature exceeds 100°F.

*Portable monitors may be used to measure the temperature.

PLANT SYSTEMS

3/4.7.5 CONTROL ROOM EMERGENCY VENTILATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.5 The Control Room Emergency Ventilation System shall be OPERABLE* with:

- a. Three air handling units,
- b. Two condensing units,
- c. Two control room recirculation fans,
- d. Two recirculation dampers,
- e. One filter train,
- f. Two isolation dampers in the normal outside air intake duct,
- g. Two isolation dampers in the emergency outside air intake duct,
- h. Control Room Envelope.

APPLICABILITY: MODES 1, 2, 3, 4, 5 and 6 or during movement of irradiated fuel assemblies.

ACTION:

- a.1 With one air handling unit inoperable, within 7 days, restore the inoperable air handling unit to OPERABLE status or, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.
- a.2 With only one OPERABLE condensing unit, within 30 days, restore at least one of the inoperable condensing units to OPERABLE status or, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.
- a.3 With one recirculation fan inoperable, within 7 days, restore the inoperable fan to OPERABLE status or, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.

*The Control Room Envelope (CRE) boundary may be opened intermittently under administrative control.

PLANT SYSTEMS

3/4.7.5 CONTROL ROOM EMERGENCY VENTILATION SYSTEM

LIMITING CONDITION FOR OPERATION (continued)

- a.4 With one recirculation damper inoperable, within 7 days, restore the inoperable damper to OPERABLE status or, place and maintain at least one of the recirculation dampers in the open position and place the system in recirculation mode or, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.
- a.5 With the filter train inoperable, e.g., an inoperable filter, and/or two inoperable recirculation fans, and/or two inoperable recirculation dampers, immediately suspend all movement of irradiated fuel and immediately initiate action to place the compensatory filtration unit in service and verify proper operation within 24 hours, following which movement of irradiated fuel may resume, and within 7 days, restore the filter train to OPERABLE status.

With the above requirements not met, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.

- a.6 With an inoperable damper in the normal outside air intake, within 7 days, restore the inoperable damper to OPERABLE status or, place and maintain at least one of the normal outside air intake isolation dampers in the closed position and place the system in recirculation mode or, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.
- a.7 With an inoperable damper in the emergency outside air intake, within 7 days, restore the inoperable damper to OPERABLE status or, place and maintain at least one of the emergency outside air intake isolation dampers in the open position or, immediately suspend all movement of irradiated fuel and be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.

PLANT SYSTEMS

3/4.7.5 CONTROL ROOM EMERGENCY VENTILATION SYSTEM

LIMITING CONDITION FOR OPERATION (continued)

- b. With the Control Room Emergency Ventilation System inoperable due to an inoperable CRE boundary during MODES 1, 2, 3 or 4, immediately initiate action to implement mitigating actions. Within 24 hours, verify mitigating actions ensure CRE occupant radiological and chemical hazards will not exceed limits, and CRE occupants are protected from smoke hazards, and restore CRE boundary to OPERABLE status within 90 days.

With the above requirements not met, be in at least HOT STANDBY within the next 6 hours for one Unit, or 12 hours for both Units, and in COLD SHUTDOWN within the following 30 hours.

With the Control Room Emergency Ventilation System inoperable due to an inoperable CRE boundary during MODES 5, 6 or during the movement of irradiated fuel assemblies, immediately suspend all movement of irradiated fuel.

SURVEILLANCE REQUIREMENTS

4.7.5 The Control Room Emergency Ventilation System shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying that the control room air temperature is less than or equal to 120°F;
- b. In accordance with the Surveillance Frequency Control Program by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes**;
- c. In accordance with the Surveillance Frequency Control Program or (1) after 720 hours of system operation, or (2) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (3) following exposure of the filters to effluents from painting, fire, or chemical release in any ventilation zone communicating with the system that may have an adverse effect on the functional capability of the system, or (4) after complete or partial replacement of a filter bank by:

**As the mitigation actions of TS 3.7.5 Action a.5 include the use of the compensatory filtration unit, the unit shall meet the surveillance requirements of TS 4.7.5.b, by manual initiation from outside the control room and TS 4.7.5.c, d and f.

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- 1) Verifying that the air cleanup system satisfies the in-place penetration and bypass leakage testing acceptance criteria of greater than or equal to 99.95% DOP and 99% halogenated hydrocarbon removal at a system flow rate of 1000 cfm $\pm 10\%$ **. |
 - 2) Verifying, within 31 days after removal, that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, and analyzed per ASTM D3803 - 1989 at 30°C and 95% relative humidity, meets the methyl iodide penetration criteria of less than 2.5% or the charcoal be replaced with charcoal that meets or exceeds the stated performance requirement**, and |
 - 3) Verifying by a visual inspection the absence of foreign materials and gasket deterioration**. |
- d.1 In accordance with the Surveillance Frequency Control Program by verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is less than 6 inches Water Gauge while operating the system at a flow rate of 1000 cfm $\pm 10\%$ **; |
- d.2 In accordance with the Surveillance Frequency Control Program, test the supply fans (trains A and B) and measure CRE pressure relative to external areas adjacent to the CRE boundary.** |
- e. In accordance with the Surveillance Frequency Control Program by verifying that on a Containment Phase "A" Isolation test signal the system automatically switches into the recirculation mode of operation, |
- f. By performing required CRE unfiltered air inleakage testing in accordance with the Control Room Envelope Habitability Program.** |

**As the mitigation actions of TS 3.7.5 Action a.5 include the use of the compensatory filtration unit, the unit shall meet the surveillance requirements of TS 4.7.5.b, by manual initiation from outside the control room and TS 4.7.5.c, d and f. |

PLANT SYSTEMS

3/4.7.6 SNUBBERS

LIMITING CONDITION FOR OPERATION

3.7.6 All snubbers shall be OPERABLE. The only snubbers excluded from the requirements are those installed on nonsafety-related systems and then only if their failure or failure of the system on which they are installed would have no adverse effect on any safety-related system.

APPLICABILITY: MODES 1, 2, 3, and 4. MODES 5 and 6 for snubbers located on systems required OPERABLE in those MODES.

ACTION:

With one or more snubbers inoperable on any system, within 72 hours replace or restore the inoperable snubber(s) to OPERABLE status and determine the impact on the attached component by evaluation in accordance with Specification 4.7.6, or declare the attached system inoperable and follow the appropriate ACTION statement for that system.

SURVEILLANCE REQUIREMENTS

4.7.6 Each snubber shall be demonstrated OPERABLE by performance of the Snubber Testing Program in Specification 6.8.4.m.

PLANT SYSTEMS

3/4.7.7 SEALED SOURCE CONTAMINATION

LIMITING CONDITION FOR OPERATION

3.7.7 Each sealed source containing radioactive material either in excess of 100 microCuries of beta and/or gamma emitting material or 5 microCuries of alpha emitting material shall be free of greater than or equal to 0.005 microCurie of removable contamination.

APPLICABILITY: At all times.

ACTION:

- a. With a sealed source having removable contamination in excess of the above limits, immediately withdraw the sealed source from use and either:
 - 1. Decontaminate and repair the sealed source, or
 - 2. Dispose of the sealed source in accordance with Commission Regulations.
- b. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.7.7.1 Test Requirements - Each sealed source shall be tested for leakage and/or contamination by:

- a. The licensee, or
- b. Other persons specifically authorized by the Commission or an Agreement State.

The test method shall have a detection sensitivity of at least 0.005 microCurie per test sample.

4.7.7.2 Test Frequencies - Each category of sealed sources (excluding startup sources and fission detectors previously subjected to core flux) shall be tested at the frequency described below.

- a. Sources in use - in accordance with the Surveillance Frequency Control Program for all sealed sources containing radioactive materials:
 - 1) With a half-life greater than 30 days (excluding Hydrogen 3), and
 - 2) In any form other than gas.

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- b. Stored sources not in use - Each sealed source and fission detector shall be tested prior to use or transfer to another licensee unless tested within the previous 6 months. Sealed sources and fission detectors transferred without a certificate indicating the last test date shall be tested prior to being placed into use; and
- c. Startup sources and fission detectors - Each sealed startup source and fission detector shall be tested within 31 days prior to being subjected to core flux or installed in the core and following repair or maintenance to the source.

4.7.7.3 Deleted

4.7.7.4 A complete inventory of licensed radioactive materials in possession shall be maintained current at all times.

PLANT SYSTEMS

3/4 3.7.8 DELETED

PLANT SYSTEMS

3/4 3.7.9 DELETED

|

3/4.8 ELECTRICAL POWER SYSTEMS

3/4.8.1 A.C. SOURCES

OPERATING

LIMITING CONDITION FOR OPERATION

3.8.1.1 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. Two startup transformers and their associated circuits, and
- b. Three separate and independent diesel generators* including:
 - 1) For Unit 3, two (3A and 3B); for Unit 4, one (3A or 3B) each with:
 - a) A separate skid-mounted fuel tank and a separate day fuel tank with an OPERABLE solenoid valve to permit gravity flow from the day tank to the skid mounted tank, and with the two tanks together containing a minimum of 2000 gallons of fuel oil.
 - b) A common Fuel Storage System containing a minimum volume of 38,000 gallons of fuel.**
 - c) A separate fuel transfer pump.**
 - d) Lubricating oil storage containing a minimum volume of 120 gallons of lubricating oil.
 - e) Capability to transfer lubricating oil from storage to the diesel generator unit, and
 - f) Energized MCC bus (MCC 3A vital section for EDG 3A, MCC 3K for EDG 3B).
 - 2) For Unit 3, one (4A or 4B); for Unit 4, two (4A and 4B) each with:
 - a) A separate day fuel tank containing a minimum volume of 230 gallons of fuel.
 - b) A separate Fuel Storage System containing a minimum volume of 34,700 gallons of fuel.
 - c) A separate fuel transfer pump, and
 - d) Energized MCC bus (MCC 4J for EDG 4A, MCC 4K for EDG 4B).

*Whenever one or more of the four EDG's is out-of-service, ensure compliance with the EDG requirements specified in Specifications 3.5.2 and 3.8.2.1.

** A temporary Class III fuel storage system containing a minimum volume of 38,000 gallons of fuel oil may be used for up to 10 days during the performance of Surveillance Requirement 4.8.1.1.2i.1 for the Unit 3 storage tank while Unit 3 is in Modes 5, 6, or defueled. If the diesel fuel oil storage tank is not returned to service within 10 days, Technical Specification 3.8.1.1 Action b and 3.8.1.2 Action apply to Unit 4 and Unit 3 respectively.

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION (Continued)

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

NOTE: LCO 3.0.4.b is not applicable to diesel generators.

- a. With one of two startup transformers or an associated circuit inoperable:
 1. Demonstrate the OPERABILITY of the other startup transformer and its associated circuits by performing Surveillance Requirement 4.8.1.1.a within 1 hour and at least once per 8 hours thereafter.
 2. Within 24 hours from discovery of no offsite power to one train concurrent with inoperability of redundant required feature(s), declare required feature(s) with no offsite power available inoperable when its redundant required feature(s) is inoperable.
 3. If the inoperable startup transformer is the associated startup transformer and became inoperable while the unit is in Mode 1:
 - a) Reduce THERMAL POWER to $\leq 30\%$ RATED THERMAL POWER within 24 hours, or
 - b) Restore the inoperable startup transformer and associated circuits to OPERABLE status within the next 48 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
 4. If THERMAL POWER is reduced to $\leq 30\%$ RATED THERMAL POWER within 24 hours or if the inoperable startup transformer is associated with the opposite unit, restore the startup transformer and its associated circuits to OPERABLE status within 30 days of the loss of OPERABILITY, or be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours.
 5. If the inoperable startup transformer is the associated startup transformer and became inoperable while the unit was in MODE 2, 3, or 4, restore the startup transformer and its associated circuits to OPERABLE status within 24 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours. This ACTION applies to both units simultaneously.

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION (Continued)

ACTION (Continued)

- b. With one of the required diesel generators inoperable:
1. Demonstrate the OPERABILITY of the above required startup transformers and their associated circuits by performing Surveillance Requirement 4.8.1.1.1.a within 1 hour and at least once per 8 hours thereafter.
 2. If the diesel generator became inoperable due to any cause other than an inoperable support system, an independently testable component, or preplanned preventative maintenance or testing, demonstrate the OPERABILITY of the remaining required diesel generators by performing Surveillance Requirement 4.8.1.1.2.a.4 within 24 hours, unless the absence of any potential common mode failure for the remaining diesel generators is determined. If testing of remaining required diesel generators is required, this testing must be performed regardless of when the inoperable diesel generator is restored to OPERABILITY.
 3. Restore the inoperable diesel generator to OPERABLE status within 14 days** or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

NOTE: Enter applicable ACTIONS of LCO 3.8.3.1, "Onsite Power Distribution - Operating," when ACTION c is entered with no AC power source to any train.

- c. With one startup transformer and one of the required diesel generators inoperable:
1. Demonstrate the OPERABILITY of the remaining A.C. sources by performing Surveillance Requirement 4.8.1.1.1.a on the remaining startup transformer and associated circuits within 1 hour and at least once per 8 hours thereafter.
 2. If the diesel generator became inoperable due to any cause other than an inoperable support system, an independently testable component, or preplanned preventive maintenance or testing, demonstrate the OPERABILITY of the remaining required diesel generators by performing Surveillance Requirement 4.8.1.1.2.a.4 within 8 hours, unless it can be confirmed that the cause of the inoperable diesel generator does not exist on the remaining required diesel generators, unless the diesel generators are already operating. If testing of remaining required diesel generators is required, this testing must be performed regardless of when the inoperable diesel generator is restored to OPERABILITY.
 3. Restore one of the inoperable sources to OPERABLE status in accordance with ACTIONS a and b, as appropriate.
 4. Restore the other A.C. power source (startup transformer or diesel generator) to OPERABLE status in accordance with the provisions of Section 3.8.1.1 ACTION a or b, as appropriate, with the time requirement of that ACTION based on the time of initial loss of the remaining inoperable A.C. power source.

** 72 hours if inoperability is associated with Action Statement 3.8.1.1.c.

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION (Continued)

ACTION (Continued)

- d. With one diesel generator inoperable, in addition to ACTION b. or c. above, verify that:
1. All required systems, subsystems, trains, components, and devices (except safety injection pumps) that depend on the remaining required OPERABLE diesel generators as a source of emergency power are also OPERABLE.

If this condition is not satisfied within 2 hours, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
 2. At least two Safety Injection pumps are OPERABLE and capable of being powered from their associated OPERABLE diesel generators.

If this condition is not satisfied within 2 hours, be in at least HOT STANDBY within the next 12 hours and in HOT SHUTDOWN within the following 6 hours. This ACTION applies to both units simultaneously.
- e. With two of the above required startup transformers or their associated circuits inoperable:
1. Within 12 hours from discovery of two offsite circuits inoperable concurrent with inoperability of redundant required feature(s), declare required feature(s) inoperable when its redundant required feature(s) is inoperable.
 2. Restore at least one of the inoperable startup transformers to OPERABLE status within 24 hours or be in at least HOT STANDBY within the next 6 hours* and in COLD SHUTDOWN within the following 30 hours. This ACTION applies to both units simultaneously.
 3. With only one startup transformer and associated circuits restored, perform Surveillance Requirement 4.8.1.1.1.a on the OPERABLE Startup transformer at least once per 8 hours, and restore the other startup transformer and its associated circuits to OPERABLE status or shutdown in accordance with the provisions of ACTION 3.8.1.1.a with time requirements of that ACTION based on the time of initial loss of a startup transformer. This ACTION applies to both units simultaneously.

*If the opposite unit is shutdown first, this time can be extended to 42 hours.

ELECTRICAL POWER SYSTEMS

LIMITING CONDITION FOR OPERATION (Continued)

ACTION (Continued)

- f. With two of the above required diesel generators inoperable, demonstrate the OPERABILITY of two startup transformers and their associated circuits by performing the requirements of Specification 4.8.1.1.1a. within 1 hour and at least once per 8 hours thereafter; restore at least one of the inoperable diesel generators to OPERABLE status within 2 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. Restore all required diesel generators to OPERABLE status within 14 days from time of initial loss or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- g. Following the addition of the new fuel oil* to the Diesel Fuel Oil Storage Tanks, with one or more diesel generators with new fuel oil properties outside the required Diesel Fuel Oil Testing Program limits, restore the stored fuel oil properties to within the required limits within 30 days.
- h. With one or more diesel generators with stored fuel oil total particulates outside the required Diesel Fuel Oil Testing Program limits, restore the fuel oil total particulates to within the required limits within 7 days.

* The properties of API Gravity, specific gravity or an absolute specific gravity; kinematic viscosity; clear and bright appearance; and flash point shall be confirmed to be within the Diesel Fuel Oil Testing Program limits, prior to the addition of the new fuel oil to the Diesel Fuel Oil Storage Tanks.

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS

- 4.8.1.1.1 Each of the above required startup transformers and their associated circuits shall be:
- a. Determined OPERABLE in accordance with the Surveillance Frequency Control Program by verifying correct breaker alignments, indicated power availability, and
 - b. Demonstrated OPERABLE in accordance with the Surveillance Frequency Control Program while shutting down, by transferring manually unit power supply from the auxiliary transformer to the startup transformer.

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

4.8.1.1.2 Each diesel generator shall be demonstrated OPERABLE*:

- a. In accordance with the Surveillance Frequency Control Program by:
 - 1) Verifying the fuel volume in the day and skid-mounted fuel tanks (Unit 4-day tank only),
 - 2) Verifying the fuel volume in the fuel storage tank,
 - 3) Verifying the lubricating oil inventory in storage,
 - 4) Verifying the diesel starts and accelerates to reach a generator voltage and frequency of 3950-4350 volts and 60 ± 0.6 Hz. In accordance with the Surveillance Frequency Control Program, these conditions shall be reached within 15 seconds after the start signal from normal conditions. For all other starts, warmup procedures, such as idling and gradual acceleration as recommended by the manufacturer may be used. The diesel generator shall be started for this test by using one of the following signals:
 - a) Manual, or
 - b) Simulated loss-of-offsite power by itself, or
 - c) Simulated loss-of-offsite power in conjunction with an ESF Actuation test signal, or
 - d) An ESF Actuation test signal by itself.
 - 5) Verifying the generator is synchronized, loaded** to 2300 - 2500 kW (Unit 3), 2650-2850 kW (Unit 4)***, operates at this loaded condition for at least 60 minutes and for Unit 3 until automatic transfer of fuel from the day tank to the skid mounted tank is demonstrated, and the cooling system is demonstrated OPERABLE.
 - 6) Verifying the diesel generator is aligned to provide standby power to the associated emergency buses.

* All diesel generator starts for the purpose of these surveillances may be preceded by a prelube period as recommended by the manufacturer.

** May include gradual loading as recommended by the manufacturer so that the mechanical stress and wear on the diesel engine is minimized.

***Momentary transients outside these load bands do not invalidate this test.

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- b. Demonstrating that a fuel transfer pump starts automatically and transfers fuel from the storage system to the day tank, in accordance with the Surveillance Frequency Control Program;
- c. In accordance with the Surveillance Frequency Control Program and after each operation of the diesel where the period of operation was greater than or equal to 1 hour by checking for and removing accumulated water from the day and skid-mounted fuel tanks (Unit 4-day tank only);
- d. In accordance with the Surveillance Frequency Control Program by checking for and removing accumulated water from the fuel oil storage tanks;
- e. By verifying fuel oil properties of new fuel oil are tested in accordance with, and maintained within the limits of, the Diesel Fuel Oil Testing Program.
- f. By verifying fuel oil properties of stored fuel oil are tested in accordance with, and maintained within the limits of, the Diesel Fuel Oil Testing Program.
- g. In accordance with the Surveillance Frequency Control Program, during shutdown (applicable to only the two diesel generators associated with the unit):
 - 1) Deleted
 - 2)* Verifying the generator capability to reject a load of greater than or equal to 392 kW without exceeding a frequency of 66.25 Hz. Within 2 seconds following the load rejection, the generator shall return to within 3950-4350 volts and frequency at 60 ± 0.6 Hz;
 - 3)* Verifying the generator capability to reject a load of greater than or equal to 2500 kW (Unit 3), 2874 kW (Unit 4) without tripping. The generator voltage shall return to less than or equal to 4784 volts within 2 seconds following the load rejection;
 - 4) Simulating a loss-of-offsite power by itself, and:
 - a) Verifying deenergization of the emergency busses and load shedding from the emergency busses, and
 - b. Verifying the diesel starts on the auto-start signal, energizes the emergency busses with any permanently

* For the purpose of this test, warmup procedures, such as idling, gradual acceleration, and gradual loading as recommended by the manufacturer may be used.

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

connected loads within 15 seconds, energizes the auto-connected shutdown loads through the load sequencer and operates for greater than or equal to 5 minutes while its generator is loaded with the auto-connected shutdown loads. After automatic load sequencing, the steady-state voltage and frequency of the emergency busses shall be maintained at 3950-4350 volts and 60 ± 0.6 Hz during this test.

- 5) Verifying that on an ESF Actuation test signal, without loss-of-offsite power, the diesel generator starts on the auto-start signal and operates on standby for greater than or equal to 5 minutes. The generator voltage and frequency shall be 3950-4350 volts and 60 ± 0.6 Hz within 15 seconds after the auto-start signal; the steady-state generator voltage and frequency shall be maintained within these limits during this test;
- 6) Simulating a loss-of-offsite power in conjunction with an ESF Actuation test signal, and:
 - a) Verifying deenergization of the emergency busses and load shedding from the emergency busses;
 - b) Verifying the diesel starts on the auto-start signal, energizes the emergency busses with any permanently connected loads within 15 seconds, energizes the auto-connected emergency (accident) loads through the load sequencer and operates for greater than or equal to 5 minutes while its generator is loaded with the emergency loads. After automatic load sequencing, the steady-state voltage and frequency of the emergency busses shall be maintained at 3950-4350 volts and 60 ± 0.6 Hz during this test; and
 - c) Verifying that diesel generator trips that are made operable during the test mode of diesel operation are inoperable.
- 7)* # Verifying the diesel generator operates for at least 24 hours. During the first 2 hours of this test, the diesel generator shall be loaded to 2550-2750 kW (Unit 3), 2950-3150 kW (Unit 4)** and during the remaining 22 hours of this test, the diesel generator shall be loaded to 2300-2500 kW (Unit 3), 2650-2850 kW (Unit 4)**. The generator voltage and frequency shall be 3950-4350 volts and 60 ± 0.6 Hz within 15 seconds after the start signal; the steady-state generator voltage and frequency

* For the purpose of this test, warmup procedures, such as idling, gradual acceleration, and gradual loading as recommended by the manufacturer may be used.

** Momentary transients outside these load bands do not invalidate this test.

This test may be performed during POWER OPERATION

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

shall be maintained within these limits during this test. Within 5 minutes after completing this 24-hour test, verify the diesel starts and accelerates to reach a generator voltage and frequency of 3950-4350 volts and 60 ± 0.6 Hz within 15 seconds after the start signal. **

- 8) Verifying that the auto-connected loads to each diesel generator do not exceed 2500 kW (Unit 3), 2874 kW (Unit 4);
- 9) Verifying the diesel generator's capability to:
 - a) Synchronize with the offsite power source while the generator is loaded with its emergency loads upon a simulated restoration of offsite power,
 - b) Transfer its loads to the offsite power source, and
 - c) Be restored to its standby status.
- 10) Verifying that the diesel generator operating in a test mode, connected to its bus, a simulated Safety Injection signal overrides the test mode by: (1) returning the diesel generator to standby operation, and (2) automatically energizing the emergency loads with offsite power;
- 11) Verifying that the fuel transfer pump transfers fuel from the fuel storage tank (Unit 3), fuel storage tanks (Unit 4) to the day tanks of each diesel associated with the unit via the installed cross-connection lines;
- 12) Verifying that the automatic load sequence timer is OPERABLE with the interval between each load block within $\pm 10\%$ of its design interval;
- 13) Verifying that the diesel generator lockout relay prevents the diesel generator from starting;

** If verification of the diesel's ability to restart and accelerate to a generator voltage and frequency of 3950-4350 volts and 60 ± 0.6 Hz within 15 seconds following the 24 hour operation test of Specification 4.8.1.1.2.g.7) is not satisfactorily completed, it is not necessary to repeat the 24-hour test. Instead, the diesel generator may be operated between 2300-2500 kW Unit 3, 2650-2850 kW (Unit 4) for 2 hours or until operating temperature has stabilized (whichever is greater). Following the 2 hours/operating temperature stabilization run, the EDG is to be secured and restarted within 5 minutes to confirm its ability to achieve the required voltage and frequency within 15 seconds.

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- h. In accordance with the Surveillance Frequency Control Program or after any modifications which could affect diesel generator interdependence by starting all required diesel generators simultaneously and verifying that all required diesel generators provide 60 ± 0.6 Hz frequency and 3950-4350 volts in less than or equal to 15 seconds: and
- i. In accordance with the Surveillance Frequency Control Program, by draining each fuel oil storage tank, removing the accumulated sediment and cleaning the tank.*
- j. At least once per 10 years, for Unit 4 only, by performing a pressure test of those portions of the diesel fuel oil system designed to Section III, subsection ND of the ASME Code in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda.

4.8.1.1.3 Reports - (Not Used)

* A temporary Class III fuel storage system containing a minimum volume of 38,000 gallons of fuel oil may be used for up to 10 days during the performance of Surveillance Requirement 4.8.1.1.2i for the Unit 3 storage tank while Unit 3 is in Modes 5, 6, or defueled. If the diesel fuel oil storage tank is not returned to service within 10 days, Technical Specification 3.8.1.1 Action b and 3.8.1.2 Action apply to Unit 4 and Unit 3 respectively.

A.C. SOURCES

SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.8.1.2 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. One startup transformer and associated circuits, or an alternate circuit, between the offsite transmission network and the 4160 volt bus, A or B, and
- b. One diesel generator with:
 - 1) For Unit 3 (3A or 3B)
A skid-mounted fuel tank and a day fuel tank, with an OPERABLE solenoid valve to permit gravity flow from the day tank to the skid mounted tank, with the two tanks together containing a minimum of 2000 gallons of fuel oil

For Unit 4 (4A or 4B)
A day fuel tank containing a minimum volume of 230 gallons of fuel
 - 2) A fuel storage system containing a minimum volume of fuel of 38,000 gallons (Unit 3). 34,700 gallons (Unit 4)**
 - 3) An associated fuel transfer pump**
 - 4) For Unit 3 only, lubricating oil storage containing a minimum volume of 120 gallons of lubricating oil
 - 5) For Unit 3 only capability to transfer lubricating oil from storage to the diesel generator unit and
 - 6) Energized MCC bus (as identified by Specification 3.8.1.1.b.).

APPLICABILITY: MODES 5* and 6*.

ACTION:

NOTE: Enter the ACTION of LCO 3.8.3.2, "Onsite Power Distribution - Shutdown," with one required train de-energized as a result of inoperable offsite circuit.

With less than the above minimum required A.C. electrical power sources OPERABLE, immediately suspend all operations involving CORE ALTERATIONS, positive reactivity changes, movement of irradiated fuel, or crane operation with loads over the fuel storage pool, and within 8 hours, depressurize and vent the Reactor Coolant System through a greater than or equal to 2.2 square inch vent. In addition, when in MODE 5 with the reactor coolant loops not filled, or in MODE 6 with the water level less than 23 feet above the reactor vessel flange, immediately initiate corrective action to restore the required sources to OPERABLE status as soon as possible and increase RCS inventory as soon as possible.

* CAUTION - If the opposite unit is in MODES 1, 2, 3, or 4 see Specification 3.8.1.1

** A temporary Class III fuel storage system containing a minimum volume of 38,000 gallons of fuel oil may be used for up to 10 days during the performance of Surveillance Requirement 4.8.1.1.2i.1 for the Unit 3 storage tank while Unit 3 is in Modes 5, 6, or defueled. If the diesel fuel oil storage tank is not returned to service within 10 days, Technical Specification 3.8.1.1 Action b and 3.8.1.2 Action apply to Unit 4 and Unit 3 respectively.

ELECTRICAL POWER SYSTEMS

SURVEILLANCE REQUIREMENTS

4.8.1.2 The above required A.C. electrical power sources shall be demonstrated OPERABLE by the performance of each of the requirements of Specifications 4.8.1.1.1.a and 4.8.1.1.2 (except for Specification 4.8.1.1.2a.5).

3/4.8.2 D.C. SOURCES

OPERATING

LIMITING CONDITION FOR OPERATION

3.8.2.1 The following D.C. electrical sources shall be OPERABLE: *#

- a. 125-volt D.C. Battery Bank 3A or spare battery bank D-52 and associated full capacity charger(s)
 - 1) 3A1 powered by motor control center (MCC) 3C with EDG 3A OPERABLE, or
 - 2) 3A2 powered by MCC 4D with EDG 4A and 4B OPERABLE, or
 - 3) 3A1 powered by MCC 3C with EDG 3A OPERABLE and 3A2 powered by MCC 4D with EDG 4A and 4B OPERABLE,
- b. 125-volt D.C. Battery Bank 3B or spare battery bank D-52 and associated full capacity charger(s)
 - 1) 3B1 powered by MCC 3B with EDG 3B OPERABLE, or
 - 2) 3B2 powered by MCC 4D with EDG 4A and 4B OPERABLE, or
 - 3) 3B1 powered by MCC 3B with EDG 3B OPERABLE and 3B2 powered by MCC 4D with EDG 4A and 4B OPERABLE,
- c. 125-volt D.C. Battery Bank 4A or spare battery bank D-52 and associated full capacity charger(s)
 - 1) 4A1 powered by MCC 4C with EDG 4A OPERABLE, or
 - 2) 4A2 powered by MCC 3D with EDG 3A and 3B OPERABLE, or
 - 3) 4A1 powered by MCC 4C with EDG 4A OPERABLE and 4A2 powered by MCC 3D with EDG 3A and 3B OPERABLE,
- d. 125-volt D.C. Battery Bank 4B or spare battery bank D-52 and associated full capacity charger(s)
 - 1) 4B1 powered by MCC 4B with EDG 4B OPERABLE, or
 - 2) 4B2 powered by MCC 3D with EDG 3A and 3B OPERABLE, or
 - 3) 4B1 powered by MCC 4B with EDG 4B OPERABLE and 4B2 powered by MCC 3D with EDG 3A and 3B OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With one or more of the required battery chargers OPERABLE but not capable of being powered from its associated OPERABLE diesel generator(s), restore the capability within 72 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours. This ACTION applies to both units simultaneously.

* All battery chargers required to satisfy the LCO shall be powered from separate MCCs.

Inoperability of the required EDG's specified in the LCO requirements below does not constitute inoperability of the associated battery chargers or battery banks.

D.C. SOURCES

LIMITING CONDITION FOR OPERATION

ACTION: (Continued)

- b. With one of the required battery banks inoperable, or with none of the full-capacity chargers associated with a battery bank OPERABLE, restore all battery banks to OPERABLE status and at least one charger associated with each battery bank to OPERABLE status within two hours* or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours. This ACTION applies to both units simultaneously.

SURVEILLANCE REQUIREMENTS

4.8.2.1 Each 125-volt battery bank and its associated full capacity charger(s) shall be demonstrated OPERABLE:

- a. In accordance with the Surveillance Frequency Control Program by verifying that:
 - 1) The parameters in Table 4.8-2 meet the Category A limits, and
 - 2) The total battery terminal voltage is greater than or equal to 129 volts on float charge and the battery charger(s) output voltage is ≥ 129 volts, and
 - 3) If two battery chargers are connected to the battery bank, verify each battery charger is supplying a minimum of 10 amperes, or demonstrate that the battery charger supplying less than 10 amperes will accept and supply the D.C. bus load independent of its associated battery charger.
- b. In accordance with the Surveillance Frequency Control Program and within 7 days after a battery discharge with battery terminal voltage below 105 volts (108.6 volts for spare battery D-52), or battery overcharge with battery terminal voltage above 143 volts, by verifying that:
 - 1) The parameters in Table 4.8-2 meet the Category B limits,
 - 2) The average electrolyte temperature of every sixth cell is above 60°F, and
 - 3) There is no visible corrosion at either terminals or connectors, or verify battery connection resistance is:

Battery 3B, 4A	Connection inter-cell / termination	Limit (Micro-Ohms) ≤ 29
	inter-cell (brace locations)	≤ 30
	transition cables	≤ 125
	or	
	total battery connections	≤ 1958
Battery 3A, 4B, D-52	Connection inter-cell / termination	Limit (Micro-Ohms) ≤ 35
	inter-cell (brace locations)	≤ 40
	transition cables	≤ 125
	or	
	total battery connections	≤ 2463

- c. In accordance with the Surveillance Frequency Control Program by verifying that:
 - 1) The cells, cell plates, and battery racks show no visual indication of physical damage or abnormal deterioration,

*Can be extended to 24 hours if the opposite unit is in MODE 5 or 6 and each of the remaining required battery chargers is capable of being powered from its associated diesel generator(s).

D.C. SOURCES

SURVEILLANCE REQUIREMENTS (Continued)

- 2) The cell-to-cell and terminal connections are clean, tight, and coated with anticorrosion material,
- 3) Each 400 amp battery charger (associated with Battery Banks 3A and 4B) will supply at least 400 amperes at ≥ 129 volts for at least 8 hours, and each 300 amp battery charger (associated with Battery Banks 3B and 4A) will supply at least 300 amperes at ≥ 129 volts for at least 8 hours, and
- 4) Battery Connection resistance is:

Battery 3B, 4A	Connection inter-cell / termination inter-cell (brace locations) transition cables or total battery connections	Limit (Micro-Ohms) ≤ 29 ≤ 30 ≤ 125 ≤ 1958
Battery 3A, 4B, D-52	Connection inter-cell / termination inter-cell (brace locations) transition cables or total battery connections	Limit (Micro-Ohms) ≤ 35 ≤ 40 ≤ 125 ≤ 2463

- d. In accordance with the Surveillance Frequency Control Program, during shutdown**, by verifying that the battery capacity is adequate to supply and maintain in OPERABLE status all of the actual or simulated emergency loads for the design duty cycle when the battery is subjected to a battery service test.
- e. At least once per 12 months, during shutdown**, by giving performance discharge tests of battery capacity to any battery that shows signs of degradation or has reached 85% [75% for Batteries 4B and D52 (Spare) when used in place of Battery 4B] of service life expected for the application. Degradation is indicated when the battery capacity drops more than 10% [7% for Batteries 4B and D52 (Spare) when used in place of Battery 4B] of rated capacity from its average on previous performance tests, or is below 90% [93% for Batteries 4B and D52 (Spare) when used in place of Battery 4B] of the manufacturer's rating.
- f. In accordance with the Surveillance Frequency Control Program, during shutdown**, by verifying that the battery capacity is at least 80% [87% for Batteries 4B and D52 (Spare) when used in place of Battery 4B] of the manufacturer's rating when subjected to a performance discharge test. Once per 60-month interval this performance discharge test may be performed in lieu of the battery service test required by Specification 4.8.2.1.d.

**Except that the spare battery bank D-52, and any other battery out of service when spare battery bank D-52 is in service may be tested with simulated loads during operation.

TABLE 4.8-2

BATTERY SURVEILLANCE REQUIREMENTS

CATEGORY A ⁽¹⁾		CATEGORY B ⁽²⁾	
PARAMETER	LIMITS FOR EACH DESIGNATED PILOT CELL	LIMITS FOR EACH CONNECTED CELL	ALLOWABLE ⁽³⁾ VALUE FOR EACH CONNECTED CELL
Electrolyte Level	>Minimum level indication mark, and < $\frac{1}{4}$ " above maximum level indication mark	>Minimum level indication mark, and < $\frac{1}{4}$ " above maximum level indication mark	Above top of plates, and not overflowing
Float Voltage	≥ 2.13 volts	≥ 2.13 volts ⁽⁶⁾	≥ 2.07 volts
Specific Gravity ⁽⁴⁾	≥ 1.200 ⁽⁵⁾	≥ 1.195	Not more than 0.020 below the average of all connected cells
		Average of all connected cells	Average of all connected cells
		> 1.205	≥ 1.195 ⁽⁵⁾

TABLE NOTATIONS

- (1) For any Category A parameter(s) outside the limit(s) shown, the battery may be considered OPERABLE provided that within 24 hours all the Category B measurements are taken and found to be within their allowable values, and provided all Category A and B parameter(s) are restored to within limits within the next 6 days.
- (2) For any Category B parameter(s) outside the limit(s) shown, the battery may be considered OPERABLE provided that the Category B parameters are within their allowable values and provided the Category B parameter(s) are restored to within limits within 7 days.
- (3) Any Category B parameter not within its allowable value indicates an inoperable battery.
- (4) Corrected for electrolyte temperature and level.
- (5) Or battery charging current is less than 2 amps when on charge.
- (6) Corrected for average electrolyte temperature.

D.C. SOURCES

SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.8.2.2 As a minimum, three 125 volt battery banks, each with at least one associated full capacity charger capable of being powered by an OPERABLE diesel generator, shall be OPERABLE.

APPLICABILITY: MODES 5* and 6*.

ACTION:

With one or more of the required 125 volt battery banks or required associated full-capacity chargers inoperable or not capable of being powered from an OPERABLE diesel generator, immediately suspend all operations involving CORE ALTERATIONS, positive reactivity changes, or movement of irradiated fuel; initiate corrective action to restore the required battery banks and associated full-capacity chargers to OPERABLE status as soon as possible, and within 8 hours, depressurize and vent the Reactor Coolant System through at least a 2.2 square inch vent.

SURVEILLANCE REQUIREMENTS

4.8.2.2 The above required 125 volt battery banks and associated full-capacity chargers shall be demonstrated OPERABLE in accordance with Specification 4.8.2.1.

*CAUTION - If the opposite unit is in MODES 1, 2, 3 or 4, see the corresponding Limiting Condition for Operation 3.8.2.1.

3/4.8.3 ONSITE POWER DISTRIBUTION

OPERATING

LIMITING CONDITION FOR OPERATION

3.8.3.1 The following electrical busses* shall be energized in the specified manner with the tie breakers open between redundant busses within the unit** and between the busses of Units 3 and 4.

- a. One train of A.C. Busses consisting of:
 - 1) 4160-Volt Bus A,
 - 2) 480-Volt Load Center Busses A, C and H***, and
 - 3) 480-Volt Motor Control Center Busses A (Unit 4 only), C and D***,
- b. One train of A.C. Busses consisting of:
 - 1) 4160-Volt Bus B
 - 2) 480-Volt Load Center Busses B, D and H***, and
 - 3) 480-Volt Motor Control Center Busses B and D***
- c. One opposite unit train of AC busses consisting of either:
 - 1) 4160-Volt Bus A, 480-Volt Load Center Busses A, C and H***, and 480-Volt Motor Control Center Busses A (Unit 4 only), C and D***, or
 - 2) 4160-Volt Bus B, 480-Volt Load Center Busses B, D and H***, and 480-Volt Motor Control Center Busses B and D***.
- d. 120 Volt AC Vital Panel 3P06 and 3P21 energized from its associated inverter connected to D.C. Bus 3B.****
- e. 120 Volt AC Vital Panel 4P06 and 4P21 energized from its associated inverter connected to D.C. Bus 3B.****
- f. 120 Volt AC Vital Panel 3P07 and 3P22 energized from its associated inverter connected to D.C. Bus 3A.****
- g. 120 Volt AC Vital Panel 4P07 and 4P22 energized from its associated inverter connected to D.C. Bus 3A.****
- h. 120 Volt AC Vital Panel 3P08 and 3P23 energized from its associated inverter connected to D.C. Bus 4B.****
- i. 120 Volt AC Vital Panel 4P08 and 4P23 energized from its associated inverter connected to D.C. Bus 4B.****

*For Motor Control Center busses, vital sections only.

**With the opposite unit in MODE 5 or 6, its 480-Volt Load Center can be cross-tied under conditions specified in Specification 3.8.3.2.a.

***Electrical bus can be energized from either train of its unit and swing function to opposite train must be OPERABLE for the Unit(s) in MODES 1,2,3, and 4.

****A back-up inverter may be used to replace the normal inverter provided the normal inverter on the same DC bus for the opposite unit is not replaced at the same time.

ONSITE POWER DISTRIBUTION

LIMITING CONDITION FOR OPERATION (Continued)

- j. 120 Volt AC Vital Panel 3P09 and 3P24 energized from its associated inverter connected to D.C. Bus 4A. ****
- k. 120 Volt AC Vital Panel 4P09 and 4P24 energized from its associated inverter connected to D.C. Bus 4A. ****
- l. 125 Volt D.C. Bus 3D01 energized from an associated battery charger and from Battery Bank 3A or spare battery bank D-52,
- m. 125 Volt D.C. Bus 3D23 energized from an associated battery charger and from Battery Bank 3B or spare battery bank D-52,
- n. 125 Volt D.C. Bus 4D01 energized from an associated battery charger and from Battery Bank 4B or spare battery bank D-52, and
- o. 125 Volt D.C. Bus 4D23 energized from an associated battery charger and from Battery Bank 4A or spare battery bank D-52

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

NOTE: Enter applicable ACTIONS of LCO 3.8.2.1, "D.C. Sources - Operating," for DC trains made inoperable by inoperable AC power distribution system.

- a. With one of the required trains (3.8.3.1a., b., and c) of A.C. emergency busses not fully energized (except for the required LC's and MCC's associated with the opposite unit), reenergize the train within 8 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With any of the required LC's and/or MCC's associated with the opposite unit inoperable, restore the inoperable LC or MCC to OPERABLE status in accordance with Table 3.8-1 or Table 3.8-2 as applicable or place the unit in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With one A.C. vital panel either not energized from its associated inverter, or with the inverter not connected to its associated D.C. bus: (1) Reenergize the A.C. vital panel within 2 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours; and (2) reenergize the A.C. vital panel from an inverter connected to its associated D.C. bus.

****A back-up inverter may be used to replace the normal inverter, provided the normal inverter on the same DC bus for the opposite unit is not replaced at the same time.

ONSITE POWER DISTRIBUTION

LIMITING CONDITION FOR OPERATION (Continued)

ACTION: (Continued)

within 24 hours or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours. This ACTION applies to both units simultaneously.

- d. With one D.C. bus not energized from its associated battery bank or associated charger, reenergize the D.C. bus from its associated battery bank within 2 hours* or in accordance with the Risk Informed Completion Time Program, or be in at least HOT STANDBY within the next 12 hours and in COLD SHUTDOWN within the following 30 hours. This ACTION applies to both units simultaneously.

SURVEILLANCE REQUIREMENTS

- 4.8.3.1 The specified busses shall be determined energized and aligned in the required manner by verifying correct breaker alignment and indicated voltage on the buses in accordance with the Surveillance Frequency Control Program.

* Can be extended to 24 hours if the opposite unit is in MODE 5 or 6 and each of the remaining required battery chargers is capable of being powered from its associated diesel generator(s).

TABLE 3.8-1

APPLICABLE TO UNIT 3 BASED ON UNIT 4 LOAD
CENTERS AND MOTOR CONTROL CENTERS INOPERABLE

ALLOWABLE OUTAGE TIMES

Unit 4 Load Centers and Motor Control Centers Inoperable (Any MODE)	Allowable Outage Times (hours) Unit 3 – MODES 1, 2, 3 and 4		
	With AC Trains 3A, 3B, 4A, & 4B OPERABLE	With AC Trains 3A, 3B, & 4A OPERABLE	With AC Trains 3A, 3B, & 4B OPERABLE
LC 4A	N/A	72 ^a	N/A
MCC 4A	N/A	N/A	N/A
LC 4C and/or MCC 4C	2 ^{**a}	2 ^{**a}	N/A
LC 4H and/or MCC 4D	2 ^{***a}	2 ^{***a}	2 ^{***a}
LC 4B and/or MCC 4B	2 ^{**a}	N/A	2 ^{**a}
LC 4D	N/A	N/A	72 ^a

* If the battery charger powered from the out-of-service LC and/or MCC is not required by LCO 3.8.2.1, the out-of-service time is not applicable (N/A).

** If neither of the battery chargers powered from the out-of-service LC and/or MCC is required by LCO 3.8.2.1, the out-of-service time is 72 hours or in accordance with the Risk Informed Completion Time Program.

^a or in accordance with the Risk Informed Completion Time Program

TABLE 3.8-2
APPLICABLE TO UNIT 4 BASED ON UNIT 3 LOAD
CENTERS AND MOTOR CONTROL CENTERS INOPERABLE

ALLOWABLE OUTAGE TIMES

Unit 3 Load Centers and Motor Control Centers Inoperable (Any MODE)	Allowable Outage Times (hours) Unit 4 – MODES 1, 2, 3 and 4		
	With AC Trains 4A, 4B, 3A, & 3B OPERABLE	With AC Trains 4A, 4B, & 3A OPERABLE	With AC Trains 4A, 4B, & 3B OPERABLE
LC 3A	N/A	72 ^a	N/A
LC 3C and/or MCC 3C	2 ^{**a}	2 ^{**a}	N/A
LC 3H and/or MCC 3D	2 ^{**a}	2 ^{**a}	2 ^{**a}
LC 3B and/or MCC 3B	2 ^{**a}	N/A	2 ^{**a}
LC 3D	N/A	N/A	72 ^a

* If the battery charger powered from the out-of-service LC and/or MCC is not required by LCO 3.8.2.1, the out-of-service time is not applicable (N/A).

** If neither of the battery chargers powered from the out-of-service LC and/or MCC is required by LCO 3.8.2.1, the out-of-service time is 72 hours or in accordance with the Risk Informed Completion Time Program.

^a or in accordance with the Risk Informed Completion Time Program

ONSITE POWER DISTRIBUTION

SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.8.3.2 As a minimum, the following electrical busses shall be energized in the specified manner:

- a. One train of A.C. emergency busses associated with the unit (3.8.3.1a. or b.) consisting of one 4160-volt and three 480-volt A.C. emergency busses load centers* and three (four for Unit 4 Train A) vital sections of motor control center busses,
- b. Two 120-volt A.C. vital busses for the unit energized from their associated inverters** connected to their respective D.C. busses, and
- c. Three 125-volt D.C. busses energized from their associated battery banks.

APPLICABILITY MODES 5*** and 6***.

ACTION:

With any of the above required electrical busses not energized in the required manner, immediately suspend all operations involving CORE ALTERATIONS, positive reactivity changes, or movement of irradiated fuel, initiate corrective action to energize the required electrical busses in the specified manner as soon as possible, and within 8 hours, depressurize and vent the RCS through at least a 2.2 square inch vent.

SURVEILLANCE REQUIREMENTS

4.8.3.2 The specified busses shall be determined energized in the required manner by verifying correct breaker alignment and indicated voltage on the busses in accordance with the Surveillance Frequency Control Program.

* With the opposite unit in MODE 1, 2, 3, or 4, the 480-volt load centers can only be cross-tied upon issuance of an engineering evaluation to prevent exceeding required electrical components maximum design ratings and to ensure availability of the minimum required equipment.

** A backup inverter may be used to replace the normal inverter provided the normal inverter on the same DC bus for the opposite unit is not replaced at the same time.

*** CAUTION - If the opposite unit is in MODES 1, 2, 3, or 4, see the corresponding Limiting Condition for Operation 3.8.3.1.

3/4.9 REFUELING OPERATIONS

3/4.9.1 BORON CONCENTRATION

LIMITING CONDITION FOR OPERATION

3.9.1 The boron concentration of all filled portions of the Reactor Coolant System and the refueling canal shall be maintained uniform and sufficient to ensure that the more restrictive of the following reactivity conditions is met; either:

- a. A K_{eff} of 0.95 or less, or
- b. A boron concentration of greater than or equal to 2300 ppm.

APPLICABILITY: MODE 6.*

ACTION:

With the requirements of the above specification not satisfied, immediately suspend all operations involving CORE ALTERATIONS or positive reactivity changes and initiate and continue boration at greater than or equal to 16 gpm of a solution containing greater than or equal to 3.0 wt% (5245 ppm) boron or its equivalent until K_{eff} is reduced to less than or equal to 0.95 or the boron concentration is restored to greater than or equal to 2300 ppm, whichever is the more restrictive.

SURVEILLANCE REQUIREMENTS

4.9.1.1 The more restrictive of the above two reactivity conditions shall be determined prior to:

- a. Removing or unbolting the reactor vessel head, and
- b. Withdrawal of any full-length control rod in excess of 3 feet from its fully inserted position within the reactor vessel.

4.9.1.2 The boron concentration of the Reactor Coolant System and the refueling canal shall be determined by chemical analysis in accordance with the Surveillance Frequency Control Program.

4.9.1.3 Valves isolating unborated water sources** shall be verified closed and secured in position by mechanical stops or by removal of air or electrical power in accordance with the Surveillance Frequency Control Program.

* The reactor shall be maintained in MODE 6 whenever fuel is in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

** The primary water supply to the boric acid blender may be opened under administrative controls for makeup.

REFUELING OPERATIONS

3/4.9.2 INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.9.2 As a minimum, one primary Source Range Neutron Flux Monitor with continuous visual indication in the control room and audible indication in the containment and control room, and one of the remaining three Source Range Neutron Flux Monitors (one primary or one of the two backup monitors) with continuous visual indication in the control room shall be OPERABLE.

APPLICABILITY: MODE 6.

ACTION:

- a. With one of the above required monitors inoperable or not operating, immediately suspend all operations involving CORE ALTERATIONS or positive reactivity changes.
- b. With both of the above required monitors inoperable or not operating, determine the boron concentration of the Reactor Coolant System at least once per 12 hours.

SURVEILLANCE REQUIREMENTS

4.9.2 Each required Source Range Neutron Flux Monitor shall be demonstrated OPERABLE by performance of:

- a. A CHANNEL CHECK in accordance with the Surveillance Frequency Control Program,
- b. An ANALOG CHANNEL OPERATIONAL TEST within 8 hours prior to the initial start of CORE ALTERATIONS, and
- c. An ANALOG CHANNEL OPERATIONAL TEST in accordance with the Surveillance Frequency Control Program.

REFUELING OPERATIONS

3/4.9.3 DECAY TIME

LIMITING CONDITION FOR OPERATION

3.9.3 The reactor shall be subcritical for at least 72 hours.

APPLICABILITY: During movement of irradiated fuel in the reactor vessel.

ACTION:

With the reactor subcritical for less than 72 hours, suspend all operations involving movement of irradiated fuel in the reactor vessel.

SURVEILLANCE REQUIREMENTS

4.9.3 The reactor shall be determined to have been subcritical for at least 72 hours by verification of the date and time of subcriticality prior to movement of irradiated fuel in the reactor vessel.

REFUELING OPERATIONS

3/4.9.4 CONTAINMENT BUILDING PENETRATIONS

LIMITING CONDITION FOR OPERATION

3.9.4 The containment building penetrations shall be in the following status:

- a. The equipment door closed and held in place by a minimum of four bolts.
 - b. A minimum of one door in each airlock is closed, or, both doors of the containment personnel airlock may be open if:
 - 1) at least one personnel airlock door is capable of being closed.
 - 2) The plant is in MODE 6 with at least 23 feet of water above the reactor vessel flange, and
 - 3) a designated individual is available outside the personnel airlock to close the door.
 - c. Each penetration providing direct access from the containment atmosphere to the outside atmosphere shall be either:*
- 1) Closed by an isolation valve, blind flange, or manual valve, or
 - 2) Be capable of being closed by an OPERABLE automatic containment ventilation isolation valve.

APPLICABILITY: During movement of recently irradiated fuel within the containment.

ACTION:

With the requirements of the above specification not satisfied, immediately suspend all operations involving movement of recently irradiated fuel in the containment building.

SURVEILLANCE REQUIREMENTS

4.9.4 Each of the above required containment building penetrations shall be determined to be either in its closed/isolated condition or capable of being closed by an OPERABLE automatic containment ventilation isolation valve within 100 hours prior to the start of and in accordance with the Surveillance Frequency Control Program during movement of recently irradiated fuel in the containment building by:

- a. Verifying the penetrations are in their closed/isolated condition, or
- b. Testing the containment ventilation isolation valves per the applicable portions of Specification 4.6.4.2.

*Exception may be taken under Administrative Controls for opening of certain valves and airlocks necessary to perform surveillance or testing requirements.

REFUELING OPERATIONS

3/4.9.5 DELETED

I

REFUELING OPERATIONS

3/4.9.6 DELETED

3/4.9.7 DELETED

REFUELING OPERATIONS

3/4.9.8 RESIDUAL HEAT REMOVAL AND COOLANT CIRCULATION

HIGH WATER LEVEL

LIMITING CONDITION FOR OPERATION

3.9.8.1 At least one residual heat removal (RHR) loop shall be OPERABLE and in operation.*

APPLICABILITY: MODE 6, when the water level above the top of the reactor vessel flange is greater than or equal to 23 feet.

ACTION:

With no RHR loop OPERABLE and in operation, suspend all operations involving an increase in the reactor decay heat load or a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required RHR loop to OPERABLE and operating status as soon as possible. Close all containment penetrations providing direct access from the containment atmosphere to the outside atmosphere within 4 hours.

SURVEILLANCE REQUIREMENTS

4.9.8.1.1 At least one RHR loop shall be verified in operation and circulating reactor coolant at a flow rate of greater than or equal to 3000 gpm in accordance with the Surveillance Frequency Control Program.

4.9.8.1.2 The RHR flow indicator shall be subjected to a CHANNEL CALIBRATION in accordance with the Surveillance Frequency Control Program.

4.9.8.1.3 Verify required RHR loop locations susceptible to gas accumulation are sufficiently filled with water in accordance with the Surveillance Frequency Control Program.

*The required RHR loop may be removed from operation for up to 1 hour per 8 hour period, provided no operations are permitted that would cause reduction of the Reactor Coolant System boron concentration.

REFUELING OPERATIONS

LOW WATER LEVEL

LIMITING CONDITION FOR OPERATION

3.9.8.2 Two independent residual heat removal (RHR) loops shall be OPERABLE, and at least one RHR loop shall be in operation*.

APPLICABILITY: MODE 6, when the water level above the top of the reactor vessel flange is less than 23 feet.

ACTION:

- a. With less than the required RHR loops OPERABLE, immediately initiate corrective action to return the required RHR loops to OPERABLE status, or to establish greater than or equal to 23 feet of water above the reactor vessel flange, as soon as possible.
- b. With no RHR loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required RHR loop to operation. Close all containment penetrations providing direct access from the containment atmosphere to the outside atmosphere within 4 hours.

SURVEILLANCE REQUIREMENTS

4.9.8.2.1 At least one RHR loop shall be verified in operation and circulating reactor coolant at a flow rate of greater than or equal to 3000 gpm in accordance with the Surveillance Frequency Control Program.

4.9.8.2.2 Verify RHR loop locations susceptible to gas accumulation are sufficiently filled with water in accordance with the Surveillance Frequency Control Program.

* One required RHR loop may be inoperable for up to 2 hours for surveillance testing, provided that the other RHR loop is OPERABLE and in operation.

REFUELING OPERATIONS

3/4.9.9 CONTAINMENT VENTILATION ISOLATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.9.9 The Containment Ventilation Isolation System shall be OPERABLE.

APPLICABILITY: During movement of irradiated fuel within the containment.

ACTION:

- a. With the Containment Ventilation Isolation System inoperable, close each of the containment ventilation penetrations providing direct access from the containment atmosphere to the outside atmosphere.
- b. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.9.9 The Containment Ventilation Isolation System shall be demonstrated OPERABLE within 100 hours prior to the start of and in accordance with the Surveillance Frequency Control Program during movement of irradiated fuel inside the containment by verifying that Containment Ventilation Isolation occurs on a High Radiation test signal from each of the containment radiation monitoring instrumentation channels.

REFUELING OPERATIONS

3/4.9.10 REFUELING CAVITY WATER LEVEL

LIMITING CONDITION FOR OPERATION

3.9.10 Refueling cavity water level shall be maintained \geq 23 feet above the top of the reactor vessel flange.

APPLICABILITY: During movement of irradiated fuel assemblies within containment.

ACTION:

With the refueling cavity water level not within limit, suspend movement of irradiated fuel assemblies within containment immediately.

SURVEILLANCE REQUIREMENTS

4.9.10 Verify refueling cavity water level is \geq 23 feet above the top of the reactor vessel flange within 2 hours prior to the start of and in accordance with the Surveillance Frequency Control Program thereafter during movement of irradiated fuel assemblies within containment.

REFUELING OPERATIONS

3/4.9.11 WATER LEVEL - STORAGE POOL

LIMITING CONDITION FOR OPERATION

3.9.11 The water level shall be maintained greater than or equal to elevation 56' - 10" the spent fuel storage pool.*

APPLICABILITY: Whenever irradiated fuel assemblies are in the storage pool.

ACTION:

- a. With the requirements of the above specification not satisfied, suspend all movement of fuel assemblies and crane operations with loads in the fuel storage areas.
- b. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

4.9.11 The water level in the storage pool shall be determined to be at least its minimum required depth in accordance with the Surveillance Frequency Control Program when irradiated fuel assemblies are in the fuel storage pool.

3/4.9.12 DELETED

REFUELING OPERATIONS

3/4.9.13 RADIATION MONITORING

LIMITING CONDITION FOR OPERATION

3.9.13 The Containment Radiation monitors which initiate containment ventilation isolation shall be OPERABLE. |

APPLICABILITY: During movement of irradiated fuel within the containment. |

ACTION:

- a) With one or both radiation monitors inoperable, operation may continue provided the containment ventilation isolation valves are maintained closed.

SURVEILLANCE REQUIREMENTS

4.9.13 Each Containment Radiation monitor shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and ANALOG CHANNEL OPERATIONAL TEST at the frequencies shown in Table 4.3-3.

REFUELING OPERATIONS

3/4.9.14 SPENT FUEL STORAGE

LIMITING CONDITION FOR OPERATION

3.9.14 The following conditions shall apply to spent fuel storage:

- a. The minimum boron concentration in the Spent Fuel Pit shall be 2300 ppm.
- b. The combination of initial enrichment, burnup, and cooling time of each fuel assembly stored in the Spent Fuel Pit shall be in accordance with Specification 5.5.1.

APPLICABILITY: At all times when fuel is stored in the Spent Fuel Pit.

ACTION:

- a. With boron concentration in the Spent Fuel Pit less than 2300 ppm, suspend movement of spent fuel in the Spent Fuel Pit and initiate action to restore boron concentration to 2300 ppm or greater.
- b. With condition b not satisfied, suspend movement of additional fuel assemblies into the Spent Fuel Pit and restore the spent fuel storage configuration to within the specified conditions.
- c. The provisions of Specification 3.0.3 are not applicable.

SURVEILLANCE REQUIREMENTS

- 4.9.14.1 The boron concentration of the Spent Fuel Pit shall be verified to be 2300 ppm or greater in accordance with the Surveillance Frequency Control Program.
- 4.9.14.2 A representative sample of inservice Metamic inserts shall be visually inspected in accordance with the Metamic Surveillance Program described in UFSAR Section 16.2. The surveillance program ensures that the performance requirements of Metamic are met over the surveillance interval.

3/4.10 SPECIAL TEST EXCEPTIONS

3/4.10.1 SHUTDOWN MARGIN

LIMITING CONDITION FOR OPERATION

3.10.1 The SHUTDOWN MARGIN requirement of Specification 3.1.1.1 may be suspended for measurement of control rod worth and SHUTDOWN MARGIN provided reactivity equivalent to at least the highest estimated control rod worth is available for trip insertion from OPERABLE control rod(s).

APPLICABILITY: MODE 2.

ACTION:

- a. With any full-length control rod not fully inserted and with less than the above reactivity equivalent available for trip insertion, immediately initiate and continue boration at greater than or equal to 16 gpm of a solution containing greater than or equal to 3.0 wt% (5245 ppm) boron or its equivalent until the SHUTDOWN MARGIN required by Specification 3.1.1.1 is restored.
- b. With all full-length control rods fully inserted and the reactor subcritical by less than the above reactivity equivalent, immediately initiate and continue boration at greater than or equal to 16 gpm of a solution containing greater than or equal to 3.0 wt% (5245 ppm) boron or its equivalent until the SHUTDOWN MARGIN required by Specification 3.1.1.1 is restored.

SURVEILLANCE REQUIREMENTS

4.10.1.1 The position of each full-length control rod either partially or fully withdrawn shall be determined in accordance with the Surveillance Frequency Control Program.

4.10.1.2 Each full-length control rod not fully inserted shall be demonstrated capable of full insertion when tripped from at least the 50% withdrawn position within 7 days prior to reducing the SHUTDOWN MARGIN to less than the limits of Specification 3.1.1.1.

SPECIAL TEST EXCEPTIONS

3/4.10.2 GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS

LIMITING CONDITION FOR OPERATION

3.10.2 The group height, insertion, and power distribution limits of Specifications 3.1.3.1, 3.1.3.5, 3.1.3.6, 3.2.1, and 3.2.4 may be suspended during the performance of PHYSICS TESTS provided:

- a. The THERMAL POWER is maintained less than or equal to 85% of RATED THERMAL POWER, and
- b. The limits of Specifications 3.2.2 and 3.2.3 are maintained and determined at the frequencies specified in Specification 4.10.2.2 below.

APPLICABILITY: MODE 1.

ACTION:

With any of the limits of Specification 3.2.2 or 3.2.3 being exceeded while the requirements of Specifications 3.1.3.1, 3.1.3.5, 3.1.3.6, 3.2.1, and 3.2.4 are suspended, either:

- a. Reduce THERMAL POWER sufficient to satisfy the ACTION requirements of Specifications 3.2.2 and 3.2.3, or
- b. Be in HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

4.10.2.1 The THERMAL POWER shall be determined to be less than or equal to 85% of RATED THERMAL POWER in accordance with the Surveillance Frequency Control Program during PHYSICS TESTS.

4.10.2.2 The requirements of the below listed specifications shall be performed in accordance with the Surveillance Frequency Control Program during PHYSICS TESTS:

- a. Specifications 4.2.2.1 and 4.2.2.5, and
- b. Specification 4.2.3.3.

SPECIAL TEST EXCEPTIONS

3/4.10.3 PHYSICS TESTS

LIMITING CONDITION FOR OPERATION

3.10.3 The limitations of Specifications 3.1.1.3, 3.1.1.4, 3.1.3.1, 3.1.3.5, and 3.1.3.6 may be suspended during the performance of PHYSICS TESTS provided:

- a. The THERMAL POWER does not exceed 5% of RATED THERMAL POWER,
- b. The Reactor Trip Setpoints on the OPERABLE Intermediate and Power Range channels are set at less than or equal to 25% of RATED THERMAL POWER, and
- c. The Reactor Coolant System lowest operating loop temperature (T_{avg}) is greater than or equal to 531°F.

APPLICABILITY: MODE 2.

ACTION:

- a. With the THERMAL POWER greater than 5% of RATED THERMAL POWER, immediately open the Reactor trip breakers.
- b. With a Reactor Coolant System operating loop temperature (T_{avg}) less than 531°F, restore T_{avg} to within its limit within 15 minutes or be in at least HOT STANDBY within the next 15 minutes.

SURVEILLANCE REQUIREMENTS

4.10.3.1 The THERMAL POWER shall be determined to be less than or equal to 5% of RATED THERMAL POWER in accordance with the Surveillance Frequency Control Program during PHYSICS TESTS.

4.10.3.2 Each Intermediate and Power Range channel shall be subjected to an ANALOG CHANNEL OPERATIONAL TEST within 12 hours prior to initiating PHYSICS TESTS.

4.10.3.3 The Reactor Coolant System temperature (T_{avg}) shall be determined to be greater than or equal to 531°F in accordance with the Surveillance Frequency Control Program during PHYSICS TESTS.

3/4.10.4 (This specification number is not used)

SPECIAL TEST EXCEPTIONS

3/4.10.5 POSITION INDICATION SYSTEM - SHUTDOWN

LIMITING CONDITION FOR OPERATION

3.10.5 The limitations of Specification 3.1.3.3 may be suspended during the performance of individual full-length shutdown and control rod drop time measurements provided;

- a. Only one shutdown or control bank is withdrawn from the fully inserted position at a time, and
- b. The rod position indicator is OPERABLE during the withdrawal of the rods.

APPLICABILITY: MODES 3, 4, and 5 during performance of rod drop time measurements.

ACTION:

With the Position Indication Systems inoperable or with more than one bank of rods withdrawn, immediately open the Reactor trip breakers.

SURVEILLANCE REQUIREMENTS

4.10.5 The above required Position Indication Systems shall be determined to be OPERABLE within 24 hours prior to the start of and in accordance with the Surveillance Frequency Control Program thereafter during rod drop time measurements by verifying the Demand Position Indication System and the Analog Rod Position Indication System agree:

- a. Within 12 steps when the rods are stationary, and
- b. Within 24 steps during rod motion.

5.0 DESIGN FEATURES

5.1 SITE

- 5.1.1 The site is approximately 25 miles south of Miami, 8 miles east of Florida City, and 9 miles southeast of Homestead, Florida

5.2 DELETED

5.3 REACTOR CORE

FUEL ASSEMBLIES

- 5.3.1 The core shall contain 157 fuel assemblies with each fuel assembly containing 204 fuel rods clad with Zircaloy-4, ZIRLO[®], or Optimized ZIRLO[™] except that replacement of fuel rods by filler rods consisting of stainless steel, or by vacant rod positions, may be made in fuel assemblies if justified by cycle-specific reload analysis using NRC-approved methodology. The reactor core contains approximately 71 metric tons of uranium in the form of natural or slightly enriched uranium dioxide pellets. Each fuel rod shall have a nominal active fuel length of 144 inches.

CONTROL ROD ASSEMBLIES

- 5.3.2 The core shall contain 45 full-length control rod assemblies. The full-length control rod assemblies shall contain a nominal 142 inches of absorber material. The absorber material shall be silver, indium, and cadmium. All control rods shall be clad with stainless steel tubing.

5.4 DELETED

DESIGN FEATURES

5.5 FUEL STORAGE

5.5.1 CRITICALITY

5.5.1.1 The spent fuel storage racks are designed and shall be maintained with:

- a. A k_{eff} less than 1.0 when flooded with unborated water, which includes an allowance for biases and uncertainties as described in UFSAR Chapter 9.
- b. A k_{eff} less than or equal to 0.95 when flooded with water borated to 500 ppm, which includes an allowance for biases and uncertainties as described in UFSAR Chapter 9.
- c. A nominal 10.6 inch center-to-center distance for Region I and 9.0 inch center-to-center distance for Region II for the two region spent fuel pool storage racks. A nominal 10.1 inch center-to-center distance in the east-west direction and a nominal 10.7 inch center-to-center distance in the north-south direction for the cask area storage rack.
- d. A maximum enrichment loading for fuel assemblies of 5.0 weight percent of U-235.
- e. No restriction on storage of fresh or irradiated fuel assemblies in the cask area storage rack.
- f. Fresh or irradiated fuel assemblies not stored in the cask area storage rack shall be stored in accordance with Specification 5.5.1.3.
- g. The Metamic neutron absorber inserts shall have a minimum certified ^{10}B areal density greater than or equal to 0.015 grams $^{10}\text{B}/\text{cm}^2$.

5.5.1.2 The racks for new fuel storage are designed to store fuel in a safe subcritical array and shall be maintained with:

- a. A nominal 21 inch center-to-center spacing to assure k_{eff} equal to or less than 0.98 for optimum moderation conditions and equal to or less than 0.95 for fully flooded conditions.
- b. Fuel assemblies placed in the New Fuel Storage Area shall contain no more than a nominal 4.5 weight percent of U-235 if the assembly contains no burnable absorber rods and no more than 5.0 weight percent of U-235 if the assembly contains at least 16 IFBA rods.

DESIGN FEATURES

- 5.5.1.3 Credit for burnup and cooling time is taken in determining acceptable placement locations for spent fuel in the two-region spent fuel racks. Fresh or irradiated fuel assemblies in the Region I or Region II racks shall be stored in compliance with the following:
- a. Any 2x2 array of Region I storage cells containing fuel shall comply with the storage patterns in Figure 5.5-1 and the requirements of Tables 5.5-1 and 5.5-2, as applicable. The reactivity rank of fuel assemblies in the 2x2 array (rank determined using Table 5.5-3) shall be equal to or less reactive than that shown for the 2x2 array.
 - b. Any 2x2 array of Region II storage cells containing fuel shall:
 - i. Comply with the storage patterns in Figure 5.5-2 and the requirements of Tables 5.5-1 and 5.5-2, as applicable. The reactivity rank of fuel assemblies in the 2x2 array (rank determined using Table 5.5-3) shall be equal to or less reactive than that shown for the 2x2 array,
 - ii. Have the same directional orientation for Metamic inserts in a contiguous group of 2x2 arrays where Metamic inserts are required, and
 - iii. Comply with the requirements of 5.5.1.3.c for cells adjacent to Region I racks.
 - c. Any 2x2 array of Region II storage cells that interface with Region I storage cells shall comply with the rules of Figure 5.5-3.
 - d. Any fuel assembly may be replaced with a fuel rod storage basket or non-fuel hardware.
 - e. Storage of Metamic inserts or RCCAs is acceptable in locations designated as empty (water-filled) cells.

DRAINAGE

- 5.5.2 The spent fuel storage pit is designed and shall be maintained to prevent inadvertent draining of the pool below a level of 6 feet above the fuel assemblies in the storage racks.

CAPACITY

- 5.5.3 The spent fuel storage pool is designed and shall be maintained with a storage capacity limited to no more than 1535 fuel assemblies.

Table 5.5-1

Blanketed Fuel - Coefficients to Calculate the Minimum Required Fuel Assembly Burnup (Bu) as a Function of Enrichment (En) and Cooling Time (Ct)

See notes 1-6 for use of Table 5.5-1

Coeff.	Fuel Category						
	I-3	I-4	II-1	II-2	II-3	II-4	II-5
A1	5.66439153	-14.7363682	-7.74060457	-7.63345029	24.4656526	8.5452608	26.2860949
A2	-7.22610116	11.0284547	5.13978237	10.7798957	-20.3141124	-4.47257395	-18.0738662
A3	2.98646188	-1.80672781	-0.360186309	-2.81231555	6.53101471	2.09078914	5.8330891
A4	-0.287945644	0.119516492	0.0021681285	0.29284474	-0.581826027	-0.188280562	-0.517434342
A5	-0.558098618	0.0620559676	-0.0304713673	0.0795058096	-0.16567492	0.157548739	-0.0614152031
A6	0.476169245	0.0236575787	0.098844889	-0.0676341983	0.243843226	-0.0593584027	0.134626308
A7	-0.117591963	-0.0088144551	-0.0277584786	0.0335130877	-0.0712130368	0.0154678626	-0.0383060399
A8	0.0095165354	0.0008957348	0.0024057185	-0.0040803875	0.0063998706	-0.0014068318	0.0033419846
A9	-47.1782783	-20.2890089	-21.424984	14.6716317	-41.1150	-0.881964768	-12.1780
A10	33.4270029	14.7485847	16.255208	-10.0312224	43.9149156	9.69128392	23.6179517
A11	-6.11257501	-1.22889103	-1.77941882	5.62580894	-9.6599923	-0.18740168	-4.10815592
A12	0.490064351	0.0807808548	0.127321203	-0.539361868	0.836931842	0.0123398618	0.363908736

Notes:

1. All relevant uncertainties are explicitly included in the criticality analysis. For instance, no additional allowance for burnup uncertainty or enrichment uncertainty is required. For a fuel assembly to meet the requirements of a Fuel Category, the assembly burnup must exceed the "minimum burnup" (GWd/MTU) given by the curve fit for the assembly "cooling time" and "initial enrichment." The specific minimum burnup required for each fuel assembly is calculated from the following equation:

$$Bu = (A_1 + A_2 \cdot En + A_3 \cdot En^2 + A_4 \cdot En^3) \cdot \exp [- (A_5 + A_6 \cdot En + A_7 \cdot En^2 + A_8 \cdot En^3) \cdot Ct] + A_9 + A_{10} \cdot En + A_{11} \cdot En^2 + A_{12} \cdot En^3$$

2. Initial enrichment, En, is the nominal central zone U-235 enrichment. Axial blanket material is not considered when determining enrichment. Any enrichment between 2.0 and 5.0 may be used.
3. Cooling time, Ct, is in years. Any cooling time between 0 years and 25 years may be used. An assembly with a cooling time greater than 25 years must use 25 years.
4. DELETED
5. DELETED
6. This Table applies for any blanketed fuel assembly.

Table 5.5-2

**Non-Blanketed Fuel - Coefficients to Calculate the Minimum Required Fuel Assembly Burnup (Bu) as a Function of
Enrichment (En) and Cooling Time (Ct)**
See notes 1-4 for use of Table 5.5-2

Coeff.	Fuel Category						
	I-3	I-4	II-1	II-2	II-3	II-4	II-5
A1	2.04088171	-27.6637884	-11.2686777	20.7284208	29.8862876	-83.5409405	35.5058622
A2	-4.83684164	26.1997193	2.0659501	11.9673275	-37.0771132	94.7973724	-30.1986997
A3	2.59801889	-7.2982252	2.66204924	-14.4072388	16.3986049	-31.9583373	11.0102438
A4	-0.300597247	0.723731768	-0.513334362	2.83623963	-2.1571669	3.55898487	-1.27269125
A5	-0.610041808	0.401332891	-0.0987986108	-1.49118695	1.02330848	0.299948492	1.34723758
A6	0.640497159	-0.418616707	-0.0724198633	1.75361041	-1.21889631	-0.312341996	-1.19871392
A7	-0.219000712	0.144304039	0.106248806	-0.659046438	0.467440882	0.107463895	0.352920811
A8	0.0252870451	-0.0154239536	-0.0197359109	0.080884618	-0.0560129443	-0.0108814287	-0.0325155213
A9	-4.48207836	-5.54507376	-1.34620551	-245.825283	12.1549	39.4975573	-5.2576
A10	-2.12118634	-5.76555416	-10.1728821	243.59979	-22.7755385	-50.5818253	10.1733379
A11	2.91619317	6.29118025	8.71968815	-75.7805818	14.3755458	23.3093829	0.369083041
A12	-0.196645176	-0.732079719	-1.14461356	8.10936356	-1.80803352	-2.69466612	0.0443577624

Notes:

1. All relevant uncertainties are explicitly included in the criticality analysis. For instance, no additional allowance for burnup uncertainty or enrichment uncertainty is required. For a fuel assembly to meet the requirements of a Fuel Category, the assembly burnup must exceed the "minimum burnup" (GWd/MTU) given by the curve fit for the assembly "cooling time" and "initial enrichment." The specific minimum burnup required for each fuel assembly is calculated from the following equation:

$$Bu = (A_1 + A_2 \cdot En + A_3 \cdot En^2 + A_4 \cdot En^3) \cdot \exp [- (A_5 + A_6 \cdot En + A_7 \cdot En^2 + A_8 \cdot En^3) \cdot Ct] + A_9 + A_{10} \cdot En + A_{11} \cdot En^2 + A_{12} \cdot En^3$$
2. Initial enrichment, En, is the nominal U-235 enrichment. Any enrichment between 1.8 and 4.0 may be used.
3. Cooling time, Ct, is in years. Any cooling time between 15 years and 25 years may be used. An assembly with a cooling time greater than 25 years must use 25 years.
4. This Table applies only for pre-EPU non-blanketed fuel assemblies. If a non-blanketed assembly is depleted at EPU conditions, none of the burnup accrued at EPU conditions can be credited (i.e., only burnup accrued at pre-EPU conditions may be used as burnup credit).

Table 5.5-3

Fuel Categories Ranked by Reactivity

See notes 1-5 for use of Table 5.5-3

Region I	I-1	High Reactivity
	I-2	
	I-3	
	I-4	
Region II	II-1	High Reactivity
	II-2	
	II-3	
	II-4	
	II-5	Low Reactivity

Notes:

1. Fuel Category is ranked by decreasing order of reactivity without regard for any reactivity-reducing mechanisms, e.g., Category I-2 is less reactive than Category I-1, etc. The more reactive fuel categories require compensatory measures to be placed in Regions I and II of the SFP, e.g., use of water filled cells, Metamic inserts, or full length RCCAs.
2. Any higher numbered fuel category can be used in place of a lower numbered fuel category from the same Region.
3. Category I-1 is fresh unburned fuel up to 5.0 wt% U-235 enrichment.
4. Category I-2 is fresh unburned fuel that obeys the IFBA requirements of Table 5.5-4.
5. All Categories except I-1 and I-2 are determined from Tables 5.5-1 and 5.5-2.

Table 5.5-4

IFBA Requirements for Fuel Category I-2

Nominal Enrichment (wt% U-235)	Minimum Required Number of IFBA Pins
Enr. \leq 4.3	0
4.3 < Enr. \leq 4.4	32
4.4 < Enr. \leq 4.7	64
4.7 < Enr. \leq 5.0	80

FIGURE 5.5-1

ALLOWABLE REGION I STORAGE ARRAYS

See notes 1-8 for use of Figure 5.5-1

DEFINITION

Array I-A

Checkerboard pattern of Category I-1 assemblies and empty (water-filled) cells.

I-1	X
X	I-1

Array I-B

Category I-4 assembly in every cell.

I-4	I-4
I-4	I-4

Array I-C

Combination of Category I-2 and I-4 assemblies. Each Category I-2 assembly shall contain a full length RCCA.

I-2	I-4
I-4	I-4

I-2	I-2
I-4	I-4

I-2	I-2
I-2	I-4

I-2	I-2
I-2	I-2

Array I-D

Category I-3 assembly in every cell. One of every four assemblies contains a full length RCCA.

I-3	I-3
I-3	I-3

Notes:

1. In all arrays, an assembly of lower reactivity can replace an assembly of higher reactivity.
2. Category I-1 is fresh unburned fuel up to 5.0 wt% U-235 enrichment.
3. Category I-2 is fresh unburned fuel that obeys the IFBA requirements in Table 5.5-4.
4. Categories I-3 and I-4 are determined from Tables 5.5-1 and 5.5-2.
5. Shaded cells indicate that the fuel assembly contains a full length RCCA.
6. X indicates an empty (water-filled) cell.
7. Attributes for each 2x2 array are as stated in the definition. Diagram is for illustrative purposes only.
8. An empty (water-filled) cell may be substituted for any fuel containing cell in all storage arrays.

FIGURE 5.5-2

ALLOWABLE REGION II STORAGE ARRAYS

See notes 1-6 for use of Figure 5.5-2

DEFINITION

Array II-A

Category II-1 assembly in three of every four cells;
one of every four cells is empty (water-filled);
the cell diagonal from the empty cell contains a Metamic insert
or full length RCCA.

ILLUSTRATION

II-1	II-1
X	II-1

X	II-1
II-1	II-1

Array II-B

Checkerboard pattern of Category II-3 and II-5 assemblies with
two of every four cells containing a Metamic insert or full length
RCCA.

II-3	II-5
II-5	II-3

II-3	II-5
II-5	II-3

Array II-C

Category II-4 assembly in every cell with two of every four cells
containing a Metamic insert or full length RCCA.

II-4	II-4
II-4	II-4

II-4	II-4
II-4	II-4

Array II-D

Category II-2 assembly in every cell with three of every four cells
containing a Metamic insert or full length RCCA.

II-2	II-2
II-2	II-2

Notes:

1. In all arrays, an assembly of lower reactivity can replace an assembly of higher reactivity.
2. Fuel categories are determined from Tables 5.5-1 and 5.5-2.
3. Shaded cells indicate that the cell contains a Metamic insert or the fuel assembly contains a full length RCCA.
4. **X** indicates an empty (water-filled) cell.
5. Attributes for each 2x2 array are as stated in the definition. Diagram is for illustrative purposes only.
6. An empty (water-filled) cell may be substituted for any fuel containing cell in all storage arrays.

FIGURE 5.5-3

INTERFACE RESTRICTIONS BETWEEN REGION I AND REGION II ARRAYS

See notes 1-8 for use of Figure 5.5-3

DEFINITION

Array II-A, as defined in Figure 5.5-2, when placed on the interface with Region I shall have the empty cell in the row adjacent to the Region I rack.

ILLUSTRATION

Region I Rack

I-4	I-4	I-4	I-4
I-4	I-4	I-4	I-4
II-1	X	II-1	X
II-1	II-1	II-1	II-1

Array II-A

Arrays II-B, II-C and II-D, as defined in Figure 5.5-2, when placed on the interface with Region I shall have an insert in every cell in the row adjacent to the Region I rack.

Region I Rack

I-4	I-4	I-4	I-4
I-4	I-4	I-4	I-4
II-3	II-5	II-3	II-5
II-5	II-3	II-5	II-3

Array II-B

Region I Rack

I-4	I-4	I-4	I-4
I-4	I-4	I-4	I-4
II-4	II-4	II-4	II-4
II-4	II-4	II-4	II-4

Array II-C

Region I Rack

I-4	I-4	I-4	I-4
I-4	I-4	I-4	I-4
II-2	II-2	II-2	II-2
II-2	II-2	II-2	II-2

Array II-D

Notes:

1. In all arrays, an assembly of lower reactivity can replace an assembly of higher reactivity.
2. Fuel categories are determined from Tables 5.5-1 and 5.5-2.
3. Shaded cells indicate that the cell contains a Metamic insert or the fuel assembly contains a full length RCCA.
4. X indicates an empty (water-filled) cell.
5. Attributes for each 2x2 array are as stated in the definition. Diagram is for illustrative purposes only. Region I Array I-B is depicted as the example; however, any Region I array is allowed provided that
 - a. For Array I-D, the RCCA shall be in the row adjacent to the Region II rack, and
 - b. Array I-A shall not interface with Array II-D.
6. If no fuel is stored adjacent to Region II in Region I, then the interface restrictions are not applicable.
7. Figure 5.5-3 is applicable only to the Region I - Region II interface. There are no restrictions for the interfaces with the cask area rack.
8. An empty (water-filled) cell may be substituted for any fuel containing cell in all storage arrays.

SECTION 6.0
ADMINISTRATIVE CONTROLS

ADMINISTRATIVE CONTROLS

6.1 RESPONSIBILITY

- 6.1.1 The plant manager shall be responsible for overall unit operation of both units and shall delegate in writing the succession to this responsibility during his absence.
- 6.1.2 The Shift Manager (SM) shall be responsible for the control room command function. During any absence of the SM from the control room while either unit is in MODE 1, 2, 3, or 4, an individual with an active Senior Reactor Operator (SRO) license shall be designated to assume the control room command function. During any absence of the SM from the control room while both units are in MODE 5 or 6, an individual with an active SRO license or Reactor Operator license shall be designated to assume the control room command function.

6.2 ORGANIZATION

ONSITE AND OFFSITE ORGANIZATION

- 6.2.1 An onsite and an offsite organization shall be established for facility operation and corporate management. The onsite and offsite organization shall include the positions for activities affecting the safety of the nuclear power plant.
- a. Lines of authority, responsibility and communication shall be established and defined from the highest management levels through intermediate levels to, and including all operating organization positions. Those relationships shall be documented and updated, as appropriate, in the form of organizational charts. These organizational charts will be documented in the Quality Assurance Topical Report and updated in accordance with 10 CFR 50.54(a)(3).
 - b. The Chief Nuclear Officer shall have corporate responsibility for overall plant nuclear safety, and shall take any measures needed to ensure acceptable performance of the staff in operating, maintaining, and providing technical support to the plant to ensure nuclear safety.
 - c. The plant manager shall be responsible for overall plant safe operation and shall have control over those onsite activities necessary for safe operation and maintenance of the plant.
 - d. Although the individuals who train the operating staff and those who carry out the quality assurance functions may report to the appropriate manager onsite, they shall have sufficient organizational freedom to be independent from operating pressures.
 - e. Although health physics individuals may report to any appropriate manager onsite, for matters relating to radiological health and safety of employees and the public, the Health Physics Supervisor shall have direct access to that onsite individual having responsibility for overall unit management. Health physics personnel shall have the authority to cease any work activity when worker safety is jeopardized or in the event of unnecessary personnel radiation exposures.

ADMINISTRATIVE CONTROLS

PLANT STAFF

6.2.2 The plant organization shall be subject to the following:

- a. Each on-duty shift shall be composed of at least the minimum shift crew composition shown in Table 6.2-1;
- b. DELETED
- c. At least two licensed Operators shall be present in the control room during reactor startup, scheduled reactor shutdown, and during recovery from reactor trips. In addition, while either unit is in MODE 1, 2, 3, or 4, at least one licensed Senior Operator shall be in the control room;
- d. A Health Physics Technician* shall be on site when fuel is in the reactor;
- e. All CORE ALTERATIONS shall be observed and directly supervised by either a licensed Senior Operator or licensed Senior Operator Limited to Fuel Handling who has no other concurrent responsibilities during this operation; and
- f. DELETED
- h. The Assistant Operations Manager - Line shall hold a Senior Reactor Operator License.
- i. The Operations Manager shall either:
 - 1. hold or have held a Senior Reactor Operator License on the Turkey Point Plant; or,
 - 2. have held a Senior Reactor Operator License on a similar plant (i.e., another pressurized water reactor); or
 - 3. have completed the Turkey Point Plant Senior Management Operations Training Course. (i.e., certified at an appropriate simulator for equivalent senior operator knowledge level.)

* The Health Physics Technician composition may be less than the minimum requirements for a period of time not to exceed 2 hours, in order to accommodate unexpected absence, provided immediate action is taken to fill the required positions.

ADMINISTRATIVE CONTROLS

TABLE 6.2-1

MINIMUM SHIFT CREW COMPOSITION

POSITION	NUMBER OF INDIVIDUALS REQUIRED TO FILL POSITION		
	BOTH UNITS IN MODE 1, 2, 3, or 4	BOTH UNITS IN MODE 5 or 6 OR DEFUELED	ONE UNIT IN MODE 1, 2, 3, or 4 AND ONE UNIT IN MODE 5 or 6 or DEFUELED
SM	1	1	1
SRO	1	none**	1
RO	3*	2*	3*
AO	3*	3*	3*
STA	1***	none	1***

SM - Shift Manager with a Senior Operator license

SRO - Individual with a Senior Operator license

RO - Individual with an Operator license

AO - Auxiliary Operator

STA - Shift Technical Advisor

The shift crew composition may be one less than the minimum requirements of Table 6.2-1 for a period of time not to exceed 2 hours in order to accommodate unexpected absence of on-duty shift crew members provided immediate action is taken to restore the shift crew composition to within the minimum requirements of Table 6.2-1. This provision does not permit any shift crew position to be unmanned upon shift change due to an oncoming shift crewman being late or absent.

* At least one of the required individuals must be assigned to the designated position for each unit.

** At least one licensed Senior Operator or licensed Senior Operator Limited to Fuel Handling must be present during CORE ALTERATIONS on either unit, who has no other concurrent responsibilities.

*** The STA position may be filled by the SM or an individual with a Senior Operator license who meets the 1985 NRC Policy Statement on Engineering Expertise on Shift.

ADMINISTRATIVE CONTROLS

6.2.3 SHIFT TECHNICAL ADVISOR FUNCTION

- 6.2.3.1 An individual shall provide advisory technical support to the unit operations shift crew in the areas of thermal hydraulics, reactor engineering, and plant analysis with regard to the safe operation of the unit and the opposite unit. This individual shall meet the qualifications specified by the 1985 NRC Policy Statement on Engineering Expertise on Shift.

6.3 FACILITY STAFF QUALIFICATIONS

- 6.3.1 Each member of the facility staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971 for comparable positions, except for
- 6.3.1.1 The Health Physics Supervisor who shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975.
- 6.3.1.2 The Operations Manager whose requirement for a Senior Reactor Operator License is as stated in Specification 6.2.2.i.
- 6.3.1.3 The licensed operators, who shall comply only with the requirements of 10 CFR 55.
- 6.3.1.4 The Multi-Discipline Supervisors who shall meet or exceed the following requirements:
- a. Education: Minimum of a high school diploma or equivalent
 - b. Experience: Minimum of four years of related technical experience, which shall include three years power plant experience of which one year is at a nuclear power plant
 - c. Training: Complete the Multi-Discipline Supervisor training program
- 6.3.2 When the Health Physics Supervisor does not meet the above requirements, compensatory action shall be taken which the Plant Nuclear Safety Committee determines and the NRC office of Nuclear Reactor Regulation concurs that the action meets the intent of Specification 6.3.1.
- 6.3.3 For the purpose of 10 CFR 55.4, a licensed Senior Reactor Operator and a licensed reactor operator are those individuals who, in addition to meeting the requirements of 6.3.1.3, perform the functions described in 10 CFR 50.54(m)

6.4 DELETED

6.5 DELETED

6.6 DELETED

6.7 DELETED

ADMINISTRATIVE CONTROLS

6.8 PROCEDURES AND PROGRAMS

6.8.1 Written procedures shall be established, implemented, and maintained covering the activities referenced below:

- a. The applicable procedures required by the Quality Assurance Topical Report.
- b. The emergency operating procedures required to implement the requirements of NUREG-0737 and Supplement 1 to NUREG-0737 as stated in Generic Letter No. 82-33;
- c. Process Control Program implementation;
- d. Offsite Dose Calculation Manual implementation;
- e. Quality Control Program for effluent monitoring using the guidance in Regulatory Guide 1.21, Revision 1, June 1974;
- f. DELETED
- g. Quality Control Program for environmental monitoring using the guidance in Regulatory Guide 4.1, Revision 1, April 1975; and
- h. Diesel Fuel Oil Testing Program implementation.

6.8.2 DELETED

6.8.3 DELETED

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

6.8.4 The following programs shall be established, implemented, and maintained:

a. Primary Coolant Sources Outside Containment

A program to reduce leakage from those portions of systems outside containment that could contain highly radioactive fluids during a serious transient or accident to as low as practical levels. The systems include the Safety Injection System, Chemical and Volume Control System, and the Containment Spray System. The program shall include the following:

- (1) Preventive maintenance and periodic visual inspection requirements, and
- (2) Integrated leak test requirements for each system at every 18 months.

The provisions of Specification 4.0.2 are applicable.

b. DELETED

c. Secondary Water Chemistry

A program for monitoring of secondary water chemistry to inhibit steam generator tube degradation. This program shall include:

- (1) Identification of a sampling schedule for the critical variables and control points for these variables,
- (2) Identification of the procedures used to measure the values of the critical variables,

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

- (3) Identification of process sampling points, which shall include monitoring the discharge of the condensate pumps for evidence of condenser in-leakage,
- (4) Procedures for the recording and management of data,
- (5) Procedures defining corrective actions for all off-control point chemistry conditions, and
- (6) A procedure identifying: (a) the authority responsible for the interpretation of the data, and (b) the sequence and timing of administrative events required to initiate corrective action.

d. DELETED

e. Diesel Fuel Oil Testing Program

A diesel fuel oil testing program to implement required testing of both new fuel oil and stored fuel oil shall be established. The program shall include sampling and testing requirements, and acceptance criteria, all in accordance with applicable ASTM Standards. The purpose of the program is to establish the following:

- a. Acceptability of new fuel oil for use prior to addition to storage tanks by determining that the fuel oil has:
 - 1. An API Gravity or an absolute specific gravity within limits,
 - 2. a flash point and kinematic viscosity within limits for Grade No. 2-D fuel oil per ASTM D975, and
 - 3. a clear and bright appearance with proper color;
- b. Other properties for Grade No. 2-D fuel oil per ASTM D975 are within limits within 30 days following sampling and addition to storage tanks; and
- c. Total particulate concentration of the fuel oil is ≤ 10 mg/liter when tested every 31 days in accordance with either ASTM D-2276 or ASTM D-5452.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

f. Radioactive Effluent Controls Program

This program conforms to 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program shall be contained in the ODCM, shall be implemented by procedures, and shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

1. Limitations on the operability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM;
2. Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS, conforming to ten times the concentration values in Appendix B, Table 2, Column 2 to 10 CFR 20.1001-20.2402;
3. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the ODCM;
4. Limitations on the annual and quarterly doses or dose commitment to a member of the public from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS, conforming to 10 CFR 50, Appendix I;
5. Determination of cumulative dose from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days. Determination of projected dose contributions from radioactive effluents in accordance with the methodology in the ODCM at least every 31 days.
6. Limitations on the operability and use of the liquid and gaseous effluent treatment systems to ensure that appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a period of 31 days would exceed 2 percent of the guidelines for the annual dose or dose commitment, conforming to 10 CFR 50, Appendix I;
7. Limitations on the dose rate resulting from radioactive material released in gaseous effluents from the site to areas at or beyond the site boundary shall be in accordance with the following:
 - a. For noble gases: a dose rate less or equal to 500 mrem/yr to the whole body and a dose rate less than or equal to 3000 mrem/yr to the skin, and
 - b. For iodine 131, iodine 133 tritium and all radionuclides in particulate form with half live greater than 8 days: a dose rate less than or equal to 1500 mrem/yr to any organ.
8. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the SITE BOUNDARY, conforming to 10 CFR §50, Appendix I;

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

9. Limitations on the annual and quarterly doses to a member of the public from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives greater than 8 days in gaseous effluents released from each unit to areas beyond the site boundary, conforming to 10 CFR 50, Appendix I;
10. Limitations on the annual dose or dose commitment to any member of the public, beyond the site boundary, due to releases of radioactivity and to radiation from uranium fuel cycle sources, conforming to 40 CFR 190.

The provisions of Specifications 4.0.2 and 4.0.3 are applicable to the Radioactive Effluent Controls Program surveillance frequency.

g. DELETED

h. Containment Leakage Rate Testing Program

A program shall be established to implement the leakage rate testing of the containment as required by 10 CFR 50.54(o) and 10 CFR 50, Appendix J, Option B, and as modified by approved exemptions. This program shall be in accordance with the guidelines contained in Regulatory Guide 1.163, "Performance-Based Containment Leak-Test Program," dated September 1995, as modified by the following deviations or exemptions:

- 1) Type A tests will be performed either in accordance with Bechtel Topical Report BN-TOP-1, Revision 1, dated November 1, 1972, or the guidelines of Regulatory Guide 1.163.
- 2) Type A testing frequency in accordance with NEI 94-01, Revision 0, Section 9.2.3, except:
 - a) For Unit 3, the first Type A test performed after the November 1992 Type A test shall be performed no later than November 2007.
 - b) For Unit 4, the first Type A test performed after October 1991 shall be performed no later than October 2006.
- 3) A vacuum test will be performed in lieu of a pressure test for airlock door seals at the required intervals (Amendment Nos. 73 and 77, issued by NRC November 11, 1981).

The peak calculated containment internal pressure for the design basis loss of coolant accident, P_a , is defined here as the containment design pressure of 55 psig.

The maximum allowable containment leakage rate, L_a , at P_a , shall be 0.20% of containment air weight per day.

Leakage Rate acceptance criteria are:

- 1) The As-found containment leakage rate acceptance criterion is $\leq 1.0 L_a$. Prior to increasing primary coolant temperature above 200°F following testing in accordance with this program or restoration from exceeding $1.0 L_a$, the As-left leakage rate acceptance criterion is $\leq 0.75 L_a$, for Type A test.
- 2) The combined leakage rate for all penetrations subject to Type B or Type C testing is as follows:

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

- The combined As-left leakage rates determined on a maximum pathway leakage rate basis for all penetrations shall be verified to be less than $0.60 L_a$, prior to increasing primary coolant temperature above 200°F following an outage or shutdown that included Type B and Type C testing only.
 - The As-found leakage rates, determined on a minimum pathway leakage rate basis, for all newly tested penetrations when summed with the As-left minimum pathway leakage rate leakage rates for all other penetrations shall be less than $0.6 L_a$, at all times when containment integrity is required.
- 3) Overall air lock leakage acceptance criteria is $\leq 0.05 L_a$, when pressurized to P_a .

The provisions of Specification 4.0.2 do not apply to the test frequencies contained within the Containment Leakage Rate Testing Program.

i. Technical Specifications (TS) Bases Control Program

This program provides a means for processing changes to the Bases of these Technical Specifications.

- a. Changes to the Bases of the TS shall be made under appropriate administrative controls and reviews.
- b. Licensees may make changes to Bases without prior NRC approval provided the changes do not require either of the following:
 - 1. Change in the TS incorporated in the license or
 - 2. A change to the updated FSAR or Bases that requires NRC approval pursuant to 10 CFR 50.59.
- c. The Bases Control Program shall contain provisions to ensure that the Bases are maintained consistent with the FSAR.
- d. Proposed changes that meet the criteria of Specification 6.8.4 i.b. above shall be reviewed and approved by the NRC prior to implementation. Changes to the Bases implemented without prior NRC approval shall be provided to the NRC on a frequency consistent with 10 CFR 50.71(e).

j. Steam Generator (SG) Program

A Steam Generator Program shall be established and implemented to ensure that SG tube integrity is maintained. In addition, the Steam Generator Program shall include the following:

- a. Provisions for condition monitoring assessments. Condition monitoring assessment means an evaluation of the "as found" condition of the tubing with respect to the performance criteria for structural integrity and accident induced leakage. The "as found" condition refers to the condition of the tubing during an SG inspection outage, as determined from the inservice inspection results or by other means, prior to the plugging of tubes. Condition monitoring assessments shall be conducted during each outage during which the SG tubes are inspected or plugged to confirm that the performance criteria are being met..

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

- b. Performance criteria for SG tube integrity. SG tube integrity shall be maintained by meeting the performance criteria for tube structural integrity, accident induced leakage, and operational leakage.
 - 1. Structural integrity performance criterion: All in-service steam generator tubes shall retain structural integrity over the full range of normal operating conditions (including startup, operation in the power range, hot standby, and cooldown), all anticipated transients included in the design specification, and design basis accidents. This includes retaining a safety factor of 3.0 against burst under normal steady state full power operation primary-to-secondary pressure differential and a safety factor of 1.4 against burst applied to the design basis accident primary-to-secondary pressure differentials. Apart from the above requirements, additional loading conditions associated with the design basis accidents, or combination of accidents in accordance with the design and licensing basis, shall also be evaluated to determine if the associated loads contribute significantly to burst or collapse. In the assessment of tube integrity, those loads that do significantly affect burst or collapse shall be determined and assessed in combination with the loads due to pressure with a safety factor of 1.2 on the combined primary loads and 1.0 on axial secondary loads.
 - 2. Accident induced leakage performance criterion: The primary-to-secondary accident induced leakage rate for any design basis accident, other than SG tube rupture, shall not exceed the leakage rate assumed in the accident analysis in terms of total leakage rate for all SGs and leakage rate for an individual SG. Leakage is not to exceed 0.60 gpm total through all SGs and 0.20 gpm through any one SG at room temperature conditions.
 - 3. The operational leakage performance criterion is specified in LCO 3.4.6.2, "Reactor Coolant System Operational Leakage."
- c. Provisions for SG tube plugging criteria. Tubes found by inservice inspection to contain flaws with a depth equal to or exceeding 40% of the nominal tube wall thickness shall be plugged.

The following alternate tube plugging criteria shall be applied as an alternative to the 40% depth based criteria:

- 1. Tubes with service-induced flaws located greater than 18.11 inches below the top of the tubesheet do not require plugging. Tubes with service-induced flaws located in the portion of the tube from the top of the tubesheet to 18.11 inches below the top of the tubesheet shall be plugged upon detection.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

- d. Provisions for SG tube inspections. Periodic SG tube inspections shall be performed. The number and portions of the tubes inspected and methods of inspection shall be performed with the objective of detecting flaws of any type (e.g., volumetric flaws, axial and circumferential cracks) that may be present along the length of the tube, from the tube-to-tubesheet weld at the tube inlet to the tube-to-tubesheet weld at the tube outlet, and that may satisfy the applicable tube plugging criteria. The portion of the tube below 18.11 inches from the top of the tubesheet is excluded from inspection. The tube-to-tubesheet weld is not part of the tube. In addition to meeting the requirements of d.1, d.2, and d.3 below, the inspection scope, inspection methods, and inspection intervals shall be such as to ensure that SG tube integrity is maintained until the next SG inspection. A degradation assessment shall be performed to determine the type and location of flaws to which the tube may be susceptible and, based on this assessment, to determine which inspection methods need to be employed and at what locations.
1. Inspect 100% of the tubes in each SG during the first refueling outage following SG installation.
 2. After the first refueling outage following SG installation, inspect each SG at least every 48 effective full power months or at least every other refueling outage (whichever results in more frequent inspections). In addition, the minimum number of tubes inspected at each scheduled inspection shall be the number of tubes in all SGs divided by the number of SG inspection outages scheduled in each inspection period as defined in a, b, and c below. If degradation assessment indicates the potential for a type of degradation to occur at a location not previously inspected with technique capable of detecting this type of degradation at this location and that may satisfy the applicable tube plugging criteria, the minimum number of locations inspected with such a capable inspection technique during the remainder of the inspection period may be prorated. The fraction of locations to be inspected for this potential type of degradation at this location at the end of the inspection period shall be no less than the ratio of the number of times the SG is scheduled to be inspected in the inspection period after the determination that a new form of degradation could potentially be occurring at this location divided by the total number of times the SG is scheduled to be inspected in the inspection period. Each inspection period defined below may be extended up to 3 effective full power months to include a SG inspection outage in an inspection period and the subsequent inspection period begins at the conclusion of the included SG inspection outage.
 - a) After the first refueling outage following SG installation, inspect 100% of the tubes during the next 120 effective full power months. This constitutes the first inspection period;
 - b) During the next 96 effective full power months, inspect 100% of the tubes. This constitutes the second inspection period; and
 - c) During the remaining life of the SGs, inspect 100% of the tubes every 72 effective full power months. This constitutes the third and subsequent inspection periods.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

3. If crack indications are found in any portion of a SG tube not excluded above, then the next inspection for each affected and potentially affected SG for the degradation mechanism that caused the crack indication shall not exceed 24 effective full power months or one refueling outage (whichever results in more frequent inspections). If definitive information, such as from examination of a pulled tube, diagnostic non-destructive testing, or engineering evaluation indicates that a crack-like indication is not associated with a crack(s), then the indication need not be treated as a crack.
- e. Provisions for monitoring operational primary-secondary leakage.
- k. Control Room Envelope Habitability Program

A Control Room Envelope (CRE) Habitability Program shall be established and implemented to ensure that CRE habitability is maintained such that, with an OPERABLE Control Room Emergency Ventilation System (CREVS), CRE occupants can control the reactor safely under normal conditions and maintain it in a safe condition following a radiological event, hazardous chemical release, or a smoke challenge. The program shall ensure that adequate radiation protection is provided to permit access and occupancy of the CRE under design basis accident (DBA) conditions without personnel receiving radiation exposures in excess of 5 rem total effective dose equivalent (TEDE) for the duration of the accident.

The program shall include the following elements:

- a. The definition of the CRE and the CRE boundary.
- b. Requirements for maintaining the CRE boundary in its design condition including configuration control and preventive maintenance.
- c. Requirements for (i) determining the unfiltered air inleakage past the CRE boundary into the CRE in accordance with the testing methods and at the Frequencies specified in Sections C.1 and C.2 of Regulatory Guide 1.197, "Demonstrating Control Room Envelope Integrity at Nuclear Power Reactors," Revision 0, May 2003, and (ii) assessing CRE habitability at the Frequencies specified in Sections C.1 and C.2 of Regulatory Guide 1.197, Revision 0.
- d. Measurement, at designated locations, of the CRE pressure relative to external areas adjacent to the CRE boundary during the pressurization mode of operation of the CREVS, operating at the flow rate required by Surveillance Requirement 4.7.5.d, at a Frequency of 18 months. Additionally, the supply fans (trains A and B) will be tested on a staggered test basis (defined in Technical Specification definition 1.29 every 36 months). The results shall be trended and the CRE boundary assessed every 18 months.
- e. The quantitative limits on unfiltered air inleakage into the CRE. These limits shall be stated in a manner to allow direct comparison to the unfiltered air inleakage measured by the testing described in paragraph c. The unfiltered air inleakage limit for radiological challenges is the inleakage flow rate assumed in the licensing basis analyses of DBA consequences. Unfiltered air inleakage limits for hazardous chemicals must ensure that exposure of CRE occupants to these hazards will be within the assumptions in the licensing basis.
- f. The provisions of Specification 4.0.2 are applicable to the Frequencies for assessing CRE habitability, determining CRE unfiltered inleakage, and measuring CRE pressure and assessing the CRE boundary as required by paragraphs c and d, respectively.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

I. Surveillance Frequency Control Program

This program provides controls for Surveillance Frequencies. The program shall ensure that Surveillance Requirements specified in the Technical Specifications are performed at intervals sufficient to assure the associated Limiting Conditions for Operations are met:

- a. The Surveillance Frequency Control Program shall contain a list of frequencies of those Surveillance Requirements for which the frequency is controlled by the program.
- b. Changes to the frequencies listed in the Surveillance Frequency Control Program shall be made in accordance with NEI 04-10, "Risk-Informed Method for Control of Surveillance Frequencies," Revision 1.
- c. The provisions of Surveillance Requirements 4.0.2 and 4.0.3 are applicable to the frequencies established in the Surveillance Frequency Control Program.

m. Snubber Testing Program

This program conforms to the examination, testing and service life monitoring for dynamic restraints (snubbers) in accordance with 10 CFR 50.55a inservice inspection (ISI) requirements for supports. The program shall be in accordance with the following:

- a. This program shall meet 10 CFR 50.55a(g) ISI requirements for supports.
- b. The program shall meet the requirements for ISI of supports set forth in subsequent editions of the Code of Record and addenda of the American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel (BPV) Code and the ASME Code for Operation and Maintenance of Nuclear Power Plants (OM Code) that are incorporated by reference in 10 CFR 50.55a(a) subject to the use and conditions on the use of standards listed in 10 CFR 50.55a(b) and subject to Commission approval.
- c. The program shall, as required by 10 CFR 50.55a(b)(3)(v), meet Subsection ISTA, "General Requirements" and Subsection ISTD, "Preservice and Inservice Examination and Testing of Dynamic Restraints (Snubbers) in Light-Water Reactor Nuclear Power Plants".
- d. The 120-month program updates shall be made in accordance with 10 CFR 50.55a(g)(4), 10 CFR 50.55a(g)(3)(v) and 10 CFR 50.55a(b) (including 10 CFR 50.55a(b)(3)(v)) subject to the conditions listed therein.

n. Reactor Coolant Pump Flywheel Inspection Program

Each Reactor Coolant Pump flywheel shall be inspected at least once every 20 years by either conducting an in-place ultrasonic examination over the volume from the inner bore of the flywheel to the circle of one-half the outer radius, or by conducting a surface examination (magnetic particle and/or liquid penetrant) of exposed surfaces of the disassembled flywheel.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

o. Gas Decay Tank Explosive Gas and Radioactivity Monitoring Program

This Program provides controls for potentially explosive gas mixtures and the quantity of radioactivity contained in the Gas Decay Tanks. The gaseous radioactivity quantities shall be determined following the methodology in Branch Technical Position (BTP) ETSB 11-5, Postulated Radioactive Release Due to Waste Gas System Leak or Failure.

The Program shall include:

1. The limits for concentrations of hydrogen and oxygen in the Gas Decay Tanks and a surveillance program to ensure that the limits are maintained. Such limits shall be appropriate to the system's design criteria (i.e., whether or not the system is designed to withstand a hydrogen explosion), and
2. A surveillance program to ensure that the quantity of radioactivity contained in each Gas Decay Tank is less than the amount that would result in a whole body exposure of 0.5 rem to any individual in an unrestricted area, in the event of an uncontrolled release of the tanks' contents.

The provision of SR 4.0.2 and SR 4.0.3 are applicable to the Gas Decay Tank Explosive Gas and Radioactivity Monitoring Program surveillance frequencies.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

p. Risk Informed Completion Time Program

This program provides controls to calculate a Risk Informed Completion Time (RICT) and must be implemented in accordance with NEI 06-09, "Risk-Informed Technical Specifications Initiative 4b: Risk-Managed Technical Specifications (RMTS) Guidelines," Revision 0-A, November 2006. The program shall include the following:

- a. The RICT may not exceed 30 days;
- b. A RICT may only be utilized in MODES 1 and 2;
- c. When a RICT is being used, any plant configuration change within the scope of the Risk Informed Completion Time Program must be considered for the effect on the RICT.
 1. For planned changes, the revised RICT must be determined prior to implementation of the change in configuration.
 2. For emergent conditions, the revised RICT must be determined within the time limits of the Required Action Completion Time (i.e., not the RICT) or 12 hours after the plant configuration change, whichever is less.
 3. Revising the RICT is not required if the plant configuration change would lower plant risk and would result in a longer RICT.
- d. Use of a RICT is not permitted for entry into a configuration which represents a loss of a specified safety function or inoperability of all required trains of a system required to be OPERABLE.
- e. If the extent of condition evaluation for inoperable structures, systems, or components (SSCs) is not complete prior to exceeding the Completion Time, the RICT shall account for the increased possibility of common cause failure (CCF) by either:
 1. Numerically accounting for the increased possibility of CCF in the RICT calculation, or
 2. Risk Management Actions (RMAs) not already credited in the RICT calculation shall be implemented that support redundant or diverse SSCs that perform the function(s) of the inoperable SSCs, and, if practicable, reduce the frequency of initiating events that challenge the function(s) performed by the inoperable SSCs.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

q. Safety Function Determination Program (SFDP)

This program ensures loss of safety function is detected and appropriate actions taken. Upon entry into LCO 3.0.7, an evaluation shall be made to determine if loss of safety function exists. Additionally, other appropriate actions may be taken as a result of the support system inoperability and corresponding exception to entering supported system ACTIONS. This program implements the requirements of LCO 3.0.7. The SFDP shall contain the following:

- a. Provisions for cross train checks to ensure a loss of the capability to perform the safety function assumed in the accident analysis does not go undetected,
- b. Provisions for ensuring the plant is maintained in a safe condition if a loss of function condition exists,
- c. Provisions to ensure that an inoperable supported system's allowed outage time is not inappropriately extended as a result of multiple support system inoperabilities, and
- d. Other appropriate limitations and remedial or compensatory actions.

A loss of safety function exists when, assuming no concurrent single failure, no concurrent loss of offsite power, or no concurrent loss of onsite diesel generator(s), a safety function assumed in the accident analysis cannot be performed. For the purpose of this program, a loss of safety function may exist when a support system is inoperable, and:

- a. A required system redundant to the system(s) supported by the inoperable support system is also inoperable, or
- b. A required system redundant to the system(s) in turn supported by the inoperable supported system is also inoperable, or
- c. A required system redundant to the support system(s) for the supported systems (a) and (b) above is also inoperable.

The SFDP identifies where a loss of safety function exists. If a loss of safety function is determined to exist by this program, the appropriate ACTIONS of the LCO in which the loss of safety function exists are required to be entered. When a loss of safety function is caused by the inoperability of a single Technical Specification support system, the appropriate ACTIONS to enter are those of the support system.

6.8.5 DELETED

ADMINISTRATIVE CONTROLS

6.9 REPORTING REQUIREMENTS

ROUTINE REPORTS

6.9.1 In addition to the applicable reporting requirements of Title 10, Code of Federal Regulations, the following reports shall be submitted to the U.S. Nuclear Regulatory Commission, Document Control Desk, Washington, DC pursuant to 10 CFR 50.4.

6.9.1.1 Deleted

6.9.1.2 Deleted

ADMINISTRATIVE CONTROLS

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT*

6.9.1.3 The Annual Radiological Environmental Operating Report covering the operation of the unit during the previous calendar year shall be submitted by May 15 of each year. The report shall include summaries, interpretations, and analyses of trends of the results of the radiological environmental monitoring program for the reporting period. The material provided shall be consistent with the objectives outlined in (1) the Offsite Dose Calculation Manual (ODCM), and in (2) 10 CFR 50, Appendix I, Sections IV.B.2, IV.B.3, and IV.C.

The Annual Radiological Environmental Operating Report shall include the results of analyses of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the table and figures in the ODCM, as well as summarized and tabulated results of these analyses and measurements. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted in a supplementary report as soon as possible.

6.9.1.4 RADIOACTIVE EFFLUENT RELEASE REPORT**

The Radioactive Effluent Release Report covering the operation of the unit shall be submitted in accordance with 10 CFR 50.36a. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The material provided shall be consistent with the objectives outlined in the ODCM and Process Control Program and in conformance with 10 CFR 50.36a and 10 CFR 50, Appendix I, Section IV.B.1.

6.9.1.5 DELETED

*A single submittal may be made for a multiple unit station.

**A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

ADMINISTRATIVE CONTROLS

PEAKING FACTOR LIMIT REPORT

6.9.1.6 The $W(Z)$ function(s) for Base-Load Operation corresponding to a $\pm 2\%$ band about the target flux difference and/or a $\pm 3\%$ band about the target flux difference, the Load-Follow function $F_z(Z)$ and the augmented surveillance turnon power fraction P_T shall be provided to the U.S. Nuclear Regulatory Commission, whenever P_T is <1.0 . In the event, the option of Baseload Operation (as defined in Section 4.2.2.3) will not be exercised, the submission of the $W(Z)$ function is not required. Should these values (i.e., $W(Z)$, $F_z(Z)$ and P_T) change requiring a new submittal or an amended submittal to the Peaking Factor Limit Report, the Peaking Factor Limit Report shall be provided to the NRC Document Control desk with copies to the Regional Administrator and the Resident Inspector within 30 days of their implementation, unless otherwise approved by the Commission.

The analytical methods used to generate the Peaking Factor limits shall be those previously reviewed and approved by the NRC. If changes to these methods are deemed necessary they will be evaluated in accordance with 10 CFR 50.59 and submitted to the NRC for review and approval prior to their use if the change is determined to involve an unreviewed safety question or if such a change would require amendment of previously submitted documentation.

CORE OPERATING LIMITS REPORT

6.9.1.7 Core operating limits shall be established and documented in the CORE OPERATING LIMITS REPORT (COLR) before each reload cycle or any remaining part of a reload cycle for the following:

1. Reactor Core Safety Limits for Specification 2.1.1.
2. Overtemperature ΔT , Note 1 of Table 2.2-1 for Specification 2.2.1, determination of values K_1 , K_2 , K_3 , T' , P' , τ_1 , τ_2 , τ_3 , τ_4 , τ_5 , τ_6 , and the breakpoint and slope values for the f_1 (ΔI).
3. Overpower ΔT , Note 3 of Table 2.2-1 for Specification 2.2.1, determination of values for K_4 , K_5 , K_6 , T'' , τ_7 and f_2 (ΔI).
4. Shutdown Margin - $T_{avg} > 200^\circ\text{F}$ for Specification 3/4.1.1.1.
5. Shutdown Margin - $T_{avg} \leq 200^\circ\text{F}$ for Specification 3/4.1.1.2.
6. Moderator Temperature Coefficient for Specification 3/4.1.1.3.
7. Axial Flux Difference for Specification 3.2.1.
8. Control Rod Insertion Limits for Specification 3.1.3.6.
9. Heat Flux Hot Channel Factor - $F_Q(Z)$ for Specification 3/4.2.2.
10. All Rods Out position for Specification 3.1.3.2.
11. Nuclear Enthalpy Rise Hot Channel Factor for Specification 3/4.2.3.
12. DNB Parameters for Specification 3.2.5, determination of values for Reactor Coolant System T_{avg} and Pressurizer Pressure.

The analytical methods used to determine the AFD limits shall be those previously reviewed and approved by the NRC in:

1. WCAP-10216-P-A, RELAXATION OF CONSTANT AXIAL OFFSET CONTROL F_Q SURVEILLANCE TECHNICAL SPECIFICATION," June 1983.
2. WCAP-8385, "POWER DISTRIBUTION CONTROL AND LOAD FOLLOWING PROCEDURES - TOPICAL REPORT," September 1974.

ADMINISTRATIVE CONTROLS

CORE OPERATING LIMITS REPORT (Continued)

The analytical methods used to determine $F_Q(Z)$, $F_{\Delta}H$ and the $K(Z)$ curve shall be those previously reviewed and approved by the NRC in:

1. WCAP-9220-P-A, Rev. 1, "Westinghouse ECCS Evaluation Model - 1981 Version," February 1982.
2. WCAP-10054-P-A, (proprietary), "Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code," August 1985.

ADMINISTRATIVE CONTROLS

3. WCAP-10054-P-A, Addendum 2, Revision 1 (proprietary), "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code: Safety Injection into the Broken Loop and COSI Condensation Model," July 1997.
4. WCAP-16009-P-A, "Realistic Large-break LOCA Evaluation Methodology Using the Automated Statistical Treatment of Uncertainty Method (ASTRUM)", January 2005.
5. USNRC Safety Evaluation Report, Letter from R. C. Jones (USNRC) to N. J. Liparulo (W), "Acceptance for Referencing of the Topical Report WCAP-12945(P) 'Westinghouse Code Qualification Document for Best Estimate Loss of Coolant Analysis,' " June 28, 1996. **
6. Letter dated June 13, 1996, from N. J. Liparulo (W) to Frank R. Orr (USNRC), "Re-Analysis Work Plans Using Final Best Estimate Methodology. ***
7. WCAP-12610-P-A, "VANTAGE+ Fuel Assembly Reference Core Report," S. L. Davidson and T. L. Ryan, April 1995.
8. WCAP-12610-P-A & CENPD-404-P-A, Addendum 1-A, "Optimized ZIRLO™," July 2006.

The analytical methods used to determine Overtemperature ΔT and Overpower ΔT shall be those previously reviewed and approved by the NRC in:

1. WCAP-8745-P-A, "Design Basis for the Thermal Overtemperature ΔT and Overpower ΔT Trip Functions," September 1986
2. WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985

The analytical methods used to determine Safety Limits, Shutdown Margin - $T_{avg} > 200^{\circ}\text{F}$, Shutdown Margin - $T_{avg} \leq 200^{\circ}\text{F}$, Moderator Temperature Coefficient, DNB Parameters, Rod Bank Insertion Limits and the All Rods Out position shall be those previously reviewed and approved by the NRC in:

1. WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985.

The analytical methods used to support the suspension of the measurement of the Moderator Temperature Coefficient in accordance with Surveillance Requirement 4.1.1.3.b shall be those previously reviewed and approved by the NRC in:

1. WCAP-13749-P-A, "Safety Evaluation Supporting the Conditional Exemption of the Most Negative EOL Moderator Temperature Coefficient Measurement," March 1997.
2. WCAP-11596-P-A, "Qualification of the Phoenix-P/ANC Nuclear Design System for Pressurized Water Reactor Cores," June 1988.
3. WCAP-16045-P-A, "Qualification of the Two-Dimensional Transport Code PARAGON," August 2004.
4. WCAP-16045-P-A, Addendum 1-A, "Qualification of the NEXUS Nuclear Data Methodology," August 2007.

**As evaluated in NRC Safety Evaluation dated December 20, 1997.

ADMINISTRATIVE CONTROLS

The ability to calculate the COLR nuclear design parameters are demonstrated in:

1. Florida Power & Light Company Topical Report NF-TR-95-01, "Nuclear Physics Methodology for Reload Design of Turkey Point & St. Lucie Nuclear Plants."

Topical Report NF-TR-95-01 was approved by the NRC for use by Florida Power & Light Company in:

1. Safety Evaluation by the Office of Nuclear Reactor Regulations Related to Amendment No. 174 to Facility Operating License DPR-31 and Amendment No. 168 to Facility Operating License DPR-41, Florida Power & Light Company Turkey Point Units 3 and 4, Docket Nos. 50-250 and 50-251.

The AFD, $F_Q(Z)$, $F_{\Delta H}$, $K(Z)$, Safety Limits, Overtemperature ΔT , Overpower ΔT , Shutdown Margin - $T_{avg} > 200^\circ\text{F}$, Shutdown Margin - $T_{avg} \leq 200^\circ\text{F}$, Moderator Temperature Coefficient, DNB Parameters, and Rod Bank Insertion Limits shall be determined such that all applicable limits of the safety analyses are met. The CORE OPERATING LIMITS REPORT, including any mid-cycle revisions or supplements thereto, shall be provided upon issuance, for each reload cycle, to the NRC Document Control Desk with copies to the Regional Administrator and Resident Inspector, unless otherwise approved by the Commission.

ADMINISTRATIVE CONTROLS

STEAM GENERATOR TUBE INSPECTION REPORT

6.9.1.8 A report shall be submitted within 180 days after the initial entry into MODE 4 following completion of an inspection performed in accordance with Specification 6.8.4.j, Steam Generator (SG) Program. The report shall include:

- a. The scope of inspections performed on each SG,
- b. Degradation mechanisms found,
- c. Nondestructive examination techniques utilized for each degradation mechanism,
- d. Location, orientation (if linear), and measured sizes (if available) of service induced indications,
- e. Number of tubes plugged during the inspection outage for each degradation mechanism,
- f. The number and percentage of tubes plugged to date, and the effective plugging percentage in each steam generator,
- g. The results of condition monitoring, including the results of tube pulls and in-situ testing, and
- h. The primary to secondary leakage rate observed in each SG (if it is not practical to assign the leakage to an individual SG, the entire primary to secondary leakage should be conservatively assumed to be from one SG) during the cycle preceding the inspection which is the subject of the report,
- i. The calculated accident induced leakage rate from the portion of the tubes below 18.11 inches from the top of the tubesheet for the most limiting accident in the most limiting SG. In addition, if the calculated accident induced leakage rate from the most limiting accident is less than 1.82 times the maximum operational primary to secondary leakage rate, the report should describe how it was determined, and
- j. The results of monitoring for tube axial displacement (slippage). If slippage is discovered, the implications of the discovery and corrective action shall be provided.

SPECIAL REPORTS

6.9.2 Special reports shall be submitted to the Regional Administrator of the Regional Office of the NRC within the time period specified for each report as stated in the Specifications within Sections 3.0, 4.0, or 5.0.

6.10 DELETED

ADMINISTRATIVE CONTROLS

6.11 DELETED

6.12 HIGH RADIATION AREA

6.12.1 Pursuant to paragraph 20.1601(c) of 10 CFR Part 20, in lieu of the “control device” or “alarm signal” required by paragraph 20.1601(a), each high radiation area, as defined in 10 CFR Part 20, in which the intensity of radiation is greater than 100 mrem/hr but equal to or less than 1000 mrem/hr at 30 cm (12 in.) from the radiation source or from any surface which the radiation penetrates shall be barricaded and conspicuously posted as a high radiation area and entrance thereto shall be controlled by requiring issuance of a Radiation Work Permit (RWP). Individuals qualified in radiation protection procedures (e.g., Health Physics Technician) or personnel continuously escorted by such individuals may be exempt from the RWP issuance requirement during the performance of their assigned duties in high radiation areas with exposure rates equal to or less than 1000 mrem/hr, provided they are otherwise following plant radiation protection procedures for entry into such high radiation areas.

Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

- a. A radiation monitoring device which continuously indicates the radiation dose rate in the area; or
- b. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate levels in the area have been established and personnel have been made knowledgeable of them; or
- c. An individual qualified in radiation protection procedures with a radiation dose rate monitoring device, who is responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified by the Health Physics Shift Supervisor in the RWP.

6.12.2 In addition to the requirements of Specification 6.12.1, areas accessible to personnel with radiation levels greater than 1000 mrem/hr at 30 cm (12 in.) and less than 500 rads/hr at 1 meter from the radiation source or from any surface which the radiation penetrates shall be provided with locked doors to prevent unauthorized entry, and the keys shall be maintained under the administrative control of the shift supervisor on duty and/or health physics supervision. Doors shall remain locked except during periods of access by personnel under an approved RWP which shall specify the dose rate levels in the immediate work areas and the maximum allowable stay time for individuals in that area. In lieu of the stay time specification of the RWP, direct or remote (such as closed circuit TV cameras) continuous surveillance may be made by personnel qualified in radiation protection procedures to provide positive exposure control over the activities being performed within the area.

For individual high radiation areas accessible to personnel with radiation levels of greater than 1000 mrem/hr and less than 500 rads/hr that are located within large areas, such as PWR containment, where no enclosure exists for purposes of locking, and where no enclosure can be reasonably constructed around the individual area, that individual area shall be barricaded, conspicuously posted, and a flashing light shall be activated as a warning device.

6.13 DELETED

ADMINISTRATIVE CONTROLS

6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM)

6.14.1 The ODCM shall contain the following:

- a. The methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm and trip setpoints, and in the conduct of the Radiological Environmental Monitoring Program; and
- b. The radioactive effluent controls and radiological environmental monitoring activities, and descriptions of the information that should be included in the Annual Radiological Environmental Operating, and Annual Radioactive Effluent Release Reports required by Specification 6.9.1.3 and Specification 6.9.1.4.

6.14.2 Licensee initiated changes to the ODCM:

- a. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:
 1. Sufficient information to support the change(s) together with the appropriate analyses or evaluations justifying the change(s), and
 2. A determination that the change(s) maintain the levels of radioactive effluent control required by 10 CFR 20.1302, 40 CFR 190, 10 CFR 50.36a, and Appendix I to 10 CFR 50, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
- b. Shall become effective after approval of the plant manager; and
- c. Shall be submitted to the NRC in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Annual Radioactive Effluent Release Report for the period of the report in which any change in the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (i.e., month and year) the change was implemented.