

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

May 12, 1981

TELEPHONE: AREA 704
373-4083

Mr. James P. O'Reilly, Director
U. S. Nuclear Regulatory Commission
Region II
101 Marietta Street, Suite 3100
Atlanta, Georgia, 30303

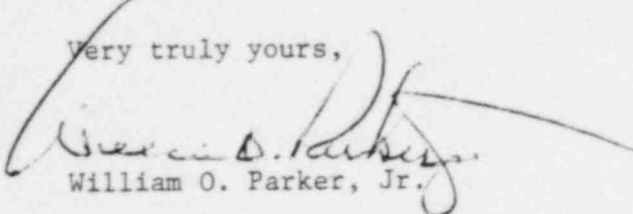
Subject: McGuire Nuclear Station
Docket Nos. 50-369 and 50-370

Re: RII:WPK
50-369/81-07
50-370/81-02

Dear Mr. O'Reilly:

Please find attached a response to Infraction 370/81-02-01 which was identified in the above referenced Inspection Report. I declare under penalty of perjury that the statements set forth herein are true and correct to the best of my knowledge.

Very truly yours,


William O. Parker, Jr.

RWO/djs
Attachment

cc: T. J. Donat
Senior Resident Inspector
McGuire Nuclear Station

McGUIRE NUCLEAR STATION

NOTICE OF VIOLATION 370/81-02-01

- A. 10 CFR 50, Appendix B, Criterion XIII as implemented by DPC Topical Report Duke 1-A, Section 17, Paragraph 17.1.13 requires measures be established to control storage of equipment to prevent damage.

Contrary to the above, on February 3-6, 1981, adequate measures were not established to control storage of equipment to prevent damage in that:

1. Four examples of rigging from installed safety-related piping were noted.
2. Three examples of rigging lines impinging on cable trays or cables in trays were noted.
3. Approximately eight examples of material stored in cable trays containing cables were noted.
4. Five examples of scaffolding supported safety-related piping were noted.

Response:

The violation occurred due to a lack of adequate guide lines for installing temporary scaffolding on permanently installed components and a failure to properly execute the proper procedure involving housekeeping inspections for storage of installed equipment.

A construction procedure has been implemented which defines the guidelines and limitations to be used when placing temporary scaffolding on piping, hangers, equipment, and any other components permanently installed in the field.

The procedure specifically states that:

- A. No scaffold shall be supported from Schedule 10 pipe.
- B. No scaffold shall place any loads on valve operators, cable trays and cables, hangers such as snubbers, struts, and movable type hangers.
- C. No scaffold shall be supported by a pipe with O.D. of less than 3".

and in general, scaffold shall never damage any permanently installed item.

The procedure involving house keeping inspections for storage of installed equipment has been reemphasized and the appropriate personnel have been notified of the importance of this procedure.

The station is currently in full compliance.