

B. 21


TEXAS UTILITIES GENERATING COMPANY

2001 BRYAN TOWER - DALLAS, TEXAS 75201

R. J. GARY
EXECUTIVE VICE PRESIDENT
AND GENERAL MANAGER

June 19, 1981

TXX-3254

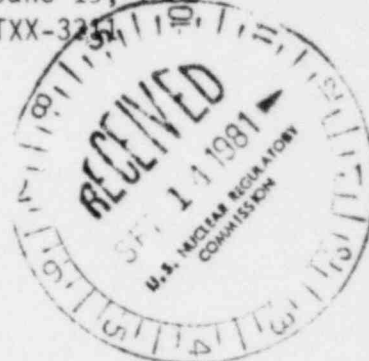

Mr. G. L. Madsen
Reactor Projects Branch
U. S. Nuclear Regulatory Commission
Office of Inspection & Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76012

COMANCHE PEAK STEAM ELECTRIC STATION
VOLUME CONTROL TANK
LEVEL CONTROL SYSTEM
FILE NO: 10110

Dear Mr. Madsen:

On May 22, 1981 we verbally informed your Mr. W. Hubacek of a deficiency regarding the Volume Control Tank Level Control System. Westinghouse had previously reported this item to the NRC under 10 CFR 21 in their May 21, 1981 letter logged NS-TMA-2451.

We have reviewed this Westinghouse letter and their recommended corrective actions. In addition we have evaluated the postulated sequence of events in light of the CPSES operating procedures and have concluded that a malfunction of the VCT level control system would not result in a safety hazard.

We therefore conclude that the problem identified by Westinghouse regarding the VCT Level Control System is not reportable under 10 CFR 50.55(e).

Very truly yours,

R. J. Gary
R. J. Gary

RJG:med

cc: NRC Region IV - (0 + 1 copy)

Director, Inspection & Enforcement - (15 copies)
c/o Distribution Services Branch, DDC, ADM.
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

IE19
5
1/0

8109150365 810619
PDR ADOCK 05000445
S PDR

1E19