

LICENSEE EVENT REPORT

CONTROL BLOCK / / / / / / (1) (PLEASE PRINT OR TYPE ALL REQUIRED INFORMATION)

/0/1/ /V/A/N/A/S/2/ (2) /0/0/-/0/0/0/0/0/-/0/0/ (3) /4/1/1/1/1/ (4) / / / (5)
 LICENSEE CODE LICENSE NUMBER LICENSE TYPE CAT

/0/1/ REPORT /L/ (6) /0/5/0/0/0/3/3/9/ (7) /0/5/3/0/8/3/ (8) /0/6/2/8/8/3/ (9)
 SOURCE DOCKET NUMBER EVENT DATE REPORT DATE

EVENT DESCRIPTION AND PROBABLE CONSEQUENCES (10)

/0/2/ / On May 30, 1983, with Unit 2 at 30% power, Emergency Diesel Generator (EDG) "2J" /
 /0/3/ / tripped on high crankcase pressure during surveillance testing. Since the high /
 /0/4/ / crankcase pressure trip is bypassed in the emergency mode of operation and the /
 /0/5/ / "2H" EDG was proven operable within 1 hour the health and safety of the public /
 /0/6/ / were not affected. This event is contrary to the LCO of T.S. 3.8.1.1 and report- /
 /0/7/ / able pursuant to T.S. 6.9.1.9.b. /
 /0/8/ /

SYSTEM CODE	CAUSE CODE	CAUSE SUBCODE	COMPONENT CODE	COMP. SUBCODE	VALVE SUBCODE
-------------	------------	---------------	----------------	---------------	---------------

LER/RO REPORT NUMBER	EVENT YEAR	SEQUENTIA REPORT NO.	OCCURRENCE CODE	REPORT TYPE	REVISION NO.
----------------------	------------	----------------------	-----------------	-------------	--------------

ACTION TAKEN	FUTURE ACTION	EFFECT ON PLANT	SHUTDOWN METHOD	HOURS	ATTACHMENT SUBMITTED	NPRD-4 FORM SUB.	PRIME COMP. SUPPLIER	COMPONENT MANUFACTURER
--------------	---------------	-----------------	-----------------	-------	----------------------	------------------	----------------------	------------------------

/X/ (18) /Z/ (19) /Z/ (20) /Z/ (21) /0/0/0/0/ (22) /N/ (23) /N/ (24) /A/ (25) /E/0/1/0/ (26)

CAUSE DESCRIPTION AND CORRECTIVE ACTIONS (27)

/1/0/ / The "2J" EDG was inspected by both electrical and mechanical maintenance person- /
 /1/1/ / nel. The cause of the high crankcase pressure was not determined. The diesel /
 /1/2/ / was subsequently tested satisfactorily under observation of the maintenance per- /
 /1/3/ / sonnel and returned to service. /
 /1/4/ /

FACILITY STATUS	%POWER	OTHER STATUS	METHOD OF DISCOVERY	DISCOVERY DESCRIPTION (32)
-----------------	--------	--------------	---------------------	----------------------------

ACTIVITY RELEASED	CONTENT OF RELEASE	AMOUNT OF ACTIVITY (35)	LOCATION OF RELEASE (36)
-------------------	--------------------	-------------------------	--------------------------

PERSONNEL EXPOSURES NUMBER	TYPE	DESCRIPTION (39)
----------------------------	------	------------------

PERSONNEL INJURIES NUMBER	DESCRIPTION (41)
---------------------------	------------------

LOSS OF OR DAMAGE TO FACILITY TYPE	DESCRIPTION (43)
------------------------------------	------------------

PUBLICITY ISSUED	DESCRIPTION (45)
------------------	------------------

ISSUED	DESCRIPTION (45)
--------	------------------

ISSUED	DESCRIPTION (45)
--------	------------------

ISSUED	DESCRIPTION (45)
--------	------------------

NAME OF PREPARER	PHONE
------------------	-------

8307120094 830628
 PDR ADOCK 05000339
 S PDR

NRC USE ONLY

PHONE (703) 894-5151

TE22
 111

Vepco

USNRC REGION II
ATLANTA, GEORGIA

VIRGINIA ELECTRIC AND POWER COMPANY

NORTH ANNA POWER STATION

P. O. BOX 402

MINERAL, VIRGINIA 23117

July
83 JUN 5 9:47

June 28, 1983

Mr. James P. O'Reilly, Regional Administrator
U. S. Nuclear Regulatory Commission
Region II
101 Marietta Street, Suite 2900
Atlanta, Georgia 30303

Serial No. N-83-089
NO/JRR: 11
Docket No. 50-339
License No. NPF-7

Dear Mr. O'Reilly:

Pursuant to North Anna Power Station Technical Specifications, the Virginia Electric and Power Company hereby submits the following License Event Report applicable to North Anna Unit No. 2.

Report No.


Applicable Technical Specifications

LER 83-047/03L-0

T.S. 6.9.1.9.b

This report has been reviewed by the Station Nuclear Safety and Operating Committee and will be forwarded to Safety Evaluation and Control for their review.

Very Truly Yours,

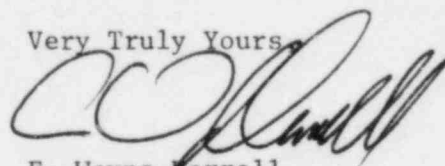

E. Wayne Harrell
Station Manager

Enclosures (3 copies)

cc: Document Control Desk (1 copy)
016 Phillips Bldg.
U.S. Nuclear Regulatory Commission
Washington, D. C. 20555

OFFICIAL COPY

IE 22

1/1