






**LA CROSSE BOILING WATER REACTOR  
FINAL STATUS SURVEY RELEASE RECORD**


**SURVEY UNIT L3-012-101  
NORTH END OF LICENSED SITE**




PREPARED BY / DATE:  1/23/20  
R. F. Yetter III, FSS Specialist

REVIEWED BY / DATE:  1/27/20  
M. D. Uz, FSS Specialist

REVIEWED BY / DATE:  1/27/20  
R. Yetter, Director, Radiological Site Closure

REVIEWED BY / DATE:  1/27/20  
P. Hollenbeck, Radiological Engineer

APPROVED BY / DATE:  01/27/2020  
S. Zoller, FSS Manager

## **TABLE OF CONTENTS**

<b>1. EXECUTIVE SUMMARY .....</b>	<b>5</b>
<b>2. SURVEY UNIT DESCRIPTION .....</b>	<b>5</b>
<b>3. CLASSIFICATION BASIS.....</b>	<b>5</b>
<b>4. DATA QUALITY OBJECTIVES .....</b>	<b>9</b>
<b>5. SURVEY DESIGN.....</b>	<b>13</b>
<b>6. SURVEY IMPLEMENTATION .....</b>	<b>19</b>
<b>7. SURVEY RESULTS.....</b>	<b>20</b>
<b>8. QUALITY CONTROL.....</b>	<b>30</b>
<b>9. INVESTIGATIONS AND RESULTS .....</b>	<b>31</b>
<b>10. REMEDIATION AND RESULTS .....</b>	<b>31</b>
<b>11. CHANGES FROM THE FINAL STATUS SURVEY PLAN .....</b>	<b>31</b>
<b>12. DATA QUALITY ASSESSMENT (DQA).....</b>	<b>31</b>
<b>13. ANOMALIES.....</b>	<b>32</b>
<b>14. CONCLUSION .....</b>	<b>32</b>
<b>15. REFERENCES.....</b>	<b>33</b>
<b>16. ATTACHMENTS .....</b>	<b>33</b>
<i>ATTACHMENT 1 – FIGURE .....</i>	<i>35</i>
<i>ATTACHMENT 2 – SCAN DATA.....</i>	<i>37</i>
<i>ATTACHMENT 3 – SIGN TEST.....</i>	<i>45</i>
<i>ATTACHMENT 4 – QUALITY CONTROL ASSESSMENT .....</i>	<i>47</i>
<i>ATTACHMENT 5 – CONSULTATION TRIGGERS FOR RESIDENTIAL SOIL CONCENTRATIONS.....</i>	<i>49</i>
<i>ATTACHMENT 6 – GRAPHICAL PRESENTATIONS.....</i>	<i>51</i>
<i>ATTACHMENT 7 – SAMPLE ANALYTICAL REPORTS .....</i>	<i>55</i>
<i>ATTACHMENT 8 – GEL LABORATORIES ANALYTICAL REPORTS .....</i>	<i>56</i>

## **LIST OF TABLES**

Table 3-1 - Statistical Quantities for Cs-137 and Co-60 from the Characterization Survey.....	7
Table 3-2 – Off-site Analysis for Characterization Samples.....	8
Table 4-1 - Dose Significant Radionuclides and Mixture for Soil .....	11
Table 4-2 - Base Case DCGLs for Soil .....	12
Table 4-3 - Operational DCGLs for Soil.....	12
Table 5-1 – Soil Surrogate Ratio .....	13
Table 5-2 – Action Levels for Survey Unit L3-012-101 .....	14
Table 5-3 – Systematic Sample Locations.....	16
Table 5-4 – Judgmental Sample Locations .....	17
Table 5-5 – Investigation Levels .....	18
Table 5-6 – Synopsis of Survey Design.....	18
Table 7-1 – Synopsis of Scan Results .....	21
Table 7-2 - Summary of Gamma Spectroscopy Results for Samples Comprising the Statistical Sample Population.....	27
Table 7-3 - Basic Statistical Properties of Systematic Sample Population .....	28
Table 7-4 - Off-Site Analysis Results.....	28
Table 7-5 - Summary of Gamma Spectroscopy Results for Judgmental Samples .....	28
Table 7-6 - Summary of Gamma Spectroscopy Results for QC Samples .....	29
Table 7-7 - Sum-of-Fractions for Systematic and QC Samples .....	29
Table 7-8 – Sum-of-Fractions for Judgmental Samples .....	30
Table 16-1 – Survey Unit L3-012-101 Complete Scan Data .....	38
Table 16-2 – Survey Unit L3-012-101 Sign Test.....	46
Table 16-3 – Survey Unit L3-012-101 QC Assessment .....	48

## **LIST OF FIGURES**

Figure 16-1 – Survey Unit L3-012-101 Random and Judgmental Sample Locations Map .....	36
Figure 16-2 - Quantile Plot for Cs-137 Concentration .....	52
Figure 16-3 - Histogram for Cs-137 Concentration.....	53
Figure 16-4 - Retrospective Power Curve for Survey Unit L3-012-101 .....	54



**LIST OF ACRONYMS AND ABBREVIATIONS**

ALARA	As Low As Reasonably Achievable
DQA	Data Quality Assessment
DQO	Data Quality Objective
DCGL	Derived Concentration Guideline Level
DCGLs	Soil Derived Concentration Guideline Level
FSS	Final Status Survey
GPS	Global Positioning System
HSA	Historical Site Assessment
HTD	Hard-to-Detect
IC	Insignificant Contributors
LACBWR	La Crosse Boiling Water Reactor
LBGR	Lower Bound of the Gray Region
LTP	License Termination Plan
MARSSIM	Multi-Agency Radiation Survey and Site Investigation Manual
MDC	Minimum Detectable Concentration
NaI	Sodium Iodide
OpDCGLs	Soil Operational Derived Concentration Guideline Level
QAPP	Quality Assurance Project Plan
QC	Quality Control
RA	Radiological Assessment
ROC	Radionuclides of Concern
SOF	Sum-of-Fractions
TEDE	Total Effective Dose Equivalent
UBGR	Upper Bound of the Gray Region
UCL	Upper Confidence Limit

## 1. EXECUTIVE SUMMARY

This Final Status Survey (FSS) Release Record for survey unit L3-012-101, North End of Licensed Site, has been generated in accordance with LaCrosseSolutions procedure LC-FS-PR-009, *Final Status Survey Data Reporting* (Reference 1) and satisfies the requirements of Section 5.11 of the *La Crosse Boiling Water Reactor License Termination Plan* (LACBWR LTP) (Reference 2).

An FSS sample plan for this survey unit was developed in accordance with LaCrosseSolutions procedure LC-FS-PR-002, *Final Status Survey Package Development* (Reference 3), the LACBWR LTP, and with guidance from NUREG-1575, Revision 1, *Multi-Agency Radiation Survey and Site Investigation Manual* (MARSSIM) (Reference 4).

Survey unit L3-012-101, an open land survey unit, has a MARSSIM classification of 3. A survey plan was designed based upon use of the Sign Test as the nonparametric statistical test for compliance. Both the Type I ( $\alpha$ ) and Type II ( $\beta$ ) decision error rates were set at 0.05. As a systematic sample population, fourteen (14) soil samples were acquired from the survey unit. In addition, soil scanning was performed on 10% of the total surface area in the survey unit. The analytical results for all soil samples taken in survey unit L3-012-101 indicate that the maximum Sum-of-Fractions (SOF), considering the concentration of all applicable Radionuclides of Concern (ROC) either by direct measurement or by inference, is equal to 0.0788 when applying the respective Operational Derived Concentration Guideline Levels (OpDCGLs) for soil. Therefore, the null hypothesis is rejected and survey unit L3-012-101 is acceptable for unrestricted release. The mean SOF when applying the respective Base Case DCGLs (DCGLs) for soil is 0.0148. This SOF equates to a dose for the survey unit of 0.3699 mrem/yr.

## 2. SURVEY UNIT DESCRIPTION

Survey unit L3-012-101 is an impacted Class 3 open land survey unit. The surface area of the survey unit is 19,885 m<sup>2</sup>.

The boundary of the survey unit and the location of the soil samples were defined using a Global Positioning System (GPS). Refer to Attachment 1 of this report for figures and maps depicting survey unit L3-012-101.

## 3. CLASSIFICATION BASIS

Survey unit L3-012-101 was originally designated as Class 3 by the “*Historical Site Assessment*” (HSA) (Reference 5).

The initial site characterization surveys performed by EnergySolutions were conducted between October 9, 2014, and August 6, 2015. Three (3) surface soil samples, three (3) subsurface soil samples, and 3 concrete/asphalt samples were collected. No ROC were positively identified in concentrations greater than the minimum detectable concentration (MDC) in any sample. A summary of the results of initial site characterization for survey unit L3-012-101 is provided in Table 3-1.

Three (3) concrete samples, one (1) sediment sample, two (2) surface soil samples, and 1 (1) subsurface soil sample were sent to Test America Laboratories for gamma spectroscopy and hard-to-detect (HTD) radionuclide analyses. The results of the analyses are presented in Table 3-2. The analysis of these samples positively identified several plant-derived ROC at residual concentrations greater than the instrument MDC, including H-3, Fe-55 and Ni-63. The HTD radionuclides exceeding MDC are likely to be the result of laboratory interferences during liquid scintillation analysis. Cs-137 was also positively detected, but at levels consistent with natural background.

**Table 3-1 - Statistical Quantities for Cs-137 and Co-60 from the Characterization Survey**

Survey Unit L3012101		
Surface Soil	Co-60	Cs-137
# of Samples	3	
# >MDC	0	0
Mean (pCi/g)	0.070	0.073
Median (pCi/g)	0.076	0.072
Max (pCi/g)	0.077	0.083
Min (pCi/g)	0.058	0.065
Standard Deviation (pCi/g)	0.011	0.009
Subsurface Soil	Co-60	Cs-137
# of Samples	3	
# >MDC	0	0
Mean (pCi/g)	0.051	0.051
Median (pCi/g)	0.053	0.052
Max (pCi/g)	0.054	0.052
Min (pCi/g)	0.046	0.051
Standard Deviation (pCi/g)	0.004	0.001
Concrete/Asphalt	Co-60	Cs-137
# of Samples	3	
# >MDC	0	0
Mean (pCi/g)	0.031	0.029
Median (pCi/g)	0.031	0.027
Max (pCi/g)	0.035	0.033
Min (pCi/g)	0.028	0.029
Standard Deviation (pCi/g)	0.003	0.004



**Table 3-2 – Off-site Analysis for Characterization Samples**

Radionuclide	H-3	C-14	Fe-55	Ni-59	Co-60	Ni-63	Sr-90	Nb-94	Tc-99	Cs-137	Pm-147	Eu-152	Eu-154	Eu-155	Np-237	Pu-238	Pu-239/240	Pu-241	Am-241	Am-243	Cm-243/244
L3012101-CR-GC-001-CV					0.028			0.030		0.026		0.043	0.221	0.059					0.053		
L3012101-CR-GC-002-CV					0.035			0.026		0.033		0.062	0.271	0.056					0.055		
L3012101-CR-GC-003-CV		0.669	2.180	2.020	0.031	3.590	0.374	0.027	0.521	0.027	1.480	0.056	0.249	0.069	0.025	0.046	0.018	1.690	0.019	0.021	0.006
L3012101-CR-GS-003-SS					0.025			0.017		<b>0.113</b>		0.052	0.157	0.059					0.052		
L3012101-QQ-GS-001-SB	<b>18.400</b>	0.717	2.390	2.870	0.016	<b>5.640</b>	0.309	0.014	0.550	0.015	0.899	0.036	0.128	0.036	0.039	0.035	0.022	2.590	0.023	0.029	0.027
L3012101-QQ-GS-001-SS	<b>15.500</b>	0.708	<b>2.330</b>	2.660	0.020	3.890	0.295	0.017	0.603	<b>0.059</b>	1.090	0.047	0.116	0.054	0.028	0.028	0.022	2.640	0.019	0.021	0.006
L3012101-QQ-SL-001-SM	0.364	0.342	<b>2.710</b>	0.739	0.022	<b>1.090</b>	0.152	0.017	0.360	0.020	0.333	0.042	0.153	0.034	0.009	0.016	0.013	0.797	0.009	0.009	0.011

Note: Bold values indicate concentration greater than MDC. Unbolded values indicate the MDC value. All values in pCi/g. Blank cells indicate that a particular radionuclide was not included in the analysis.

Section 5.1 of the LTP states that the actual Insignificant Contributor (IC) dose will be calculated for each individual sample result using the DCGLs from Table 4 of TSD RS-TD-313196-004, *LACBWR Soil DCGL, Basement Concrete DCGL, and Buried Pipe DCGL* (Reference 6) for soil. If the IC dose calculated is less than the IC dose assigned for DCGL adjustment, then no further action will be taken. If the actual IC dose calculated from the sample result is greater than the IC dose assigned for DCGL adjustment, then a minimum of five (5) additional investigation samples will be taken around the original sample location. Each investigation sample will be analyzed by the on-site gamma spectroscopy system and sent for HTD analysis (full suite of radionuclides from LTP Table 5-1). As with the original sample, the actual IC dose will be calculated for each investigation sample. In this case, the actual calculated maximum IC dose from an individual sample observed in the survey unit will be used to readjust the DCGLs in that survey unit. If the maximum IC dose exceeds 10%, then the additional radionuclides that were the cause of the IC dose exceeding 10% will be added as additional ROC for that survey unit. The survey unit-specific DCGLs used for compliance, the ROC for that survey unit, and the survey data serving as the basis for the IC dose adjustment will be documented in the release record for the survey unit.

An assessment of the results of continuing characterization confirmed that the IC dose is unchanged (dose fraction less than 10%).

Based upon review of the historical information, the results of the characterization survey data, and completion of a final Survey Unit Classification Worksheet, the correct final classification of survey unit L3-012-101 was determined to be Class 3.

#### **4. DATA QUALITY OBJECTIVES (DQO)**

FSS planning and design relies on a properly executed Data Quality Objective (DQO) process to ensure, through compliance with explicitly defined inputs and boundaries, that the primary objective of the survey is satisfied. The DQO process, utilized in accordance with MARSSIM, is described in the LACBWR LTP. The appropriate design for a given survey was developed using the DQO process as outlined in Appendix D of MARSSIM. A summary of seven steps of the DQO process are outlined as follows.

The DQO process incorporated hypothesis testing and probabilistic sampling distributions to control decision errors during data analysis. Hypothesis testing is a process based on the scientific method that compares a baseline condition to an alternate condition. The baseline condition is technically known as the null hypothesis. Hypothesis testing rests on the premise that the null hypothesis is true and that sufficient evidence must be provided for rejection. In designing the survey plan, the underlying assumption, or null hypothesis was that residual activity in the survey unit exceeded the release criteria. Rejection of the null

hypothesis would indicate that residual activity within the survey unit does not exceed the release criteria. Therefore, the survey unit would satisfy the primary objective of the FSS sample plan.

The primary objective of the FSS sample plan is to demonstrate that the level of residual radioactivity in survey unit L3-012-101 did not exceed the release criteria specified in the LTP and that the potential dose from residual radioactivity is As Low As Reasonably Achievable (ALARA).

EnergySolutions TSD RS-TD-313196-001, *Radionuclides of Concern during LACBWR Decommissioning* (Reference 7) established the basis for an initial suite of potential ROC for decommissioning. LTP Chapter 2 provides detailed characterization data that describes the results of surveys taken of soil. Surface and subsurface soil samples were taken in each impacted open land survey units and analyzed for the presence of plant-derived radionuclides. The results of surface and subsurface soil characterization in the impacted area surrounding LACBWR indicate that there is minimal residual radioactivity in soil.

IC were determined consistent with the guidance contained in Section 3.3 of NUREG-1757, Volume 2, Revision 1, *Consolidated Decommissioning Guidance – Characterization, Survey, and Determination of Radiological Criteria, Final Report* (Reference 8). In all soil and concrete scenarios, Cs-137, Co-60, Sr-90, Eu-152 and Eu-154 contribute nearly 100% of the total dose. The remaining radionuclides were designated as IC and are eliminated from further detailed evaluation. Therefore, the final ROCs for LACBWR soil, basement concrete and buried piping are Cs-137, Co-60, Sr-90, Eu-152 and Eu-154.

The LTP, Section 6.14.1 discusses the process used to derive the ROC for the decommissioning of LACBWR, including the elimination of IC from the initial suite. Table 4-1 presents the ROC for the decommissioning of soil at LACBWR and the normalized mixture fractions based on the radionuclide mixture.

**Table 4-1 - Dose Significant Radionuclides and Mixture for Soil**

Radionuclide	Fraction of Total Activity (normalized) <sup>(1)</sup>
Co-60	0.064
Sr-90	0.098
Cs-137	0.829
Eu-152	0.005
Eu-154	0.003

(1) Based on maximum percent of total activity from Table 22 of RS-TD-313196-001, normalized to one for the dose significant radionuclides.

The LTP, Section 5.2 states that each radionuclide-specific Base Case DCGL is equivalent to the level of residual radioactivity (above background levels) that could, when considered independently, result in a Total Effective Dose Equivalent (TEDE) of 25 mrem/yr to an Average Member of the Critical Group. To ensure that the summation of dose from each source term is 25 mrem/yr or less after all FSS is completed, the Base Case DCGLs are reduced based on an expected, or *a priori*, fraction of the 25 mrem/yr dose limit from each source term. The reduced DCGLs (i.e., Operational DCGLs) can be related to the Base Case DCGLs as an expected fraction of dose based on an *a priori* assessment of what the expected dose should be based on the results of site characterization, process knowledge, and the extent of planned remediation. The Operational DCGL is then used as the DCGL for the FSS design of the survey unit (e.g., calculation of surrogate DCGLs, investigation levels). Details of the Operational DCGLs derived for each dose component and the basis for the applied *a priori* dose fractions are provided in LC-FS-TSD-002, *Operational Derived Concentration Guideline Levels for Final Status Survey* (Reference 9).

Multiple ROCs are known to be present at LACBWR. The dose contribution from each ROC is accounted for using the SOF to ensure that the total dose from all ROC does not exceed the dose criterion. A Base Case DCGL that is established for the average residual radioactivity in a survey unit is equivalent to a DCGL<sub>w</sub>. In Class 3 land survey units, the DCGL<sub>w</sub> can be multiplied by Area Factors to obtain a Base Case DCGL that represents the same dose to an individual for residual radioactivity over a smaller area within a survey unit.

At LACBWR, compliance is demonstrated through the summation of dose from five (5) distinct source terms (i.e., basements, soils, buried pipe, above-ground structures, and groundwater) for the end-state. When applied to soil, the DCGLs are expressed in units of activity per unit of mass (pCi/g).



For LACBWR, soil is defined as a layer of soil beginning at the surface but extending to a depth of 1 m to allow for flexibility in compliance demonstration if contamination deeper than 0.15 m is encountered. Based on characterization data and historical information, there are no expectations of encountering a source term geometry that is comprised of a clean surface layer of soil over a contaminated subsurface soil layer. EnergySolutions TSD RS-TD-313196-004 and LTP, Section 6.8 provide the exposure scenarios and modeling parameters that were used to calculate the site-specific soil DCGLs. The adjusted soil DCGLs for the unrestricted release of open land survey units as provided in Chapter 6, Section 6.16.1 are reproduced in Table 4-2. The IC percentages for the most limiting basement scenario were used to adjust the DCGLs for soil to account for the dose from the eliminated insignificant contributor radionuclides.

**Table 4-2 - Base Case DCGLs for Soil**

<b>Radionuclide</b>	<b>DCGLs (pCi/g)</b>
Co-60	10.6
Sr-90	5470
Cs-137	48.3
Eu-152	23.6
Eu-154	21.9

The Operational DCGLs are then used as the DCGL for the FSS design of the survey unit (e.g., calculation of surrogate DCGLs, investigation levels). The OpDCGLs for the unrestricted release of soil are provided in Table 4-3.

**Table 4-3 - Operational DCGLs for Soil**

<b>Radionuclide</b>	<b>OpDCGLs (pCi/g)</b>
Co-60	3.83
Sr-90	1970.45
Cs-137	17.39
Eu-152	8.51
Eu-154	7.89

Instrument DQOs included a verification of the ability of the survey instrument to detect the radiation(s) of interest relative to the Operational DCGL. Survey instrument response checks were required prior to issuance and after the instrument had been used. Control and accountability of survey instruments was required to assure the quality and prevent the loss of data.

As part of the DQOs applied to laboratory processes, analysis results were reported as actual calculated results. The actual reported value was used as the recorded FSS result for measurement and/or sample values that are less than MDC. Negative values were recorded as “zero.” Results were not reported as “less than MDC” ( $< \text{MDC}$ ). Sample report summaries included unique sample identification, analytical method, radionuclide, result, uncertainty, laboratory data qualifiers, units, and the observed MDC.

In accordance with the LTP, for laboratory analysis, MDCs less than 10% of the Operational DCGL were preferable while MDCs up to 50% of the Operational DCGL were acceptable. The minimum acceptable MDC for measurements obtained using field instruments was 50% of the applicable Operational DCGL.

## 5. SURVEY DESIGN

The level of effort associated with planning a survey is based on the complexity of the survey and nature of the hazards. Guidance for preparing FSS plans is provided in procedure LC-FS-PR-002, *Final Status Survey Package Development*.

The DQO process validated that Co-60, Sr-90, Cs-137, Eu-152, and Eu-154 would be the ROC in survey unit L3-012-101 as presented in LTP Section 5.1. During the data analysis of the FSS results, concentrations for the HTD ROC Sr-90 are inferred using a surrogate approach. Cs-137 is the principle surrogate radionuclide for Sr-90. During characterization, both Sr-90 and Cs-137 was positively detected in all thirty (30) concrete core samples assessed in the Reactor Building, Tunnel, and Waste Treatment Building. The 95% Upper Confidence Limit (UCL) of the Cs-137 fractions was chosen to represent the overall nuclide mix for soils/buried pipe, the Reactor Building, and the Waste Gas Tank Vault. The surrogate ratio for soil is given in Table 5-1.

**Table 5-1 – Soil Surrogate Ratio**

Radionuclides	Ratio
Sr-90/Cs-137	0.502

The equation for calculating a surrogate DCGL is as follows:

**Equation 1**

$$Surrogate_{DCGL} = \frac{1}{\left[\left(\frac{1}{DCGL_{Sur}}\right) + \left(\frac{R_2}{DCGL_2}\right) + \left(\frac{R_3}{DCGL_3}\right) + \dots \left(\frac{R_n}{DCGL_n}\right)\right]}$$

Where:  $DCGL_{Sur}$  = Surrogate radionuclide DCGL  
 $DCGL_{2,3\dots n}$  = DCGL for radionuclides to be represented by the surrogate  
 $R_n$  = Ratio of concentration (or nuclide mixture fraction) of radionuclide “n” to surrogate radionuclide

Using the Operational DCGLs presented in Table 4-3 and the ratio from Table 5-1, the following surrogate calculation was performed:

**Equation 2**

$$Surrogate_{DCGL (Cs-137)} = \frac{1}{\left[\left(\frac{1}{17.39_{(Cs-137)}}\right) + \left(\frac{0.502}{1970.45_{(Sr-90)}}\right)\right]} = 17.31 \text{ pCi/g}$$

The surrogate Operational DCGL that was used for Cs-137 in this survey unit for direct comparison of sample results to demonstrate compliance was 17.31 pCi/g.

The action levels for survey unit L3-012-101 are based on 50% of the Operational DCGL and are presented in Table 5-2.

**Table 5-2 – Action Levels for Survey Unit L3-012-101**

ROC	Action Level (pCi/g)
Co-60	1.915 <sup>(1)</sup>
Cs-137	8.655 <sup>(2)</sup>
Eu-152	4.255 <sup>(1)</sup>
Eu-154	3.945 <sup>(1)</sup>

(1) Based on 50% of the Operational DCGL.

(2) Based on 50% of the surrogate adjusted DCGL of Cs-137 while inferring Sr-90.

The Sign Test was selected as the non-parametric statistical test. The use of the Sign Test did not require the selection or use of a background reference area, which simplified survey

design and implementation. This approach was conservative since it included background Cs-137 as part of the sample set.

The number of soil samples for FSS was determined in accordance with procedure LC-FS-PR-002. The relative shift ( $\Delta/\sigma$ ) for the survey unit data set is defined as shift ( $\Delta$ ), which is the Upper Boundary of the Gray Region (UBGR), or the DCGL (SOF of 1), minus the Lower Bound of the Gray Region (LBGR), divided by sigma ( $\sigma$ ), which is the standard deviation of the data set used for survey design. The optimal value for  $\Delta/\sigma$  should range between one (1) and three (3). The largest value the  $\Delta/\sigma$  can have is three (3). If the calculated value of  $\Delta/\sigma$  exceeds three (3), an adjusted value of three (3) will be used for  $\Delta/\sigma$ . The  $\Delta/\sigma$  for survey unit L3-012-101, based on the data for surface soil samples collected during the RA of survey unit L3-012-101, was calculated as follows:

**Equation 3**

$$\Delta/\sigma = (1 - 0.016) / 0.002 = 492$$

As the calculated relative shift was greater than three (3), a value of three (3) was used as the adjusted  $\Delta/\sigma$ . Both the Type I error (i.e.,  $\alpha$  value) and the Type II error (i.e.,  $\beta$  value) was set at 0.05. The sample size from Table 5.5 of MARSSIM that equates to the Type I and Type II error of 0.05 for use with the Sign Test is an N value of fourteen (14).

A Prospective Power Curve was generated using COMPASS, a software package developed under the sponsorship of the United States Nuclear Regulatory Commission (USNRC) for implementation of the MARSSIM in support of the decommissioning license termination rule (10CFR20, Subpart E). The result of the COMPASS computer run showed adequate power for the survey design.

Sample locations were inadvertently selected based on a systematic triangular grid with a random starting point rather than simple random locations. This was deemed acceptable during data review due to multiple factors. First, the survey unit was small in terms of physical size for a Class 3 survey unit, increasing the probability that sample locations would be located relatively close to each other if the two sampling designs were compared. Second, the correct number of samples were taken for statistical testing, and all data derived from the sampling is acceptable for use. Third, both MARSSIM and EPA QA/G-5S, *Guidance on Choosing a Sampling Design for Environmental Data Collection* (Reference 10) discuss the similarities between simple random and grid sampling. MARSSIM suggests using random sampling to ensure measurements are independent and meet the requirements of the statistical tests, while systematic grids with a random starting point are utilized because there is an increased probability of small areas of elevated activity. This is mirrored in a discussion of the limitations of simple random sampling in



Section 5.4 of EPA QA/G-5S, which states that random sampling may not be uniformly dispersed and that the method designs ignore all prior information regarding the site, except for the expected variability of the site or process measurements. Section 5.4 of EPA QA/G-5S also states that “Because of these limitations, simple random sampling is seldom recommended for use in practice except for relatively uniform populations.... Alternatively, one may use systematic sampling or quasi-random sampling to overcome these same limitations.”

Lastly, MARSSIM discusses a similar situation in Section 8.3.4, with the exception that the role is reversed. The evaluation is whether sampling should be performed with a triangular grid in a Class 3 survey unit where residual radioactivity is present. The discussion follows: “If one determines that residual radioactivity is definitely present, this would indicate that the survey unit was initially mis-classified. Ordinarily, MARSSIM recommends a resurvey using a Class 1 or Class 2 design. If one determines that the survey unit is a Class 2, a resurvey might be avoided if the survey unit does not exceed the maximum size for such a classification. In this case, the only difference in survey design would be whether the measurements were obtained on a random or on a triangular grid. Provided that the initial survey’s scanning methodology is sufficiently sensitive to detect areas at DCGL<sub>w</sub> without the use of an area factor, this difference in the survey grids alone would not affect the outcome of the statistical analysis. Therefore, if the above conditions were met, a resurvey might not be necessary.” This reasoning, along with the others discussed above, provide the basis that the systematic sampling, rather than random, is sufficient to demonstrate compliance in survey unit L3-012-101.

The systematic locations of the soil samples were selected using Visual Sample Plan (VSP), in accordance with LC-FS-PR-002. Input parameters included use of aerial photographs and the systematic sampling tool set with a predetermined number (14) of samples. The systematic coordinates generated with VSP were integrated with a GPS to identify sample locations in the field. Table 5-3 lists the systematic samples collected for FSS and the corresponding GPS coordinates, based on the Wisconsin State Plane North American Datum 1983 coordinate system.

**Table 5-3 – Systematic Sample Locations**

Sample ID	Northing	Easting
L3-012-101-FSPA-001-AV	571401.6346	1642530.4782
L3-012-101-FSGS-002-SS	571516.7012	1642085.4421
L3-012-101-FSGS-003-SS	571631.7678	1642156.8758
L3-012-101-FSGS-004-SS	571631.7678	1642530.4782

Sample ID	Northing	Easting
L3-012-101-FSGS-005-SS	571748.8344	1642193.3095
L3-012-101-FSGS-006-SS	571861.9010	1642264.7433
L3-012-101-FSGS-007-SS	571861.9010	1642397.6107
L3-012-101-FSGS-008-SS	571861.9010	1642530.4782
L3-012-101-FSGS-009-SS	571976.9676	1642331.1770
L3-012-101-FSGS-010-SS	571976.9676	1642464.0445
L3-012-101-FSGS-011-SS	572092.0342	1642397.6107
L3-012-101-FSGS-012-SS	572092.0342	1642530.4782
L3-012-101-FSGS-013-SS	572207.1007	1642464.0445
L3-012-101-FSGS-014-SS	572322.1673	1642530.4782

In accordance with the sample plan, at least one (1) judgmental sample was required from the survey unit. The number of judgmental samples actually obtained was two (2), which brings the total number of samples collected for the FSS of survey unit L3-012-101 to sixteen (16). Table 5-4 lists the judgmental samples collected for FSS and the corresponding GPS coordinates.

**Table 5-4 – Judgmental Sample Locations**

Sample ID	Northing	Easting
L3-012-101-FJGS-015-SS	571695.0840	1642535.1240
L3-012-101-FSGS-001-SS	571401.6346	1642530.4782

The LACBWR LTP, Section 5.1 states that soil samples will be collected during FSS to confirm the HTD to surrogate radionuclide ratio. Ten percent (10%) of the FSS samples collected from open land survey units will be analyzed for HTD ROC. Only the HTD radionuclide included as ROC (Sr-90) will be analyzed in the FSS confirmatory samples. In addition, if any sample has a SOF of 10% of the Operational DCGL or more, it must be sent for HTD ROC analysis. For samples with positive results for both the HTD ROC and the corresponding surrogate radionuclide (Cs-137), the HTD surrogate ratio will be derived and compared against the 95% UCL ratio (see Table 5-1). If the derived ratio from the confirmatory samples exceeds the 95% UCL ratio, then the area-specific ratio as determined by actual survey data will be used.

The selection of one (1) soil sample, L3-012-101-FSGS-003-SS, met the requirement that a minimum of 10% of the samples collected for the FSS of survey unit L3-012-101 be analyzed for HTD ROC.

The implementation of quality control measures as referenced by LTP, Section 5.9 and LaCrosseSolutions LC-QA-PN-001, *Final Status Survey Quality Assurance Project Plan* (QAPP) (Reference 11) includes the collection of a soil sample for “split sample” analysis on 5% of the soil samples taken in a survey unit with the locations selected at random. One (1) soil sample, L3-012-101-FQGS-007-SS, was designated for split sample QC analysis for the FSS of this survey unit.

The LTP, Section 5.6.4.4 states that for Class 3 survey units, judgmental surface scans will typically be performed on areas with the greatest potential of contamination and that for open land areas, this will include surface drainage areas and collection points. For survey unit L3-012-101, 10% scan coverage was selected, which equates to 1,989 m<sup>2</sup>. One hundred and seventy (170) scan lanes within four (4) separate scan areas were established, constituting a total area of 2,007 m<sup>2</sup> (more than the required minimum).

For this Class 3 open land survey unit, the “Investigation Levels” for area scanning and soil sample measurement results are those levels specified in LTP, Table 5-16, and are reproduced below in Table 5-5.

**Table 5-5 – Investigation Levels**

Classification	Scan Investigation Levels	Direct Investigation Levels
Class 3	>Operational DCGL or >MDC <sub>scan</sub> if MDC <sub>scan</sub> is greater than Operational DCGL	>0.5 Operational DCGL

Table 5-6 provides a synopsis of the survey design for survey unit L3-012-101.

**Table 5-6 – Synopsis of Survey Design**

Feature	Design Criteria	Basis
Survey Unit Surface Area	19,885 m <sup>2</sup>	GPS measurements for area
Number of Systematic Samples (N)	14	<ul style="list-style-type: none"> <li>• <math>\sigma = 0.002</math></li> <li>• UBGR = SOF of 1</li> <li>• LBGR = 0.016</li> <li>• Type I &amp; II error = 0.05</li> <li>• <math>\Delta/\sigma = 3</math> (adjusted)</li> <li>• MARSSIM Table 5.5</li> </ul>

Feature	Design Criteria	Basis
Action Levels	Co-60: 1.915 pCi/g Cs-137: 8.655 pCi/g Eu-152: 4.255 pCi/g Eu-154: 3.945 pCi/g	50 % Operational DCGLs for soil, LTP, Table 5-6, Release Record, Table 5-2
Scan Investigation Level	>Operational DCGL	LTP, Table 5-16
Direct Investigation Level	>0.5 Operational DCGL	LTP, Table 5-16
Scan Areal Coverage	2007 m <sup>2</sup> , ~10% areal coverage	LTP, Table 5-15
Judgmental Samples	1 2	Per Survey Design Actual Number Obtained
HTD ROC Analysis	1	LTP, Section 5.1
QC	1 split sample selected at random 2	LTP, Section 5.9 Actual Number Obtained

## 6. SURVEY IMPLEMENTATION

For survey unit L3-012-101, compliance with the unrestricted release criteria was demonstrated through a combination of soil scanning with a Ludlum Model 44-10 gamma detector and the sampling of soil for isotopic analysis.

An FSS Supervisor performed a visual inspection and walk-down of the survey unit on September 3, 2019, prior to performing FSS. The purpose of the walk-down was to assess the physical condition of the survey unit, evaluate access points and travel paths, and identify potentially hazardous conditions. This survey unit was made up of mostly asphalt and gravel travel paths to and from the site.

FSS field activities were conducted under the FSS Sample Plan, which included DQOs, survey design, detailed FSS instructions, job safety analysis, and related procedures for reference. FSS field activities were projected to take four (4) working days to complete. Daily briefings were conducted to discuss the expectations for job performance and to review safety aspects of the job. A “Field Log” was used to document field activities and other information pertaining to the performance of the FSS. FSS field activities commenced on September 5, 2019, and were concluded on September 20, 2019.

A total of one hundred and seventy (170) different scan lanes within four (4) separate areas, constituting an areal coverage of 2,007 m<sup>2</sup>, were scanned using a Ludlum 2350-1 paired with a Ludlum Model 44-10 (2” x 2”) sodium iodide (NaI) detector. Scan areas were biased to areas with a higher potential for contamination (e.g., low points, culverts, outfall piping).



The background was established as the average of five (5) 1-minute static measurements, while maintaining the detector 6" from the soil. In survey unit L3-012-101, background mean ranged from 4,489 cpm to 5,030 cpm.

All designated scan areas were scanned using a Ludlum 2350-1 paired with a Model 44-10 2" x 2" NaI detector operated in the rate-meter mode and using audio response. The probe was positioned no more than 3" from the ground and was moved at a scan speed of approximately 0.5 meters per second. In accordance with RS-TD-313196-006, *Ludlum Model 44-10 Detector Sensitivity* (Reference 12), scan MDC was sufficient to detect residual radioactivity at the action level (50% of the adjusted surrogate Cs-137 DCGL, or 8.655 pCi/g). Complete scan results are provided in Attachment 2.

The fourteen (14) systematic sample locations were marked with flags based on GPS coordinates provided. Each soil sample consisted of approximately one (1) liter of soil. The soil sample media was sifted to remove stones and other media larger than one (1) centimeter in diameter. All soil samples were collected, controlled, transported, stored, and transferred to the on-site laboratory using the Chain-of-Custody process from LC-FS-PR-012, *Chain of Custody Protocol* (Reference 13), and in accordance with LC-FS-PR-004, *Sample Media Collection for Site Characterization and Final Status Survey* (Reference 14), LC-FS-PR-005, *Sample Media Preparation for Site Characterization and Final Status Survey* (Reference 15), and LC-FS-PR-001, *Sample Storage* (Reference 16).

The survey design specified one (1) sample was required for HTD ROC analysis. Sample L3-012-101-FSGS-004-SS was selected for HTD radionuclide analysis.

The implementation of survey specific QC measures included the collection of two (2) samples (L3-012-101-FQGS-007-SS, L3-012-101-FSGS-007-SS SPLIT) for split and duplicate sample analysis.

## 7. SURVEY RESULTS

All areas identified in the FSS sample plan were scanned for elevated activity levels. Four (4) alarms were verified during the scan survey. No additional investigational samples were collected in response to the alarms because the alarms occurred on pre and post systematic sample collections. The readings were consistent with each other, and a sample representing the area of alarm was collected as part of the systematic sample population. Table 7-1 provides an overview of the scan results for all scan lanes (identified as sub area A, B, C or D for a total of 170, the 1 m<sup>2</sup> scan areas around each sample point location before and after sample collection (identified with "SP"), and QC locations (identified with a "QC"). Complete scan results are provided in Attachment 2.

**Table 7-1 – Synopsis of Scan Results**

<b>Scan Area</b>	<b>Highest Logged Reading (cpm)</b>	<b>Action Level<sup>(1)</sup> (cpm)</b>	<b># of Scan Alarms</b>	<b>Investigation Samples</b>
A01	4475	6502	0	0
A02	4649	6502	0	0
A03	4451	6502	0	0
A04	4496	6502	0	0
A05	4695	6502	0	0
A06	4523	6502	0	0
A07	4934	6502	0	0
A08	4358	6502	0	0
A09	4148	6502	0	0
A10	4583	6502	0	0
A11	4245	6502	0	0
A12	4602	6502	0	0
A13	4282	6502	0	0
A14	4316	6502	0	0
A15	4320	6502	0	0
A16	4295	6502	0	0
A17	4363	6502	0	0
A18	4385	6502	0	0
A19	4545	6502	0	0
A20	4910	6502	0	0
A21	4514	6502	0	0
A22	4377	6502	0	0
A23	5109	6502	0	0
A24	5096	6502	0	0
A25	5155	6502	0	0
A26	4991	6502	0	0
A27	5788	6502	0	0
A28	5633	6502	0	0
A29	5331	6502	0	0
A30	5577	6502	0	0
A31	5876	6502	0	0

Scan Area	Highest Logged Reading (cpm)	Action Level <sup>(1)</sup> (cpm)	# of Scan Alarms	Investigation Samples
A32	5535	6502	0	0
A33	5126	6502	0	0
A34	5022	6502	0	0
A35	4779	6502	0	0
A36	4518	6502	0	0
A37	4365	6502	0	0
A38	5397	6502	0	0
A39	4529	6502	0	0
A40	4478	6502	0	0
A41	4982	6502	0	0
A42	4955	6502	0	0
A43	4875	6502	0	0
A44	4894	6502	0	0
B01	6437	6826	0	0
B02	6229	6826	0	0
B03	5636	6826	0	0
B04	5834	6826	0	0
B05	5994	6826	0	0
B06	5723	6826	0	0
B07	5606	6826	0	0
B08	5569	6826	0	0
B09	5547	6826	0	0
B10	5216	6826	0	0
C01	4692	6251	0	0
C02	4315	6251	0	0
C03	4188	6251	0	0
C04	4203	6251	0	0
C05	4272	6251	0	0
C06	4815	6251	0	0
C07	4363	6251	0	0
C08	4382	6251	0	0
C09	4416	6251	0	0

Scan Area	Highest Logged Reading (cpm)	Action Level <sup>(1)</sup> (cpm)	# of Scan Alarms	Investigation Samples
C10	4513	6251	0	0
C11	4396	6251	0	0
C12	4561	6251	0	0
C13	4406	6251	0	0
C14	4278	6251	0	0
C15	4340	6251	0	0
C16	4276	6251	0	0
C17	4458	6251	0	0
C18	4968	6251	0	0
C19	4271	6251	0	0
C20	4697	6251	0	0
C21	4337	6251	0	0
C22	5001	6251	0	0
C23	5463	6251	0	0
C24	4766	6251	0	0
C25	5382	6251	0	0
C26	4962	6251	0	0
C27	4919	6251	0	0
C28	4839	6251	0	0
C29	4963	6251	0	0
C30	5385	6251	0	0
C31	5100	6251	0	0
C32	4180	6251	0	0
C33	4411	6251	0	0
C34	3983	6251	0	0
C35	4328	6251	0	0
C36	4537	6251	0	0
C37	4426	6251	0	0
C38	4094	6251	0	0
C39	4531	6251	0	0
C40	3993	6251	0	0
C41	4515	6251	0	0

Scan Area	Highest Logged Reading (cpm)	Action Level <sup>(1)</sup> (cpm)	# of Scan Alarms	Investigation Samples
C42	4100	6251	0	0
C43	4148	6251	0	0
C44	3781	6251	0	0
C45	3934	6251	0	0
C46	4095	6251	0	0
C47	4054	6251	0	0
C48	4246	6251	0	0
C49	4316	6251	0	0
C50	4041	6251	0	0
C51	4460	6251	0	0
C52	4205	6251	0	0
C53	4762	6251	0	0
C54	4581	6251	0	0
C55	3970	6251	0	0
C56	4946	6251	0	0
C57	4945	6251	0	0
C58	4467	6251	0	0
C59	4905	6251	0	0
C60	5820	6251	0	0
D01	6688	6792	0	0
D02	6278	6792	0	0
D03	5919	6792	0	0
D04	5738	6792	0	0
D05	5416	6792	0	0
D06	5200	6792	0	0
D07	5435	6792	0	0
D08	5966	6792	0	0
D09	5487	6792	0	0
D10	4905	6792	0	0
D11	5235	6792	0	0
D12	5273	6792	0	0
D13	4849	6792	0	0

Scan Area	Highest Logged Reading (cpm)	Action Level <sup>(1)</sup> (cpm)	# of Scan Alarms	Investigation Samples
D14	4562	6792	0	0
D15	4155	6792	0	0
D16	4717	6792	0	0
D17	3842	6792	0	0
D18	4000	6792	0	0
D19	4043	6792	0	0
D20	4395	6792	0	0
D21	3945	6792	0	0
D22	3779	6792	0	0
D23	4067	6792	0	0
D24	3909	6792	0	0
D25	4327	6792	0	0
D26	4297	6792	0	0
D27	5199	6792	0	0
D28	4616	6792	0	0
D29	4436	6792	0	0
D30	4811	6792	0	0
D31	4437	6792	0	0
D32	4291	6792	0	0
D33	4291	6792	0	0
D34	3930	6792	0	0
D35	4495	6792	0	0
D36	4841	6792	0	0
D37	5071	6792	0	0
D38	4960	6792	0	0
D39	4382	6792	0	0
D40	5058	6792	0	0
D41	4207	6792	0	0
D42	3935	6792	0	0
D43	3967	6792	0	0
D44	4340	6792	0	0
D45	3889	6792	0	0

Scan Area	Highest Logged Reading (cpm)	Action Level <sup>(1)</sup> (cpm)	# of Scan Alarms	Investigation Samples
D46	3791	6792	0	0
D47	3690	6792	0	0
D48	3595	6792	0	0
D49	3696	6792	0	0
D50	3758	6792	0	0
D51	3660	6792	0	0
D52	3539	6792	0	0
D53	3956	6792	0	0
D54	4187	6792	0	0
D55	3620	6792	0	0
D56	3725	6792	0	0
SP 1A	4885	7427	0	0
SP 01	5025	7427	0	0
SP 02	5067	7427	0	0
SP 03	5851	7427	0	0
SP 04	6548	7427	0	0
SP 05	4933	7427	0	0
SP 06	5616	7427	0	0
SP 07	6229	7427	0	0
QC SP 07	5119	6568	0	0
SP 08	5773	7427	0	0
SP 09	7931	7427	2	0
SP 10	4132	7427	0	0
SP 11	4401	7427	0	0
SP 12	8145	7427	2	0
SP 13	4950	7427	0	0
SP 14	5807	7427	0	0
SP 15	6244	7427	0	0
QC 03	5376	6275	0	0
QC 04	5475	6275	0	0



(1) Action Level based on the average background plus 1,762 cpm (50% OpDCGL equivalent).

The on-site laboratory analyzed the fourteen (14) soil samples taken for non-parametric statistical testing using the on-site gamma spectroscopy system. A summary of the results for the fourteen (14) samples collected for non-parametric statistical testing is provided in Table 7-2. Gamma spectroscopy results revealed that Cs-137 was positively identified in three (3) of the systematic samples. No other ROC were positively identified. The concentration for Sr-90 was inferred based on the ratio specified in Table 5-1. The complete gamma spectroscopy reports are presented in Attachment 7. The basic statistics for the systematic sample population are summarized in Table 7-3.

**Table 7-2 - Summary of Gamma Spectroscopy Results for Samples Comprising the Statistical Sample Population**

Sample ID	Co-60 (pCi/g)	Cs-137 (pCi/g)	Eu-152 (pCi/g)	Eu-154 (pCi/g)	Sr-90 (pCi/g)
L3-012-101-FSPA-001-AV	4.98E-02	7.10E-02	4.56E-02	7.79E-02	3.56E-02
L3-012-101-FSGS-002-SS	1.83E-02	8.88E-02	2.87E-03	4.33E-03	4.46E-02
L3-012-101-FSGS-003-SS	5.13E-02	4.86E-02	1.05E-01	2.65E-02	2.44E-02
L3-012-101-FSGS-004-SS	6.93E-02	<b>1.66E-01</b>	0.00E+00	4.03E-01	8.33E-02
L3-012-101-FSGS-005-SS	8.85E-02	<b>1.28E-01</b>	1.20E-01	1.40E-01	6.43E-02
L3-012-101-FSGS-006-SS	1.40E-01	1.24E-02	1.23E-03	7.92E-02	6.22E-02
L3-012-101-FSGS-007-SS	6.75E-02	6.54E-02	0.00E+00	5.57E-02	3.28E-02
L3-012-101-FSGS-008-SS	3.70E-02	<b>5.42E-02</b>	1.15E-01	1.69E-02	2.72E-02
L3-012-101-FSGS-009-SS	4.38E-02	6.38E-02	2.61E-01	6.94E-02	3.20E-02
L3-012-101-FSGS-010-SS	5.44E-02	4.16E-02	1.12E-01	6.94E-02	2.09E-02
L3-012-101-FSGS-011-SS	5.02E-02	3.63E-02	1.30E-02	8.69E-02	1.82E-02
L3-012-101-FSGS-012-SS	4.40E-02	1.26E-01	2.91E-01	5.26E-01	6.33E-02
L3-012-101-FSGS-013-SS	0.00E+00	4.96E-02	4.89E-02	1.55E-01	4.04E-02
L3-012-101-FSGS-014-SS	9.07E-02	8.71E-02	1.67E-01	4.15E-02	4.37E-02

Note: Bold values indicate concentrations greater than MDC.

**Table 7-3 - Basic Statistical Properties of Systematic Sample Population**

ROC	Mean (pCi/g)	Median (pCi/g)	Max (pCi/g)	Min (pCi/g)	Std. Dev. (pCi/g)	BcDCGL (pCi/g)	Avg. SOF per ROC	Avg. Dose Per ROC
Co-60	5.49E-02	5.08E-02	1.04E-01	0.00E+00	2.80E-02	1.06E+01	5.18E-03	1.30E-01
Sr-90	4.24E-02	3.80E-02	8.33E-02	1.82E-02	1.93E-02	5.47E+03	7.74E-06	1.94E-04
Cs-137	7.42E-02	6.46E-02	1.66E-01	1.24E-02	4.17E-02	4.83E+01	1.54E-03	3.84E-02
Eu-152	9.16E-02	7.70E-02	2.91E-01	0.00E+00	9.57E-02	2.36E+01	3.88E-03	9.70E-02
Eu-154	9.18E-02	7.25E-02	4.03E-01	4.33E-03	9.89E-02	2.19E+01	4.19E-03	1.05E-01

The off-site laboratory, GEL Laboratories, processed one (1) sample selected for HTD ROC analysis, sample L3-012-101-FSGS-004-SS. Only the HTD ROC Sr-90 was included in the analysis. All analyses met the required MDC.

Sr-90 was not detected in the off-site analysis of sample L3-012-101-FSGS-004-SS. The results are provided in Table 7-4.

**Table 7-4 - Off-Site Analysis Results**

Sample ID	ROC	Result (pCi/g)	Uncertainty (pCi/g)	MDC (pCi/g)	>MDC
L3-012-101-FSGS-004-SS	Sr-90	1.12E01	8.40E-02	1.33E-01	No

The on-site laboratory analyzed two (2) judgmental soil samples using the on-site gamma spectroscopy system. A summary of the analytical results for the judgmental soil samples are provided in Table 7-5. Gamma spectroscopy results revealed that Cs-137 was positively identified in both of the judgmental samples. No other ROC were positively identified. The concentrations for Sr-90 were inferred based on the ratio specified in Table 5-1. The complete gamma spectroscopy reports are presented in Attachment 7.

**Table 7-5 - Summary of Gamma Spectroscopy Results for Judgmental Samples**

Sample ID	Co-60 (pCi/g)	Cs-137 (pCi/g)	Eu-152 (pCi/g)	Eu-154 (pCi/g)	Sr-90 (pCi/g)
L3-012-101-FJGS-015-SS	4.95E-02	<b>6.53E-02</b>	4.00E-02	1.05E-01	3.28E-02
L3-012-101-FSGS-001-SS	6.99E-02	<b>4.81E-02</b>	1.28E-01	1.12E-01	2.41E-02

**Note: Bold values indicate concentrations greater than MDC.**

The implementation of survey specific QC measures included the collection of two (2) samples (L3-012-101-FQGS-007-SS, L3-012-101-FSGS-007-SS SPLIT) for split and duplicate sample analysis. The on-site laboratory analyzed the QC samples using the on-site gamma spectroscopy system. A summary of the analytical results for the QC samples

are provided in Table 7-6. Gamma spectroscopy results revealed that no ROC were positively identified in any QC sample. The concentration for Sr-90 was inferred based on the ratio specified in Table 5-1.

**Table 7-6 - Summary of Gamma Spectroscopy Results for QC Samples**

Sample ID	Co-60 (pCi/g)	Cs-137 (pCi/g)	Eu-152 (pCi/g)	Eu-154 (pCi/g)	Sr-90 (pCi/g)
L3-012-101-FQGS-007-SS	2.54E-03	3.30E-03	0.00E+00	2.32E-02	1.00E-05
L3-012-101-FSGS-007-SS SPLIT	7.51E-02	4.60E-02	8.49E-02	8.49E-02	2.31E-02

**Note: Bold values indicate concentrations greater than MDC.**

The SOF or “unity rule” is the mathematical test used to evaluate compliance with radiological criteria for license termination when more than one radionuclide has been determined to be potentially present. The equation for the unity rule is:

**Equation 4**

$$\frac{C_1}{DCGL_1} + \frac{C_2}{DCGL_2} + \dots + \frac{C_n}{DCGL_n} \leq 1$$

Where:  $C_n$  = concentration of radionuclide  $n$

$DCGL_n$  = DCGL of radionuclide  $n$ .

The results of the unity rule calculation for the ROC in the systematic sample population for survey unit L3-012-101 are provided in Table 7-7.

**Table 7-7 - Sum-of-Fractions for Systematic and QC Samples**

Sample ID	Fraction of Operational DCGL					SOF
	Co-60	Cs-137	Eu-152	Eu-154	Sr-90	
L1-012-101-FSPA-001-AV	0.01300	0.00408	0.00536	0.00987	0.00002	0.03234
L1-012-101-FSGS-002-SS	0.00478	0.00511	0.00034	0.00055	0.00002	0.01079
L1-012-101-FSGS-003-SS	0.01339	0.00279	0.01234	0.00336	0.00001	0.03190
L1-012-101-FSGS-004-SS	0.01809	0.00955	0.00000	0.05108	0.00004	0.07876
L1-012-101-FSGS-005-SS	0.02311	0.00736	0.01410	0.01774	0.00003	0.06235
L1-012-101-FSGS-006-SS	0.02715	0.00071	0.00014	0.01004	0.00003	0.03805
L1-012-101-FSGS-007-SS	0.01762	0.00376	0.00000	0.00706	0.00002	0.02846
L1-012-101-FSGS-008-SS	0.00966	0.00312	0.01351	0.00214	0.00001	0.02845
L1-012-101-FSGS-009-SS	0.01144	0.00367	0.03067	0.00880	0.00002	0.05459
L1-012-101-FSGS-010-SS	0.01420	0.00239	0.01316	0.00880	0.00001	0.03856

L1-012-101-FSGS-011-SS	0.01311	0.00209	0.00153	0.01101	0.00001	0.02775
L1-012-101-FSGS-012-SS	0.01149	0.00725	0.03420	0.00667	0.00003	0.05963
L1-012-101-FSGS-013-SS	0.00000	0.00285	0.00575	0.01965	0.00002	0.02826
L1-012-101-FSGS-014-SS	0.02368	0.00501	0.01962	0.00526	0.00002	0.05360
L1-010-106-FQGS-007-SS	0.00254	0.00330	0.00000	0.02319	0.00001	0.02904
L1-010-106-FSGS-007-SS SPLIT	0.01961	0.00265	0.00998	0.00085	0.00001	0.03309

#### Systematic Samples

Number of Systematic Samples =	14
# of Systematic Samples with SOF $\geq 1$ =	0
# of Systematic Samples with SOF > 0.1 (HTD Assessment) =	0
Max Individual Systematic Sample SOF =	0.0788
Mean Systematic Sample SOF =	0.0410

The results of the unity rule calculation for the ROC in the judgmental sample populations for survey unit L3-012-101 are provided in Table 7-8.

**Table 7-8 – Sum-of-Fractions for Judgmental Samples**

Sample ID	Fraction of Operational DCGL					SOF
	Co-60	Cs-137	Eu-152	Eu-154	Sr-90	
L1-010-106-FJGS-015-SS	0.01292	0.00376	0.00470	0.01331	0.00002	0.03470
L1-010-106-FSGS-001-SS	0.01825	0.00277	0.01504	0.01420	0.00001	0.05027

#### Judgmental Samples

Number of Judgmental Samples =	2
# of Judgmental Samples with SOF $\geq 1$ =	0
# of Judgmental Samples with SOF > 0.1 (HTD Assessment) =	0
Max Individual Judgmental Sample SOF =	0.0503

## 8. QUALITY CONTROL

The on-site laboratory processed two (2) split and duplicate samples (L3-012-101-FQGS-007-SS and L3-012-101-FSGS-007-SS SPLIT) using gamma spectroscopy analysis. The data was evaluated using USNRC acceptance criteria specified in Inspection Procedure No. 84750, *Radioactive Waste Treatment, and Effluent and Environmental Monitoring* (Reference 17). K-40 was substituted for the assessment, because Cs-137 was not identified

in either the standard or comparison sample. There was acceptable agreement between field split and duplicate results. Refer to Attachment 4 for data and quality control analysis results.

## **9. INVESTIGATIONS AND RESULTS**

No investigations were performed during the performance or analyses of the survey.

## **10. REMEDIATION AND RESULTS**

No radiological remedial action as described by MARSSIM Section 5.4 was performed in this survey unit prior to or as a result of the FSS. Chapter 4 of the LTP determined that remediation beyond that required to meet the release criteria is unnecessary and that the remaining residual radioactivity in soil was ALARA.

## **11. CHANGES FROM THE FINAL STATUS SURVEY PLAN**

The FSS sample plan specified that the sample locations for use with the Sign test would be selected at random. Inadvertently, the sample locations were selected based on a systematic grid with a random starting point. A justification for using systematic sample locations in a Class 3 open land survey unit is provided in Section 5 of this release record.

## **12. DATA QUALITY ASSESSMENT (DQA)**

The DQO sample design and data were reviewed in accordance with LC-FS-PR-008, *Final Status Survey Data Assessment* (Reference 18) for completeness and consistency. Documentation was complete and legible. Surveys and the collection of samples were consistent with the DQOs and were sufficient to ensure that the survey unit was properly designated as Class 3. The survey design had adequate power as indicated by the Retrospective Power Curve (see Attachment 6).

The measurement results indicated that all samples were less than a SOF of one (1) when compared to the OpDCGLs.

Although MARSSIM states that the Sign Test need not be performed in the instance that no measurements surpass the Operational DCGL, the test was conducted to demonstrate coherence to the statistical principles of the DQO process. The Sign Test was performed on the data and compared to the original assumptions of the DQOs. The evaluation of the Sign Test results clearly demonstrates that the survey unit passes the unrestricted release criteria,

thus, the null hypothesis is rejected. The results of the Sign Test are presented in Attachment 3.

The preliminary data review consisted of calculating basic statistical quantities (e.g., mean, median, standard deviation). All data was considered valid including negative values, zeros, values reported below the MDC, and values with uncertainties that exceeded two standard deviations. The mean and median values for each ROC were well below the respective Operational DCGLs. Also, the retrospective power curve shows that a sufficient number of samples were collected to achieve the desired power. Therefore, the survey unit meets the unrestricted release criteria with adequate power as required by the DQOs.

The mean of all identified isotopes are less than the Consultation Triggers for Residential Soil Concentration depicted in Table H.1 of NUREG 1757, Vol.1, Rev. 2 (MOU Table 1). The full table is included in Attachment 5 of this release record.

The data for Cs-137 is presented graphically through a frequency plot and quantile plot. All graphical presentations are provided in Attachment 6.

### **13. ANOMALIES**

No anomalies were observed during the performance or analyses of the survey.

### **14. CONCLUSION**

Survey unit L3-012-101 has met the DQOs of the FSS plan. The ALARA criteria as specified in Chapter 4 of the LTP were achieved. The Elevated Measurement Comparison for soils was not applicable and remediation was not required.

All identified ROC were used for statistical testing to determine the adequacy of the survey unit for FSS. Evaluation of the data shows that none of the systematic ROC concentration values exceeds the OpDCGLs; therefore, in accordance with LTP Section 5.11, the survey unit meets the release criteria.

The sample data passed the Sign Test. The null hypothesis was rejected. The Retrospective Power Curve showed that adequate power was achieved. The survey unit is properly classified as Class 3.

The dose contribution from soil in survey unit L3-012-101 is 0.3699 mrem/yr TEDE, based on the average concentration of the ROC in samples used for non-parametric statistical sampling.

Survey unit L3-012-101 is acceptable for unrestricted release.

## 15. REFERENCES

1. LC-FS-PR-009, Final Status Survey Data Reporting
2. *La Crosse Boiling Water Reactor License Termination Plan*
3. LC-FS-PR-002, *Final Status Survey Package Development*
4. NUREG-1575, Revision 1, *Multi-Agency Radiation Survey and Site Investigation Manual (MARSSIM)*
5. *La Crosse Boiling Water Reactor Historical Site Assessment*
6. RS-TD-313196-004, *LACBWR Soil DCGL, Basement Concrete DCGL, and Buried Pipe DCGL*
7. RS-TD-313196-001, *Radionuclides of Concern during LACBWR Decommissioning*
8. NUREG-1757, Volume 2, Revision 1, *Consolidated Decommissioning Guidance – Characterization, Survey, and Determination of Radiological Criteria, Final Report*
9. LC-FS-TSD-002, *Operational Derived Concentration Guideline Levels for Final Status Survey*
10. LC-QA-PN-001, *Final Status Survey Quality Assurance Project Plan*
11. EPA QA/G-5S, *Guidance on Choosing a Sampling Design for Environmental Data Collection*
12. RS-TD-313196-006, *Ludlum Model 44-10 Detector Sensitivity*
13. LC-FS-PR-012, *Chain of Custody Protocol*
14. LC-FS-PR-004, *Sample Media Collection for Site Characterization and Final Status Survey*
15. LC-FS-PR-005, *Sample Media Preparation for Site Characterization and Final Status Survey*
16. LC-FS-PR-001, *Sample Storage*
17. USNRC Inspection Procedure No. 84750, *Radioactive Waste Treatment, and Effluent and Environmental Monitoring*
18. LC-FS-PR-008, *Final Status Survey Data Assessment*

## 16. ATTACHMENTS

- Attachment 1 – Figure
- Attachment 2 – Scan Data
- Attachment 3 – Sign Test
- Attachment 4 – Quality Control Assessment
- Attachment 5 – Consultation Triggers for Residential Soil Concentrations
- Attachment 6 – Graphical Presentations




Attachment 7 – Sample Analytical Reports

Attachment 8 – GEL Laboratories Analytical Reports

# **ATTACHMENT 1**

## **FIGURE**

**Figure 16-1 – Survey Unit L3-012-101 Random and Judgmental Sample Locations Map**

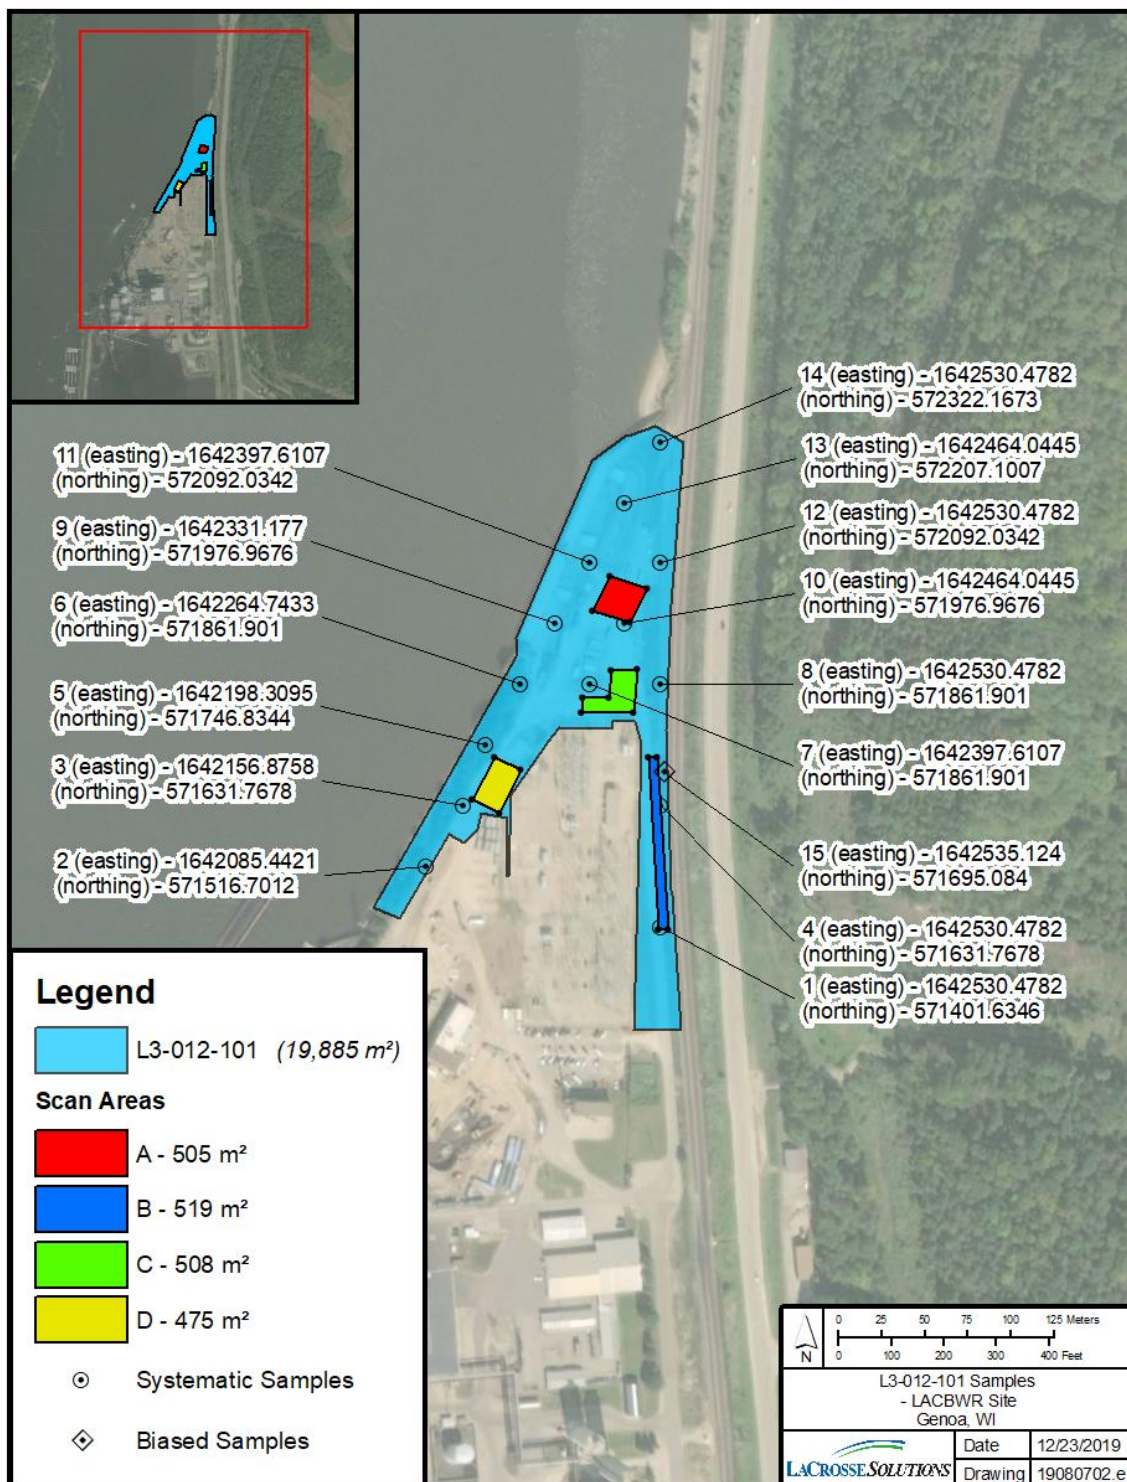

# **ATTACHMENT 2**

## **SCAN DATA**

**Table 16-1 – Survey Unit L3-012-101 Complete Scan Data**

<b>Detector Type</b>	<b>Detector ID</b>	<b>M2350-1 ID</b>	<b>Location</b>	<b>Scan Logged Result (cpm)</b>	<b>Avg Background (cpm)</b>	<b>Action Level (cpm)</b>	<b>Scan Alarms</b>
44-10	226940	117014	A01	4475	4740	6502	0
44-10	226940	117014	A02	4649	4740	6502	0
44-10	226940	117014	A03	4451	4740	6502	0
44-10	226940	117014	A04	4496	4740	6502	0
44-10	226940	117014	A05	4695	4740	6502	0
44-10	226940	117014	A06	4523	4740	6502	0
44-10	226940	117014	A07	4934	4740	6502	0
44-10	226940	117014	A08	4358	4740	6502	0
44-10	226940	117014	A09	4148	4740	6502	0
44-10	226940	117014	A10	4583	4740	6502	0
44-10	226940	117014	A11	4245	4740	6502	0
44-10	226940	117014	A12	4602	4740	6502	0
44-10	226940	117014	A13	4282	4740	6502	0
44-10	226940	117014	A14	4316	4740	6502	0
44-10	226940	117014	A15	4320	4740	6502	0
44-10	226940	117014	A16	4295	4740	6502	0
44-10	226940	117014	A17	4363	4740	6502	0
44-10	226940	117014	A18	4385	4740	6502	0
44-10	226940	117014	A19	4545	4740	6502	0
44-10	226940	117014	A20	4910	4740	6502	0
44-10	226940	117014	A21	4514	4740	6502	0
44-10	226940	117014	A22	4377	4740	6502	0
44-10	226940	117014	A23	5109	4740	6502	0
44-10	226940	117014	A24	5096	4740	6502	0
44-10	226940	117014	A25	5155	4740	6502	0
44-10	226940	117014	A26	4991	4740	6502	0
44-10	226940	117014	A27	5788	4740	6502	0
44-10	226940	117014	A28	5633	4740	6502	0
44-10	226940	117014	A29	5331	4740	6502	0
44-10	226940	117014	A30	5577	4740	6502	0
44-10	226940	117014	A31	5876	4740	6502	0
44-10	226940	117014	A32	5535	4740	6502	0

Detector Type	Detector ID	M2350-1 ID	Location	Scan Logged Result (cpm)	Avg Background (cpm)	Action Level (cpm)	Scan Alarms
44-10	226940	117014	A33	5126	4740	6502	0
44-10	226940	117014	A34	5022	4740	6502	0
44-10	226940	117014	A35	4779	4740	6502	0
44-10	226940	117014	A36	4518	4740	6502	0
44-10	226940	117014	A37	4365	4740	6502	0
44-10	226940	117014	A38	5397	4740	6502	0
44-10	226940	117014	A39	4529	4740	6502	0
44-10	226940	117014	A40	4478	4740	6502	0
44-10	226940	117014	A41	4982	4740	6502	0
44-10	226940	117014	A42	4955	4740	6502	0
44-10	226940	117014	A43	4875	4740	6502	0
44-10	226940	117014	A44	4894	4740	6502	0
44-10	226940	117014	B01	6437	5064	6826	0
44-10	226940	117014	B02	6229	5064	6826	0
44-10	226940	117014	B03	5636	5064	6826	0
44-10	226940	117014	B04	5834	5064	6826	0
44-10	226940	117014	B05	5994	5064	6826	0
44-10	226940	117014	B06	5723	5064	6826	0
44-10	226940	117014	B07	5606	5064	6826	0
44-10	226940	117014	B08	5569	5064	6826	0
44-10	226940	117014	B09	5547	5064	6826	0
44-10	226940	117014	B10	5216	5064	6826	0
44-10	215123	216185	C01	4692	4489	6251	0
44-10	215123	215185	C02	4315	4489	6251	0
44-10	215123	214185	C03	4188	4489	6251	0
44-10	215123	213185	C04	4203	4489	6251	0
44-10	215123	212185	C05	4272	4489	6251	0
44-10	215123	211185	C06	4815	4489	6251	0
44-10	215123	210185	C07	4363	4489	6251	0
44-10	215123	209185	C08	4382	4489	6251	0
44-10	215123	208185	C09	4416	4489	6251	0
44-10	215123	207185	C10	4513	4489	6251	0
44-10	215123	206185	C11	4396	4489	6251	0

Detector Type	Detector ID	M2350-1 ID	Location	Scan Logged Result (cpm)	Avg Background (cpm)	Action Level (cpm)	Scan Alarms
44-10	215123	205185	C12	4561	4489	6251	0
44-10	215123	204185	C13	4406	4489	6251	0
44-10	215123	203185	C14	4278	4489	6251	0
44-10	215123	202185	C15	4340	4489	6251	0
44-10	215123	201185	C16	4276	4489	6251	0
44-10	215123	200185	C17	4458	4489	6251	0
44-10	215123	199185	C18	4968	4489	6251	0
44-10	215123	198185	C19	4271	4489	6251	0
44-10	215123	197185	C20	4697	4489	6251	0
44-10	215123	196185	C21	4337	4489	6251	0
44-10	215123	195185	C22	5001	4489	6251	0
44-10	215123	194185	C23	5463	4489	6251	0
44-10	215123	193185	C24	4766	4489	6251	0
44-10	215123	192185	C25	5382	4489	6251	0
44-10	215123	191185	C26	4962	4489	6251	0
44-10	215123	190185	C27	4919	4489	6251	0
44-10	215123	189185	C28	4839	4489	6251	0
44-10	215123	188185	C29	4963	4489	6251	0
44-10	215123	187185	C30	5385	4489	6251	0
44-10	215123	186185	C31	5100	4489	6251	0
44-10	215123	185185	C32	4180	4489	6251	0
44-10	215123	184185	C33	4411	4489	6251	0
44-10	215123	183185	C34	3983	4489	6251	0
44-10	215123	182185	C35	4328	4489	6251	0
44-10	215123	181185	C36	4537	4489	6251	0
44-10	215123	180185	C37	4426	4489	6251	0
44-10	215123	179185	C38	4094	4489	6251	0
44-10	215123	178185	C39	4531	4489	6251	0
44-10	215123	177185	C40	3993	4489	6251	0
44-10	215123	176185	C41	4515	4489	6251	0
44-10	215123	175185	C42	4100	4489	6251	0
44-10	215123	174185	C43	4148	4489	6251	0
44-10	215123	173185	C44	3781	4489	6251	0



Detector Type	Detector ID	M2350-1 ID	Location	Scan Logged Result (cpm)	Avg Background (cpm)	Action Level (cpm)	Scan Alarms
44-10	215123	172185	C45	3934	4489	6251	0
44-10	215123	171185	C46	4095	4489	6251	0
44-10	215123	170185	C47	4054	4489	6251	0
44-10	215123	169185	C48	4246	4489	6251	0
44-10	215123	168185	C49	4316	4489	6251	0
44-10	215123	167185	C50	4041	4489	6251	0
44-10	215123	166185	C51	4460	4489	6251	0
44-10	215123	165185	C52	4205	4489	6251	0
44-10	215123	164185	C53	4762	4489	6251	0
44-10	215123	163185	C54	4581	4489	6251	0
44-10	215123	162185	C55	3970	4489	6251	0
44-10	215123	161185	C56	4946	4489	6251	0
44-10	215123	160185	C57	4945	4489	6251	0
44-10	215123	159185	C58	4467	4489	6251	0
44-10	215123	158185	C59	4905	4489	6251	0
44-10	215123	157185	C60	5820	4489	6251	0
44-10	215123	156185	D01	6688	5030	6792	0
44-10	215123	155185	D02	6278	5030	6792	0
44-10	215123	154185	D03	5919	5030	6792	0
44-10	215123	153185	D04	5738	5030	6792	0
44-10	215123	152185	D05	5416	5030	6792	0
44-10	215123	151185	D06	5200	5030	6792	0
44-10	215123	150185	D07	5435	5030	6792	0
44-10	215123	149185	D08	5966	5030	6792	0
44-10	215123	148185	D09	5487	5030	6792	0
44-10	215123	147185	D10	4905	5030	6792	0
44-10	215123	146185	D11	5235	5030	6792	0
44-10	215123	145185	D12	5273	5030	6792	0
44-10	215123	144185	D13	4849	5030	6792	0
44-10	215123	143185	D14	4562	5030	6792	0
44-10	215123	142185	D15	4155	5030	6792	0
44-10	215123	141185	D16	4717	5030	6792	0
44-10	215123	140185	D17	3842	5030	6792	0

Detector Type	Detector ID	M2350-1 ID	Location	Scan Logged Result (cpm)	Avg Background (cpm)	Action Level (cpm)	Scan Alarms
44-10	215123	139185	D18	4000	5030	6792	0
44-10	215123	138185	D19	4043	5030	6792	0
44-10	215123	137185	D20	4395	5030	6792	0
44-10	215123	136185	D21	3945	5030	6792	0
44-10	215123	135185	D22	3779	5030	6792	0
44-10	215123	134185	D23	4067	5030	6792	0
44-10	215123	133185	D24	3909	5030	6792	0
44-10	215123	132185	D25	4327	5030	6792	0
44-10	215123	131185	D26	4297	5030	6792	0
44-10	215123	130185	D27	5199	5030	6792	0
44-10	215123	129185	D28	4616	5030	6792	0
44-10	215123	128185	D29	4436	5030	6792	0
44-10	215123	127185	D30	4811	5030	6792	0
44-10	215123	126185	D31	4437	5030	6792	0
44-10	215123	125185	D32	4291	5030	6792	0
44-10	215123	124185	D33	4291	5030	6792	0
44-10	215123	123185	D34	3930	5030	6792	0
44-10	215123	122185	D35	4495	5030	6792	0
44-10	215123	121185	D36	4841	5030	6792	0
44-10	215123	120185	D37	5071	5030	6792	0
44-10	215123	119185	D38	4960	5030	6792	0
44-10	215123	118185	D39	4382	5030	6792	0
44-10	215123	117185	D40	5058	5030	6792	0
44-10	215123	116185	D41	4207	5030	6792	0
44-10	215123	115185	D42	3935	5030	6792	0
44-10	215123	114185	D43	3967	5030	6792	0
44-10	215123	113185	D44	4340	5030	6792	0
44-10	215123	112185	D45	3889	5030	6792	0
44-10	215123	111185	D46	3791	5030	6792	0
44-10	215123	110185	D47	3690	5030	6792	0
44-10	215123	109185	D48	3595	5030	6792	0
44-10	215123	108185	D49	3696	5030	6792	0
44-10	215123	107185	D50	3758	5030	6792	0

Detector Type	Detector ID	M2350-1 ID	Location	Scan Logged Result (cpm)	Avg Background (cpm)	Action Level (cpm)	Scan Alarms
44-10	215123	106185	D51	3660	5030	6792	0
44-10	215123	105185	D52	3539	5030	6792	0
44-10	215123	104185	D53	3956	5030	6792	0
44-10	215123	103185	D54	4187	5030	6792	0
44-10	215123	102185	D55	3620	5030	6792	0
44-10	215123	101185	D56	3725	5030	6792	0
44-10	226940	117041	SP 1A	4885	5665	7427	0
44-10	226940	117041	SP 01	5025	5665	7427	0
44-10	226940	117041	SP 01	4845	5665	7427	0
44-10	226940	117041	SP 02	5067	5665	7427	0
44-10	226940	117041	SP 02	4674	5665	7427	0
44-10	226940	117041	SP 03	5851	5665	7427	0
44-10	226940	117041	SP 03	5586	5665	7427	0
44-10	226940	117041	SP 04	6548	5665	7427	0
44-10	226940	117041	SP 04	6476	5665	7427	0
44-10	226940	117041	SP 05	4933	5665	7427	0
44-10	226940	117041	SP 05	4597	5665	7427	0
44-10	226940	117041	SP 06	5486	5665	7427	0
44-10	226940	117041	SP 06	5616	5665	7427	0
44-10	226940	117041	SP 07	6229	5665	7427	0
44-10	211680	98620	QC SP 07	5069	4806	6568	0
44-10	226940	117041	SP 07	6114	5665	7427	0
44-10	211680	98620	QC SP 07	5119	4806	6568	0
44-10	226940	117041	SP 08	5773	5665	7427	0
44-10	226940	117041	SP 08	5526	5665	7427	0
44-10	226940	117041	SP 09	7931	5665	7427	1
44-10	226940	117041	SP 09	7745	5665	7427	1
44-10	226940	117041	SP 10	4132	5665	7427	0
44-10	226940	117041	SP 10	4055	5665	7427	0
44-10	226940	117041	SP 11	4401	5665	7427	0
44-10	226940	117041	SP 11	4190	5665	7427	0

Detector Type	Detector ID	M2350-1 ID	Location	Scan Logged Result (cpm)	Avg Background (cpm)	Action Level (cpm)	Scan Alarms
44-10	226940	117041	SP 12	8145	5665	7427	1
44-10	226940	117041	SP 12	7868	5665	7427	1
44-10	226940	117041	SP 13	4950	5665	7427	0
44-10	226940	117041	SP 13	4942	5665	7427	0
44-10	226940	117041	SP 14	5506	5665	7427	0
44-10	226940	117041	SP 14	5807	5665	7427	0
44-10	226940	117041	SP 15	6244	5665	7427	0
44-10	226940	117041	SP 15	6013	5665	7427	0
44-10	226936	120635	QC03	5376	4513	6275	0
44-10	226936	120635	QC04	5475	4513	6275	0

# **ATTACHMENT 3**

## **SIGN TEST**

**Table 16-2 – Survey Unit L3-012-101 Sign Test**

#	SOF (Ws)	1-Ws	Sign
1	0.03234	0.97	+1
2	0.01079	0.99	+1
3	0.03190	0.97	+1
4	0.07876	0.92	+1
5	0.06235	0.94	+1
6	0.03805	0.96	+1
7	0.02846	0.97	+1
8	0.02845	0.97	+1
9	0.05537	0.94	+1
10	0.03856	0.96	+1
11	0.02775	0.97	+1
12	0.05963	0.94	+1
13	0.02826	0.97	+1
14	0.05360	0.95	+1

Number of positive differences  
 (S+) 14

Critical Value 10

Survey Unit Meets Acceptance  
 Criteria

# **ATTACHMENT 4**

## **QUALITY CONTROL ASSESSMENT**



**Table 16-3 – Survey Unit L3-012-101 QC Assessment**

Survey Unit #: 012		Survey Unit # L3-012-101		Survey Unit Name:		North End of Licensed Site																	
Sample Plan#:		L3-012-101																					
Sample Description: Comparison of split samples collected from surface soil samples from location #007 analyzed using gamma spectroscopy by on-site HPGe System. The standard sample was L3-012-101-FSGS-007-SS and the comparison sample was L3-012-101-FQGS-007-SS Split.																							
STANDARD						COMPARISON																	
Radionuclide	Activity Value	Standard Error	Resolution	Agreement Range (Low to High)		Activity Value	Standard Error	Comparison Ratio	Acceptable (Y/N)														
K-40	5.32E+00	6.54E-02	81.35	0.8	1.25	6.58E+00	8.60E-02	1.24	Y														
Comments/Corrective Actions: Neither sample reported Cs-137 as a detect. As such, K-40 substituted for comparison. The results are excepted.						Table is provided to show acceptance criteria used to assess split samples. <table><tr><td>Resolution</td><td>Acceptable Ratio</td></tr><tr><td>&lt;4</td><td>0.4-2.5</td></tr><tr><td>4-7</td><td>0.5-2.0</td></tr><tr><td>8-15</td><td>0.6-1.66</td></tr><tr><td>16-50</td><td>0.75-1.33</td></tr><tr><td>51-200</td><td>0.80-1.25</td></tr><tr><td>&gt;200</td><td>0.85-1.18</td></tr></table>				Resolution	Acceptable Ratio	<4	0.4-2.5	4-7	0.5-2.0	8-15	0.6-1.66	16-50	0.75-1.33	51-200	0.80-1.25	>200	0.85-1.18
										Resolution	Acceptable Ratio												
										<4	0.4-2.5												
										4-7	0.5-2.0												
										8-15	0.6-1.66												
										16-50	0.75-1.33												
										51-200	0.80-1.25												
										>200	0.85-1.18												

**ATTACHMENT 5**  
**CONSULTATION TRIGGERS FOR**  
**RESIDENTIAL AND**  
**COMMERCIAL/INDUSTRIAL SOIL**  
**CONCENTRATION**

**Table H.1 Consultation Triggers for Residential and Commercial/Industrial Soil Contamination (MOU Table 1)**


Except for radium-226, thorium-232, or total uranium, concentrations should be aggregated using a sum of the fraction approach to determine site-specific consultation trigger concentrations. This table is based on single contaminant concentrations for residential and commercial/industrial land use when using generally accepted exposure parameters. Table users should select the appropriate column based on the site's reasonably anticipated land use.

Radionuclide	Residential Soil Concentration	Industrial/Commercial Soil Concentration
H-3	228 pCi/g	423 pCi/g
C-14	46 pCi/g	123,000 pCi/g
Na-22	9 pCi/g	14 pCi/g
S-35	19,600 pCi/g	32,200,000 pCi/g
Cl-36	6 pCi/g	10,700 pCi/g
Ca-45	13,500 pCi/g	3,740,000 pCi/g
Sc-46	105 pCi/g	169 pCi/g
Mn-54	69 pCi/g	112 pCi/g
Fe-55	269,000 pCi/g	2,210,000 pCi/g
Co-57	873 pCi/g	1,420 pCi/g
Co-60	4 pCi/g	6 pCi/g
Ni-59	20,800 pCi/g	1,230,000 pCi/g
Ni-63	9,480 pCi/g	555,000 pCi/g
Sr-90+D	23 pCi/g	1,070 pCi/g
Nb-94	2 pCi/g	3 pCi/g
Tc-99	25 pCi/g	89,400 pCi/g
I-129	60 pCi/g	1,080 pCi/g
Cs-134	16 pCi/g	26 pCi/g
Cs-137+D	6 pCi/g	11 pCi/g
Eu-152	4 pCi/g	7 pCi/g
Eu-154	5 pCi/g	8 pCi/g
Ir-192	336 pCi/g	544 pCi/g
Pb-210+D	15 pCi/g	123 pCi/g
Ra-226	5 pCi/g	5 pCi/g
Ac-227+D	10 pCi/g	21 pCi/g
Th-228+D	15 pCi/g	25 pCi/g
Th-232	5 pCi/g	5 pCi/g
U-234	401 pCi/g	3,310 pCi/g
U-235+D	20 pCi/g	39 pCi/g
U-238+D	74 pCi/g	179 pCi/g
total uranium	47 mg/kg	1230 mg/kg
Pu-238	297 pCi/g	1,640 pCi/g
Pu-239	259 pCi/g	1,430 pCi/g
Pu-241	40,600 pCi/g	172,000 pCi/g
Am-241	187 pCi/g	568 pCi/g
Cm-242	32,200 pCi/g	344,000 pCi/g
Cm-243	35 pCi/g	67 pCi/g


# **ATTACHMENT 6**

## **GRAPHICAL PRESENTATIONS**


**Figure 16-2 - Quantile Plot for Cs-137 Concentration**

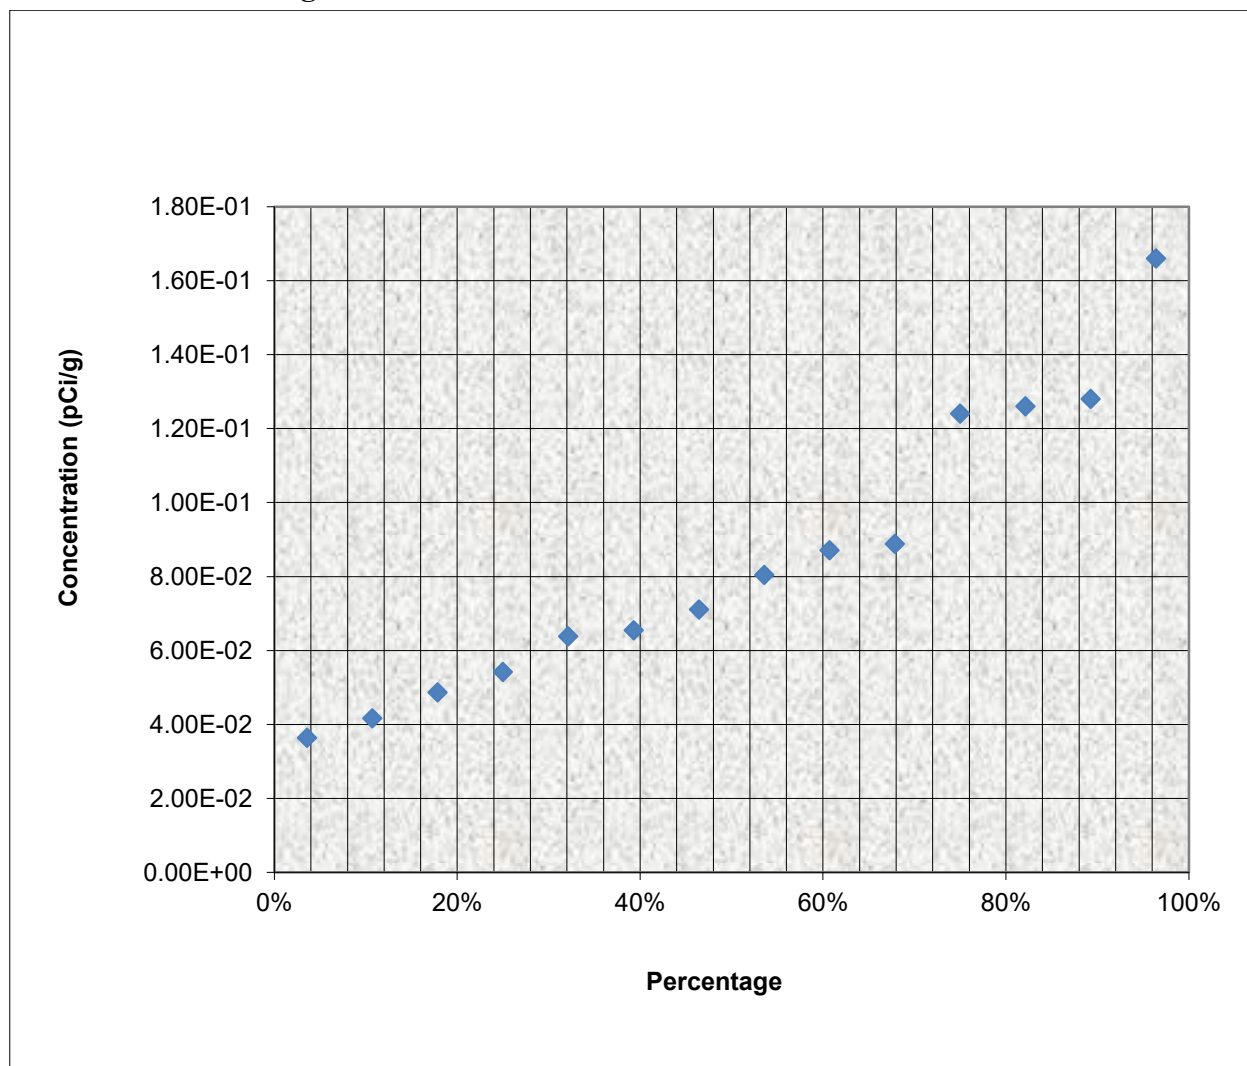

**Figure 16-3 - Histogram for Cs-137 Concentration**

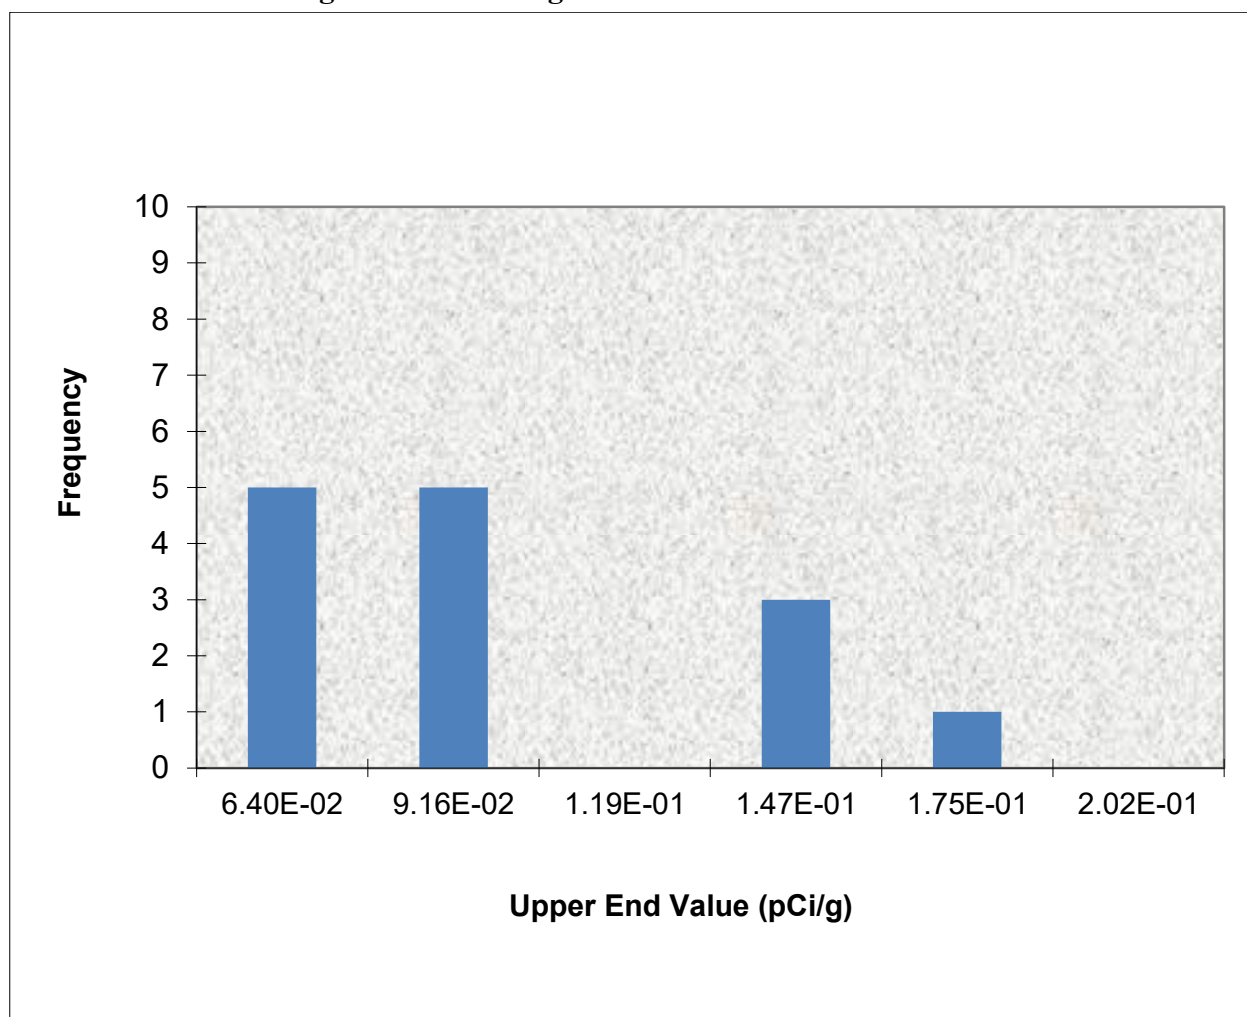

**Figure 16-4 - Retrospective Power Curve for Survey Unit L3-012-101**

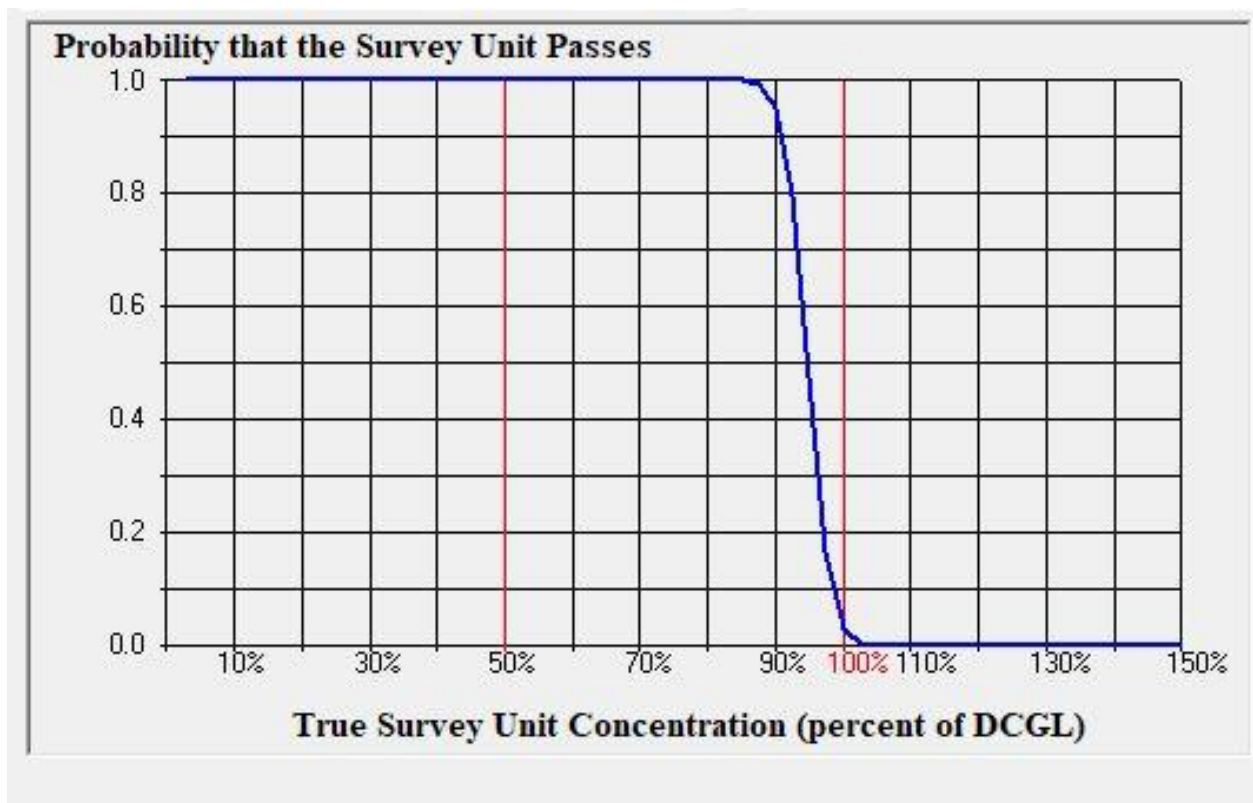

# **ATTACHMENT 7**

## **SAMPLE ANALYTICAL REPORTS**



Analysis Report for L3-012-101-FSPA-001-AV

L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSPA-001-AV  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 8.041E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 8:46:00AM  
Acquisition Started : 9/9/2019 8:13:05AM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.6 seconds

Dead Time : 0.31 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7418

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 8:43:14AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSPA-001-AV

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
	1	74.77	147 -	157	150.08	1.02E+02	49.46	4.29E+02	1.58
M	2	238.49	472 -	487	477.45	9.12E+01	24.49	1.78E+02	1.31
m	3	241.44	472 -	487	483.34	4.93E+01	19.19	1.46E+02	1.32
F	4	295.06	585 -	597	590.57	7.80E+01	23.31	1.63E+02	1.66
F	5	351.66	697 -	712	703.74	1.23E+02	24.37	1.04E+02	1.38
F	6	583.06	1161 -	1171	1166.47	2.57E+01	13.20	4.34E+01	1.68
F	7	609.26	1213 -	1224	1218.85	8.39E+01	20.65	5.05E+01	1.76
F	8	1460.41	2913 -	2928	2920.93	2.40E+02	31.02	0.00E+00	2.57

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 8:43:14AM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
	1	74.77	1.02E+02	49.46			1.02E+02	4.95E+01
M	2	238.49	9.12E+01	24.49			9.12E+01	2.45E+01
m	3	241.44	4.93E+01	19.19			4.93E+01	1.92E+01
F	4	295.06	7.80E+01	23.31			7.80E+01	2.33E+01
F	5	351.66	1.23E+02	24.37	4.18E+01	1.86E+01	8.10E+01	3.07E+01
F	6	583.06	2.57E+01	13.20			2.57E+01	1.32E+01
F	7	609.26	8.39E+01	20.65	2.06E+01	1.21E+01	6.33E+01	2.39E+01
F	8	1460.41	2.40E+02	31.02	2.82E+01	8.57E+00	2.12E+02	3.22E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSPA-001-AV

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75 *	10.67	5.74E+00	9.28E-01
PB-212	0.55	77.11	17.50		
		238.63 *	44.60	1.17E-01	3.20E-02
BI-214	0.34	609.31 *	46.30	1.81E-01	6.93E-02
		1120.29	15.10		
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.71	77.11	10.70		
		295.21 *	19.20	2.77E-01	8.40E-02
		351.92 *	37.20	1.74E-01	6.64E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.981	5.74E+00	9.28E-01	
PB-212	0.558	1.17E-01	3.20E-02	
BI-214	0.349	1.81E-01	6.93E-02	

Analysis Report for L3-012-101-FSPA-001-AV

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
PB-214	0.714	2.14E-01	5.21E-02	

- ? = nuclide is part of an undetermined solution  
X = nuclide rejected by the Interference analysis  
@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSPA-001-AV  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/9/2019 8:43:14AM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
1	74.77	5.64838E-02	24.32		
m 3	241.44	2.73877E-02	19.47		
F 6	583.06	1.43036E-02	25.64		

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	5.74E+00	6.81E-01
+	AR-41	1293.64	99.16	-2.96E+13	4.77E+14	4.77E+14
+	CO-60	1173.22	100.00	4.98E-02	7.07E-02	8.76E-02
		1332.49	100.00	-6.16E-02		7.07E-02
+	KR-85	513.99	0.43	1.39E+01	1.48E+01	1.48E+01
+	Y-88	898.04	93.70	2.98E-02	6.30E-02	7.35E-02
		1836.06	99.20	-8.87E-03		6.30E-02
+	NB-94	702.63	100.00	2.02E-02	5.62E-02	5.62E-02
		871.10	100.00	3.95E-02		7.16E-02
+	I-131	284.30	6.06	4.62E-01	7.63E-02	1.07E+00
		364.48	81.20	-3.00E-03		7.63E-02
		636.97	7.27	-1.82E-01		1.03E+00
+	CS-134	604.70	97.60	4.66E-04	7.98E-02	7.98E-02

## Analysis Report for L3-012-101-FSPA-001-AV

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
	CS-134	795.84	85.40	2.58E-02	7.98E-02	8.49E-02
+	CS-137	661.65	85.12	7.10E-02	8.43E-02	8.43E-02
+	CE-144	80.12	1.36	-3.98E+00	3.92E-01	4.89E+00
		133.51	11.09	-9.23E-02		3.92E-01
+	EU-152	121.78	28.40	-5.73E-02	1.53E-01	1.53E-01
		344.28	26.60	4.56E-02		1.86E-01
		1408.00	20.74	2.27E-01		3.87E-01
+	EU-154	123.07	40.40	-9.75E-02	1.06E-01	1.06E-01
		723.30	19.70	-1.11E-01		2.96E-01
		1274.51	35.50	7.79E-02		2.33E-01
+	EU-155	86.54	32.80	6.95E-02	1.72E-01	1.72E-01
		105.31	21.80	9.02E-02		2.16E-01
+	BI-214	609.31	* 46.30	1.81E-01	1.11E-01	1.11E-01
		1120.29	15.10	2.70E-01		6.07E-01
		1238.11	5.94	5.72E-01		1.77E+00
		1377.67	4.11	7.52E-01		1.91E+00
		1407.98	2.48	1.90E+00		3.23E+00
		1509.19	2.19	2.44E+00		3.05E+00
		1764.49	15.80	5.47E-01		6.13E-01
+	PB-214	77.11	10.70	6.23E-01	1.25E-01	6.53E-01
		295.21	* 19.20	2.77E-01		1.81E-01
		351.92	* 37.20	1.74E-01		1.25E-01
+	PA-228	89.95	22.00	2.85E+00	2.93E+00	4.97E+00
		93.35	35.00	-1.80E+00		2.93E+00
		105.00	16.30	4.08E+00		5.91E+00
		129.22	2.97	7.37E+00		2.98E+01
		338.32	5.30	-4.90E-01		1.85E+01
		463.00	13.80	2.08E+00		7.24E+00
		911.23	16.70	1.88E-01		9.45E+00
+	AM-241	59.54	36.30	-2.55E-01	3.06E-01	3.06E-01
+	CM-243	103.76	23.00	1.75E-02	2.05E-01	2.05E-01
		228.18	10.60	-5.22E-02		4.02E-01
		277.60	14.00	-1.61E-01		3.23E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-001-SS  
L3-012-101

---

## **GAMMA SPECTRUM ANALYSIS**

---

Sample Identification : L3-012-101-FSGS-001-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 7.949E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 8:50:00AM  
Acquisition Started : 9/9/2019 7:42:04AM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.9 seconds

Dead Time : 0.32 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7417

---

## **PEAK ANALYSIS REPORT**

---

Peak Analysis Performed on : 9/9/2019 8:12:18AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-001-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	186.14	369 -	376	372.78	3.72E+01	20.51	2.03E+02	1.02
F	2	238.60	471 -	481	477.67	6.42E+01	24.92	2.77E+02	1.18
F	3	295.09	582 -	595	590.63	7.14E+01	21.31	1.40E+02	1.51
F	4	351.88	700 -	708	704.19	7.18E+01	20.99	7.04E+01	1.86
F	5	583.06	1161 -	1170	1166.46	2.20E+01	11.97	4.00E+01	1.20
F	6	609.21	1214 -	1225	1218.75	5.86E+01	18.25	4.45E+01	2.04
F	7	661.45	1316 -	1330	1323.21	6.14E+01	17.72	3.38E+01	2.37
F	8	1460.39	2915 -	2928	2920.90	1.42E+02	24.45	1.40E+01	2.29

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 8:12:18AM

Env. Background File : C:\Canberra\Apex\Root\Daq\land\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	186.14	3.72E+01	20.51			3.72E+01	2.05E+01
F	2	238.60	6.42E+01	24.92			6.42E+01	2.49E+01
F	3	295.09	7.14E+01	21.31			7.14E+01	2.13E+01
F	4	351.88	7.18E+01	20.99	4.18E+01	1.86E+01	3.01E+01	2.80E+01
F	5	583.06	2.20E+01	11.97			2.20E+01	1.20E+01
F	6	609.21	5.86E+01	18.25	2.06E+01	1.21E+01	3.81E+01	2.19E+01
F	7	661.45	6.14E+01	17.72	3.31E+01	1.27E+01	2.83E+01	2.18E+01
F	8	1460.39	1.42E+02	24.45	2.82E+01	8.57E+00	1.14E+02	2.59E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma



Analysis Report for L3-012-101-FSGS-001-SS

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\ Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75	*	10.67	3.12E+00	7.31E-01
CS-137	0.99	661.65	*	85.12	4.81E-02	3.71E-02
PB-212	0.56	77.11		17.50		
		238.63	*	44.60	8.33E-02	3.26E-02
BI-214	0.34	609.31	*	46.30	1.10E-01	6.38E-02
		1120.29		15.10		
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49		15.80		
PB-214	0.72	77.11		10.70		
		295.21	*	19.20	2.57E-01	7.77E-02
		351.92	*	37.20	6.54E-02	6.11E-02
RA-226	0.99	186.21	*	3.28	5.52E-01	3.06E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.980	3.12E+00	7.31E-01	

## Analysis Report for L3-012-101-FSGS-001-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
CS-137	0.993	4.81E-02	3.71E-02	
PB-212	0.560	8.33E-02	3.26E-02	
BI-214	0.349	1.10E-01	6.38E-02	
PB-214	0.721	1.38E-01	4.80E-02	
RA-226	0.999	5.52E-01	3.06E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-001-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/9/2019 8:12:18AM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 5	583.06	1.22471E-02	27.16		

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daivyland\_NPPLibrary\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	3.12E+00	8.07E-01
+	AR-41	1293.64		99.16	-4.19E+14	3.06E+14
+	CO-60	1173.22		100.00	5.51E-02	7.51E-02
		1332.49		100.00	6.99E-02	7.63E-02
+	KR-85	513.99		0.43	1.05E+01	1.36E+01
+	Y-88	898.04		93.70	1.38E-02	5.16E-02
		1836.06		99.20	-3.32E-02	5.16E-02
+	NB-94	702.63		100.00	1.80E-02	5.29E-02
		871.10		100.00	-6.70E-03	5.54E-02
+	I-131	284.30		6.06	6.68E-01	6.53E-02
		364.48		81.20	-1.69E-02	6.53E-02
		636.97		7.27	6.83E-02	1.02E+00
+	CS-134	604.70		97.60	-5.76E-02	6.75E-02
		795.84		85.40	1.03E-02	6.75E-02
+	CS-137	661.65	*	85.12	4.81E-02	6.63E-02
+	CE-144	80.12		1.36	3.13E+00	3.75E-01
		133.51		11.09	-1.54E-01	3.75E-01

## Analysis Report for L3-012-101-FSGS-001-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	EU-152	121.78	28.40	-1.21E-01	1.40E-01	1.40E-01
		344.28	26.60	-9.06E-02		1.97E-01
		1408.00	20.74	1.28E-01		2.66E-01
+	EU-154	123.07	40.40	-3.92E-02	9.88E-02	9.88E-02
		723.30	19.70	2.59E-02		3.11E-01
		1274.51	35.50	1.12E-01		1.90E-01
+	EU-155	86.54	32.80	-4.85E-02	1.65E-01	1.65E-01
		105.31	21.80	-7.87E-03		1.98E-01
+	BI-214	609.31	* 46.30	1.10E-01	1.09E-01	1.09E-01
		1120.29	15.10	5.02E-01		5.32E-01
		1238.11	5.94	-2.54E-01		1.32E+00
		1377.67	4.11	-4.06E-01		1.27E+00
		1407.98	2.48	1.07E+00		2.23E+00
		1509.19	2.19	1.43E+00		2.93E+00
		1764.49	15.80	4.99E-01		5.43E-01
+	PB-214	77.11	10.70	8.15E-02	1.08E-01	6.29E-01
		295.21	* 19.20	2.57E-01		1.74E-01
		351.92	* 37.20	6.54E-02		1.08E-01
+	PA-228	89.95	22.00	1.85E+00	2.78E+00	4.78E+00
		93.35	35.00	-1.09E-01		2.78E+00
		105.00	16.30	-2.63E-01		5.31E+00
		129.22	2.97	1.68E+01		2.83E+01
		338.32	5.30	-8.87E+00		1.80E+01
		463.00	13.80	2.98E+00		7.61E+00
		911.23	16.70	5.52E+00		8.62E+00
+	AM-241	59.54	36.30	3.97E-02	3.10E-01	3.10E-01
+	CM-243	103.76	23.00	-1.95E-01	1.85E-01	1.85E-01
		228.18	10.60	-2.11E-02		3.79E-01
		277.60	14.00	-2.00E-01		3.01E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-002-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification	: L3-012-101-FSGS-002-SS
Sample Description	: L3-012-101
Sample Type	: 500 ml Marinelli
Unit	:
Sample Point	:
Sample Size	: 1.028E+03 grams
Facility	: Dairyleland_NPP
Sample Taken On	: 9/5/2019 1:46:00PM
Acquisition Started	: 9/9/2019 8:44:44AM
Procedure	: 500ml Marinelli
Operator	: Administrator
Detector Name	: HOTLAB
Geometry	: 500ml Marinelli
Live Time	: 1800.0 seconds
Real Time	: 1805.3 seconds
Dead Time	: 0.30 %
Peak Locate Threshold	: 3.00
Peak Locate Range (in channels)	: 100 - 4096
Peak Area Range (in channels)	: 100 - 4096
Identification Energy Tolerance	: 1.000 keV
Energy Calibration Used Done On	: 7/8/2014
Efficiency Calibration Used Done On	: 7/8/2014
Efficiency Calibration Description	:
Sample Number	: 7419

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 9:14:53AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-002-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
M	1	74.88	147 -	158	150.30	5.41E+01	26.91	4.07E+02	1.14
m	2	77.32	147 -	158	155.18	8.28E+01	29.89	4.34E+02	1.14
F	3	185.60	366 -	376	371.70	5.93E+01	29.74	3.91E+02	1.70
M	4	238.54	474 -	489	477.55	1.21E+02	29.44	2.30E+02	1.41
m	5	241.84	474 -	489	484.15	5.93E+01	22.99	2.60E+02	1.41
F	6	295.19	586 -	596	590.84	1.16E+02	26.68	1.79E+02	1.38
F	7	338.34	672 -	682	677.11	2.85E+01	16.76	1.17E+02	1.47
F	8	351.75	697 -	711	703.93	2.13E+02	32.66	1.73E+02	1.60
F	9	583.36	1160 -	1174	1167.06	4.47E+01	16.56	6.39E+01	2.06
F	10	609.13	1212 -	1225	1218.60	1.59E+02	27.33	7.51E+01	1.73
F	11	1120.11	2234 -	2245	2240.40	2.67E+01	12.19	3.30E+01	1.28
F	12	1460.35	2915 -	2928	2920.80	2.00E+02	28.79	1.28E+01	2.31
F	13	1764.00	3523 -	3533	3528.07	2.27E+01	10.41	2.39E+00	2.44

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 9:14:53AM

Env. Background File : C:\Canberra\Apex\Roof\ Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
M	1	74.88	5.41E+01	26.91			5.41E+01	2.69E+01
m	2	77.32	8.28E+01	29.89			8.28E+01	2.99E+01
F	3	185.60	5.93E+01	29.74			5.93E+01	2.97E+01
M	4	238.54	1.21E+02	29.44			1.21E+02	2.94E+01
m	5	241.84	5.93E+01	22.99			5.93E+01	2.30E+01
F	6	295.19	1.16E+02	26.68			1.16E+02	2.67E+01
F	7	338.34	2.85E+01	16.76			2.85E+01	1.68E+01
F	8	351.75	2.13E+02	32.66	4.18E+01	1.86E+01	1.72E+02	3.76E+01
F	9	583.36	4.47E+01	16.56			4.47E+01	1.66E+01
F	10	609.13	1.59E+02	27.33	2.06E+01	1.21E+01	1.38E+02	2.99E+01
F	11	1120.11	2.67E+01	12.19			2.67E+01	1.22E+01
F	12	1460.35	2.00E+02	28.79	2.82E+01	8.57E+00	1.72E+02	3.00E+01
F	13	1764.00	2.27E+01	10.41	7.59E+00	4.90E+00	1.51E+01	1.15E+01

Analysis Report for L3-012-101-FSGS-002-SS

L3-012-101

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daistryland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.97	1460.75	*	10.67	3.64E+00	6.68E-01
PB-212	0.99	77.11	*	17.50	2.26E-01	8.29E-02
		238.63	*	44.60	1.21E-01	3.02E-02
BI-214	0.77	609.31	*	46.30	3.09E-01	6.92E-02
		1120.29	*	15.10	3.17E-01	1.46E-01
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49	*	15.80	2.54E-01	1.94E-01
PB-214	0.99	77.11	*	10.70	3.69E-01	1.36E-01
		295.21	*	19.20	3.22E-01	7.59E-02
		351.92	*	37.20	2.88E-01	6.47E-02
RA-226	0.94	186.21	*	3.28	6.79E-01	3.43E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Analysis Report for L3-012-101-FSGS-002-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.974	3.64E+00	6.68E-01	
PB-212	0.997	1.13E-01	2.86E-02	
BI-214	0.778	3.05E-01	5.95E-02	
PB-214	0.996	2.89E-01	4.66E-02	
RA-226	0.942	6.79E-01	3.43E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma



Analysis Report for L3-012-101-FSGS-002-SS  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/9/2019 9:14:53AM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
M 1	74.88	3.00367E-02	24.89		
m 5	241.84	3.29632E-02	19.37		
F 7	338.34	1.58255E-02	29.42	Tol.	AC-228 PA-228
F 9	583.36	2.48365E-02	18.52		

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daivryland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	3.64E+00	6.13E-01
+	AR-41	1293.64	99.16	1.17E+13	6.67E+13	6.67E+13
+	CO-60	1173.22	100.00	1.44E-03	6.57E-02	7.20E-02
		1332.49	100.00	1.83E-02		6.57E-02
+	KR-85	513.99	0.43	9.87E+00	1.18E+01	1.18E+01
+	Y-88	898.04	93.70	5.69E-03	3.99E-02	5.90E-02
		1836.06	99.20	-1.20E-02		3.99E-02
+	NB-94	702.63	100.00	-1.28E-02	4.51E-02	4.51E-02
		871.10	100.00	2.23E-03		5.65E-02

## Analysis Report for L3-012-101-FSGS-002-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	I-131	284.30	6.06	-3.95E-01	6.73E-02	8.90E-01
		364.48	81.20	1.47E-02		6.73E-02
		636.97	7.27	6.74E-01		9.72E-01
+	CS-134	604.70	97.60	1.91E-04	6.34E-02	7.99E-02
		795.84	85.40	1.60E-02		6.34E-02
+	CS-137	661.65	85.12	8.88E-02	6.47E-02	6.47E-02
+	CE-144	80.12	1.36	-5.02E+00	3.16E-01	4.32E+00
		133.51	11.09	-1.32E-01		3.16E-01
+	EU-152	121.78	28.40	-3.05E-02	1.29E-01	1.29E-01
		344.28	26.60	2.87E-03		1.63E-01
		1408.00	20.74	9.03E-02		3.20E-01
+	EU-154	123.07	40.40	4.33E-03	9.10E-02	9.10E-02
		723.30	19.70	-1.01E-01		2.33E-01
		1274.51	35.50	3.77E-02		1.98E-01
+	EU-155	86.54	32.80	1.19E-02	1.50E-01	1.50E-01
		105.31	21.80	-3.02E-02		1.86E-01
+	BI-214	609.31	* 46.30	3.09E-01	9.95E-02	9.95E-02
		1120.29	* 15.10	3.17E-01		2.84E-01
		1238.11	5.94	-3.66E-01		1.23E+00
		1377.67	4.11	1.12E+00		1.62E+00
		1407.98	2.48	7.55E-01		2.67E+00
		1509.19	2.19	7.17E-01		2.33E+00
		1764.49	* 15.80	2.54E-01		2.68E-01
+	PB-214	77.11	* 10.70	3.69E-01	1.12E-01	3.18E-01
		295.21	* 19.20	3.22E-01		1.42E-01
		351.92	* 37.20	2.88E-01		1.12E-01
+	PA-228	89.95	22.00	2.77E+00	2.26E+00	3.84E+00
		93.35	35.00	-5.73E-02		2.26E+00
		105.00	16.30	-2.32E-02		4.43E+00
		129.22	2.97	7.99E+00		2.17E+01
		338.32	5.30	2.07E+00		1.35E+01
		463.00	13.80	1.14E+00		5.87E+00
		911.23	16.70	7.59E-01		6.65E+00
+	AM-241	59.54	36.30	8.90E-02	2.73E-01	2.73E-01
+	CM-243	103.76	23.00	8.30E-02	1.80E-01	1.80E-01
		228.18	10.60	-2.35E-01		3.57E-01
		277.60	14.00	6.14E-02		2.84E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-002-SS  
L3-012-101

Analysis Report for L3-012-101-FSGS-003-SS

L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification	: L3-012-101-FSGS-003-SS
Sample Description	: L3-012-101
Sample Type	: 500 ml Marinelli
Unit	:
Sample Point	:
Sample Size	: 8.773E+02 grams
Facility	: Dairyland_NPP
Sample Taken On	: 9/5/2019 1:33:00PM
Acquisition Started	: 9/9/2019 9:15:18AM
Procedure	: 500ml Marinelli
Operator	: Administrator
Detector Name	: HOTLAB
Geometry	: 500ml Marinelli
Live Time	: 1800.0 seconds
Real Time	: 1805.7 seconds
Dead Time	: 0.31 %
Peak Locate Threshold	: 3.00
Peak Locate Range (in channels)	: 100 - 4096
Peak Area Range (in channels)	: 100 - 4096
Identification Energy Tolerance	: 1.000 keV
Energy Calibration Used Done On	: 7/8/2014
Efficiency Calibration Used Done On	: 7/8/2014
Efficiency Calibration Description	:
Sample Number	: 7420

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 9:45:28AM

Peak Analysis From Channel	: 100
Peak Analysis To Channel	: 4096

Analysis Report for L3-012-101-FSGS-003-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	185.80	367 -	376	372.10	8.16E+01	30.90	3.26E+02	1.81
M	2	238.49	472 -	488	477.45	2.43E+02	36.52	2.37E+02	1.49
m	3	241.65	472 -	488	483.77	7.39E+01	24.08	2.46E+02	1.49
M	4	295.26	587 -	605	590.96	1.25E+02	27.51	1.55E+02	1.41
m	5	300.65	587 -	605	601.74	2.61E+01	17.07	1.57E+02	1.41
F	6	338.04	671 -	682	676.52	5.37E+01	21.64	1.81E+02	1.55
F	7	351.72	699 -	708	703.87	2.57E+02	35.95	1.43E+02	1.54
F	8	583.14	1163 -	1173	1166.61	7.53E+01	19.49	4.48E+01	1.59
F	9	609.26	1213 -	1225	1218.85	1.57E+02	28.03	1.01E+02	1.70
F	10	910.88	1817 -	1827	1822.01	3.15E+01	14.98	4.59E+01	2.01
F	11	1460.47	2914 -	2929	2921.06	2.26E+02	30.49	1.06E+01	2.48

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 9:45:28AM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	185.80	8.16E+01	30.90			8.16E+01	3.09E+01
M	2	238.49	2.43E+02	36.52			2.43E+02	3.65E+01
m	3	241.65	7.39E+01	24.08			7.39E+01	2.41E+01
M	4	295.26	1.25E+02	27.51			1.25E+02	2.75E+01
m	5	300.65	2.61E+01	17.07			2.61E+01	1.71E+01
F	6	338.04	5.37E+01	21.64			5.37E+01	2.16E+01
F	7	351.72	2.57E+02	35.95	4.18E+01	1.86E+01	2.15E+02	4.05E+01
F	8	583.14	7.53E+01	19.49			7.53E+01	1.95E+01
F	9	609.26	1.57E+02	28.03	2.06E+01	1.21E+01	1.36E+02	3.05E+01
F	10	910.88	3.15E+01	14.98			3.15E+01	1.50E+01
F	11	1460.47	2.26E+02	30.49	2.82E+01	8.57E+00	1.98E+02	3.17E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-003-SS

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75	*	10.67	4.91E+00	8.32E-01
PB-212	0.55	77.11		17.50		
		238.63	*	44.60	2.86E-01	4.54E-02
BI-214	0.34	609.31	*	46.30	3.58E-01	8.26E-02
		1120.29		15.10		
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49		15.80		
PB-214	0.71	77.11		10.70		
		295.21	*	19.20	4.07E-01	9.19E-02
		351.92	*	37.20	4.23E-01	8.23E-02
RA-226	0.97	186.21	*	3.28	1.10E+00	4.20E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
--------------	-----------------------	------------------------------	------------------------------	----------

## Analysis Report for L3-012-101-FSGS-003-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.988	4.91E+00	8.32E-01	
PB-212	0.558	2.86E-01	4.54E-02	
BI-214	0.349	3.58E-01	8.26E-02	
PB-214	0.718	4.16E-01	6.13E-02	
RA-226	0.973	1.10E+00	4.20E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-003-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/9/2019 9:45:28AM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

	Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
m	3	241.65	4.10349E-02	16.30		
m	5	300.65	1.44825E-02	32.74		
F	6	338.04	2.98316E-02	20.15	Tol.	AC-228 PA-228
F	8	583.14	4.18276E-02	12.94		
F	10	910.88	1.75262E-02	23.74	Tol.	AC-228 PA-228

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	4.91E+00	7.07E-01	7.07E-01
+	AR-41	1293.64	99.16	1.22E+13	1.11E+14	1.11E+14
+	CO-60	1173.22	100.00	5.13E-02	7.97E-02	9.38E-02
		1332.49	100.00	8.82E-04		7.97E-02



## Analysis Report for L3-012-101-FSGS-003-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	KR-85	513.99	0.43	1.49E+01	1.46E+01	1.46E+01
+	Y-88	898.04	93.70	-1.02E-02	5.26E-02	7.44E-02
		1836.06	99.20	-4.10E-02		5.26E-02
+	NB-94	702.63	100.00	-1.68E-02	6.21E-02	6.21E-02
		871.10	100.00	1.01E-02		7.28E-02
+	I-131	284.30	6.06	5.49E-01	8.12E-02	1.14E+00
		364.48	81.20	3.84E-03		8.12E-02
		636.97	7.27	6.30E-03		1.04E+00
+	CS-134	604.70	97.60	-2.46E-02	7.00E-02	9.67E-02
		795.84	85.40	-4.93E-02		7.00E-02
+	CS-137	661.65	85.12	4.86E-02	8.49E-02	8.49E-02
+	CE-144	80.12	1.36	-2.20E-01	4.15E-01	5.36E+00
		133.51	11.09	3.12E-01		4.15E-01
+	EU-152	121.78	28.40	-1.44E-01	1.55E-01	1.55E-01
		344.28	26.60	-2.25E-01		2.20E-01
		1408.00	20.74	1.05E-01		3.39E-01
+	EU-154	123.07	40.40	-5.37E-02	1.10E-01	1.10E-01
		723.30	19.70	8.99E-02		3.18E-01
		1274.51	35.50	2.65E-02		2.32E-01
+	EU-155	86.54	32.80	-5.24E-02	1.82E-01	1.82E-01
		105.31	21.80	1.41E-01		2.23E-01
+	BI-214	609.31	* 46.30	3.58E-01	1.27E-01	1.27E-01
		1120.29	15.10	4.42E-01		6.10E-01
		1238.11	5.94	1.56E+00		1.80E+00
		1377.67	4.11	4.27E-01		1.88E+00
		1407.98	2.48	8.80E-01		2.83E+00
		1509.19	2.19	3.11E+00		3.23E+00
		1764.49	15.80	3.11E-01		5.62E-01
+	PB-214	77.11	10.70	1.02E+00	1.16E-01	7.33E-01
		295.21	* 19.20	4.07E-01		1.42E-01
		351.92	* 37.20	4.23E-01		1.16E-01
+	PA-228	89.95	22.00	5.89E+00	2.77E+00	4.81E+00
		93.35	35.00	-1.02E+00		2.77E+00
		105.00	16.30	3.07E+00		5.41E+00
		129.22	2.97	-1.71E+01		2.75E+01
		338.32	5.30	1.77E+01		1.89E+01
		463.00	13.80	1.47E+00		7.25E+00
		911.23	16.70	8.42E+00		8.95E+00
+	AM-241	59.54	36.30	-8.28E-02	3.35E-01	3.35E-01
+	CM-243	103.76	23.00	6.68E-02	2.12E-01	2.12E-01
		228.18	10.60	2.21E-01		4.18E-01
		277.60	14.00	-3.20E-01		3.51E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-003-SS  
L3-012-101

---

Analysis Report for L3-012-101-FSGS-004-SS

L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-004-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 6.521E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 8:58:00AM  
Acquisition Started : 9/9/2019 10:14:21AM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.6 seconds

Dead Time : 0.31 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7421

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 10:44:30AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-004-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	76.65	147 -	158	153.85	8.73E+01	31.96	6.30E+02	1.20
F	2	185.65	367 -	375	371.80	4.63E+01	26.28	2.87E+02	1.51
M	3	238.41	470 -	488	477.30	1.87E+02	33.54	2.47E+02	1.45
m	4	241.75	470 -	488	483.97	4.87E+01	22.25	2.67E+02	1.45
F	5	295.17	586 -	594	590.79	9.36E+01	24.09	1.27E+02	1.34
F	6	338.16	668 -	681	676.75	4.58E+01	18.71	1.42E+02	1.34
F	7	351.73	696 -	708	703.89	1.64E+02	29.41	1.52E+02	1.52
F	8	582.98	1161 -	1170	1166.31	4.00E+01	15.60	6.10E+01	1.30
F	9	608.84	1211 -	1225	1218.01	1.27E+02	25.13	9.99E+01	1.57
F	10	661.26	1316 -	1330	1322.83	1.13E+02	23.45	6.80E+01	1.82
F	11	910.72	1816 -	1828	1821.68	4.25E+01	15.71	4.26E+01	1.99
F	12	968.71	1933 -	1943	1937.65	3.03E+01	12.76	1.65E+01	2.21
F	13	1119.65	2233 -	2246	2239.48	3.83E+01	14.41	2.48E+01	2.57
F	14	1459.87	2912 -	2927	2919.86	1.87E+02	28.14	2.00E+01	2.65
F	15	1763.70	3522 -	3533	3527.47	3.00E+01	11.21	0.00E+00	2.48

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 10:44:30AM

Env. Background File : C:\Canberra\Apex\Root\Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	76.65	8.73E+01	31.96			8.73E+01	3.20E+01
F	2	185.65	4.63E+01	26.28			4.63E+01	2.63E+01
M	3	238.41	1.87E+02	33.54			1.87E+02	3.35E+01
m	4	241.75	4.87E+01	22.25			4.87E+01	2.22E+01
F	5	295.17	9.36E+01	24.09			9.36E+01	2.41E+01
F	6	338.16	4.58E+01	18.71			4.58E+01	1.87E+01
F	7	351.73	1.64E+02	29.41	4.18E+01	1.86E+01	1.23E+02	3.48E+01
F	8	582.98	4.00E+01	15.60			4.00E+01	1.56E+01
F	9	608.84	1.27E+02	25.13	2.06E+01	1.21E+01	1.06E+02	2.79E+01
F	10	661.26	1.13E+02	23.45	3.31E+01	1.27E+01	7.99E+01	2.67E+01
F	11	910.72	4.25E+01	15.71			4.25E+01	1.57E+01
F	12	968.71	3.03E+01	12.76			3.03E+01	1.28E+01
F	13	1119.65	3.83E+01	14.41			3.83E+01	1.44E+01
F	14	1459.87	1.87E+02	28.14	2.82E+01	8.57E+00	1.58E+02	2.94E+01

Analysis Report for L3-012-101-FSGS-004-SS

L3-012-101

Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F 15	1763.70	3.00E+01	11.21			3.00E+01	1.12E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.88	1460.75 *	10.67	5.29E+00	1.03E+00
CS-137	0.97	661.65 *	85.12	1.66E-01	5.60E-02
PB-212	0.98	77.11 *	17.50	3.81E-01	1.42E-01
		238.63 *	44.60	2.95E-01	5.52E-02
BI-214	0.74	609.31 *	46.30	3.74E-01	1.01E-01
		1120.29 *	15.10	7.17E-01	2.72E-01
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49 *	15.80	7.92E-01	3.01E-01
PB-214	0.99	77.11 *	10.70	6.23E-01	2.32E-01
		295.21 *	19.20	4.10E-01	1.08E-01
		351.92 *	37.20	3.25E-01	9.35E-02
RA-226	0.95	186.21 *	3.28	8.36E-01	4.77E-01
AC-228	0.57	209.28	4.40		
		338.32 *	11.40	3.82E-01	1.57E-01
		794.70	4.60		
		911.60 *	27.70	3.61E-01	1.34E-01
		964.60	5.20		
		969.11 *	16.60	4.54E-01	1.92E-01

Analysis Report for L3-012-101-FSGS-004-SS

L3-012-101

---

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

---

---

## INTERFERENCE CORRECTED REPORT

---

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.884	5.29E+00	1.03E+00	
CS-137	0.976	1.66E-01	5.60E-02	
PB-212	0.985	2.78E-01	5.17E-02	
BI-214	0.743	4.49E-01	9.00E-02	
PB-214	0.991	3.45E-01	6.79E-02	
RA-226	0.951	8.36E-01	4.77E-01	
AC-228	0.579	3.89E-01	9.02E-02	

---

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

---

Analysis Report for L3-012-101-FSGS-004-SS  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/9/2019 10:44:30AM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
m 4	241.75	2.70594E-02	22.84		
F 8	582.98	2.22449E-02	19.48		

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daqryland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	5.29E+00	1.05E+00	1.05E+00
+	AR-41	1293.64	99.16	-3.55E+14	1.16E+15	1.16E+15
+	CO-60	1173.22	100.00	6.48E-02	1.06E-01	1.14E-01
		1332.49	100.00	6.93E-02		1.06E-01
+	KR-85	513.99	0.43	1.90E+01	2.00E+01	2.00E+01
+	Y-88	898.04	93.70	7.50E-02	7.44E-02	9.87E-02
		1836.06	99.20	2.51E-02		7.44E-02
+	NB-94	702.63	100.00	1.24E-02	7.70E-02	7.70E-02
		871.10	100.00	-1.09E-01		7.91E-02
+	I-131	284.30	6.06	3.36E-01	1.06E-01	1.47E+00
		364.48	81.20	3.21E-02		1.06E-01
		636.97	7.27	1.11E+00		1.53E+00
+	CS-134	604.70	97.60	-2.95E-03	9.12E-02	1.17E-01
		795.84	85.40	-2.48E-02		9.12E-02

## Analysis Report for L3-012-101-FSGS-004-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>		<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	CS-137	661.65	*	85.12	1.66E-01	9.49E-02	9.49E-02
+	CE-144	80.12		1.36	-2.63E+00	5.11E-01	6.62E+00
		133.51		11.09	-8.70E-02		5.11E-01
+	EU-152	121.78		28.40	-1.01E-01	1.96E-01	1.96E-01
		344.28		26.60	-6.63E-02		2.71E-01
		1408.00		20.74	-1.14E-01		3.25E-01
+	EU-154	123.07		40.40	-5.45E-02	1.37E-01	1.37E-01
		723.30		19.70	4.03E-01		4.74E-01
		1274.51		35.50	-3.45E-02		2.87E-01
+	EU-155	86.54		32.80	-1.92E-01	2.21E-01	2.21E-01
		105.31		21.80	-7.88E-02		2.70E-01
+	BI-214	609.31	*	46.30	3.74E-01	7.15E-02	1.76E-01
		1120.29	*	15.10	7.17E-01		4.16E-01
		1238.11		5.94	1.00E+00		2.14E+00
		1377.67		4.11	-3.25E-01		2.33E+00
		1407.98		2.48	-9.51E-01		2.71E+00
		1509.19		2.19	6.49E-01		3.76E+00
		1764.49	*	15.80	7.92E-01		7.15E-02
+	PB-214	77.11	*	10.70	6.23E-01	1.65E-01	6.80E-01
		295.21	*	19.20	4.10E-01		1.80E-01
		351.92	*	37.20	3.25E-01		1.65E-01
+	PA-228	89.95		22.00	6.51E+00	4.08E+00	7.00E+00
		93.35		35.00	4.00E-01		4.08E+00
		105.00		16.30	-1.63E+00		7.78E+00
		129.22		2.97	-1.92E+01		4.03E+01
		338.32		5.30	6.40E+00		2.69E+01
		463.00		13.80	2.65E+00		1.06E+01
		911.23		16.70	7.44E+00		1.46E+01
+	AM-241	59.54		36.30	2.73E-02	4.26E-01	4.26E-01
+	CM-243	103.76		23.00	5.81E-02	2.56E-01	2.56E-01
		228.18		10.60	-4.50E-02		5.30E-01
		277.60		14.00	-5.03E-03		4.40E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level



Analysis Report for L3-012-101-FSGS-005-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-005-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 6.916E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 1:00:00PM  
Acquisition Started : 9/9/2019 10:53:46AM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.3 seconds

Dead Time : 0.29 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7422

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 11:23:56AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-005-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	76.98	147 -	159	154.51	4.81E+01	28.38	6.17E+02	1.22
F	2	185.86	368 -	377	372.22	5.35E+01	25.44	2.66E+02	1.54
F	3	238.34	470 -	481	477.16	8.49E+01	26.67	2.91E+02	1.24
F	4	295.02	586 -	595	590.49	8.25E+01	22.94	1.16E+02	1.49
F	5	351.67	697 -	712	703.77	1.31E+02	25.94	1.34E+02	1.56
F	6	582.66	1159 -	1170	1165.67	3.39E+01	14.85	5.12E+01	1.68
F	7	609.00	1213 -	1224	1218.34	6.17E+01	17.69	4.80E+01	1.42
F	8	661.27	1317 -	1329	1322.85	9.88E+01	22.70	7.15E+01	1.82
F	9	910.54	1817 -	1826	1821.33	2.22E+01	12.37	4.34E+01	1.27
F	10	1459.95	2911 -	2929	2920.02	1.66E+02	26.19	1.44E+01	2.42

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 11:23:56AM

Env. Background File : C:\Canberra\Apex\Root\Daityland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	76.98	4.81E+01	28.38			4.81E+01	2.84E+01
F	2	185.86	5.35E+01	25.44			5.35E+01	2.54E+01
F	3	238.34	8.49E+01	26.67			8.49E+01	2.67E+01
F	4	295.02	8.25E+01	22.94			8.25E+01	2.29E+01
F	5	351.67	1.31E+02	25.94	4.18E+01	1.86E+01	8.91E+01	3.19E+01
F	6	582.66	3.39E+01	14.85			3.39E+01	1.48E+01
F	7	609.00	6.17E+01	17.69	2.06E+01	1.21E+01	4.11E+01	2.14E+01
F	8	661.27	9.88E+01	22.70	3.31E+01	1.27E+01	6.58E+01	2.60E+01
F	9	910.54	2.22E+01	12.37			2.22E+01	1.24E+01
F	10	1459.95	1.66E+02	26.19	2.82E+01	8.57E+00	1.37E+02	2.76E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-005-SS

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daivyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.90	1460.75	*	10.67	4.33E+00	9.00E-01
CS-137	0.97	661.65	*	85.12	1.28E-01	5.13E-02
PB-212	0.99	77.11	*	17.50	1.97E-01	1.17E-01
		238.63	*	44.60	1.26E-01	4.03E-02
BI-214	0.34	609.31	*	46.30	1.37E-01	7.18E-02
		1120.29		15.10		
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49		15.80		
PB-214	0.99	77.11	*	10.70	3.21E-01	1.91E-01
		295.21	*	19.20	3.41E-01	9.63E-02
		351.92	*	37.20	2.22E-01	8.05E-02
RA-226	0.98	186.21	*	3.28	9.12E-01	4.37E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.903	4.33E+00	9.00E-01	

Analysis Report for L3-012-101-FSGS-005-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
CS-137	0.977	1.28E-01	5.13E-02	
PB-212	0.990	1.17E-01	3.83E-02	
BI-214	0.342	1.37E-01	7.18E-02	
PB-214	0.992	2.58E-01	5.90E-02	
RA-226	0.981	9.12E-01	4.37E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-005-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/9/2019 11:23:56AM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 6	582.66	1.88505E-02	21.88		
F 9	910.54	1.23519E-02	27.81	Tol.	PA-228

---

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	4.33E+00	9.59E-01	9.59E-01
+	AR-41	1293.64	99.16	5.80E+13	2.80E+14	2.80E+14
+	CO-60	1173.22	100.00	8.85E-02	8.64E-02	1.04E-01
		1332.49	100.00	2.96E-02		8.64E-02
+	KR-85	513.99	0.43	9.70E+00	1.61E+01	1.61E+01
+	Y-88	898.04	93.70	2.03E-03	6.32E-02	7.35E-02
		1836.06	99.20	2.94E-02		6.32E-02
+	NB-94	702.63	100.00	-1.42E-02	6.65E-02	6.65E-02
		871.10	100.00	-9.60E-03		7.45E-02
+	I-131	284.30	6.06	5.29E-02	8.79E-02	1.19E+00
		364.48	81.20	-3.09E-02		8.79E-02
		636.97	7.27	-4.21E-02		1.15E+00
+	CS-134	604.70	97.60	-5.98E-03	8.45E-02	8.81E-02
		795.84	85.40	-1.10E-02		8.45E-02
+	CS-137	661.65	* 85.12	1.28E-01	8.84E-02	8.84E-02
+	CE-144	80.12	1.36	-9.96E-01	4.24E-01	5.79E+00

## Analysis Report for L3-012-101-FSGS-005-SS

## L3-012-101

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
	CE-144	133.51	11.09	-6.02E-02	4.24E-01	4.24E-01
+	EU-152	121.78	28.40	-5.41E-02	1.69E-01	1.69E-01
		344.28	26.60	1.20E-02		2.25E-01
		1408.00	20.74	3.14E-01		4.08E-01
+	EU-154	123.07	40.40	-6.53E-02	1.18E-01	1.18E-01
		723.30	19.70	2.84E-01		3.76E-01
		1274.51	35.50	1.40E-01		2.51E-01
+	EU-155	86.54	32.80	7.08E-02	2.11E-01	2.11E-01
		105.31	21.80	1.86E-01		2.47E-01
+	BI-214	609.31	* 46.30	1.37E-01	1.28E-01	1.28E-01
		1120.29	15.10	1.15E-01		6.41E-01
		1238.11	5.94	1.45E+00		1.81E+00
		1377.67	4.11	6.62E-01		2.26E+00
		1407.98	2.48	2.62E+00		3.41E+00
		1509.19	2.19	1.42E+00		2.63E+00
		1764.49	15.80	3.18E-01		6.24E-01
+	PB-214	77.11	* 10.70	3.21E-01	1.56E-01	6.44E-01
		295.21	* 19.20	3.41E-01		1.67E-01
		351.92	* 37.20	2.22E-01		1.56E-01
+	PA-228	89.95	22.00	3.05E+00	3.34E+00	5.77E+00
		93.35	35.00	5.60E-01		3.34E+00
		105.00	16.30	4.35E+00		6.37E+00
		129.22	2.97	-4.70E-01		3.05E+01
		338.32	5.30	1.17E+01		2.11E+01
		463.00	13.80	6.01E+00		9.46E+00
		911.23	16.70	9.96E+00		1.13E+01
+	AM-241	59.54	36.30	6.58E-02	3.58E-01	3.58E-01
+	CM-243	103.76	23.00	-5.52E-02	2.31E-01	2.31E-01
		228.18	10.60	1.22E-01		4.78E-01
		277.60	14.00	7.03E-02		3.84E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-006-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-006-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :  
  
Sample Size : 6.809E+02 grams  
Facility : Dairyland\_NPP  
  
Sample Taken On : 9/5/2019 1:11:00PM  
Acquisition Started : 9/9/2019 12:05:08PM  
  
Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.5 seconds  
  
Dead Time : 0.30 %  
  
Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV  
  
Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :  
  
Sample Number : 7423

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 12:35:16PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-006-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	77.00	147 -	159	154.54	1.30E+02	37.86	6.87E+02	1.64
F	2	185.83	368 -	376	372.16	4.76E+01	21.88	2.96E+02	0.89
F	3	238.43	472 -	481	477.33	1.65E+02	34.66	3.82E+02	1.22
F	4	295.14	582 -	595	590.73	1.02E+02	26.22	1.86E+02	1.92
F	5	337.73	668 -	683	675.90	3.60E+01	16.97	1.79E+02	1.19
F	6	351.84	698 -	709	704.10	1.81E+02	29.92	1.22E+02	1.48
F	7	582.84	1161 -	1171	1166.03	4.14E+01	16.70	7.70E+01	1.43
F	8	609.05	1213 -	1225	1218.43	1.44E+02	25.67	4.82E+01	1.78
F	9	910.78	1817 -	1827	1821.80	2.95E+01	12.88	2.40E+01	1.72
F	10	1120.08	2236 -	2245	2240.34	1.88E+01	4.16	4.18E+01	0.66
F	11	1460.12	2911 -	2928	2920.35	2.28E+02	31.40	4.07E+01	2.51
F	12	1763.65	3521 -	3533	3527.37	3.38E+01	12.18	3.32E+00	2.48

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 12:35:16PM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	77.00	1.30E+02	37.86			1.30E+02	3.79E+01
F	2	185.83	4.76E+01	21.88			4.76E+01	2.19E+01
F	3	238.43	1.65E+02	34.66			1.65E+02	3.47E+01
F	4	295.14	1.02E+02	26.22			1.02E+02	2.62E+01
F	5	337.73	3.60E+01	16.97			3.60E+01	1.70E+01
F	6	351.84	1.81E+02	29.92	4.18E+01	1.86E+01	1.39E+02	3.52E+01
F	7	582.84	4.14E+01	16.70			4.14E+01	1.67E+01
F	8	609.05	1.44E+02	25.67	2.06E+01	1.21E+01	1.24E+02	2.84E+01
F	9	910.78	2.95E+01	12.88			2.95E+01	1.29E+01
F	10	1120.08	1.88E+01	4.16			1.88E+01	4.16E+00
F	11	1460.12	2.28E+02	31.40	2.82E+01	8.57E+00	2.00E+02	3.26E+01
F	12	1763.65	3.38E+01	12.18			3.38E+01	1.22E+01



Analysis Report for L3-012-101-FSGS-006-SS

L3-012-101

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.93	1460.75	*	10.67	6.40E+00	1.10E+00
PB-212	0.99	77.11	*	17.50	5.38E-01	1.61E-01
		238.63	*	44.60	2.50E-01	5.40E-02
BI-214	0.76	609.31	*	46.30	4.18E-01	9.88E-02
		1120.29	*	15.10	3.37E-01	7.62E-02
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49	*	15.80	8.56E-01	3.13E-01
PB-214	0.99	77.11	*	10.70	8.80E-01	2.63E-01
		295.21	*	19.20	4.28E-01	1.12E-01
		351.92	*	37.20	3.54E-01	9.11E-02
RA-226	0.97	186.21	*	3.28	8.24E-01	3.82E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Analysis Report for L3-012-101-FSGS-006-SS  
L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.938	6.40E+00	1.10E+00	
PB-212	0.995	2.55E-01	5.14E-02	
BI-214	0.762	3.85E-01	5.93E-02	
PB-214	0.999	3.88E-01	6.85E-02	
RA-226	0.977	8.24E-01	3.82E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-006-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/9/2019 12:35:16PM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 5	337.73	2.00249E-02	23.54	Tol.	AC-228 PA-228
F 7	582.84	2.30086E-02	20.17		
F 9	910.78	1.63697E-02	21.86	Tol.	AC-228 PA-228

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	6.40E+00	1.20E+00	1.20E+00
+	AR-41	1293.64	99.16	-3.23E+13	4.85E+14	4.85E+14
+	CO-60	1173.22	100.00	1.04E-01	8.91E-02	1.05E-01
		1332.49	100.00	8.06E-03		8.91E-02
+	KR-85	513.99	0.43	4.42E+00	1.80E+01	1.80E+01
+	Y-88	898.04	93.70	1.13E-02	7.12E-02	9.23E-02
		1836.06	99.20	-5.34E-03		7.12E-02
+	NB-94	702.63	100.00	-3.80E-02	6.53E-02	6.53E-02
		871.10	100.00	-1.24E-01		6.80E-02
+	I-131	284.30	6.06	-6.86E-01	1.03E-01	1.35E+00
		364.48	81.20	7.74E-02		1.03E-01

## Analysis Report for L3-012-101-FSGS-006-SS

L3-012-101

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
	I-131	636.97	7.27	-1.71E-01	1.03E-01	1.27E+00
+	CS-134	604.70	97.60	-4.30E-02	9.37E-02	1.15E-01
		795.84	85.40	-1.17E-01		9.37E-02
+	CS-137	661.65	85.12	1.24E-02	9.63E-02	9.63E-02
+	CE-144	80.12	1.36	-4.52E+00	5.02E-01	6.68E+00
		133.51	11.09	3.42E-01		5.02E-01
+	EU-152	121.78	28.40	-1.72E-01	1.84E-01	1.84E-01
		344.28	26.60	1.23E-03		2.50E-01
		1408.00	20.74	7.68E-02		4.07E-01
+	EU-154	123.07	40.40	-5.31E-02	1.32E-01	1.32E-01
		723.30	19.70	1.91E-01		3.87E-01
		1274.51	35.50	7.92E-02		3.26E-01
+	EU-155	86.54	32.80	-6.40E-03	2.22E-01	2.22E-01
		105.31	21.80	1.59E-01		2.59E-01
+	BI-214	609.31	* 46.30	4.18E-01	1.32E-01	1.32E-01
		1120.29	* 15.10	3.37E-01		4.70E-01
		1238.11	5.94	3.74E-01		2.02E+00
		1377.67	4.11	9.81E-01		2.12E+00
		1407.98	2.48	6.42E-01		3.40E+00
		1509.19	2.19	-5.45E-02		4.16E+00
		1764.49	* 15.80	8.56E-01		2.45E-01
+	PB-214	77.11	* 10.70	8.80E-01	1.47E-01	6.90E-01
		295.21	* 19.20	4.28E-01		2.33E-01
		351.92	* 37.20	3.54E-01		1.47E-01
+	PA-228	89.95	22.00	6.31E+00	3.71E+00	6.41E+00
		93.35	35.00	-8.80E-02		3.71E+00
		105.00	16.30	3.43E+00		6.95E+00
		129.22	2.97	-2.26E+01		3.63E+01
		338.32	5.30	2.02E+01		2.45E+01
		463.00	13.80	6.01E-01		9.99E+00
		911.23	16.70	9.57E+00		1.22E+01
+	AM-241	59.54	36.30	-2.15E-01	4.07E-01	4.07E-01
+	CM-243	103.76	23.00	-7.89E-03	2.46E-01	2.46E-01
		228.18	10.60	-1.50E-01		5.11E-01
		277.60	14.00	-7.61E-02		4.36E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-006-SS  
L3-012-101

Analysis Report for L3-012-101-FSGS-007-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-007-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 7.558E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 10:26:00AM  
Acquisition Started : 9/9/2019 12:36:02PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.4 seconds

Dead Time : 0.30 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7424

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 1:06:11PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-007-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	76.82	147 -	159	154.18	8.87E+01	34.18	7.54E+02	1.34
F	2	185.83	364 -	378	372.16	7.09E+01	25.98	4.32E+02	1.22
F	3	238.58	474 -	481	477.64	1.75E+02	34.19	2.66E+02	1.25
F	4	295.14	582 -	597	590.73	1.08E+02	27.01	2.48E+02	1.70
F	5	338.11	672 -	680	676.66	4.66E+01	18.36	8.57E+01	1.41
F	6	351.66	696 -	709	703.75	1.81E+02	30.35	1.80E+02	1.37
F	7	582.75	1159 -	1173	1165.84	5.77E+01	18.54	7.52E+01	1.93
F	8	609.01	1209 -	1225	1218.35	1.50E+02	25.71	3.84E+01	2.00
F	9	910.55	1817 -	1826	1821.34	2.56E+01	12.47	3.56E+01	1.30
F	10	1460.40	2913 -	2930	2920.91	2.13E+02	29.68	1.40E+01	2.55
F	11	1764.43	3524 -	3535	3528.93	2.35E+01	10.43	5.00E+00	2.13

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 1:06:11PM

Env. Background File : C:\Canberra\Apex\Root\Daairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	76.82	8.87E+01	34.18			8.87E+01	3.42E+01
F	2	185.83	7.09E+01	25.98			7.09E+01	2.60E+01
F	3	238.58	1.75E+02	34.19			1.75E+02	3.42E+01
F	4	295.14	1.08E+02	27.01			1.08E+02	2.70E+01
F	5	338.11	4.66E+01	18.36			4.66E+01	1.84E+01
F	6	351.66	1.81E+02	30.35	4.18E+01	1.86E+01	1.40E+02	3.56E+01
F	7	582.75	5.77E+01	18.54			5.77E+01	1.85E+01
F	8	609.01	1.50E+02	25.71	2.06E+01	1.21E+01	1.30E+02	2.84E+01
F	9	910.55	2.56E+01	12.47			2.56E+01	1.25E+01
F	10	1460.40	2.13E+02	29.68	2.82E+01	8.57E+00	1.84E+02	3.09E+01
F	11	1764.43	2.35E+01	10.43	7.59E+00	4.90E+00	1.59E+01	1.15E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-007-SS

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

<b>Nuclide Name</b>	<b>Id Confidence</b>	<b>Energy (keV)</b>		<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Activity Uncertainty</b>
K-40	0.98	1460.75 *		10.67	5.32E+00	9.38E-01
PB-212	0.99	77.11 *		17.50	3.33E-01	1.30E-01
		238.63 *		44.60	2.39E-01	4.83E-02
BI-214	0.54	609.31 *		46.30	3.95E-01	8.93E-02
		1120.29		15.10		
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49 *		15.80	3.64E-01	2.64E-01
PB-214	0.99	77.11 *		10.70	5.44E-01	2.13E-01
		295.21 *		19.20	4.08E-01	1.04E-01
		351.92 *		37.20	3.19E-01	8.28E-02
RA-226	0.97	186.21 *		3.28	1.11E+00	4.10E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
---------------------	------------------------------	-------------------------------------	-------------------------------------	-----------------



Analysis Report for L3-012-101-FSGS-007-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.980	5.32E+00	9.38E-01	
PB-212	0.996	2.26E-01	4.55E-02	
BI-214	0.545	3.92E-01	8.46E-02	
PB-214	0.992	3.38E-01	6.23E-02	
RA-226	0.977	1.11E+00	4.10E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-007-SS  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/9/2019 1:06:11PM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 5	338.11	2.59026E-02	19.69	Tol.	AC-228 PA-228
F 7	582.75	3.20770E-02	16.06		
F 9	910.55	1.42239E-02	24.35	Tol.	PA-228

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daairyland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	5.32E+00	8.72E-01	8.72E-01
+	AR-41	1293.64	99.16	-1.79E+14	1.46E+15	1.46E+15
+	CO-60	1173.22	100.00	1.58E-02	8.94E-02	1.01E-01
		1332.49	100.00	6.75E-02		8.94E-02
+	KR-85	513.99	0.43	1.23E+01	1.70E+01	1.70E+01
+	Y-88	898.04	93.70	4.68E-02	7.51E-02	9.09E-02
		1836.06	99.20	-3.15E-02		7.51E-02
+	NB-94	702.63	100.00	-3.27E-02	6.51E-02	6.51E-02
		871.10	100.00	-6.53E-03		7.45E-02
+	I-131	284.30	6.06	2.81E-01	9.48E-02	1.27E+00
		364.48	81.20	-1.61E-02		9.48E-02
		636.97	7.27	1.04E-01		1.28E+00
+	CS-134	604.70	97.60	6.40E-03	9.32E-02	1.02E-01

## Analysis Report for L3-012-101-FSGS-007-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
	CS-134	795.84	85.40	-2.74E-02	9.32E-02	9.32E-02
+	CS-137	661.65	85.12	6.54E-02	9.05E-02	9.05E-02
+	CE-144	80.12	1.36	-2.05E+00	4.38E-01	5.95E+00
		133.51	11.09	-2.38E-02		4.38E-01
+	EU-152	121.78	28.40	-5.58E-02	1.77E-01	1.77E-01
		344.28	26.60	-8.68E-02		2.34E-01
		1408.00	20.74	-1.19E-01		3.46E-01
+	EU-154	123.07	40.40	-2.51E-02	1.25E-01	1.25E-01
		723.30	19.70	4.03E-02		3.78E-01
		1274.51	35.50	5.57E-02		2.48E-01
+	EU-155	86.54	32.80	-1.10E-01	1.98E-01	1.98E-01
		105.31	21.80	-2.29E-02		2.38E-01
+	BI-214	609.31	46.30	3.95E-01	1.17E-01	1.17E-01
		1120.29	15.10	4.81E-01		7.58E-01
		1238.11	5.94	2.37E-01		2.02E+00
		1377.67	4.11	-7.98E-01		1.78E+00
		1407.98	2.48	-9.92E-01		2.89E+00
		1509.19	2.19	-2.07E-01		3.54E+00
		1764.49	* 15.80	3.64E-01		3.95E-01
+	PB-214	77.11	* 10.70	5.44E-01	1.52E-01	6.52E-01
		295.21	* 19.20	4.08E-01		2.51E-01
		351.92	* 37.20	3.19E-01		1.52E-01
+	PA-228	89.95	22.00	1.13E+00	3.70E+00	6.28E+00
		93.35	35.00	1.93E+00		3.70E+00
		105.00	16.30	-6.42E-01		7.02E+00
		129.22	2.97	2.84E+00		3.72E+01
		338.32	5.30	-1.56E+00		2.35E+01
		463.00	13.80	-3.50E+00		9.31E+00
		911.23	16.70	4.06E+00		1.29E+01
+	AM-241	59.54	36.30	1.78E-01	3.82E-01	3.82E-01
+	CM-243	103.76	23.00	-4.07E-02	2.26E-01	2.26E-01
		228.18	10.60	1.10E-02		4.74E-01
		277.60	14.00	-2.21E-01		3.81E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-008-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-008-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 6.255E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 9:09:00AM  
Acquisition Started : 9/9/2019 1:51:37PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.6 seconds

Dead Time : 0.31 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7426

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 2:21:48PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

## Analysis Report for L3-012-101-FSGS-008-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	76.89	147 -	158	154.32	1.10E+02	33.87	5.90E+02	1.28
F	2	238.50	471 -	481	477.47	1.30E+02	31.21	3.47E+02	1.20
F	3	294.95	582 -	596	590.35	9.22E+01	25.14	2.36E+02	1.44
F	4	338.07	673 -	680	676.57	2.97E+01	17.49	9.31E+01	1.50
F	5	351.66	699 -	712	703.75	1.72E+02	29.48	1.68E+02	1.27
F	6	583.00	1162 -	1172	1166.33	3.68E+01	15.34	5.52E+01	1.51
F	7	609.24	1214 -	1224	1218.82	8.68E+01	20.67	5.13E+01	1.47
F	8	661.42	1316 -	1329	1323.15	5.81E+01	19.09	8.42E+01	1.90
F	9	910.69	1815 -	1826	1821.62	2.95E+01	14.72	5.93E+01	1.59
F	10	1119.93	2234 -	2245	2240.04	3.89E+01	14.31	2.09E+01	2.52
F	11	1460.35	2912 -	2928	2920.81	2.09E+02	29.46	1.72E+01	2.64
F	12	1763.52	3523 -	3533	3527.10	2.19E+01	9.60	0.00E+00	1.27

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 2:21:48PM

Env. Background File : C:\Canberra\Apex\Root\Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	76.89	1.10E+02	33.87			1.10E+02	3.39E+01
F	2	238.50	1.30E+02	31.21			1.30E+02	3.12E+01
F	3	294.95	9.22E+01	25.14			9.22E+01	2.51E+01
F	4	338.07	2.97E+01	17.49			2.97E+01	1.75E+01
F	5	351.66	1.72E+02	29.48	4.18E+01	1.86E+01	1.30E+02	3.49E+01
F	6	583.00	3.68E+01	15.34			3.68E+01	1.53E+01
F	7	609.24	8.68E+01	20.67	2.06E+01	1.21E+01	6.62E+01	2.40E+01
F	8	661.42	5.81E+01	19.09	3.31E+01	1.27E+01	2.51E+01	2.29E+01
F	9	910.69	2.95E+01	14.72			2.95E+01	1.47E+01
F	10	1119.93	3.89E+01	14.31			3.89E+01	1.43E+01
F	11	1460.35	2.09E+02	29.46	2.82E+01	8.57E+00	1.80E+02	3.07E+01
F	12	1763.52	2.19E+01	9.60			2.19E+01	9.60E+00

Analysis Report for L3-012-101-FSGS-008-SS

L3-012-101

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.97	1460.75	*	10.67	6.29E+00	1.12E+00
CS-137	0.99	661.65	*	85.12	5.42E-02	4.96E-02
PB-212	0.99	77.11	*	17.50	4.98E-01	1.57E-01
		238.63	*	44.60	2.15E-01	5.26E-02
BI-214	0.75	609.31	*	46.30	2.44E-01	8.92E-02
		1120.29	*	15.10	7.61E-01	2.82E-01
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49	*	15.80	6.04E-01	2.67E-01
PB-214	0.99	77.11	*	10.70	8.14E-01	2.56E-01
		295.21	*	19.20	4.22E-01	1.17E-01
		351.92	*	37.20	3.60E-01	9.78E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Analysis Report for L3-012-101-FSGS-008-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.975	6.29E+00	1.12E+00	
CS-137	0.991	5.42E-02	4.96E-02	
PB-212	0.996	2.19E-01	5.01E-02	
BI-214	0.758	3.20E-01	8.11E-02	
PB-214	0.990	3.91E-01	7.23E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-008-SS  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/9/2019 2:21:48PM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 4	338.07	1.64946E-02	29.45	Tol.	AC-228 PA-228
F 6	583.00	2.04394E-02	20.85		
F 9	910.69	1.63917E-02	24.94	Tol.	AC-228 PA-228

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Roof\Daairyland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	6.29E+00	1.08E+00	1.08E+00
+	AR-41	1293.64	99.16	-1.35E+15	3.64E+15	3.64E+15
+	CO-60	1173.22	100.00	2.07E-02	1.11E-01	1.26E-01
		1332.49	100.00	3.70E-02		1.11E-01
+	KR-85	513.99	0.43	1.89E+01	1.90E+01	1.90E+01
+	Y-88	898.04	93.70	-3.72E-02	9.66E-02	9.98E-02
		1836.06	99.20	3.08E-02		9.66E-02
+	NB-94	702.63	100.00	-3.33E-02	7.70E-02	7.70E-02
		871.10	100.00	-1.02E-01		8.24E-02
+	I-131	284.30	6.06	-1.57E+00	1.12E-01	1.37E+00
		364.48	81.20	1.21E-02		1.12E-01



## Analysis Report for L3-012-101-FSGS-008-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
	I-131	636.97	7.27	-1.51E-01	1.12E-01	1.48E+00
+	CS-134	604.70	97.60	-6.39E-02	1.07E-01	1.07E-01
		795.84	85.40	-6.39E-04		1.10E-01
+	CS-137	661.65	* 85.12	5.42E-02	1.04E-01	1.04E-01
+	CE-144	80.12	1.36	-5.73E+00	5.11E-01	7.06E+00
		133.51	11.09	-1.52E-01		5.11E-01
+	EU-152	121.78	28.40	1.15E-01	2.09E-01	2.09E-01
		344.28	26.60	-3.27E-01		2.68E-01
		1408.00	20.74	2.56E-01		4.00E-01
+	EU-154	123.07	40.40	1.69E-02	1.46E-01	1.46E-01
		723.30	19.70	3.52E-01		4.38E-01
		1274.51	35.50	1.07E-01		3.06E-01
+	EU-155	86.54	32.80	-1.09E-01	2.37E-01	2.37E-01
		105.31	21.80	-5.83E-02		2.81E-01
+	BI-214	609.31	* 46.30	2.44E-01	7.46E-02	1.42E-01
		1120.29	* 15.10	7.61E-01		3.82E-01
		1238.11	5.94	6.24E-01		2.26E+00
		1377.67	4.11	4.55E-01		2.57E+00
		1407.98	2.48	2.14E+00		3.34E+00
		1509.19	2.19	1.25E-01		3.72E+00
		1764.49	* 15.80	6.04E-01		7.46E-02
+	PB-214	77.11	* 10.70	8.14E-01	1.81E-01	6.86E-01
		295.21	* 19.20	4.22E-01		2.90E-01
		351.92	* 37.20	3.60E-01		1.81E-01
+	PA-228	89.95	22.00	7.00E+00	4.86E+00	8.33E+00
		93.35	35.00	3.35E-03		4.86E+00
		105.00	16.30	-7.91E-01		9.05E+00
		129.22	2.97	-1.24E+01		4.60E+01
		338.32	5.30	-1.56E+00		2.93E+01
		463.00	13.80	7.03E+00		1.35E+01
		911.23	16.70	1.00E+01		1.77E+01
+	AM-241	59.54	36.30	1.28E-01	4.22E-01	4.22E-01
+	CM-243	103.76	23.00	2.72E-02	2.68E-01	2.68E-01
		228.18	10.60	2.21E-01		5.48E-01
		277.60	14.00	1.85E-01		4.62E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-008-SS  
L3-012-101

Analysis Report for L3-012-101-FSGS-009-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-009-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 8.089E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 10:14:00AM  
Acquisition Started : 9/9/2019 2:24:05PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1806.0 seconds

Dead Time : 0.33 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7427

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 2:54:14PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-009-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
M	1	74.68	142 -	161	149.90	1.60E+02	38.33	7.49E+02	1.32
m	2	76.94	142 -	161	154.43	2.80E+02	46.79	7.26E+02	1.32
F	3	92.62	171 -	193	185.78	1.27E+02	42.44	1.89E+03	1.62
F	4	185.97	364 -	380	372.45	1.90E+02	39.40	8.26E+02	1.53
M	5	238.50	474 -	490	477.47	3.30E+02	44.13	3.20E+02	1.43
m	6	241.76	474 -	490	483.98	1.63E+02	32.47	3.51E+02	1.44
F	7	295.06	583 -	604	590.56	2.96E+02	39.79	5.02E+02	1.54
F	8	338.36	672 -	681	677.16	5.17E+01	24.36	2.09E+02	1.75
F	9	351.79	699 -	710	704.00	5.26E+02	50.93	2.19E+02	1.56
F	10	582.98	1159 -	1172	1166.30	1.17E+02	24.78	1.26E+02	1.44
F	11	609.07	1213 -	1227	1218.48	3.84E+02	41.60	1.10E+02	1.71
F	12	767.88	1530 -	1541	1536.03	3.84E+01	14.96	8.39E+01	0.96
F	13	911.02	1816 -	1829	1822.28	6.99E+01	19.96	6.90E+01	1.97
F	14	968.82	1932 -	1943	1937.87	3.58E+01	16.05	7.99E+01	1.54
F	15	1119.92	2232 -	2246	2240.03	6.91E+01	19.04	4.89E+01	2.37
F	16	1238.33	2470 -	2484	2476.82	3.40E+01	15.19	6.16E+01	2.07
F	17	1460.52	2913 -	2929	2921.15	2.06E+02	29.79	2.96E+01	2.64
F	18	1764.08	3520 -	3534	3528.22	6.22E+01	16.27	3.56E+00	2.45

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 2:54:14PM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
M	1	74.68	1.60E+02	38.33			1.60E+02	3.83E+01
m	2	76.94	2.80E+02	46.79			2.80E+02	4.68E+01
F	3	92.62	1.27E+02	42.44			1.27E+02	4.24E+01
F	4	185.97	1.90E+02	39.40			1.90E+02	3.94E+01
M	5	238.50	3.30E+02	44.13			3.30E+02	4.41E+01
m	6	241.76	1.63E+02	32.47			1.63E+02	3.25E+01
F	7	295.06	2.96E+02	39.79			2.96E+02	3.98E+01
F	8	338.36	5.17E+01	24.36			5.17E+01	2.44E+01
F	9	351.79	5.26E+02	50.93	4.18E+01	1.86E+01	4.84E+02	5.42E+01
F	10	582.98	1.17E+02	24.78			1.17E+02	2.48E+01
F	11	609.07	3.84E+02	41.60	2.06E+01	1.21E+01	3.63E+02	4.33E+01

Analysis Report for L3-012-101-FSGS-009-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	12	767.88	3.84E+01	14.96			3.84E+01	1.50E+01
F	13	911.02	6.99E+01	19.96			6.99E+01	2.00E+01
F	14	968.82	3.58E+01	16.05			3.58E+01	1.61E+01
F	15	1119.92	6.91E+01	19.04			6.91E+01	1.90E+01
F	16	1238.33	3.40E+01	15.19			3.40E+01	1.52E+01
F	17	1460.52	2.06E+02	29.79	2.82E+01	8.57E+00	1.78E+02	3.10E+01
F	18	1764.08	6.22E+01	16.27	7.59E+00	4.90E+00	5.46E+01	1.70E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

<b>Nuclide Name</b>	<b>Id Confidence</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Activity Uncertainty</b>
K-40	0.99	1460.75 *	10.67	4.79E+00	8.76E-01
PB-212	0.99	77.11 *	17.50	9.80E-01	1.75E-01
		238.63 *	44.60	4.21E-01	6.03E-02
BI-214	0.86	609.31 *	46.30	1.03E+00	1.36E-01
		1120.29 *	15.10	1.04E+00	2.92E-01
		1238.11 *	5.94	1.43E+00	6.41E-01
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49 *	15.80	1.16E+00	3.69E-01
PB-214	0.99	77.11 *	10.70	1.60E+00	2.87E-01
		295.21 *	19.20	1.05E+00	1.50E-01
		351.92 *	37.20	1.03E+00	1.26E-01
RA-226	0.99	186.21 *	3.28	2.77E+00	5.94E-01
AC-228	0.60	209.28	4.40		
		338.32 *	11.40	3.48E-01	1.65E-01
		794.70	4.60		
		911.60 *	27.70	4.79E-01	1.38E-01
		964.60	5.20		
		969.11 *	16.60	4.33E-01	1.95E-01

Analysis Report for L3-012-101-FSGS-009-SS  
L3-012-101

\* = Energy line found in the spectrum.  
- = Manually added nuclide.  
? = Manually edited nuclide.  
@ = Energy line not used for Weighted Mean Activity  
Energy Tolerance : 1.000 keV  
Nuclide confidence index threshold = 0.30  
Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.991	4.79E+00	8.76E-01	
PB-212	0.997	4.14E-01	5.74E-02	
BI-214	0.863	1.06E+00	1.15E-01	
PB-214	0.997	1.03E+00	9.20E-02	
RA-226	0.991	2.77E+00	5.94E-01	
AC-228	0.609	4.27E-01	9.31E-02	

? = nuclide is part of an undetermined solution  
X = nuclide rejected by the interference analysis  
@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-009-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/9/2019 2:54:14PM

Peak Locate From Channel : 100

Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
M 1	74.68	8.91626E-02	11.94		
F 3	92.62	7.05769E-02	16.70	Tol.	PA-228
m 6	241.76	9.03072E-02	9.99		
F 10	582.98	6.48829E-02	10.61		
F 12	767.88	2.13247E-02	19.49		

---

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	4.79E+00	9.26E-01
+	AR-41	1293.64	99.16	1.29E+15	3.47E+15	3.47E+15
+	CO-60	1173.22	100.00	4.38E-02	9.73E-02	9.98E-02
		1332.49	100.00	1.04E-02		9.73E-02
+	KR-85	513.99	0.43	1.32E+01	1.89E+01	1.89E+01
+	Y-88	898.04	93.70	-4.62E-02	7.89E-02	8.27E-02
		1836.06	99.20	-1.02E-01		7.89E-02
+	NB-94	702.63	100.00	4.68E-02	7.39E-02	7.39E-02
		871.10	100.00	-3.34E-02		8.18E-02

## Analysis Report for L3-012-101-FSGS-009-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	I-131	284.30	6.06	-4.13E-01	1.11E-01	1.45E+00
		364.48	81.20	1.73E-02		1.11E-01
		636.97	7.27	4.02E-01		1.37E+00
+	CS-134	604.70	97.60	-7.98E-02	1.00E-01	1.44E-01
		795.84	85.40	-4.09E-02		1.00E-01
+	CS-137	661.65	85.12	6.38E-02	1.00E-01	1.00E-01
+	CE-144	80.12	1.36	-6.57E-02	5.41E-01	7.54E+00
		133.51	11.09	-4.41E-02		5.41E-01
+	EU-152	121.78	28.40	-6.90E-02	2.12E-01	2.12E-01
		344.28	26.60	-5.40E-01		2.81E-01
		1408.00	20.74	2.61E-01		4.96E-01
+	EU-154	123.07	40.40	7.56E-02	1.51E-01	1.51E-01
		723.30	19.70	2.81E-01		3.98E-01
		1274.51	35.50	-9.94E-02		2.66E-01
+	EU-155	86.54	32.80	-2.44E-03	2.48E-01	2.48E-01
		105.31	21.80	-1.05E-01		2.75E-01
+	BI-214	609.31	* 46.30	1.03E+00	1.47E-01	1.47E-01
		1120.29	* 15.10	1.04E+00		4.59E-01
		1238.11	* 5.94	1.43E+00		1.43E+00
		1377.67	4.11	9.57E-01		2.58E+00
		1407.98	2.48	2.18E+00		4.14E+00
		1509.19	2.19	-1.30E+00		3.63E+00
		1764.49	* 15.80	1.16E+00		3.60E-01
+	PB-214	77.11	* 10.70	1.60E+00	1.47E-01	5.22E-01
		295.21	* 19.20	1.05E+00		3.70E-01
		351.92	* 37.20	1.03E+00		1.47E-01
+	PA-228	89.95	22.00	7.57E-01	4.85E+00	8.61E+00
		93.35	35.00	-4.21E-02		4.85E+00
		105.00	16.30	-2.69E+00		8.70E+00
		129.22	2.97	-5.57E-01		4.76E+01
		338.32	5.30	-1.93E+00		3.03E+01
		463.00	13.80	4.04E+00		1.24E+01
		911.23	16.70	2.52E+01		1.63E+01
+	AM-241	59.54	36.30	-6.01E-02	4.23E-01	4.23E-01
+	CM-243	103.76	23.00	8.46E-02	2.63E-01	2.63E-01
		228.18	10.60	3.37E-01		5.74E-01
		277.60	14.00	-3.25E-01		4.51E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level



Analysis Report for L3-012-101-FSGS-009-SS  
L3-012-101

Analysis Report for L3-012-101-FSGS-010-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-010-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 9.540E+02 grams  
Facility : Dairylead\_NPP

Sample Taken On : 9/5/2019 9:19:00AM  
Acquisition Started : 9/9/2019 2:55:25PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.5 seconds

Dead Time : 0.30 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7428

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 3:25:34PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-010-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	76.86	147 -	158	154.26	4.69E+01	29.17	5.85E+02	1.28
F	2	238.61	474 -	481	477.69	3.68E+01	29.74	2.36E+02	1.01
F	3	295.19	582 -	605	590.84	7.97E+01	23.00	3.25E+02	1.40
F	4	351.79	699 -	708	704.02	1.20E+02	25.68	1.12E+02	1.39
F	5	582.70	1161 -	1170	1165.74	2.29E+01	12.80	4.00E+01	1.62
F	6	609.12	1213 -	1225	1218.58	1.06E+02	22.59	4.84E+01	1.86
F	7	1460.44	2912 -	2927	2920.98	1.42E+02	24.67	2.04E+01	2.42

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 3:25:34PM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	76.86	4.69E+01	29.17			4.69E+01	2.92E+01
F	2	238.61	3.68E+01	29.74			3.68E+01	2.97E+01
F	3	295.19	7.97E+01	23.00			7.97E+01	2.30E+01
F	4	351.79	1.20E+02	25.68	4.18E+01	1.86E+01	7.78E+01	3.17E+01
F	5	582.70	2.29E+01	12.80			2.29E+01	1.28E+01
F	6	609.12	1.06E+02	22.59	2.06E+01	1.21E+01	8.56E+01	2.56E+01
F	7	1460.44	1.42E+02	24.67	2.82E+01	8.57E+00	1.14E+02	2.61E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-010-SS

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75 *	10.67	2.60E+00	6.14E-01
PB-212	0.99	77.11 *	17.50	1.39E-01	8.70E-02
		238.63 *	44.60	3.98E-02	3.22E-02
BI-214	0.34	609.31 *	46.30	2.07E-01	6.29E-02
		1120.29	15.10		
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.99	77.11 *	10.70	2.28E-01	1.42E-01
		295.21 *	19.20	2.39E-01	7.00E-02
		351.92 *	37.20	1.41E-01	5.78E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.984	2.60E+00	6.14E-01	
PB-212	0.997	3.86E-02	3.04E-02	
BI-214	0.347	2.07E-01	6.29E-02	

Analysis Report for L3-012-101-FSGS-010-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
PB-214	0.997	1.79E-01	4.28E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-010-SS  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/9/2019 3:25:34PM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 5	582.70	1.27458E-02	27.90		

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	2.60E+00	7.24E-01	7.24E-01
+	AR-41	1293.64	99.16	-6.09E+15	3.35E+15	3.35E+15
+	CO-60	1173.22	100.00	5.44E-02	6.91E-02	7.45E-02
		1332.49	100.00	1.52E-02		6.91E-02
+	KR-85	513.99	0.43	7.46E+00	1.10E+01	1.10E+01
+	Y-88	898.04	93.70	-2.48E-02	4.59E-02	6.03E-02
		1836.06	99.20	-4.12E-02		4.59E-02
+	NB-94	702.63	100.00	-4.40E-03	4.90E-02	4.90E-02
		871.10	100.00	-1.03E-02		5.51E-02
+	I-131	284.30	6.06	2.06E-01	6.68E-02	9.36E-01
		364.48	81.20	8.22E-03		6.68E-02
		636.97	7.27	-2.11E-01		9.08E-01
+	CS-134	604.70	97.60	-8.13E-03	6.54E-02	7.28E-02
		795.84	85.40	1.46E-03		6.54E-02
+	CS-137	661.65	85.12	4.16E-02	6.53E-02	6.53E-02
+	CE-144	80.12	1.36	-8.69E-01	3.27E-01	4.27E+00
		133.51	11.09	-7.34E-02		3.27E-01

## Analysis Report for L3-012-101-FSGS-010-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	EU-152	121.78	28.40	-1.04E-01	1.22E-01	1.22E-01
		344.28	26.60	-4.87E-02		1.61E-01
		1408.00	20.74	1.12E-01		2.80E-01
+	EU-154	123.07	40.40	-6.31E-03	8.76E-02	8.76E-02
		723.30	19.70	6.94E-02		2.43E-01
		1274.51	35.50	-4.68E-02		1.87E-01
+	EU-155	86.54	32.80	-9.78E-02	1.46E-01	1.46E-01
		105.31	21.80	3.71E-02		1.76E-01
+	BI-214	609.31	* 46.30	2.07E-01	9.39E-02	9.39E-02
		1120.29	15.10	6.33E-01		5.88E-01
		1238.11	5.94	1.09E+00		1.43E+00
		1377.67	4.11	3.10E-01		1.46E+00
		1407.98	2.48	9.35E-01		2.34E+00
		1509.19	2.19	1.05E+00		2.23E+00
		1764.49	15.80	3.25E-01		4.52E-01
+	PB-214	77.11	* 10.70	2.28E-01	1.00E-01	4.49E-01
		295.21	* 19.20	2.39E-01		2.60E-01
		351.92	* 37.20	1.41E-01		1.00E-01
+	PA-228	89.95	22.00	6.98E+00	3.02E+00	5.26E+00
		93.35	35.00	3.26E-01		3.02E+00
		105.00	16.30	1.51E+00		5.85E+00
		129.22	2.97	-5.52E+00		2.93E+01
		338.32	5.30	-8.19E+00		1.88E+01
		463.00	13.80	1.26E+00		8.12E+00
		911.23	16.70	-2.58E+00		9.74E+00
+	AM-241	59.54	36.30	1.05E-01	2.57E-01	2.57E-01
+	CM-243	103.76	23.00	9.96E-02	1.68E-01	1.68E-01
		228.18	10.60	-1.61E-02		3.47E-01
		277.60	14.00	3.75E-02		2.79E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-011-SS  
L3-012-101

---

## **GAMMA SPECTRUM ANALYSIS**

---

Sample Identification : L3-012-101-FSGS-011-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 8.342E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 10:02:00AM  
Acquisition Started : 9/9/2019 3:26:11PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.6 seconds

Dead Time : 0.31 %

Peak Locate Threshold : 3.00  
Peak Locate Range (In channels) : 100 - 4096  
Peak Area Range (In channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7429

---

## **PEAK ANALYSIS REPORT**

---

Peak Analysis Performed on : 9/9/2019 3:56:20PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096



Analysis Report for L3-012-101-FSGS-011-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	76.06	147 -	159	152.67	1.43E+02	40.06	4.43E+02	4.07
M	2	238.51	474 -	490	477.49	5.99E+01	20.29	1.18E+02	1.09
m	3	241.81	474 -	490	484.10	3.35E+01	17.37	1.54E+02	1.09
F	4	295.05	586 -	596	590.56	7.59E+01	21.80	1.34E+02	1.25
F	5	351.95	699 -	710	704.32	1.01E+02	23.79	9.94E+01	1.68
F	6	608.94	1213 -	1227	1218.21	7.64E+01	18.82	3.76E+01	1.41
F	7	1460.53	2912 -	2929	2921.18	1.64E+02	25.88	8.87E+00	2.48

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 3:56:20PM

Env. Background File : C:\Canberra\Apex\Root\Daairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	76.06	1.43E+02	40.06			1.43E+02	4.01E+01
M	2	238.51	5.99E+01	20.29			5.99E+01	2.03E+01
m	3	241.81	3.35E+01	17.37			3.35E+01	1.74E+01
F	4	295.05	7.59E+01	21.80			7.59E+01	2.18E+01
F	5	351.95	1.01E+02	23.79	4.18E+01	1.86E+01	5.95E+01	3.02E+01
F	6	608.94	7.64E+01	18.82	2.06E+01	1.21E+01	5.58E+01	2.24E+01
F	7	1460.53	1.64E+02	25.88	2.82E+01	8.57E+00	1.36E+02	2.73E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-011-SS  
L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.99	1460.75 *	10.67	3.54E+00	7.39E-01
PB-212	0.55	77.11	17.50		
		238.63 *	44.60	7.41E-02	2.54E-02
BI-214	0.33	609.31 *	46.30	1.54E-01	6.23E-02
		1120.29	15.10		
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.72	77.11	10.70		
		295.21 *	19.20	2.60E-01	7.58E-02
		351.92 *	37.20	1.23E-01	6.29E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.992	3.54E+00	7.39E-01	
PB-212	0.559	7.41E-02	2.54E-02	
BI-214	0.339	1.54E-01	6.23E-02	

Analysis Report for L3-012-101-FSGS-011-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
PB-214	0.720	1.79E-01	4.84E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-011-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/9/2019 3:56:20PM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 1	76.06	7.93716E-02	14.02		
m 3	241.81	1.86051E-02	25.93		

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apexi\Root\Daistryland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	3.54E+00	7.41E-01	7.41E-01
+	AR-41	1293.64	99.16	-1.59E+15	3.81E+15	3.81E+15
+	CO-60	1173.22	100.00	5.02E-02	8.00E-02	8.52E-02
		1332.49	100.00	3.03E-02		8.00E-02
+	KR-85	513.99	0.43	1.10E+01	1.32E+01	1.32E+01
+	Y-88	898.04	93.70	2.25E-02	5.25E-02	7.16E-02
		1836.06	99.20	-8.86E-03		5.25E-02
+	NB-94	702.63	100.00	2.18E-03	5.23E-02	5.23E-02
		871.10	100.00	4.85E-03		5.81E-02
+	I-131	284.30	6.06	-4.20E-01	7.90E-02	9.63E-01
		364.48	81.20	9.72E-03		7.90E-02
		636.97	7.27	-5.87E-01		9.57E-01
+	CS-134	604.70	97.60	-3.47E-02	7.19E-02	7.46E-02
		795.84	85.40	-5.30E-02		7.19E-02

## Analysis Report for L3-012-101-FSGS-011-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	CS-137	661.65	85.12	3.63E-02	7.71E-02	7.71E-02
+	CE-144	80.12	1.36	-1.86E+00	3.59E-01	4.58E+00
		133.51	11.09	-7.91E-02		3.59E-01
+	EU-152	121.78	28.40	1.30E-02	1.41E-01	1.41E-01
		344.28	26.60	-2.49E-02		1.82E-01
		1408.00	20.74	2.42E-01		3.56E-01
+	EU-154	123.07	40.40	-3.64E-02	9.87E-02	9.87E-02
		723.30	19.70	-3.51E-02		2.68E-01
		1274.51	35.50	8.69E-02		1.88E-01
+	EU-155	86.54	32.80	6.63E-02	1.59E-01	1.59E-01
		105.31	21.80	3.21E-02		1.89E-01
+	BI-214	609.31	* 46.30	1.54E-01	1.03E-01	1.03E-01
		1120.29	15.10	7.72E-02		5.12E-01
		1238.11	5.94	9.15E-02		1.46E+00
		1377.67	4.11	1.48E+00		1.61E+00
		1407.98	2.48	2.02E+00		2.98E+00
		1509.19	2.19	-1.64E+00		2.46E+00
		1764.49	15.80	4.41E-01		5.46E-01
+	PB-214	77.11	10.70	1.91E-01	1.14E-01	6.15E-01
		295.21	* 19.20	2.60E-01		1.53E-01
		351.92	* 37.20	1.23E-01		1.14E-01
+	PA-228	89.95	22.00	1.38E+00	3.36E+00	5.59E+00
		93.35	35.00	4.20E-01		3.36E+00
		105.00	16.30	1.03E+00		6.23E+00
		129.22	2.97	5.78E+00		3.33E+01
		338.32	5.30	-3.66E+00		2.10E+01
		463.00	13.80	7.81E+00		8.83E+00
		911.23	16.70	-5.08E+00		9.29E+00
+	AM-241	59.54	36.30	3.62E-02	2.95E-01	2.95E-01
+	CM-243	103.76	23.00	-5.29E-03	1.81E-01	1.81E-01
		228.18	10.60	2.05E-01		3.81E-01
		277.60	14.00	-2.54E-02		3.05E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-012-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-012-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 8.265E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 9:33:00AM  
Acquisition Started : 9/9/2019 4:07:38PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1806.3 seconds

Dead Time : 0.35 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7430

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 4:37:48PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-012-SS

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
M	1	74.66	142 -	161	149.87	1.76E+02	41.37	8.29E+02	1.21
m	2	77.02	142 -	161	154.59	3.23E+02	50.13	8.82E+02	1.21
M	3	87.16	167 -	191	174.86	1.10E+02	38.37	7.72E+02	1.28
m	4	92.60	167 -	191	185.73	1.25E+02	39.83	8.39E+02	1.29
F	5	185.81	366 -	377	372.11	1.85E+02	40.19	7.83E+02	1.27
F	6	209.26	413 -	426	419.00	6.50E+01	27.17	6.87E+02	0.94
M	7	238.52	471 -	490	477.52	4.32E+02	50.10	4.26E+02	1.41
m	8	241.74	471 -	490	483.96	1.66E+02	33.56	4.20E+02	1.42
F	9	295.17	587 -	595	590.80	3.46E+02	45.23	3.45E+02	1.38
F	10	338.05	673 -	680	676.53	6.48E+01	23.92	2.11E+02	1.12
F	11	351.75	697 -	708	703.93	6.55E+02	55.66	2.03E+02	1.33
F	12	583.01	1157 -	1172	1166.36	1.29E+02	25.87	1.44E+02	1.48
F	13	609.15	1212 -	1223	1218.63	4.83E+02	47.25	1.05E+02	1.60
F	14	727.34	1451 -	1459	1454.98	1.40E+01	9.77	4.57E+01	0.68
F	15	768.18	1531 -	1542	1536.63	5.25E+01	17.90	7.45E+01	1.55
F	16	806.23	1607 -	1618	1612.73	3.65E+01	14.95	5.07E+01	1.60
F	17	910.82	1813 -	1827	1821.89	7.02E+01	19.79	7.50E+01	1.97
F	18	934.36	1864 -	1874	1868.96	2.31E+01	11.80	4.07E+01	1.15
F	19	968.97	1933 -	1945	1938.16	4.07E+01	17.61	9.26E+01	1.76
F	20	1120.03	2234 -	2248	2240.24	8.58E+01	20.97	6.32E+01	1.97
F	21	1460.45	2912 -	2929	2921.01	2.95E+02	35.47	4.51E+01	2.27
F	22	1508.55	3012 -	3023	3017.21	2.24E+01	11.31	1.58E+01	2.21
F	23	1763.89	3521 -	3535	3527.86	7.16E+01	17.23	4.09E+00	2.54

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 4:37:48PM

Env. Background File : C:\Canberra\Apex\Root\Daairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
M	1	74.66	1.76E+02	41.37			1.76E+02	4.14E+01
m	2	77.02	3.23E+02	50.13			3.23E+02	5.01E+01
M	3	87.16	1.10E+02	38.37			1.10E+02	3.84E+01
m	4	92.60	1.25E+02	39.83			1.25E+02	3.98E+01
F	5	185.81	1.85E+02	40.19			1.85E+02	4.02E+01
F	6	209.26	6.50E+01	27.17			6.50E+01	2.72E+01

Analysis Report for L3-012-101-FSGS-012-SS

L3-012-101

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
M	7	238.52	4.32E+02	50.10			4.32E+02	5.01E+01
m	8	241.74	1.66E+02	33.56			1.66E+02	3.36E+01
F	9	295.17	3.46E+02	45.23			3.46E+02	4.52E+01
F	10	338.05	6.48E+01	23.92			6.48E+01	2.39E+01
F	11	351.75	6.55E+02	55.66	4.18E+01	1.86E+01	6.13E+02	5.87E+01
F	12	583.01	1.29E+02	25.87			1.29E+02	2.59E+01
F	13	609.15	4.83E+02	47.25	2.06E+01	1.21E+01	4.62E+02	4.88E+01
F	14	727.34	1.40E+01	9.77			1.40E+01	9.77E+00
F	15	768.18	5.25E+01	17.90			5.25E+01	1.79E+01
F	16	806.23	3.65E+01	14.95			3.65E+01	1.50E+01
F	17	910.82	7.02E+01	19.79			7.02E+01	1.98E+01
F	18	934.36	2.31E+01	11.80			2.31E+01	1.18E+01
F	19	968.97	4.07E+01	17.61			4.07E+01	1.76E+01
F	20	1120.03	8.58E+01	20.97			8.58E+01	2.10E+01
F	21	1460.45	2.95E+02	35.47	2.82E+01	8.57E+00	2.67E+02	3.65E+01
F	22	1508.55	2.24E+01	11.31			2.24E+01	1.13E+01
F	23	1763.89	7.16E+01	17.23	7.59E+00	4.90E+00	6.40E+01	1.79E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daistryland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75 *	10.67	7.05E+00	1.04E+00
BI-212	0.60	727.17 *	11.80	1.80E-01	1.26E-01
		785.42	2.00		
		1620.56	2.75		
PB-212	0.99	77.11 *	17.50	1.10E+00	1.85E-01
		238.63 *	44.60	5.38E-01	6.84E-02
BI-214	0.80	609.31 *	46.30	1.29E+00	1.54E-01
		1120.29 *	15.10	1.27E+00	3.16E-01
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19 *	2.19	2.96E+00	1.50E+00



Analysis Report for L3-012-101-FSGS-012-SS

L3-012-101

<b>Nuclide Name</b>	<b>Id Confidence</b>	<b>Energy (keV)</b>		<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Activity Uncertainty</b>
BI-214	0.80	1764.49 *		15.80	1.33E+00	3.83E-01
PB-214	0.99	77.11 *		10.70	1.80E+00	3.03E-01
		295.21 *		19.20	1.20E+00	1.67E-01
		351.92 *		37.20	1.28E+00	1.38E-01
RA-226	0.97	186.21 *		3.28	2.64E+00	5.91E-01
AC-228	0.76	209.28 *		4.40	7.46E-01	3.14E-01
		338.32 *		11.40	4.26E-01	1.59E-01
		794.70		4.60		
		911.60 *		27.70	4.71E-01	1.34E-01
		964.60		5.20		
		969.11 *		16.60	4.82E-01	2.09E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.985	7.05E+00	1.04E+00	
BI-212	0.602	1.80E-01	1.26E-01	
PB-212	0.998	5.17E-01	6.46E-02	
BI-214	0.803	1.30E+00	1.29E-01	
PB-214	0.997	1.22E+00	1.01E-01	
RA-226	0.974	2.64E+00	5.91E-01	
AC-228	0.761	4.81E-01	8.84E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-012-SS

L3-012-101

---

**UNIDENTIFIED PEAKS**


---

Peak Locate Performed on : 9/9/2019 4:37:48PM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Peak Size (CPS)</b>	<b>Peak CPS (%) Uncertainty</b>	<b>Peak Type</b>	<b>Tolerance Nuclide</b>
M	1	74.66	9.75354E-02	11.78		
M	3	87.16	6.12983E-02	17.39		
m	4	92.60	6.96713E-02	15.88	Tol.	PA-228
m	8	241.74	9.20920E-02	10.12		
F	12	583.01	7.14083E-02	10.06		
F	15	768.18	2.91817E-02	17.04		
F	16	806.23	2.02523E-02	20.51		
F	18	934.36	1.28481E-02	25.52		

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---

**NUCLIDE MDA REPORT**


---

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	K-40	1460.75	* 10.67	7.05E+00	1.02E+00	1.02E+00

## Analysis Report for L3-012-101-FSGS-012-SS

L3-012-101

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	AR-41	1293.64	99.16	-3.27E+15	8.86E+15	8.86E+15
+	CO-60	1173.22	100.00	4.40E-02	1.06E-01	1.13E-01
		1332.49	100.00	3.38E-02		1.06E-01
+	KR-85	513.99	0.43	1.33E+01	1.90E+01	1.90E+01
+	Y-88	898.04	93.70	-7.28E-02	8.30E-02	9.08E-02
		1836.06	99.20	-2.36E-02		8.30E-02
+	NB-94	702.63	100.00	2.03E-02	7.91E-02	8.75E-02
		871.10	100.00	-9.68E-02		7.91E-02
+	I-131	284.30	6.06	-1.69E+00	1.18E-01	1.59E+00
		364.48	81.20	5.23E-02		1.18E-01
		636.97	7.27	9.83E-01		1.59E+00
+	CS-134	604.70	97.60	6.92E-01	9.30E-02	1.56E-01
		795.84	85.40	-4.45E-02		9.30E-02
+	CS-137	661.65	85.12	1.26E-01	1.14E-01	1.14E-01
+	CE-144	80.12	1.36	-1.59E+00	5.73E-01	7.99E+00
		133.51	11.09	1.20E-02		5.73E-01
+	EU-152	121.78	28.40	-2.45E-01	2.16E-01	2.16E-01
		344.28	26.60	-1.77E-01		2.91E-01
		1408.00	20.74	2.91E-01		4.60E-01
+	EU-154	123.07	40.40	-1.72E-01	1.53E-01	1.53E-01
		723.30	19.70	5.26E-02		4.02E-01
		1274.51	35.50	-2.63E-01		2.84E-01
+	EU-155	86.54	32.80	-5.90E-02	2.65E-01	2.65E-01
		105.31	21.80	-4.25E-03		3.00E-01
+	BI-214	609.31	* 46.30	1.29E+00	1.34E-01	1.34E-01
		1120.29	* 15.10	1.27E+00		5.06E-01
		1238.11	5.94	1.42E+00		2.31E+00
		1377.67	4.11	1.90E+00		2.69E+00
		1407.98	2.48	2.43E+00		3.84E+00
		1509.19	* 2.19	2.96E+00		2.36E+00
		1764.49	* 15.80	1.33E+00		3.62E-01
+	PB-214	77.11	* 10.70	1.80E+00	1.41E-01	5.61E-01
		295.21	* 19.20	1.20E+00		2.29E-01
		351.92	* 37.20	1.28E+00		1.41E-01
+	PA-228	89.95	22.00	1.66E+01	5.73E+00	9.96E+00
		93.35	35.00	7.31E-01		5.73E+00
		105.00	16.30	-2.35E+00		1.02E+01
		129.22	2.97	3.26E+01		5.35E+01
		338.32	5.30	4.33E+01		3.53E+01
		463.00	13.80	6.50E+00		1.33E+01
		911.23	16.70	2.89E+01		1.76E+01
+	AM-241	59.54	36.30	3.23E-01	4.67E-01	4.67E-01
+	CM-243	103.76	23.00	-1.81E-01	2.85E-01	2.85E-01
		228.18	10.60	-3.25E-01		5.90E-01
		277.60	14.00	5.09E-02		4.98E-01

Analysis Report for L3-012-101-FSGS-012-SS

L3-012-101

- 
- + = Nuclide identified during the nuclide identification
  - \* = Energy line found in the spectrum
  - > = MDA value not calculated
  - @ = Half-life too short to be able to perform the decay correction
  - ? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level
- 
-

Analysis Report for L3-012-101-FSGS-013-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-013-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 7.958E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 12:39:00PM  
Acquisition Started : 9/10/2019 6:03:56AM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.8 seconds

Dead Time : 0.32 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7432

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/10/2019 6:34:06AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-013-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	76.25	148 -	159	153.05	1.06E+02	40.44	5.58E+02	2.96
F	2	238.43	472 -	485	477.34	1.39E+02	31.16	3.13E+02	1.73
F	3	295.09	586 -	595	590.63	8.09E+01	23.21	1.23E+02	1.52
F	4	351.61	698 -	709	703.65	1.20E+02	25.56	1.40E+02	1.27
F	5	462.76	922 -	929	925.91	2.20E+01	12.61	3.77E+01	1.38
F	6	509.71	1015 -	1025	1019.78	3.10E+01	15.87	7.28E+01	1.70
F	7	522.83	1043 -	1050	1046.03	1.49E+01	10.63	3.35E+01	1.26
F	8	582.98	1158 -	1173	1166.31	3.54E+01	13.70	6.25E+01	1.14
F	9	609.09	1212 -	1227	1218.51	1.11E+02	22.85	4.67E+01	2.29
F	10	910.88	1815 -	1826	1822.00	2.15E+01	10.65	2.09E+01	1.19
F	11	968.71	1933 -	1943	1937.65	1.79E+01	11.29	4.36E+01	1.27
F	12	1120.15	2235 -	2245	2240.49	2.49E+01	11.74	1.92E+01	1.91
F	13	1460.54	2914 -	2928	2921.19	1.64E+02	26.11	7.12E+00	2.32

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/10/2019 6:34:06AM

Env. Background File : C:\Canberra\Apex\Root\Daairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	76.25	1.06E+02	40.44			1.06E+02	4.04E+01
F	2	238.43	1.39E+02	31.16			1.39E+02	3.12E+01
F	3	295.09	8.09E+01	23.21			8.09E+01	2.32E+01
F	4	351.61	1.20E+02	25.56	4.18E+01	1.86E+01	7.87E+01	3.16E+01
F	5	462.76	2.20E+01	12.61			2.20E+01	1.26E+01
F	6	509.71	3.10E+01	15.87			3.10E+01	1.59E+01
F	7	522.83	1.49E+01	10.63			1.49E+01	1.06E+01
F	8	582.98	3.54E+01	13.70			3.54E+01	1.37E+01
F	9	609.09	1.11E+02	22.85	2.06E+01	1.21E+01	9.03E+01	2.59E+01
F	10	910.88	2.15E+01	10.65			2.15E+01	1.07E+01
F	11	968.71	1.79E+01	11.29			1.79E+01	1.13E+01
F	12	1120.15	2.49E+01	11.74			2.49E+01	1.17E+01
F	13	1460.54	1.64E+02	26.11	2.82E+01	8.57E+00	1.36E+02	2.75E+01

Analysis Report for L3-012-101-FSGS-013-SS

L3-012-101

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dalryland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.99	1460.75 *	10.67	3.72E+00	7.80E-01
PB-212	0.96	77.11 *	17.50	3.81E-01	1.48E-01
		238.63 *	44.60	1.80E-01	4.14E-02
BI-214	0.58	609.31 *	46.30	2.61E-01	7.62E-02
		1120.29 *	15.10	3.83E-01	1.81E-01
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.97	77.11 *	10.70	6.24E-01	2.42E-01
		295.21 *	19.20	2.91E-01	8.46E-02
		351.92 *	37.20	1.71E-01	6.91E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Analysis Report for L3-012-101-FSGS-013-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.993	3.72E+00	7.80E-01	
PB-212	0.963	1.84E-01	4.00E-02	
BI-214	0.581	2.80E-01	7.03E-02	
PB-214	0.973	2.24E-01	5.23E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma



Analysis Report for L3-012-101-FSGS-013-SS

L3-012-101

---

**UNIDENTIFIED PEAKS**


---

Peak Locate Performed on : 9/10/2019 6:34:06AM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 5	462.76	1.22340E-02	28.64	To1.	PA-228
F 6	509.71	1.72470E-02	25.56		
F 7	522.83	8.29862E-03	35.60		
F 8	582.98	1.96854E-02	19.33		
F 10	910.88	1.19669E-02	24.73	To1.	AC-228 PA-228
F 11	968.71	9.94358E-03	31.54	To1.	AC-228

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

**NUCLIDE MDA REPORT**


---

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	3.72E+00	7.51E-01
+	AR-41	1293.64	99.16	-1.84E+17	4.06E+17	4.06E+17
+	CO-60	1173.22	100.00	-2.39E-02	7.96E-02	8.77E-02
		1332.49	100.00	-6.58E-03		7.96E-02
+	KR-85	513.99	0.43	5.56E+00	1.44E+01	1.44E+01
+	Y-88	898.04	93.70	8.65E-02	6.92E-02	7.47E-02

## Analysis Report for L3-012-101-FSGS-013-SS

L3-012-101

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
	Y-88	1836.06	99.20	2.50E-02	6.92E-02	6.92E-02
+	NB-94	702.63	100.00	-1.17E-02	5.46E-02	6.40E-02
		871.10	100.00	-6.52E-02		5.46E-02
+	I-131	284.30	6.06	4.75E-01	8.46E-02	1.16E+00
		364.48	81.20	-2.84E-02		8.46E-02
		636.97	7.27	-4.16E-01		1.16E+00
+	CS-134	604.70	97.60	-2.18E-02	7.73E-02	8.68E-02
		795.84	85.40	-3.77E-02		7.73E-02
+	CS-137	661.65	85.12	4.96E-02	8.04E-02	8.04E-02
+	CE-144	80.12	1.36	-7.67E-01	3.98E-01	5.30E+00
		133.51	11.09	5.00E-02		3.98E-01
+	EU-152	121.78	28.40	-2.26E-04	1.54E-01	1.54E-01
		344.28	26.60	4.89E-02		1.96E-01
		1408.00	20.74	-8.54E-02		3.42E-01
+	EU-154	123.07	40.40	-3.60E-02	1.09E-01	1.09E-01
		723.30	19.70	1.86E-01		3.40E-01
		1274.51	35.50	1.55E-01		2.48E-01
+	EU-155	86.54	32.80	-1.23E-02	1.81E-01	1.81E-01
		105.31	21.80	-5.69E-02		2.04E-01
+	BI-214	609.31	* 46.30	2.61E-01	1.15E-01	1.15E-01
		1120.29	* 15.10	3.83E-01		2.85E-01
		1238.11	5.94	3.87E-01		1.56E+00
		1377.67	4.11	-1.80E+00		1.48E+00
		1407.98	2.48	-7.13E-01		2.86E+00
		1509.19	2.19	2.85E-01		2.67E+00
		1764.49	15.80	2.18E-01		5.09E-01
+	PB-214	77.11	* 10.70	6.24E-01	1.31E-01	5.31E-01
		295.21	* 19.20	2.91E-01		1.50E-01
		351.92	* 37.20	1.71E-01		1.31E-01
+	PA-228	89.95	22.00	5.21E+00	5.26E+00	9.09E+00
		93.35	35.00	-2.87E+00		5.26E+00
		105.00	16.30	-5.12E+00		9.83E+00
		129.22	2.97	-2.86E+00		5.31E+01
		338.32	5.30	2.22E+01		3.37E+01
		463.00	13.80	8.61E-01		1.38E+01
		911.23	16.70	-1.82E-01		1.67E+01
+	AM-241	59.54	36.30	1.66E-01	3.25E-01	3.25E-01
+	CM-243	103.76	23.00	-7.90E-02	1.96E-01	1.96E-01
		228.18	10.60	-2.35E-02		4.13E-01
		277.60	14.00	2.23E-01		3.61E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-013-SS  
L3-012-101

Analysis Report for L3-012-101-FSGS-014-SS  
L3-012-101

---

## **GAMMA SPECTRUM ANALYSIS**

---

Sample Identification : L3-012-101-FSGS-014-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :  
  
Sample Size : 6.671E+02 grams  
Facility : Dairyland\_NPP  
  
Sample Taken On : 9/5/2019 9:53:00AM  
Acquisition Started : 9/10/2019 6:34:30AM  
  
Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.7 seconds  
  
Dead Time : 0.32 %  
  
Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV  
  
Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :  
  
Sample Number : 7433

---

## **PEAK ANALYSIS REPORT**

---

Peak Analysis Performed on : 9/10/2019 7:04:41AM  
Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-014-SS  
L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	76.95	147 -	158	154.45	8.61E+01	33.42	5.47E+02	1.50
M	2	238.46	474 -	490	477.40	1.16E+02	26.51	1.46E+02	1.41
m	3	241.55	474 -	490	483.56	5.96E+01	20.48	1.45E+02	1.41
F	4	295.08	586 -	596	590.61	6.58E+01	22.22	1.53E+02	1.50
F	5	351.90	700 -	712	704.23	1.23E+02	25.81	1.31E+02	1.49
F	6	582.95	1162 -	1173	1166.24	5.58E+01	17.18	4.28E+01	1.79
F	7	609.06	1212 -	1222	1218.45	7.93E+01	20.38	4.32E+01	1.79
F	8	1119.71	2235 -	2245	2239.59	2.24E+01	10.41	8.56E+00	2.19
F	9	1460.49	2913 -	2928	2921.10	1.27E+02	23.03	8.01E+00	2.58

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/10/2019 7:04:41AM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	76.95	8.61E+01	33.42			8.61E+01	3.34E+01
M	2	238.46	1.16E+02	26.51			1.16E+02	2.65E+01
m	3	241.55	5.96E+01	20.48			5.96E+01	2.05E+01
F	4	295.08	6.58E+01	22.22			6.58E+01	2.22E+01
F	5	351.90	1.23E+02	25.81	4.18E+01	1.86E+01	8.10E+01	3.18E+01
F	6	582.95	5.58E+01	17.18			5.58E+01	1.72E+01
F	7	609.06	7.93E+01	20.38	2.06E+01	1.21E+01	5.87E+01	2.37E+01
F	8	1119.71	2.24E+01	10.41			2.24E+01	1.04E+01
F	9	1460.49	1.27E+02	23.03	2.82E+01	8.57E+00	9.88E+01	2.46E+01

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-014-SS  
L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Dalryland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.99	1460.75 *	10.67	3.23E+00	8.22E-01
PB-212	0.99	77.11 *	17.50	3.65E-01	1.44E-01
		238.63 *	44.60	1.79E-01	4.20E-02
BI-214	0.57	609.31 *	46.30	2.03E-01	8.26E-02
		1120.29 *	15.10	4.10E-01	1.92E-01
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.99	77.11 *	10.70	5.97E-01	2.35E-01
		295.21 *	19.20	2.82E-01	9.62E-02
		351.92 *	37.20	2.10E-01	8.31E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.990	3.23E+00	8.22E-01	
PB-212	0.996	1.82E-01	4.04E-02	
BI-214	0.571	2.35E-01	7.59E-02	

Analysis Report for L3-012-101-FSGS-014-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
PB-214	0.999	2.45E-01	6.09E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-014-SS

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/10/2019 7:04:41AM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4000

	Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
m	3	241.55	3.31167E-02	17.17		
F	6	582.95	3.09946E-02	15.40		

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daifland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	3.23E+00	9.11E-01	9.11E-01
+	AR-41	1293.64	99.16	-9.13E+17	1.63E+18	1.63E+18
+	CO-60	1173.22	100.00	4.78E-02	9.50E-02	1.01E-01
		1332.49	100.00	9.07E-02		9.50E-02
+	KR-85	513.99	0.43	1.37E+01	1.77E+01	1.77E+01
+	Y-88	898.04	93.70	-3.94E-02	5.27E-02	8.14E-02
		1836.06	99.20	-5.37E-02		5.27E-02
+	NB-94	702.63	100.00	-2.66E-02	6.51E-02	7.11E-02
		871.10	100.00	-7.20E-02		6.51E-02
+	I-131	284.30	6.06	3.62E-01	1.02E-01	1.36E+00
		364.48	81.20	4.38E-02		1.02E-01
		636.97	7.27	5.72E-01		1.42E+00
+	CS-134	604.70	97.60	1.24E-01	8.46E-02	9.24E-02
		795.84	85.40	-5.43E-02		8.46E-02
+	CS-137	661.65	85.12	8.71E-02	1.02E-01	1.02E-01



Analysis Report for L3-012-101-FSGS-014-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	CE-144	80.12	1.36	-3.38E+00	4.66E-01	6.16E+00
		133.51	11.09	1.54E-01		4.66E-01
+	EU-152	121.78	28.40	-2.27E-01	1.71E-01	1.71E-01
		344.28	26.60	-3.31E-01		2.29E-01
		1408.00	20.74	1.67E-01		3.83E-01
+	EU-154	123.07	40.40	-1.44E-01	1.20E-01	1.20E-01
		723.30	19.70	3.64E-01		3.77E-01
		1274.51	35.50	4.15E-02		2.61E-01
+	EU-155	86.54	32.80	-1.39E-01	2.07E-01	2.07E-01
		105.31	21.80	-1.82E-01		2.41E-01
+	BI-214	609.31	* 46.30	2.03E-01	1.27E-01	1.27E-01
		1120.29	* 15.10	4.10E-01		2.45E-01
		1238.11	5.94	1.70E-01		1.58E+00
		1377.67	4.11	4.09E-01		1.90E+00
		1407.98	2.48	1.40E+00		3.20E+00
		1509.19	2.19	1.01E+00		3.08E+00
		1764.49	15.80	1.36E-01		5.36E-01
+	PB-214	77.11	* 10.70	5.97E-01	1.56E-01	6.18E-01
		295.21	* 19.20	2.82E-01		2.06E-01
		351.92	* 37.20	2.10E-01		1.56E-01
+	PA-228	89.95	22.00	9.76E+00	7.19E+00	1.20E+01
		93.35	35.00	4.53E+00		7.19E+00
		105.00	16.30	-5.60E+00		1.28E+01
		129.22	2.97	2.57E+00		6.65E+01
		338.32	5.30	8.94E+00		4.39E+01
		463.00	13.80	1.44E+01		1.78E+01
		911.23	16.70	1.20E+01		2.27E+01
+	AM-241	59.54	36.30	-1.34E-01	3.81E-01	3.81E-01
+	CM-243	103.76	23.00	-2.90E-02	2.33E-01	2.33E-01
		228.18	10.60	-1.17E-01		4.59E-01
		277.60	14.00	-1.06E-02		3.90E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FJGS-015-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FJGS-015-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 6.753E+02 grams  
Facility : Dalryland\_NPP

Sample Taken On : 9/5/2019 2:00:00PM  
Acquisition Started : 9/10/2019 7:16:01AM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.4 seconds

Dead Time : 0.30 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7434

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/10/2019 7:46:10AM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FJGS-015-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	63.36	123 -	130	127.28	2.87E+01	19.87	2.96E+02	0.71
F	2	185.85	368 -	377	372.20	5.38E+01	25.07	2.39E+02	1.64
F	3	210.00	415 -	424	420.49	2.68E+01	19.04	1.93E+02	1.23
F	4	238.55	472 -	481	477.57	7.09E+01	24.97	2.74E+02	1.09
F	5	295.10	587 -	596	590.65	6.26E+01	20.27	1.49E+02	1.00
F	6	351.65	699 -	710	703.72	8.27E+01	21.24	9.99E+01	1.28
F	7	583.04	1160 -	1174	1166.42	3.83E+01	15.23	4.58E+01	2.29
F	8	609.14	1212 -	1226	1218.62	6.79E+01	18.48	5.77E+01	1.52
F	9	661.49	1316 -	1328	1323.29	6.57E+01	19.40	5.62E+01	1.92
F	10	1460.45	2912 -	2930	2921.01	1.35E+02	23.60	8.92E+00	2.42

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/10/2019 7:46:10AM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	63.36	2.87E+01	19.87			2.87E+01	1.99E+01
F	2	185.85	5.38E+01	25.07			5.38E+01	2.51E+01
F	3	210.00	2.68E+01	19.04			2.68E+01	1.90E+01
F	4	238.55	7.09E+01	24.97			7.09E+01	2.50E+01
F	5	295.10	6.26E+01	20.27			6.26E+01	2.03E+01
F	6	351.65	8.27E+01	21.24	4.18E+01	1.86E+01	4.10E+01	2.82E+01
F	7	583.04	3.83E+01	15.23			3.83E+01	1.52E+01
F	8	609.14	6.79E+01	18.48	2.06E+01	1.21E+01	4.73E+01	2.21E+01
F	9	661.49	6.57E+01	19.40	3.31E+01	1.27E+01	3.26E+01	2.32E+01
F	10	1460.45	1.35E+02	23.60	2.82E+01	8.57E+00	1.07E+02	2.51E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FJGS-015-SS

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Roof\ Dairyland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)		Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75	*	10.67	3.44E+00	8.32E-01
CS-137	0.99	661.65	*	85.12	6.53E-02	4.65E-02
PB-212	0.56	77.11		17.50		
		238.63	*	44.60	1.08E-01	3.85E-02
BI-214	0.34	609.31	*	46.30	1.61E-01	7.59E-02
		1120.29		15.10		
		1238.11		5.94		
		1377.67		4.11		
		1407.98		2.48		
		1509.19		2.19		
		1764.49		15.80		
PB-214	0.71	77.11		10.70		
		295.21	*	19.20	2.65E-01	8.68E-02
		351.92	*	37.20	1.05E-01	7.24E-02
RA-226	0.97	186.21	*	3.28	9.40E-01	4.41E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
K-40	0.986	3.44E+00	8.32E-01	

Analysis Report for L3-012-101-FJGS-015-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
CS-137	0.996	6.53E-02	4.65E-02	
PB-212	0.560	1.08E-01	3.85E-02	
BI-214	0.347	1.61E-01	7.59E-02	
PB-214	0.714	1.71E-01	5.56E-02	
RA-226	0.979	9.40E-01	4.41E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FJGS-015-SS  
L3-012-101

## UNIDENTIFIED PEAKS

Peak Locate Performed on : 9/10/2019 7:46:10AM  
Peak Locate From Channel : 100  
Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 1	63.36	1.59640E-02	34.57		
F 3	210.00	1.49152E-02	35.45	Tol.	AC-228
F 7	583.04	2.12771E-02	19.89		

M = First peak in a multiplet region  
m = Other peak in a multiplet region  
F = Fitted singlet  
Errors quoted at 2.000sigma

## NUCLIDE MDA REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daityland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	* 10.67	3.44E+00	9.17E-01	9.17E-01
+	AR-41	1293.64	99.16	-1.38E+17	3.95E+17	3.95E+17
+	CO-60	1173.22	100.00	4.95E-02	8.57E-02	9.57E-02
		1332.49	100.00	3.73E-02		8.57E-02
+	KR-85	513.99	0.43	5.38E+00	1.60E+01	1.60E+01
+	Y-88	898.04	93.70	-2.28E-02	6.50E-02	8.29E-02
		1836.06	99.20	-1.41E-02		6.50E-02
+	NB-94	702.63	100.00	1.89E-02	6.97E-02	6.97E-02
		871.10	100.00	-2.08E-02		7.71E-02
+	I-131	284.30	6.06	1.10E-01	9.33E-02	1.31E+00
		364.48	81.20	-6.01E-02		9.33E-02
		636.97	7.27	-7.19E-01		1.41E+00
+	CS-134	604.70	97.60	-8.37E-03	9.32E-02	9.32E-02
		795.84	85.40	-3.09E-02		9.32E-02

## Analysis Report for L3-012-101-FJGS-015-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>		<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	CS-137	661.65	*	85.12	6.53E-02	8.53E-02	8.53E-02
+	CE-144	80.12		1.36	3.66E+00	4.41E-01	5.81E+00
		133.51		11.09	2.62E-02		4.41E-01
+	EU-152	121.78		28.40	-1.44E-01	1.71E-01	1.71E-01
		344.28		26.60	-3.53E-02		2.15E-01
		1408.00		20.74	4.00E-02		3.61E-01
+	EU-154	123.07		40.40	-6.21E-02	1.22E-01	1.22E-01
		723.30		19.70	-8.45E-02		3.55E-01
		1274.51		35.50	1.05E-01		2.64E-01
+	EU-155	86.54		32.80	-4.18E-03	2.02E-01	2.02E-01
		105.31		21.80	-1.31E-01		2.26E-01
+	BI-214	609.31	*	46.30	1.61E-01	1.43E-01	1.43E-01
		1120.29		15.10	1.17E-01		6.33E-01
		1238.11		5.94	1.38E+00		1.82E+00
		1377.67		4.11	9.20E-01		1.70E+00
		1407.98		2.48	3.34E-01		3.02E+00
		1509.19		2.19	8.65E-01		3.54E+00
		1764.49		15.80	1.53E-01		4.63E-01
+	PB-214	77.11		10.70	-2.26E-01	1.41E-01	7.67E-01
		295.21	*	19.20	2.65E-01		1.93E-01
		351.92	*	37.20	1.05E-01		1.41E-01
+	PA-228	89.95		22.00	5.66E+00	6.03E+00	1.03E+01
		93.35		35.00	2.08E+00		6.03E+00
		105.00		16.30	-6.35E-01		1.09E+01
		129.22		2.97	1.82E+01		5.95E+01
		338.32		5.30	2.74E+01		3.99E+01
		463.00		13.80	1.41E+01		1.59E+01
		911.23		16.70	6.84E+00		1.99E+01
+	AM-241	59.54		36.30	-7.69E-02	3.61E-01	3.61E-01
+	CM-243	103.76		23.00	1.64E-01	2.20E-01	2.20E-01
		228.18		10.60	-3.23E-01		4.52E-01
		277.60		14.00	1.78E-01		3.91E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FQGS-007-SS  
L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FQGS-007-SS  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 7.813E+02 grams  
Facility : Dairylead\_NPP

Sample Taken On : 9/5/2019 10:39:00AM  
Acquisition Started : 9/9/2019 1:21:03PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.5 seconds

Dead Time : 0.30 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7425

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/9/2019 1:51:13PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096



Analysis Report for L3-012-101-FQGS-007-SS

L3-012-101

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>ROI start</b>	<b>ROI end</b>	<b>Peak Centroid</b>	<b>Net Peak Area</b>	<b>Net Area Uncertainty</b>	<b>Continuum Counts</b>	<b>FWHM (keV)</b>
F	1	76.90	147 -	159	154.35	1.18E+02	35.00	7.21E+02	1.25
F	2	87.30	171 -	178	175.14	4.15E+01	28.82	4.29E+02	1.20
F	3	238.45	472 -	481	477.38	1.59E+02	33.75	3.64E+02	1.20
F	4	295.01	586 -	595	590.47	9.84E+01	25.87	1.78E+02	1.40
F	5	338.12	673 -	680	676.67	3.73E+01	17.70	9.87E+01	1.24
F	6	351.82	698 -	709	704.07	1.48E+02	28.17	1.65E+02	1.30
F	7	510.30	1014 -	1027	1020.96	4.95E+01	18.42	9.65E+01	1.86
F	8	582.92	1161 -	1173	1166.18	6.28E+01	18.07	5.11E+01	1.53
F	9	608.95	1212 -	1224	1218.23	1.32E+02	25.32	7.53E+01	1.59
F	10	910.99	1816 -	1827	1822.22	3.91E+01	15.28	5.40E+01	1.49
F	11	968.08	1932 -	1943	1936.39	1.89E+01	12.09	4.44E+01	1.66
F	12	1120.23	2236 -	2245	2240.65	1.65E+01	11.35	3.57E+01	1.61
F	13	1460.40	2912 -	2930	2920.91	2.70E+02	33.06	8.87E+00	2.42

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/9/2019 1:51:13PM

Env. Background File : C:\Canberra\Apex\Root\Dairyland\_NPP\Data\0000001364.CNF

	<b>Peak No.</b>	<b>Energy (keV)</b>	<b>Original Area</b>	<b>Orig. Area Uncertainty</b>	<b>Ambient Background</b>	<b>Backgr. Uncert.</b>	<b>Subtracted Area</b>	<b>Subtracted Uncert.</b>
F	1	76.90	1.18E+02	35.00			1.18E+02	3.50E+01
F	2	87.30	4.15E+01	28.82			4.15E+01	2.88E+01
F	3	238.45	1.59E+02	33.75			1.59E+02	3.38E+01
F	4	295.01	9.84E+01	25.87			9.84E+01	2.59E+01
F	5	338.12	3.73E+01	17.70			3.73E+01	1.77E+01
F	6	351.82	1.48E+02	28.17	4.18E+01	1.86E+01	1.06E+02	3.38E+01
F	7	510.30	4.95E+01	18.42			4.95E+01	1.84E+01
F	8	582.92	6.28E+01	18.07			6.28E+01	1.81E+01
F	9	608.95	1.32E+02	25.32	2.06E+01	1.21E+01	1.11E+02	2.81E+01
F	10	910.99	3.91E+01	15.28			3.91E+01	1.53E+01
F	11	968.08	1.89E+01	12.09			1.89E+01	1.21E+01
F	12	1120.23	1.65E+01	11.35			1.65E+01	1.13E+01
F	13	1460.40	2.70E+02	33.06	2.82E+01	8.57E+00	2.42E+02	3.41E+01

Analysis Report for L3-012-101-FQGS-007-SS

L3-012-101

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.98	1460.75 *	10.67	6.75E+00	1.02E+00
PB-212	0.99	77.11 *	17.50	4.26E-01	1.30E-01
		238.63 *	44.60	2.09E-01	4.58E-02
BI-214	0.57	609.31 *	46.30	3.28E-01	8.47E-02
		1120.29 *	15.10	2.58E-01	1.78E-01
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.99	77.11 *	10.70	6.96E-01	2.12E-01
		295.21 *	19.20	3.60E-01	9.63E-02
		351.92 *	37.20	2.34E-01	7.55E-02

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Analysis Report for L3-012-101-FQGS-007-SS

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.981	6.75E+00	1.02E+00	
PB-212	0.995	2.14E-01	4.34E-02	
BI-214	0.574	3.15E-01	7.65E-02	
PB-214	0.996	2.87E-01	5.75E-02	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FQGS-007-SS

L3-012-101

---

**UNIDENTIFIED PEAKS**


---

Peak Locate Performed on : 9/9/2019 1:51:13PM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 2	87.30	2.30634E-02	34.71	Tol.	EU-155
F 5	338.12	2.07235E-02	23.72	Tol.	AC-228 PA-228
F 7	510.30	2.75033E-02	18.61		
F 8	582.92	3.49089E-02	14.38		
F 10	910.99	2.17040E-02	19.56	Tol.	AC-228 PA-228
F 11	968.08	1.04876E-02	32.01		

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

**NUCLIDE MDA REPORT**


---

Nuclide Library Used : C:\Canberra\Apex\Root\Daistryland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	6.75E+00	7.91E-01
+	AR-41	1293.64		99.16	-1.02E+15	1.53E+15
+	CO-60	1173.22	100.00	-3.38E-02	7.65E-02	1.01E-01
		1332.49	100.00	9.71E-03		7.65E-02
+	KR-85	513.99	0.43	5.37E+00	1.60E+01	1.60E+01

## Analysis Report for L3-012-101-FQGS-007-SS

L3-012-101

	<b>Nuclide Name</b>	<b>Energy (keV)</b>	<b>Yield(%)</b>	<b>Activity (pCi/grams)</b>	<b>Nuclide MDA (pCi/grams)</b>	<b>Line MDA (pCi/grams)</b>
+	Y-88	898.04	93.70	-2.98E-02	6.21E-02	8.56E-02
		1836.06	99.20	-6.77E-02		6.21E-02
+	NB-94	702.63	100.00	3.81E-02	7.13E-02	7.13E-02
		871.10	100.00	-2.09E-02		7.97E-02
+	I-131	284.30	6.06	8.84E-01	9.54E-02	1.28E+00
		364.48	81.20	-2.31E-02		9.54E-02
		636.97	7.27	3.65E-01		1.20E+00
+	CS-134	604.70	97.60	7.13E-03	7.87E-02	1.00E-01
		795.84	85.40	-1.82E-02		7.87E-02
+	CS-137	661.65	85.12	5.74E-02	8.60E-02	8.60E-02
+	CE-144	80.12	1.36	1.21E-01	4.49E-01	5.95E+00
		133.51	11.09	-3.29E-03		4.49E-01
+	EU-152	121.78	28.40	-1.23E-01	1.68E-01	1.68E-01
		344.28	26.60	-1.44E-01		2.17E-01
		1408.00	20.74	-1.62E-01		3.41E-01
+	EU-154	123.07	40.40	-7.40E-02	1.18E-01	1.18E-01
		723.30	19.70	1.83E-01		3.86E-01
		1274.51	35.50	-1.24E-01		2.53E-01
+	EU-155	86.54	32.80	-8.65E-02	2.01E-01	2.01E-01
		105.31	21.80	-2.36E-01		2.33E-01
+	BI-214	609.31	* 46.30	3.28E-01	1.29E-01	1.29E-01
		1120.29	* 15.10	2.58E-01		3.74E-01
		1238.11	5.94	-2.04E+00		1.76E+00
		1377.67	4.11	1.23E+00		2.16E+00
		1407.98	2.48	-1.35E+00		2.85E+00
		1509.19	2.19	2.45E-01		2.63E+00
		1764.49	15.80	6.99E-01		6.84E-01
+	PB-214	77.11	* 10.70	6.96E-01	1.39E-01	6.18E-01
		295.21	* 19.20	3.60E-01		1.81E-01
		351.92	* 37.20	2.34E-01		1.39E-01
+	PA-228	89.95	22.00	8.01E+00	3.81E+00	6.55E+00
		93.35	35.00	-1.63E+00		3.81E+00
		105.00	16.30	-3.75E+00		7.08E+00
		129.22	2.97	-6.47E+00		3.66E+01
		338.32	5.30	9.35E+00		2.38E+01
		463.00	13.80	5.68E-01		9.56E+00
		911.23	16.70	1.97E+01		1.39E+01
+	AM-241	59.54	36.30	3.45E-01	3.68E-01	3.68E-01
+	CM-243	103.76	23.00	1.67E-01	2.28E-01	2.28E-01
		228.18	10.60	-2.81E-01		4.50E-01
		277.60	14.00	1.59E-01		3.83E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FQGS-007-SS  
L3-012-101

Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)

L3-012-101

---

## GAMMA SPECTRUM ANALYSIS

---

Sample Identification : L3-012-101-FSGS-007-SS (SPLIT)  
Sample Description : L3-012-101  
Sample Type : 500 ml Marinelli  
Unit :  
Sample Point :

Sample Size : 7.594E+02 grams  
Facility : Dairyland\_NPP

Sample Taken On : 9/5/2019 10:26:00AM  
Acquisition Started : 9/11/2019 2:27:00PM

Procedure : 500ml Marinelli  
Operator : Administrator  
Detector Name : HOTLAB  
Geometry : 500ml Marinelli  
Live Time : 1800.0 seconds  
Real Time : 1805.7 seconds

Dead Time : 0.32 %

Peak Locate Threshold : 3.00  
Peak Locate Range (in channels) : 100 - 4096  
Peak Area Range (in channels) : 100 - 4096  
Identification Energy Tolerance : 1.000 keV

Energy Calibration Used Done On : 7/8/2014  
Efficiency Calibration Used Done On : 7/8/2014  
Efficiency Calibration Description :

Sample Number : 7439

---

## PEAK ANALYSIS REPORT

---

Peak Analysis Performed on : 9/11/2019 2:57:09PM

Peak Analysis From Channel : 100  
Peak Analysis To Channel : 4096

Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)

L3-012-101

	Peak No.	Energy (keV)	ROI start	ROI end	Peak Centroid	Net Peak Area	Net Area Uncertainty	Continuum Counts	FWHM (keV)
F	1	77.12	148 -	162	154.78	1.12E+02	35.28	7.50E+02	1.49
F	2	185.64	367 -	377	371.77	6.18E+01	27.62	3.52E+02	1.51
F	3	238.49	472 -	481	477.45	1.24E+02	30.87	3.26E+02	1.20
F	4	295.06	585 -	597	590.58	8.09E+01	24.08	2.00E+02	1.51
F	5	338.16	673 -	685	676.75	5.16E+01	18.53	1.30E+02	1.26
F	6	351.85	700 -	708	704.13	1.43E+02	27.49	1.05E+02	1.35
F	7	583.07	1162 -	1171	1166.48	5.86E+01	18.48	5.55E+01	1.59
F	8	609.03	1194 -	1224	1218.40	1.30E+02	25.38	1.81E+02	1.86
F	9	911.12	1816 -	1829	1822.48	4.26E+01	15.76	4.47E+01	2.15
F	10	1120.06	2235 -	2246	2240.31	4.09E+01	14.69	2.40E+01	2.11
F	11	1460.64	2915 -	2930	2921.39	2.58E+02	32.72	1.44E+01	2.25

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma

## BACKGROUND SUBTRACT REPORT

Peak Analysis Performed on : 9/11/2019 2:57:09PM

Env. Background File : C:\Canberra\Apex\Root\ Dairyland\_NPP\Data\0000001364.CNF

	Peak No.	Energy (keV)	Original Area	Orig. Area Uncertainty	Ambient Background	Backgr. Uncert.	Subtracted Area	Subtracted Uncert.
F	1	77.12	1.12E+02	35.28			1.12E+02	3.53E+01
F	2	185.64	6.18E+01	27.62			6.18E+01	2.76E+01
F	3	238.49	1.24E+02	30.87			1.24E+02	3.09E+01
F	4	295.06	8.09E+01	24.08			8.09E+01	2.41E+01
F	5	338.16	5.16E+01	18.53			5.16E+01	1.85E+01
F	6	351.85	1.43E+02	27.49	4.18E+01	1.86E+01	1.02E+02	3.32E+01
F	7	583.07	5.86E+01	18.48			5.86E+01	1.85E+01
F	8	609.03	1.30E+02	25.38	2.06E+01	1.21E+01	1.09E+02	2.81E+01
F	9	911.12	4.26E+01	15.76			4.26E+01	1.58E+01
F	10	1120.06	4.09E+01	14.69			4.09E+01	1.47E+01
F	11	1460.64	2.58E+02	32.72	2.82E+01	8.57E+00	2.29E+02	3.38E+01

M = First peak in a multiplet region

m = Other peak in a multiplet region

F = Fitted singlet

Errors quoted at 2.000sigma



Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)

L3-012-101

## NUCLIDE IDENTIFICATION REPORT

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

### IDENTIFIED NUCLIDES

Nuclide Name	Id Confidence	Energy (keV)	Yield(%)	Activity (pCi/grams)	Activity Uncertainty
K-40	0.99	1460.75 *	10.67	6.58E+00	1.04E+00
PB-212	0.99	77.11 *	17.50	4.16E-01	1.34E-01
		238.63 *	44.60	1.68E-01	4.28E-02
BI-214	0.57	609.31 *	46.30	3.30E-01	8.72E-02
		1120.29 *	15.10	6.59E-01	2.38E-01
		1238.11	5.94		
		1377.67	4.11		
		1407.98	2.48		
		1509.19	2.19		
		1764.49	15.80		
PB-214	0.99	77.11 *	10.70	6.80E-01	2.18E-01
		295.21 *	19.20	3.05E-01	9.19E-02
		351.92 *	37.20	2.31E-01	7.64E-02
RA-226	0.94	186.21 *	3.28	9.59E-01	4.32E-01

\* = Energy line found in the spectrum.

- = Manually added nuclide.

? = Manually edited nuclide.

@ = Energy line not used for Weighted Mean Activity

Energy Tolerance : 1.000 keV

Nuclide confidence index threshold = 0.30

Errors quoted at 2.000sigma

## INTERFERENCE CORRECTED REPORT

Nuclide Name	Nuclide Id Confidence	Wt mean Activity (pCi/grams)	Wt mean Activity Uncertainty	Comments
--------------	-----------------------	------------------------------	------------------------------	----------

## Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)

L3-012-101

<b>Nuclide Name</b>	<b>Nuclide Id Confidence</b>	<b>Wt mean Activity (pCi/grams)</b>	<b>Wt mean Activity Uncertainty</b>	<b>Comments</b>
K-40	0.998	6.58E+00	1.04E+00	
PB-212	0.998	1.76E-01	4.09E-02	
BI-214	0.578	3.69E-01	8.19E-02	
PB-214	0.999	2.70E-01	5.69E-02	
RA-226	0.949	9.59E-01	4.32E-01	

? = nuclide is part of an undetermined solution

X = nuclide rejected by the interference analysis

@ = nuclide contains energy lines not used in Weighted Mean Activity

Errors quoted at 2.000sigma

Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)

L3-012-101

---

## UNIDENTIFIED PEAKS

---

Peak Locate Performed on : 9/11/2019 2:57:09PM  
 Peak Locate From Channel : 100  
 Peak Locate To Channel : 4096

Peak No.	Energy (keV)	Peak Size (CPS)	Peak CPS (%) Uncertainty	Peak Type	Tolerance Nuclide
F 5	338.16	2.86407E-02	17.97	Tol.	AC-228 PA-228
F 7	583.07	3.25554E-02	15.77		
F 9	911.12	2.36942E-02	18.47	Tol.	AC-228 PA-228

---

M = First peak in a multiplet region  
 m = Other peak in a multiplet region  
 F = Fitted singlet  
 Errors quoted at 2.000sigma

---



---

## NUCLIDE MDA REPORT

---

Nuclide Library Used : C:\Canberra\Apex\Root\Daivland\_NPP\Library\HOTLAB.NLB

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
+	K-40	1460.75	*	10.67	6.58E+00	8.52E-01
+	@ AR-41	1293.64	99.16	1.00E+26	1.00E+26	1.00E+26
+	CO-60	1173.22	100.00	7.51E-02	9.22E-02	9.91E-02
		1332.49	100.00	1.93E-02		9.22E-02
+	KR-85	513.99	0.43	1.01E+01	1.67E+01	1.67E+01
+	Y-88	898.04	93.70	-3.85E-02	7.05E-02	7.75E-02
		1836.06	99.20	-5.85E-02		7.05E-02
+	NB-94	702.63	100.00	-4.26E-02	6.62E-02	6.62E-02
		871.10	100.00	-2.97E-02		6.66E-02
+	I-131	284.30	6.06	-4.62E-01	1.08E-01	1.52E+00
		364.48	81.20	1.45E-02		1.08E-01

## Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)

L3-012-101

	Nuclide Name	Energy (keV)	Yield(%)	Activity (pCi/grams)	Nuclide MDA (pCi/grams)	Line MDA (pCi/grams)
	I-131	636.97	7.27	-1.08E+00	1.08E-01	1.45E+00
+	CS-134	604.70	97.60	1.82E-01	8.42E-02	1.02E-01
		795.84	85.40	-4.74E-02		8.42E-02
+	CS-137	661.65	85.12	4.60E-02	8.85E-02	8.85E-02
+	CE-144	80.12	1.36	-8.25E-01	4.23E-01	6.03E+00
		133.51	11.09	-2.06E-01		4.23E-01
+	EU-152	121.78	28.40	-2.24E-02	1.74E-01	1.74E-01
		344.28	26.60	-2.65E-01		2.24E-01
		1408.00	20.74	8.49E-02		3.44E-01
+	EU-154	123.07	40.40	6.71E-03	1.22E-01	1.22E-01
		723.30	19.70	3.46E-01		3.93E-01
		1274.51	35.50	1.21E-02		2.41E-01
+	EU-155	86.54	32.80	-1.43E-01	1.99E-01	1.99E-01
		105.31	21.80	1.46E-01		2.37E-01
+	BI-214	609.31	* 46.30	3.30E-01	2.40E-01	2.40E-01
		1120.29	* 15.10	6.59E-01		3.35E-01
		1238.11	5.94	4.01E-02		1.78E+00
		1377.67	4.11	6.73E-01		1.97E+00
		1407.98	2.48	7.09E-01		2.87E+00
		1509.19	2.19	-9.06E-01		2.50E+00
		1764.49	15.80	3.94E-01		6.10E-01
+	PB-214	77.11	* 10.70	6.80E-01	1.22E-01	6.78E-01
		295.21	* 19.20	3.05E-01		2.12E-01
		351.92	* 37.20	2.31E-01		1.22E-01
+	PA-228	89.95	22.00	2.03E+01	1.77E+01	3.07E+01
		93.35	35.00	-1.06E+01		1.77E+01
		105.00	16.30	1.02E+01		3.38E+01
		129.22	2.97	4.29E+01		1.71E+02
		338.32	5.30	3.29E+01		1.11E+02
		463.00	13.80	2.08E+00		4.13E+01
		911.23	16.70	4.26E+01		6.06E+01
+	AM-241	59.54	36.30	-1.92E-01	3.60E-01	3.60E-01
+	CM-243	103.76	23.00	2.75E-02	2.24E-01	2.24E-01
		228.18	10.60	-1.96E-01		4.49E-01
		277.60	14.00	2.21E-01		4.05E-01

+ = Nuclide identified during the nuclide identification

\* = Energy line found in the spectrum

&gt; = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

? = CAUTION: MDA value is inconsistent with Currie MDA at 95% confidence level

Analysis Report for L3-012-101-FSGS-007-SS (SPLIT)  
L3-012-101

# **ATTACHMENT 8**

## **GEL LABORATORIES ANALYTICAL REPORTS**

October 15, 2019

Mr. Jason Q. Spaide  
LaCrosseSolutions  
S4601 State Hwy 35  
Genoa, Wisconsin 54632

Re: LACBWR Site Restoration Project  
Work Order: 490846

Dear Mr. Spaide:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on September 20, 2019. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.

Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at [www.gel.com](http://www.gel.com).

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4453.

Sincerely,



Edith Kent  
Project Manager

Purchase Order: 672583  
Enclosures



## GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 – (843) 556-8171 – www.gel.com

### Certificate of Analysis Report for

ENRG070 LaCrosseSolutions, LLC (672583)

Client SDG: 490846 GEL Work Order: 490846

**The Qualifiers in this report are defined as follows:**

- \* A quality control analyte recovery is outside of specified acceptance criteria
- \*\* Analyte is a Tracer compound
- \*\* Analyte is a surrogate compound
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Edith Kent.

Reviewed by





# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-SUB-TDS-FJGS-A24-SB  
Sample ID: 490846001  
Matrix: Soil  
Collect Date: 03-JUL-19 12:56  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0174	+/-0.0686	0.134	0.400	pCi/g			JXC9	10/07/19	1511	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-SUB-TDS-FJGS-A25-SB  
Sample ID: 490846002  
Matrix: Soil  
Collect Date: 03-JUL-19 13:01  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0855	+/-0.0784	0.128	0.400	pCi/g			JXC9	10/07/19	1511	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-SUB-TDS-FJGS-A12A-SB

Project: ENRG07001

Sample ID: 490846003

Client ID: ENRG070

Matrix: Soil

Collect Date: 12-JUL-19 13:02

Receive Date: 20-SEP-19

Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0271	+/-0.0476	0.104	0.400	pCi/g			JXC9	10/07/19	1511	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			84	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-107-FJGS-005-SS  
Sample ID: 490846004  
Matrix: Soil  
Collect Date: 08-AUG-19 15:29  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.033	+/-0.0803	0.145	0.400	pCi/g			JXC9	10/07/19	1511	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			70.7	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-107-FJGS-016-SS  
Sample ID: 490846005  
Matrix: Soil  
Collect Date: 09-AUG-19 14:00  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0505	+/-0.0835	0.167	0.400	pCi/g			JXC9	10/07/19	1511	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			81.8	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-101-FJGS-003-SS  
Sample ID: 490846006  
Matrix: Soil  
Collect Date: 08-AUG-19 14:21  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.00619	+/-0.0654	0.121	0.400	pCi/g			JXC9	10/08/19	0817	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			81.8	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-102-FJGS-010-SS  
Sample ID: 490846007  
Matrix: Soil  
Collect Date: 15-AUG-19 08:48  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0125	+/-0.0576	0.106	0.400	pCi/g			JXC9	10/08/19	1106	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			79.6	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor  
DL: Detection Limit  
MDA: Minimum Detectable Activity  
MDC: Minimum Detectable Concentration

Lc/LC: Critical Level  
PF: Prep Factor  
RL: Reporting Limit  
SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-103-FJGS-008-SS  
Sample ID: 490846008  
Matrix: Soil  
Collect Date: 14-AUG-19 10:25  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0247	+/-0.0832	0.149	0.400	pCi/g			JXC9	10/07/19	1510	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			90.6	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor  
DL: Detection Limit  
MDA: Minimum Detectable Activity  
MDC: Minimum Detectable Concentration

Lc/LC: Critical Level  
PF: Prep Factor  
RL: Reporting Limit  
SQL: Sample Quantitation Limit



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-104-FJGS-006-SS  
Sample ID: 490846009  
Matrix: Soil  
Collect Date: 23-AUG-19 08:44  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0047	+/-0.0675	0.130	0.400	pCi/g			JXC9	10/07/19	1510	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			81.8	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-105-FJGS-008-SS  
Sample ID: 490846010  
Matrix: Soil  
Collect Date: 23-AUG-19 13:39  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0453	+/-0.0588	0.125	0.400	pCi/g			JXC9	10/08/19	0817	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			77.3	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-106-FJGS-004-SS  
Sample ID: 490846011  
Matrix: Soil  
Collect Date: 28-AUG-19 10:39  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.024	+/-0.0648	0.117	0.400	pCi/g			JXC9	10/07/19	1510	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			92.8	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-106-FJGS-017-SS  
Sample ID: 490846012  
Matrix: Soil  
Collect Date: 28-AUG-19 14:31  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.023	+/-0.0397	0.0872	0.400	pCi/g			JXC9	10/08/19	0817	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			84	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-106-FJGS-018-SS  
Sample ID: 490846013  
Matrix: Soil  
Collect Date: 28-AUG-19 14:51  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0371	+/-0.0984	0.174	0.400	pCi/g			JXC9	10/07/19	1510	1921875	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			86.2	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35  
  
Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-SUB-TDS-CJGS-A01-SB  
Sample ID: 490846014  
Matrix: Soil  
Collect Date: 27-JUN-19 10:51  
Receive Date: 20-SEP-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	U	0.0233	+/-0.0336	0.0405	0.400	pCi/g			MXS2	10/14/19	0853	1919949	1
Americium-243	U	-0.0154	+/-0.0278	0.0708	0.400	pCi/g							
Curium-243/244	U	-0.00404	+/-0.0179	0.0466	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	U	-0.00044	+/-0.00286	0.0059	0.010	pCi/g			MXS2	10/13/19	1023	1919950	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	U	0.0035	+/-0.0399	0.0848	0.400	pCi/g			MXS2	10/14/19	0738	1919951	3
Plutonium-239/240	U	-0.00481	+/-0.0332	0.0808	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	U	3.99	+/-3.10	5.16	5.00	pCi/g			MXS2	10/14/19	2041	1919952	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	U	-0.464	+/-1.15	1.82	5.00	pCi/g			TXJ1	10/11/19	0816	1921366	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137		0.312	+/-0.0643	0.0341	1.00	pCi/g			MXR1	10/05/19	1250	1919313	6
Cobalt-60	U	0.00967	+/-0.0204	0.0438		pCi/g							
Europium-152	U	0.031	+/-0.0481	0.0992		pCi/g							
Europium-154	U	0.0292	+/-0.0612	0.129		pCi/g							
Europium-155	U	0.00749	+/-0.0528	0.102		pCi/g							
Niobium-94	U	0.00999	+/-0.0155	0.0334		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0873	+/-0.113	0.192	0.400	pCi/g			JXC9	10/07/19	1510	1921875	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	U	4.06	+/-4.58	7.69	10.0	pCi/g			EW3	10/04/19	0308	1921574	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	U	-2.58	+/-2.02	3.60	5.00	pCi/g			TXP3	10/09/19	1559	1921585	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	U	-0.45	+/-0.886	1.55	2.00	pCi/g			JJ3	10/06/19	0743	1921541	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	U	-1.7	+/-5.55	7.59	10.0	pCi/g			TXJ1	10/11/19	1543	1921313	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-SUB-TDS-CJGS-A01-SB  
Sample ID: 490846014

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	U	1.70	+/-2.13	3.60	5.00	pCi/g			TXJ1	10/11/19	1554	1921355	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	RYH1	09/25/19	1209	1919153

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			71.8	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			84.8	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			97.2	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			55.2	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			55.2	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			108	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			86.2	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			104	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			64.4	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			81.5	(25%-125%)

Notes:

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: October 15, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-SUB-TDS-CJGS-A01-SB  
Sample ID: 490846014

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit



# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Report Date: October 15, 2019

Page 1 of 7

**LaCrosseSolutions**  
**S4601 State Hwy 35**  
**Genoa, Wisconsin**

**Contact: Mr. Jason Q. Spaide**

**Workorder: 490846**

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<hr/>											
Rad Alpha Spec											
Batch	1919949										
QC1204388648	490846014	DUP									
Americium-241	U	0.0233	U	0.0153	pCi/g	N/A		N/A	MXS2	10/14/19	08:53
	Uncertainty	+/-0.0336		+/-0.0404							
Americium-243	U	-0.0154	U	-0.00504	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0278		+/-0.0171							
Curium-243/244	U	-0.00404	U	-0.0184	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0179		+/-0.0318							
QC1204388649	LCS										
Americium-241	1.92			1.77	pCi/g		92.4	(75%-125%)		10/14/19	08:53
	Uncertainty			+/-0.186							
Americium-243			U	-0.0226	pCi/g			(75%-125%)			
	Uncertainty			+/-0.0444							
Curium-243/244	2.26			1.89	pCi/g		83.8	(75%-125%)			
	Uncertainty			+/-0.191							
QC1204388647	MB										
Americium-241			U	-0.00254	pCi/g					10/14/19	08:53
	Uncertainty			+/-0.0237							
Americium-243			U	0.000499	pCi/g						
	Uncertainty			+/-0.0229							
Curium-243/244			U	-0.00426	pCi/g						
	Uncertainty			+/-0.0193							
<hr/>											
Batch	1919950										
QC1204388651	490846014	DUP									
Neptunium-237	U	-0.00044	U	-0.00249	pCi/g	N/A		N/A	MXS2	10/13/19	10:23
	Uncertainty	+/-0.00286		+/-0.00293							
QC1204388652	LCS										
Neptunium-237	1.44			1.55	pCi/g		108	(75%-125%)		10/13/19	10:23
	Uncertainty			+/-0.056							
QC1204388650	MB										
Neptunium-237			U	-0.00178	pCi/g					10/13/19	10:23
	Uncertainty			+/-0.00276							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 490846

Page 2 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Alpha Spec</b>											
Batch	1919951										
QC1204388654	490846014	DUP									
Plutonium-238	U	0.0035	U	0.0176	pCi/g	N/A		N/A	MXS2	10/14/19	07:38
	Uncertainty	+/-0.0399		+/-0.0379							
Plutonium-239/240	U	-0.00481	U	-0.0268	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0332		+/-0.0203							
QC1204388655	LCS										
Plutonium-238			U	0.00911	pCi/g					10/14/19	07:38
	Uncertainty			+/-0.0382							
Plutonium-239/240	1.96			1.86	pCi/g		95.3	(75%-125%)			
	Uncertainty			+/-0.244							
QC1204388653	MB										
Plutonium-238			U	-0.00287	pCi/g					10/14/19	07:38
	Uncertainty			+/-0.0268							
Plutonium-239/240			U	0.00918	pCi/g						
	Uncertainty			+/-0.0253							
Batch	1919952										
QC1204388657	490846014	DUP									
Plutonium-241	U	3.99	U	3.44	pCi/g	N/A		N/A	MXS2	10/15/19	02:00
	Uncertainty	+/-3.10		+/-2.41							
QC1204388658	LCS										
Plutonium-241	162			184	pCi/g		113	(75%-125%)		10/15/19	04:04
	Uncertainty			+/-4.54							
QC1204388656	MB										
Plutonium-241			U	1.84	pCi/g					10/14/19	22:45
	Uncertainty			+/-2.15							
<b>Rad Gamma Spec</b>											
Batch	1919313										
QC1204386990	490846014	DUP									
Cesium-137		0.312		0.350	pCi/g	11.5		(0%-20%)	MXR1	10/05/19	15:03
	Uncertainty	+/-0.0643		+/-0.0553							
Cobalt-60	U	0.00967	U	0.0062	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0204		+/-0.0199							
Europium-152	U	0.031	U	-0.00481	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0481		+/-0.0438							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 490846

Page 3 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Gamma Spec</b>											
Batch	1919313										
Europium-154	U	0.0292	U	0.00422	pCi/g	N/A		N/A MXR1		10/05/19	15:03
	Uncertainty	+/-0.0612		+/-0.0613							
Europium-155	U	0.00749	U	-0.0257	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0528		+/-0.0382							
Niobium-94	U	0.00999	U	0.0181	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0155		+/-0.0137							
QC1204386991	LCS										
Americium-241	487			510	pCi/g		105	(75%-125%)		10/05/19	12:52
	Uncertainty			+/-5.36							
Cesium-137	167			164	pCi/g		98.3	(75%-125%)			
	Uncertainty			+/-3.96							
Cobalt-60	108			107	pCi/g		98.5	(75%-125%)			
	Uncertainty			+/-3.72							
Europium-152			U	-0.591	pCi/g						
	Uncertainty			+/-1.40							
Europium-154			U	-0.258	pCi/g						
	Uncertainty			+/-0.900							
Europium-155			U	0.655	pCi/g						
	Uncertainty			+/-1.02							
Niobium-94			U	0.231	pCi/g						
	Uncertainty			+/-0.450							
QC1204386989	MB										
Cesium-137			U	-0.00479	pCi/g					10/05/19	12:51
	Uncertainty			+/-0.0152							
Cobalt-60			U	-0.00517	pCi/g						
	Uncertainty			+/-0.0145							
Europium-152			U	-0.000709	pCi/g						
	Uncertainty			+/-0.0424							
Europium-154			U	-0.0286	pCi/g						
	Uncertainty			+/-0.038							
Europium-155			U	0.0641	pCi/g						
	Uncertainty			+/-0.0928							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 490846

Page 4 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Gamma Spec</b>											
Batch	1919313										
Niobium-94			U	0.00784	pCi/g				MXR1	10/05/19	12:51
	Uncertainty			+/-0.0142							
<hr/>											
Batch	1921366										
QC1204391968	490846014	DUP									
Nickel-59			U	-0.464	pCi/g	N/A			N/A	TXJ1	10/11/19 08:17
	Uncertainty			+/-1.15							
QC1204391969	LCS										
Nickel-59				100	pCi/g		108	(75%-125%)			10/11/19 09:30
	Uncertainty			+/-6.10							
QC1204391967	MB										
Nickel-59			U	1.07	pCi/g						10/11/19 08:17
	Uncertainty			+/-1.85							
<hr/>											
<b>Rad Gas Flow</b>											
Batch	1921875										
QC1204393106	490846005	DUP									
Strontium-90			U	0.0293	pCi/g	N/A			N/A	JXC9	10/07/19 15:10
	Uncertainty			+/-0.0985							
QC1204393107	LCS										
Strontium-90				5.83	pCi/g		109	(75%-125%)			10/07/19 15:10
	Uncertainty			+/-0.340							
QC1204393105	MB										
Strontium-90			U	0.015	pCi/g						10/07/19 15:10
	Uncertainty			+/-0.0671							
<hr/>											
<b>Rad Liquid Scintillation</b>											
Batch	1921313										
QC1204391802	490846014	DUP									
Iron-55			U	-0.904	pCi/g	N/A			N/A	TXJ1	10/11/19 18:19
	Uncertainty			+/-5.55							
QC1204391803	LCS										
Iron-55				71.5	pCi/g		93.5	(75%-125%)			10/11/19 19:37
	Uncertainty			+/-5.37							
QC1204391801	MB										
Iron-55			U	1.03	pCi/g						10/11/19 17:01
	Uncertainty			+/-4.39							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 490846

Page 5 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Liquid Scintillation</b>											
Batch	1921355										
QC1204391926	490846014	DUP									
Nickel-63	U	1.70	U	-0.61	pCi/g	N/A		N/A	TXJ1	10/11/19	16:28
	Uncertainty	+/-2.13		+/-2.12							
QC1204391927	LCS										
Nickel-63	96.5			101	pCi/g		104	(75%-125%)		10/11/19	16:44
	Uncertainty			+/-5.11							
QC1204391925	MB										
Nickel-63			U	-0.418	pCi/g					10/11/19	16:11
	Uncertainty			+/-2.23							
Batch	1921541										
QC1204392284	490846014	DUP									
Technetium-99	U	-0.45	U	-0.161	pCi/g	N/A		N/A	JJ3	10/06/19	08:48
	Uncertainty	+/-0.886		+/-0.901							
QC1204392285	LCS										
Technetium-99	41.1			36.7	pCi/g		89.3	(75%-125%)		10/06/19	09:20
	Uncertainty			+/-1.70							
QC1204392283	MB										
Technetium-99			U	-0.684	pCi/g					10/06/19	08:15
	Uncertainty			+/-0.898							
Batch	1921574										
QC1204392383	490846014	DUP									
Tritium	U	4.06	U	4.45	pCi/g	N/A		N/A	EW3	10/04/19	05:53
	Uncertainty	+/-4.58		+/-4.62							
QC1204392385	LCS										
Tritium	146			129	pCi/g		88.1	(75%-125%)		10/04/19	07:27
	Uncertainty			+/-8.79							
QC1204392382	MB										
Tritium			U	3.98	pCi/g					10/04/19	03:55
	Uncertainty			+/-4.49							
QC1204392384	490846014	MS									
Tritium	149 U	4.06		124	pCi/g		83.3	(75%-125%)		10/04/19	06:40
	Uncertainty	+/-4.58		+/-8.95							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 490846

Page 6 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Liquid Scintillation</b>											
Batch	1921585										
QC1204392425	490846014	DUP									
Carbon-14	U	-2.58	U	-1.82	pCi/g	N/A		N/A	TXP3	10/09/19	17:34
	Uncertainty	+/-2.02		+/-2.01							
QC1204392427	LCS										
Carbon-14	142			133	pCi/g		93.5	(75%-125%)		10/09/19	19:10
	Uncertainty			+/-4.36							
QC1204392424	MB										
Carbon-14			U	0.0484	pCi/g					10/09/19	16:46
	Uncertainty			+/-2.08							
QC1204392426	490846014	MS									
Carbon-14	146 U	-2.58		132	pCi/g		90.2	(75%-125%)		10/09/19	18:23
	Uncertainty	+/-2.02		+/-4.40							

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

The Qualifiers in this report are defined as follows:

- \*\* Analyte is a Tracer compound
- < Result is less than value reported
- > Result is greater than value reported
- BD Results are either below the MDC or tracer recovery is low
- FA Failed analysis.
- H Analytical holding time was exceeded
- J See case narrative for an explanation
- J Value is estimated
- K Analyte present. Reported value may be biased high. Actual value is expected to be lower.
- L Analyte present. Reported value may be biased low. Actual value is expected to be higher.
- M M if above MDC and less than LLD
- M REMP Result > MDC/CL and < RDL
- N/A RPD or %Recovery limits do not apply.
- N1 See case narrative
- ND Analyte concentration is not detected above the detection limit
- NJ Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier
- Q One or more quality control criteria have not been met. Refer to the applicable narrative or DER.
- R Sample results are rejected
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- UI Gamma Spectroscopy--Uncertain identification

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 490846

Page 7 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
UJ	Gamma Spectroscopy--Uncertain identification										
UL	Not considered detected. The associated number is the reported concentration, which may be inaccurate due to a low bias.										
X	Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier										
Y	Other specific qualifiers were required to properly define the results. Consult case narrative.										
^	RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.										
h	Preparation or preservation holding time was exceeded										

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

\* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry  
Technical Case Narrative  
LaCrosseSolutions, LLC  
SDG #: 490846**

**Product:** Alphaspec Isotopic Am241 Am243, Cm243/244, Solid

**Analytical Method:** DOE EML HASL-300, Am-05-RC Modified

**Analytical Procedure:** GL-RAD-A-011 REV# 27

**Analytical Batch:** 1919949

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204388647	Method Blank (MB)
1204388648	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204388649	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information**

**Recounts**

The Cm-244 portion of sample 1204388647 (MB) was recounted due to results more negative than the three sigma TPU. The recount is reported.

**Product:** Alphaspec Np, Solid

**Analytical Method:** ASTM C 1475-00 Modified

**Analytical Procedure:** GL-RAD-A-032 REV# 22

**Analytical Batch:** 1919950

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153



The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204388650	Method Blank (MB)
1204388651	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204388652	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Alphaspec Pu238, 239/240, Solid

**Analytical Method:** DOE EML HASL-300, Pu-11-RC Modified

**Analytical Procedure:** GL-RAD-A-011 REV# 27

**Analytical Batch:** 1919951

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204388653	Method Blank (MB)
1204388654	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204388655	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Dry Weight

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
490846001	L1-SUB-TDS-FJGS-A24-SB
490846002	L1-SUB-TDS-FJGS-A25-SB
490846003	L1-SUB-TDS-FJGS-A12A-SB
490846004	L1-010-107-FJGS-005-SS
490846005	L1-010-107-FJGS-016-SS
490846006	L1-010-101-FJGS-003-SS
490846007	L1-010-102-FJGS-010-SS
490846008	L1-010-103-FJGS-008-SS
490846009	L1-010-104-FJGS-006-SS
490846010	L1-010-105-FJGS-008-SS
490846011	L1-010-106-FJGS-004-SS
490846012	L1-010-106-FJGS-017-SS
490846013	L1-010-106-FJGS-018-SS
490846014	L1-SUB-TDS-CJGS-A01-SB

The samples in this SDG were analyzed on an "as received" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155

**Analytical Method:** DOE HASL 300, 4.5.2.3/Ga-01-R

**Analytical Procedure:** GL-RAD-A-013 REV# 27

**Analytical Batch:** 1919313

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204386989	Method Blank (MB)
1204386990	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204386991	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Gamma Ni59, Solid

**Analytical Method:** DOE RESL Ni-1

**Analytical Procedure:** GL-RAD-A-022 REV# 19

**Analytical Batch:** 1921366

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204391967	Method Blank (MB)
1204391968	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204391969	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** GFPC, Sr90, Solid

**Analytical Method:** EPA 905.0 Modified/DOE RP501 Rev. 1 Modified

**Analytical Procedure:** GL-RAD-A-004 REV# 21

**Analytical Batch:** 1921875

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846001	L1-SUB-TDS-FJGS-A24-SB
490846002	L1-SUB-TDS-FJGS-A25-SB
490846003	L1-SUB-TDS-FJGS-A12A-SB
490846004	L1-010-107-FJGS-005-SS
490846005	L1-010-107-FJGS-016-SS
490846006	L1-010-101-FJGS-003-SS
490846007	L1-010-102-FJGS-010-SS
490846008	L1-010-103-FJGS-008-SS
490846009	L1-010-104-FJGS-006-SS

490846010	L1-010-105-FJGS-008-SS
490846011	L1-010-106-FJGS-004-SS
490846012	L1-010-106-FJGS-017-SS
490846013	L1-010-106-FJGS-018-SS
490846014	L1-SUB-TDS-CJGS-A01-SB
1204393105	Method Blank (MB)
1204393106	490846005(L1-010-107-FJGS-016-SS) Sample Duplicate (DUP)
1204393107	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Technical Information**

##### **Recounts**

Samples 490846006 (L1-010-101-FJGS-003-SS), 490846007 (L1-010-102-FJGS-010-SS), 490846010 (L1-010-105-FJGS-008-SS) and 490846012 (L1-010-106-FJGS-017-SS) were recounted due to results more negative than the three sigma TPU. The second counts are reported.

#### **Product: Liquid Scint Pu241, Solid**

**Analytical Method:** DOE EML HASL-300, Pu-11-RC Modified

**Analytical Procedure:** GL-RAD-A-035 REV# 21

**Analytical Batch:** 1919952

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204388656	Method Blank (MB)
1204388657	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204388658	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Liquid Scint Fe55, Solid

**Analytical Method:** DOE RESL Fe-1, Modified

**Analytical Procedure:** GL-RAD-A-040 REV# 13

**Analytical Batch:** 1921313

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204391801	Method Blank (MB)
1204391802	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204391803	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information**

**Recounts**

Samples were recounted due to high MDCs. The recounts are reported.

**Product:** Liquid Scint Ni63, Solid

**Analytical Method:** DOE RESL Ni-1, Modified

**Analytical Procedure:** GL-RAD-A-022 REV# 19

**Analytical Batch:** 1921355

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1919153

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204391925	Method Blank (MB)
1204391926	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204391927	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product: Liquid Scint Tc99, Solid**

**Analytical Method:** DOE EML HASL-300, Tc-02-RC Modified

**Analytical Procedure:** GL-RAD-A-059 REV# 5

**Analytical Batch:** 1921541

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204392283	Method Blank (MB)
1204392284	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204392285	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product: LSC, Tritium Distillation, Solid**

**Analytical Method:** EPA 906.0 Modified

**Analytical Procedure:** GL-RAD-A-002 REV# 23

**Analytical Batch:** 1921574

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204392382	Method Blank (MB)
1204392383	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204392384	490846014(L1-SUB-TDS-CJGS-A01-SB) Matrix Spike (MS)
1204392385	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Liquid Scint C14, Solid

**Analytical Method:** EPA EERF C-01 Modified

**Analytical Procedure:** GL-RAD-A-003 REV# 16

**Analytical Batch:** 1921585

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
490846014	L1-SUB-TDS-CJGS-A01-SB
1204392424	Method Blank (MB)
1204392425	490846014(L1-SUB-TDS-CJGS-A01-SB) Sample Duplicate (DUP)
1204392426	490846014(L1-SUB-TDS-CJGS-A01-SB) Matrix Spike (MS)
1204392427	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.


**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Certification Statement**

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

490846

Page: <u>1</u> of <u>2</u>		 <b>Laboratories LLC</b> <small>Chemistry   Radiochemistry   Radiobioassay   Specialty Analytics</small> <b>Chain of Custody and Analytical Request</b>		GEL Laboratories, LLC 2040 Savage Road Charleston, SC 29407 Phone: (843) 556-8171 Fax: (843) 766-1178	
Project # <u>LACBWR</u> Site					
GEL Quote #:					
COC Number <sup>(1)</sup> :					
PO Number: 672583		GEL Work Order Number:		GEL Project Manager:	
Client Name: La Crosse Solutions		Phone # 608-689-4259		Sample Analysis Requested <sup>(5)</sup> (Fill in the number of containers for each test)	
Project/Site Name: LACBWR-Genoa WI		Fax #		Should this sample be considered:	
Address: 54601 State Road 35				Total number of containers	
Collected By: Kevin L Murray		Send Results To: Scott Zoller sgzoller@energysolutions.com		<input type="checkbox"/> Sr90 <input type="checkbox"/> Preservative Type (6)	
Sample ID	*Date Collected (mm-dd-yy)	*Time Collected (Military) (hhmm)	QC Code <sup>(a)</sup>	Field Filtered <sup>(b)</sup>	Sample Matrix <sup>(c)</sup>
* For composites - indicate start and stop date/time					
L1-SUB-TDS-FJGS-A24-SB	07/03/19	12:56	N	N	SO
L1-SUB-TDS-FJGS-A25-SB	07/03/19	13:01	N	N	SO
L1-SUB-TDS-FJGS-A12A-SB	07/12/19	13:02	N	N	SO
L1-010-107-FSGS-005-SS	08/08/19	15:29	N	N	SO
L1-010-107-FJGS-016-SS	08/09/19	14:00	N	N	SO
L1-010-101-FSGS-003-SS	08/08/19	14:21	N	N	SO
L1-010-102-FSGS-010-SB	08/15/19	8:48	N	N	SO
L1-010-103-FSGS-008-SS	08/14/19	10:25	N	N	SO
L1-010-104-FSGS-006-SS	08/23/19	8:44	N	N	SO
L1-010-105-FSGS-008-SS	08/23/19	13:39	N	N	SO
Chain of Custody Signatures					
Relinquished By (Signed)			Received by (signed)		
Date			Date		
Time			Time		
1. Kevin L Murray <i>Kevin L Murray</i> 9/18/19 0900			1 <i>Scott Zoller</i> 9/20/19 8:55		
2			2		
3			3		
Fax Results: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			Select Deliverable: <input type="checkbox"/> C of A <input type="checkbox"/> QC Summary <input type="checkbox"/> Level 1 <input checked="" type="checkbox"/> Level 2 <input type="checkbox"/> Level 3 <input type="checkbox"/> Level 4		
Additional Remarks: <b>None</b>			For Lab Receiving Use Only: Custody Seal Intact? <input type="checkbox"/> Yes <input type="checkbox"/> No Cooler Temp: _____ °C		
> For sample shipping and delivery details, see Sample Receipt & Review form (SRR.)			Sample Collection Time Zone: <input type="checkbox"/> Eastern <input type="checkbox"/> Pacific <input checked="" type="checkbox"/> Central <input type="checkbox"/> Mountain <input type="checkbox"/> Other:		
1.) Chain of Custody Number = Client Determined 2.) QC Codes: N = Normal Sample, TB = Trip Blank, FD = Field Duplicate, EB = Equipment Blank, MS = Matrix Spike Sample, MSD = Matrix Spike Duplicate Sample, G = Grab, C = Composite 3.) Field Filtered: For liquid matrices, indicate with a - Y - for yes the sample was field filtered or - N - for sample was not field filtered. 4.) Matrix Codes: DW=Drinking Water, GW=Groundwater, SW=Surface Water, WW=Waste Water, W=Water, ML=Misc Liquid, SO=Soil, SD=Sediment, SL=Sludge, SS=Solid Waste, O=Oil, F=Filter, P=Wipe, U=Urine, F=Fecal, N=Nasal 5.) Sample Analysis Requested: Analytical method requested (i.e. 8260B, 6010B/7470A) and number of containers provided for each (i.e. 8260B - 3, 6010B/7470A - 1). 6.) Preservative Type: HA = Hydrochloric Acid, NI = Nitric Acid, SH = Sodium Hydroxide, SA = Sulfuric Acid, AA = Ascorbic Acid, HX = Hexane, ST = Sodium Thiosulfate, If no preservative is added = leave field blank					
7.) <b>KNOWN OR POSSIBLE HAZARDS</b>		Characteristic Hazards	Listed Waste	Other	
RCRA Metals		FL = Flammable/Ignitable	LW = Listed Waste	OT = Other / Unknown	
As = Arsenic Hg = Mercury		CO = Corrosive	(F, K, P and U-listed wastes.)	(i.e.: High/low pH, asbestos, beryllium, irritants, other misc. health hazards, etc.)	
Ba = Barium Se = Selenium		RE = Reactive	Waste code(s):	Description:	
Cd = Cadmium Ag = Silver		TSCA Regulated			
Cr = Chromium MR = Misc. RCRA metals		PCB = Polychlorinated			
Pb = Lead		biphenyls			
Please provide any additional details below regarding handling and/or disposal concerns. (i.e.: Origin of sample(s), type of site collected from, odd matrices, etc.)					



490846

Page: <u>2</u> of <u>2</u>		<b>Laboratories LLC</b> <small>Chemistry   Radiochemistry   Radiobiology   Specialty Analytics</small> <b>Chain of Custody and Analytical Request</b>		GEL Laboratories, LLC	
Project # <u>LACBWR</u> Site				2040 Savage Road	
GEL Quote #:				Charleston, SC 29407	
COC Number <sup>(1)</sup> :				Phone: (843) 556-8171	
PO Number: 672583		GEL Work Order Number:		GEL Project Manager:	
Client Name: La Crosse Solutions		Phone # 608-689-4259		Sample Analysis Requested <sup>(5)</sup> (Fill in the number of containers for each test)	
Project/Site Name: LACBWR-Genoa W1		Fax #		Should this sample be considered: (7) Known or possible Hazards Total number of containers Si90 Ni59, Co60, Nb94 Cs137, Eu152, Eu154 Eu155, Pu241 H3, C14, Fe55 Ni63, Tc99 Np237, Pu238 Pu239, Pu240 Am241, Am243 Cm243, Cm244 <-- Preservative Type (6)	
Address: 54601 State Road 35					
Collected By: Kevin L Murray		Send Results To: Scott Zoller sgzoller@energysolutions.com		Comments Note: extra sample is required for sample specific QC	
Sample ID <i>* For composites - indicate start and stop date/time</i>		*Date Collected (mm-dd-yy) *Time Collected (Military) (hhmm) QC Code <sup>(3)</sup> Field Filtered <sup>(4)</sup> Sample Matrix <sup>(4)</sup>			
L1-010-106-FSGS-004-SS		08/28/19 10:39 N N SO N N			
L1-010-106-FJGS-017-SS		08/28/19 14:31 N N SO N N			
L1-010-106-FJGS-018-SS		08/28/19 14:51 N N SO N N			
L1-SUB-TDS-CJGS-A01-SB		06/27/19 10:51 N N SO N N		MDC <0.01pCi Np-237	
A N					
Chain of Custody Signatures				TAT Requested: Normal: <input checked="" type="checkbox"/> Rush: <input type="checkbox"/> Specify: <input type="text"/> (Subject to Surcharge)	
Relinquished By (Signed) _____ Date _____ Time _____		Received by (signed) _____ Date _____ Time _____		Fax Results: [ ] Yes [X] No	
1. Kevin L. Murray <i>Kevin L. Murray</i> 9/18/19 0900		1. <i>Scott Zoller</i> 9/20/19 855		Select Deliverable: [ ] C of A [ ] QC Summary [ ] Level 1 [X] Level 2 [ ] Level 3 [ ] Level 4	
2		2		Additional Remarks: None	
3		3		For Lab Receiving Use Only: Custody Seal Intact? [ ] Yes [ ] No Cooler Temp: _____ °C	
> For sample shipping and delivery details, see Sample Receipt & Review form (SRR.)				Sample Collection Time Zone: [ ] Eastern [ ] Pacific [X] Central [ ] Mountain [ ] Other:	
1.) Chain of Custody Number = Client Determined 2.) QC Codes: N = Normal Sample, TB = Trip Blank, FD = Field Duplicate, EB = Equipment Blank, MS = Matrix Spike Sample, MSD = Matrix Spike Duplicate Sample, G = Grab, C = Composite 3.) Field Filtered: For liquid matrices, indicate with a - Y - for yes the sample was field filtered or - N - for sample was not field filtered. 4.) Matrix Codes: DW=Drinking Water, GW=Groundwater, SW=Surface Water, WW=Waste Water, W=Water, ML=Misc Liquid, SO=Soil, SD=Sediment, SL=Sludge, SS=Solid Waste, O=Oil, F=Filter, P=Wipe, U=Urine, F=Fecal, N=Nasal 5.) Sample Analysis Requested: Analytical method requested (i.e. 8260B, 6010B/7470A) and number of containers provided for each (i.e. 8260B - 3, 6010B/7470A - 1). 6.) Preservative Type: HA = Hydrochloric Acid, NI = Nitric Acid, SH = Sodium Hydroxide, SA = Sulfuric Acid, AA = Ascorbic Acid, HX = Hexane, ST = Sodium Thiosulfate, If no preservative is added = leave field blank					
<b>7.) KNOWN OR POSSIBLE HAZARDS</b> <b>RCRA Metals</b> As = Arsenic Hg= Mercury Ba = Barium Se= Selenium Cd = Cadmium Ag= Silver Cr = Chromium MR= Misc. RCRA metals Pb = Lead		<b>Characteristic Hazards</b> FL = Flammable/Ignitable CO = Corrosive RE = Reactive  <b>TSCA Regulated</b> PCB = Polychlorinated biphenyls		<b>Listed Waste</b> LW= Listed Waste (F,K,P and U-listed wastes.) Waste code(s): _____  <b>Other</b> OT= Other / Unknown (i.e.: High/low pH, asbestos, beryllium, irritants, other misc. health hazards, etc.) Description: _____ _____ _____	
Please provide any additional details below regarding handling and/or disposal concerns. (i.e.: Origin of sample(s), type of site collected from, odd matrices, etc.)					

## SAMPLE RECEIPT &amp; REVIEW FORM

Client: <b>ENRG</b>		SDG/AR/COC/Work Order: <b>490846</b>	
Received By: <b>STACY BOONE</b>		Date Received: <b>20 - SEPT - 19</b>	
Carrier and Tracking Number		Circle Applicable: FedEx Express    FedEx Ground    UPS    Field Services    Courier    Other	
		<b>7762 7528 4418</b>	
Suspected Hazard Information	Yes	No	* If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.
A) Shipped as a DOT Hazardous?			Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___
B) Did the client designate the samples are to be received as radioactive?			COC notation or radioactive stickers on containers equal client designation.
C) Did the RSO classify the samples as radioactive?			Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1    Rad 2    Rad 3
D) Did the client designate samples are hazardous?			COC notation or hazard labels on containers equal client designation.
E) Did the RSO identify possible hazards?			If D or E is yes, select Hazards below: PCB's    Flammable    Foreign Soil    RCRA    Asbestos    Beryllium    Other: _____
Sample Receipt Criteria		Yes	NA
1	Shipping containers received intact and sealed?		
2	Chain of custody documents included with shipment?		
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*		
4	Daily check performed and passed on IR temperature gun?		
5	Sample containers intact and sealed?		
6	Samples requiring chemical preservation at proper pH?		
7	Do any samples require Volatile Analysis?		
8	Samples received within holding time?		
9	Sample ID's on COC match ID's on bottles?		
10	Date & time on COC match date & time on bottles?		
11	Number of containers received match number indicated on COC?		
12	Are sample containers identifiable as GEL provided?		
13	COC form is properly signed in relinquished/received sections?		
Comments (Use Continuation Form if needed):			

PM (or PMA) review: Initials MB Date 9/23/19 Page 1 of 1

**List of current GEL Certifications as of 15 October 2019**

<b>State</b>	<b>Certification</b>
Alaska	17-018
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122020-1
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2019-165
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-19-15
Utah NELAP	SC000122019-28
Vermont	VT87156
Virginia NELAP	460202
Washington	C780



November 14, 2019

Mr. Jason Q. Spaide  
LaCrosseSolutions  
S4601 State Hwy 35  
Genoa, Wisconsin 54632

Re: LACBWR Site Restoration Project  
Work Order: 493624

Dear Mr. Spaide:

GEL Laboratories, LLC (GEL) appreciates the opportunity to provide the enclosed analytical results for the sample(s) we received on October 21, 2019. This original data report has been prepared and reviewed in accordance with GEL's standard operating procedures.


Test results for NELAP or ISO 17025 accredited tests are verified to meet the requirements of those standards, with any exceptions noted. The results reported relate only to the items tested and to the sample as received by the laboratory. These results may not be reproduced except as full reports without approval by the laboratory. Copies of GEL's accreditations and certifications can be found on our website at [www.gel.com](http://www.gel.com).

Our policy is to provide high quality, personalized analytical services to enable you to meet your analytical needs on time every time. We trust that you will find everything in order and to your satisfaction. If you have any questions, please do not hesitate to call me at (843) 556-8171, ext. 4453.

Sincerely,

Edith Kent  
Project Manager

Purchase Order: 672583  
Enclosures

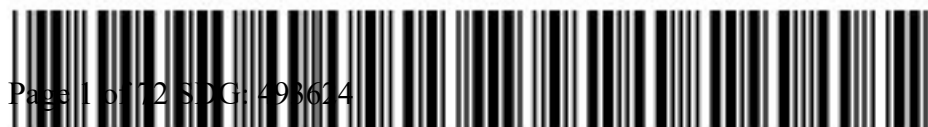

## GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 – (843) 556-8171 – www.gel.com

### Certificate of Analysis Report for

ENRG070 LaCrosseSolutions, LLC (672583)

Client SDG: 493624 GEL Work Order: 493624

**The Qualifiers in this report are defined as follows:**

- \* A quality control analyte recovery is outside of specified acceptance criteria
- \*\* Analyte is a Tracer compound
- \*\* Analyte is a surrogate compound
- H Analytical holding time was exceeded
- U Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.
- h Preparation or preservation holding time was exceeded

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the Certificate of Analysis.

The designation ND, if present, appears in the result column when the analyte concentration is not detected above the limit as defined in the 'U' qualifier above.

This data report has been prepared and reviewed in accordance with GEL Laboratories LLC standard operating procedures. Please direct any questions to your Project Manager, Edith Kent.

Reviewed by



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RAGS-002-SS  
Sample ID: 493624001  
Matrix: Soil  
Collect Date: 08-SEP-16 11:05  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	HUh	0.0084	+/-0.0467	0.0895	0.400	pCi/g			HAKB	11/06/19	0953	1929693	1
Americium-243	HUh	0.0346	+/-0.0974	0.104	0.400	pCi/g							
Curium-243/244	HUh	-0.00429	+/-0.037	0.0857	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	HUh	0.00125	+/-0.00299	0.00529	0.010	pCi/g			HAKB	11/11/19	1231	1929694	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	HUh	0.00487	+/-0.0271	0.0519	0.400	pCi/g			HAKB	11/06/19	0922	1929695	3
Plutonium-239/240	HUh	-0.00402	+/-0.0278	0.0676	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	HUh	-1.25	+/-2.38	4.12	5.00	pCi/g			HAKB	11/09/19	0252	1929696	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	HUh	-0.18	+/-1.68	3.01	5.00	pCi/g			TXJ1	10/30/19	0619	1931847	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137	Hh	0.113	+/-0.0594	0.0518	1.00	pCi/g			MXR1	10/30/19	0857	1929624	6
Cobalt-60	HUh	0.036	+/-0.0349	0.0881		pCi/g							
Europium-152	HUh	-0.00616	+/-0.0669	0.115		pCi/g							
Europium-154	HUh	-0.0128	+/-0.0717	0.149		pCi/g							
Europium-155	HUh	0.0587	+/-0.0622	0.134		pCi/g							
Niobium-94	HUh	0.0376	+/-0.0275	0.0407		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	HUh	0.0238	+/-0.0658	0.120	0.400	pCi/g			JXC9	11/06/19	1419	1933651	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	HU	1.65	+/-5.62	9.75	10.0	pCi/g			EW3	10/28/19	2327	1929721	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	HU	1.92	+/-1.76	2.94	5.00	pCi/g			TXP3	11/08/19	1739	1934551	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	HU	-0.00734	+/-0.483	0.861	2.00	pCi/g			JJ3	11/05/19	2229	1929739	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	HUh	-1.57	+/-12.1	18.7	10.0	pCi/g			RP1	11/01/19	0908	1931683	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RAGS-002-SS  
Sample ID: 493624001

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	HUh	-0.424	+/-1.17	2.08	5.00	pCi/g			RP1	10/30/19	1251	1931689	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			35	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			18.2	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			91.7	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			79.9	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			79.9	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			98.8	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			92.8	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			92.1	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			20.5	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			97.4	(25%-125%)

Notes:

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RAGS-002-SS  
Sample ID: 493624001

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35  
  
Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RAGS-004-SS  
Sample ID: 493624002  
Matrix: Soil  
Collect Date: 13-SEP-16 11:00  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	HUh	-0.00947	+/-0.0286	0.0803	0.400	pCi/g			HAKB	11/06/19	0953	1929693	1
Americium-243	HUh	0.049	+/-0.0706	0.0851	0.400	pCi/g							
Curium-243/244	HUh	-0.0105	+/-0.0316	0.0888	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	HUh	0.00322	+/-0.00457	0.00708	0.010	pCi/g			HAKB	11/11/19	1407	1929694	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	HUh	0.0216	+/-0.043	0.0698	0.400	pCi/g			HAKB	11/06/19	0922	1929695	3
Plutonium-239/240	HUh	0.00537	+/-0.0299	0.0572	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	HUh	-0.71	+/-2.66	4.58	5.00	pCi/g			HAKB	11/09/19	0453	1929696	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	HUh	0.790	+/-1.61	1.85	5.00	pCi/g			TXJ1	10/30/19	0732	1931847	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137	HUh	-0.00991	+/-0.0244	0.0436	1.00	pCi/g			MXR1	10/30/19	2007	1929624	6
Cobalt-60	HUh	-0.0119	+/-0.0357	0.0682		pCi/g							
Europium-152	HUh	0.0185	+/-0.085	0.158		pCi/g							
Europium-154	HUh	-0.0397	+/-0.0855	0.151		pCi/g							
Europium-155	HUh	0.0322	+/-0.121	0.245		pCi/g							
Niobium-94	HUh	0.00172	+/-0.0225	0.0424		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	HUh	-0.0186	+/-0.0688	0.136	0.400	pCi/g			JXC9	11/07/19	0654	1933651	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	HU	6.63	+/-5.88	9.76	10.0	pCi/g			EW3	10/29/19	0019	1929721	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	HU	0.791	+/-1.54	2.62	5.00	pCi/g			TXP3	11/10/19	1745	1934551	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	HU	0.117	+/-0.461	0.809	2.00	pCi/g			JJ3	11/05/19	2312	1929739	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	HUh	-8.13	+/-10.8	16.8	10.0	pCi/g			RP1	11/01/19	1112	1931683	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RAGS-004-SS  
Sample ID: 493624002

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	HUh	-0.325	+/-1.16	2.04	5.00	pCi/g			RP1	10/30/19	1308	1931689	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			45.5	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			29.7	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			77.2	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			72.9	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			72.9	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			106	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			75.1	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			95.4	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			23.8	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			101	(25%-125%)

Notes:

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RAGS-004-SS  
Sample ID: 493624002

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RBGS-004-SS  
Sample ID: 493624003  
Matrix: Soil  
Collect Date: 14-OCT-16 09:02  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	HUh	0.00515	+/-0.0286	0.0549	0.400	pCi/g			HAKB	11/11/19	2243	1929693	1
Americium-243	HUh	0.0273	+/-0.0467	0.0409	0.400	pCi/g							
Curium-243/244	HUh	0.0083	+/-0.0311	0.0524	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	HUh	0.00372	+/-0.00542	0.00881	0.010	pCi/g			HAKB	11/11/19	1407	1929694	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	HUh	0.00351	+/-0.0367	0.0765	0.400	pCi/g			HAKB	11/06/19	0922	1929695	3
Plutonium-239/240	HUh	0.0186	+/-0.0427	0.0677	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	HUh	-2.96	+/-3.25	5.69	5.00	pCi/g			HAKB	11/09/19	0654	1929696	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	HUh	-1.19	+/-1.81	3.10	5.00	pCi/g			TXJ1	10/30/19	0732	1931847	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137	Hh	0.165	+/-0.0676	0.0583	1.00	pCi/g			MXR1	10/30/19	2007	1929624	6
Cobalt-60	HUh	0.00774	+/-0.0495	0.104		pCi/g							
Europium-152	HUh	0.00852	+/-0.0674	0.143		pCi/g							
Europium-154	HUh	-0.0312	+/-0.128	0.242		pCi/g							
Europium-155	HUh	0.0809	+/-0.0975	0.216		pCi/g							
Niobium-94	HUh	0.0112	+/-0.0238	0.0472		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	HUh	-0.0302	+/-0.0603	0.125	0.400	pCi/g			JXC9	11/06/19	1419	1933651	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	HU	2.06	+/-5.54	9.58	10.0	pCi/g			EW3	10/29/19	0111	1929721	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	HU	1.88	+/-1.91	3.20	5.00	pCi/g			TXP3	11/08/19	1914	1934551	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	HU	0.210	+/-0.757	1.32	2.00	pCi/g			JJ3	11/05/19	2354	1929739	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	HUh	-3.06	+/-10.9	16.7	10.0	pCi/g			RP1	11/01/19	1316	1931683	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RBGS-004-SS  
Sample ID: 493624003

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	HUh	-0.265	+/-1.50	2.64	5.00	pCi/g			RP1	10/30/19	1324	1931689	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			63.2	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			38.5	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			67	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			58.2	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			58.2	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			84.1	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			90.6	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			83.5	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			24.3	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			77.5	(25%-125%)

Notes:

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RBGS-004-SS  
Sample ID: 493624003

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RBGS-007-SS  
Sample ID: 493624004  
Matrix: Soil  
Collect Date: 24-OCT-16 09:05  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	HUh	0.0113	+/-0.0385	0.0714	0.400	pCi/g			HAKB	11/06/19	0953	1929693	1
Americium-243	HUh	0.0127	+/-0.0397	0.0744	0.400	pCi/g							
Curium-243/244	HUh	-0.00764	+/-0.0449	0.107	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	HUh	0.00296	+/-0.00441	0.00677	0.010	pCi/g			HAKB	11/11/19	1407	1929694	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	HUh	0.0131	+/-0.0504	0.0977	0.400	pCi/g			HAKB	11/07/19	0836	1929695	3
Plutonium-239/240	HUh	-0.0113	+/-0.0263	0.0779	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	HUh	-3.33	+/-2.87	5.04	5.00	pCi/g			HAKB	11/09/19	0856	1929696	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	HUh	0.384	+/-1.43	2.69	5.00	pCi/g			TXJ1	10/30/19	0901	1931847	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137	Hh	0.174	+/-0.128	0.107	1.00	pCi/g			MXR1	10/30/19	2008	1929624	6
Cobalt-60	HUh	0.010	+/-0.0701	0.154		pCi/g							
Europium-152	HUh	-0.0434	+/-0.125	0.241		pCi/g							
Europium-154	HUh	0.0975	+/-0.198	0.446		pCi/g							
Europium-155	HUh	0.184	+/-0.157	0.316		pCi/g							
Niobium-94	HUh	-0.0248	+/-0.0531	0.0943		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	HUh	-0.0921	+/-0.0818	0.172	0.400	pCi/g			JXC9	11/06/19	1419	1933651	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	HU	-0.242	+/-5.47	9.57	10.0	pCi/g			EW3	10/30/19	0546	1929721	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	HU	1.60	+/-1.86	3.13	5.00	pCi/g			TXP3	11/08/19	2000	1934551	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	HU	0.0756	+/-0.755	1.33	2.00	pCi/g			JJ3	11/06/19	0037	1929739	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	HUh	-2.34	+/-9.51	14.1	10.0	pCi/g			RP1	11/01/19	1519	1931683	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RBGS-007-SS  
Sample ID: 493624004

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	HUh	-0.239	+/-1.48	2.61	5.00	pCi/g			RP1	10/30/19	1340	1931689	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			57.8	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			55.4	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			61.1	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			67.4	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			67.4	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			77.8	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			79.7	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			33.8	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			75.7	(25%-125%)

Notes:



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-RBGS-007-SS  
Sample ID: 493624004

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L4-OFF-SOL-IJGS-A01-SS NE  
Sample ID: 493624005  
Matrix: Soil  
Collect Date: 04-MAY-17 08:25  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	HUh	0.00418	+/-0.0437	0.0913	0.400	pCi/g			HAKB	11/06/19	0953	1929693	1
Americium-243	HUh	0.0805	+/-0.113	0.180	0.400	pCi/g							
Curium-243/244	HUh	0.0123	+/-0.046	0.0774	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	HUh	0.0027	+/-0.0048	0.00826	0.010	pCi/g			HAKB	11/11/19	1407	1929694	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	HUh	0.00535	+/-0.0297	0.057	0.400	pCi/g			HAKB	11/07/19	0919	1929695	3
Plutonium-239/240	HUh	0.00565	+/-0.0365	0.0746	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	HUh	-1.69	+/-2.64	4.58	5.00	pCi/g			HAKB	11/09/19	1057	1929696	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	HUh	-0.319	+/-1.80	3.04	5.00	pCi/g			TXJ1	10/30/19	0902	1931847	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137	HUh	-0.0202	+/-0.0335	0.062	1.00	pCi/g			MXR1	10/31/19	1914	1929624	6
Cobalt-60	HUh	-0.000764	+/-0.0486	0.105		pCi/g							
Europium-152	HUh	-0.0349	+/-0.0944	0.189		pCi/g							
Europium-154	HUh	0.0419	+/-0.107	0.261		pCi/g							
Europium-155	HUh	0.0633	+/-0.0849	0.189		pCi/g							
Niobium-94	HUh	-0.0074	+/-0.0313	0.0606		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	HUh	-0.0141	+/-0.058	0.117	0.400	pCi/g			JXC9	11/06/19	1419	1933651	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	HU	3.03	+/-5.68	9.73	10.0	pCi/g			EW3	10/29/19	0406	1929721	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	HU	2.67	+/-1.65	2.70	5.00	pCi/g			TXP3	11/08/19	2047	1934551	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	HU	0.468	+/-0.587	0.992	2.00	pCi/g			JJ3	11/06/19	0235	1929739	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	HUh	-2.65	+/-8.40	12.7	10.0	pCi/g			RP1	11/01/19	1723	1931683	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L4-OFF-SOL-IJGS-A01-SS NE  
Sample ID: 493624005

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	HUh	0.190	+/-1.16	2.01	5.00	pCi/g			RP1	10/30/19	1357	1931689	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			40	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			32.4	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			89.7	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			71.9	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			71.9	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			98	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			95.2	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			28.8	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			101	(25%-125%)

Notes:

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L4-OFF-SOL-IJGS-A01-SS NE  
Sample ID: 493624005

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35  
  
Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L4-OFF-SOL-IJGS-A03-SS SW  
Sample ID: 493624006  
Matrix: Soil  
Collect Date: 04-MAY-17 09:30  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Alpha Spec Analysis													
Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"													
Americium-241	HUh	-0.00883	+/-0.0399	0.101	0.400	pCi/g			HAKB	11/06/19	0953	1929693	1
Americium-243	HUh	0.00791	+/-0.0933	0.197	0.400	pCi/g							
Curium-243/244	HUh	-0.00337	+/-0.0291	0.0673	0.400	pCi/g							
Alphaspec Np, Solid "Dry Weight Corrected"													
Neptunium-237	HUh	0.00226	+/-0.004	0.00662	0.010	pCi/g			HAKB	11/11/19	1407	1929694	2
Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"													
Plutonium-238	HUh	-0.0135	+/-0.0384	0.0935	0.400	pCi/g			HAKB	11/06/19	0953	1929695	3
Plutonium-239/240	HUh	0.00711	+/-0.0355	0.071	0.400	pCi/g							
Liquid Scint Pu241, Solid "Dry Weight Corrected"													
Plutonium-241	HUh	-1.48	+/-2.38	4.14	5.00	pCi/g			HAKB	11/09/19	1258	1929696	4
Rad Gamma Spec Analysis													
Gamma Ni59, Solid "Dry Weight Corrected"													
Nickel-59	HUh	0.850	+/-0.613	1.77	5.00	pCi/g			TXJ1	10/30/19	0902	1931847	5
Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155 "Dry Weight Corrected"													
Cesium-137	HUh	-0.0164	+/-0.0249	0.0423	1.00	pCi/g			MXR1	11/01/19	0622	1929624	6
Cobalt-60	HUh	0.00904	+/-0.0233	0.0583		pCi/g							
Europium-152	HUh	0.123	+/-0.0925	0.150		pCi/g							
Europium-154	HUh	-0.097	+/-0.081	0.110		pCi/g							
Europium-155	HUh	0.0555	+/-0.0883	0.181		pCi/g							
Niobium-94	HUh	0.0103	+/-0.0227	0.049		pCi/g							
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	HUh	-0.0582	+/-0.055	0.122	0.400	pCi/g			JXC9	11/06/19	1419	1933651	7
Rad Liquid Scintillation Analysis													
LSC, Tritium Distillation, Solid "As Received"													
Tritium	HU	3.85	+/-5.29	8.96	10.0	pCi/g			EW3	10/29/19	0458	1929721	8
Liquid Scint C14, Solid "As Received"													
Carbon-14	HU	1.65	+/-1.66	2.79	5.00	pCi/g			TXP3	11/10/19	1832	1934551	9
Liquid Scint Tc99, Solid "As Received"													
Technetium-99	HU	-0.11	+/-1.09	1.95	2.00	pCi/g			JJ3	11/06/19	0317	1929739	10
Liquid Scint Fe55, Solid "Dry Weight Corrected"													
Iron-55	HUh	-1.18	+/-6.18	8.97	10.0	pCi/g			RP1	11/01/19	1927	1931683	11
Liquid Scint Ni63, Solid "Dry Weight Corrected"													

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L4-OFF-SOL-IJGS-A03-SS SW  
Sample ID: 493624006

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Liquid Scintillation Analysis													
Liquid Scint Ni63, Solid "Dry Weight Corrected"													
Nickel-63	HUh	-0.546	+/-1.17	2.08	5.00	pCi/g			RP1	10/30/19	1413	1931689	12

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	DOE EML HASL-300, Am-05-RC Modified	
2	ASTM C 1475-00 Modified	
3	DOE EML HASL-300, Pu-11-RC Modified	
4	DOE EML HASL-300, Pu-11-RC Modified	
5	DOE RESL Ni-1	
6	DOE HASL 300, 4.5.2.3/Ga-01-R	
7	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	
8	EPA 906.0 Modified	
9	EPA EERF C-01 Modified	
10	DOE EML HASL-300, Tc-02-RC Modified	
11	DOE RESL Fe-1, Modified	
12	DOE RESL Ni-1, Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Americium-243 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			42.8	(15%-125%)
Curium-243/244 Tracer	Alphaspec Isotopic Am241 Am243, Cm243/244, Solid "Dry Weight Corrected"			27.2	(15%-125%)
Americium-243 Tracer	Alphaspec Np, Solid "Dry Weight Corrected"			69.5	(15%-125%)
Plutonium-242 Tracer	Alphaspec Pu238, 239/240, Solid "Dry Weight Corrected"			80	(15%-125%)
Plutonium-242 Tracer	Liquid Scint Pu241, Solid "Dry Weight Corrected"			80	(15%-125%)
Nickel Carrier	Gamma Ni59, Solid "Dry Weight Corrected"			98.4	(25%-125%)
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			95	(25%-125%)
Technetium-99m Tracer	Liquid Scint Tc99, Solid "As Received"			63.8	(15%-125%)
Iron-59 Tracer	Liquid Scint Fe55, Solid "Dry Weight Corrected"			43.4	(15%-125%)
Nickel Carrier	Liquid Scint Ni63, Solid "Dry Weight Corrected"			96.5	(25%-125%)

Notes:

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632  
Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L4-OFF-SOL-IJGS-A03-SS SW  
Sample ID: 493624006

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
-----------	-----------	--------	-------------	-----	----	-------	----	----	---------	------	------	-------	--------

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: S3-012-109B-FJGS-062-SM  
Sample ID: 493624007  
Matrix: Soil  
Collect Date: 22-AUG-19 10:05  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0139	+/-0.0617	0.113	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			110	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: S3-012-109B-FJGS-063-SM  
Sample ID: 493624008  
Matrix: Soil  
Collect Date: 22-AUG-19 10:14  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.00923	+/-0.0636	0.121	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			104	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: S3-012-109B-FJGS-064-SM  
Sample ID: 493624009  
Matrix: Soil  
Collect Date: 22-AUG-19 13:12  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0355	+/-0.0445	0.0974	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			104	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L2-011-101-FSGS-013-SS  
Sample ID: 493624010  
Matrix: Soil  
Collect Date: 20-SEP-19 10:43  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0706	+/-0.085	0.144	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			97.2	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L2-011-104-FSGS-001-SS  
Sample ID: 493624011  
Matrix: Soil  
Collect Date: 09-SEP-19 14:08  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0354	+/-0.0446	0.096	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			113	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L2-011-104-FSGS-010-SS  
Sample ID: 493624012  
Matrix: Soil  
Collect Date: 09-SEP-19 14:46  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0194	+/-0.0367	0.0792	0.400	pCi/g			JXC9	11/07/19	0654	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			97.2	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-FSGS-004-SS

Project: ENRG07001

Sample ID: 493624013

Client ID: ENRG070

Matrix: Soil

Collect Date: 05-SEP-19 08:58

Receive Date: 21-OCT-19

Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.112	+/-0.084	0.133	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			92.8	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-109-FSGS-005-SS  
Sample ID: 493624014  
Matrix: Soil  
Collect Date: 24-SEP-19 08:05  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0801	+/-0.0672	0.107	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-109-FSGS-006-SS  
Sample ID: 493624015  
Matrix: Soil  
Collect Date: 24-SEP-19 10:36  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0454	+/-0.038	0.0913	0.400	pCi/g			JXC9	11/06/19	1419	1933651	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			104	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-109-FSGS-011-SS  
Sample ID: 493624016  
Matrix: Soil  
Collect Date: 23-SEP-19 14:09  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0482	+/-0.0493	0.111	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			92.8	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-107-FSGS-008-SS  
Sample ID: 493624017  
Matrix: Soil  
Collect Date: 08-AUG-19 15:00  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0295	+/-0.0766	0.151	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			84	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-101-FSGS-015-SS  
Sample ID: 493624018  
Matrix: Soil  
Collect Date: 08-AUG-19 15:12  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0436	+/-0.0544	0.118	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-102-FSGS-007-SS  
Sample ID: 493624019  
Matrix: Soil  
Collect Date: 14-AUG-19 15:18  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0969	+/-0.0724	0.155	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-103-FSGS-005-SS  
Sample ID: 493624020  
Matrix: Soil  
Collect Date: 14-AUG-19 10:13  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0229	+/-0.0522	0.109	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1024	1929602

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			90.6	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-104-FSGS-016-SS  
Sample ID: 493624021  
Matrix: Soil  
Collect Date: 23-AUG-19 09:57  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0967	+/-0.087	0.141	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			79.6	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-010-105-FSGS-007-SS  
Sample ID: 493624022  
Matrix: Soil  
Collect Date: 23-AUG-19 13:29  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0341	+/-0.0859	0.154	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			79.6	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L2-011-101-FSGS-005-SS  
Sample ID: 493624023  
Matrix: Soil  
Collect Date: 20-SEP-19 14:01  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.0135	+/-0.0736	0.141	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit



# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L2-011-104-FSGS-011-SS  
Sample ID: 493624024  
Matrix: Soil  
Collect Date: 09-SEP-19 14:52  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	-0.058	+/-0.0508	0.117	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			88.4	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-101-FSGS-005-SS  
Sample ID: 493624025  
Matrix: Soil  
Collect Date: 05-SEP-19 13:00  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0836	+/-0.0864	0.144	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			102	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-109-FSGS-014-SS

Project: ENRG07001

Sample ID: 493624026

Client ID: ENRG070

Matrix: Soil

Collect Date: 23-SEP-19 14:21

Receive Date: 21-OCT-19

Collector: Client

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0202	+/-0.0604	0.110	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			97.2	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L3-012-109-FSGS-017-SS  
Sample ID: 493624027  
Matrix: Soil  
Collect Date: 24-SEP-19 13:52  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0116	+/-0.0446	0.0829	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			115	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-PAD-GR5-AJGS-006-SS  
Sample ID: 493624028  
Matrix: Soil  
Collect Date: 12-JUL-19 12:22  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0456	+/-0.0691	0.119	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			104	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston SC 29407 - (843) 556-8171 - www.gel.com

## Certificate of Analysis

Report Date: November 14, 2019

Company : LaCrosseSolutions  
Address : S4601 State Hwy 35

Genoa, Wisconsin 54632

Contact: Mr. Jason Q. Spaide  
Project: LACBWR Site Restoration Project

Client Sample ID: L1-PAD-GR10-AJGS-007-SS  
Sample ID: 493624029  
Matrix: Soil  
Collect Date: 13-JUL-19 13:48  
Receive Date: 21-OCT-19  
Collector: Client

Project: ENRG07001  
Client ID: ENRG070

Parameter	Qualifier	Result	Uncertainty	MDC	RL	Units	PF	DF	Analyst	Date	Time	Batch	Method
Rad Gas Flow Proportional Counting													
GFPC, Sr90, Solid "Dry Weight Corrected"													
Strontium-90	U	0.0349	+/-0.0546	0.0954	0.400	pCi/g			JXC9	11/06/19	1526	1933654	1

The following Prep Methods were performed:

Method	Description	Analyst	Date	Time	Prep Batch
Dry Soil Prep	Dry Soil Prep GL-RAD-A-021	CXB7	10/22/19	1034	1929603

The following Analytical Methods were performed:

Method	Description	Analyst Comments
1	EPA 905.0 Modified/DOE RP501 Rev. 1 Modified	

Surrogate/Tracer Recovery	Test	Result	Nominal	Recovery%	Acceptable Limits
Strontium Carrier	GFPC, Sr90, Solid "Dry Weight Corrected"			97.2	(25%-125%)

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

Column headers are defined as follows:

DF: Dilution Factor	Lc/LC: Critical Level
DL: Detection Limit	PF: Prep Factor
MDA: Minimum Detectable Activity	RL: Reporting Limit
MDC: Minimum Detectable Concentration	SQL: Sample Quantitation Limit

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Report Date: November 14, 2019

Page 1 of 7

LaCrosseSolutions  
S4601 State Hwy 35  
Genoa, Wisconsin

Contact: Mr. Jason Q. Spaide

Workorder: 493624

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<hr/>											
Rad Alpha Spec											
Batch	1929693										
QC1204411092	493624001	DUP									
Americium-241	HUh	0.0084	HU	0.0166	pCi/g	N/A			N/AHAKB	11/06/19	09:53
	Uncertainty	+/-0.0467		+/-0.0457							
Americium-243	HUh	0.0346	HU	-0.012	pCi/g	N/A			N/A		
	Uncertainty	+/-0.0974		+/-0.0532							
Curium-243/244	HUh	-0.00429	HU	-0.0069	pCi/g	N/A			N/A		
	Uncertainty	+/-0.037		+/-0.0305							
QC1204411093	LCS										
Americium-241	1.92			1.99	pCi/g		104	(75%-125%)		11/07/19	09:18
	Uncertainty			+/-0.348							
Americium-243			U	0.00469	pCi/g			(75%-125%)			
	Uncertainty			+/-0.0491							
Curium-243/244	2.26			2.33	pCi/g		103	(75%-125%)			
	Uncertainty			+/-0.373							
QC1204411091	MB										
Americium-241			U	0.014	pCi/g					11/06/19	09:53
	Uncertainty			+/-0.0279							
Americium-243			U	0.0163	pCi/g						
	Uncertainty			+/-0.0371							
Curium-243/244			U	0.00352	pCi/g						
	Uncertainty			+/-0.0196							
<hr/>											
Batch	1929694										
QC1204411095	493624003	DUP									
Neptunium-237	HUh	0.00372	HU	0.00341	pCi/g	N/A			N/AHAKB	11/11/19	14:07
	Uncertainty	+/-0.00542		+/-0.00442							
QC1204411096	LCS										
Neptunium-237	0.869			1.01	pCi/g		116	(75%-125%)		11/11/19	14:07
	Uncertainty			+/-0.0485							
QC1204411094	MB										
Neptunium-237			U	-0.000288	pCi/g					11/11/19	14:07
	Uncertainty			+/-0.00229							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 493624

Page 2 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Alpha Spec</b>											
Batch	1929695										
QC1204411098	493624001	DUP									
Plutonium-238	HUh	0.00487	HU	0.0052	pCi/g	N/A		N/AHAKB		11/06/19	09:53
	Uncertainty	+/-0.0271		+/-0.0366							
Plutonium-239/240	HUh	-0.00402	HU	-0.00169	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0278		+/-0.0254							
QC1204411099	LCS										
Plutonium-238			U	-0.00294	pCi/g					11/06/19	09:53
	Uncertainty			+/-0.0203							
Plutonium-239/240	1.96			2.06	pCi/g		105	(75%-125%)			
	Uncertainty			+/-0.231							
QC1204411097	MB										
Plutonium-238			U	0.00862	pCi/g					11/06/19	09:53
	Uncertainty			+/-0.0295							
Plutonium-239/240			U	0.00663	pCi/g						
	Uncertainty			+/-0.0297							
Batch	1929696										
QC1204411101	493624001	DUP									
Plutonium-241	HUh	-1.25	HU	-2.36	pCi/g	N/A		N/AHAKB		11/09/19	17:00
	Uncertainty	+/-2.38		+/-2.42							
QC1204411102	LCS										
Plutonium-241	162			155	pCi/g		95.5	(75%-125%)		11/09/19	19:02
	Uncertainty			+/-4.78							
QC1204411100	MB										
Plutonium-241			U	-0.546	pCi/g					11/09/19	14:59
	Uncertainty			+/-1.98							
<b>Rad Gamma Spec</b>											
Batch	1929624										
QC1204410975	493624001	DUP									
Cesium-137	Hh	0.113	H	0.0865	pCi/g	26.4		(0% - 100%)	MXR1	11/01/19	06:24
	Uncertainty	+/-0.0594		+/-0.0561							
Cobalt-60	HUh	0.036	HU	0.0428	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0349		+/-0.0446							
Europium-152	HUh	-0.00616	HU	0.070	pCi/g	N/A		N/A			
	Uncertainty	+/-0.0669		+/-0.0644							



# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 493624

Page 3 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Gamma Spec</b>											
Batch	1929624										
Europium-154	HUh	-0.0128	HU	-0.0196	pCi/g	N/A			N/A MXR1	11/01/19	06:24
	Uncertainty	+/-0.0717		+/-0.109							
Europium-155	HUh	0.0587	HU	0.0597	pCi/g	N/A			N/A		
	Uncertainty	+/-0.0622		+/-0.088							
Niobium-94	HUh	0.0376	HU	-0.0216	pCi/g	N/A			N/A		
	Uncertainty	+/-0.0275		+/-0.0246							
QC1204410976	LCS										
Americium-241	487			512	pCi/g		105	(75%-125%)		11/01/19	06:24
	Uncertainty			+/-6.27							
Cesium-137	167			166	pCi/g		99.4	(75%-125%)			
	Uncertainty			+/-3.92							
Cobalt-60	107			106	pCi/g		98.5	(75%-125%)			
	Uncertainty			+/-3.73							
Europium-152			U	-1.13	pCi/g						
	Uncertainty			+/-1.44							
Europium-154			U	-0.069	pCi/g						
	Uncertainty			+/-1.07							
Europium-155			U	-1.32	pCi/g						
	Uncertainty			+/-1.03							
Niobium-94			U	-0.276	pCi/g						
	Uncertainty			+/-0.508							
QC1204410974	MB										
Cesium-137			U	0.00323	pCi/g					11/01/19	06:23
	Uncertainty			+/-0.0103							
Cobalt-60			U	0.0164	pCi/g						
	Uncertainty			+/-0.0236							
Europium-152			U	0.0135	pCi/g						
	Uncertainty			+/-0.0399							
Europium-154			U	0.0106	pCi/g						
	Uncertainty			+/-0.0612							
Europium-155			U	-0.00293	pCi/g						
	Uncertainty			+/-0.0231							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 493624

Page 4 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Gamma Spec</b>											
Batch	1929624										
Niobium-94			U	0.00978	pCi/g				MXR1	11/01/19	06:23
	Uncertainty			+/-0.020							
<hr/>											
Batch	1931847										
QC1204415727	493624001	DUP									
Nickel-59	HUh	-0.18	HU	-0.803	pCi/g	N/A			N/A	TXJ1	10/30/19 10:43
	Uncertainty	+/-1.68		+/-1.60							
QC1204415728	LCS										
Nickel-59	90.3			73.2	pCi/g		81.1	(75%-125%)			10/30/19 10:44
	Uncertainty			+/-6.52							
QC1204415726	MB										
Nickel-59			U	-0.45	pCi/g						10/30/19 10:43
	Uncertainty			+/-1.04							
<hr/>											
<b>Rad Gas Flow</b>											
Batch	1933651										
QC1204420255	493624005	DUP									
Strontium-90	HUh	-0.0141	HU	-0.134	pCi/g	N/A			N/A	JXC9	11/06/19 14:18
	Uncertainty	+/-0.058		+/-0.105							
QC1204420256	LCS										
Strontium-90	5.40			4.94	pCi/g		91.4	(75%-125%)			11/06/19 14:20
	Uncertainty			+/-0.313							
QC1204420254	MB										
Strontium-90			U	-0.00246	pCi/g						11/06/19 14:18
	Uncertainty			+/-0.0478							
<hr/>											
Batch	1933654										
QC1204420263	493624025	DUP									
Strontium-90	U	0.0836	U	0.0226	pCi/g	N/A			N/A	JXC9	11/06/19 15:26
	Uncertainty	+/-0.0864		+/-0.0608							
QC1204420264	LCS										
Strontium-90	5.51			6.75	pCi/g		122	(75%-125%)			11/07/19 06:45
	Uncertainty			+/-0.356							
QC1204420262	MB										
Strontium-90			U	-0.02	pCi/g						11/06/19 15:26
	Uncertainty			+/-0.0423							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 493624

Page 5 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Liquid Scintillation</b>											
Batch	1929721										
QC1204411179	493624001	DUP									
Tritium	HU	1.65	HU	-3.61	pCi/g	N/A		N/A	EW3	10/30/19	06:58
	Uncertainty	+/-5.62		+/-5.09							
QC1204411181	LCS										
Tritium	142			152	pCi/g		107	(75%-125%)		10/29/19	07:49
	Uncertainty			+/-17.1							
QC1204411178	MB										
Tritium			U	0.00583	pCi/g					10/29/19	05:50
	Uncertainty			+/-4.35							
QC1204411180	493624001	MS									
Tritium	171 HU	1.65	H	138	pCi/g		80.3	(75%-125%)		10/29/19	07:33
	Uncertainty	+/-5.62		+/-17.9							
Batch	1929739										
QC1204411223	493624001	DUP									
Technetium-99	HU	-0.00734	HU	0.523	pCi/g	N/A		N/A	JJ3	11/06/19	04:42
	Uncertainty	+/-0.483		+/-0.575							
QC1204411224	LCS										
Technetium-99	38.8			37.5	pCi/g		96.7	(75%-125%)		11/06/19	05:25
	Uncertainty			+/-2.62							
QC1204411222	MB										
Technetium-99			U	0.488	pCi/g					11/06/19	04:00
	Uncertainty			+/-0.492							
Batch	1931683										
QC1204415380	493624001	DUP									
Iron-55	HUh	-1.57	HU	-9.54	pCi/g	N/A		N/A	RP1	11/01/19	21:31
	Uncertainty	+/-12.1		+/-8.16							
QC1204415381	LCS										
Iron-55	75.4			73.8	pCi/g		97.8	(75%-125%)		10/31/19	18:25
	Uncertainty			+/-4.98							
QC1204415379	MB										
Iron-55			U	2.24	pCi/g					10/31/19	16:19
	Uncertainty			+/-3.57							

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 493624

Page 6 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
<b>Rad Liquid Scintillation</b>											
Batch	1931689										
QC1204415395	493624001	DUP									
Nickel-63	HUh	-0.424	HU	-0.114	pCi/g	N/A		N/A	RP1	10/30/19	14:46
	Uncertainty	+/-1.17		+/-1.26							
QC1204415396	LCS										
Nickel-63	70.5			60.2	pCi/g		85.4	(75%-125%)		10/30/19	15:03
	Uncertainty			+/-3.12							
QC1204415394	MB										
Nickel-63			U	-0.312	pCi/g					10/30/19	14:30
	Uncertainty			+/-1.36							
Batch	1934551										
QC1204422492	493624001	DUP									
Carbon-14	HU	1.92	HU	1.76	pCi/g	N/A		N/A	TXP3	11/08/19	22:21
	Uncertainty	+/-1.76		+/-1.72							
QC1204422494	LCS										
Carbon-14	128			125	pCi/g		97.6	(75%-125%)		11/08/19	23:55
	Uncertainty			+/-3.84							
QC1204422491	MB										
Carbon-14			U	1.00	pCi/g					11/09/19	12:08
	Uncertainty			+/-1.18							
QC1204422493	493624001	MS									
Carbon-14	150 HU	1.92	H	146	pCi/g		97.3	(75%-125%)		11/08/19	23:08
	Uncertainty	+/-1.76		+/-4.51							

### Notes:

Counting Uncertainty is calculated at the 95% confidence level (1.96-sigma).

The Qualifiers in this report are defined as follows:

- \*\* Analyte is a Tracer compound
- < Result is less than value reported
- > Result is greater than value reported
- BD Results are either below the MDC or tracer recovery is low
- FA Failed analysis.
- H Analytical holding time was exceeded
- J See case narrative for an explanation
- J Value is estimated
- K Analyte present. Reported value may be biased high. Actual value is expected to be lower.
- L Analyte present. Reported value may be biased low. Actual value is expected to be higher.

# GEL LABORATORIES LLC

2040 Savage Road Charleston, SC 29407 - (843) 556-8171 - www.gel.com

## QC Summary

Workorder: 493624

Page 7 of 7

Parmname	NOM	Sample	Qual	QC	Units	RPD%	REC%	Range	Anlst	Date	Time
M	M if above MDC and less than LLD										
M	REMP Result > MDC/CL and < RDL										
N/A	RPD or %Recovery limits do not apply.										
N1	See case narrative										
ND	Analyte concentration is not detected above the detection limit										
NJ	Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier										
Q	One or more quality control criteria have not been met. Refer to the applicable narrative or DER.										
R	Sample results are rejected										
U	Analyte was analyzed for, but not detected above the MDL, MDA, MDC or LOD.										
UI	Gamma Spectroscopy--Uncertain identification										
UJ	Gamma Spectroscopy--Uncertain identification										
UL	Not considered detected. The associated number is the reported concentration, which may be inaccurate due to a low bias.										
X	Consult Case Narrative, Data Summary package, or Project Manager concerning this qualifier										
Y	Other specific qualifiers were required to properly define the results. Consult case narrative.										
^	RPD of sample and duplicate evaluated using +/-RL. Concentrations are <5X the RL. Qualifier Not Applicable for Radiochemistry.										
h	Preparation or preservation holding time was exceeded										

N/A indicates that spike recovery limits do not apply when sample concentration exceeds spike conc. by a factor of 4 or more or %RPD not applicable.

^ The Relative Percent Difference (RPD) obtained from the sample duplicate (DUP) is evaluated against the acceptance criteria when the sample is greater than five times (5X) the contract required detection limit (RL). In cases where either the sample or duplicate value is less than 5X the RL, a control limit of +/- the RL is used to evaluate the DUP result.

\* Indicates that a Quality Control parameter was not within specifications.

For PS, PSD, and SDILT results, the values listed are the measured amounts, not final concentrations.

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless qualified on the QC Summary.

**Radiochemistry  
Technical Case Narrative  
LaCrosseSolutions, LLC  
SDG #: 493624**

**Product:** Alphaspec Isotopic Am241 Am243, Cm243/244, Solid

**Analytical Method:** DOE EML HASL-300, Am-05-RC Modified

**Analytical Procedure:** GL-RAD-A-011 REV# 27

**Analytical Batch:** 1929693

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204411091	Method Blank (MB)
1204411092	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204411093	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information**

**Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

Sample	Value
1204411092 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Recounts**

The Am-243 traced portion of sample 493624003 (L3-012-101-RBGS-004-SS) was recounted due to a suspected false positive. The recount is reported.

**Product: Alphaspec Np, Solid**

**Analytical Method:** ASTM C 1475-00 Modified

**Analytical Procedure:** GL-RAD-A-032 REV# 22

**Analytical Batch:** 1929694

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204411094	Method Blank (MB)
1204411095	493624003(L3-012-101-RBGS-004-SS) Sample Duplicate (DUP)
1204411096	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information****Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204411095 (L3-012-101-RBGS-004-SSDUP)	Received 21-OCT-19, out of holding 12-APR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17

**Product:** Alphaspec Pu238, 239/240, Solid

**Analytical Method:** DOE EML HASL-300, Pu-11-RC Modified

**Analytical Procedure:** GL-RAD-A-011 REV# 27

**Analytical Batch:** 1929695

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b>GEL Sample ID#</b>	<b>Client Sample Identification</b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204411097	Method Blank (MB)
1204411098	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204411099	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Technical Information**

##### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204411098 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17



**Recounts**

Samples 493624004 (L3-012-101-RBGS-007-SS) and 493624005 (L4-OFF-SOL-IJGS-A01-SS NE) were recounted due to a peak shift. The recounts are reported.

**Miscellaneous Information****Additional Comments**

The tracer peak centroid for sample 493624005 (L4-OFF-SOL-IJGS-A01-SS NE) is greater than 50 keV from the expected library energy value for the tracer; however, the tracer yield requirement was met and the tracer peak is within the tracer region of interest.

**Product: Dry Weight**

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
493624007	S3-012-109B-FJGS-062-SM
493624008	S3-012-109B-FJGS-063-SM
493624009	S3-012-109B-FJGS-064-SM
493624010	L2-011-101-FSGS-013-SS
493624011	L2-011-104-FSGS-001-SS
493624012	L2-011-104-FSGS-010-SS
493624013	L3-012-101-FSGS-004-SS
493624014	L3-012-109-FSGS-005-SS
493624015	L3-012-109-FSGS-006-SS
493624016	L3-012-109-FSGS-011-SS
493624017	L1-010-107-FSGS-008-SS
493624018	L1-010-101-FSGS-015-SS
493624019	L1-010-102-FSGS-007-SS
493624020	L1-010-103-FSGS-005-SS

The samples in this SDG were analyzed on an "as received" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Dry Weight

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929603

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624021	L1-010-104-FSGS-016-SS
493624022	L1-010-105-FSGS-007-SS
493624023	L2-011-101-FSGS-005-SS
493624024	L2-011-104-FSGS-011-SS
493624025	L3-012-101-FSGS-005-SS
493624026	L3-012-109-FSGS-014-SS
493624027	L3-012-109-FSGS-017-SS
493624028	L1-PAD-GR5-AJGS-006-SS
493624029	L1-PAD-GR10-AJGS-007-SS

The samples in this SDG were analyzed on an "as received" basis.

**Data Summary:**

There are no exceptions, anomalies or deviations from the specified methods. All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable.

**Product:** Gamma, Cs137, Co60, Nb94, Eu152, Eu154, Eu155

**Analytical Method:** DOE HASL 300, 4.5.2.3/Ga-01-R

**Analytical Procedure:** GL-RAD-A-013 REV# 27

**Analytical Batch:** 1929624

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204410974	Method Blank (MB)
1204410975	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204410976	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information****Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

Sample	Value
1204410975 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Product:** Gamma Ni59, Solid

**Analytical Method:** DOE RESL Ni-1

**Analytical Procedure:** GL-RAD-A-022 REV# 19

**Analytical Batch:** 1931847

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204415726	Method Blank (MB)
1204415727	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204415728	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

### **Technical Information**

#### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

Sample	Value
1204415727 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Product:** GFPC, Sr90, Solid

**Analytical Method:** EPA 905.0 Modified/DOE RP501 Rev. 1 Modified

**Analytical Procedure:** GL-RAD-A-004 REV# 21

**Analytical Batch:** 1933651

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
493624007	S3-012-109B-FJGS-062-SM
493624008	S3-012-109B-FJGS-063-SM
493624009	S3-012-109B-FJGS-064-SM
493624010	L2-011-101-FSGS-013-SS
493624011	L2-011-104-FSGS-001-SS
493624012	L2-011-104-FSGS-010-SS
493624013	L3-012-101-FSGS-004-SS

493624014	L3-012-109-FSGS-005-SS
493624015	L3-012-109-FSGS-006-SS
1204420254	Method Blank (MB)
1204420255	493624005(L4-OFF-SOL-IJGS-A01-SS NE) Sample Duplicate (DUP)
1204420256	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Technical Information**

##### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

Sample	Value
1204420255 (L4-OFF-SOL-IJGS-A01-SS NEDUP)	Received 21-OCT-19, out of holding 31-OCT-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

##### **Recounts**

Samples 493624002 (L3-012-101-RAGS-004-SS) and 493624012 (L2-011-104-FSGS-010-SS) were recounted due to results more negative than the three sigma TPU. The second counts are reported.

##### **Product:** GFPC, Sr90, Solid

**Analytical Method:** EPA 905.0 Modified/DOE RP501 Rev. 1 Modified

**Analytical Procedure:** GL-RAD-A-004 REV# 21

**Analytical Batch:** 1933654

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batches:** 1929602 and 1929603

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624016	L3-012-109-FSGS-011-SS
493624017	L1-010-107-FSGS-008-SS

493624018	L1-010-101-FSGS-015-SS
493624019	L1-010-102-FSGS-007-SS
493624020	L1-010-103-FSGS-005-SS
493624021	L1-010-104-FSGS-016-SS
493624022	L1-010-105-FSGS-007-SS
493624023	L2-011-101-FSGS-005-SS
493624024	L2-011-104-FSGS-011-SS
493624025	L3-012-101-FSGS-005-SS
493624026	L3-012-109-FSGS-014-SS
493624027	L3-012-109-FSGS-017-SS
493624028	L1-PAD-GR5-AJGS-006-SS
493624029	L1-PAD-GR10-AJGS-007-SS
1204420262	Method Blank (MB)
1204420263	493624025(L3-012-101-FSGS-005-SS) Sample Duplicate (DUP)
1204420264	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Technical Information**

##### **Recounts**

Sample 1204420264 (LCS) was recounted due to high recovery. The recount is reported.

##### **Product: Liquid Scint Pu241, Solid**

**Analytical Method:** DOE EML HASL-300, Pu-11-RC Modified

**Analytical Procedure:** GL-RAD-A-035 REV# 21

**Analytical Batch:** 1929696

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204411100	Method Blank (MB)
1204411101	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204411102	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Quality Control (QC) Information**

##### **RDL Met**

Sample (see below) did not meet the detection limit due to a lower sample yield. The client yield requirement was met. The sample was counted the maximum count time in order to achieve the lowest possible MDAs.

Sample	Analyte	Value
493624003 (L3-012-101-RBGS-004-SS)	Plutonium-241	Result -2.96 < MDA 5.69 > RDL 5 pCi/g

#### **Technical Information**

##### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

Sample	Value
1204411101 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

#### **Miscellaneous Information**

##### **Additional Comments**

The tracer peak centroid for sample 493624005 (L4-OFF-SOL-IJGS-A01-SS NE) is greater than 50 keV from the expected library energy value for the tracer; however, the tracer yield requirement was met and the tracer peak is within the tracer region of interest.

**Product:** LSC, Tritium Distillation, Solid

**Analytical Method:** EPA 906.0 Modified

**Analytical Procedure:** GL-RAD-A-002 REV# 23

**Analytical Batch:** 1929721

The following samples were analyzed using the above methods and analytical procedure(s).

<u>GEL Sample ID#</u>	<u>Client Sample Identification</u>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204411178	Method Blank (MB)
1204411179	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204411180	493624001(L3-012-101-RAGS-002-SS) Matrix Spike (MS)
1204411181	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Technical Information**

##### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204411179 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
1204411180 (L3-012-101-RAGS-002-SSMS)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

##### **Recounts**

Samples 1204411179 (L3-012-101-RAGS-002-SSDUP) and 493624004 (L3-012-101-RBGS-007-SS) were recounted due to high MDCs. The recounts are reported.

##### **Product: Liquid Scint Tc99, Solid**

**Analytical Method:** DOE EML HASL-300, Tc-02-RC Modified

**Analytical Procedure:** GL-RAD-A-059 REV# 5

**Analytical Batch:** 1929739



The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204411222	Method Blank (MB)
1204411223	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204411224	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information**

**Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204411223 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Product:** Liquid Scint Fe55, Solid

**Analytical Method:** DOE RESL Fe-1, Modified

**Analytical Procedure:** GL-RAD-A-040 REV# 13

**Analytical Batch:** 1931683

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204415379	Method Blank (MB)
1204415380	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204415381	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Quality Control (QC) Information**

##### **RDL Met**

Samples (see below) did not meet the detection limits. Samples were counted the maximum count time in order to achieve the lowest MDAs possible.

<b>Sample</b>	<b>Analyte</b>	<b>Value</b>
1204415380 (L3-012-101-RAGS-002-SSDUP)	Iron-55	Result -9.54 < MDA 12.4 > RDL 10 pCi/g
493624001 (L3-012-101-RAGS-002-SS)	Iron-55	Result -1.57 < MDA 18.7 > RDL 10 pCi/g
493624002 (L3-012-101-RAGS-004-SS)	Iron-55	Result -8.13 < MDA 16.8 > RDL 10 pCi/g
493624003 (L3-012-101-RBGS-004-SS)	Iron-55	Result -3.06 < MDA 16.7 > RDL 10 pCi/g
493624004 (L3-012-101-RBGS-007-SS)	Iron-55	Result -2.34 < MDA 14.1 > RDL 10 pCi/g
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Iron-55	Result -2.65 < MDA 12.7 > RDL 10 pCi/g

#### **Technical Information**

##### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204415380 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Recounts**

Samples 1204415380 (L3-012-101-RAGS-002-SSDUP), 493624001 (L3-012-101-RAGS-002-SS), 493624002 (L3-012-101-RAGS-004-SS), 493624003 (L3-012-101-RBGS-004-SS), 493624004 (L3-012-101-RBGS-007-SS), 493624005 (L4-OFF-SOL-IJGS-A01-SS NE) and 493624006 (L4-OFF-SOL-IJGS-A03-SS SW) were recounted due to high MDCs. The recounts are reported.

**Product: Liquid Scint Ni63, Solid**

**Analytical Method:** DOE RESL Ni-1, Modified

**Analytical Procedure:** GL-RAD-A-022 REV# 19

**Analytical Batch:** 1931689

**Preparation Method:** Dry Soil Prep

**Preparation Procedure:** GL-RAD-A-021 REV# 23

**Preparation Batch:** 1929602

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204415394	Method Blank (MB)
1204415395	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204415396	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on a "dry weight" basis.

**Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

**Technical Information****Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204415395 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17

493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Product:** Liquid Scint C14, Solid

**Analytical Method:** EPA EERF C-01 Modified

**Analytical Procedure:** GL-RAD-A-003 REV# 16

**Analytical Batch:** 1934551

The following samples were analyzed using the above methods and analytical procedure(s).

<b><u>GEL Sample ID#</u></b>	<b><u>Client Sample Identification</u></b>
493624001	L3-012-101-RAGS-002-SS
493624002	L3-012-101-RAGS-004-SS
493624003	L3-012-101-RBGS-004-SS
493624004	L3-012-101-RBGS-007-SS
493624005	L4-OFF-SOL-IJGS-A01-SS NE
493624006	L4-OFF-SOL-IJGS-A03-SS SW
1204422491	Method Blank (MB)
1204422492	493624001(L3-012-101-RAGS-002-SS) Sample Duplicate (DUP)
1204422493	493624001(L3-012-101-RAGS-002-SS) Matrix Spike (MS)
1204422494	Laboratory Control Sample (LCS)

The samples in this SDG were analyzed on an "as received" basis.

#### **Data Summary:**

All sample data provided in this report met the acceptance criteria specified in the analytical methods and procedures for initial calibration, continuing calibration, instrument controls and process controls where applicable, with the following exceptions.

#### **Technical Information**

##### **Holding Time**

Samples (See Below) were received and analyzed outside the hold time.

<b>Sample</b>	<b>Value</b>
1204422492 (L3-012-101-RAGS-002-SSDUP)	Received 21-OCT-19, out of holding 07-MAR-17
1204422493 (L3-012-101-RAGS-002-SSMS)	Received 21-OCT-19, out of holding 07-MAR-17
493624001 (L3-012-101-RAGS-002-SS)	Received 21-OCT-19, out of holding 07-MAR-17
493624002 (L3-012-101-RAGS-004-SS)	Received 21-OCT-19, out of holding 12-MAR-17
493624003 (L3-012-101-RBGS-004-SS)	Received 21-OCT-19, out of holding 12-APR-17
493624004 (L3-012-101-RBGS-007-SS)	Received 21-OCT-19, out of holding 22-APR-17
493624005 (L4-OFF-SOL-IJGS-A01-SS NE)	Received 21-OCT-19, out of holding 31-OCT-17
493624006 (L4-OFF-SOL-IJGS-A03-SS SW)	Received 21-OCT-19, out of holding 31-OCT-17

**Recounts**

Samples 493624002 (L3-012-101-RAGS-004-SS) and 493624006 (L4-OFF-SOL-IJGS-A03-SS SW) were recounted to verify sample results. Recounts are reported.

**Certification Statement**

Where the analytical method has been performed under NELAP certification, the analysis has met all of the requirements of the NELAC standard unless otherwise noted in the analytical case narrative.

Page: _____ of _____ Project # LACBWR Site GEL Quote #: COC Number (1): PO Number: 672583		<div>GEL Laboratories LLC <small>Chemistry   Radiochemistry   Radiobiology   Specialty Analytics</small></div> <b>Chain of Custody and Analytical Request</b>										GEL Laboratories, LLC 2040 Savage Road Charleston, SC 29407 Phone: (843) 556-8171 Fax: (843) 766-1178											
Client Name: La Crosse Solutions Phone # 608-689-4259										Sample Analysis Requested (5) (Fill in the number of containers for each test)													
Project/Site Name: LACBWR-Genoa WI Fax #										<-- Preservative Type (6)													
Address: 54601 State Road 35																							
Collected By: Kevin L Murray Send Results To: Scott Zoller sgzoller@energysolutions.com																							
Sample ID <small>* For composites - indicate start and stop date/time</small>		Date Collected <small>(mm-dd-yy)</small>	Time Collected <small>(Military) (hh:mm)</small>	QC Code (1)	Field Filtered (3)	Sample Matrix (4)	Radiactive <small>(if yes, please supply isotope info.)</small>	Known or Possible Hazards <small>(7)</small>	Total number of containers	Sr90	Ni59, Co60, Nb94	Cs137, Eu152, Eu154	Eu155, Pu241	H3, C14, Fe55	Ni63, Tc99	Pu237, Pu238	Pu239, Pu240	Am241, Am243	Cm243, Cm244	Comments <small>Note: extra sample is required for sample specific QC</small>			
L3-012-101-RAGS-002-SS		09/08/16	11:05	N	N	SO	N	N	1	1	1	1	1	1	1	1	1	1	1	MDC <0.01 pCi Np-237			
L3-012-101-RAGS-004-SS		09/13/16	11:00	N	N	SO	N	N	1	1	1	1	1	1	1	1	1	1	1	MDC <0.01 pCi Np-237			
L3-012-101-RBGGS-004-SS		10/14/16	9:02	N	N	SO	N	N	1	1	1	1	1	1	1	1	1	1	1	MDC <0.01 pCi Np-237			
L3-012-101-RBGGS-007-SS		10/24/16	9:05	N	N	SO	N	N	1	1	1	1	1	1	1	1	1	1	1	MDC <0.01 pCi Np-237			
L4-OFF-SOL-IJGS-A01-SS NE		05/04/17	8:25	N	N	SO	N	N	1	1	1	1	1	1	1	1	1	1	1	MDC <0.01 pCi Np-237			
L4-OFF-SOL-IJGS-A03-SS SW		05/04/17	9:30	N	N	SO	N	N	1	1	1	1	1	1	1	1	1	1	1	MDC <0.01 pCi Np-237			
Chain of Custody Signatures										TAT Requested: Normal: X Rush: Specify: (Subject to Surcharge)													
Relinquished By (Signed)		Date	Time	Received by (signed)		Date	Time	Fax Results: [ ] Yes [X] No															
1. Kevin L Murray		10/16/2019	1315	A. Olson		10/24/19	8:40	Select Deliverable: [ ] C of A [ ] QC Summary [ ] level 1 [X] Level 2 [ ] Level 3 [ ] Level 4															
2				2				Additional Remarks: None															
3				3				For Lab Receiving Use Only: Custody Seal Intact? [ ] Yes [ ] No Cooler Temp: °C															
> For sample shipping and delivery details, see Sample Receipt & Review form (SRR.)										Sample Collection Time Zone: [ ] Eastern [ ] Pacific [X] Central [ ] Mountain [ ] Other:													
1.) Chain of Custody Number = Client Determined																							
2.) QC Codes: N = Normal Sample, TB = Trip Blank, FD = Field Duplicate, EB = Equipment Blank, MS = Matrix Spike Sample, MSD = Matrix Spike Duplicate Sample, G = Grab, C = Composite																							
3.) Field Filtered: For liquid matrices, indicate with a - Y - for yes the sample was field filtered or - N - for sample was not field filtered.																							
4.) Matrix Codes: DW=Drinking Water, GW=Groundwater, SW=Surface Water, WW=Waste Water, W=Water, ML=Misc Liquid, SO=Soil, SD=Sediment, SL=Sludge, SS=Solid Waste, O=Oil, F=Filter, P=Wipe, U=Urine, F=Fecal, N=Nasal																							
5.) Sample Analysis Requested: Analytical method requested (i.e. 8260B, 6010B/7470A) and number of containers provided for each (i.e. 8260B - 3, 6010B/7470A - 1).																							
6.) Preservative Type: HA = Hydrochloric Acid, NI = Nitric Acid, SH = Sodium Hydroxide, SA = Sulfuric Acid, AA = Ascorbic Acid, HX = Hexane, ST = Sodium Thiosulfate, If no preservative is added = leave field blank																							
7.) KNOWN OR POSSIBLE HAZARDS				Characteristic Hazards				Listed Waste				Other				Please provide any additional details below regarding handling and/or disposal concerns. (i.e.: Origin of sample(s), type of site collected from, odd matrices, etc.)							
RCRA Metals				FL = Flammable/Ignitable				LW = Listed Waste				OT = Other / Unknown											
As = Arsenic Hg = Mercury				CO = Corrosive				(F,K,P and U-listed wastes.)				(i.e.: High/low pH, asbestos, beryllium, irritants, other misc. health hazards, etc.)											
Ba = Barium Se = Selenium				RE = Reactive				Waste code(s):				Description:											
Cd = Cadmium Ag = Silver				TSCA Regulated																			
Cr = Chromium MR = Misc. RCRA metals				PCB = Polychlorinated biphenyls																			
Pb = Lead																							

Page: 2 of 4		<div><div>GEL</div><div>Laboratories LLC</div><div>Chemistry   Radiochemistry   Radiobiology   Specialty Analytics</div></div>		GEL Laboratories, LLC 2040 Savage Road Charleston, SC 29407 Phone: (843) 556-8171 Fax: (843) 766-1178															
Project # LACBWR Site		GEL Quote #:		COC Number (1)															
PO Number: 672583		GEL Work Order Number:		GEL Project Manager:															
Client Name: La Crosse Solutions		Phone # 608-689-4259		Sample Analysis Requested (5) (Fill in the number of containers for each test)															
Project/Site Name: LACBWR-Genoa WI		Fax #		<-- Preservative Type (6)															
Address: 54601 State Road 35		Should this sample be considered:		Comments															
Collected By: Kevin L Murray		Send Results To: Scott Zoller sgzoller@energysolutions.com		Note: extra sample is required for sample specific QC															
Sample ID	*Date Collected	*Time Collected	QC Code	Field Filtered	Sample Matrix	Radiactive	(7) Known or possible Hazards	Total number of containers	Sr90										
* For composites - indicate start and stop date/time																			
S3-012-109B-FJGS-062-SM	08/22/19	10:05	N	N	SO	N	N	1	1										
S3-012-109B-FJGS-063-SM	08/22/19	10:14	N	N	SO	N	N	1	1										
S3-012-109B-FJGS-064-SM	08/22/19	13:12	N	N	SO	N	N	1	1										
L2-011-101-FSGS-013-SS	09/20/19	10:43	N	N	SO	N	N	1	1										
L2-011-104-FSGS-001-SS	09/09/19	14:08	N	N	SO	N	N	1	1										
L2-011-104-FSGS-010-SS	09/09/19	14:46	N	N	SO	N	N	1	1										
L3-012-101-FSGS-004-SS	09/05/19	8:58	N	N	SO	N	N	1	1										
L3-012-109-FSGS-005-SS	09/24/19	8:05	N	N	SO	N	N	1	1										
L3-012-109-FSGS-006-SS	09/24/19	10:36	N	N	SO	N	N	1	1										
L3-012-109-FSGS-011-SS	09/23/19	14:09	N	N	SO	N	N	1	1										
Chain of Custody Signatures										TAT Requested: Normal: X Rush: Specify: (Subject to Surcharge)									
Relinquished By (Signed) Date Time			Received by (signed) Date Time			Fax Results: [ ] Yes [X] No													
1. Kevin L Murray 10/16/2019 1315			1 A. Almer 10/21/19 8:40			Select Deliverable: [ ] C of A [ ] QC Summary [ ] Level 1 [X] Level 2 [ ] Level 3 [ ] Level 4													
2			2			Additional Remarks: None													
3			3			For Lab Receiving Use Only: Custody Seal Intact? [ ] Yes [ ] No Cooler Temp: °C													
> For sample shipping and delivery details, see Sample Receipt & Review form (SRR.)										Sample Collection Time Zone: [ ] Eastern [ ] Pacific [X] Central [ ] Mountain [ ] Other:									
1.) Chain of Custody Number = Client Determined																			
2.) QC Codes: N = Normal Sample, TB = Trip Blank, FD = Field Duplicate, EB = Equipment Blank, MS = Matrix Spike Sample, MSD = Matrix Spike Duplicate Sample, G = Grab, C = Composite																			
3.) Field Filtered: For liquid matrices, indicate with a - Y - for yes the sample was field filtered or - N - for sample was not field filtered.																			
4.) Matrix Codes: DW=Drinking Water, GW=Groundwater, SW=Surface Water, WW=Waste Water, W=Water, ML=Misc Liquid, SO=Soil, SD=Sediment, SL=Sludge, SS=Solid Waste, O=Oil, F=Filter, P=Wipe, U=Urine, F=Fecal, N=Nasal																			
5.) Sample Analysis Requested: Analytical method requested (i.e. 8260B, 6010B/7470A) and number of containers provided for each (i.e. 8260B - 3, 6010B/7470A - 1).																			
6.) Preservative Type: HA = Hydrochloric Acid, NI = Nitric Acid, SH = Sodium Hydroxide, SA = Sulfuric Acid, AA = Ascorbic Acid, HX = Hexane, ST = Sodium Thiosulfate, If no preservative is added = leave field blank																			
7.) KNOWN OR POSSIBLE HAZARDS																			
Characteristic Hazards					Listed Waste					Other					Please provide any additional details below regarding handling and/or disposal concerns. (i.e.: Origin of sample(s), type of site collected from, odd matrices, etc.)				
FL = Flammable/Ignitable					LW = Listed Waste					OT = Other / Unknown									
CO = Corrosive					(F,K,P and U-listed wastes.)					(i.e.: High/low pH, asbestos, beryllium, irritants, other misc. health hazards, etc.)									
RE = Reactive					Waste code(s):					Description:									
RCRA Metals					TSCA Regulated														
As = Arsenic Hg= Mercury					PCB = Polychlorinated														
Ba = Barium Se= Selenium					biphenyls														
Cd = Cadmium Ag= Silver																			
Cr = Chromium MR= Misc. RCRA metals																			
Pb = Lead																			



493624

Page: <u>3</u> of <u>4</u>		<b>Laboratories LLC</b> <small>Chemistry   Radiochemistry   Radioassay   Specialty Analytics</small> <b>Chain of Custody and Analytical Request</b>		GEL Laboratories, LLC 2040 Savage Road Charleston, SC 29407 Phone: (843) 556-8171 Fax: (843) 766-1178			
Project # <u>LACBWR</u> Site							
GEL Quote #:							
COC Number <sup>(1)</sup> :							
PO Number: 672583		<b>GEL Work Order Number:</b> _____		<b>GEL Project Manager:</b> _____			
Client Name: La Crosse Solutions		Phone # 608-689-4259		<b>Sample Analysis Requested <sup>(5)</sup></b> (Fill in the number of containers for each test)			
Project/Site Name: LACBWR-Genoa WI		Fax #					
Address: 54601 State Road 35							
Collected By: Kevin L Murray		Send Results To: Scott Zoller sgzoller@energysolutions.com		<div style="text-align: center;"> <b>Comments</b>          Note: extra sample is required for sample specific QC       </div>			
<b>Sample ID</b> <small>* For composites - indicate start and stop date/time</small>	<b>*Date Collected</b> <small>(mm-dd-yy)</small>	<b>*Time Collected</b> <small>(Military) (hhmm)</small>	<b>QC Code <sup>(2)</sup></b>			<b>Field Filtered <sup>(3)</sup></b>	<b>Sample Matrix <sup>(4)</sup></b>
L1-010-107-FSGS-008-SS	08/08/19	15:00	N			N	SO
L1-010-101-FJGS-015-SS	08/08/19	15:12	N			N	SO
L1-010-102-FSGS-007-SS	08/14/19	15:18	N			N	SO
L1-010-103-FSGS-005-SS	08/14/19	10:13	N			N	SO
L1-010-104-FJGS-016-SS	08/23/19	9:57	N			N	SO
L1-010-105-FSGS-007-SS	08/23/19	13:29	N			N	SO
L2-011-101-FSGS-005-SS	09/20/19	14:01	N			N	SO
L2-011-104-FSGS-011-SS	09/09/19	14:52	N			N	SO
L3-012-101-FSGS-005-SS	09/05/19	13:00	N			N	SO
L3-012-109-FSGS-014-SS	09/23/19	14:21	N			N	SO
<b>Chain of Custody Signatures</b>							
Relinquished By (Signed) _____ Date _____ Time _____		Received by (signed) _____ Date _____ Time _____				<b>TAT Requested:</b> Normal: <input checked="" type="checkbox"/> Rush: _____ Specify: _____ (Subject to Surcharge)	
1. Kevin L Murray <i>[Signature]</i> 10/16/2019 1315		1 <i>[Signature]</i> 10/20/19 8:40				Fax Results: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Select Deliverable: <input type="checkbox"/> C of A <input type="checkbox"/> QC Summary <input type="checkbox"/> level 1 <input checked="" type="checkbox"/> Level 2 <input type="checkbox"/> Level 3 <input type="checkbox"/> Level 4	
2		2		Additional Remarks: <b>None</b>			
3		3		<b>For Lab Receiving Use Only:</b> Custody Seal Intact? <input type="checkbox"/> Yes <input type="checkbox"/> No <b>Cooler Temp:</b> _____ °C			
<b>&gt; For sample shipping and delivery details, see Sample Receipt &amp; Review form (SRR.)</b>							
<b>Sample Collection Time Zone:</b> <input type="checkbox"/> Eastern <input type="checkbox"/> Pacific <input checked="" type="checkbox"/> Central <input type="checkbox"/> Mountain <input type="checkbox"/> Other:							
1.) Chain of Custody Number = Client Determined 2.) QC Codes: N = Normal Sample, TB = Trip Blank, FD = Field Duplicate, EB = Equipment Blank, MS = Matrix Spike Sample, MSD = Matrix Spike Duplicate Sample, G = Grab, C = Composite 3.) Field Filtered: For liquid matrices, indicate with a - Y - for yes the sample was field filtered or - N - for sample was not field filtered. 4.) Matrix Codes: DW=Drinking Water, GW=Groundwater, SW=Surface Water, WW=Waste Water, W=Water, ML=Misc Liquid, SO=Soil, SD=Sediment, SL=Sludge, SS=Solid Waste, O=Oil, F=Filter, P=Wipe, U=Urine, F=Fecal, N=Nasal 5.) Sample Analysis Requested: Analytical method requested (i.e. 8260B, 6010B/7470A) and number of containers provided for each (i.e. 8260B - 3, 6010B/7470A - 1). 6.) Preservative Type: HA = Hydrochloric Acid, NI = Nitric Acid, SH = Sodium Hydroxide, SA = Sulfuric Acid, AA = Ascorbic Acid, HX = Hexane, ST = Sodium Thiosulfate. If no preservative is added = leave field blank							
<b>7.) KNOWN OR POSSIBLE HAZARDS</b> <b>RCRA Metals</b> As = Arsenic Hg= Mercury Ba = Barium Se= Selenium Cd = Cadmium Ag= Silver Cr = Chromium MR= Misc. RCRA metals Pb = Lead		<b>Characteristic Hazards</b> FL = Flammable/Ignitable CO = Corrosive RE = Reactive <b>TSCA Regulated</b> PCB = Polychlorinated biphenyls		<b>Listed Waste</b> LW= Listed Waste (F, K, P and U-listed wastes.) Waste code(s): _____			
				<b>Other</b> OT= Other / Unknown (i.e.: High/low pH, asbestos, beryllium, irritants, other misc. health hazards, etc.) Description: _____			
<b>Please provide any additional details below regarding handling and/or disposal concerns. (i.e.: Origin of sample(s), type of site collected from, odd matrices, etc.)</b>							



[illegible]

EK

## SAMPLE RECEIPT &amp; REVIEW FORM

Client: <u>ENRAG</u>		SDG/AR/COC/Work Order: <u>493624</u>	
Received By: <u>AJA</u>		Date Received: <u>10/21/19</u>	
Carrier and Tracking Number		Circle Applicable: <input checked="" type="radio"/> FedEx Express <input type="radio"/> FedEx Ground <input type="radio"/> UPS <input type="radio"/> Field Services <input type="radio"/> Courier <input type="radio"/> Other <u>7767 3575 6970</u>	
Suspected Hazard Information	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	*If Net Counts > 100cpm on samples not marked "radioactive", contact the Radiation Safety Group for further investigation.	
A) Shipped as a DOT Hazardous?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Hazard Class Shipped: _____ UN#: _____ If UN2910, Is the Radioactive Shipment Survey Compliant? Yes ___ No ___	
B) Did the client designate the samples are to be received as radioactive?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	COC notation or radioactive stickers on containers equal client designation.	
C) Did the RSO classify the samples as radioactive?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	Maximum Net Counts Observed* (Observed Counts - Area Background Counts): <u>0</u> CPM / mR/Hr Classified as: Rad 1 Rad 2 Rad 3	
D) Did the client designate samples are hazardous?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	COC notation or hazard labels on containers equal client designation.	
E) Did the RSO identify possible hazards?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>	If D or E is yes, select Hazards below. PCB's Flammable Foreign Soil RCRA Asbestos Beryllium Other: _____	
Sample Receipt Criteria		Yes <input type="checkbox"/> NA <input checked="" type="checkbox"/> No <input type="checkbox"/>	Comments/Qualifiers (Required for Non-Conforming Items)
1	Shipping containers received intact and sealed?	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
2	Chain of custody documents included with shipment?	<input checked="" type="checkbox"/>	Circle Applicable: Client contacted and provided COC COC created upon receipt
3	Samples requiring cold preservation within (0 ≤ 6 deg. C)?*	<input checked="" type="checkbox"/>	Preservation Method: Wet Ice Ice Packs Dry ice <input checked="" type="radio"/> None <input type="radio"/> Other: _____ *all temperatures are recorded in Celsius TEMP: <u>23°</u>
4	Daily check performed and passed on IR temperature gun?	<input checked="" type="checkbox"/>	Temperature Device Serial #: <u>784-16</u> Secondary Temperature Device Serial # (If Applicable): _____
5	Sample containers intact and sealed?	<input checked="" type="checkbox"/>	Circle Applicable: Seals broken Damaged container Leaking container Other (describe)
6	Samples requiring chemical preservation at proper pH?	<input checked="" type="checkbox"/>	Sample ID's and Containers Affected: _____ If Preservation added, Lot#: _____
7	Do any samples require Volatile Analysis?	<input checked="" type="checkbox"/>	If Yes, are Encores or Soil Kits present for solids? Yes ___ No ___ NA ___ (If yes, take to VOA Freezer) Do liquid VOA vials contain acid preservation? Yes ___ No ___ NA ___ (If unknown, select No) Are liquid VOA vials free of headspace? Yes ___ No ___ NA ___ Sample ID's and containers affected: _____
8	Samples received within holding time?	<input checked="" type="checkbox"/>	ID's and tests affected: _____
9	Sample ID's on COC match ID's on bottles?	<input checked="" type="checkbox"/>	ID's and containers affected: _____
10	Date & time on COC match date & time on bottles?	<input checked="" type="checkbox"/>	Circle Applicable: No dates on containers No times on containers COC missing info Other (describe)
11	Number of containers received match number indicated on COC?	<input checked="" type="checkbox"/>	Circle Applicable: No container count on COC Other (describe)
12	Are sample containers identifiable as GEL provided?	<input checked="" type="checkbox"/>	
13	COC form is properly signed in relinquished/received sections?	<input checked="" type="checkbox"/>	Circle Applicable: Not relinquished Other (describe)
Comments (Use Continuation Form if needed):			

PM (or PMA) review: Initials MB Date 10/22/19 Page 1 of 1

GL-CHL-SR-001 Rev 6

**List of current GEL Certifications as of 14 November 2019**

<b>State</b>	<b>Certification</b>
Alaska	17-018
Alaska Drinking Water	SC00012
Arkansas	88-0651
CLIA	42D0904046
California	2940
Colorado	SC00012
Connecticut	PH-0169
DoD ELAP/ ISO17025 A2LA	2567.01
Florida NELAP	E87156
Foreign Soils Permit	P330-15-00283, P330-15-00253
Georgia	SC00012
Georgia SDWA	967
Hawaii	SC00012
Idaho	SC00012
Illinois NELAP	200029
Indiana	C-SC-01
Kansas NELAP	E-10332
Kentucky SDWA	90129
Kentucky Wastewater	90129
Louisiana Drinking Water	LA024
Louisiana NELAP	03046 (AI33904)
Maine	2019020
Maryland	270
Massachusetts	M-SC012
Massachusetts PFAS Approv	Letter
Michigan	9976
Mississippi	SC00012
Nebraska	NE-OS-26-13
Nevada	SC000122020-1
New Hampshire NELAP	2054
New Jersey NELAP	SC002
New Mexico	SC00012
New York NELAP	11501
North Carolina	233
North Carolina SDWA	45709
North Dakota	R-158
Oklahoma	2019-165
Pennsylvania NELAP	68-00485
Puerto Rico	SC00012
S. Carolina Radiochem	10120002
Sanitation Districts of L	9255651
South Carolina Chemistry	10120001
Tennessee	TN 02934
Texas NELAP	T104704235-19-15
Utah NELAP	SC000122019-29
Vermont	VT87156
Virginia NELAP	460202
Washington	C780