



CHARLES CENTER • P.O. BOX 1475 • BALTIMORE, MARYLAND 21203

ARTHUR E. LUNDVALL, JR.
VICE PRESIDENT
SUPPLY

September 22, 1981

Mr. R. C. Haynes, Director
Office of Inspection and Enforcement
U. S. Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, Pennsylvania 19406

SUBJECT: Calvert Cliffs Nuclear Power Plant
Unit No. 1 and Unit No. 2
Docket Nos. 50-317 and 50-318
Reports of Startup Testing


REFERENCE (1): Calvert Cliffs Nuclear Power Plant
Unit 1, Startup Test Report, 4/8/81
(2): Calvert Cliffs Nuclear Power Plant
Unit 2, Startup Test Report, 5/15/81

Dear Mr. Haynes:

The routine inspection conducted by Dr. J. W. Chung (Inspection 50-317/81-14) identified an error in the Unit 1, Cycle 5 Startup Test Report (Reference 1). Table 2 of the Summary Report listed the CEA positions for the temperature and power coefficient tests as 105" withdrawn instead of the correct position of 102". Our review has identified the same error in the Unit 2, Cycle 4 Startup Test Report (Reference 2) and an error in the value reported for the ITC measured at zero power. The value reported in Table 2 of $.396 \times 10^{-4} \Delta \rho / ^\circ \text{F}$ should be $.415 \times 10^{-4} \Delta \rho / ^\circ \text{F}$. Enclosed are corrected pages of the respective reports.

Very truly yours,

BALTIMORE GAS AND ELECTRIC COMPANY

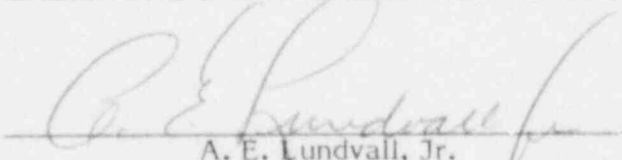

A. E. Lundvall, Jr.
Vice President - Supply

AEL/MEB/djw
Enclosures

Copies To: J. A. Biddison, Esq.
D. H. Jaffe - NRC
P. W. Kruse - CE
G. F. Trowbridge, Esq.
R. Architzel - NRC
Director, Office of Inspection and Enforcement (36)

8111100487 811030
PDR ADDOCK 05000317
Q PDR