

POINT BEACH NUCLEAR PLANT
UNIT 1 AND 2

ENVIRONMENTAL MANUAL

WISCONSIN ELECTRIC

June 19, 1991

Revision 8

9303020207 930225
PDR ADDCK 05000266
R PDR

ENVIRONMENTAL MANUAL

TABLE OF CONTENTS

	<u>PAGE</u>
1.0 <u>RADIOLOGICAL ENVIRONMENTAL PROGRAM ADMINISTRATION</u>	1
1.1 <u>Definition of Radiological Environmental Monitoring</u>	1
1.2 <u>Responsibilities for Program Implementation</u>	1
1.2.1 Nuclear technical services section functions	1
a. Program scope	1
b. Record keeping	1
c. Data monitoring	2
d. Data summary	2
e. Contractor communications	2
f. Reportable items	2
1.2.2 PBNP functions	3
a. Manual control and distribution	3
b. Program coordination	4
1.3 <u>Quality Assurance/Quality Control</u>	4
1.4 <u>Program Revisions</u>	5
2.0 <u>RADIOLOGICAL ENVIRONMENTAL MONITORING</u>	6
2.1 <u>Program Overview</u>	6
2.1.1 Purpose	6
2.1.2 Samples	6
2.1.3 Monitoring sensitivity	6
2.1.4 Technical specifications	6
2.2 <u>Program Parameters</u>	7
2.2.1 Contamination avoidance	7
2.2.2 Sample size	7

ENVIRONMENTAL MANUAL

	<u>PAGE</u>
2.2.3 Lower limit of detection	8
2.2.4 Notification levels	9
a. Regulatory notification levels	9
b. Administrative notification levels	10
2.2.5 Sampling locations	10
2.2.6 Sampling media and frequency	11
2.2.7 Sample labeling	11
2.2.8 Sample shipping	12
2.2.9 Sample analyses and frequency	12
2.2.10 Analytical laboratory	13
2.3 <u>Assistance to the State of Wisconsin</u>	13
2.4 <u>Sampling Procedure</u>	14
2.4.1 Vegetation	14
2.4.2 TLDs	14
2.4.3 Lake water	15
2.4.4 Well water	15
2.4.5 Air	15
a. Sample collection	15
b. System description	18
c. Calibration	18
d. Inspection and maintenance	19
e. Repair and replacement	19
2.4.6 Milk	20
2.4.7 Algae	21
2.4.8 Fish	21

ENVIRONMENTAL MANUAL

	<u>PAGE</u>
2.4.9 Soil	22
2.4.10 Shoreline sediment	22
2.5 <u>Milk Survey</u>	23
3.0 <u>NON-RADIOLOGICAL MONITORING</u>	35

ENVIRONMENTAL MANUAL

TABLE OF TABLES

<u>TABLE</u>		<u>PAGE</u>
2-1	Sample Size	24
2-2	Lower Limit of Detection and Notification Levels	25, 26
2-3	Radiological Environmental Sampling Locations	27, 28
2-4	PBNP Radiological Environmental Sample Collection Frequency	29
2-5	PBNP Radiological Environmental Sample Analysis and Frequency	30
2-6	Samples Collected for the State of Wisconsin	31

TABLE OF FIGURES

<u>FIGURES</u>		<u>PAGE</u>
2-1	Radiological Environmental Sampling Locations	32, 33
2-2	Sampling Deviation Reporting Form	34

APPENDICES

APPENDIX A	Radiological Environmental Monitoring Technical Specifications
------------	--

ENVIRONMENTAL MANUAL

1.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ADMINISTRATION1.1 Definition of Radiological Environmental Monitoring

Radiological environmental monitoring is the measurement of radioactivity in samples collected from the atmospheric, aquatic and terrestrial environment around the Point Beach Nuclear Plant (PBNP). Monitoring radioactivity in effluent streams at or prior to the point of discharge to the environment is not part of the Radiological Environmental Monitoring Program.

1.2 Responsibilities for Program Implementation

1.2.1 Nuclear technical services section functions

The manager and the staff of the Nuclear Technical Services Section (NTSS) provide the Manager - PBNP with technical, regulatory, licensing and administrative support necessary for the implementation of the program. The NTSS administrative functions relating to the Radiological Environmental Monitoring Program fall into the six broad areas outlined below.

a. Program scope

The scope of the Radiological Environmental Monitoring Program is determined by NTSS. Based on the scope, NTSS prepares the program manual as necessary to conform to changes in program procedures and scope. NTSS monitors the program effectiveness and compliance with Radiological Effluent Technical Specifications (RETS). In order to verify compliance with RETS, NTSS arranges for a program audit at least once every 12 months and an audit of the analytical contractor at least once every 36 months.

b. Record keeping

Monthly results of contractor analyses are sent to both PBNP and NTSS. However, the analytical results maintained by NTSS are regarded as the official results. These records are kept for the lifetime of the plant.

ENVIRONMENTAL MANUAL

c. Data monitoring

The cognizant NTSS engineer reviews and interprets all program analytical results on a monthly basis as they are reported. Trends, if any, are noted. Any resulting corrections, modifications and additions to the data are made by the cognizant NTSS engineer. Inconsistencies are investigated by the cognizant NTSS engineer with the cooperation of PBNP and contractor personnel, as required. Unusual results as evidenced by radioactivity levels exceeding NTSS administrative notification levels are investigated in the same manner. Results of the investigation will be conveyed to the Manager - PBNP. NTSS will promptly inform PBNP of any sample exceeding Nuclear Regulatory Commission (NRC) regulatory notification levels and both NTSS and PBNP will initiate an investigation. A formal report shall be provided to the Manager - PBNP by NTSS upon completion of the investigation.

d. Data summary

Results from the Radiological Environmental Monitoring Program shall be summarized semiannually for inclusion in the PBNP Semiannual Monitoring Report. This summary advises the Manager - PBNP of the radiological status of the environment in the vicinity of PBNP. The summary shall include the numbers and types of samples as well as the averages, statistical confidence limits and the ranges of analytical results. Methods used in summarizing data are at the discretion of NTSS.

e. Contractor communications

Communication with the contractor regarding data, analytical procedures, lower limits of detection, notification levels and contractual matters are normally conducted by NTSS. Communication regarding sample shipment may be done by either PBNP or NTSS as appropriate.

f. Reportable items

1. NTSS shall generate all technically-specified reports related to the operation of the Radiological Environmental Monitoring Program. The following items and occurrences are required to be reported in the PBNP Semiannual Monitoring Report:

- (a) Summary of monitoring results including number and type of samples;

ENVIRONMENTAL MANUAL

- (b) Unavailable, missing, lost samples and plans to prevent recurrence;
 - (c) New or relocated sampling locations;
 - (d) LLDs that are higher than specifications and factors contributing to inability to achieve specified LLDs; and
 - (e) Notification that the analytical laboratory does not participate in an interlaboratory comparison program.
2. The following items are required to be reported to the NRC within 30 days of occurrence:
- (a) Confirmed environmental radionuclide concentrations, attributable to PBNP effluents, in excess of notification levels; and
 - (b) Confirmed results of weighted sum calculations involving radionuclide concentrations, attributable to PBNP effluents, in environmental samples in excess of the specified notification level.

1.2.2 PBNP functions

The primary responsibility for the implementation of the Point Beach Nuclear Plant (PBNP) Radiological Environmental Monitoring Program and for any actions to be taken at PBNP, based on the results of the program, resides with the Manager - PBNP. The responsibility for ensuring that PBNP portions of the Semiannual Monitoring Report are correct, complete and transmitted to NTSS in a timely manner resides with the manager - Chemistry.

a. Manual control and distribution

The distribution of the PBNP Environmental Manual is the responsibility of PBNP.

ENVIRONMENTAL MANUAL

b. Program coordination

The daily operation of the program is conducted by PBNP Health Physics personnel, and other qualified personnel as required, under the supervision of a Specialist - Nuclear Health Physics who consults, as needed, with the cognizant NTSS engineer. The daily administrative functions of the Cognizant Specialist - Nuclear Health Physics address those functions required for the effective operation of the PBNP Radiological Environmental Monitoring program. These administrative functions include the following:

1. Ensuring that samples are obtained in accordance with the applicable Technical Specifications following procedures outlined in this manual;
2. Ensuring adequate sampling supplies and calibrated, operable equipment are available at all times;
3. Ensuring that air sampling pumps are maintained, repaired and calibrated as required and that an adequate number of backup pumps are readily available at all times;
4. Formally reporting lost or unavailable samples as well as other potential deviations from the technically-specified sampling regime to the cognizant NTSS engineer and logging the same at PBNP;
5. Assisting the State of Wisconsin in obtaining samples at co-located and other sampling sites based upon a yearly, renewable agreement; and
6. Assisting, as necessary, the cognizant NTSS engineer with investigations into elevated radioactivity levels in environmental samples.

1.3 Quality Assurance/Quality Control

Quality assurance considerations are an integral part of Wisconsin Electric's Radiological Environmental Monitoring Program. The program involves the interaction of the Nuclear Technical Services Section (NTSS), Point Beach Nuclear Plant (PBNP), Wisconsin Electric's Quality Assurance Section (QAS) and Teledyne Isotopes Midwest Laboratory (TIML).

ENVIRONMENTAL MANUAL

The TIML quality assurance and quality control program is described in the TIML Quality Assurance Program Manual and the TIML Quality Control Procedures Manual. Copies of these manuals are maintained by NTSS and QAS. Amendments and revisions of these documents are reviewed by responsible NTSS and QAS personnel as they are issued. The contractor is audited by Wisconsin Electric personnel periodically at intervals which do not exceed three years. The quality assurance portion of the audit is performed by QAS and the technical portion of the audit is performed by NTSS. If circumstances preclude an audit by NTSS/QAS personnel within the allotted time interval, a delay of up to six (6) months is permitted provided that the results of an audit by another qualified QA group is available for review. As part of its quality control program, TIML participates in the Environmental Crosscheck Program operated by the Intercomparison and Calibration Section, Quality Assurance Branch, Environmental Monitoring and Support Laboratory, U.S. Environmental Protection Agency, Las Vegas, Nevada.

Quality control for the PBNP portion of the Radiological Environmental Monitoring Program is achieved by following the procedures contained in this manual. Health Physics technologists (HPTs) collect, package and ship environmental samples under the supervision of Health Physics supervisors and the General Supervisor - Health Physics. They are advised by the Specialist - Nuclear Health Physics who has immediate responsibility for the overall technical operation of the environmental sampling functions. The HPTs receive classroom training as well as on-the-job training in carrying out these procedures.

An audit of the PBNP Radiological Environmental Monitoring Program and its results shall be completed at least once every 12 months as a means of monitoring program effectiveness and assuring compliance with program directives. The audit shall be performed by either NTSS personnel, QAS or a qualified consulting firm.

1.4 Program Revisions

This manual describes the current scope of the PBNP Radiological Environmental Monitoring Program. The program and the manual are maintained by NTSS, consistent with Technical Specification commitments. Program items or procedures periodically may be updated or changed, consistent with good radiologically monitoring practices, either to reflect new conditions or to improve program effectiveness. Technical and program features described in this manual may be changed at the discretion of NTSS with the concurrence of the PBNP Managers' Supervisory Staff.

ENVIRONMENTAL MANUAL

2.0 RADIOLOGICAL ENVIRONMENTAL MONITORING2.1 Program Overview

2.1.1 Purpose

No significant or unexpected radionuclide concentrations of plant origin are expected because each normal effluent pathway at PBNP is monitored at or before the release point. However, the Radiological Environmental Monitoring Program is conducted to verify that plant operations produce no significant radiological impact on the environment and to demonstrate compliance with applicable standards.

2.1.2 Samples

Samples for the Radiological Environmental Monitoring Program are obtained from the aquatic, terrestrial and atmospheric environment. The sample types represent key indicators or critical pathways identified by applying sound radiological principles to the PBNP environment.

2.1.3 Monitoring sensitivity

The effectiveness of the Radiological Environmental Monitoring Program in fulfilling its purpose depends upon the ability to accurately determine the nature and origins of fluctuations in low levels of environmental radioactivity. This requires a high degree of sensitivity so that it is possible to correctly discriminate between fluctuations in background radiation levels and levels of radioactivity that may be attributable to the operation of PBNP. Therefore, personnel actively participating in the monitoring program should make every effort to minimize the possibility of contaminating environmental samples and to obtain samples of the appropriate size.

2.1.4 Technical Specifications

A copy of the PBNP Technical Specifications applicable to the Radiological Environmental Monitoring Program is located in Appendix A of this manual. These specifications are part of the Radiological Effluent Technical Specifications (RETS).

ENVIRONMENTAL MANUAL

2.2 Program Parameters

2.2.1 Contamination avoidance

Contamination prevents the accurate quantification of environmental radioactivity and the correct differentiation between fluctuating background radioactivity and levels of radioactivity attributable to the operation of PBNP. Therefore, it is necessary that all personnel associated with collecting and handling radiological environmental samples take the appropriate precautions to minimize the possibility of contaminating the samples. Some of the precautions that should be taken and which will help to minimize contamination are listed below:

- a. Equipment which has been on the controlled side, even if released clean, should not be used in conjunction with radiological environmental monitoring;
- b. Store sampling equipment in radiologically clean areas only;
- c. Store radiological environmental samples only in radiologically clean areas when samples cannot be shipped to the contractor on the same day they are collected;
- d. Treat each sample as a possible source of contamination for other samples so as to minimize the possibility of cross-contamination;
- e. Radiological environmental monitoring equipment should be repaired in clean-side shops;
- f. Contamination avoidance for environmental TLDs is covered in Section 2.4.2; and
- g. Do not enter the controlled zone prior to leaving to collect environmental samples.

2.2.2 Sample size

Sample size affects the sensitivity achievable in quantifying low levels of environmental radioactivity. Therefore, sampling personnel must attempt to attain the quantities of sample specified in Table 2-1. When a range is given, every effort should be made to obtain a quantity at the upper part of the range.

ENVIRONMENTAL MANUAL

2.2.3 Lower limit of detection

The sensitivity required for a specific analysis of an environmental sample is defined in terms of the lower limit of detection (LLD). The LLD is the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with a 95 % probability and have only a 5 % probability of falsely concluding that a blank observation represents a real signal. Mathematically, the LLD is defined by the formula

$$LLD = \frac{4.66 S_b}{E \times V \times 2.22 \times Y \times \text{EXP}(-\lambda \Delta T)}$$

Where

LLD = the a priori lower limit of detection in picocuries per unit volume or mass, as applicable;

S_b = the standard deviation of the background counting rate or the counting rate of a blank sample, as appropriate, in counts per minutes;

E = counting efficiency in counts per disintegration;

V = sample size in units of volume or mass, as applicable;

2.22 = number of disintegrations per minute per picocurie;

Y = the fractional chemical yield as applicable;

λ = the radioactive decay constant for the particular radionuclide; and

ΔT = the elapsed time between sample collection, or the end of the collection period, and the time of counting.

Typical values of E, V, Y, and ΔT are used to calculate the LLD. As defined, the LLD is an a priori limit representing the capability of a measuring system and not an a posteriori limit for a particular measurement.

ENVIRONMENTAL MANUAL

The required analysis for each environmental sample and the highest acceptable LLD associated with each analysis are listed in Table 2-2. Whenever LLD values lower than those specified in Table 2-2 are reasonably achievable, the analytical contractor for the radiological environmental samples will do so. When the LLDs listed in Table 2-2 are not achieved, a description of the factors contributing to the higher LLD shall be reported in the next PBNP Semiannual Monitoring Report.

2.2.4 Notification levels

The Notification Level (NL) is that measured quantity of radioactivity in an environmental sample which, when exceeded, requires a notification of such an occurrence be made to the appropriate party. Regulatory and administrative notification levels are listed in Table 2-2.

a. Regulatory notification levels

The regulatory notification levels listed in Table 2-2 represent the concentration levels at which NRC notification is required by PBNP Technical Specification requirements. If a measured level of radioactivity in any environmental medium exceeds the regulatory notification level listed in Table 2-2, resampling and/or reanalysis for confirmation shall be completed within 30 days of the determination of the anomalous result. If the confirmed measured level of radioactivity remains above the notification level, a written report shall be submitted to the NRC. If more than one of the radionuclides listed in Table 2-2 are detected in any environmental medium, a weighted sum calculation shall be performed if the measured concentration of a detected radionuclide is greater than 25% of the notification levels. For those radionuclides with LLDs in excess of 25% of the notification level, a weighted sum calculation needs to be performed only if the reported value exceeds the LLD. Radionuclide concentration levels, called Weighted Sum Action Levels, which trigger a weighted sum calculation are listed in Table 2-2.

ENVIRONMENTAL MANUAL

The weighted sum is calculated as follows:

$$\frac{\text{concentration (1)}}{\text{notification level (1)}} + \frac{\text{concentration (2)}}{\text{notification level (2)}} + \dots = \text{weighted sum}$$

If the calculated weighted sum is equal to or greater than 1, resampling and/or reanalysis for confirmation shall be completed within 30 days of the determination of the anomalous result. If the confirmed calculated weighted sum remains equal to or greater than 1, a written report shall be submitted to the NRC. This calculation requirement and report is not required if the measured level of radioactivity was not the result of plant effluents.

b. Administrative notification levels

The NTSS administrative notification levels are the concentration levels at which the contracted analytical laboratory promptly notifies the cognizant NTSS engineer by phone, followed by a formal written communication. The NTSS administrative notification levels are set lower than the NRC regulatory notification levels and lower than, or equal to, the weighted sum action levels so that the nature and origin of the increased level of environmental radioactivity may be expeditiously ascertained and corrective actions taken if required.

2.2.5 Sampling locations

A list of sampling locations and the corresponding location codes appear in Table 2-3. The locations also are shown in Figures 2-1a and 2-1b. It is conceivable that samples may become unavailable from specified sample locations. If this were to occur, new locations for obtaining replacement samples shall be identified and added to the Radiological Environmental Monitoring Program. If milk or vegetation samples become unavailable from the specified sampling locations, new sampling locations will be identified within 30 days. The specific locations where samples were unavailable may be deleted from the monitoring program. A formal, written reason for the new site and its location shall be transmitted to the cognizant NTSS engineer who will make the appropriate changes to the Environmental Manual. Any significant changes in existing sampling location and the criteria for the change shall be reported in the Semiannual Monitoring Report for the period in which the change occurred. Additional sampling locations may be designated if deemed necessary by cognizant company personnel.

ENVIRONMENTAL MANUAL

2.2.6 Sampling media and frequency

The sampling frequency for the environmental media required by PBNP Technical Specifications is found in Table 2-4. In addition to samples required by Technical Specifications, the Radiological Environmental Monitoring Program also includes the sampling of soil and shoreline sediment. To ensure that all samples are obtained at the appropriate times, two different checklists are used. A yearly checklist provides a month-by-month indication of all samples, except air, to be obtained at each sampling location (PBF-4121). This checklist also identifies the schedule for the annual milk survey and provides space for recording the date the samples were shipped offsite for analysis. In addition, a separate checklist is provided for each sampling location to identify all samples, including weekly air samples, to be obtained and the collection date (PBF-4075 series). Because the weekly air samples require additional information, a separate checklist is used for each individual air sampling location as shown in PBF-4078.

It is recognized that on occasions samples will be lost or that samples cannot be collected at the specified frequency because of hazardous conditions, seasonable unavailability, automatic sampling equipment malfunctions and other legitimate reasons. Reasonable efforts will be made to recover lost or missed samples if warranted and appropriate. If samples are not obtained at the indicated frequency or location, the reasons or explanations for deviations from the sampling frequency specified in Table 2-4 shall be logged at PBNP and shall be conveyed formally in writing to the cognizant NTSS engineer using the appropriate form (Figure 2-2). The cognizant engineer will evaluate the sampling problem to determine whether it constitutes a reportable deviation from the Technical Specifications in Table 2-4. If it does, a description of the reasons for not conducting the sampling as specified and, when appropriate, plans for preventing a recurrence, shall be identified in the next Semiannual Monitoring Report by the cognizant NTSS engineer.

2.2.7 Sample labeling

All samples must be properly labeled to ensure that the necessary information is conveyed to the analytical contractor and that the results are associated with the correct geographical location. Each label (PBF-4026) must contain the following:

- a. Sample type;

ENVIRONMENTAL MANUAL

- b. Sample location including both the location code and location description from Table 2-3;
- c. Date and time (as appropriate) collected;
- d. Air samples must show the total volume in m^3 ; volumes for water and milk are in gallons; vegetation, sediment, soil, and algae are indicated as ≤ 1000 grams; and fish ≥ 1000 grams;
- e. Analyses for routine samples are indicated as "per contract." For special samples, the manager - Health Physics or the Cognizant Specialist - Nuclear Health Physics will designate the analyses required; and
- f. Name of person collecting the sample.

A permanent or indelible ink type felt-tip marker shall be used.

A separate sample label is needed for each sample type and location. Labels are securely attached to each sample container. In addition to sample labels, other identifying markings may be placed on sample containers as appropriate.

2.2.8 Sample shipping

All environmental samples are shipped to a contractor for analysis. The samples shall be packaged and shipped in such a way as to minimize the possibility of cross-contamination, loss, spoilage and leakage. Each sample shipment shall have a typed cover letter and, when appropriate, a contractor data collection sheet. Included in the letter shall be the same information required for the sample labels as well as the specific analyses required. The original cover letter and data collection sheet shall be sent to the contractor under separate cover; one copy of each is to be used as a packing list and a copy of each shall be kept in the appropriate PBNP file.

2.2.9 Sample analyses and frequency

The PBNP Radiological Environmental Monitoring Program samples shall be analyzed for designated parameters at the frequency listed in Table 2-5.

ENVIRONMENTAL MANUAL

2.2.10 Analytical laboratory

The analyses are performed by a contractor. The current contractor is:

Teledyne Isotopes Midwest Laboratory
700 Landwehr Road
Northbrook, IL 60062-4517
(708)564-0700

This laboratory, former named Hazleton Environmental Sciences Corporation, performs the analyses in such a manner as to attain the desired LLDs. The contracted laboratory participates in the inter-laboratory comparison crosscheck program conducted by the U.S. Environmental Protection Agency, Intercomparison and Calibration Section, Quality Assurance Branch, Environmental Monitoring and Support Laboratory, Las Vegas, Nevada.

The contractor is responsible for providing prompt notification to NTSS regarding any samples found to exceed the NTSS administrative notification levels as identified in Table 2-2.

2.3 Assistance to the State of Wisconsin

As a courtesy and convenience, PBNP personnel obtain certain environmental samples for the Section of Radiation Protection, Department of Health and Social Services of the State of Wisconsin as listed in Table 2-6. A checklist is used as shown in PBF-4075 series. In addition, a State of Wisconsin air sampling data sheet is submitted with each sample obtained at Wisconsin air sampling locations serviced by PBNP personnel.

State of Wisconsin precipitation samples collected twice a month (or as available) require a state sample tag to be placed in a box with the quart cubitainer. State supplied labels for air particulate filters require start and stop time, date and beginning and ending volume. Fish sent to the state identify only the quarter and the year using a PBNP label (PBF-4026). The monthly lake water composite is picked up by state personnel and therefore requires only that the date and location be written on the box for the cubitainer. The state provides a sample tag for the quarterly lake water sample.

ENVIRONMENTAL MANUAL

Samples obtained for the State of Wisconsin are either given directly to state personnel or shipped as required. The department address is:

Radiation Protection Laboratory
Room 111
State Laboratory of Hygiene
465 Henry Mall
Madison, Wisconsin 53706

2.4 Specification of Sampling Procedures

General radiological environmental sampling procedures follow the directives presented in Sections 2.1 and 2.2. Specific information for handling individual sample types follow.

2.4.1 Vegetation

Vegetation samples consist of green, growing grasses and weeds and are obtained three times per year, as available, from specified locations. New growth, not dead vegetation, should be used because these samples are indicators of recent atmospheric deposition. Use a scissors or other sharp cutting tool to cut the grasses and weeds off as close to the ground as possible. Do not include plant roots and take care not to contaminate the sample with soil. Total sample collected should exceed 500 grams and ideally should be 1000 grams. Place entire sample in a plastic bag, tape the bag shut, and label the bag as described in Section 2.2.7.

2.4.2 Thermoluminescent dosimeters (TLDs)

TLDs capable of multiple, independent measurements of the same exposure are posted at the twenty-seven (27) locations specified in Table 2-4 and are changed quarterly. The utmost care in handling is required to minimize unnecessary exposure during transit, storage and posting because the TLDs begin recording all radiation from the moment they are annealed (heated to rezero) at the contractor's laboratory. Packages of TLDs in transit should be marked "DO NOT X-RAY."

A transportation control (E-TC) shall accompany the new batch in transit from the contractor's laboratory to the plant. The control shall accompany the batch during brief storage and subsequent posting. The same control shall accompany the "old" or exposed batch on its way back to the contractor. Therefore, each control represents the sum of approximately half the in-transit exposure of the two batches. This control system is able to identify any unusual in-transit exposure.

ENVIRONMENTAL MANUAL

Environmental TLDs should never be brought into the plant controlled zone or any other area with elevated radiation, but may be stored for brief periods in a shielded enclosure in the Extension Building or other low background area, such as the basement of the Energy Center or the Site Boundary Control Center. The contractor is to time shipments to coincide as closely as possible with the beginning of a calendar quarter. TLDs should be shipped back to the contractor immediately or within 24 hours of removal. The contractor is instructed to process the samples immediately upon receipt. The contractor shall report removal data and cumulative readings in mR for all locations and control, correct for in-transit exposure and express results in net mR/7 days. Labels of the exposed set for shipment to contractor should show both posting and removal dates.

2.4.3 Lake water

Lake water samples are obtained monthly at specified locations. As a special case, the water sample at the discharge flume is composited weekly for monthly analysis. The contractor is responsible for the compositing for quarterly analyses. Collect approximately 8000 ml of lake water in the required number of cubitainers at each location and label as directed in Section 2.2.7.

Lake water is collected at the request of the state of Wisconsin. These samples are collected, labeled, and forwarded to the appropriate agency.

2.4.4 Well water

Well water samples are obtained quarterly from the single onsite well. Collect approximately 8000 ml of well water using the required number of cubitainers. Label as directed in Section 2.2.7.

2.4.5 Air

a. Sample collection

Air filters are changed weekly at specified locations. Take precautions to avoid loss of collected material and to avoid contamination when handling filters. Washing hands before leaving the plant to change filters is a recommended practice.

ENVIRONMENTAL MANUAL

Both particulate filters and charcoal cartridges are employed at each sampling location. Particulate filters are analyzed for gross beta activity after waiting for at least 24 hours to allow for the decay of short-lived radon and thoron daughter products. The contractor makes quarterly composites of the weekly particulate samples for gamma isotopic analyses.

A regulated pump (Eberline Model RAS-1 or equivalent) is used at each air sampling location. Because of the automatic flow regulation, rotameter readings at the beginning and ending of the sampling period should be nearly identical. Substantial differences in readings usually require some investigation to determine the cause. The rotameters attached to the pumps are calibrated in liters per minute. When new filters are installed, flow rate should be about 28-30 lpm. Flow rates less than 26 lpm or greater than 32 lpm require that the pump regulator be readjusted. The correct flow rate is determined by multiplying the rotameter reading by the correction factor indicated on the calibration sticker affixed to the rotameter.

The pumps are equipped with an elapsed time meter which reads in hours. Elapsed time in hours for the sample is obtained by subtracting the meter reading at start time from the reading at the end of the sampling period. The form shown in PBF-4078 is used for recording pertinent air sampling data for each location. At a normal filter change, the following procedure will apply:

1. Record "date off" on the air sampling data sheet.
2. Record rotameter reading for end of period (R_2).
3. Turn off pump and record hour meter reading for end of period (t_2).
4. Calculate total volume for period and enter on data sheet (m^3).
5. Before removing the filter, label the envelope as directed in Section 2.2.7. Also enter any other pertinent information at this time. Always write data on the envelope before the particulate filter is in the envelope.
6. Remove particulate filter being careful to handle filter only by edges, place in envelope.

ENVIRONMENTAL MANUAL

7. Remove charcoal cartridge, place in plastic bag, and label as directed in Section 2.2.7.
8. Install new charcoal cartridge and particulate filter being sure to check the charcoal cartridge for breaks and holes in the filter surface. Discard cartridges with holes and breaks.
9. Record "date on" on a new line of the data sheet.
10. Record hour meter reading for beginning of period (t_1).
11. Turn pump on.
12. Perform weekly gross leak test.
13. Record rotameter reading for beginning of period (R_1).
14. Record correction factor as indicated on calibration sticker affixed to rotameter (C).
15. Observe that the starting rotameter reading (R_1) is close to the previous ending reading (R_2). A substantial difference indicates need for further investigation because the regulator will generally maintain constant flow regardless of filter loading.
16. Any unusual conditions or observations should be referenced under (*) and recorded under "**NOTES" at the bottom of the data sheet.

Air samples are collected for the State of Wisconsin at three locations, one of which is co-located with a PBNP air sampling site. They are handled in a manner similar to PBNP samples except that no charcoal cartridges are involved. However, state samplers are equipped with volume integrating meters. Therefore, clock time must be recorded in addition to the ending and beginning volumes. Label and forward samples to the State.

ENVIRONMENTAL MANUAL

b. Air sampling system description

The air monitoring equipment for the PBNP air sampling program consists of a Regulated Rate Control System. The Regulated Rate Control System is used at PBNP because of its simplicity and reliability. It is designed to minimize both calibration difficulties and the potential for leaks. The regulated rate control system includes a pump, a flow regulator, an electrical hour meter, the appropriate filter holders and a minimum of tubing. In this system, the total volume sampled can be calculated simply and accurately from the elapsed time indicated on the hour meter and the flow rate which is kept constant by the regulator regardless of filter loading.

The air samplers are Eberline Model RAS-1 (or equivalent) and have built-in rotameters which read in liters per minute. The systems also include a 1000-hour elapsed time meter, an Eberline WPH-1 (or equivalent) weatherproof housing and an iodine cartridge holder and mounting kit. Currently, all metallic and rigid plastic tubing and rigid fittings are used in lieu of tygon tubing and quick disconnects. Glass fiber, 47 mm diameter, particulate filters capable of collecting 95% of 1 micron diameter particles and iodine impregnated charcoal cartridges (Scott or equivalent) constitute the filter media.

c. Calibration

Calibrate the pump rotameter at initial installation and at yearly intervals thereafter by connecting a laboratory-quality reference flow meter with NBS traceable calibration to the filter face with the particulate filter and charcoal cartridge in position. Upon completion, a calibration sticker indicating the correction factor is affixed to, or near, the built-in rotameter. The results are recorded on the form shown in PBF-4020.

ENVIRONMENTAL MANUAL

d. Inspection and maintenance

Initially, and at quarterly intervals, not to exceed 16 weeks, thereafter, the assembled system should be checked for leaks by attaching the reference flow meter across the face of the filter holder with the filters in position. Leakage in this configuration is indicated by a higher reading on the built-in rotameter than on the reference flow meter. Because leakage is indicated by disagreement between the two flow measuring devices, remember to apply the calibration correction factor to the built-in rotameter reading. Leak tests are to be recorded on the form shown in PBF-4020. Weekly gross leak checks shall be accomplished as indicated in the appropriate PBNP procedure.

For normal operation, the regulators should be adjusted to maintain a true flow rate of 28-30 liters per minute. Adjustments are made by turning the screw marked FLOW ADJUST located on the side of the regulator body: counterclockwise increases flow, clockwise decreases flow. Flow rates should be observed at all filter changes. Flow rates less than 26 lpm or more than 32 lpm require readjustment of the regulator. Particular attention should be paid to flow rate readings with the "old," loaded filter and with new, unused filters in position. Because of the regulator, the difference in flow should be barely perceptible, perhaps no more than one lpm. Significant differences in flow rates require further investigation to determine the cause.

Preventive maintenance shall be performed on all environmental air samplers and the results recorded on the form shown in PBF-4020.

e. Pump repair and replacement

The pumps can operate for long periods of time with minimal or no maintenance. The vane assembly of the pump is most susceptible to failure, indicated by excessive noise or inability to maintain sufficient flow across loaded filters. At least one standby pump should be available for temporary service during the repair period. In the event of motor failures due to causes other than defective connections, complete replacement of the unit may be necessary. All pump repairs should be done in a clean-side shop with clean tools.

ENVIRONMENTAL MANUAL

2.4.6 Milk

Because of iodine decay and protein binding of iodine in aging milk samples, speed is imperative in processing and samples must be kept cool to avoid degradation and spoilage of the samples. Milk samples are obtained monthly in conjunction with the State of Wisconsin Milk Sampling Program from three individual dairy farmers located north, south, and west of the site. Because two of the three sites are co-located, the PBNP pickup is coordinated to coincide with the State arranged schedule. The pickup usually will be the first Wednesday of the month.

The following sequence should be followed:

- a. After verifying the State milk pickup date with the Manitowoc Public Health Department (Mr. Alan Troullier, phone number 683-4454), notify Mr. Leon Strutz (755-2060) of the pickup date. This must be done because the Strutz farm (PBNP sampling location E-21) is not a State of Wisconsin sampling site.
- b. Because the milk must be kept cool, but not frozen, fill enough cubitainers with water and freeze to be able to put one in each shipping container. Fill the cubitainers with water and freeze the day preceding the pickup.
- c. The milk from the Strutz farm (E-21) must be picked up before 0900 because that is the time the Strutz milk is shipped. A late arrival may mean a missed sample. Milk from sites E-11 and E-19 may be picked up any time after the Strutz pickup.
- d. Identify yourself and the nature of your business at each milk pickup site. Collect two one-gallon samples from each site, using a funnel if necessary. Place each gallon in a one-gallon box liner for shipment. If shipment cannot occur on the collection day, store the milk in a clean-side refrigerator overnight. **DO NOT FREEZE.**
- e. Complete a PBNP sample tag according to Section 2.2.7 for each gallon sample and place in the box with the sample. Do not seal the box. Place the samples in insulated containers and turn them over to Ready Stores personnel for shipment. Make sure that the cover letter and, as appropriate, the contractor data collection sheets are sent according to Section 2.2.8 of this manual.

ENVIRONMENTAL MANUAL

2.4.7 Algae

Filamentous algae are collected from pilings or rocks three times per year, as available, from two locations. The long, grassy, dark green algae can normally be cut with scissors. The shorter, light green algae normally must be scraped from rocks or pilings. When scraping algae, be careful not to include pieces of rock in the sample. The sample can be lightly rinsed in the same medium in which it is growing. This rinse will help rid the sample of pieces of rock and gravel that may have been inadvertently collected with the sample. Because rocks and sediment contain naturally occurring radioactive materials, their inclusion may give false sample results. Collect between 100 and 1000 gm of algae. A sample greater than 500 gm is preferred. Place the algae in a 1000 ml cubitainer and label the container as director in Section 2.2.7. The algae must be kept cool to prevent spoilage.

2.4.8 Fish

Fish are obtained three times per year (March, August and December) as available either from the traveling screens as washed into the fish basket or by other methods as required. For any given sampling period, three fish, or a sufficient number to yield at least 1000 gm of fillets, should be provided.

Place fish in plastic bags and tape and/or tie tightly closed. Fish are stored briefly in a radiologically clean freezer. It may be desirable in warm weather to coordinate milk and fish sampling, thereby allowing simultaneous shipment in insulated containers. Pack fish samples with ice if needed. Label bags as directed in Section 2.2.7, being sure to indicate fish species when possible. Following packaging of fish, remove and discard any fish left in the freezer. This avoids sending fish that are not representative of the sampling period.

Fish are obtained four times per year (March, June, September and December) for the State of Wisconsin. Fish sampling for the State is performed in the same manner as that for the plant. Approximately four fish should be sent to the state at each sampling period.

In March and December split samples are sent to Teledyne and the State of Wisconsin. Each fish is bisected with one half going to Teledyne and the other half to the State.

ENVIRONMENTAL MANUAL

2.4.9 Soil

Soil integrates atmospheric deposition and acts as a reservoir for long-lived radionuclides. Although soil sampling is a poor technique for assessing small incremental releases and for monitoring routine releases, it does provide a means of monitoring long-term trends in atmospheric deposition in the vicinity of PBNP. Therefore, soil samples are obtained two times per year from specified locations.

Clear the vegetation from a 6" x 6" area, being careful to leave the top layer of soil relatively intact. Remove root bound soil by shaking the soil onto the cleared area or into the sample container before discarding the roots. When necessary, it is preferable to leave some roots in the soil rather than to lose the top layer of soil.

Remove the soil to a depth of three inches. If necessary, expand the area, instead of digging deeper, to obtain the required amount of sample. If an area larger than 6" x 6" is used, notify the cognizant NTSS Engineer of the area used. The minimum acceptable quantity is 500 grams. Place the entire soil sample in a 1000 ml plastic bag and seal the bag with tape. Label the sample as directed in Section 2.2.7.

This procedure assumes that the samples are obtained from undisturbed land; land that has not been plowed within approximately the last 25 years. If the land has been plowed, the soil should be sampled to the plow depth which typically is eight inches. Place the soil in a clean bucket or appropriate size plastic bag, homogenize the soil and place 1000 grams of the well mixed soil sample in a plastic bag and label as described above.

2.4.10 Shoreline Sediment

Shoreline sediment consisting of sand and smaller grain size material is sampled two times per year from specified locations. The 1000 gram sample is collected, from beach areas near the water ridge. At each location collect representative samples of sediment types roughly in proportion to their occurrence. For example, at E-06 avoid collecting a sample which consists exclusively of the dark-brown to black sediments which occur in layers up to several inches thick. Package the sample in a 1000 ml cubitainer and label as described in Section 2.2.7.

ENVIRONMENTAL MANUAL

2.5 Milk Survey

In accordance with PBNP Technical Specifications, the milk sampling program is reviewed annually, including a visual verification of animal grazing in the vicinity of the site boundary, to ensure that sampling locations remain as conservative as practicable. The verification is conducted each summer by cognizant PBNP personnel. Because it is already assumed that milk animals may graze up to the site boundary, it is only necessary to verify that these animals have not moved onto the site. No animal census is required. Upon completion of the visual check, PBNP personnel will notify NTSS in writing. To ensure performance of the annual verification, "milk review" is identified on the sampling checklist, PBF-4121.

ENVIRONMENTAL MANUAL

TABLE 2-1

RECOMMENDED MINIMUM SAMPLE SIZE

<u>Sample Type</u>	<u>Size</u>
Vegetation	100-1000 gm
Lake Water	8 liters
Air Filters	250 m ³
Well Water	8 liters
Milk	8 liters
Algae	100-1000 gm
Fish (edible portions)	1000 gm
Soil	500-1000 gm
Shoreline Sediment	500-1000 gm



ENVIRONMENTAL MANUAL

TABLE 2-2
SAMPLE TYPES AND ASSOCIATED LOWER LEVEL OF DETECTION (LLD) AND
NOTIFICATION LEVEL VALUES

SAMPLE TYPE	REPORTING UNIT	PARAMETER	LLD(a)	NOTIFICATION NRC (Regulatory)	NTSS(b) (Admin.)	LEVELS WEIGHTED SUM ACTION LEVEL
Vegetation	pCi/g wet	Gross Beta(c)	0.25	---	60	---
		Cs-137	0.08	2	0.40	0.50
		Cs-134	0.06	1	0.20	0.25
		I-131	0.06	0.1	0.06	0.06
		Other(d)	0.25	---	2.0	---
Shoreline Sediment and Soil(e)	pCi/g dry	Gross Beta	2.0	---	100	---
		Cs-137	0.15	---	20	---
		Other(d)	0.15	---	20	---
Algae	pCi/g wet	Gross Beta	0.25	---	12	---
		Cs-137	0.25	10	1	2.5
		Cs-134	0.25	10	1	2.5
		Co-58	0.25	10	1	2.5
		Co-60	0.25	10	1	2.5
		Other(d)	0.25	---	1	---
Fish	pCi/g wet	Gross Beta(c)	0.5	---	125	---
		Cs-137	0.15	2	0.40	0.50
		Cs-134	0.13	1	0.20	0.25
		Co-58	0.13	30	3	7.5
		Co-60	0.13	10	1	2.5
		Mn-54	0.13	30	3	7.5
		Fe-50	0.26	10	1	2.5
		Zn-65	0.26	20	2	5.0
		Other(d)	0.5	---	6	---
TLDs	mR/7 days	Gamma Exposure	1mR/TLD	---	5mR/7 days	---
Lakewater and Well Water	pCi/l-T.S.(f)	Gross Beta	4	---	100	---
		Cs-134	15	30	15	15
		Cs-137	18	50	18	18
		Fe-59	30	400	40	100
		Zn-65	30	300	30	75
		Zr-Nb-95	15	400	40	100
		Ba-La-140	15	200	20	50
		Co-58	15	1,000	100	250
		Co-60	15	300	30	75



ENVIRONMENTAL MANUAL

TABLE 2-2

SAMPLE TYPES AND ASSOCIATED LOWER LEVEL OF DETECTION (LLD) AND
NOTIFICATION LEVEL VALUES
(CONTINUED)

SAMPLE TYPE	REPORTING UNIT	PARAMETER	LLD(a)	NOTIFICATION NRC (Regulatory)	NTSS(b) (Admin.)	LEVELS WEIGHTED SUM ACTION LEVEL
Lakewater and Well Water (Continued)	pCi/l-T.S.(f)	Mn-54	15	1,000	100	250
		I-131(c)	2	---	2	---
		Other(c)	30	---	100	---
		H-3	3,000	30,000	3,000	7,500
		Sr-89(c)	10	---	50	---
		Sr-90(c)	2	---	20	---
Milk	pCi/l	Sr-89(c)	5	---	100	---
		Sr-90(c)	1	---	100	---
		I-131	0.5	3	0.5	0.75
		Cs-134	15	60	15	15
		Cs-137	18	70	18	18
		Ba-La-140	15	300	30	75
		Other(d)	15	---	30	---
Air Filter	pCi/m ³	Gross Beta	0.01	---	1.0	---
		I-131	0.07	0.9	0.09	0.2
		Cs-137	0.06	20	2.0	5.0
		Cs-134	0.05	10	1.0	2.5
		Other(d)	0.1	---	1.0	---

- (a) The LLDs in this column are the maximum acceptable values.
 (b) The values in this column are not technical specifications.
 (c) This parameter and associated LLD and notification level are not Technical Specifications items.
 (d) Other refers to non-tech spec identifiable gamma emitters.
 (e) These sample types and associated values are not required by the Technical Specifications.
 (f) T.S. = total solids.

ENVIRONMENTAL MANUAL

TABLE 2-3

RADIOLOGICAL ENVIRONMENTAL SAMPLING LOCATIONS

<u>Location Code</u>	<u>Location Description</u>
E-01	Meteorological Tower
E-02	Site Boundary Control Center - East Side of Building
E-03	Tapawingo Road, about 0.4 Miles West of Lakeshore Road
E-04	North Boundary
E-05	Two Creeks Park
E-06	Point Beach State Park - Coast Guard Station
E-07	WPSC Substation on County Rt. V, about 0.5 Miles West of Hwy. 42
E-08	G. J. Francar Property, at the Southeast Corner of the Intersection of Hwy. 163 and Zander Road
E-09	Nature Conservancy
E-10	PBNP Site Well
E-11	Dairy Farm (W. Funk), about 3.75 Miles West of Site
E-12	Discharge Flume/Pier
E-13	Pumphouse
E-14	South Boundary, about 0.2 miles East of Site Boundary Control Center
E-15	Southwest Corner of Site
E-16	WSW, Hwy. 42, Bishop Residence, about 0.25 miles North of Nuclear Road
E-17	North of Mishicot, Hwy. 163 and Assman Road, Northeast Corner of Intersection
E-18	Northwest of Two Creeks at Zander and Tannery Roads
E-19	Local Dairy Farm, about 0.2 miles West of Hwy. 42 on the North Side of Two Creeks Road (L. Engelbrecht)
E-20	Reference Location, 17 miles Southwest, at Silver Lake College
E-21	Local Dairy Farm just South of Site (L. Strutz) on Lakeshore and Irish Roads
E-22	West Side of Hwy. 42, about 0.25 miles North of Johanek Road
E-23	Greenfield Lane, about 4.5 Miles South of Site, 0.5 Miles East of Hwy. 42
E-24	North Side of County Rt. V, near intersection of Saxonburg Road
E-25	South Side of County Rt. BB, about 0.5 miles West of Norman Road
E-26	804 Tapawingo Road, about 0.4 miles East of Hwy. 163, North Side of Road
E-27	Intersection of Saxonburg and Nuclear Roads, Southwest Corner, about 1 Miles WSW

ENVIRONMENTAL MANUAL

TABLE 2-3

RADIOLOGICAL ENVIRONMENTAL SAMPLING LOCATIONS
(CONTINUED)

E-28	Nature Trail sign in parking lot on West side of EIC.
E-29	On tree on bluff overlooking Lake Michigan NE of Microwave Tower and due East of MET Tower.
E-30	NE corner at Intersection of Tapawingo and Lakeshore Roads.
E-31	On utility pole North side of Tapawingo Road closest to the gate at the West property line
E-32	On a tree located at the junction of property lines, as indicated by trees and shrubs, about 1000 feet east of the west gate on Tapawingo Road and about 1200 feet south of Tapawingo Road. The location is almost under the power lines between the blue and gray transmission towers.
E-TC	Transportation Control; Reserved for TLDs



ENVIRONMENTAL MANUAL

TABLE 2-4

PBNP RADIOLOGICAL ENVIRONMENTAL SAMPLE COLLECTION FREQUENCY

Sample Type	Sample Codes	Collection Frequency
Environmental Radiation Exposure	E-01, -02, -03, -04, -05, -06, -07, -08, -09, -12, -14, -15, -16, -17, -18, -20, -22, -23, -24, -25, -26, -27, -28, -29, -30, -31, -32	Quarterly
Vegetation	E-01, -02, -03, -04, -06, -08, -09, -20	3x/yr as available
Algae	E-05, -12	3x/yr as available
Fish	E-13	3x/yr as available
Well Water	E-10	Quarterly
Lake Water	E-01, -05, -06, -09, -12	E-12 collected weekly for monthly composite. Others collected monthly.
Milk	E-11, -19, -21	Monthly
Air Filters	E-01, -02, -03, -04, -08, -20	Weekly particulate filters and charcoal canisters by continuous air sampler.
Soil	E-01, -02, -03, -04, -06, -08, -09, -20	2x/yr
Shoreline Sediment	E-01, -05, -06, -09, -12	2x/yr



ENVIRONMENTAL MANUAL

TABLE 2-5

PBNP RADIOLOGICAL ENVIRONMENTAL SAMPLE ANALYSIS AND FREQUENCY

Sample Type	Sample Codes	Analyses	Frequency
Environmental Radiation Exposure	E-01, -02, -03, -04, -05 -06, -07, -08, -09, -12 -14, -15, -16, -17, -18, -20, -22, -23, -24, -25, -26, -27, -28, -29, -30, -31, -32, -TC	TLD	Quarterly
Vegetation	E-01, -02, -03, -04, -06, -08, -09, -20	Gross Beta Gamma Isotopic Analysis	3x/yr as available
Algae	E-05, -12	Gross Beta Gamma Isotopic Analysis	3x/yr as available
Fish	E-13	Gross Beta Gamma Isotopic Analysis (Analysis of edible portions only)	3x/yr as available
Well Water	E-10	Gross Beta, H-3 Sr-89, 90, I-131 Gamma Isotopic Analysis (on total solids)	Quarterly
Lake Water	E-01, -05, -06, -09, -12	Gross Beta H-3, Sr-89, 90 I-131 Gamma Isotopic Analysis (on total solids)	Monthly Quarterly composite of monthly collections Monthly Monthly
Milk	E-11, -19, -21	Sr-89, 90 I-131 Gamma Isotopic Analysis	Monthly
Air Filters	E-01, -02, -03, -04, -08, -20	Gross Beta I-131 Gamma Isotopic Analysis	Weekly (particulate) Weekly (charcoal) Quarterly (on composite particulate filters)
Soil	E-01, -02, -03, -04, -06, -08, -09, -20	Gross Beta Gamma Isotopic Analysis	2x/yr
Shoreline Sediment	E-01, -05, -06, -09, -12	Gross Beta Gamma Isotopic Analysis	2x/yr

ENVIRONMENTAL MANUAL


TABLE 2-6

SAMPLES COLLECTED FOR STATE OF WISCONSIN

<u>Sample Type</u>	<u>Location</u>	<u>Frequency</u>
1. Lake Water	E-12 E-05	Weekly, Composited Monthly Quarterly
2. Air Filters	E-07 E-08 Buechert Residence	Weekly
3. Fish	E-13	Quarterly, As Available
4. Precipitation	E-01 E-04 E-07 E-08	Twice a month, As Available




ENVIRONMENTAL MANUAL

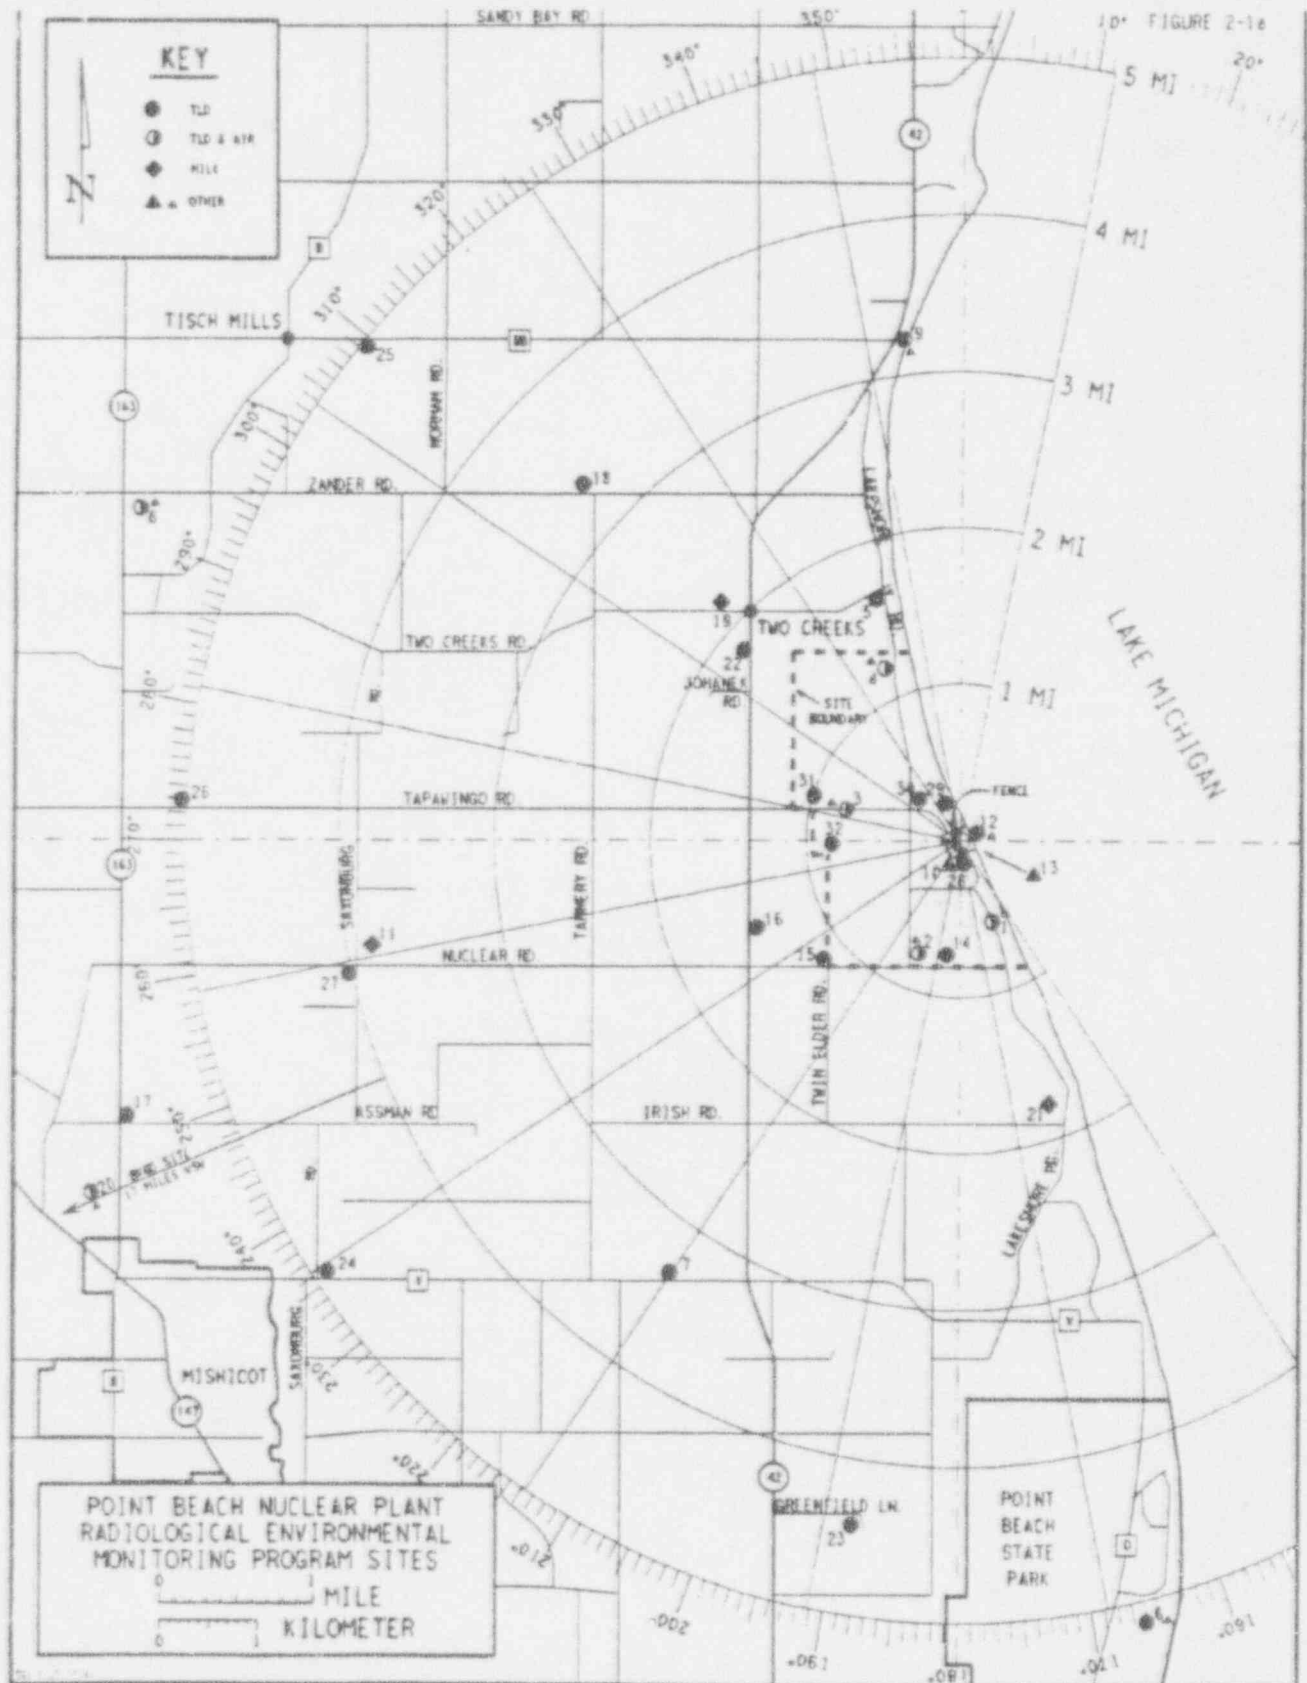



ENVIRONMENTAL MANUAL

Figure 2-1b

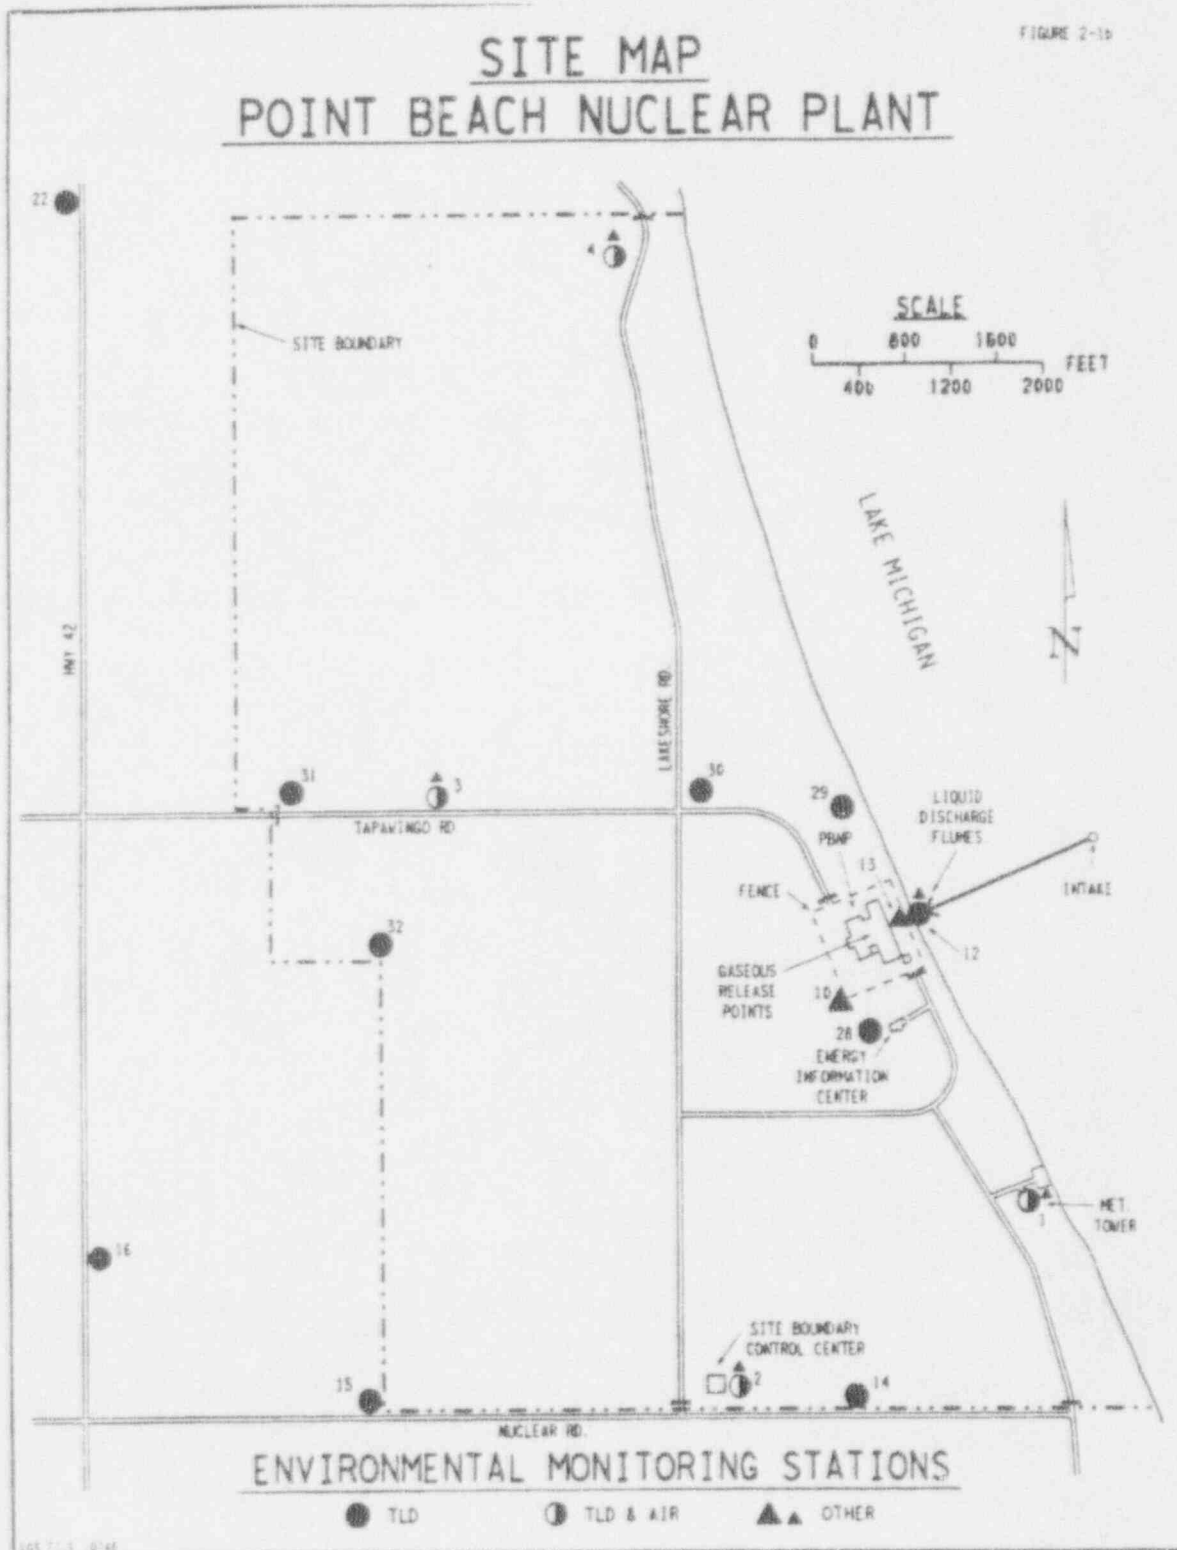



ENVIRONMENTAL MANUAL

Figure 2-2

POINT BEACH NUCLEAR PLANT

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
SAMPLING PROBLEM REPORT FORM

Location Number and Description _____

Sample Type _____* Date _____

Type of Problem (Check One)

_____ Lost in Field

_____ Lost in Transit to Contractor Laboratory

_____ Sample Not Available

_____ Other (Explain) _____

Cause of Sampling Problem: _____

Description of Sampling Problem: _____

Suggestions (if any) for Preventing Recurrence: _____

Reported By _____ Date _____

Reviewed By _____ Date _____

*Sample Type Code

AP - Airborne Particulates

AI - Airborne Iodines

TLD - Thermoluminescent Dosimeter

ML - Milk

WW - Well Water

G - Grasses and Weeds

F - Fish

SL - Slime, Aq. Vegetation

SS - Shoreline Sediment

SP - Special Sample (Indicate what kind)

SO - Soil

LW - Lakewater

ENVIRONMENTAL MANUAL

3.0 NON-RADIOLOGICAL MONITORING

The measurement of meteorological data is the only non-radiological environmental monitoring currently required by PBNP Technical Specifications. In accordance with Amendment Nos. 69 and 74 to Facility Operating Licenses DPR-24 and DPR-27, respectively dated March 11, 1983, all other non-radiological environmental monitoring has been deleted. The meteorological data are kept on site for review by the NRC upon request.



ENVIRONMENTAL MANUAL

APPENDIX A

RADIOLOGICAL ENVIRONMENTAL MONITORING TECHNICAL SPECIFICATIONS

15.7.7 OPERATIONAL ENVIRONMENTAL MONITORING PROGRAM

Applicability

This section applies to operational environmental radioactivity monitoring and sampling.

Objective

To verify that plant operations have no significant radiological effects on the environment.

Specifications

A. Environmental Monitoring Program

1. Environmental monitoring samples shall be taken at locations specified in the PBNP Environmental Manual according to the sampling and collection frequencies given in Table 15.7.7-1.
2. Deviations from the required sampling schedule as specified in Table 15.7.7-1, are permitted if hazardous conditions, seasonal unavailability, automatic sampling equipment malfunctions, and other legitimate reasons make the sample unobtainable. If the radiological environmental monitoring program is not being conducted as specified in Table 15.7.7-1, a description of the reasons for not conducting the program and the plans for preventing a recurrence will be submitted with the next Semiannual Monitoring Report.
3. If milk or vegetation samples become unavailable from one or more of the sample locations specified in the PBNP Environmental Manual, identify locations for obtaining replacement samples and add them to the radiological environmental monitoring program within 30 days. The specific locations from which samples were unavailable may then be deleted from the monitoring program. The cause of the unavailability of samples and replacement samples shall be

identified in the next Semiannual Monitoring Report. Figures and tables in the Environmental Manual are to be revised reflecting the new sample locations.

B. Detection Capabilities

1. Environmental samples shall be analyzed as specified in Table 15.7.7-2.
2. The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs).
3. If circumstances render the stated LLDs in Table 15.7.7-2 unachievable, the contributing factors shall be identified and described in next Semiannual Monitoring Report.

C. Notification Levels

1. If a measured level of radioactivity in any environmental medium exceeds the notification level listed in Table 15.7.7-3, resampling and/or reanalysis for confirmation shall be completed within 30 days of the determination of the anomalous result. If the confirmed measured level of radioactivity remains above the notification level, a written report shall be submitted to the NRC in accordance with Section 15.7.8.4.B within thirty days of the confirmation. This report is not required if the measured level of radioactivity was not the result of plant effluents.
2. If more than one of the radionuclides listed in Table 15.7.7-3 are detected in any environmental medium, a weighted sum calculation shall be performed if the measured concentration of a detected radionuclide is greater than 25% of the notification levels. For those radionuclides with LLDs in excess of 25% of the notification level, a weighted sum calculation need only be performed if the reported value exceeds the LLD. The weighted sum is calculated as follows:

$$\frac{\text{concentration (1)}}{\text{notification level (1)}} + \frac{\text{concentration (2)}}{\text{notification level (2)}} + \dots = \text{weighted sum}$$

If the calculated weighted sum is equal to or greater than 1, resampling and/or reanalysis for confirmation shall be completed within 30 days of the determination of the anomalous result. If

the confirmed calculated weighted sum remains equal to or greater than 1, a written report shall be submitted to the NRC in accordance with Section 15.7.8.4.B within thirty (30) days of the confirmation. This calculation requirement and report is not required if the measured level of radioactivity was not the result of plant effluents. ~

3. All detected radionuclides shall be reported in the Semiannual Monitoring Reports. Naturally occurring nuclides such as Be-7, K-40, and the U-238 and Th-232 decay series radionuclides shall not be included in this requirement.

D. Land Use Census

1. The milk sampling program shall be reviewed annually, including a visual verification of animals grazing in the vicinity of the site boundary, to ensure that sampling locations remain as conservative as practicable.

E. Interlaboratory Comparison Program

1. The environmental sampling analyses shall be performed by a laboratory participating in an Interlaboratory Comparison Program.
2. If the analytical laboratory is not participating in the Interlaboratory Comparison Program, a description of the corrective actions to be taken to preclude a recurrence shall be submitted in the Semiannual Monitoring Report.

Basis

The operational radiological environmental monitoring program as outlined in Table 15.7.7-1 provides sufficient sample types and locations to detect and to evaluate changes in environmental radioactivity. Although radioactivity in plant effluents is continuously monitored and releases are well below levels which are considered safe upper limits, radiological environmental monitoring is a conservative measure undertaken to determine whether the operation of the Point Beach Nuclear Plant produces any significant radiological change in the surrounding environment.

Radioactivity is released in liquid and gaseous effluents. Air particulate samples and thermoluminescent dosimeters placed at various locations provide means of detecting changes in environmental radioactivity as a result of plant releases to the atmosphere.

The land in the area of Point Beach Nuclear Plant is used primarily for farming and dairy operations. Therefore, radiological environmental sampling of vegetation is conducted to detect changes in radiological conditions at the base of the food chain. Sampling of area-produced milk is carried out because dairy farming is a major industry in the area.

Water, periphyton, and fish are analyzed to monitor radionuclide levels in Lake Michigan in the vicinity of PBNP. Periphyton, attached algae, concentrate radionuclides from the surrounding lake water. Therefore, algae samples, along with lakewater samples, provide a means of detecting changes which may have a potential impact on the radionuclide concentrations in Lake Michigan fish. Because of the migratory behavior of fish, fish sampling is of minimal value for determining radiological impact specifically related to the operation of the Point Beach Nuclear Plant. However, fish sampling is carried out as a conservative measure with emphasis on species which are of intermediate trophic level and which exhibit minimal migration in order to monitor the status of radioactivity in fish.

Vegetation, algae, and fish sampling frequencies are qualified on an "as available" basis recognizing that certain biological samples may occasionally be unavailable due to environmental conditions.

TABLE 15.7.7-1

OPERATIONAL RADIOLOGICAL ENVIRONMENTAL PROGRAM

SAMPLE TYPE	NUMBER & LOCATION OF SAMPLES	COLLECTION FREQUENCY	ANALYSIS TYPE AND FREQUENCY
Direct environmental	<p>23 TLDs are distributed as follows: (Each TLD contains 2 chips)</p> <p>9 - In the general area of the site boundary in the nine meteorological sectors around the Point Beach Nuclear Plant</p> <p>1 - On the Lake Michigan side of PBNP</p> <p>11 - In a ring around PBNP at a distance of 3 to 6 miles from the plant</p> <p>1 - Background reference in a low D/Q area greater than 16 miles from PBNP</p> <p>1 - Transport control</p>	Quarterly	Gamma dose quarterly
Vegetation	<p>8 samples of vegetation obtained as follows:</p> <p>1 - Background reference as described above</p> <p>4 - In the general area of the site boundary</p> <p>3 - At locations N, W and S of PBNP at 3-6 miles from the plant</p>	3x/yr as available	Radioiodine and gamma isotopic analysis performed 3x/yr as samples are available

TABLE 15.7.7-1 (Continued)

SAMPLE TYPE	NUMBER & LOCATION OF SAMPLES	COLLECTION FREQUENCY	ANALYSIS TYPE AND FREQUENCY
Well water	1 - Onsite well	Quarterly	H-3 quarterly with gamma isotopic analysis performed quarterly on total solids
Lake water	1 - Discharge flume 2 - N of discharge 0.5 to 5 miles from PBNP 2 - S of discharge 0.5 to 5 miles from PBNP	Monthly (discharge flume is collected weekly and composited for monthly analysis)	Monthly gross beta and gamma isotopic analysis of total solids, H-3 analysis quarterly on composite
Air filters	1 - Reference location as described above 4 - In the general area of the site boundary 1 - About 6 miles W of PBNP	Weekly by continuous air sampler	Radioiodine weekly on charcoal canisters. Gross beta weekly on particulate filters after at least 24 hours decay. Gamma isotopic analysis quarterly on particulate filter composites.
Milk	3 - Dairy farms about 2-6 miles N, W, and S of PBNP	Monthly	Monthly gamma isotopic analysis and radiiodine analysis
Fish	1 - Travelling screens	3x/yr as available	Gamma isotopic analysis 3x/yr as available. Analysis of edible portions only
Algae	2 - Along shore within 5 miles N and S of discharge	3x/yr as available	Gross beta and gamma isotopic analysis 3x/yr as available

TABLE 15.7.7-2 RADIOLOGICAL ENVIRONMENTAL MONITORING ANALYSIS¹
 LOWER LIMIT OF DETECTION (LLD)²

<u>Analysis</u>	<u>Vegetation (pCi/g wet)</u>	<u>Airborne (pCi/m³)</u>	<u>Milk (pCi/l)</u>	<u>Well Water & Lake Water³ (pCi/l)-T.S.⁴</u>	<u>Algae (pCi/g wet)</u>	<u>Fish (pCi/g wet)</u>
Gross Beta		0.01		4	0.25	
H-3				3,000		
Gamma Scan						
I-131	0.06	0.07	0.5			
Cs-137	0.08	0.06	18	18	0.25	0.15
Cs-134	0.06	0.05	15	15	0.25	0.13
Co-58				15	0.25	0.13
Co-60				15	0.25	0.13
Ba-La-140			15	15		
Zr-Nb-95				15		
Fe-59				30		0.26
Zn-65				30		0.26
Mn-54				15		0.13

NOTES FOR TABLE 15.7.7-2

1. For gamma isotopic analysis of environmental samples, the spectrum is scanned over the energy range of 80 to 2048 KeV for gamma ray emitting radionuclides which may be attributable to Point Beach Nuclear Plant effluents. The analysis specifically includes, but is not limited to Mn-54, Fe-59, Zn-65, Co-58, Co-60, Zr-Nb-95, Ru-103, Ru-106, I-131, Ba-La-140, Cs-134, Cs-137, Ce-141, and Ce-144.
2. The environmental TLDs have an LLD of 1 mrem/chip.
3. No drinking water
4. T.S. = total solids

TABLE 15.7.7-3 RADIOLOGICAL ENVIRONMENTAL MONITORING ANALYSIS

NOTIFICATION LEVELS

<u>Analysis</u>	<u>Vegetation (pCi/g wet)</u>	<u>Airborne (pCi/m³)</u>	<u>Milk (pCi/l)</u>	<u>Well Water & Lake Water (pCi/l)-T.S.</u>	<u>Algae (pCi/g wet)</u>	<u>Fish (pCi/g wet)</u>
H-3				30,000		
I-131	0.1	0.9	3			
Cs-137	2	20	70	50	10	" 2
Cs-134	1	10	60	30	10	1
Co-58				1,000	10	30
Co-60				300	10	10
Ba-La-140			300	200		
Zr-Nb-95				400		
Fe-59				400		10
Zn-65				300		20
Mn-54				1,000		30

POINT BEACH NUCLEAR PLANT
UNITS 1 AND 2

OFFSITE DOSE CALCULATION MANUAL

WISCONSIN ELECTRIC POWER COMPANY

January 1993

Revision 6

TABLE OF CONTENTS

	<u>Page</u>
1.0 <u>OFFSITE DOSE CALCULATION MANUAL ADMINISTRATION</u>	1-1
1.1 Purpose	1-1
1.2 General Responsibilities	1-1
1.3 Manual Revisions	1-2
2.0 <u>RADIATION MONITORING SYSTEM (RMS)</u>	2-1
3.0 <u>METHODOLOGY FOR DETERMINING RMS ALERT AND ALARM SETPOINTS</u>	3-1
3.1 Introduction	3-1
3.2 Objective	3-1
3.3 Alert Setpoint Guidelines	3-1
3.4 Alarm Setpoint Guidelines	3-1
3.5 Monitor Calibration and Calibration Constant Determination	3-2
3.6 Determination of Effective Maximum Effluent Concentration (EMEC) for Liquid Releases	3-3
3.7 Determination of Liquid Effluent Monitor Alarm Setpoints	3-4
3.8 Determination of EMEC for Atmospheric Releases	3-8
3.9 Determination of Gaseous Effluent Monitor Alarm Setpoints	3-8
4.0 <u>DEMONSTRATING COMPLIANCE WITH 10 CFR 50, APPENDIX I</u>	4-1
4.1 Introduction	4-1
4.2 Dose Limits	4-1
4.3 Release Limits	4-2
4.4 EPA Regulations	4-5
5.0 <u>CALCULATION AND COMPARISON OF EFFLUENT RELEASES TO RELEASE LIMITS</u>	5-1
5.1 Appendix I Dose Calculations	5-1
5.1.1 Liquid Release Mode	5-1
5.1.2 Atmospheric Release Mode: Radioiodine, Tritium, and Particulates	5-17
5.1.3 Atmospheric Release Mode: Noble Gases	5-31
6.0 <u>RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM</u>	6-1
7.0 <u>RADIOLOGICAL IMPACT EVALUATIONS OF SEWAGE TREATMENT SLUDGE DISPOSAL</u>	7-1
7.1 Basis	7-1
7.2 Procedure	7-1

Appendix A	A-1
A1.0 Derivation of Liquid Release Effective Maximum Effluent Concentration	A-2
A1.1 Source Term	A-2
A1.2 Effective Maximum Effluent Concentration	A-2
Appendix B	B-1
B1.0 Derivation of Atmospheric Release Effective Maximum Effluent Concentration	B-2
B1.1 Source Term	B-2
B1.2 Effective Maximum Effluent Concentration	B-2
Appendix C	C-1
C1.0 Calculation of Total Dose Factors Using Regulatory Guide 1.109 Methodology	C-2
C1.1 Liquid Release Dose Factors	C-2
C1.1.1 Aquatic Foods	C-2
C1.1.2 Irrigated Foods (Meat from Watered Cattle)	C-4
C1.1.3 Irrigated Foods (Milk from Watered Cattle)	C-6
C1.1.4 Potable Water	C-8
C1.1.5 Shoreline Deposits	C-10
C1.2 Atmospheric Release Dose Factors: Non-Gaseous	C-12
C1.2.1 Inhalation of Nuclides in Air	C-12
C1.2.2 Annual Organ Dose from External Irradiation From Nuclides Deposited on the Ground	C-13
C1.2.3 Annual Organ Dose from Atmospherically Released Nuclides in Milk	C-14
C1.2.4 Annual Organ Dose from Atmospherically Released Nuclides in Meat	C-17
C1.2.5 Annual Organ Dose from Atmospherically Released Nuclides in Produce	C-20
C1.2.6 Annual Organ Dose from Atmospherically Released Nuclides in Leafy Vegetables	C-22
C1.3 Atmospheric Release Dose Factors: Noble Gases	C-23
C1.3.1 Annual Gamma and Beta Dose from All Noble Gas Releases	C-24
C1.3.2 Annual Skin Dose from All Noble Gas Releases	C-25
C1.3.3 Annual Total Body Dose from All Noble Gas Releases	C-26
Appendix D	D-1
D1.0 Liquid Effluent Dilution Factor Calculations	D-2

D1.1	Methodology	D-2
D1.2	Dilution Factor Twelve Miles Downstream: Two Rivers Water Intake	D-5
Appendix E	NRC Submittal: Radiological Impact Evaluation of Sewage Treatment Sludge	E-1
Appendix F	Modification to NRC Submittal	F-1

LIST OF TABLES AND FIGURES

	<u>Page</u>
 <u>SECTION 2.0</u>	
Table 2-1 Radioactive Liquid Waste Effluent Monitors	2-2
Table 2-2 Radioactive Gaseous Waste Effluent Monitors	2-3
Figure 2-1 Radioactive Liquid Waste Effluent Monitors	2-4
Figure 2-2 Radioactive Gaseous Waste Effluent Monitors	2-5
 <u>SECTION 3.0</u>	
Table 3.7-1 Summary of Liquid Dilution and Effluent Pathway Flow Rates	3-6
Table 3.7-2 Liquid Pathway Monitor Calculated Default Setpoints	3-7
Table 3.9-1 Summary of Gaseous Effluent Pathway Discharge Flow Rates	3-9
Table 3.9-2 Atmospheric Pathway Monitor Default RMS Setpoints	3-11
 <u>SECTION 5.0</u>	
Table 5.1-1 Liquid Effluent Dose Conversion Factors	5-3
Table 5.1-2 Airborne Effluent Dose Factors	5-18
Table 5.1-3 Activity to Dose Conversion Factors for Noble Gases	5-32
 <u>APPENDIX A</u>	
Table A-1 Curies Released in Liquids	A-3
Table A-2 Fractional MEC in Liquid Effluent	A-4
 <u>APPENDIX B</u>	
Table B-1 Curies in Atmospheric Effluent	B-3
Table B-2 Fractional MEC for Atmospheric Effluent	B-4
 <u>APPENDIX D</u>	
Table D-1 Surface Dilution Factors, Liquid Effluent in a Large Lake	D-3
Figure D-1 Dilution Factor at Surface	D-4

1.0 OFFSITE DOSE CALCULATION MANUAL ADMINISTRATION

1.1 Purpose

The PBNP Offsite Dose Calculation Manual contains the current methodology and parameters for the calculation of offsite doses due to radioactive gaseous and liquid effluents. This manual describes a methodology for demonstrating compliance with 10 CFR 50, Appendix I dose limits. Compliance with Appendix I is demonstrated by periodic calculation of offsite doses based on actual plant releases and comparison to Appendix I dose limits.

The manual also details the methodology for the determination of gaseous and liquid effluent monitor alarm setpoints. The PBNP Radiation Monitoring System (RMS) effluent monitor alarm setpoints are established to ensure that controlled releases of liquid and gaseous radioactive effluents are maintained as low as is reasonably achievable and to ensure releases result in concentrations to unrestricted areas within limits specified in 10 CFR 20.

The manual also details the methodology for evaluating the radiological impact of sewage treatment sludge disposal. This methodology addresses the commitments made to the United States Nuclear Regulatory Commission in our application dated October 8, 1987 (NRC-87-104) and accepted by the USNRC in a letter dated January 13, 1988. This application was submitted in accordance with the provisions of 10 CFR 20.302(a). A copy of the submittal and subsequent modifications is contained in Appendices E and F. Dose limits are established in the application to ensure the health and safety of the maximally exposed member of the general public and the inadvertent intruder. 10 CFR 50 Appendix I dose limits do not apply to sewage treatment sludge disposal.

1.2 General Responsibilities

The primary responsibility for the implementation of the PBNP offsite dose calculation program and for any actions required by the program resides with the Manager and the staff of the Nuclear Industry and Regulatory Services Section (IRSS). IRSS will provide the technical, regulatory, licensing, and administrative support necessary to fulfill the requirements of this manual. The calculation of offsite doses and analysis of data are IRSS responsibilities.

The Manager, PBNP is responsible for assuring that Radiation Monitoring System alarm setpoints are established and maintained in accordance with the methodologies outlined in this manual. The Manager, PBNP is also responsible for assuring the performance of periodic release summaries for the purpose of demonstrating compliance with PBNP effluent release limits.

1.3. Manual Revisions

This manual describes the current scope of the PBNP offsite dose calculation program. The program and the manual are maintained by IRSS. Program items or procedures may be periodically updated or changed, either to reflect new parameters or to improve program effectiveness. This manual may be revised at the discretion of IRSS with the concurrence of the PBNP Manager's Supervisory Staff (MSS).

2.0 RADIATION MONITORING SYSTEM AND RELEASE ACCOUNTING

A computerized Radiation Monitoring System (RMS) is installed at Point Beach Nuclear Plant (PBNP). The RMS includes area, process, and effluent monitors. A description of those monitors used for liquid and gaseous effluents is presented in Tables 2-1 and 2-2. The liquid and gaseous waste processing flow paths, equipment, and monitoring systems are depicted in Figures 2-1 and 2-2. Calibration of the RMS detectors is accomplished in accordance with procedures contained in the PBNP Health Physics Calibration Manual. The setpoint methodology is described in Section 3 of this manual.

The RMS is designed to detect and measure liquid and gaseous releases from the plant effluent pathways. The RMS will initiate isolation and control functions on certain effluent streams identified in Table 2-1 and 2-2. Complete monitoring and accounting of nuclides released in liquid and gaseous effluents is accomplished with the RMS together with the characterization of nuclide distributions by laboratory analysis of grab samples. Sampling frequencies and analysis requirements are described in Tables 15.7.6-1 and 15.7.6-2 of the PBNP Technical Specifications. The various aspects of grab sampling and release accountability are described in the PBNP Release Accountability Manual.

TABLE 2-1
RADIOACTIVE LIQUID WASTE EFFLUENT MONITORS

<u>Channel Number</u>	<u>Name</u>	<u>Control Function</u>	<u>Detector Type</u>
1(2) RE-216	Containment Fan Coolers Liquid Monitors	None	Scintillation
RE-218	Waste Disposal System Liquid Monitor	Shuts waste liquid overboard	Scintillation
1(2) RE-219	Steam Generator Blowdown Liquid Monitors	Shuts steam generator blowdown: isolation valves, blowdown tank outlet valves and steam generator sample valves	Scintillation
RE-220	Spent Fuel Pool Liquid Monitor	None	Scintillation
RE-223	Waste Distillate Overboard Liquid Monitor	Shuts waste distillate overboard isolation valve	Scintillation
1(2) RE-229	Service Water Discharge Monitors	None	Scintillation
RE-230	Retention Pond Discharge Liquid Monitor	None	Scintillation
1(2) RE-222	Steam Generator Blowdown Tank Outlet Monitor	Shuts steam generator blowdown isolation valves and blowdown tank outlet valves	GM Tube

TABLE 2-2
RADIOACTIVE GASEOUS WASTE EFFLUENT MONITORS

<u>Channel Number</u>	<u>Name</u>	<u>Control Function</u>	<u>Detector Type</u>
1(2) RE-212	Containment Noble Gas Monitor	Actuates containment ventilation isolation	Scintillation
RE-214	Auxiliary Building Exhaust Ventilation Noble Gas Monitor	Shuts gas release valve and shifts auxiliary building exhaust through carbon filters	Scintillation
1(2) RE-215	Condenser Air Ejector Noble Gas Monitors	None	Scintillation
RE-225	Combined Air Ejector Low-Range Noble Gas Monitor	None	Scintillation
RE-221	Drumming Area Vent Noble Gas Monitor	None	Scintillation
RE-224	Gas Stripper Building Exhaust Noble Gas Monitor	None	Scintillation
1(2) RE-305	Unit 1 and 2 Purge Exhaust Noble Gas Monitors (Channel 5 on SPING Units No. 21 and No. 22)	Containment ventilation isolation	Scintillation
RE-315	Auxiliary Building Exhaust Ventilation Noble Gas Monitor (Channel 5 on SPING Unit No. 23)	None	Scintillation
RE-325	Drumming Area Ventilation Noble Gas Monitor (Channel 5 on SPING Unit No. 24)	None	Scintillation

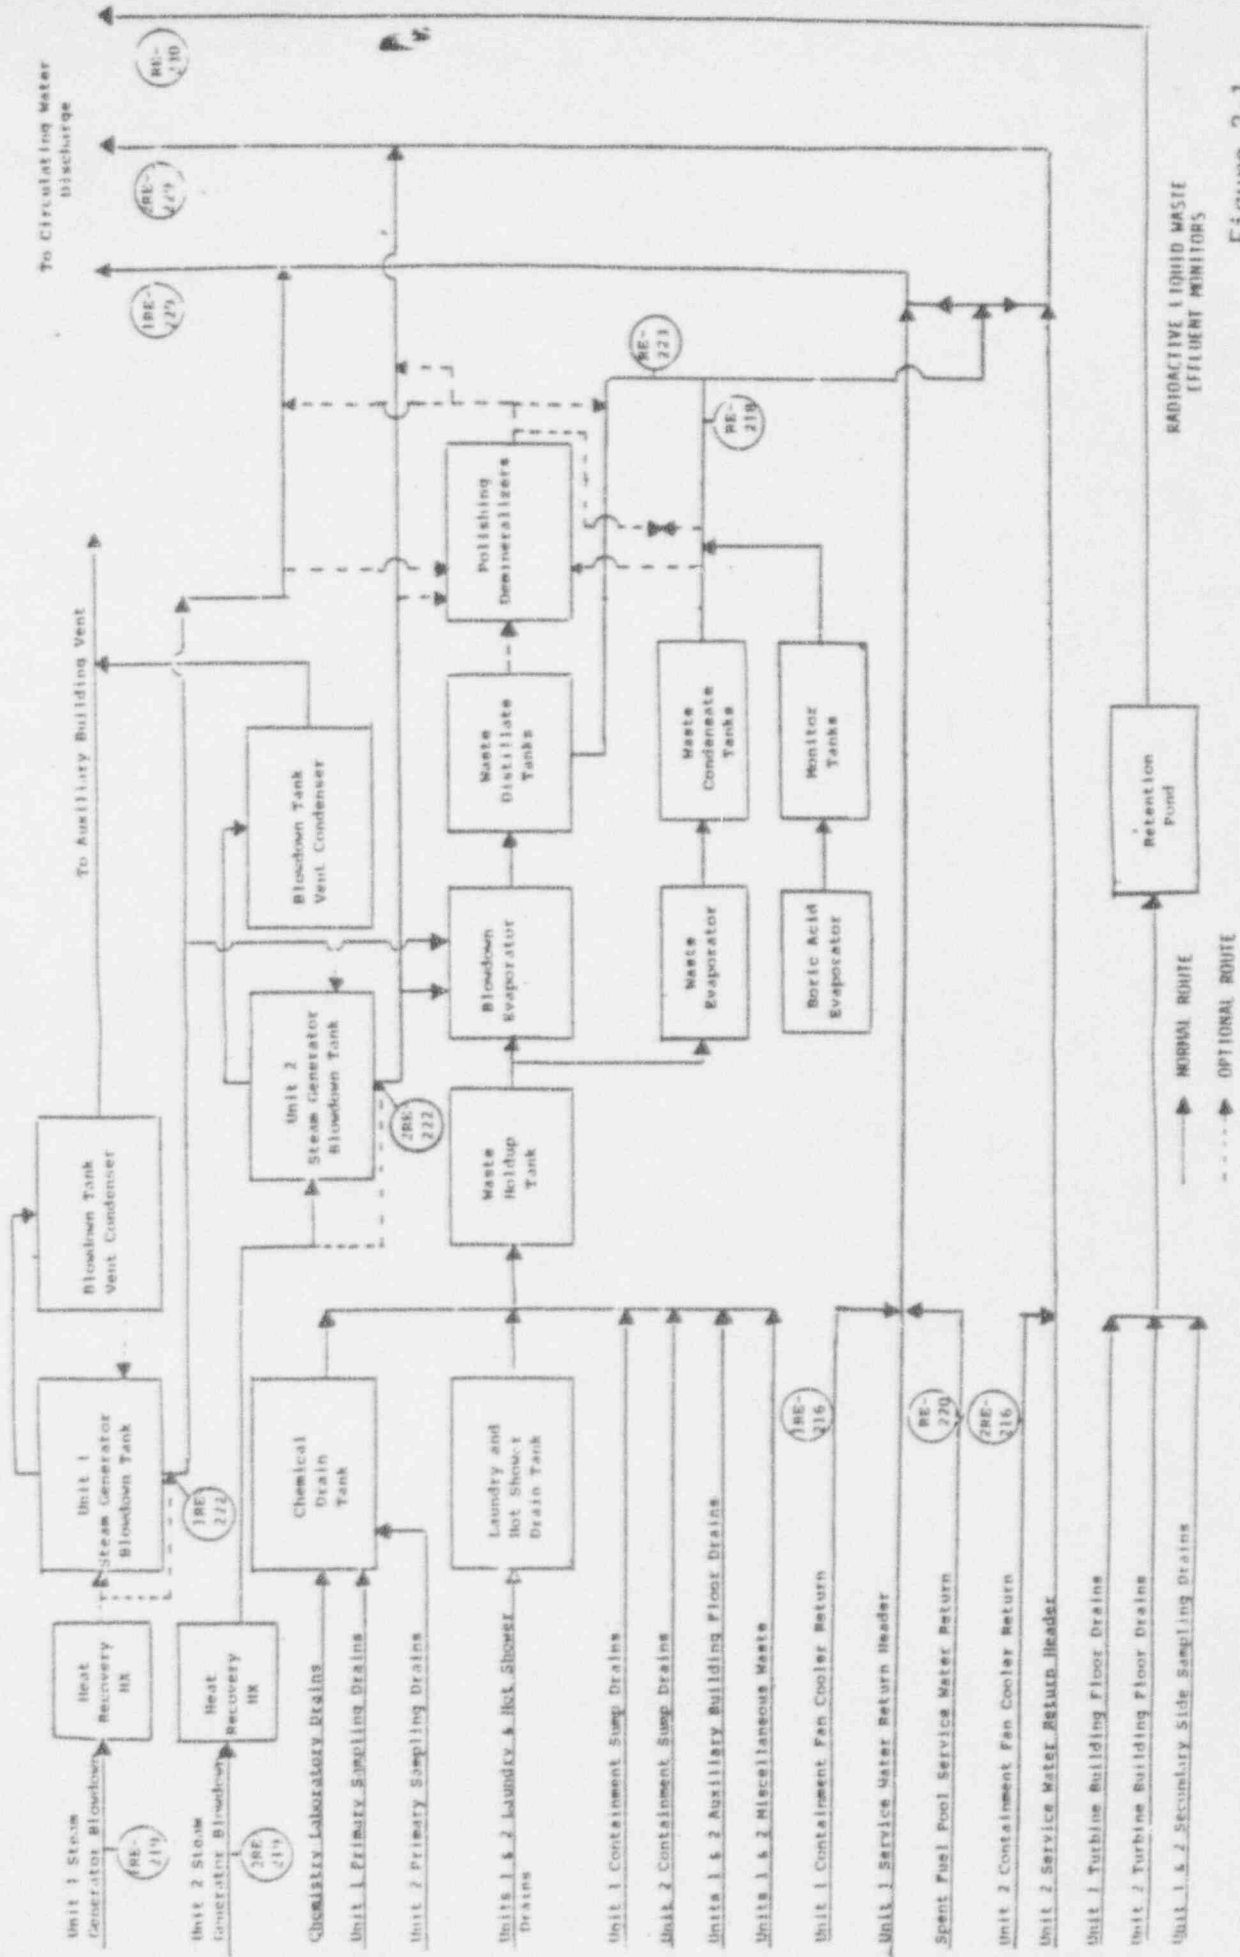


Figure 2-1



3.0 METHODOLOGY FOR DETERMINING ALARM SETPOINTS

3.1 Introduction

The selection and maintenance of alert and alarm setpoints for each effluent monitor of the PBNP radiation monitoring system will be accomplished within the guidelines of this section. The computerized PBNP radiation monitoring system permits each effluent radiation monitor to be programmed to alarm at two distinct setpoints. The alert setpoint, typically twice the steady-state reading, is intended to delineate a changing plant condition which may warrant corrective action. The high alarm or trip setpoint either will actuate a control function as applicable or will require corrective action to be initiated.

3.2 Objective

The effluent monitor setpoints are established to ensure that controlled releases of liquid and gaseous radioactive effluents are maintained as low as is reasonably achievable, to ensure releases result in concentrations to unrestricted areas within limits specified in 10 CFR 20, and to ensure that the dose limits of 10 CFR 50, Appendix I are not exceeded.

3.3 Alert Setpoint Guidelines

The alert setpoint of each effluent monitor generally will be set to alarm at two times the established steady-state reading. The alert setpoint is normally set at concentrations well below the alarm setpoint value and is never to be set in excess of the alarm setpoint. In the course of plant operations, certain situations may require a deviation from the two times steady-state guideline. The intent of the alert setpoint is to warn of changing plant conditions which may warrant an evaluation of the cause of the increased radiation. If the increased reading is actually due to an increased radiation inventory within the system being monitored, as opposed to an increased background radiation field in the vicinity of the detector, an evaluation should be made to determine the impact of the release. The alert setpoint may be adjusted with the approval of the Duty Shift Superintendent. Alert setpoint adjustments are to be made in accordance with the PBNP RMS Alarm Setpoint and Response Book.

3.4 Alarm or Trip Setpoint Guidelines

In accordance with the requirements of Technical Specifications 15.7.5.A.2 and 15.7.5.C.2, the alarm or trip setpoint for effluent monitors shall be established to annunciate at radiation levels which would result in an unrestricted area concentration equal to or less than the applicable maximum effluent concentration (MEC) specified in 10 CFR 20, Appendix B, Table 2 for a single radionuclide. However, for a mixture of radionuclides, the setpoint shall be established so that the summation of fractions, as defined in Appendix B of 10 CFR 20, is less than or equal to one (1). The appropriate detailed response to an effluent alarm is described in the PBNP RMS Alarm Setpoint and Response Book.

3.5 Monitor Calibration and Calibration Constant Determination

Calibration of the RMS effluent detectors is accomplished in accordance with procedures contained in the PBNP Health Physics Calibration Manual. Noble gas effluent monitors apply the calibration constant to standardize all gaseous releases to the 1985-1991 average isotopic noble gas distribution. The calibration constants are based on the calculated monitor response to the beta energy distribution in the 1985-1991 average isotopic noble gas distribution.

Noble gas effluent monitor calibration constants are derived from the following formulae:

$$\text{Cal. Constant} = \frac{1}{\text{Sensitivity}}$$

and

$$\text{Sensitivity} = \frac{\text{Monitor Response}}{I (\mu\text{Ci/cc})}$$

where:

Monitor response = the calculated counts per minute registered by monitor exposed to the 1985-1991 average noble gas isotopic distribution

$I (\mu\text{Ci/cc})$ = total concentration of isotopes in the 1985-1991 average noble gas isotopic distribution

The liquid effluent monitors apply the derived calibration constant to standardize all liquid releases to the total concentration in the release path. The calibration constants are based on the monitor response to the 1985-1991 average liquid isotopic distribution. Each liquid monitor channel displays the effluent concentration in terms of a total release concentration.

Liquid effluent monitor calibration constants are derived from the following formulae:

$$\text{Cal. Constant} = \frac{1}{\text{Sensitivity}}$$

and

$$\text{Sensitivity} = \frac{\text{Monitor Response}}{I \text{ } (\mu\text{Ci/cc})}$$

where:

Monitor Response = the counts per minute registered by monitor exposed to calibration source

$I (\mu\text{Ci/cc})$ = total concentration on radionuclides in the 1985-1991 average liquid effluent isotopic distribution

The QAD computer program may be utilized to predict or determine monitor calibration constants. Application of the QAD program may be appropriate for determining monitor response for accident source terms or other instances when the use of a calibration source is impracticable. The methodology for determination of calibration constants using the QAD program is maintained by the staff of the IRSS.

3.6 Determination of the Effective Maximum Effluent Concentration (EMEC) for Liquid Releases

In order to fulfill the requirements of 10 CFR 20, the RMS setpoint must be a value which will alarm when a liquid effluent would contain enough radionuclides to cause the effluent concentration limit of 10 CFR 20, Appendix B, Table 2, Column 2 for a single radionuclide to be exceeded, or for a mixture of radionuclides, the summation of fractions (SOF), as defined in Appendix B, to exceed one (1). Dividing the average isotopic concentrations for the years 1985-1991 by the SOF scales the total of individual concentrations up to the value where the SOF equals one. This total concentration is called the effective maximum effluent concentration (EMEC) and its calculation is described below. (For a complete discussion of the EMEC derivation, see Appendix A.)

The SOF is calculated using the formula found in the revised 10 CFR 20, Appendix B, Note 4:

$$\text{SOF} = \sum C_i / \text{MEC}_i$$

where:

C_i = concentration of radionuclide "i" ($\mu\text{Ci/ml}$) in effluent (annual discharge/total volume of discharge)

MEC_i = maximum effluent concentration for unrestricted areas from Appendix B, Table 2, Column 2 of the revised 10 CFR 20.

The SOF for radionuclides in liquid effluent for the years 1985 through 1991 were averaged and applied to the average of the isotopic concentrations for the same years. Na-24 and H-3 were not used in the calculations (see Appendix A for details).

Next, the "effective MEC" or EMEC is calculated using the formula:

$$\text{EMEC} = \text{DC}_i / \sum (\text{C}_i/\text{MEC}_i) \text{ or } \text{DC}_i * 1 \text{ JF}$$

where the variables are the same as defined above.

The average EMEC, based on 1985-1991 data is $4.29\text{E-}06 \mu\text{Ci/cc}$. This is the maximum non H-3 radionuclide mixture concentration that could be released in liquid effluent without the SOF exceeding one (1).

However, the 10 CFR 20 Appendix B criterion is that the SOF for all radionuclides, including H-3 which can not be measured by the liquid effluent NaI RMS monitors, be less than or equal to one (1). Therefore, the above equation modified by a factor of 0.70 (see Appendix A) to account for H-3 becomes

$$\text{EMEC} = 0.70 \text{ DC}_i / \sum (\text{C}_i/\text{MEC}_i) \text{ or } \text{DC}_i * 0.70/\text{SOF}.$$

The EMEC becomes

$$\text{EMEC} = 0.70 * 4.29\text{E-}06 = 3.00\text{E-}06 \mu\text{Ci/cc}.$$

Only three radionuclides identified in PBNP liquid effluent have a lower MEC (10 CFR 20, Appendix B, Table 2). They are I-131 ($1\text{E-}06$), Cs-134 ($9\text{E-}07$), and Cs-137 ($1\text{E-}06$).

Note that the use of the 0.7 modifying factor sets the SOF for non-tritium radionuclides to 0.7 and allows an SOF of 0.3 for H-3. A SOF of 0.3 limits the discharge concentration of H-3 to 0.3 MEC or $3\text{E-}04 \mu\text{Ci/cc}$. The factor of 0.3 may be changed as needed for releases for which the isotopic mixture and concentrations are known as long as the total SOF ≤ 1 .

3.7 Determination of Liquid Effluent Monitor Alarm Setpoint

The alarm setpoint for each liquid monitor is based upon the 1985-1991 average radionuclide concentration in the effluent discharged to the unrestricted area. The radionuclide concentration in the release is calculated assuming a minimum circulating water flow rate of 206,000 gpm and the maximum flow rate of the individual liquid effluent waste stream. The isotopic distribution of the waste stream is obtained from the historical PBNP release data for the seven years mentioned above. Setpoints are determined such that the sum of all radionuclides in the mixture, when released into the circulating water system, will be maintained at or below the unrestricted area EMEC.

Setpoints are calculated using the formula

$$SP = EMEC * \frac{\text{Circ water flow rate (gpm)}}{\text{Waste Discharge Flow Rate (gpm)}}$$

where

SP = RMS alarm setpoint in $\mu\text{Ci/cc}$

EMEC = effective maximum effluent concentration

Circ water flow rate = total flow from Unit 1 + Unit 2

Waste discharge flow rate = flow rate for effluent line on which the monitor is located

Maximum waste discharge flow rates and monitors associated with each liquid effluent pathway are described in Table 3.7-1.

Default alarm setpoints normally are established based upon the maximum waste discharge flow rate and the minimum circulation water flow rate. The liquid release monitor default setpoints are listed in Table 3.7-2. Alarm setpoints may be adjusted for batch releases, when actual flow rates are known. Alarm setpoint adjustments which are higher than default values, are to be made in accordance with the provisions and methodologies of this section and requires approval of the MSS. Lower alarm setpoint values maybe used without MSS approval if the default values lie outside the upper range of the monitor or if compliance with applicable limits will not be compromised.

TABLE 3.7-1

SUMMARY OF LIQUID DILUTION AND EFFLUENT PATHWAY FLOW RATES

<u>LIQUID EFFLUENT PATHWAY</u>	<u>DISCHARGE FLOW RATE (GPM)</u>	<u>PATHWAY MONITOR</u>
RECIRCULATION WATER		
1 pump, either unit	206,000	none
2 pumps, either unit	350,000	
1 pump, each unit	392,000	
1 pump, one unit & 2 pumps, other unit	530,000	
2 pumps, each unit	680,000	
SERVICE WATER RETURN (normal cooldown per pump)		1(2) RE-229
2 pumps @ 7500 gpm	15,000	
3 pumps @ 6300 gpm	18,900	
4 pumps @ 5100 gpm	20,400	
5 pumps @ 4300 gpm	21,500	
6 pumps @ 3700 gpm	22,200	
STEAM GENERATOR BLOWDOWN		1(2) RE-219 & 1(2) RE-222
Max flow	100	
RETENTION POND		RE-230
Max Flow Rate (2 pumps) (sliding gate open)	360 1670	
SPENT FUEL POOL		RE-220
Max Flow Rate	700	
WASTE DISTILLATE & CONDENSATE TANK DISCHARGE		RE-218 & RE-223
Max Flow Rate	100	
CONTAINMENT FAN COOLER RETURN		1(2) RE-216
Max Flow Rate per Containment	4000	

TABLE 3.7-2
LIQUID PATHWAY MONITOR
CALCULATED DEFAULT SETPOINTS

<u>MONITOR</u>	<u>FLOWRATE (gpm)</u>	<u>SETPOINT ($\mu\text{Ci/cc}$)</u>
1(2) RE-229	6 @ 3700 ¹	2.78E-05
1(2) RE-219& 1(2) RE-222	100	6.80E-03
RE-230	1670	3.70E-04
RE-220	700	8.83E-04
RE-218& RE-223	100	6.18E-03
1(2) RE-216	4000	1.55E-04

¹ six service water pumps at normal cooldown flow rates

3.8 Determination of EMEC for Atmospheric Releases

The maximum concentration of the mixture of radionuclides that is allowable at the site boundary is called the effective maximum effluent concentration (EMEC). The EMEC for an effluent mixture is defined by the equation

$$\text{EMEC} = \text{EC}_i / \sum (\text{C}_i / \text{MEC}_i)$$

where

C_i = concentration of radionuclide "i"

MEC_i = maximum effluent concentration for radionuclide i from 10 CFR 20, Appendix B, Table 2

$\sum (\text{C}_i / \text{MEC}_i)$ = summation of fractions (SOF), as discussed in Section 3.6, applied to atmospheric releases

The EMEC is calculated from the reference radionuclide mixture. This mixture is obtained from the 1985 - 1991 average annual atmospheric releases and the corresponding concentrations determined from the highest annual average χ/Q . (Details of the EMEC calculation are found in Appendix B.)

The calculated EMEC, corrected for H-3, of $1.92\text{E-}08 \mu\text{Ci/cc}$ was obtained to be used in the setpoint calculations.

3.9 Determination of Gaseous Effluent Monitor Alarm Setpoints

The alarm setpoint for each monitor is based upon maintaining the concentration of the reference radionuclide mixture at or below the EMEC. The set point is calculated using the formula

$$\text{SP} = 2.12\text{E+}03 * \text{EMEC} / (\chi/Q * \text{FR})$$

where

SP = setpoint in $\mu\text{Ci/cc}$

$2.12\text{E+}03$ = conversion factor for ft^3/min to m^3/sec

EMEC = $1.92\text{E-}08 \mu\text{Ci/cc}$

χ/Q = highest site boundary annual average $1.5\text{E-}06 \text{ sec/m}^3$

FR = the flow rate in ft^3/min of the effluent pathway being monitored.

Combining the above numerical values yields

$$\text{SP}(\mu\text{Ci/cc}) = 2.71\text{E+}01 / \text{FR}$$

Gaseous effluent pathway discharge flow rates and monitors associated with each pathway are summarized in Table 3.9-1.

TABLE 3.9-1

SUMMARY OF GASEOUS EFFLUENT PATHWAY DISCHARGE FLOW RATES

<u>Gaseous Effluent Pathway</u>	<u>Discharge Flow Rate (CFM)</u>	<u>Monitor(s) In Effluent Pathway</u>
a. Auxiliary Building Vent	66,400	RE-214 & SPING 23
b. Combined Air Ejector	20	RE-225
c. Unit Air Ejector	10	1(2) RE-215
d. Containment Purge Vent		
1) 1 Fan operating	12,500	1(2) RE-212 &
2) 2 Fans operating	25,000	SPINGS 21 & 22
e. Gas Stripper Building	13,000	RE-224
f. Drumming Area Vent	43,100	RE-221 & SPING 24

Alarm setpoints are to be normally established based upon maximum waste discharge flow rates and the highest annual average χ/Q value at the site boundary. The alarm setpoints may be adjusted for release periods if actual flow rates are reduced to less than maximum values or actual χ/Q values are calculated. Alarm setpoint adjustments to higher values are to be made in accordance with the provisions and methodologies of this section and require MSS approval.

Default setpoint values obtained using the flow rates in Table 3.9-1 are presented in Table 3.9-2. An additional reduction factor of 1/4th has been applied to the four release point monitors so that the maximum allowable site boundary concentrations will not be exceeded in the event simultaneous releases from these points occur. Lower setpoint values may be used for any of the monitors without MSS approval if the default value is outside the upper range of the monitor or if compliance with applicable release limits will not be compromised. The setpoint values for the SPINGs will be the same as the corresponding release point monitor; RE-214 (SPING 23), 1(2)RE-212 (SPINGS 21 and 22) or RE-221 (SPING 24).

TABLE 3.9-2
ATMOSPHERIC PATHWAY MONITORDEFAULT RMS SETPOINTS

<u>MONITOR</u>	<u>FLOW RATE</u> <u>(ft³/min)</u>	<u>SETPOINT</u> <u>(μCi/cc)</u>
RE-214	66,400	1.02E-04
RE-225	20	1.36E+00
1RE-215	10	2.71E+00
2RE-215	10	2.71E+00
1RE-212	25,000 ¹	2.73E-04
2RE-212	38,000 ²	1.78E-04
RE-224	13,000	2.09E-03
RE-221	43,100	1.58E-04

¹ 2 fans (with 1 fan the flow rate is 12,500 cubic feet/minute)

² 2 fans + 13,000 cfm from the gas stripper building

4.0 DEMONSTRATING COMPLIANCE WITH 10 CFR 50, APPENDIX I

4.1 Introduction

Maintaining effluents within the dose objectives of Appendix I is demonstrated at PBNP by periodic calculations. Compliance with Appendix I limits is demonstrated by periodically calculating doses to the maximum exposed individual using the methodology set forth in Regulatory Guide 1.109, Rev. 1, October 1977 and in other recognized sources such as ICRP publications.

In order to aid in the dose calculations, the formulae in Reg Guide 1.109 were rearranged to calculate the dose per curie released (mrem/Ci) to the environment. For each pathway given in Reg Guide 1.109, a radionuclide's mrem/Ci values for the whole body and the organs were calculated for each of the two release modes, liquid and atmospheric. All of the pathway doses for a radionuclide via the release mode under consideration were summed to obtain the radionuclide's total mrem/Ci released. These values, called total dose factors (TDFs), are listed in Tables 5.1.1 and 5.1.2. The application of TDFs are given in Section 5; the calculations used to obtain them, in Appendix C.

4.2 Dose Limits

To define the limits and conditions for the controlled release of radioactive materials in liquid and gaseous effluents to the environment, to ensure that these releases are as low as is reasonably achievable in conformance with 10 CFR Parts 50.34a and 50.36a, to ensure that these releases result in concentrations of radioactive materials in liquid and gaseous effluents released to unrestricted areas that are within the limits specified in 10 CFR 20, and to ensure that the releases of radioactive material above background to unrestricted areas are as low as is reasonably achievable, the following design release limits as defined in Appendix I to 10 CFR 50 apply:

- A. The annual total quantity of all radioactive material above background that may be released from each light-water-cooled nuclear power reactor to unrestricted areas should not result in an annual dose or dose commitment from liquid effluents for any individual in an unrestricted area from all pathways of exposure in excess of 3 millirems to the total body or 10 millirems to any organ.
- B. The annual total quantity of all radioactive material above background that may be released from each light-water-cooled nuclear power reactor to the atmosphere should not result in an annual air dose from gaseous effluents at any location near ground level which could be occupied by individuals in unrestricted areas in excess of 10 millirads for gamma radiation or 20 millirads for beta radiation, or that this quantity should not result in an annual external dose from gaseous effluents to any individual in unrestricted areas in excess of 5 millirems to the total body or 15 millirems to the skin.

- C. The annual total quantity of all radioactive iodine and radioactive material in particulate form above background that may be released from each light-water-cooled nuclear power reactor in effluents to the atmosphere should not result in an annual dose or dose commitment from such radioactive iodine and radioactive material in particulate form for any individual in an unrestricted area from all pathways of exposure in excess of 15 millirems to any organ.

4.3 Release Limits

Based on the Appendix I dose limits, Point Beach, being a two (2) unit nuclear plant, may release into the environment the quantities of radionuclides above background that fulfill the criteria listed below.

- A. Pursuant to Section 4.2.A, the doses from radionuclides in the unrestricted area in liquids shall not exceed
1. Six (6) millirem to the whole body, or
 2. Twenty (20) millirem to any organ.
- B. Pursuant to Section 4.2.B, the doses from gaseous radionuclides in the unrestricted area shall not exceed
1. Twenty (20) millirads to the air from gamma radiation,
 2. Forty (40) millirads to the air from beta radiation,
 3. Ten (10) millirem to the whole body, or
 4. Thirty (30) millirem to the skin.
- C. Pursuant to Section 4.2.C, the dose from radioiodine and radioactive material in particulate form released to the atmosphere in the unrestricted area shall not exceed thirty (30) millirem to any organ.

4.4 EPA Regulations

Compliance with the provisions of Appendix I to 10 CFR 50 is adequate demonstration of conformance to the standards set forth in 40 CFR 190 regarding the dose commitment to individuals from the uranium fuel cycle. For 40 CFR 190 compliance, quarterly dose calculations shall include exposures from effluent pathways and direct radiation contributions from the reactor units and from any outside storage tanks.

The above calculations do not include contributions from the Kewaunee Nuclear Power Plant (KNPP) which is some four miles north of PBNP. Under normal operations using the PBNP annual average \bar{y}/Q and assuming that the KNPP source term is identical to either PBNP unit, the greatest KNPP dose contribution occurs at the north sector PBNP boundary. However, the total KNPP-PBNP dose at that point is less than the dose in the highest sector (south boundary) from PBNP alone. The KNPP contribution in this sector adds only 1% to 8% to the total dose depending upon the release mode. Even in the highly unlikely event that PBNP and KNPP operated for an entire year at twice the Appendix I levels, the small percentage contribution from KNPP would be insufficient to yield doses exceeding 40 CFR 190 limits.

5.0 CALCULATION AND COMPARISON OF EFFLUENT RELEASES TO RELEASE LIMITS

Technical Specifications 15.7.5.B.3 and 15.7.5.D.3 require that an effluent release summary or dose calculation be performed quarterly. This section describes the methodology for the calculation of doses for comparison to the corresponding dose limits. For Appendix I compliance, the organ and whole body doses shall be calculated for the maximum exposed individual in each age group using the appropriate total dose factors in mrem/Ci released which were obtained using Regulatory Guide 1.109 and other documented methodologies.

5.1 Appendix I Dose Calculations

5.1.1 Liquid Release Mode

The dose calculations for demonstration of compliance with the 10 CFR 50, Appendix I dose limits will be accomplished by the Radiological Engineering Group of IRSS. These calculations will be done monthly, within fifteen (15) days of receipt of the final effluent curie values from the PBNP Chemistry Section. The doses from each radionuclide will be calculated for each age group and for each organ, including the whole body, and summed over all the identified radionuclides released. The total dose is compared to the corresponding liquid release mode Appendix I dose limit for the organ in question. Noble gases released in liquids are added to the atmospherically released noble gases for Appendix I dose compliance calculations.

The doses are calculated using the following formula:

$$API = \sum Dose_{aomi} = \sum (TDF_{aomi} \times C_i) \leq K_{om} \text{ mrem}$$

where

API	=	the Appendix I dose for compliance evaluation in mrem
Dose _{aomi}	=	the dose to the specific age group (a) and organ (o) via release mode (m) from radionuclide (i)
TDF _{aomi}	=	total dose factor for the specific age group (a) and organ (o) via release mode (m) from radionuclide (i) from Table 5.1-1 in mrem/Ci
C _i	=	curies of radionuclide (i) released
K _{om}	=	the Appendix I dose limit for organ (o) and release mode (m) for which the calculation is being made.

The methodology and the values used to obtain the TDF_{aomi} values are given in Appendix C.

It is recognized that some of the release quantities may not be available at the end of the month because the samples from these release paths are sent to a vendor for analysis. Usually, the only radionuclides affected by these delays are Sr-89 and Sr-90. Because the quantities of these two radionuclides are but a small fraction of the total release, the absence of their dose contributions from the initial monthly dose calculation will not significantly affect the total dose obtained from the remaining

radionuclides. The dose for the month will be updated upon the receipt of the vendor isotopic results and upon the receipt of any corrections to previous release quantities.

Instead of using the precalculated total dose factors, the Appendix I dose calculation may be modified to reflect the actual liquid discharge volume during the release period using the methodology in Appendix C.

Table 5.1-1

Liquid Effluent Dose Factors

Summation of dose per curie released factor calculations over the pathways: potable water, aquatic food, shoreline deposit, irrigated foods (milk), and irrigated foods (meat).

Dose factor - liquid release pathway (mrem/Ci released)

H-3	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	4.57E-06	4.57E-06	4.57E-06	4.57E-06	4.57E-06	4.57E-06
Teen	0.00E+00	4.11E-06	4.11E-06	4.11E-06	4.11E-06	4.11E-06	4.11E-06
Child	0.00E+00	6.76E-06	6.76E-06	6.76E-06	6.76E-06	6.76E-06	6.76E-06
Infant	0.00E+00	7.80E-06	7.80E-06	7.80E-06	7.80E-06	7.80E-06	7.80E-06

Dose factor - liquid release pathway (mrem/Ci released)

F-18

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.15E-07	9.12E-89	1.28E-08	0.00E+00	5.14E-89	0.00E+00	3.40E-09
Teen	1.21E-07	7.59E-89	1.35E-08	0.00E+00	4.35E-89	0.00E+00	1.09E-08
Child	1.51E-07	1.08E-88	1.50E-08	0.00E+00	5.74E-89	0.00E+00	4.08E-08
Infant	2.05E-12	0.00E+00	1.75E-13	0.00E+00	0.00E+00	0.00E+00	4.83E-13

Dose factor - liquid release pathway (mrem/Ci released)

Na-22

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	4.71E-03	4.71E-03	4.82E-03	4.71E-03	4.71E-03	4.71E-03	4.71E-03
Teen	5.48E-03	5.48E-03	6.07E-03	5.48E-03	5.48E-03	5.48E-03	5.48E-03
Child	8.32E-03	8.32E-03	8.45E-03	8.32E-03	8.32E-03	8.32E-03	8.32E-03
Infant	7.21E-03	7.21E-03	7.21E-03	7.21E-03	7.21E-03	7.21E-03	7.21E-03

Dose factor - liquid release pathway (mrem/Ci released)

Na-24

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.85E-04	1.85E-04	1.85E-04	1.85E-04	1.85E-04	1.85E-04	1.85E-04
Teen	1.98E-04	1.98E-04	1.98E-04	1.98E-04	1.98E-04	1.98E-04	1.98E-04
Child	2.40E-04	2.40E-04	2.40E-04	2.40E-04	2.40E-04	2.40E-04	2.40E-04
Infant	8.06E-05	8.06E-05	8.06E-05	8.06E-05	8.06E-05	8.06E-05	8.06E-05

Dose factor - liquid release pathway (mrem/Ci released)

Sc-46

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.70E-07	3.31E-07	8.92E-06	0.00E+00	3.09E-07	0.00E+00	1.61E-03
Teen	1.52E-07	2.97E-07	4.94E-05	0.00E+00	2.84E-07	0.00E+00	1.01E-03
Child	3.54E-07	4.85E-07	1.05E-05	0.00E+00	4.29E-07	0.00E+00	7.09E-04
Infant	3.42E-07	4.94E-07	1.54E-07	0.00E+00	3.25E-07	0.00E+00	3.22E-04

Dose factor - liquid release pathway (mrem/Ci released)

Mn-54

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	3.28E-03	6.34E-04	0.00E+00	9.75E-04	0.00E+00	1.00E-02
Teen	0.00E+00	3.22E-03	6.86E-04	0.00E+00	9.59E-04	0.00E+00	6.60E-03
Child	0.00E+00	2.60E-03	7.04E-04	0.00E+00	7.30E-04	0.00E+00	2.19E-03
Infant	0.00E+00	1.92E-04	4.34E-05	0.00E+00	4.25E-05	0.00E+00	7.04E-05

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Cr-51

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	0.00E+00	1.01E-06	5.84E-07	2.15E-07	1.30E-06	2.46E-04
Teen	0.00E+00	0.00E+00	1.17E-06	5.60E-07	2.21E-07	1.44E-06	1.70E-04
Child	0.00E+00	0.00E+00	1.19E-06	6.44E-07	1.76E-07	1.18E-06	6.15E-05
Infant	0.00E+00	0.00E+00	1.72E-07	1.12E-07	2.45E-08	2.18E-07	5.01E-06

Dose factor - liquid release pathway (mrem/Ci released)

Mn-56

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	3.18E-06	5.65E-07	0.00E+00	4.04E-06	0.00E+00	1.02E-04
Teen	0.00E+00	3.33E-06	5.94E-07	0.00E+00	4.22E-06	0.00E+00	2.19E-04
Child	0.00E+00	3.04E-06	6.86E-07	0.00E+00	3.67E-06	0.00E+00	4.40E-04
Infant	0.00E+00	1.97E-11	3.39E-12	0.00E+00	1.69E-11	0.00E+00	1.79E-09

Dose factor - liquid release pathway (mrem/Ci released)

Fe-55

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.98E-04	4.13E-04	9.63E-05	0.00E+00	0.00E+00	2.31E-04	2.37E-04
Teen	6.11E-04	4.33E-04	1.01E-04	0.00E+00	0.00E+00	2.75E-04	1.88E-04
Child	9.35E-04	4.96E-04	1.54E-04	0.00E+00	0.00E+00	2.80E-04	9.19E-05
Infant	1.55E-04	1.00E-04	2.68E-05	0.00E+00	0.00E+00	4.91E-05	1.28E-05

Dose factor - liquid release pathway (mrem/Ci released)

Fe-59

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	9.12E-04	2.14E-03	8.23E-04	0.00E+00	0.00E+00	5.99E-04	7.14E-03
Teen	9.22E-04	2.15E-03	8.40E-04	0.00E+00	0.00E+00	6.79E-04	5.09E-03
Child	1.29E-03	2.09E-03	1.04E-03	0.00E+00	0.00E+00	6.07E-04	2.18E-03
Infant	3.34E-04	5.84E-04	2.30E-04	0.00E+00	0.00E+00	1.73E-04	2.79E-04

Dose factor - liquid release pathway (mrem/Ci released)

Co-57

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	2.02E-05	3.57E-05	0.00E+00	0.00E+00	0.00E+00	5.13E-04
Teen	0.00E+00	2.06E-05	4.62E-05	0.00E+00	0.00E+00	0.00E+00	3.83E-04
Child	0.00E+00	2.31E-05	4.93E-05	0.00E+00	0.00E+00	0.00E+00	1.89E-04
Infant	0.00E+00	1.24E-05	2.02E-05	0.00E+00	0.00E+00	0.00E+00	4.24E-05

Dose factor - liquid release pathway (mrem/Ci released)

Co-58

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	8.49E-05	1.93E-04	0.00E+00	0.00E+00	0.00E+00	1.72E-03
Teen	0.00E+00	8.30E-05	2.04E-04	0.00E+00	0.00E+00	0.00E+00	1.14E-03
Child	0.00E+00	8.32E-05	2.57E-04	0.00E+00	0.00E+00	0.00E+00	4.85E-04
Infant	0.00E+00	3.84E-05	9.58E-05	0.00E+00	0.00E+00	0.00E+00	9.57E-05

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Co-60

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	2.48E-04	6.82E-04	0.00E+00	0.00E+00	0.00E+00	4.66E-03
Teen	0.00E+00	2.44E-04	1.30E-03	0.00E+00	0.00E+00	0.00E+00	3.17E-03
Child	0.00E+00	2.49E-04	8.92E-04	0.00E+00	0.00E+00	0.00E+00	1.38E-03
Infant	0.00E+00	1.17E-04	2.77E-04	0.00E+00	0.00E+00	0.00E+00	2.79E-04

Dose factor - liquid release pathway (mrem/Ci released)

Ni-63

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.03E-02	2.10E-03	1.02E-03	0.00E+00	0.00E+00	0.00E+00	4.38E-04
Teen	3.13E-02	2.21E-03	1.06E-03	0.00E+00	0.00E+00	0.00E+00	3.52E-04
Child	5.00E-02	2.67E-03	1.70E-03	0.00E+00	0.00E+00	0.00E+00	1.80E-04
Infant	1.27E-02	7.85E-04	4.41E-04	0.00E+00	0.00E+00	0.00E+00	3.91E-05

Dose factor - liquid release pathway (mrem/Ci released)

Ni-65

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.39E-06	4.40E-07	2.00E-07	0.00E+00	0.00E+00	0.00E+00	1.12E-05
Teen	3.66E-06	4.68E-07	2.13E-07	0.00E+00	0.00E+00	0.00E+00	2.54E-05
Child	4.68E-06	4.41E-07	2.57E-07	0.00E+00	0.00E+00	0.00E+00	5.40E-05
Infant	1.74E-10	1.97E-11	8.95E-12	0.00E+00	0.00E+00	0.00E+00	1.50E-09

Dose factor - liquid release pathway (mrem/Ci released)

Cu-64

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	4.02E-06	1.89E-06	0.00E+00	1.01E-05	0.00E+00	3.43E-04
Teen	0.00E+00	4.31E-06	2.04E-06	0.00E+00	1.09E-05	0.00E+00	3.34E-04
Child	0.00E+00	4.30E-06	2.60E-06	0.00E+00	1.04E-05	0.00E+00	2.02E-04
Infant	0.00E+00	1.41E-06	6.52E-07	0.00E+00	2.38E-06	0.00E+00	2.89E-05

Dose factor - liquid release pathway (mrem/Ci released)

Zn-65

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.73E-02	5.50E-02	2.49E-02	0.00E+00	3.68E-02	0.00E+00	3.46E-02
Teen	1.58E-02	5.50E-02	2.57E-02	0.00E+00	3.52E-02	0.00E+00	2.33E-02
Child	1.68E-02	4.47E-02	2.78E-02	0.00E+00	2.82E-02	0.00E+00	7.85E-03
Infant	1.32E-03	4.51E-03	2.08E-03	0.00E+00	2.19E-03	0.00E+00	3.81E-03

Dose factor - liquid release pathway (mrem/Ci released)

Zn-69

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.97E-05	3.76E-05	2.62E-06	0.00E+00	2.44E-05	0.00E+00	5.65E-06
Teen	2.14E-05	4.08E-05	2.86E-06	0.00E+00	2.67E-05	0.00E+00	7.52E-05
Child	2.77E-05	4.00E-05	3.70E-06	0.00E+00	2.43E-05	0.00E+00	2.52E-03
Infant	5.98E-07	1.08E-06	8.01E-08	0.00E+00	4.47E-07	0.00E+00	8.78E-05

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Zn-69m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.25E-04	7.79E-04	7.12E-05	0.00E+00	4.72E-04	0.00E+00	4.76E-02
Teen	3.50E-04	8.25E-04	7.57E-05	0.00E+00	5.01E-04	0.00E+00	4.53E-02
Child	4.49E-04	7.65E-04	9.04E-05	0.00E+00	4.44E-04	0.00E+00	2.49E-02
Infant	9.61E-06	1.96E-05	1.79E-06	0.00E+00	7.94E-06	0.00E+00	2.72E-04

Dose factor - liquid release pathway (mrem/Ci released)

Br-82

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	0.00E+00	1.39E-03	0.00E+00	0.00E+00	0.00E+00	1.59E-03
Teen	0.00E+00	0.00E+00	1.47E-03	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Child	0.00E+00	0.00E+00	1.71E-03	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Infant	0.00E+00	0.00E+00	4.43E-04	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Dose factor - liquid release pathway (mrem/Ci released)

Br-83

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	0.00E+00	9.06E-07	0.00E+00	0.00E+00	0.00E+00	1.30E-06
Teen	0.00E+00	0.00E+00	9.85E-07	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Child	0.00E+00	0.00E+00	1.27E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Infant	0.00E+00	0.00E+00	2.93E-11	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Dose factor - liquid release pathway (mrem/Ci released)

Br-84

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	0.00E+00	3.12E-05	0.00E+00	0.00E+00	0.00E+00	2.44E-10
Teen	0.00E+00	0.00E+00	3.43E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Child	0.00E+00	0.00E+00	4.33E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Infant	0.00E+00	0.00E+00	1.20E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Dose factor - liquid release pathway (mrem/Ci released)

Br-85

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	0.00E+00	4.24E-82	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Teen	0.00E+00	0.00E+00	4.60E-82	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Child	0.00E+00	0.00E+00	5.94E-82	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Infant	0.00E+00	0.00E+00	9.35E-309	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Dose factor - liquid release pathway (mrem/Ci released)

Rb-86

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	7.36E-02	3.43E-02	0.00E+00	0.00E+00	0.00E+00	1.45E-02
Teen	0.00E+00	7.98E-02	3.75E-02	0.00E+00	0.00E+00	0.00E+00	1.18E-02
Child	0.00E+00	7.93E-02	4.88E-02	0.00E+00	0.00E+00	0.00E+00	5.10E-03
Infant	0.00E+00	9.07E-03	4.48E-03	0.00E+00	0.00E+00	0.00E+00	2.32E-04

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Rb-88

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	1.41E-16	7.46E-17	0.00E+00	0.00E+00	0.00E+00	1.94E-27
Teen	0.00E+00	1.51E-16	8.04E-17	0.00E+00	0.00E+00	0.00E+00	1.29E-23
Child	0.00E+00	1.45E-16	1.01E-16	0.00E+00	0.00E+00	0.00E+00	7.12E-18
Infant	0.00E+00	5.68E-54	3.12E-54	0.00E+00	0.00E+00	0.00E+00	5.54E-54

Dose factor - liquid release pathway (mrem/Ci released)

Rb-89

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	1.28E-18	8.99E-19	0.00E+00	0.00E+00	0.00E+00	7.42E-32
Teen	0.00E+00	1.34E-18	9.45E-19	0.00E+00	0.00E+00	0.00E+00	2.05E-27
Child	0.00E+00	1.23E-18	1.09E-18	0.00E+00	0.00E+00	0.00E+00	1.07E-20
Infant	0.00E+00	1.15E-61	7.93E-62	0.00E+00	0.00E+00	0.00E+00	3.92E-62

Dose factor - liquid release pathway (mrem/Ci released)

Sr-89

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.26E-02	0.00E+00	6.48E-04	0.00E+00	0.00E+00	0.00E+00	3.62E-03
Teen	2.43E-02	0.00E+00	6.95E-04	0.00E+00	0.00E+00	0.00E+00	2.89E-03
Child	4.27E-02	0.00E+00	1.22E-03	0.00E+00	0.00E+00	0.00E+00	1.65E-03
Infant	2.58E-02	0.00E+00	7.40E-04	0.00E+00	0.00E+00	0.00E+00	5.30E-04

Dose factor - liquid release pathway (mrem/Ci released)

Sr-90

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.63E-01	0.00E+00	1.38E-01	0.00E+00	0.00E+00	0.00E+00	1.63E-02
Teen	4.64E-01	0.00E+00	1.15E-01	0.00E+00	0.00E+00	0.00E+00	1.30E-02
Child	5.59E-01	0.00E+00	1.42E-01	0.00E+00	0.00E+00	0.00E+00	7.53E-03
Infant	1.95E-01	0.00E+00	4.97E-02	0.00E+00	0.00E+00	0.00E+00	2.44E-03

Dose factor - liquid release pathway (mrem/Ci released)

Sr-91

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.27E-04	0.00E+00	5.14E-06	0.00E+00	0.00E+00	0.00E+00	6.05E-04
Teen	1.38E-04	0.00E+00	5.51E-06	0.00E+00	0.00E+00	0.00E+00	6.24E-04
Child	1.83E-04	0.00E+00	6.91E-06	0.00E+00	0.00E+00	0.00E+00	4.04E-04
Infant	1.59E-05	0.00E+00	5.76E-07	0.00E+00	0.00E+00	0.00E+00	1.88E-05

Dose factor - liquid release pathway (mrem/Ci released)

Sr-92

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.21E-06	0.00E+00	2.26E-07	0.00E+00	0.00E+00	0.00E+00	1.03E-04
Teen	5.64E-06	0.00E+00	2.42E-07	0.00E+00	0.00E+00	0.00E+00	1.44E-04
Child	7.20E-06	0.00E+00	2.89E-07	0.00E+00	0.00E+00	0.00E+00	1.36E-04
Infant	9.41E-10	0.00E+00	3.50E-11	0.00E+00	0.00E+00	0.00E+00	1.01E-08

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Y-90

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	4.85E-07	0.00E+00	1.30E-08	0.00E+00	0.00E+00	0.00E+00	5.15E-03
Teen	5.16E-07	0.00E+00	1.40E-08	0.00E+00	0.00E+00	0.00E+00	4.26E-03
Child	8.67E-07	0.00E+00	2.32E-08	0.00E+00	0.00E+00	0.00E+00	2.47E-03
Infant	4.80E-07	0.00E+00	1.29E-08	0.00E+00	0.00E+00	0.00E+00	6.63E-04

Dose factor - liquid release pathway (mrem/Ci released)

Y-91

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	9.20E-06	0.00E+00	2.53E-07	0.00E+00	0.00E+00	0.00E+00	5.06E-03
Teen	9.68E-06	0.00E+00	2.97E-07	0.00E+00	0.00E+00	0.00E+00	3.97E-03
Child	1.74E-05	0.00E+00	4.74E-07	0.00E+00	0.00E+00	0.00E+00	2.32E-03
Infant	1.03E-05	0.00E+00	2.73E-07	0.00E+00	0.00E+00	0.00E+00	7.35E-04

Dose factor - liquid release pathway (mrem/Ci released)

Y-91m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.71E-13	0.00E+00	5.10E-14	0.00E+00	0.00E+00	0.00E+00	5.02E-13
Teen	1.85E-13	0.00E+00	2.55E-13	0.00E+00	0.00E+00	0.00E+00	8.72E-12
Child	2.36E-13	0.00E+00	6.04E-14	0.00E+00	0.00E+00	0.00E+00	4.62E-10
Infant	2.62E-26	0.00E+00	8.92E-28	0.00E+00	0.00E+00	0.00E+00	8.72E-23

Dose factor - liquid release pathway (mrem/Ci released)

Y-92

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.51E-09	0.00E+00	2.88E-10	0.00E+00	0.00E+00	0.00E+00	6.15E-05
Teen	3.83E-09	0.00E+00	1.15E-09	0.00E+00	0.00E+00	0.00E+00	1.05E-04
Child	4.92E-09	0.00E+00	3.57E-10	0.00E+00	0.00E+00	0.00E+00	1.42E-04
Infant	5.88E-12	0.00E+00	1.65E-13	0.00E+00	0.00E+00	0.00E+00	1.12E-07

Dose factor - liquid release pathway (mrem/Ci released)

Y-93

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.32E-08	0.00E+00	2.33E-09	0.00E+00	0.00E+00	0.00E+00	1.69E-03
Teen	5.77E-08	0.00E+00	6.38E-09	0.00E+00	0.00E+00	0.00E+00	1.76E-03
Child	7.75E-08	0.00E+00	3.13E-09	0.00E+00	0.00E+00	0.00E+00	1.16E-03
Infant	8.33E-09	0.00E+00	2.27E-10	0.00E+00	0.00E+00	0.00E+00	6.58E-05

Dose factor - liquid release pathway (mrem/Ci released)

Zr-95

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.23E-06	3.94E-07	1.79E-06	0.00E+00	6.19E-07	0.00E+00	1.25E-03
Teen	1.11E-06	3.52E-07	8.74E-06	0.00E+00	5.17E-07	0.00E+00	8.11E-04
Child	2.48E-06	5.45E-07	2.26E-06	0.00E+00	7.80E-07	0.00E+00	5.69E-04
Infant	1.87E-06	4.56E-07	3.23E-07	0.00E+00	4.91E-07	0.00E+00	2.27E-04

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Zr-97

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.07E-08	2.16E-09	1.23E-08	0.00E+00	3.27E-09	0.00E+00	6.70E-04
Teen	1.11E-08	2.19E-09	6.42E-08	0.00E+00	3.33E-09	0.00E+00	5.94E-04
Child	2.21E-08	3.19E-09	1.51E-08	0.00E+00	4.58E-09	0.00E+00	4.83E-04
Infant	1.92E-08	3.29E-09	1.50E-09	0.00E+00	3.32E-09	0.00E+00	2.10E-04

Dose factor - liquid release pathway (mrem/Ci released)

Nb-95

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.23E-04	1.79E-04	9.73E-05	0.00E+00	1.77E-04	0.00E+00	1.09E+00
Teen	3.25E-04	1.80E-04	1.04E-04	0.00E+00	1.75E-04	0.00E+00	7.70E-01
Child	3.84E-04	1.49E-04	1.08E-04	0.00E+00	1.40E-04	0.00E+00	2.76E-01
Infant	5.36E-07	2.21E-07	1.28E-07	0.00E+00	1.58E-07	0.00E+00	1.86E-04

Dose factor - liquid release pathway (mrem/Ci released)

Nb-97

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.69E-09	6.81E-10	2.51E-10	0.00E+00	7.95E-10	0.00E+00	2.51E-06
Teen	2.90E-09	7.20E-10	2.73E-10	0.00E+00	8.41E-10	0.00E+00	1.72E-05
Child	3.68E-09	6.65E-10	3.12E-10	0.00E+00	7.38E-10	0.00E+00	2.05E-04
Infant	5.81E-21	1.24E-10	4.47E-22	0.00E+00	9.68E-22	0.00E+00	3.91E-16

Dose factor - liquid release pathway (mrem/Ci released)

Mo-99

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	0.00E+00	1.49E-04	2.84E-05	0.00E+00	3.38E-04	0.00E+00	3.46E-04
Teen	0.00E+00	1.76E-04	3.36E-05	0.00E+00	4.03E-04	0.00E+00	3.15E-04
Child	0.00E+00	2.79E-04	6.91E-05	0.00E+00	5.96E-04	0.00E+00	2.31E-04
Infant	0.00E+00	4.38E-04	8.54E-05	0.00E+00	6.54E-04	0.00E+00	1.44E-04

Dose factor - liquid release pathway (mrem/Ci released)

Tc-99m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.68E-09	4.74E-09	6.07E-08	0.00E+00	7.20E-08	2.32E-09	2.81E-06
Teen	1.74E-09	4.86E-09	6.46E-08	0.00E+00	7.24E-08	2.70E-09	3.19E-06
Child	2.19E-09	4.29E-09	7.15E-08	0.00E+00	6.24E-08	2.18E-09	2.44E-06
Infant	3.78E-10	7.79E-10	1.00E-08	0.00E+00	8.38E-09	4.07E-10	2.26E-07

Dose factor - liquid release pathway (mrem/Ci released)

Tc-101

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.60E-24	5.19E-24	5.10E-23	0.00E+00	9.34E-23	2.65E-24	1.56E-35
Teen	3.89E-24	5.53E-24	5.49E-23	0.00E+00	1.00E-22	3.37E-24	9.45E-31
Child	4.98E-24	5.22E-24	6.63E-23	0.00E+00	8.90E-23	2.76E-24	1.66E-23
Infant	9.73E-69	1.23E-68	1.21E-67	0.00E+00	1.46E-67	6.69E-69	2.08E-66

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Ru-103

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.47E-05	0.00E+00	1.56E-05	0.00E+00	1.32E-04	0.00E+00	4.05E-03
Teen	2.96E-05	0.00E+00	1.64E-05	0.00E+00	1.04E-04	0.00E+00	2.47E-03
Child	5.53E-05	0.00E+00	2.20E-05	0.00E+00	1.39E-04	0.00E+00	1.43E-03
Infant	1.33E-05	0.00E+00	4.43E-06	0.00E+00	2.76E-05	0.00E+00	1.61E-04

Dose factor - liquid release pathway (mrem/Ci released)

Ru-105

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	4.13E-08	0.00E+00	1.75E-08	0.00E+00	5.34E-07	0.00E+00	2.53E-05
Teen	4.45E-08	0.00E+00	2.42E-08	0.00E+00	5.62E-07	0.00E+00	3.59E-05
Child	5.71E-08	0.00E+00	2.22E-08	0.00E+00	5.02E-07	0.00E+00	3.73E-05
Infant	6.98E-10	0.00E+00	2.35E-10	0.00E+00	5.13E-09	0.00E+00	2.78E-07

Dose factor - liquid release pathway (mrem/Ci released)

Ru-106

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	6.71E-04	0.00E+00	8.76E-05	0.00E+00	1.30E-03	0.00E+00	4.34E-02
Teen	5.86E-04	0.00E+00	8.85E-05	0.00E+00	1.13E-03	0.00E+00	2.81E-02
Child	1.13E-03	0.00E+00	1.44E-04	0.00E+00	1.53E-03	0.00E+00	1.76E-02
Infant	2.23E-04	0.00E+00	2.78E-05	0.00E+00	2.63E-04	0.00E+00	1.69E-03

Dose factor - liquid release pathway (mrem/Ci released)

Rh-105

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.35E-06	2.45E-06	1.62E-06	0.00E+00	1.04E-05	0.00E+00	3.90E-04
Teen	4.10E-06	2.96E-06	1.97E-06	0.00E+00	1.26E-05	0.00E+00	3.77E-04
Child	8.43E-06	4.52E-06	3.88E-06	0.00E+00	1.80E-05	0.00E+00	2.80E-04
Infant	1.08E-05	7.05E-06	4.74E-06	0.00E+00	1.96E-05	0.00E+00	1.75E-04

Dose factor - liquid release pathway (mrem/Ci released)

Ag-110m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.06E-05	2.83E-05	3.83E-05	0.00E+00	5.56E-05	0.00E+00	1.15E-02
Teen	3.74E-05	3.54E-05	1.41E-04	0.00E+00	6.75E-05	0.00E+00	9.94E-03
Child	6.78E-05	4.58E-05	6.17E-05	0.00E+00	8.53E-05	0.00E+00	5.45E-03
Infant	8.87E-05	6.47E-05	4.28E-05	0.00E+00	9.26E-05	0.00E+00	3.36E-03

Dose factor - liquid release pathway (mrem/Ci released)

Sb-124

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.42E-04	1.02E-05	2.21E-04	1.32E-06	0.00E+00	4.22E-04	1.54E-02
Teen	5.66E-04	1.04E-05	2.53E-04	1.28E-06	0.00E+00	4.94E-04	1.14E-02
Child	7.89E-04	1.02E-05	2.83E-04	1.74E-06	0.00E+00	4.38E-04	4.94E-03
Infant	1.95E-04	2.86E-06	6.03E-05	5.17E-07	0.00E+00	1.22E-04	6.00E-04

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Sb-125

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.49E-04	3.90E-06	1.07E-04	3.55E-07	0.00E+00	2.69E-04	3.85E-03
Teen	3.65E-04	3.99E-06	2.19E-04	3.49E-07	0.00E+00	3.21E-04	2.84E-03
Child	5.14E-04	3.96E-06	1.35E-04	4.76E-07	0.00E+00	2.86E-04	1.23E-03
Infant	1.14E-04	1.11E-06	2.35E-05	1.43E-07	0.00E+00	7.17E-05	1.52E-04

Dose factor - liquid release pathway (mrem/Ci released)

Te-125m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.30E-04	1.20E-04	4.43E-05	9.93E-05	1.34E-03	0.00E+00	1.32E-03
Teen	3.36E-04	1.21E-04	4.53E-05	9.39E-05	0.00E+00	0.00E+00	9.92E-04
Child	5.74E-04	1.56E-04	7.67E-05	1.61E-04	0.00E+00	0.00E+00	5.54E-04
Infant	2.47E-04	8.27E-05	3.35E-05	8.33E-05	0.00E+00	0.00E+00	1.18E-04

Dose factor - liquid release pathway (mrem/Ci released)

Te-127

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.15E-05	1.13E-05	6.83E-06	2.34E-05	1.28E-04	0.00E+00	2.49E-03
Teen	3.45E-05	1.22E-05	7.43E-06	2.38E-05	1.40E-04	0.00E+00	2.67E-03
Child	4.45E-05	1.20E-05	9.54E-06	3.08E-05	1.27E-04	0.00E+00	1.74E-03
Infant	3.10E-07	1.04E-07	6.67E-08	2.52E-07	7.56E-07	0.00E+00	6.51E-06

Dose factor - liquid release pathway (mrem/Ci released)

Te-127m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	8.63E-04	3.08E-04	1.05E-04	2.21E-04	3.51E-03	0.00E+00	2.89E-03
Teen	8.74E-04	3.10E-04	1.04E-04	2.08E-04	3.54E-03	0.00E+00	2.18E-03
Child	1.50E-03	4.05E-04	1.79E-04	3.60E-04	4.29E-03	0.00E+00	1.22E-03
Infant	6.28E-04	2.08E-04	7.61E-05	1.82E-04	1.55E-03	0.00E+00	2.54E-04

Dose factor - liquid release pathway (mrem/Ci released)

Te-129

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.68E-08	6.32E-09	4.10E-09	1.29E-08	7.07E-08	0.00E+00	1.27E-08
Teen	1.83E-08	6.82E-09	4.45E-09	1.31E-08	7.68E-08	0.00E+00	1.00E-07
Child	2.36E-08	6.58E-09	5.60E-09	1.68E-08	6.90E-08	0.00E+00	1.47E-06
Infant	1.08E-18	3.73E-19	2.53E-19	9.07E-19	2.69E-18	0.00E+00	8.65E-17

Dose factor - liquid release pathway (mrem/Ci released)

Te-129m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.35E-03	5.04E-04	2.14E-04	4.64E-04	5.63E-03	0.00E+00	6.80E-03
Teen	1.37E-03	5.10E-04	2.18E-04	4.43E-04	5.75E-03	0.00E+00	5.16E-03
Child	2.34E-03	6.54E-04	3.64E-04	7.55E-04	6.88E-03	0.00E+00	2.86E-03
Infant	1.04E-03	3.58E-04	1.61E-04	4.01E-04	2.61E-03	0.00E+00	6.23E-04

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Te-131m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.04E-04	5.08E-05	4.24E-05	8.05E-05	5.15E-04	0.00E+00	5.05E-03
Teen	1.11E-04	5.34E-05	4.49E-05	8.03E-05	5.56E-04	0.00E+00	4.28E-03
Child	1.63E-04	5.63E-05	6.00E-05	1.16E-04	5.45E-04	0.00E+00	2.28E-03
Infant	5.46E-05	2.20E-05	1.81E-05	4.45E-05	1.51E-04	0.00E+00	3.70E-04

Dose factor - liquid release pathway (mrem/Ci released)

Te-131

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.97E-15	1.24E-15	9.40E-16	2.44E-15	1.30E-14	0.00E+00	4.21E-16
Teen	3.21E-15	1.32E-15	1.01E-15	2.47E-15	1.40E-14	0.00E+00	2.63E-16
Child	4.12E-15	1.25E-15	1.23E-15	3.15E-15	1.24E-14	0.00E+00	2.16E-14
Infant	4.22E-41	1.56E-41	1.18E-41	3.77E-41	1.08E-40	0.00E+00	1.71E-39

Dose factor - liquid release pathway (mrem/Ci released)

Te-132

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.96E-04	1.26E-04	1.19E-04	1.40E-04	1.22E-03	0.00E+00	5.98E-03
Teen	2.05E-04	1.30E-04	1.22E-04	1.37E-04	1.24E-03	0.00E+00	4.11E-03
Child	3.15E-04	1.39E-04	1.69E-04	2.03E-04	1.29E-03	0.00E+00	1.40E-03
Infant	1.48E-04	7.32E-05	6.83E-05	1.08E-04	4.58E-04	0.00E+00	2.71E-04

Dose factor - liquid release pathway (mrem/Ci released)

I-131

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.09E-04	2.99E-04	1.71E-04	9.78E-02	5.12E-04	0.00E+00	7.88E-05
Teen	2.41E-04	3.37E-04	1.81E-04	9.83E-02	5.80E-04	0.00E+00	6.66E-05
Child	4.90E-04	4.93E-04	2.80E-04	1.63E-01	8.09E-04	0.00E+00	4.39E-05
Infant	5.71E-04	6.73E-04	2.96E-04	2.21E-01	7.86E-04	0.00E+00	2.40E-05

Dose factor - liquid release pathway (mrem/Ci released)

I-132

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.43E-07	3.81E-07	1.34E-07	1.33E-05	6.07E-07	0.00E+00	7.16E-08
Teen	1.49E-07	3.90E-07	1.41E-07	1.32E-05	6.15E-07	0.00E+00	1.70E-07
Child	1.85E-07	3.39E-07	1.56E-07	1.57E-05	5.19E-07	0.00E+00	3.99E-07
Infant	1.64E-11	3.32E-11	1.18E-11	1.56E-09	3.71E-11	0.00E+00	2.69E-11

Dose factor - liquid release pathway (mrem/Ci released)

I-133

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.33E-05	5.80E-05	1.77E-05	8.52E-03	1.01E-04	0.00E+00	5.21E-05
Teen	3.74E-05	6.34E-05	1.94E-05	8.85E-03	1.11E-04	0.00E+00	4.80E-05
Child	6.27E-05	7.75E-05	2.94E-05	1.44E-02	1.29E-04	0.00E+00	3.13E-05
Infant	4.77E-05	6.95E-05	2.04E-05	1.26E-02	8.17E-05	0.00E+00	1.18E-05

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

I-134

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.09E-10	5.69E-10	2.04E-10	9.85E-09	9.04E-10	0.00E+00	4.96E-13
Teen	2.20E-10	5.82E-10	2.10E-10	9.70E-09	9.18E-10	0.00E+00	7.67E-12
Child	2.72E-10	5.05E-10	2.33E-10	1.16E-08	7.72E-10	0.00E+00	3.35E-10
Infant	5.37E-22	1.10E-21	3.91E-22	2.56E-20	1.23E-21	0.00E+00	1.14E-21

Dose factor - liquid release pathway (mrem/Ci released)

I-135

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.37E-06	8.83E-06	3.26E-06	5.82E-04	1.42E-05	0.00E+00	9.97E-06
Teen	3.55E-06	9.14E-06	3.41E-06	5.88E-04	1.44E-05	0.00E+00	1.01E-05
Child	4.54E-06	8.17E-06	3.87E-06	7.24E-04	1.25E-05	0.00E+00	6.23E-06
Infant	4.48E-07	8.92E-07	3.25E-07	7.99E-05	9.94E-07	0.00E+00	3.23E-07

Dose factor - liquid release pathway (mrem/Ci released)

Cs-134

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.19E-01	5.21E-01	4.26E-01	0.00E+00	1.69E-01	5.60E-02	9.12E-03
Teen	2.25E-01	5.30E-01	2.46E-01	0.00E+00	1.68E-01	6.43E-02	6.59E-03
Child	2.76E-01	4.52E-01	9.55E-02	0.00E+00	1.40E-01	5.03E-02	2.44E-03
Infant	1.07E-02	2.00E-02	2.02E-03	0.00E+00	5.16E-03	2.11E-03	5.44E-05

Dose factor - liquid release pathway (mrem/Ci released)

Cs-134m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	4.21E-06	8.85E-06	4.52E-06	0.00E+00	4.80E-06	7.56E-07	3.12E-06
Teen	4.42E-06	9.16E-06	4.71E-06	0.00E+00	5.10E-06	8.95E-07	6.09E-06
Child	5.48E-06	8.11E-06	5.29E-06	0.00E+00	4.28E-06	7.07E-07	1.03E-05
Infant	5.19E-11	8.64E-11	4.37E-11	0.00E+00	3.33E-11	7.67E-12	6.84E-11

Dose factor - liquid release pathway (mrem/Ci released)

Cs-136

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.23E-02	8.81E-02	6.34E-02	0.00E+00	4.90E-02	6.72E-03	1.00E-02
Teen	2.25E-02	8.85E-02	5.95E-02	0.00E+00	4.82E-02	7.59E-03	7.12E-03
Child	2.69E-02	7.40E-02	4.79E-02	0.00E+00	3.94E-02	5.87E-03	2.60E-03
Infant	1.18E-03	3.47E-03	1.29E-03	0.00E+00	1.38E-03	2.83E-04	5.27E-05

Dose factor - liquid release pathway (mrem/Ci released)

Cs-137

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.81E-01	3.84E-01	2.52E-01	0.00E+00	1.30E-01	4.33E-02	7.43E-03
Teen	3.02E-01	4.01E-01	1.40E-01	0.00E+00	1.36E-01	5.30E-02	5.71E-03
Child	3.85E-01	3.69E-01	5.45E-02	0.00E+00	1.20E-01	4.33E-02	2.31E-03
Infant	1.49E-02	1.74E-02	1.24E-03	0.00E+00	4.68E-03	1.89E-03	5.45E-05

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Cs-138

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.57E-11	7.04E-11	3.49E-11	0.00E+00	5.18E-11	5.11E-12	3.00E-16
Teen	3.82E-11	7.34E-11	3.67E-11	0.00E+00	5.42E-11	6.30E-12	3.33E-14
Child	4.84E-11	6.73E-11	4.27E-11	0.00E+00	4.73E-11	5.10E-12	3.10E-11
Infant	1.63E-32	2.65E-32	1.28E-32	0.00E+00	1.32E-32	2.06E-33	4.23E-32

Dose factor - liquid release pathway (mrem/Ci released)

Ba-139

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.67E-09	1.19E-12	4.93E-11	0.00E+00	1.12E-12	6.77E-13	2.97E-09
Teen	1.83E-09	1.29E-12	5.50E-11	0.00E+00	1.21E-12	8.87E-13	1.63E-08
Child	2.35E-09	1.25E-12	6.84E-11	0.00E+00	1.09E-12	7.37E-13	1.36E-07
Infant	3.30E-16	2.19E-19	9.55E-18	0.00E+00	1.31E-19	1.33E-19	2.09E-14

Dose factor - liquid release pathway (mrem/Ci released)

Ba-140

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.34E-04	6.71E-07	3.51E-05	0.00E+00	2.28E-07	3.84E-07	1.10E-03
Teen	5.41E-04	6.63E-07	3.56E-05	0.00E+00	2.25E-07	4.46E-07	8.35E-04
Child	1.32E-03	1.16E-06	7.72E-05	0.00E+00	3.76E-07	6.89E-07	6.69E-04
Infant	1.52E-03	1.52E-06	7.84E-05	0.00E+00	3.61E-07	9.34E-07	3.74E-04

Dose factor - liquid release pathway (mrem/Ci released)

Ba-141

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	4.57E-19	3.45E-22	1.63E-20	0.00E+00	3.21E-22	1.96E-22	2.15E-28
Teen	4.96E-19	3.70E-22	2.14E-20	0.00E+00	3.44E-22	2.53E-22	1.06E-24
Child	6.37E-19	3.57E-22	2.18E-20	0.00E+00	3.09E-22	2.10E-21	3.63E-19
Infant	1.58E-53	1.08E-56	4.99E-55	0.00E+00	6.52E-57	6.60E-57	1.93E-52

Dose factor - liquid release pathway (mrem/Ci released)

La-140

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.66E-08	1.84E-08	1.03E-07	0.00E+00	0.00E+00	0.00E+00	1.35E-03
Teen	3.68E-08	1.81E-08	5.51E-07	0.00E+00	0.00E+00	0.00E+00	1.04E-03
Child	8.21E-08	2.87E-08	1.24E-07	0.00E+00	0.00E+00	0.00E+00	8.00E-04
Infant	8.56E-08	3.38E-08	8.69E-09	0.00E+00	0.00E+00	0.00E+00	3.97E-04

Dose factor - liquid release pathway (mrem/Ci released)

La-142

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.92E-11	1.33E-11	4.94E-11	0.00E+00	0.00E+00	0.00E+00	9.71E-08
Teen	3.12E-11	1.38E-11	2.61E-10	0.00E+00	0.00E+00	0.00E+00	4.21E-07
Child	3.93E-11	1.25E-11	5.77E-11	0.00E+00	0.00E+00	0.00E+00	2.48E-06
Infant	7.74E-18	2.84E-18	6.81E-19	0.00E+00	0.00E+00	0.00E+00	4.83E-13

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Ce-141

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.05E-07	1.39E-07	2.42E-07	0.00E+00	6.45E-08	0.00E+00	5.31E-04
Teen	2.06E-07	1.37E-07	4.88E-07	0.00E+00	6.47E-08	0.00E+00	3.93E-04
Child	5.80E-07	2.89E-07	1.42E-07	0.00E+00	1.27E-07	0.00E+00	3.61E-04
Infant	7.11E-07	4.34E-07	5.11E-08	0.00E+00	1.34E-07	0.00E+00	2.24E-04

Dose factor - liquid release pathway (mrem/Ci released)

Ce-143

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.47E-08	1.09E-05	1.78E-08	0.00E+00	4.78E-09	0.00E+00	4.06E-04
Teen	1.49E-08	1.08E-05	9.40E-08	0.00E+00	4.86E-09	0.00E+00	3.26E-04
Child	4.01E-08	2.17E-05	2.25E-08	0.00E+00	9.12E-09	0.00E+00	3.18E-04
Infant	5.10E-08	3.38E-05	3.86E-09	0.00E+00	9.85E-09	0.00E+00	1.97E-04

Dose factor - liquid release pathway (mrem/Ci released)

Ce-144

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.12E-05	4.67E-06	1.04E-06	0.00E+00	2.77E-06	0.00E+00	3.78E-03
Teen	1.12E-05	4.65E-06	3.03E-06	0.00E+00	2.78E-06	0.00E+00	2.82E-03
Child	3.17E-05	9.92E-06	2.20E-06	0.00E+00	5.50E-06	0.00E+00	2.59E-03
Infant	2.80E-05	1.15E-05	1.57E-06	0.00E+00	4.63E-06	0.00E+00	1.61E-03

Dose factor - liquid release pathway (mrem/Ci released)

Pr-143

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.69E-07	2.28E-07	2.82E-08	0.00E+00	1.32E-07	0.00E+00	2.49E-03
Teen	6.00E-07	2.40E-07	2.99E-08	0.00E+00	1.39E-07	0.00E+00	1.97E-03
Child	1.07E-06	3.21E-07	5.31E-08	0.00E+00	1.74E-07	0.00E+00	1.15E-03
Infant	6.81E-07	2.55E-07	3.38E-08	0.00E+00	9.47E-08	0.00E+00	3.60E-04

Dose factor - liquid release pathway (mrem/Ci released)

Pr-144

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.76E-22	1.56E-22	2.24E-23	0.00E+00	8.80E-23	0.00E+00	5.41E-29
Teen	4.09E-22	1.67E-22	3.91E-23	0.00E+00	9.61E-23	0.00E+00	4.51E-25
Child	5.29E-22	1.64E-22	3.05E-23	0.00E+00	8.66E-23	0.00E+00	3.52E-19
Infant	1.72E-59	6.66E-60	8.67E-61	0.00E+00	2.41E-60	0.00E+00	3.10E-55

Dose factor - liquid release pathway (mrem/Ci released)

Nd-147

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.82E-07	4.42E-07	1.13E-07	0.00E+00	2.58E-07	0.00E+00	2.12E-03
Teen	4.23E-07	4.60E-07	5.09E-07	0.00E+00	2.70E-07	0.00E+00	1.66E-03
Child	7.45E-07	6.03E-07	1.47E-07	0.00E+00	3.31E-07	0.00E+00	9.55E-04
Infant	4.53E-07	4.65E-07	2.85E-08	0.00E+00	1.79E-07	0.00E+00	2.95E-04

Table 5.1-1 (continued)

Dose factor - liquid release pathway (mrem/Ci released)

Eu-152

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.31E-05	2.99E-04	1.63E-04	0.00E+00	1.85E-05	0.00E+00	1.72E-03
Teen	1.21E-05	2.92E-06	9.00E-04	0.00E+00	1.35E-05	0.00E+00	1.07E-03
Child	1.84E-05	3.34E-06	1.91E-04	0.00E+00	1.41E-05	0.00E+00	5.49E-04
Infant	6.27E-06	1.67E-06	1.40E-06	0.00E+00	4.67E-06	0.00E+00	1.48E-04

Dose factor - liquid release pathway (mrem/Ci released)

W-187

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	1.52E-04	1.27E-04	4.45E-05	0.00E+00	0.00E+00	0.00E+00	4.17E-02
Teen	1.65E-04	1.34E-04	4.71E-05	0.00E+00	0.00E+00	0.00E+00	3.63E-02
Child	2.09E-04	1.24E-04	5.57E-05	0.00E+00	0.00E+00	0.00E+00	1.74E-02
Infant	2.25E-06	1.57E-06	5.41E-07	0.00E+00	0.00E+00	0.00E+00	9.21E-05

Dose factor - liquid release pathway (mrem/Ci released)

Np-239

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.15E-08	3.09E-09	2.30E-08	0.00E+00	9.65E-09	0.00E+00	6.34E-04
Teen	3.42E-08	3.22E-09	1.21E-07	0.00E+00	1.01E-08	0.00E+00	5.19E-04
Child	6.77E-08	4.86E-09	2.83E-08	0.00E+00	1.41E-08	0.00E+00	3.60E-04
Infant	5.72E-08	5.12E-09	2.89E-09	0.00E+00	1.02E-08	0.00E+00	1.48E-04

Dose factor - liquid release pathway (mrem/Ci released)

U-235

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	3.05E-02	0.00E+00	1.89E-03	0.00E+00	7.13E-03	0.00E+00	2.98E-03
Teen	3.17E-02	0.00E+00	2.13E-03	0.00E+00	7.43E-03	0.00E+00	2.30E-03
Child	6.92E-02	0.00E+00	4.23E-03	0.00E+00	1.14E-02	0.00E+00	1.63E-03
Infant	4.42E-02	0.00E+00	3.37E-03	0.00E+00	9.40E-03	0.00E+00	7.67E-04

Dose factor - liquid release pathway (mrem/Ci released)

U-238

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	2.92E-02	0.00E+00	1.73E-03	0.00E+00	6.67E-03	0.00E+00	2.10E-03
Teen	3.03E-02	0.00E+00	1.81E-03	0.00E+00	6.96E-03	0.00E+00	1.62E-03
Child	6.62E-02	0.00E+00	3.93E-03	0.00E+00	1.06E-02	0.00E+00	1.15E-03
Infant	4.23E-02	0.00E+00	3.15E-03	0.00E+00	8.78E-03	0.00E+00	5.41E-04

Dose factor - liquid release pathway (mrem/Ci released)

Am-241

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI
Adult	5.25E-02	1.85E-02	3.47E-03	0.00E+00	2.61E-02	0.00E+00	4.75E-03
Teen	4.10E-02	1.56E-02	2.77E-03	0.00E+00	2.05E-02	0.00E+00	3.74E-03
Child	4.10E-02	1.83E-02	2.93E-03	0.00E+00	1.79E-02	0.00E+00	2.19E-03
Infant	1.42E-02	6.68E-03	1.01E-03	0.00E+00	6.10E-03	0.00E+00	7.17E-04

5.1.2 Atmospheric Release Mode: Radioiodine, Tritium, and Particulates

The dose calculations for demonstration of compliance with the 10 CFR 50, Appendix I dose limits for radioiodines, tritium, and particulate radionuclides released to the atmosphere will be done in the manner similar to the liquid release dose calculations described in Section 5.1.1. The total dose is compared to the corresponding atmospheric release mode Appendix I dose limit for the organ in question.

The doses are calculated using the following formula:

$$API = \sum Dose_{aom(i)} = \sum (TDF_{aom(i)} \times C_i) \leq K_{om} \text{ mrem}$$

Where

API	=	the Appendix I dose for compliance evaluations in mrem
$Dose_{aom(i)}$	=	the dose to the specific age group (a) and organ (o) via release mode (m) from radionuclide (i)
$TDF_{aom(i)}$	=	total dose factor for the specific age group (a) and organ (o) via release mode (m) from radionuclide (i) from Table 5.1-2 in mrem/Ci
C_i	=	curies of radionuclide (i) released
K_{om}	=	the Appendix I dose limit for organ (o) and release mode (m) for which the calculation is being made.

The methodology and the values used to obtain the $TDF_{aom(i)}$ values are given in Appendix C.

It is recognized that some of the release quantities may not be available at the end of the month because the samples from these release paths are sent to a vendor for analysis. Usually, the only radionuclides affected by these delays are Sr-89 and Sr-90. Because the quantities of these two radionuclides are but a small fraction of the total release, the absence of their dose contributions from the initial monthly dose calculation will not significantly affect the total dose obtained from the remaining radionuclides. The dose for the month will be updated upon the receipt of the vendor isotopic results and upon the receipt of any corrections to previous release quantities.

Instead of using the precalculated total dose factors, the Appendix I dose calculation may be modified to reflect the actual x/Q during the release period using the methodology of Appendix C.

Table 5.1-2

Airborne Effluent Dose Factors

Summations of dose per curie released were made for calculations over the pathways: ingestion of produce, leafy vegetables, milk, meat; inhalation of airborne radionuclides, and direct exposure to deposited radioactivity.

Dose factor - airborne release pathway (mrem/Ci released)

H-3

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	9.78E-05	9.78E-05	9.78E-05	9.78E-05	9.78E-05	9.78E-05	0.00E+00
Teen	0.00E+00	1.03E-04	1.03E-04	1.03E-04	1.03E-04	1.03E-04	1.03E-04	0.00E+00
Child	0.00E+00	1.32E-04	1.32E-04	1.32E-04	1.32E-04	1.32E-04	1.32E-04	0.00E+00
Infant	0.00E+00	2.03E-05	2.03E-05	2.03E-05	2.03E-05	2.03E-05	2.03E-05	0.00E+00

Dose factor - airborne release pathway (mrem/Ci released)

F-18

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.12E-04	0.00E+00	9.61E-04	0.00E+00	0.00E+00	0.00E+00	2.19E-06	2.23E-03
Teen	1.55E-04	0.00E+00	9.65E-04	0.00E+00	0.00E+00	0.00E+00	9.23E-06	2.23E-03
Child	2.06E-04	0.00E+00	9.69E-04	0.00E+00	0.00E+00	0.00E+00	3.70E-05	2.23E-03
Infant	1.63E-04	0.00E+00	9.62E-04	0.00E+00	0.00E+00	0.00E+00	2.53E-05	2.23E-03

Dose factor - airborne release pathway (mrem/Ci released)

Na-22

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.83E+00	4.83E+00	2.89E+01	4.83E+00	4.83E+00	4.83E+00	4.83E+00	3.79E+01
Teen	7.41E+00	7.41E+00	3.15E+01	7.41E+00	7.41E+00	7.41E+00	7.41E+00	3.79E+01
Child	1.50E+01	1.50E+01	3.90E+01	1.50E+01	1.50E+01	1.50E+01	1.50E+01	3.79E+01
Infant	1.81E+01	1.81E+01	4.21E+01	1.81E+01	1.81E+01	1.81E+01	1.81E+01	3.79E+01

Dose factor - airborne release pathway (mrem/Ci released)

Na-24

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	9.48E-04	9.48E-04	1.77E-02	9.48E-04	9.48E-04	9.48E-04	9.48E-04	7.64E-02
Teen	1.36E-03	1.36E-03	1.81E-02	1.36E-03	1.36E-03	1.36E-03	1.36E-03	7.64E-02
Child	2.37E-03	2.37E-03	1.91E-02	2.37E-03	2.37E-03	2.37E-03	2.37E-03	7.64E-02
Infant	3.14E-03	3.14E-03	1.99E-02	3.14E-03	3.14E-03	3.14E-03	3.14E-03	7.64E-02

Dose factor - airborne release pathway (mrem/Ci released)

Sc-46

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.33E-02	2.59E-02	2.00E+00	0.00E+00	2.42E-02	0.00E+00	2.40E+00	2.69E+00
Teen	1.75E-02	3.41E-02	2.00E+00	0.00E+00	3.26E-02	0.00E+00	2.09E+00	2.69E+00
Child	2.23E-02	3.05E-02	2.00E+00	0.00E+00	2.70E-02	0.00E+00	1.32E+00	2.69E+00
Infant	1.56E-02	2.25E-02	2.00E+00	0.00E+00	1.48E-02	0.00E+00	1.35E-03	2.69E+00

Dose factor - airborne release pathway (mrem/Ci released)

Mn-54

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	2.32E-01	1.99E+00	0.00E+00	6.89E-02	4.15E-02	7.08E-01	2.28E+00
Teen	0.00E+00	3.34E-01	2.01E+00	0.00E+00	9.95E-02	5.89E-02	6.83E-01	2.28E+00
Child	0.00E+00	4.86E-01	2.07E+00	0.00E+00	1.36E-01	4.68E-02	4.08E-01	2.28E+00
Infant	0.00E+00	2.03E-02	1.95E+00	0.00E+00	4.47E-03	2.97E-02	7.38E-03	2.28E+00

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Cr-51

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	0.00E+00	6.39E-03	2.68E-05	9.86E-06	4.83E-04	1.07E-02	7.73E-03
Teen	0.00E+00	0.00E+00	6.60E-03	3.39E-05	1.34E-05	7.03E-04	9.66E-03	7.73E-03
Child	0.00E+00	0.00E+00	6.66E-03	6.30E-05	1.72E-05	6.14E-04	5.81E-03	7.73E-03
Infant	0.00E+00	0.00E+00	6.58E-03	2.42E-05	5.31E-06	4.25E-04	1.02E-03	7.73E-03

Dose factor - airborne release pathway (mrem/Ci released)

Mn-56

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	4.81E-08	1.27E-03	0.00E+00	5.31E-08	2.80E-04	6.01E-04	1.50E-03
Teen	0.00E+00	6.05E-08	1.27E-03	0.00E+00	6.61E-08	4.51E-04	1.70E-03	1.50E-03
Child	0.00E+00	6.26E-08	1.27E-03	0.00E+00	6.58E-08	3.90E-04	3.66E-03	1.50E-03
Infant	0.00E+00	4.57E-08	1.27E-03	0.00E+00	3.27E-08	3.72E-04	2.13E-03	1.50E-03

Dose factor - airborne release pathway (mrem/Ci released)

Fe-55

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.20E-01	2.21E-01	5.15E-02	0.00E+00	0.00E+00	1.25E-01	1.27E-01	0.00E+00
Teen	3.80E-01	2.70E-01	6.29E-02	0.00E+00	0.00E+00	1.74E-01	1.17E-01	0.00E+00
Child	8.65E-01	4.59E-01	1.42E-01	0.00E+00	0.00E+00	2.62E-01	8.49E-02	0.00E+00
Infant	7.36E-02	4.75E-02	1.27E-02	0.00E+00	0.00E+00	2.56E-02	6.02E-03	0.00E+00

Dose factor - airborne release pathway (mrem/Ci released)

Fe-59

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	2.01E-01	4.73E-01	5.65E-01	0.00E+00	0.00E+00	1.62E-01	1.58E+00	4.50E-01
Teen	2.25E-01	5.24E-01	5.86E-01	0.00E+00	0.00E+00	2.10E-01	1.24E+00	4.50E-01
Child	4.62E-01	7.48E-01	7.56E-01	0.00E+00	0.00E+00	2.54E-01	7.80E-01	4.50E-01
Infant	6.14E-02	1.07E-01	4.26E-01	0.00E+00	0.00E+00	6.16E-02	5.16E-02	4.50E-01

Dose factor - airborne release pathway (mrem/Ci released)

Co-57

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	1.17E-02	4.93E-01	0.00E+00	0.00E+00	1.10E-02	2.97E-01	6.13E-01
Teen	0.00E+00	1.59E-02	5.00E-01	0.00E+00	0.00E+00	1.74E-02	2.97E-01	6.13E-01
Child	0.00E+00	2.57E-02	5.26E-01	0.00E+00	0.00E+00	1.50E-02	2.11E-01	6.13E-01
Infant	0.00E+00	4.38E-03	4.81E-01	0.00E+00	0.00E+00	1.13E-02	1.50E-02	6.13E-01

Dose factor - airborne release pathway (mrem/Ci released)

Co-58

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	3.14E-02	6.02E-01	0.00E+00	0.00E+00	2.75E-02	6.38E-01	6.23E-01
Teen	0.00E+00	4.00E-02	6.24E-01	0.00E+00	0.00E+00	3.99E-02	5.53E-01	6.23E-01
Child	0.00E+00	5.73E-02	7.07E-01	0.00E+00	0.00E+00	3.28E-02	3.35E-01	6.23E-01
Infant	0.00E+00	9.90E-03	5.57E-01	0.00E+00	0.00E+00	2.31E-02	2.49E-02	6.23E-01

Dose factor - airborne release pathway (mrem/Ci released)

Co-60

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	1.68E-01	3.06E+01	0.00E+00	0.00E+00	1.77E-01	3.16E+00	3.56E+01
Teen	0.00E+00	2.23E-01	3.07E+01	0.00E+00	0.00E+00	2.59E-01	2.90E+00	3.56E+01
Child	0.00E+00	3.28E-01	3.12E+01	0.00E+00	0.00E+00	2.10E-01	1.82E+00	3.56E+01
Infant	0.00E+00	5.86E-02	3.04E+01	0.00E+00	0.00E+00	1.34E-01	1.40E-01	3.56E+01

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Ni-63

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	2.39E+01	1.65E+00	8.00E-01	0.00E+00	0.00E+00	5.29E-03	3.45E-01	0.00E+00
Teen	2.93E+01	2.07E+00	9.92E-01	0.00E+00	0.00E+00	9.11E-03	3.29E-01	0.00E+00
Child	6.73E+01	3.60E+00	2.29E+00	0.00E+00	0.00E+00	8.16E-03	2.43E-01	0.00E+00
Infant	2.11E+01	1.30E+00	7.32E-01	0.00E+00	0.00E+00	6.19E-03	6.49E-02	0.00E+00

Dose factor - airborne release pathway (mrem/Ci released)

Ni-65

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	8.95E-08	1.19E-08	4.17E-04	0.00E+00	0.00E+00	1.66E-04	3.66E-04	4.85E-04
Teen	1.06E-07	1.39E-08	4.17E-04	0.00E+00	0.00E+00	2.78E-04	1.09E-03	4.85E-04
Child	1.64E-07	1.58E-08	4.17E-04	0.00E+00	0.00E+00	2.43E-04	2.49E-03	4.85E-04
Infant	7.17E-08	8.51E-09	4.17E-04	0.00E+00	0.00E+00	2.41E-04	1.49E-03	4.85E-04

Dose factor - airborne release pathway (mrem/Ci released)

Cu-64

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	1.12E-05	8.57E-04	0.00E+00	2.82E-05	2.01E-04	2.40E-03	9.65E-04
Teen	0.00E+00	1.40E-05	8.58E-04	0.00E+00	3.54E-05	3.30E-04	2.90E-03	9.65E-04
Child	0.00E+00	2.19E-05	8.65E-04	0.00E+00	5.28E-05	2.84E-04	2.11E-03	9.65E-04
Infant	0.00E+00	3.42E-05	8.68E-04	0.00E+00	5.79E-05	2.76E-04	1.15E-03	9.65E-04

Dose factor - airborne release pathway (mrem/Ci released)

Zn-65

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.21E+00	3.85E+00	2.79E+00	0.00E+00	2.57E+00	2.56E-02	2.42E+00	1.21E+00
Teen	1.63E+00	5.67E+00	3.69E+00	0.00E+00	3.63E+00	3.68E-02	2.40E+00	1.21E+00
Child	3.12E+00	8.31E+00	6.22E+00	0.00E+00	5.24E+00	2.95E-02	1.46E+00	1.21E+00
Infant	2.95E+00	1.01E+01	5.71E+00	0.00E+00	4.91E+00	1.92E-02	8.54E+00	1.21E+00

Dose factor - airborne release pathway (mrem/Ci released)

Zn-69

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.01E-06	5.76E-06	4.01E-07	0.00E+00	3.74E-06	2.73E-05	1.35E-04	0.00E+00
Teen	4.64E-06	8.83E-06	6.18E-07	0.00E+00	5.77E-06	4.70E-05	2.47E-05	0.00E+00
Child	1.08E-05	1.56E-05	1.45E-06	0.00E+00	9.49E-06	4.22E-05	1.29E-03	0.00E+00
Infant	1.93E-05	3.48E-05	2.59E-06	0.00E+00	1.45E-05	4.36E-05	3.23E-03	0.00E+00

Dose factor - airborne release pathway (mrem/Ci released)

Zn-69m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.99E-05	1.20E-04	3.07E-03	0.00E+00	7.26E-05	5.65E-04	1.13E-02	5.74E-03
Teen	7.60E-05	1.79E-04	3.07E-03	0.00E+00	1.09E-04	9.30E-04	1.49E-02	5.74E-03
Child	1.76E-04	3.00E-04	3.09E-03	0.00E+00	1.74E-04	8.08E-04	1.27E-02	5.74E-03
Infant	3.11E-04	6.35E-04	3.12E-03	0.00E+00	2.57E-04	7.93E-04	1.00E-02	5.74E-03

Dose factor - airborne release pathway (mrem/Ci released)

Br-82

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	0.00E+00	5.44E-02	0.00E+00	0.00E+00	0.00E+00	8.47E-03	6.41E-02
Teen	0.00E+00	0.00E+00	5.89E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	6.41E-02
Child	0.00E+00	0.00E+00	7.04E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	6.41E-02
Infant	0.00E+00	0.00E+00	8.32E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	6.41E-02

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Br-83

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	0.00E+00	1.65E-05	0.00E+00	0.00E+00	0.00E+00	6.89E-06	2.84E-03
Teen	0.00E+00	0.00E+00	1.96E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.84E-03
Child	0.00E+00	0.00E+00	2.34E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.84E-03
Infant	0.00E+00	0.00E+00	2.07E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.84E-03

Dose factor - airborne release pathway (mrem/Ci released)

Br-84

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	0.00E+00	2.59E-02	0.00E+00	0.00E+00	0.00E+00	1.11E-09	2.49E-01
Teen	0.00E+00	0.00E+00	2.60E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.49E-01
Child	0.00E+00	0.00E+00	2.63E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.49E-01
Infant	0.00E+00	0.00E+00	2.66E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.49E-01

Dose factor - airborne release pathway (mrem/Ci released)

Br-85

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	0.00E+00	4.95E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.63E-04
Teen	0.00E+00	0.00E+00	7.06E-06	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.63E-04
Child	0.00E+00	0.00E+00	2.02E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.63E-04
Infant	0.00E+00	0.00E+00	4.21E-05	0.00E+00	0.00E+00	0.00E+00	0.00E+00	2.63E-04

Dose factor - airborne release pathway (mrem/Ci released)

Rb-86

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	8.21E-01	3.95E-01	0.00E+00	0.00E+00	0.00E+00	1.61E-01	1.44E-02
Teen	0.00E+00	1.23E+00	5.52E-01	0.00E+00	0.00E+00	0.00E+00	1.82E-01	1.44E-02
Child	0.00E+00	2.18E+00	1.35E+00	0.00E+00	0.00E+00	0.00E+00	1.40E-01	1.44E-02
Infant	0.00E+00	4.17E+00	2.07E+00	0.00E+00	0.00E+00	0.00E+00	1.07E-01	1.44E-02

Dose factor - airborne release pathway (mrem/Ci released)

Rb-88

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	1.15E-05	5.22E-05	0.00E+00	0.00E+00	0.00E+00	9.92E-17	5.31E-05
Teen	0.00E+00	1.62E-05	5.45E-05	0.00E+00	0.00E+00	0.00E+00	8.66E-13	5.31E-05
Child	0.00E+00	1.67E-05	5.73E-05	0.00E+00	0.00E+00	0.00E+00	5.12E-07	5.31E-05
Infant	0.00E+00	1.65E-05	5.50E-05	0.00E+00	0.00E+00	0.00E+00	1.01E-05	5.31E-05

Dose factor - airborne release pathway (mrem/Ci released)

Rb-89

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	7.60E-06	1.78E-04	0.00E+00	0.00E+00	0.00E+00	2.75E-19	2.07E-04
Teen	0.00E+00	1.04E-05	1.80E-04	0.00E+00	0.00E+00	0.00E+00	1.00E-14	2.07E-04
Child	0.00E+00	1.02E-05	1.81E-04	0.00E+00	0.00E+00	0.00E+00	5.61E-08	2.07E-04
Infant	0.00E+00	9.51E-06	1.79E-04	0.00E+00	0.00E+00	0.00E+00	2.02E-06	2.07E-04

Dose factor - airborne release pathway (mrem/Ci released)

Sr-89

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	7.63E+00	0.00E+00	2.19E-01	0.00E+00	0.00E+00	4.15E-02	1.23E+00	3.53E-05
Teen	1.16E+01	0.00E+00	3.34E-01	0.00E+00	0.00E+00	7.17E-02	1.40E+00	3.53E-05
Child	2.77E+01	0.00E+00	7.90E-01	0.00E+00	0.00E+00	6.40E-02	1.08E+00	3.53E-05
Infant	3.66E+00	0.00E+00	1.05E-01	0.00E+00	0.00E+00	6.02E-02	7.69E-02	3.53E-05

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Sr-90

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	5.10E+02	0.00E+00	1.25E+02	0.00E+00	0.00E+00	2.85E-01	1.47E+01	0.00E+00
Teen	6.33E+02	0.00E+00	1.56E+02	0.00E+00	0.00E+00	4.89E-01	1.77E+01	0.00E+00
Child	1.05E+03	0.00E+00	2.65E+02	0.00E+00	0.00E+00	4.38E-01	1.41E+01	0.00E+00
Infant	7.33E+01	0.00E+00	1.84E+01	0.00E+00	0.00E+00	3.34E-01	9.04E-01	0.00E+00

Dose factor - airborne release pathway (mrem/Ci released)

Sr-91

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	2.29E-04	0.00E+00	3.03E-03	0.00E+00	0.00E+00	1.08E-03	6.76E-03	3.53E-03
Teen	2.20E-04	0.00E+00	3.03E-03	0.00E+00	0.00E+00	1.80E-03	8.68E-03	3.53E-03
Child	4.09E-04	0.00E+00	3.03E-03	0.00E+00	0.00E+00	1.58E-03	6.06E-03	3.53E-03
Infant	5.29E-05	0.00E+00	3.02E-03	0.00E+00	0.00E+00	1.56E-03	2.24E-03	3.53E-03

Dose factor - airborne release pathway (mrem/Ci released)

Sr-92

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	5.04E-07	0.00E+00	1.65E-03	0.00E+00	0.00E+00	4.89E-04	1.28E-03	3.15E-03
Teen	5.66E-07	0.00E+00	1.65E-03	0.00E+00	0.00E+00	8.14E-04	3.54E-03	3.15E-03
Child	9.08E-07	0.00E+00	1.65E-03	0.00E+00	0.00E+00	7.12E-04	7.20E-03	3.15E-03
Infant	3.12E-07	0.00E+00	1.65E-03	0.00E+00	0.00E+00	7.06E-04	4.15E-03	3.15E-03

Dose factor - airborne release pathway (mrem/Ci released)

Y-90

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	7.17E-05	0.00E+00	8.23E-06	0.00E+00	0.00E+00	5.03E-03	1.19E-01	7.45E-06
Teen	9.77E-05	0.00E+00	8.93E-06	0.00E+00	0.00E+00	8.69E-03	9.20E-02	7.45E-06
Child	1.39E-04	0.00E+00	1.00E-05	0.00E+00	0.00E+00	7.76E-03	5.63E-02	7.45E-06
Infant	9.77E-05	0.00E+00	8.93E-06	0.00E+00	0.00E+00	7.98E-03	3.26E-03	7.45E-06

Dose factor - airborne release pathway (mrem/Ci released)

Y-91

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.78E-02	0.00E+00	1.98E-03	0.00E+00	0.00E+00	5.06E-02	2.26E+00	1.70E-03
Teen	2.55E-02	0.00E+00	2.19E-03	0.00E+00	0.00E+00	8.71E-02	2.44E+00	1.70E-03
Child	4.10E-02	0.00E+00	2.60E-03	0.00E+00	0.00E+00	7.79E-02	1.86E+00	1.70E-03
Infant	1.75E-02	0.00E+00	1.97E-03	0.00E+00	0.00E+00	7.27E-02	3.72E-03	1.70E-03

Dose factor - airborne release pathway (mrem/Ci released)

Y-91m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.58E-06	0.00E+00	2.31E-04	0.00E+00	0.00E+00	5.70E-05	1.05E-05	4.33E-04
Teen	6.15E-06	0.00E+00	2.31E-04	0.00E+00	0.00E+00	9.49E-05	2.91E-04	4.33E-04
Child	1.50E-05	0.00E+00	2.31E-04	0.00E+00	0.00E+00	8.34E-05	2.94E-02	4.33E-04
Infant	1.21E-08	0.00E+00	2.31E-04	0.00E+00	0.00E+00	8.27E-05	6.98E-05	4.33E-04

Dose factor - airborne release pathway (mrem/Ci released)

Y-92

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.35E-05	0.00E+00	4.38E-04	0.00E+00	0.00E+00	4.65E-04	5.83E-01	2.90E-02
Teen	5.80E-05	0.00E+00	4.39E-04	0.00E+00	0.00E+00	7.95E-04	1.58E+00	2.90E-02
Child	1.42E-04	0.00E+00	4.41E-04	0.00E+00	0.00E+00	7.09E-04	4.09E+00	2.90E-02
Infant	4.86E-07	0.00E+00	4.37E-04	0.00E+00	0.00E+00	7.27E-04	3.76E-03	2.90E-02

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Y-93

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.08E-04	0.00E+00	4.43E-04	0.00E+00	0.00E+00	1.44E-03	3.35E+00	6.58E-02
Teen	1.86E-04	0.00E+00	4.45E-04	0.00E+00	0.00E+00	2.47E-03	5.59E+00	6.58E-02
Child	4.53E-04	0.00E+00	4.52E-04	0.00E+00	0.00E+00	2.21E-03	6.69E+00	6.58E-02
Infant	4.45E-06	0.00E+00	4.40E-04	0.00E+00	0.00E+00	2.27E-03	4.95E-03	6.59E-02

Dose factor - airborne release pathway (mrem/Ci released)

Zr-95

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.79E-03	1.54E-03	3.45E-01	0.00E+00	2.42E-03	5.25E-02	1.64E+00	3.98E-01
Teen	6.16E-03	1.94E-03	3.45E-01	0.00E+00	2.85E-03	7.98E-02	1.35E+00	3.98E-01
Child	9.47E-03	2.08E-03	3.45E-01	0.00E+00	2.97E-03	6.62E-02	8.81E-01	3.98E-01
Infant	3.43E-03	8.27E-04	3.44E-01	0.00E+00	9.23E-04	5.19E-02	9.12E-04	3.98E-01

Dose factor - airborne release pathway (mrem/Ci released)

Zr-97

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.12E-06	6.31E-07	4.16E-03	0.00E+00	9.56E-07	2.34E-03	3.09E-02	4.84E-03
Teen	4.31E-06	8.52E-07	4.16E-03	0.00E+00	1.29E-06	3.85E-03	3.09E-02	4.84E-03
Child	5.98E-06	8.66E-07	4.16E-03	0.00E+00	1.24E-06	3.36E-03	1.95E-02	4.84E-03
Infant	4.45E-06	7.60E-07	4.16E-03	0.00E+00	7.69E-07	3.27E-03	4.16E-03	4.84E-03

Dose factor - airborne release pathway (mrem/Ci released)

Nb-95

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.39E-03	7.75E-04	1.92E-01	0.00E+00	7.67E-04	1.50E-02	3.30E+00	2.26E-01
Teen	1.39E-03	7.72E-04	1.92E-01	0.00E+00	7.48E-04	2.23E-02	1.99E+00	2.26E-01
Child	2.22E-03	8.65E-04	1.93E-01	0.00E+00	8.13E-04	1.82E-02	1.10E+00	2.26E-01
Infant	6.08E-04	2.49E-04	1.92E-01	0.00E+00	1.82E-04	1.42E-02	4.99E-02	2.26E-01

Dose factor - airborne release pathway (mrem/Ci released)

Nb-97

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	2.05E-06	5.17E-07	4.17E-04	0.00E+00	6.03E-07	7.12E-05	1.91E-03	3.20E-03
Teen	3.50E-06	8.68E-07	4.17E-04	0.00E+00	1.02E-06	1.17E-04	2.07E-02	3.20E-03
Child	8.49E-06	1.53E-06	4.17E-04	0.00E+00	1.70E-06	1.01E-04	4.73E-01	3.20E-03
Infant	1.01E-08	2.16E-09	4.17E-04	0.00E+00	1.69E-09	9.84E-05	7.98E-04	3.20E-03

Dose factor - airborne release pathway (mrem/Ci released)

Mo-99

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	0.00E+00	9.10E-03	7.34E-03	0.00E+00	2.06E-02	2.71E-03	2.85E-02	6.50E-03
Teen	0.00E+00	1.24E-02	7.97E-03	0.00E+00	2.84E-02	4.56E-03	3.02E-02	6.50E-03
Child	0.00E+00	2.06E-02	1.07E-02	0.00E+00	4.41E-02	4.02E-03	2.08E-02	6.50E-03
Infant	0.00E+00	3.82E-02	1.31E-02	0.00E+00	5.70E-02	4.00E-03	1.40E-02	6.50E-03

Dose factor - airborne release pathway (mrem/Ci released)

Tc-99m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	2.92E-09	8.24E-09	2.59E-04	0.00E+00	1.25E-07	2.27E-05	1.28E-04	2.96E-04
Teen	3.11E-09	8.68E-09	2.59E-04	0.00E+00	1.29E-07	3.42E-05	1.87E-04	2.96E-04
Child	5.95E-09	1.17E-08	2.59E-04	0.00E+00	1.69E-07	2.82E-05	1.49E-04	2.96E-04
Infant	5.14E-09	1.06E-08	2.59E-04	0.00E+00	1.14E-07	2.41E-05	6.33E-05	2.96E-04

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Tc-101

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.16E-05	1.67E-05	2.08E-04	0.00E+00	3.01E-04	2.04E-05	5.06E-17	5.80E-04
Teen	1.99E-05	2.83E-05	3.23E-04	0.00E+00	5.12E-04	3.71E-05	4.87E-12	5.80E-04
Child	4.89E-05	5.12E-05	6.93E-04	0.00E+00	8.72E-04	4.44E-05	1.63E-04	5.80E-04
Infant	1.93E-12	2.44E-12	4.44E-05	0.00E+00	2.90E-11	1.73E-05	2.50E-05	5.80E-04

Dose factor - airborne release pathway (mrem/Ci released)

Ru-103

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.36E-02	0.00E+00	1.71E-01	0.00E+00	1.66E-01	1.50E-02	5.08E+00	1.77E-01
Teen	3.76E-02	0.00E+00	1.68E-01	0.00E+00	1.33E-01	2.32E-02	3.14E+00	1.77E-01
Child	7.01E-02	0.00E+00	1.79E-01	0.00E+00	1.77E-01	1.97E-02	1.81E+00	1.77E-01
Infant	6.20E-05	0.00E+00	1.52E-01	0.00E+00	1.30E-04	1.64E-02	5.05E-04	1.77E-01

Dose factor - airborne release pathway (mrem/Ci released)

Ru-105

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	6.19E-04	0.00E+00	2.07E-03	0.00E+00	7.99E-03	3.25E-04	3.80E-01	1.02E-02
Teen	1.06E-03	0.00E+00	2.23E-03	0.00E+00	1.34E-02	5.39E-04	8.59E-01	1.02E-02
Child	2.59E-03	0.00E+00	2.76E-03	0.00E+00	2.28E-02	4.72E-04	1.69E+00	1.02E-02
Infant	3.63E-08	0.00E+00	1.82E-03	0.00E+00	2.67E-08	4.65E-04	1.44E-03	1.02E-02

Dose factor - airborne release pathway (mrem/Ci released)

Ru-106

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.65E+00	0.00E+00	8.01E-01	0.00E+00	3.18E+00	2.78E-01	1.06E+02	7.11E-01
Teen	1.49E+00	0.00E+00	7.81E-01	0.00E+00	2.88E+00	4.77E-01	7.16E+01	7.11E-01
Child	2.93E+00	0.00E+00	9.58E-01	0.00E+00	3.96E+00	4.25E-01	4.55E+01	7.11E-01
Infant	2.67E-03	0.00E+00	5.93E-01	0.00E+00	3.28E-03	3.43E-01	5.60E-03	7.11E-01

Dose factor - airborne release pathway (mrem/Ci released)

Rh-103

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.81E-02	3.52E-02	2.47E-02	0.00E+00	1.50E-01	5.72E-04	5.61E+00	7.74E-03
Teen	8.33E-02	6.02E-02	4.10E-02	0.00E+00	2.56E-01	9.71E-04	7.66E+00	7.74E-03
Child	2.04E-01	1.10E-01	9.53E-02	0.00E+00	4.37E-01	8.59E-04	6.80E+00	7.74E-03
Infant	7.15E-04	4.68E-04	1.83E-03	0.00E+00	1.30E-03	8.64E-04	1.22E-02	7.74E-03

Dose factor - airborne release pathway (mrem/Ci released)

Ag-110m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.10E-02	3.80E-02	4.85E+00	0.00E+00	7.47E-02	1.37E-01	1.54E+01	5.63E+00
Teen	6.28E-02	5.94E-02	4.86E+00	0.00E+00	1.13E-01	2.00E-01	1.66E+01	5.63E+00
Child	1.34E-01	9.04E-02	4.90E+00	0.00E+00	1.68E-01	1.62E-01	1.07E+01	5.63E+00
Infant	1.93E-01	1.41E-01	4.92E+00	0.00E+00	2.02E-01	1.09E-01	7.31E+00	5.63E+00

Dose factor - airborne release pathway (mrem/Ci released)

Sb-124

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.44E-01	2.73E-03	1.36E+00	3.50E-04	0.00E+00	1.85E-01	4.09E+00	4.02E+00
Teen	2.22E-01	4.09E-03	1.39E+00	5.03E-04	0.00E+00	3.07E-01	4.46E+00	4.02E+00
Child	5.11E-01	6.63E-03	1.48E+00	1.13E-03	0.00E+00	3.79E-01	3.19E+00	4.02E+00
Infant	6.72E-02	9.90E-04	1.32E+00	1.78E-04	0.00E+00	1.20E-01	2.06E-01	4.02E+00

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Sb-125

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.07E-01	1.20E-03	5.38E+00	1.09E-04	0.00E+00	1.33E-01	1.17E+00	9.11E+00
Teen	1.61E-01	1.76E-03	5.39E+00	1.54E-04	0.00E+00	2.21E-01	1.24E+00	9.11E+00
Child	3.69E-01	2.84E-03	5.43E+00	3.42E-04	0.00E+00	2.73E-01	8.75E-01	9.11E+00
Infant	8.33E-02	8.05E-04	5.37E+00	1.04E-04	0.00E+00	9.99E-02	1.09E-01	9.11E+00

Dose factor - airborne release pathway (mrem/Ci released)

Te-125m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.87E-01	1.40E-01	6.67E-02	1.16E-01	1.57E+00	9.30E-03	1.55E+00	3.96E-02
Teen	5.11E-01	1.84E-01	8.32E-02	1.43E-01	0.00E+00	1.59E-02	1.51E+00	3.96E-02
Child	1.17E+00	3.16E-01	1.70E-01	3.27E-01	0.00E+00	1.42E-02	1.13E+00	3.96E-02
Infant	5.10E-02	1.71E-02	2.18E-02	1.72E-02	0.00E+00	1.33E-02	2.46E-02	3.96E-02

Dose factor - airborne release pathway (mrem/Ci released)

Te-127

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.47E-06	1.61E-06	5.15E-06	3.31E-06	1.82E-05	1.93E-04	2.05E-03	4.60E-06
Teen	4.34E-06	1.55E-06	5.12E-06	3.00E-06	1.76E-05	3.32E-04	2.73E-03	4.60E-06
Child	8.13E-06	2.20E-06	5.93E-06	5.63E-06	2.31E-05	2.98E-04	1.98E-03	4.60E-06
Infant	1.25E-06	4.25E-07	4.45E-06	1.02E-06	3.03E-06	3.07E-04	7.48E-04	4.60E-06

Dose factor - airborne release pathway (mrem/Ci released)

Te-127m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.19E+00	4.26E-01	1.54E-01	3.05E-01	4.84E+00	2.85E-02	4.00E+00	6.16E-02
Teen	1.48E+00	5.26E-01	1.85E-01	3.52E-01	6.01E+00	4.91E-02	3.70E+00	6.16E-02
Child	3.32E+00	8.94E-01	4.03E-01	7.94E-01	9.47E+00	4.39E-02	2.69E+00	6.16E-02
Infant	1.96E-01	6.50E-02	3.26E-02	5.66E-02	4.82E-01	3.89E-02	7.96E-02	6.16E-02

Dose factor - airborne release pathway (mrem/Ci released)

Te-129

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.48E-09	7.10E-10	3.68E-05	1.16E-09	5.56E-09	5.74E-05	4.65E-06	4.36E-05
Teen	2.11E-09	1.00E-09	3.68E-05	1.54E-09	7.88E-09	9.78E-05	4.79E-05	4.36E-05
Child	2.90E-09	1.04E-09	3.68E-05	2.12E-09	7.62E-09	8.71E-05	7.56E-04	4.36E-05
Infant	2.34E-09	1.03E-09	3.68E-05	2.00E-09	5.19E-09	8.89E-05	7.81E-04	4.36E-05

Dose factor - airborne release pathway (mrem/Ci released)

Te-129m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.39E+00	5.19E-01	2.35E-01	4.78E-01	5.80E+00	3.44E-02	7.01E+00	9.07E-01
Teen	1.94E+00	7.20E-01	3.22E-01	6.26E-01	8.12E+00	5.86E-02	7.30E+00	9.07E-01
Child	4.53E+00	1.26E+00	7.18E-01	1.46E+00	1.33E+01	5.23E-02	5.53E+00	9.07E-01
Infant	1.39E-01	4.77E-02	3.66E-02	5.34E-02	3.48E-01	4.98E-02	8.46E-02	9.07E-01

Dose factor - airborne release pathway (mrem/Ci released)

Te-131

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.47E-03	6.14E-04	5.56E-04	1.21E-03	6.43E-03	4.13E-05	2.09E-04	1.63E-03
Teen	2.52E-03	1.04E-03	8.80E-04	1.94E-03	1.10E-02	6.93E-05	2.07E-04	1.63E-03
Child	6.19E-03	1.89E-03	1.93E-03	4.73E-03	1.87E-02	6.09E-05	3.25E-02	1.63E-03
Infant	5.15E-10	2.44E-10	9.27E-05	4.69E-10	1.18E-09	6.11E-05	2.44E-04	1.63E-03

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Te-131m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.30E-01	6.34E-02	7.45E-02	1.03E-01	6.43E-01	4.32E-03	6.32E+00	3.77E-02
Teen	2.21E-01	1.06E-01	1.10E-01	1.60E-01	1.11E+00	7.05E-03	8.53E+00	3.77E-02
Child	5.38E-01	1.86E-01	2.20E-01	3.83E-01	1.80E+00	6.10E-03	7.56E+00	3.77E-02
Infant	6.34E-04	2.56E-04	2.18E-02	5.18E-04	1.76E-03	5.90E-03	7.81E-03	3.77E-02

Dose factor - airborne release pathway (mrem/Ci released)

Te-132

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.92E-01	1.24E-01	1.27E-01	1.37E-01	1.20E+00	8.55E-03	5.89E+00	1.32E-02
Teen	3.19E-01	2.02E-01	2.00E-01	2.13E-01	1.94E+00	1.33E-02	6.42E+00	1.32E-02
Child	7.61E-01	3.37E-01	4.17E-01	4.91E-01	3.13E+00	1.12E-02	3.39E+00	1.32E-02
Infant	3.94E-03	1.95E-03	1.17E-02	2.88E-03	1.22E-02	1.01E-02	8.50E-03	1.32E-02

Dose factor - airborne release pathway (mrem/Ci released)

I-131

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	7.16E-02	1.02E-01	8.29E-02	3.36E+01	1.76E-01	0.00E+00	2.69E-02	2.93E-02
Teen	6.57E-02	9.19E-02	7.35E-02	2.68E+01	1.58E-01	0.00E+00	1.81E-02	2.93E-02
Child	1.44E-01	1.45E-01	1.07E-01	4.80E+01	2.38E-01	0.00E+00	1.29E-02	2.93E-02
Infant	2.04E-01	2.40E-01	1.30E-01	7.89E+01	2.80E-01	0.00E+00	8.56E-03	2.93E-02

Dose factor - airborne release pathway (mrem/Ci released)

I-132

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.44E-05	9.67E-05	1.78E-03	3.40E-03	1.54E-04	0.00E+00	1.21E-05	2.06E-03
Teen	4.73E-05	1.30E-04	1.80E-03	4.49E-03	2.05E-04	0.00E+00	3.78E-05	2.06E-03
Child	6.28E-05	1.21E-04	1.80E-03	5.74E-03	1.86E-04	0.00E+00	9.50E-05	2.06E-03
Infant	5.03E-05	1.05E-04	1.79E-03	5.03E-03	1.17E-04	0.00E+00	5.65E-05	2.06E-03

Dose factor - airborne release pathway (mrem/Ci released)

I-133

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.46E-03	2.53E-03	4.21E-03	3.71E-01	4.41E-03	0.00E+00	2.14E-03	4.19E-03
Teen	1.49E-03	2.52E-03	4.21E-03	3.53E-01	4.42E-03	0.00E+00	1.75E-03	4.19E-03
Child	2.87E-03	3.55E-03	4.78E-03	6.61E-01	5.91E-03	0.00E+00	1.35E-03	4.19E-03
Infant	3.16E-03	4.59E-03	4.79E-03	8.37E-01	5.40E-03	0.00E+00	7.45E-04	4.19E-03

Dose factor - airborne release pathway (mrem/Ci released)

I-134

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.91E-05	5.13E-05	6.45E-04	8.85E-04	8.17E-05	0.00E+00	2.99E-08	7.45E-04
Teen	2.63E-05	6.88E-05	6.52E-04	1.17E-03	1.09E-04	0.00E+00	6.05E-07	7.45E-04
Child	3.48E-05	6.41E-05	6.57E-04	1.50E-03	9.79E-05	0.00E+00	2.83E-05	7.45E-04
Infant	2.73E-05	5.57E-05	6.47E-04	1.32E-03	6.19E-05	0.00E+00	3.83E-05	7.45E-04

Dose factor - airborne release pathway (mrem/Ci released)

I-135

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	9.31E-05	2.43E-04	3.64E-03	1.56E-02	3.87E-04	0.00E+00	1.96E-04	4.14E-03
Teen	1.22E-04	3.12E-04	3.66E-03	2.05E-02	4.92E-04	0.00E+00	2.41E-04	4.14E-03
Child	1.69E-04	3.00E-04	3.69E-03	2.72E-02	4.61E-04	0.00E+00	1.63E-04	4.14E-03
Infant	1.23E-04	2.43E-04	3.64E-03	2.22E-02	2.70E-04	0.00E+00	6.06E-05	4.14E-03

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Cs-134

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	6.68E+00	1.59E+01	2.26E+01	0.00E+00	5.15E+00	1.71E+00	2.78E-01	1.12E+01
Teen	1.06E+01	2.49E+01	2.12E+01	0.00E+00	7.90E+00	3.02E+00	3.09E-01	1.12E+01
Child	2.39E+01	3.93E+01	1.79E+01	0.00E+00	1.22E+01	4.37E+00	2.12E-01	1.12E+01
Infant	1.96E+01	3.66E+01	1.33E+01	0.00E+00	9.42E+00	3.86E+00	9.94E-02	1.12E+01

Dose factor - airborne release pathway (mrem/Ci released)

Cs-134m

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	8.36E-04	1.76E-03	9.41E-04	0.00E+00	9.54E-04	1.50E-04	6.19E-04	6.90E-05
Teen	1.40E-03	2.89E-03	1.53E-03	0.00E+00	1.61E-03	2.83E-04	1.92E-03	6.90E-05
Child	3.30E-03	4.89E-03	3.24E-03	0.00E+00	2.58E-03	4.27E-04	6.18E-03	6.90E-05
Infant	5.48E-06	8.72E-06	4.70E-05	0.00E+00	3.53E-06	8.31E-07	4.82E-06	6.90E-05

Dose factor - airborne release pathway (mrem/Ci released)

Cs-136

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.31E-01	1.31E+00	1.28E+00	0.00E+00	7.27E-01	9.97E-02	1.48E-01	4.73E-01
Teen	5.12E-01	2.02E+00	1.70E+00	0.00E+00	1.10E+00	1.73E-01	1.62E-01	4.73E-01
Child	1.14E+00	3.14E+00	2.38E+00	0.00E+00	1.67E+00	2.49E-01	1.10E-01	4.73E-01
Infant	3.54E-01	1.04E+00	7.33E-01	0.00E+00	4.15E-01	8.48E-02	1.58E-02	4.73E-01

Dose factor - airborne release pathway (mrem/Ci released)

Cs-137

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	9.52E+00	1.30E+01	2.30E+01	0.00E+00	4.42E+00	1.47E+00	2.52E-01	1.69E+01
Teen	1.57E+01	2.09E+01	2.18E+01	0.00E+00	7.12E+00	2.77E+00	2.97E-01	1.69E+01
Child	3.73E+01	3.57E+01	1.97E+01	0.00E+00	1.16E+01	4.18E+00	2.23E-01	1.69E+01
Infant	2.99E+01	3.49E+01	1.70E+01	0.00E+00	9.38E+00	3.80E+00	1.09E-01	1.69E+01

Dose factor - airborne release pathway (mrem/Ci released)

Cs-138

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	2.17E-03	4.28E-03	2.70E-03	0.00E+00	3.14E-03	3.10E-04	1.82E-08	4.39E-03
Teen	3.69E-03	7.08E-03	4.13E-03	0.00E+00	5.23E-03	6.08E-04	3.21E-06	4.39E-03
Child	8.93E-03	1.24E-02	8.46E-03	0.00E+00	8.73E-03	9.40E-04	5.71E-03	4.39E-03
Infant	1.50E-05	2.32E-05	5.97E-04	0.00E+00	1.22E-05	1.94E-06	2.60E-05	4.39E-03

Dose factor - airborne release pathway (mrem/Ci released)

Ba-139

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.78E-03	2.69E-06	1.38E-04	0.00E+00	2.52E-06	4.62E-05	6.71E-03	6.76E-03
Teen	6.56E-03	4.61E-06	2.18E-04	0.00E+00	4.35E-06	8.00E-05	5.86E-02	6.76E-03
Child	1.61E-02	8.60E-06	4.95E-04	0.00E+00	7.51E-06	7.37E-05	9.31E-01	6.76E-03
Infant	1.76E-08	1.17E-11	2.75E-05	0.00E+00	7.04E-12	7.07E-05	6.06E-04	6.76E-03

Dose factor - airborne release pathway (mrem/Ci released)

Ba-140

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.09E-01	1.37E-04	3.60E-02	0.00E+00	4.67E-05	3.78E-02	2.29E-01	3.29E-02
Teen	1.19E-01	1.46E-04	3.65E-02	0.00E+00	4.94E-05	6.04E-02	1.88E-01	3.29E-02
Child	2.39E-01	2.10E-04	4.28E-02	0.00E+00	6.83E-05	5.18E-02	1.23E-01	3.29E-02
Infant	4.46E-02	4.46E-05	3.11E-02	0.00E+00	1.06E-05	4.74E-02	1.17E-02	3.29E-02

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Ba-141

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.83E-03	1.39E-06	2.01E-04	0.00E+00	1.29E-06	2.38E-05	8.66E-13	1.55E-03
Teen	3.16E-03	2.36E-06	2.45E-04	0.00E+00	2.19E-06	4.07E-05	6.75E-09	1.55E-03
Child	7.79E-03	4.36E-06	3.92E-04	0.00E+00	3.77E-06	6.03E-05	4.44E-03	1.55E-03
Infant	1.86E-09	1.28E-12	1.39E-04	0.00E+00	7.72E-13	3.53E-05	5.64E-05	1.55E-03

Dose factor - airborne release pathway (mrem/Ci released)

La-140

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.17E-05	5.91E-06	2.70E-02	0.00E+00	0.00E+00	4.04E-03	6.96E-02	3.06E-02
Teen	1.57E-05	7.71E-06	2.70E-02	0.00E+00	0.00E+00	6.36E-03	5.51E-02	3.06E-02
Child	2.18E-05	7.60E-06	2.70E-02	0.00E+00	0.00E+00	5.42E-03	3.26E-02	3.06E-02
Infant	1.56E-05	6.17E-06	2.70E-02	0.00E+00	0.00E+00	4.98E-03	5.27E-03	3.06E-02

Dose factor - airborne release pathway (mrem/Ci released)

La-142

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.98E-06	2.27E-06	1.97E-03	0.00E+00	0.00E+00	7.52E-05	1.65E-02	9.71E-03
Teen	8.44E-06	3.75E-06	1.97E-03	0.00E+00	0.00E+00	1.21E-04	1.14E-01	9.71E-03
Child	2.04E-05	6.50E-06	1.97E-03	0.00E+00	0.00E+00	1.03E-04	1.29E+00	9.71E-03
Infant	1.22E-08	4.48E-09	1.97E-03	0.00E+00	0.00E+00	9.77E-05	7.07E-04	9.71E-03

Dose factor - airborne release pathway (mrem/Ci released)

Ce-141

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	7.38E-04	5.01E-04	1.93E-02	0.00E+00	2.32E-04	1.07E-02	3.84E-01	2.16E-02
Teen	1.05E-03	7.02E-04	1.93E-02	0.00E+00	3.29E-04	1.82E-02	4.02E-01	2.16E-02
Child	1.65E-03	8.20E-04	1.93E-02	0.00E+00	3.59E-04	1.61E-02	3.02E-01	2.16E-02
Infant	8.32E-04	5.00E-04	1.92E-02	0.00E+00	1.58E-04	1.53E-02	3.79E-03	2.16E-02

Dose factor - airborne release pathway (mrem/Ci released)

Ce-143

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	6.71E-05	4.80E-02	4.80E-03	0.00E+00	2.18E-05	9.48E-04	1.80E+00	6.60E-02
Teen	1.15E-04	8.10E-02	4.81E-03	0.00E+00	3.74E-05	1.55E-03	2.44E+00	6.60E-02
Child	2.77E-04	1.48E-01	4.82E-03	0.00E+00	6.31E-05	1.37E-03	2.17E+00	6.60E-02
Infant	3.55E-06	5.06E-05	4.80E-03	0.00E+00	6.85E-07	1.38E-03	8.73E-04	6.60E-02

Dose factor - airborne release pathway (mrem/Ci released)

Ce-144

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.26E-01	5.24E-02	1.04E-01	0.00E+00	3.10E-02	2.31E-01	8.05E+00	1.13E-01
Teen	1.83E-01	7.56E-02	1.07E-01	0.00E+00	4.51E-02	3.96E-01	9.46E+00	1.13E-01
Child	2.91E-01	9.10E-02	1.13E-01	0.00E+00	5.04E-02	3.55E-01	7.37E+00	1.13E-01
Infant	9.58E-02	3.64E-02	1.03E-01	0.00E+00	1.61E-02	2.92E-01	6.97E-02	1.13E-01

Dose factor - airborne release pathway (mrem/Ci released)

Pr-143

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	5.11E-04	2.05E-04	2.53E-05	0.00E+00	1.18E-04	3.34E-03	1.75E+00	3.77E-01
Teen	8.14E-04	3.25E-04	4.05E-05	0.00E+00	1.89E-04	5.74E-03	2.16E+00	3.77E-01
Child	1.82E-03	5.46E-04	9.02E-05	0.00E+00	2.96E-04	5.15E-03	1.73E+00	3.77E-01
Infant	1.67E-04	6.23E-05	8.32E-06	0.00E+00	2.35E-05	5.14E-03	5.83E-04	3.77E-01

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Pr-144

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	8.93E-10	3.70E-10	2.58E-06	0.00E+00	2.09E-10	3.01E-05	6.39E-16	2.91E-06
Teen	1.27E-09	5.22E-10	2.58E-06	0.00E+00	2.99E-10	5.20E-05	6.98E-12	2.91E-06
Child	1.77E-09	5.48E-10	2.58E-06	0.00E+00	2.90E-10	4.64E-05	5.84E-06	2.96E-06
Infant	1.42E-09	5.48E-10	2.58E-06	0.00E+00	1.99E-10	4.78E-05	1.27E-04	2.96E-06

Dose factor - airborne release pathway (mrem/Ci released)

Nd-147

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	8.95E-05	1.03E-04	2.00E-02	0.00E+00	6.04E-05	2.62E-03	1.51E-01	2.00E-01
Teen	1.22E-04	1.33E-04	2.00E-02	0.00E+00	7.80E-05	4.42E-03	1.15E-01	2.00E-01
Child	1.85E-04	1.49E-04	2.00E-02	0.00E+00	8.22E-05	3.90E-03	7.33E-02	2.00E-01
Infant	9.45E-05	9.69E-05	2.00E-02	0.00E+00	3.75E-05	3.83E-03	4.73E-04	2.00E-01

Dose factor - airborne release pathway (mrem/Ci released)

Eu-152

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.32E-02	2.45E-01	3.62E+01	0.00E+00	4.67E-02	3.26E-02	1.38E+00	6.86E+01
Teen	4.20E-02	1.02E-02	3.62E+01	0.00E+00	4.73E-02	4.76E-02	1.23E+00	6.86E+01
Child	6.02E-02	1.10E-02	3.62E+01	0.00E+00	4.64E-02	3.96E-02	8.25E-01	6.86E+01
Infant	1.30E-02	2.95E-03	3.62E+01	0.00E+00	9.90E-03	2.46E-02	5.31E-04	6.86E+01

Dose factor - airborne release pathway (mrem/Ci released)

W-187

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.08E-03	3.41E-03	7.22E-03	0.00E+00	0.00E+00	3.45E-04	1.12E+00	2.79E-02
Teen	6.98E-03	5.69E-03	8.03E-03	0.00E+00	0.00E+00	5.63E-04	1.54E+00	2.79E-02
Child	1.69E-02	1.00E-02	1.05E-02	0.00E+00	0.00E+00	4.88E-04	1.41E+00	2.79E-02
Infant	1.13E-05	7.88E-06	6.04E-03	0.00E+00	0.00E+00	4.71E-04	8.79E-04	2.79E-02

Dose factor - airborne release pathway (mrem/Ci released)

U-235

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	4.06E+01	0.00E+00	1.04E+01	0.00E+00	9.47E+00	4.66E+00	3.87E+00	1.06E+01
Teen	6.45E+01	0.00E+00	1.19E+01	0.00E+00	1.51E+01	8.03E+00	4.59E+00	1.06E+01
Child	1.54E+02	0.00E+00	1.73E+01	0.00E+00	2.53E+01	7.17E+00	3.58E+00	1.06E+01
Infant	1.17E+01	0.00E+00	8.84E+00	0.00E+00	2.49E+00	5.46E+00	1.90E-01	1.06E+01

Dose factor - airborne release pathway (mrem/Ci released)

U-238

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	3.88E+01	0.00E+00	2.33E+00	0.00E+00	8.86E+00	4.36E+00	2.72E+00	2.47E-01
Teen	6.17E+01	0.00E+00	3.70E+00	0.00E+00	1.41E+01	7.50E+00	3.23E+00	2.47E-01
Child	1.48E+02	0.00E+00	8.79E+00	0.00E+00	2.37E+01	6.73E+00	2.53E+00	2.47E-01
Infant	1.12E+01	0.00E+00	8.63E-01	0.00E+00	2.33E+00	5.09E+00	1.34E-01	2.47E-01

Dose factor - airborne release pathway (mrem/Ci released)

Np-239

	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	5.00E-05	4.92E-06	5.54E-03	0.00E+00	1.53E-05	4.47E-04	9.55E-01	9.52E-03
Teen	8.79E-05	8.29E-06	5.55E-03	0.00E+00	2.60E-05	7.71E-04	1.27E+00	9.52E-03
Child	2.11E-04	1.52E-05	5.55E-03	0.00E+00	4.39E-05	6.91E-04	1.10E+00	9.52E-03
Infant	4.42E-06	3.95E-07	5.54E-03	0.00E+00	7.88E-07	7.07E-04	3.14E-04	9.52E-03

Table 5.1-2 (continued)

Dose factor - airborne release pathway (mrem/Ci released)

Am-241	Bone	Liver	T. Body	Thyroid	Kidney	Lungs	GI-LLI	Skin
Adult	1.34E+02	4.76E+01	1.03E+01	0.00E+00	6.70E+01	5.76E+00	3.48E+00	2.94E+00
Teen	1.46E+02	5.59E+01	1.11E+01	0.00E+00	7.31E+01	9.99E+00	4.12E+00	2.94E+00
Child	1.37E+02	6.14E+01	1.11E+01	0.00E+00	5.98E+01	8.88E+00	3.22E+00	2.94E+00
Infant	3.07E+01	1.41E+01	3.56E+00	0.00E+00	1.32E+01	6.76E+00	2.58E+03	2.94E+00

5.1.3 Atmospheric Release Mode: Noble Gases

The dose calculations for demonstration of compliance with the 10 CFR 50, Appendix I dose limits for noble gases released to the atmosphere will be done in the manner similar to the liquid release dose calculations described in Section 5.1.1. The total doses to the air, skin, and whole body resulting from the release of noble gases is compared to the corresponding Appendix limits. Noble gases released in liquids are to be added to the atmospherically released noble gases for Appendix I dose compliance calculations.

The doses are calculated using the following formula:

$$API = \sum Dose_{ti} = \sum (TDF_{ti} \times C_i) \leq K_t \text{ mrem}$$

where

API = the Appendix I dose for compliance evaluation in mrem

$Dose_{ti}$ = the dose to the applicable target (t) from radionuclide (i)

TDF_{ti} = total dose factor from Table 5.1-3 in mrem/Ci for the specific target (t) from radionuclide (i) based on the maximum annual average χ/Q at the site boundary

C_i = curies of radionuclide (i) released

K_t = the noble gas Appendix I dose limit for target (t)

The methodology used to obtain the TDF values are given in Appendix C.

Instead of using the precalculated total dose factors, the Appendix I dose calculation may be modified to reflect actual χ/Q values during the release using the methodology of Appendix C.

Table 5.1-3

Activity to Dose Conversion Factors for Noble Gases
(Highest Annual Average λ/Q)

<u>Nuclide</u>	<u>Beta Air</u> <u>(mrad/Ci)</u>	<u>Gamma Air</u> <u>(mrad/Ci)</u>	<u>Skin</u> <u>(mrem/Ci)</u>	<u>Whole Body</u> <u>(mrem/Ci)</u>
AR-41	1.56E-04	4.42E-04	2.94E-04	4.72E-04
KR-83M	1.37E-05	9.18E-07	2.52E-09	7.13E-07
KR-85M	9.37E-05	5.85E-05	3.89E-05	1.15E-04
KR-85	9.27E-05	8.18E-07	5.36E-07	6.44E-05
KR-87	4.90E-04	2.93E-04	1.97E-04	6.91E-04
KR-88	1.39E-04	7.23E-04	4.89E-04	6.74E-04
KR-89	5.04E-04	8.23E-04	5.53E-04	1.12E-03
KR-90	3.72E-04	7.75E-04	5.19E-04	9.49E-04
XE-131M	5.28E-05	7.42E-06	3.05E-06	2.84E-05
XE-133M	7.04E-05	1.55E-05	8.35E-06	5.93E-05
XE-133	4.99E-05	1.68E-05	9.79E-06	2.76E-05
XE-135M	3.51E-05	1.60E-04	1.04E-04	1.58E-04
XE-135	1.17E-04	9.13E-05	6.02E-05	1.59E-04
XE-137	6.04E-04	7.18E-05	4.73E-05	6.36E-04
XE-138	2.26E-04	4.38E-04	2.94E-04	5.37E-04

6.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

Requirements for the PBNP environmental monitoring program are detailed in Technical Specification 15.7.7. A complete description of the PBNP radiological environmental monitoring program, including procedures and responsibilities, is contained in the PBNP Environmental Manual. The latter is hereby incorporated into the Offsite Dose Calculation Manual (ODCM) by reference.

7.0 RADIOLOGICAL IMPACT EVALUATION OF SEWAGE TREATMENT SLUDGE DISPOSAL

The methodology for determining the radiological impact of sewage treatment sludge disposal is presented in this section. The radiological impact evaluation must be performed for each sewage treatment sludge disposal prior to land application.

7.1 Basis

Wisconsin Electric's commitment with the United States Nuclear Regulatory Commission in a letter dated October 8, 1987 (VPNPD-87-430, NRC-87-104) requires Wisconsin Electric to measure the concentrations of radionuclides in the sewage treatment sludge and compare them to concentration limits prior to disposal. In addition, the appropriate exposure pathways will be evaluated prior to each application of sludge to insure that the dose to the maximally exposed member of the general public is maintained less than 1 mrem/year and the dose to the inadvertent intruder is maintained less than 5 mrem/year.

The exposure pathways evaluated for the maximally exposed individual are the following:

1. External whole body exposure due to a ground plane source of radionuclides.
2. Milk ingestion pathway from cows fed alfalfa grown on plot.
3. Meat ingestion pathway from cows fed alfalfa grown on plot.
4. Vegetable ingestion pathway from vegetables grown on plot.
5. Inhalation of radioactivity resuspended in air above plot.
6. Pathways associated with a release to Lake Michigan. These pathways are ingestion of potable water at the Two Rivers, Wisconsin municipal water supply, ingestion of fish from edge of initial mixing zone of radionuclide release, ingestion of fresh and stored vegetables irrigated with water from Lake Michigan, ingestion of milk and meat from cows utilizing Lake Michigan as drinking water source, swimming and boating activities at the edge of the initial mixing zone, and shoreline deposits.

The exposure pathways evaluated for the inadvertent intruder are the same as items 1, 4, 5, and 6 identified above for the maximally exposed individual.

7.2 Procedure

The following steps are to be performed by the Responsible Engineer - IRSS for each sewage treatment sludge disposal:

- 7.2.1 Obtain from PBNP - Chemistry the radionuclide concentrations in each representative sewage treatment sludge sample. The minimum number of representative samples required is three from each sludge storage tank. The average of all statistically valid concentration determinations will be utilized in determining the sludge storage tank concentration values.

7.2.2 Verify that the concentration of each radionuclide meets the concentration and activity limit criteria. The methodology for determining compliance with the concentration and activity limit criteria are contained in Appendix E.

7.2.3 Verify that the proposed disposal of the sewage treatment sludge will maintain doses within the applicable limits. This calculation will include radionuclides disposed of in previous sludge applications. The activity from these prior disposals will be corrected for radiological decay prior to performing dose calculations for the meat, milk, and vegetable ingestion pathways, the inhalation of resuspended radionuclides, and all pathways associated with a potential release to Lake Michigan. The residual radioactivity will be corrected, if applicable, for the mixing of radionuclides in the soil prior to performing external exposure calculations.

Wisconsin Electric utilizes QAD, a nationally recognized computer code, to perform shielding and dose rate analyses. QAD will be used to calculate the dose rate due to standing on a plot of land utilized for sludge disposal in which the radionuclides from prior disposals have been incorporated into the plot by plowing. This calculated dose rate will be used to assess the radiological consequences from prior disposals with the consequences of proposed future disposals. The total radiological dose consequence of the past and the proposed disposal will be compared to the applicable limits to insure the dose is maintained at or below the limits.

The methodology for calculating the radiological impact of the sewage treatment sludge disposal is contained in Appendix E.

7.2.4 Inform PBNP - Chemistry that the sewage treatment sludge disposal may proceed after verifying that the sewage treatment sludge meets the concentration, activity, and dose limits.

7.2.5 Forward all calculations to PBNP - Chemistry to be included with the sewage treatment sludge disposal record.

APPENDIX A

DERIVATION OF LIQUID RELEASE PATHWAY
EFFECTIVE MAXIMUM EFFLUENT CONCENTRATION

A1.0 DERIVATION OF LIQUID RELEASE EFFECTIVE MAXIMUM EFFLUENT CONCENTRATIONA1.1 Source Term

The effective maximum effluent concentration is calculated from the annual releases via liquids for the years 1985 - 1991 (Table A-1). Although Na-24 was discharged in 1985, it was excluded from the isotopic mixture because it is not a radionuclide which would be normally found in PBNP effluent. Na-24 appears in the effluent because it was used for tests run on the steam system. Tritium also was omitted from the initial calculation because its production is largely independent from the appearance of the fission products in the effluent.

A1.2 Effective Maximum Effluent Concentration

The effective maximum effluent concentration (EMEC) was calculated using the formula given in Section 3.6

$$\text{EMEC} = \text{IC}_i / \sum (\text{C}_i / \text{MEC}_i) \text{ or } \text{IC}_i * 1/\text{SOF}$$

where:

$\text{SOF} = \sum \text{C}_i / \text{MEC}_i$ is the summation of fractions for the annual effluent isotopic release

C_i = concentration of radionuclide "i" ($\mu\text{Ci}/\text{ml}$) in effluent (annual discharge/total volume of discharge)

MEC_i = maximum effluent concentration for unrestricted areas from Appendix B, Table 2, Column 2 of the revised 10 CFR 20.

The SOF for radionuclides in liquid effluent for the years 1985 through 1991 were calculated with and without H-3 and used to calculate the EMEC for the same years (Table B-2). The average EMEC without H-3 is $4.29\text{E-}06 \mu\text{Ci}/\text{cc}$. This is the maximum concentration of non H-3 radionuclides in a mixture that could be released in liquid effluent without the SOF exceeding one (1).

However, the 10 CFR 20 Appendix B criterion is that the SOF for all radionuclides, including H-3 which can not be measured by the liquid effluent NaI RMS monitors, be less than or equal to one (1). Therefore, the above equation, modified by a factor of 0.70 to account for H-3, becomes

$$\text{EMEC} = 0.70 \text{ IC}_i / \sum (\text{C}_i / \text{MEC}_i) \text{ or } \text{IC}_i * 0.70/\text{SOF}.$$

The EMEC becomes

$$\text{EMEC} = 0.70 * 4.29\text{E-}06 = 3.00\text{E-}06 \mu\text{Ci}/\text{cc}.$$

Only three radionuclides identified in PBNP liquid effluent have a lower MEC (10 CFR 20, Appendix B, Table 2). They are I-131 ($1\text{E-}06$), Cs-134 ($9\text{E-}07$), and Cs-137 ($1\text{E-}06$).

By restricting the non-tritium radionuclides to 70% of their calculated EMEC, the H-3 concentration can be discharged at 30% of its MEC or $3.00\text{E-}04 \mu\text{Ci}/\text{cc}$ without exceeding the SOF criterion of 10 CFR 20, Appendix B for the total liquid effluent isotopic mixture.

TABLE A-1
CURIES RELEASED IN LIQUIDS

LIQUID RELEASES NUCLIDE	MEC uCi/cc	1985	1986	1987	1988	1989	1990	1991
H-3	1.00E-03	8.05E+02	8.11E+02	7.09E+02	3.57E+02	5.59E+02	8.72E+02	7.87E+02
I-131	1.00E-06	1.02E-01	3.74E-02	1.04E-02	1.40E-03	1.77E-03	1.53E-04	1.83E-03
I-132	1.00E-04	6.15E-02	7.25E-02	5.82E-02	1.03E-03	8.15E-04	4.45E-05	9.41E-03
I-133	7.00E-06	1.27E-01	1.49E-01	1.04E-01	1.21E-02	8.11E-03	3.01E-03	1.01E-02
I-134	4.00E-04	3.18E-02	4.39E-02	3.97E-02	2.29E-04			6.83E-04
I-135	3.00E-05	1.04E-01	1.34E-01	1.23E-01	4.48E-04			8.21E-04
AG-110M	6.00E-06	2.55E-05	2.84E-04	3.09E-03	9.85E-04	4.70E-04	1.71E-04	4.06E-04
BA-133	2.00E-05							
BA-139	2.00E-04			8.63E-06	2.47E-04			
BA-140	8.00E-06	6.90E-06		4.45E-05	6.13E-05			
CD-109	6.00E-06		6.33E-05		1.31E-04			
CE-139	7.00E-05							
CE-141	3.00E-05	1.31E-03		7.50E-04				
CE-144	3.00E-06		1.37E-03	2.08E-03	4.76E-04	1.59E-04	9.47E-06	9.64E-06
CO-56	6.00E-06							
CO-57	6.00E-05	2.52E-03	1.33E-04	3.21E-04	5.07E-05	6.90E-07	4.08E-06	
CO-58	2.00E-05	4.05E-01	9.02E-03	3.36E-02	6.81E-03	3.12E-03	3.25E-04	2.93E-03
CO-60	3.00E-06	2.88E-01	2.85E-02	6.34E-02	2.04E-02	1.54E-02	1.41E-03	5.53E-03
CR-51	5.00E-04	2.71E-02	3.16E-04	1.58E-02	5.31E-05	4.44E-04	8.71E-05	
CS-134	9.00E-07	4.76E-02	6.92E-03	1.18E-03	4.96E-04			1.49E-03
CS-134M	2.00E-03				3.59E-04	5.97E-06		4.67E-04
CS-136	6.00E-06							
CS-137	1.00E-06	9.60E-02	2.11E-02	7.54E-03	8.63E-03	2.80E-03	1.94E-03	8.93E-03
CS-138	4.00E-04	1.11E-03	5.48E-03	3.24E-03				
F-18	7.00E-04		1.00E-02	1.67E-02	7.56E-04	1.66E-03	2.26E-03	4.06E-04
FE-59	1.00E-05			2.76E-04				
LA-140	9.00E-06							
MN-54	3.00E-05	7.46E-03	1.18E-03	4.68E-03	1.54E-04	2.68E-04	3.10E-05	1.96E-04
MO-99	2.00E-05				3.70E-05			
NB-95	3.00E-05	6.28E-03	6.65E-04	3.21E-03	1.61E-04	2.33E-06	8.68E-05	
NB-97	3.00E-04	1.35E-03	5.22E-04	6.16E-05	1.06E-05	3.90E-06	8.80E-06	5.30E-06
RB-88	4.00E-04	8.46E-05	1.11E-02	3.33E-03				
RB-89	9.00E-04		7.98E-04	2.34E-04				
RU-103	3.00E-05	3.59E-03	1.68E-06	8.41E-04	5.86E-05			
RU-106	3.00E-06	8.07E-04	2.88E-03	7.33E-03	1.04E-04			
SB-124	7.00E-06	3.86E-02	2.96E-04	1.42E-04	2.34E-04			
SB-125	3.00E-05	1.12E-02	1.20E-03	1.95E-03	1.00E-03	2.12E-02	1.28E-05	1.08E-02
SN-113	3.00E-05	1.07E-03	4.20E-05	5.13E-04	3.21E-04			3.07E-06
SR-89	8.00E-06	2.27E-04	3.46E-05	3.89E-03	2.68E-03	8.69E-06		
SR-90	5.00E-07	1.29E-03	2.28E-04	2.80E-04	3.50E-04	2.55E-04		
TC-99M	1.00E-03	1.75E-05	3.75E-06		3.30E-05			
TC-101	2.00E-03			1.10E-05				
TE-131	8.00E-05				7.98E-05			
TE-132	9.00E-06	5.83E-07	6.94E-05	2.74E-05	7.19E-06			1.74E-04
W-187	3.00E-05				3.41E-05			
Y-91M	2.00E-03							
ZN-65	5.00E-06			5.15E-05				
ZR-95	2.00E-05	7.95E-05	2.61E-04	2.45E-03			1.58E-05	
ZR-97	9.00E-06	1.49E-06	3.09E-06		1.74E-05			
TOTAL CI		8.06E+02	8.12E+02	7.10E+02	3.57E+02	5.59E+02	8.72E+02	7.87E+02
TOTAL W/O H-3		1.37E+00	5.39E-01	5.12E-01	5.99E-02	5.65E-02	9.57E-03	5.42E-02

TABLE A-2
FRACTIONAL MEC IN LIQUID EFFLUENT

NUCLIDE	MEC uCi/cc	1985	1986	1987	1988	1989	1990	1991
H-3	1.00E-03	1.27E-03	1.25E-03	1.04E-03	5.17E-04	8.36E-04	1.26E-03	1.22E-03
I-131	1.00E-06	1.61E-04	5.75E-05	1.52E-05	2.03E-06	2.65E-06	2.21E-07	2.84E-06
I-132	1.00E-04	9.70E-07	1.12E-06	8.53E-07	1.49E-08	1.22E-08	6.43E-10	1.46E-07
I-133	7.00E-06	2.86E-05	3.27E-05	2.18E-05	2.51E-06	1.73E-06	6.21E-07	2.24E-06
I-134	4.00E-04	1.25E-07	1.69E-07	1.46E-07	8.30E-10			2.65E-09
I-135	3.00E-05	5.47E-06	6.87E-06	6.01E-06	2.16E-08			4.24E-08
AG-110M	6.00E-06	6.70E-09	7.28E-08	7.55E-07	2.38E-07	1.17E-07	4.12E-08	1.05E-07
BA-133	2.00E-05							
BA-139	2.00E-04			6.33E-11	1.79E-09			
BA-140	8.00E-06	1.36E-09	0.00E+00	8.16E-09	1.11E-08			
CD-109	6.00E-06		1.62E-08		3.16E-08			
CE-139	7.00E-05							
CE-141	3.00E-05	6.89E-08		3.67E-08				
CE-144	3.00E-06		7.03E-07	1.02E-06	2.30E-07	7.92E-08	4.56E-09	4.98E-09
CO-56	6.00E-06							
CO-57	6.00E-05	6.62E-08	3.41E-09	7.84E-09	1.22E-09	1.72E-11	9.83E-11	
CO-58	2.00E-05	3.19E-05	6.94E-07	2.46E-06	4.93E-07	2.33E-07	2.35E-08	2.27E-07
CO-60	3.00E-06	1.51E-04	1.46E-05	3.10E-05	9.86E-06	7.67E-06	6.79E-07	2.86E-06
CR-51	5.00E-04	8.55E-08	9.72E-10	4.63E-08	1.54E-10	1.33E-09	2.52E-10	
CS-134	9.00E-07	8.34E-05	1.18E-05	1.92E-06	7.99E-07			2.57E-06
CS-134M	2.00E-03				2.60E-10	4.46E-12		3.62E-10
CS-136	6.00E-06							
CS-137	1.00E-06	1.51E-04	3.25E-05	1.11E-05	1.25E-05	4.19E-06	2.80E-06	1.38E-05
CS-138	4.00E-04	4.38E-09	2.11E-08	1.19E-08				
F-18	7.00E-04		2.20E-08	3.50E-08	1.57E-09	3.54E-09	4.67E-09	8.99E-10
FE-59	1.00E-05			4.05E-08				
LA-140	9.00E-06							
MN-54	3.00E-05	3.92E-07	6.05E-08	2.29E-07	7.44E-09	1.34E-08	1.49E-09	1.01E-08
MO-99	2.00E-05				2.68E-09			
NB-95	3.00E-05	3.30E-07	3.41E-08	1.57E-07	7.78E-09	1.16E-10	4.18E-09	
NB-97	3.00E-04	7.10E-09	2.68E-09	3.01E-10	5.12E-11	1.94E-11	4.24E-11	2.74E-11
RB-88	4.00E-04	3.34E-10	4.27E-08	1.22E-08				
RB-89	9.00E-04		1.36E-09	3.81E-10				
RU-103	3.00E-05	1.89E-07	8.62E-11	4.11E-08	2.83E-09			
RU-106	3.00E-06	4.24E-07	1.48E-06	3.58E-06	5.02E-08			
SB-124	7.00E-06	8.70E-06	6.51E-08	2.97E-08	4.84E-08			
SB-125	3.00E-05	5.89E-07	6.15E-08	9.53E-08	4.83E-08	1.06E-06	6.17E-10	5.58E-07
SN-113	3.00E-05	5.63E-08	2.15E-09	2.51E-08	1.55E-08			1.59E-10
SR-89	8.00E-06	4.48E-08	6.65E-09	7.13E-07	4.86E-07	1.62E-09		
SR-90	5.00E-07	4.07E-06	7.02E-07	8.21E-07	1.01E-06	7.62E-07		
TC-99M	1.00E-03	2.76E-11	5.77E-12		4.78E-11			
TC-101	2.00E-03			8.06E-12				
TE-131	8.00E-05				1.45E-09			
TE-132	9.00E-06	1.02E-10	1.19E-08	4.46E-09	1.16E-09			3.00E-08
W-187	3.00E-05				1.65E-09			
Y-91M	2.00E-03							
ZN-65	5.00E-06			1.51E-08				
ZR-95	2.00E-05	6.27E-09	2.01E-08	1.80E-07			1.14E-09	
ZR-97	9.00E-06	2.61E-10	5.28E-10		2.80E-09			
ANNUAL VOL(CC's)		6.34E+14	6.50E+14	6.82E+14	6.90E+14	6.69E+14	6.92E+14	6.45E+14
TOT FRACTION		1.90E-03	1.41E-03	1.14E-03	5.48E-04	8.54E-04	1.26E-03	1.25E-03
FRACT W/O H-3		6.29E-04	1.61E-04	9.83E-05	3.04E-05	1.85E-05	4.41E-06	2.55E-05
TOTAL CI		8.06E+02	8.12E+02	7.10E+02	3.57E+02	5.59E+02	8.72E+02	7.87E+02
TOTAL W/O H-3		1.37E+00	5.39E-01	5.12E-01	5.99E-02	5.65E-02	9.57E-03	5.42E-02
TOT CONC(uCi/CC)		1.27E-06	1.25E-06	1.04E-06	5.17E-07	8.36E-07	1.26E-06	1.22E-06
TCO W/O H-3		2.16E-09	8.30E-10	7.51E-10	8.69E-11	8.44E-11	1.38E-11	8.40E-11
EMEC		6.70E-04	8.86E-04	9.14E-04	9.45E-04	9.78E-04	9.97E-04	9.80E-04
EMEC W/O H-3		3.43E-06	5.14E-06	7.64E-06	2.85E-06	4.56E-06	3.14E-06	3.30E-06

APPENDIX B

DERIVATION OF ATMOSPHERIC RELEASE MODE
EFFECTIVE MAXIMUM EFFLUENT CONCENTRATION

B1.0 DERIVATION OF ATMOSPHERIC RELEASE EFFECTIVE MAXIMUM EFFLUENT CONCENTRATIONB1.1 Source Term

The effective maximum effluent concentration (EMEC) for atmospheric effluents is calculated from the annual releases for the years 1985 - 1991 (Table B-1). Unlike liquid releases, tritium was not omitted from the EMEC calculation. Instead, the EMEC was calculated with H-3 and then modified by the fraction of non-tritium radionuclides in the effluent.

B1.2 Effective Maximum Effluent Concentration

The maximum concentration of a radionuclide mixture that is allowable at the site boundary is called the effective maximum effluent concentration (EMEC). The EMEC for an effluent mixture is defined by the equation

$$\text{EMEC} = \sum C_i / \sum (C_i / \text{MEC}_i)$$

where

C_i = concentration of radionuclide "i"

MEC_i = maximum effluent concentration for radionuclide "i" from 10 CFR 20, Appendix B, Table 2, Column 1

$\sum (C_i / \text{MEC}_i)$ = summation of fractions (SOF), as discussed in Section 3.6, applied to atmospheric releases

The EMEC is calculated from the reference radionuclide mixture which is the radionuclides released during the years 1985 - 1991. The average annual site boundary concentration for each year was calculated using the highest annual average χ/Q of $1.56\text{E-}06$ sec/m^3 . Then the total EMEC was calculated for each year (Table C-2). The average total EMEC is $8.04\text{E-}08 \pm 1.31\text{E-}08$ $\mu\text{Ci/cc}$ with a range of $5.84\text{E-}08$ to $9.50\text{E-}08$ $\mu\text{Ci/cc}$. Next, the annual EMEC was modified for the presence of H-3, which is not detected by the atmospheric RMS, by multiplying each EMEC by the ratio of the non H-3 concentration to the total concentration. The annual H-3 corrected EMECs were averaged to obtain a value of $1.92\text{E-}08 \pm 1.23\text{E-}08$ $\mu\text{Ci/cc}$ with a range of $5.02\text{E-}09$ to $3.70\text{E-}08$ $\mu\text{Ci/cc}$.

TABLE B-1
CURIES IN ATMOSPHERIC EFFLUENT

NUCLIDE	MEC μCi/ml	1985	1986	1987	1988	1989	1990	1991
H-3	1.00E-07	6.71E+01	1.20E+02	1.18E+02	1.26E+02	1.42E+02	1.28E+02	1.13E+02
AR-41	1.00E-08	1.27E+00	6.81E-01	2.17E+00	1.96E+00	1.57E+00	1.11E+00	1.07E+00
KR-85M	1.00E-07	1.84E+01	6.77E-01	1.18E+00	7.31E-01	2.24E-01	1.85E-01	1.03E-01
KR-85	7.00E-07	1.67E+01	1.32E+00	7.11E-01	9.84E-01	3.58E-01	1.78E-01	2.74E-01
KR-87	2.00E-08	4.78E+00	1.01E+00	2.37E+00	1.48E+00	4.94E-01	4.05E-01	2.31E-01
KR-88	9.00E-09	5.73E+00	1.30E+00	2.72E+00	1.69E+00	5.64E-01	4.49E-01	2.56E-01
XE-131M	2.00E-06	8.54E-02						
XE-133M	6.00E-07	3.30E-01	1.38E-01	2.12E-01	3.35E-01	4.94E-03	2.06E-02	3.97E-02
XE-133	5.00E-07	3.45E+01	1.53E+01	2.06E+01	6.04E+01	7.54E+00	1.96E+00	1.60E+01
XE-135M	4.00E-08	5.76E+00	1.27E+00	3.68E+00	2.54E+00	7.37E-01	6.49E-01	3.44E-01
XE-135	7.00E-08	1.19E+01	3.21E+00	5.64E+00	3.53E+00	1.08E+00	1.09E+00	6.03E-01
XE-138	2.00E-08	1.65E+01	2.91E+00	8.87E+00	7.19E+00	2.45E+00	1.99E+00	1.06E+00
AG-110M	1.00E-10				2.31E-07			
BA-133	9.00E-10							
BA-139	4.00E-08							1.17E-07
BA-140	2.00E-09			3.41E-07				
CD-109	2.00E-10	8.92E-06	1.26E-06	2.28E-04				
CE-139	9.00E-10							
CE-141	8.00E-10	8.48E-09						
CE-144	2.00E-11		2.04E-06			3.92E-07		3.94E-09
CO-57	9.00E-10	2.10E-07		2.52E-11	1.13E-08		1.23E-06	4.80E-07
CO-58	1.00E-09	1.57E-04	1.33E-05	1.01E-04	3.59E-05	1.69E-04	2.74E-05	3.85E-06
CO-60	5.00E-11	7.94E-05	1.11E-04	1.18E-05	3.64E-04	1.63E-04	3.56E-06	1.06E-04
CR-51	3.00E-08					5.28E-04		7.58E-09
CS-134	2.00E-10	1.18E-03	9.49E-04	5.86E-05	7.27E-05			1.10E-03
CS-136	9.00E-10							
CS-137	2.00E-10	4.02E-03	2.94E-04	3.08E-04	6.74E-04	2.10E-03	1.91E-04	1.90E-03
CS-138	8.00E-08	9.64E-07	1.92E-06	1.85E-03	1.26E-07	3.44E-06		1.92E-02
F-18	1.00E-07		1.08E-05	2.52E-04	3.87E-05	3.31E-04	1.10E-05	6.60E-04
FE-59	7.00E-10							4.87E-09
MN-54	1.00E-09	1.99E-06	1.70E-06		4.86E-05			
MO-99	2.00E-09			7.27E-09	2.71E-08			
NA-24	7.00E-09	1.39E-04		4.32E-04	4.29E-04			
NB-95	2.00E-09	2.52E-06	7.70E-07	5.97E-07	6.25E-08		9.56E-10	
NB-97	1.00E-07				1.60E-08			1.65E-09
RB-88	9.00E-08	4.63E-05	3.46E-05	1.03E-02	4.00E-06	1.81E-05		1.62E-01
RB-89	2.00E-07					4.30E-09		
RU-103	9.00E-10	1.91E-08	1.89E-05					
SB-125	7.00E-10	1.25E-07		3.08E-06	9.39E-08			
SN-113	8.00E-10	2.16E-08			4.80E-10			
SR-89	2.00E-10	4.87E-08	1.54E-06	7.70E-07	3.71E-06			
SR-90	6.00E-12			1.68E-10	4.30E-06			
SR-91	5.00E-09							
TC-99M	3.00E-07			6.43E-08	2.20E-07	9.24E-07		
TC-101	5.00E-07							
TE-132	9.00E-10				3.07E-06	7.33E-08		2.34E-06
Y-88	3.00E-10			1.28E-10				
ZN-65	4.00E-10				9.27E-06			
ZR-95	4.00E-10	1.31E-06			3.56E-09		7.43E-10	
ZR-97	2.00E-09	2.97E-10						
I-131	2.00E-10	3.44E-03	1.11E-03	3.08E-03	5.43E-04	3.18E-04	7.85E-05	3.46E-04
I-132	2.00E-08	3.75E-03	1.79E-03	2.42E-03	4.78E-04	4.20E-05	1.09E-05	2.95E-05
I-133	1.00E-09	1.37E-03	6.80E-04	3.04E-03	1.53E-03	1.19E-03	1.13E-04	1.13E-04
I-134	6.00E-08	1.33E-05		9.32E-04				
I-135	6.00E-09	5.79E-04	1.09E-04	2.19E-03	9.18E-05	1.26E-05	3.15E-08	1.58E-05

TABLE B-2
FRACTIONAL MEC FOR ATMOSPHERIC EFFLUENT

NUCLIDE	1985	1986	1987	1988	1989	1990	1991
H-3	3.20E-05	5.71E-05	5.62E-05	6.00E-05	6.76E-05	6.10E-05	5.38E-05
AR-41	6.05E-06	3.24E-06	1.03E-05	9.33E-06	7.48E-06	5.29E-06	5.10E-06
KR-85M	8.76E-06	3.22E-07	5.62E-07	3.48E-07	1.07E-07	8.81E-08	4.90E-08
KR-85	1.14E-06	8.98E-08	4.84E-08	6.69E-08	2.44E-08	1.21E-08	1.86E-08
KR-87	1.14E-05	2.40E-06	5.64E-06	3.52E-06	1.18E-06	9.64E-07	5.50E-07
KR-88	3.03E-05	6.88E-06	1.44E-05	8.94E-06	2.98E-06	2.38E-06	1.35E-06
YF-131M	2.03E-09						
XE-133M	2.62E-08	1.10E-08	1.68E-08	2.66E-08	3.92E-10	1.63E-09	3.15E-09
XE-133	3.29E-06	1.46E-06	1.96E-06	5.75E-06	7.18E-07	1.87E-07	1.52E-06
XE-135M	6.86E-06	1.51E-06	4.38E-06	3.02E-06	8.77E-07	7.73E-07	4.10E-07
XE-135	8.10E-06	2.18E-06	3.84E-06	2.40E-06	7.35E-07	7.41E-07	4.10E-07
XE-138	3.93E-05	6.93E-06	2.11E-05	1.71E-05	5.83E-06	4.74E-06	2.52E-06
AG-110M				1.10E-10			
BA-139						1.39E-13	
BA-140			8.12E-12				
CD-109	2.12E-09	3.00E-10	5.43E-08				
CE-141	5.05E-13						
CE-144		4.86E-09			9.33E-10		9.38E-12
CO-57	1.11E-11		1.33E-15	5.98E-13		6.51E-11	2.54E-11
CO-58	7.48E-09	6.33E-10	4.81E-09	1.71E-09	8.05E-09	1.30E-09	1.83E-10
CO-60	7.56E-08	1.06E-07	1.12E-08	3.47E-07	1.55E-07	3.39E-09	1.01E-07
CR-51					8.38E-10		1.20E-14
CS-134	2.81E-07	2.26E-07	1.40E-08	1.73E-08			2.62E-07
CS-136							
CS-137	9.57E-07	7.00E-08	7.33E-08	1.60E-07	5.00E-07	4.55E-08	4.52E-07
CS-138	5.74E-13	1.14E-12	1.10E-09	7.50E-14	2.05E-12		1.14E-08
F-18		5.14E-12	1.20E-10	1.84E-11	1.58E-10	5.24E-12	3.14E-10
FE-59							3.31E-13
MN-54	9.48E-11	8.10E-11		2.31E-09			
MO-99			1.73E-13	6.45E-13			
NA-24	9.46E-10		2.94E-09	2.92E-09			
NB-95	6.00E-11	1.83E-11	1.42E-11	1.49E-12		2.28E-14	
NB-97				7.62E-15			7.86E-16
RB-88	2.45E-11	1.83E-11	5.45E-09	2.12E-12	9.58E-12		8.57E-08
RB-89					1.02E-15		
RU-103	1.01E-12	1.00E-09					
SB-125	8.50E-12		2.50E-10	6.39E-12			
SN-113	1.29E-12			2.86E-14			
SR-89	1.16E-11	3.67E-10	1.83E-10	8.83E-10			
SR-90			1.33E-12	3.41E-08			
SR-91							
TC-99M			1.02E-14	3.49E-14	1.47E-13		
TC-101							
TE-132				1.62E-10	3.88E-12		1.24E-10
Y-88			2.03E-14				
ZN-65				1.10E-09			
ZR-95	1.56E-10			4.24E-13		8.85E-14	
ZR-97	7.07E-15						
1-131	8.19E-07	2.64E-07	7.33E-07	1.29E-07	7.57E-08	1.87E-08	8.24E-08
1-132	8.93E-09	4.26E-09	5.76E-09	1.14E-09	1.00E-10	2.60E-11	7.02E-11
1-133	6.52E-08	3.24E-08	1.45E-07	7.29E-08	5.67E-08	5.38E-09	5.38E-09
1-134	1.06E-11		7.40E-10				
1-135	4.60E-09	8.65E-10	1.74E-08	7.29E-10	1.00E-10	2.50E-13	1.25E-10
TOTALFRAC	1.49E-04	8.29E-05	1.20E-04	1.11E-04	8.83E-05	7.62E-05	6.67E-05
TOTAL H3	1.17E-04	2.57E-05	6.34E-05	5.13E-05	2.07E-05	1.52E-05	1.29E-05
EFF MEC	5.84E-08	8.49E-08	6.62E-08	8.85E-08	8.46E-08	8.50E-08	9.50E-08
W/O H-3	3.70E-08	1.60E-08	1.92E-08	3.46E-08	8.10E-09	5.02E-09	1.44E-08

APPENDIX C

CALCULATION OF TOTAL DOSE FACTORS

USING

REGULATORY GUIDE 1.109, REV. 1

C1.0 CALCULATION OF TOTAL DOSE FACTORS USING REGULATORY GUIDE 1.109 METHODOLOGYC1.1 Liquid Release Dose Factors

The equations and values used to calculate the total dose to the maximum exposed individual for each of the liquid release mode pathways evaluated according to Regulatory Guide 1.109, Rev. 1, 1977 methodology is shown below. The total dose factor in mrem/Ci released is the sum of all pathway doses in mrem/Ci for the following pathways: milk, meat, fish, potable water, and shoreline deposits. The results for an organ is summed for each pathway and the total presented by age group and target organ in a matrix format for each radionuclide in Section 5, Table 5.1.1. The derivation of dilution factors used in the calculations is presented in Appendix D. The highest dose in each matrix is used as the dose tracking factor to be used for the monthly tracking of release doses. These values are found in Section 5, Table 5.2.

C1.1.1 Aquatic Foods

The dose from the eating of fresh fish caught at the edge of the initial mixing zone was calculated using the equation:

$$Dose_{apj} = 1100 \frac{M_p U_{ap}}{F} \sum_i Q_i B_{ip} D_{aipj} e^{-\lambda_i t_p}$$

where: $Dose_{apj}$ = the dose to the organ j of an individual of age group a from all of the nuclides i in pathway p , in mrem/year;

1100 = a factor to convert from Ci-sec/yr-ft³ to pCi/liter;

M_p = the mixing ratio (reciprocal of the dilution factor) at the point of harvest of aquatic food, dimensionless;

U_{ap} = a usage factor that specifies the intake rate for an individual of age group a associated with pathway p , in kg/year;

F = the flow rate of the liquid effluent, in ft³/sec;

Q_i = the release rate of nuclide i , in Ci/year;

B_{ip} = the equilibrium bioaccumulation factor for nuclide i in pathway p , expressed as the ratio of the concentration in biota (in pCi/kg) to the radionuclide concentration in water (in pCi/l), in liters/kg;

D_{aipj} = the dose factor, specific to a given age group a , nuclide i , pathway p , and organ j , which is used to calculate the radiation dose from an intake of a nuclide, in mrem/pCi;

λ_i = the radioactive decay constant of nuclide i , in day⁻¹;

t_p = the average transit time required for nuclides to reach the point of exposure. For internal dose, t_p is the total time elapsed between release of the nuclides and the ingestion of the water, in days.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{aipj}}{Q_i} = 1100 \frac{M_p U_{ap}}{F} B_{ip} D_{aipj} e^{-\lambda_i t_p}$$

The values used in the equation above are:

- M_p = 0.1136 (Point of harvest of the fresh fish is taken at a point 1000 m downstream. The plume centerline dilution factor at this location is 8.8 using RG 1.111 methodology. The dilution factor calculations are attached. The factor of 2 allowed for current reversals was not used.);
- U_{ap} = Infant - 0, Child - 6.9, Teen - 16, and Adult - 21 kg/year;
- F = 1507 ft³/sec. (677000 gpm);
- B_{ip} = Values used are taken from Table A-1 of RG 1.109;
- D_{aipj} = Values used are taken from Tables E-11 through E-14 of RG 1.109;
- t_p = 0.5 days.

C1.1.2 Irrigated Foods (Meat From Watered Cattle)

The dose from the ingestion of meat from cattle which have been given contaminated water was calculated using the equation:

$$Dose_{apj} = 1100 \frac{M_p U_{ap} Q_{Aw}}{F} \sum_i Q_i F_{iA} D_{aiPj} e^{-\lambda_i t_s}$$

- where: $Dose_{apj}$ = the dose to the organ j of an individual of age group a from all of the nuclides i in pathway p, in mrem/year;
- 1100 = factor to convert from Ci-sec/yr-ft³ to pCi/liter;
- M_p = the mixing ratio (reciprocal of the dilution factor) at the point of exposure, dimensionless;
- U_{ap} = a usage factor that specifies the intake rate for an individual of age group a associated with pathway p, in kg/year;
- Q_{Aw} = consumption rate of contaminated water by an animal, in liters/day;
- F = the flow rate of the liquid effluent, in ft³/sec;
- Q_i = the release rate of nuclide i, in Ci/year;
- F_{iA} = the stable element transfer coefficient that relates the daily intake rate by an animal to the concentration in an edible portion of animal product, in pCi/liter of meat per pCi/day;
- D_{aiPj} = the dose factor, specific to a given age group a, nuclide i, pathway p, and organ j, which is used to calculate the radiation dose from an intake of a nuclide, in mrem/pCi;
- λ_i = the radioactive decay constant of nuclide i, in day⁻¹;
- t_s = the average time from slaughter to consumption, in days.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{aipj}}{Q_i} = 1100 \frac{M_p U_{ap} Q_{Aw}}{F} F_{iA} D_{aipj} e^{-\lambda_i t_s}$$

The values used in the equation above are:

M_p	=	0.1111 (Point at which water is taken from the lake is taken as plume centerline 1 mile downstream. The plume centerline dilution factor at this location is 9 using RG 1.111 methodology.);
U_{ap}	=	Infant - 0, Child - 41, Teen - 65, and Adult - 110 kg/year;
Q_{Aw}	=	60 liters/day;
F	=	1507 ft ³ /sec. (677000 gpm);
F_{iA}	=	Values used are taken from Table E-1 of RG 1.109;
D_{aipj}	=	Values used are taken from Tables E-11 through E-14 of RG 1.109;
t_s	=	20 days.

C1.1.3 Irrigated Foods (Milk From Watered Cattle)

The dose from the ingestion of milk from cows which have been given contaminated water was calculated using the equation:

$$Dose_{apj} = 1100 \frac{M_p U_{ap} Q_{Aw}}{F} \sum_i Q_i F_{iA} D_{aipj} e^{-\lambda_i t_i}$$

where: $Dose_{apj}$ = the dose to the organ j of an individual of age group a from all of the nuclides i in pathway p , in mrem/year;

- 1100 = factor to convert from Ci-sec/yr-ft³ to pCi/liter;
- M_p = the mixing ratio (reciprocal of the dilution factor) at the point of exposure, dimensionless;
- U_{ap} = a usage factor that specifies the intake rate for an individual of age group a associated with pathway p , in liters/year;
- Q_{Aw} = consumption rate of contaminated water by an animal, in liters/day;
- F = the flow rate of the liquid effluent, in ft³/sec;
- Q_i = the release rate of nuclide i , in Ci/year;
- F_{iA} = the stable element transfer coefficient that relates the daily intake rate by an animal to the concentration in an edible portion of animal product, in pCi/liter of milk per pCi/day;
- D_{aipj} = the dose factor, specific to a given age group a , nuclide i , pathway p , and organ j , which is used to calculate the radiation dose from an intake of a nuclide, in mrem/pCi;
- λ_i = the radioactive decay constant of nuclide i , in day⁻¹;
- t_i = the average transport time of the activity from the feed into the milk and to the receptor, in days.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{aipj}}{Q_j} = 1100 \frac{M_p U_{ap} Q_{Aw}}{F} F_{iA} D_{aipj} e^{-\lambda_j t_j}$$

The values used in the equation above are:

M_p	=	0.1111 (Point at which water is taken from the lake is taken as plume centerline 1 mile downstream. The plume centerline dilution factor at this location is 9 using RG 1.111 methodology. the dilution factor calculations are attached. The factor of 2 allowed for current reversals was not used. This is a conservative assumption.);
U_{ap}	=	Infant - 330, Child - 330, Teen - 400, and Adult - 310 liters/year;
Q_{Aw}	=	60 liters/day;
F	=	1507 ft ³ /sec. (677000 gpm);
F_{iA}	=	Values used are taken from Table E-1 of RG 1.109;
D_{aipj}	=	Values used are taken from Tables E-11 through E-14 of RG 1.109;
t_j	=	2 days.

C1.1.4 Potable Water

The dose from ingestion of water was calculated using the equation:

$$Dose_{apj} = 1100 \frac{M_p U_{ap}}{F} \sum_i Q_i D_{aipj} e^{-\lambda_i t_p}$$

- where: $Dose_{apj}$ = the dose to the organ j of an individual of age group a from all of the nuclides i in pathway p, in mrem/year;
- 1100 = a factor to convert from Ci-sec/yr-ft³ to pCi/liter;
- M_p = the mixing ratio (reciprocal of the dilution factor) at the point of withdrawal of drinking water, dimensionless;
- U_{ap} = a usage factor that specifies the intake rate for an individual of age group a associated with pathway p, in l/year;
- F = the flow rate of the liquid effluent, in ft³/sec;
- Q_i = the release rate of nuclide i, in Ci/year;
- D_{aipj} = the dose factor, specific to a given age group a, nuclide i, pathway p, and organ j, which is used to calculate the radiation dose from an intake of a nuclide, in mrem/pCi;
- λ_i = the radioactive decay constant of nuclide i, in day⁻¹;
- t_p = the average transit time required for nuclides to reach the point of exposure. For internal dose, t_p is the total time elapsed between release of the nuclides and the ingestion of the water, in days.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{aij}}{Q_i} = 1100 \frac{M_p U_{ap}}{F} D_{aij} e^{-\lambda_i t_p}$$

The values used in the equation above are:

- M_p = 0.0384 (Withdrawal point is taken as the Two Rivers municipal water intake located a distance of 12 miles downstream. The plume centerline dilution factor at this location is 26 using RG 1.111 methodology and the factor of 2 allowed for current reversals. The dilution factor calculations are attached.);
- U_{ap} = Infant - 330, Child - 510, Teen - 510, and Adult - 730 liters/year;
- F = 1507 ft³/sec. (677000 gpm);
- D_{aij} = Values used are taken from Tables E-11 through E-14 of RG 1.109
- t_p = 2 days (This was calculated using a current speed of 12.2 cm/s plus 12 hours to reflect the transport of the water through the water purification plant and distribution system.)

C1.1.5 Shoreline Deposits

The dose from exposure to radioactive materials deposited on the shoreline of the lake was calculated using the equation:

$$Dose_{apj} = 110000 \frac{M_p U_{ap} W}{F} \sum_i Q_i T_i D_{aipj} e^{-\lambda_i t_p} (1 - e^{-\lambda_i t_b})$$

where: $Dose_{apj}$ = the dose to the organ j of an individual of age group a from all of the nuclides i in pathway p, in mrem/year;

- 110000 = a factor to convert from Ci-sec/yr-ft³ to pCi/liter and to account for the proportionality constant used in the sediment radioactivity model;
- M_p = the mixing ratio (reciprocal of the dilution factor) at the point of exposure, dimensionless;
- U_{ap} = a usage factor that specifies the exposure time for an individual of age group a associated with pathway p, in hours/year;
- W = shoreline width factor, dimensionless;
- F = the flow rate of the liquid effluent, in ft³/sec;
- Q_i = the release rate of nuclide i, in Ci/year;
- T_i = the radioactive half life of nuclide i, in days;
- D_{aipj} = the dose factor, specific to a given age group a, nuclide i, pathway p, and organ j, which is used to calculate the radiation dose from an intake of a nuclide, in mrem/pCi;
- λ_i = the radioactive decay constant of nuclide i, in day⁻¹;
- t_p = the average transit time required for nuclides to reach the point of exposure. For internal dose, t_p is the total time elapsed between release of the nuclides and the ingestion of the water, in days;
- t_b = the period of time for which the sediment or soil is exposed to the contaminated water, in days.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{aipj}}{Q_i} = 110000 \frac{M_p U_{ap} W}{F} B_{ip} T_i D_{aipj} e^{-\lambda_i t_p} (1 - e^{-\lambda_i t_b})$$

The values used in the equation above are:

- M_p = 0.01821 (Point of exposure is taken as the Point Beach State Park beach which is located 8000 meters downstream. The plume shoreline dilution factor at this location is 54.9 using RG 1.111 methodology. The dilution factor calculations are attached. The factor of 2 allowed for current reversals was not used.);
- U_{ap} = Infant - 0, Child - 14, Teen - 67, and Adult - 12 hours/year;
- W = 0.3;
- B_{ip} = Values used are taken from Table A-1 of RG 1.109;
- F = 1507 ft³/sec. (677000 gpm);
- D_{aipj} = Values used are taken from Table E-6 of RG 1.109;
- t_p = 0.5 day;
- t_b = 5458 days.

C1.2 Atmospheric Release Dose Factors: Non-Gaseous

The equations and values used to calculate the total dose to the maximum exposed individual factors for non-gaseous radionuclides released to the atmosphere using Regulatory Guide 1.109, Rev. 1, 1977 is shown below. The total dose factor in mrem/Ci released is the sum of all airborne effluent doses in mrem/Ci for the following pathways: milk, meat, leafy vegetables, potable water, and shoreline deposits. A summary of totals is presented by age group and target organ in matrix format for each radionuclide in Section 5, Table 5-1. The highest dose in each matrix is used as the dose tracking factor to be used for the monthly tracking of release doses. These values are found in Section 5, Table 5-2.

C1.2.1 Inhalation of Nuclides In Air

The dose from the inhalation of nuclides in the air was calculated using the equation:

$$Dose_{ja} = 3.17E+04 R_a \left(\frac{\chi}{Q} \right) \sum_i Q_i DFI_{ija}$$

where: $Dose_{ja}$ = the annual dose to organ j of an individual of age group a due to inhalation, in mrem/year;

$3.17E+04$ = the number of pCi/Ci divided by the number of sec/year;

R_a = the annual air intake for individuals in the age group a , in m^3 /year;

χ/Q = the annual average atmosphere dispersion factor, in sec/m^3 (The location at which the dose was calculated was the site boundary in the south sector - a distance of 1270 meters.);

Q_i = the release rate of nuclide i , in Ci/year;

DFI_{ija} = the inhalation dose factor for radionuclide i , organ j , and age group a , mrem/pCi.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{ija}}{Q_i} = 3.17E+04 R_a \left(\frac{X}{Q} \right) DFI_{ija}$$

The values used in the equation above are:

- R_a = Infant - 1400, Child - 3700, Teen - 8000, and Adult - 8000 m³/year;
- X/Q = 9.36E-07 seconds/m³ (This value taken from Table I.4-2 of the FSAR, release mode 1B, annual average, site boundary.);
- DFI_{ij} = Values used are taken from Tables E-7 through E-10 of RG 1.109.

C1.2.2 Annual Organ Dose From External Irradiation From Nuclides Deposited On the Ground

The organ dose from external irradiation from nuclides deposited on the ground was calculated using the equation:

$$Dose_j = 1E+12 (8760) \delta_i S_F \sum_i \frac{Q_i (1 - e^{-\lambda_i t_b})}{\lambda_i} DFG_{ij}$$

- where: $Dose_j$ = the annual dose to the organ j, in mrem/year;
- 1E+12 = the number of pCi per Ci;
- 8760 = the number of hours in a year;
- δ_i = the annual average relative deposition of nuclide i, considering depletion of the plume during transport, in m², (The location at which the dose is calculated is the site boundary in the south sector - a distance of 1300 meters.);
- S_F = the attenuation factor that accounts for the dose reduction due to shielding provided by residential structures, dimensionless;
- Q_i = the release rate of nuclide i, in Ci/year;
- λ_i = the radioactive decay constant of nuclide i, in day⁻¹;
- t_b = the time period over which the accumulation is evaluated, in days;
- DFG_{ij} = the open field ground plane dose conversion factor for organ j from nuclide i, in mrem-m²/pCi-hour.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

The values used in the equation above are:

$$\frac{Dose_{ij}}{Q_i} = 1E+12 (8760) \delta_i S_F \frac{(1 - e^{-\lambda_i t_b})}{\lambda_i} DFG_{ij}$$

- δ_i = 31E-09 m² (This value taken from Table I.4-2 of the FSAR, release mode 1B, annual average, site boundary.);
 S_F = 1 (No structural shielding is assumed.);
 t_b = 5479 days (15 years);
 DFG_{ij} = Values used are taken from Table E-6 of RG 1.109.

C1.2.3 Annual Organ Dose From Atmospherically Released Nuclides In Milk

The organ dose from atmospherically released nuclides in milk was calculated using the equation:

$$Dose_{ja} = 2.7E+9 U_a Q_F \delta_i \sum_i Q_i F_{im} DFI_{ijs} e^{-\lambda_i t_i} \{f_p f_s + e^{-90\lambda_i} (1 - f_p f_s)\} \\ \times \left\{ \frac{r(1 - e^{-\lambda_{ei} t_e})}{Y_V \lambda_{ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_b})}{P \lambda_i} \right\}$$

- where: $Dose_{ja}$ = the annual dose to the organ j of an individual in age group a from a dietary intake of atmospherically released nuclides, in mrem/year;
- 2.7E+9 = the number of pCi per Ci divided by the number of days per year;
- U_a = the ingestion rate of milk for individuals in age group a, in liters/year;
- Q_F = the amount of feed consumed by a cow per, in kg/day;
- δ_i = the annual average relative deposition of nuclide i, considering depletion of the plume during transport, in m², (The location at which the dose is calculated is the nearest animal location in the south-southeast sector - a distance of 1300 meters.);
- Q_i = the release rate of nuclide i, in Ci/year;
- λ_i = the radioactive decay constant of nuclide i, in day⁻¹;
- t_b = the time period over which the accumulation is evaluated, in days;
- DFI_{ijs} = the dose conversion factor for the ingestion of nuclide i, organ j, and age group a, in mrem/pCi;
- F_{im} = the average fraction of the animal's daily intake of nuclide i which appears in each liter of milk, in days/liter;

-
- t_i = the average transport time of the activity from the feed into the milk and to the receptor, in days;
- f_p = the fraction of the year that the animals graze on pasture, dimensionless;
- f_i = the fraction of the daily feed that is pasture grass when the animal grazes on pasture, dimensionless;
- r = the fraction of the deposited activity retained on crops, dimensionless;
- λ_E = the effective removal rate constant for nuclide i from crops, in days^{-1} , where $\lambda_E = \lambda_i + \lambda_w$, and λ_w is the removal rate constant for physical loss by weathering;
- λ_w = 0.0504 day^{-1} ;
- t_e = the time period that crops are exposed to contamination during the growing season, in days;
- Y_v = the agricultural productivity, in $\text{kg (wet weight)/m}^2$;
- B_{ip} = the concentration factor for the uptake of nuclide i in pathway p , expressed as the ratio of the concentration in biota (in pCi/kg) to the nuclide concentration in water (in pCi/liter), in liters/kg ;
- P = the effective surface density for soil, in kg (dry soil)/m^2 .

* For iodines, this factor is changed to $1.4\text{E}+09$.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{ije}}{Q_i} = 2.7E+9 \ U_a Q_F \delta_i \sum_j F_{im} DFI_{ija} e^{-\lambda_i t_r} \{f_p f_s + e^{-90\lambda_i} (1 - f_p f_s)\} \\ \times \left\{ \frac{r(1 - e^{-\lambda_i t_e})}{Y_v \lambda_{Ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_b})}{P \lambda_i} \right\}$$

The values used in the equation above are:

U_a	=	Infant - 330, Child - 330, Teen - 400, and Adult - 310 liters/year;
Q_F	=	50 kg/day;
δ_i	=	18.8E-09 m ² (This value taken from Table I.4-2 of the FSAR, release mode 1B, grazing season, site boundary.);
F_{im}	=	Values used are taken from Table E-1 of RG 1.109;
DFI_{im}	=	Values used are taken from Tables E-11 through E-14 of RG 1.109;
t_r	=	2 days;
f_p	=	0.5;
f_s	=	0.5;
r	=	0.25, 1.0 for iodines, and 0.20 for noble gases, tritium, and carbon-14;
t_e	=	30 days;
Y_v	=	0.7 kg/m ² ;
B_{iv}	=	Values used are taken from Table E-1 of RG 1.109;
P	=	240 kg/m ² ;
t_b	=	5458 days (15 years).

C1.2.4 Annual Organ Dose From Atmospherically Released Nuclides In Meat

The organ dose from atmospherically released nuclides in meat was calculated using the equation:

$$Dose_{ja} = 2.7E+9 U_a Q_F \delta_i \sum_i Q_i F_{im} DFI_{ija} e^{-\lambda_i t_a} \{f_p f_s + e^{-\beta_0 \lambda_i} (1 - f_p f_s)\} \\ \times \left\{ \frac{r(1 - e^{-\lambda_{Ei} t_a})}{Y_v \lambda_{Ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_b})}{P \lambda_i} \right\}$$

- where: $Dose_{ja}$ = the annual dose to the organ j of an individual in age group a from a dietary intake of atmospherically released nuclides, in mrem/year;
- $2.7E+9$ = the number of pCi per Ci divided by the number of days per year;
- U_a = the ingestion rate of milk for individuals in age group a , in liters/year;
- Q_F = the amount of feed consumed by a cow per, in kg/day;
- δ_i = the annual average relative deposition of nuclide i , considering depletion of the plume during transport, in m^{-2} , (The location at which the dose is calculated is the nearest animal location in the south-southeast sector - a distance of 1300 meters.);
- Q_i = the release rate of nuclide i , in Ci/year;
- λ_i = the radioactive decay constant of nuclide i , in day^{-1} ;
- t_a = the time period over which the accumulation is evaluated, in days;
- DFI_{ija} = the dose conversion factor for the ingestion of nuclide i , organ j , and age group a , in mrem/pCi;
- F_{iv} = the average fraction of the animal's daily intake of nuclide i which appears in each kilogram of flesh, in days/kg;
- t_b = the average time from slaughter to consumption, in days;
- f_p = the fraction of the year that the animals graze on pasture, dimensionless;
- f_s = the fraction of the daily feed that is pasture grass when the animal grazes on pasture, dimensionless;
- r = the fraction of the deposited activity retained on crops, dimensionless;
- λ_{Ei} = the effective removal rate constant for nuclide i from crops, in $days^{-1}$, where $\lambda_{Ei} = \lambda_i + \lambda_w$, and λ_w is the removal rate constant for physical loss by weathering;

-
- t_c = the time period that crops are exposed to contamination during the growing season, in days;
- Y_v = the agricultural productivity, in kg (wet weight)/m²;
- B_{iv} = the concentration factor for the uptake of nuclide i in pathway p, expressed as the ratio of the concentration in biota (in pCi/kg) to the nuclide concentration in water (in pCi/liter), in liters/kg;
- P = the effective surface density for soil, in kg (dry soil)/m².

* For iodines, this factor is changed to 1.4E+09.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{ijs}}{Q_i} = 2.7E+9 U_a Q_r \delta_i \sum_j F_{im} DFI_{ija} e^{-\lambda_i t_s} \{f_p f_s + e^{-90\lambda_i} (1 - f_p f_s)\} \\ \times \left\{ \frac{r(1 - e^{-\lambda_i t_e})}{Y_v \lambda_{ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_b})}{P \lambda_i} \right\}$$

The values used in the equation above are:

U_a	=	Infant - 0, Child - 41, Teen - 65, and Adult - 110 kg/year;
Q_r	=	50 kg/day;
δ_i	=	18.8E-09 m ³ (This value taken from Table I.4-2 of the FSAR, release mode 1B, grazing season, site boundary.);
F_{im}	=	Values used are taken from Table E-1 of RG 1.109;
DFI_{ij}	=	Values used are taken from Tables E-11 through E-14 of RG 1.109;
t_s	=	20 days;
f_p	=	0.5;
f_s	=	1.0;
r	=	0.25, 1.0 for iodines, and 0.20 for noble gases, tritium, and carbon-14;
t_e	=	30 days;
B_{iv}	=	Values used are taken from Table E-1 of RG 1.109;
Y_v	=	0.7 kg/m ² ;
P	=	240 kg/m ² ;
λ_w	=	0.0504 day ⁻¹ ;
t_b	=	5458 days (15 years).

C1.2.5 Annual Organ Dose From Atmospherically Released Nuclides In Produce

The organ dose from atmospherically released nuclides in produce was calculated using the equation:

$$Dose_{ja} = 2.7E+9 \ U_a f_g \delta_i \sum_j Q_i DFI_{ija} e^{-\lambda_i t_h} \left\{ \frac{r(1 - e^{-\lambda_{ei} t_e})}{Y_v \lambda_{ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_p})}{P \lambda_i} \right\}$$

- where: $Dose_{ja}$ = the annual dose to the organ j of an individual in age group a from a dietary intake of atmospherically released nuclides, in mrem/year;
- $2.7E+9^*$ = the number of pCi per Ci divided by the number of days per year;
- U_a = the ingestion rate of produce for individuals in age group a , in kg/year;
- f_g = fraction of produce ingested grown in garden of interest, dimensionless;
- δ_i = the annual average relative deposition of nuclide i , considering depletion of the plume during transport, in m^2 . (The location at which the dose is calculated is the nearest garden location in the south-southwest sector - a distance of 1460 meters.);
- Q_i = the release rate of nuclide i , in Ci/year;
- λ_i = the radioactive decay constant of nuclide i , in day^{-1} ;
- t_h = the time period over which the accumulation is evaluated, in days;
- DFI_{ija} = the dose conversion factor for the ingestion of nuclide i , organ j , and age group a , in mrem/pCi;
- t_e = the holdup time that represents the time interval between harvest and consumption of the food, in days;
- r = the fraction of the deposited activity retained on crops, dimensionless;
- λ_{ei} = the effective removal rate constant for nuclide i from crops, in $days^{-1}$, where $\lambda_{ei} = \lambda_i + \lambda_{w_i}$, and λ_{w_i} is the removal rate constant for physical loss by weathering;
- t_e = the time period that crops are exposed to contamination during the growing season, in days;
- Y_v = the agricultural productivity, in kg (wet weight)/ m^2 ;
- B_{iv} = the concentration factor for the uptake of nuclide i in pathway p , expressed as the ratio of the concentration in biota (in pCi/kg) to the nuclide concentration in water (in pCi/liter), in liters/kg;
- P = the effective surface density for soil, in kg (dry soil)/ m^2 .

* For iodines, this factor is changed to $1.4E+09$.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{ija}}{Q_i} = 2.7E+9 U_a f_g \delta_i \sum_j DFI_{ija} e^{-\lambda_i t_n} \left\{ \frac{r(1 - e^{-\lambda_{Ei} t_e})}{Y_v \lambda_{Ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_b})}{P \lambda_i} \right\}$$

The values used in the equation above are:

U_a	=	Infant - 0, Child - 520, Teen - 630, and Adult - 520 kg/year;
f_g	=	0.76;
δ_i	=	18.8E-09 m ² (This value taken from Table I.4-2 of the FSAR, release mode 1B, growing season, site boundary.);
DFI_{ija}	=	Values used are taken from Tables E-11 through E-14 of RG 1.109;
t_n	=	60 days;
r	=	0.25, 1.0 for iodines, and 0.20 for noble gases, tritium, and carbon-14;
λ_{iv}	=	0.0504 day ⁻¹ ;
t_e	=	60 days;
Y_v	=	0.7 kg/m ² ;
B_{iv}	=	Values used are taken from Table E-1 of RG 1.109,
P	=	240 kg/m ² ;
t_b	=	5458 days (15 years).

C1.2.6 Annual Organ Dose From Atmospherically Released Nuclides In Leafy Vegetables

The organ dose from atmospherically released nuclides in leafy vegetables was calculated using the equation:

$$Dose_{ja} = 2.7E+9 \ U_a f_i \delta_i \sum_j Q_i DFI_{ija} e^{-\lambda_i t_h} \left\{ \frac{r(1 - e^{-\lambda_{Ei} t_e})}{Y_v \lambda_{Ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_h})}{P \lambda_i} \right\}$$

- where: $Dose_{ja}$ = the annual dose to the organ j of an individual in age group a from a dietary intake of atmospherically released nuclides, in mrem/year;
- $2.7E+9^*$ = the number of pCi per Ci divided by the number of days per year;
- U_a = the ingestion rate of produce for individuals in age group a, in kg/year;
- f_i = fraction of leafy vegetables ingested grown in garden of interest, dimensionless;
- δ_i = the annual average relative deposition of nuclide i, considering depletion of the plume during transport, in m^{-2} , (The location at which the dose is calculated is the nearest garden location in the south-southwest sector - a distance of 1460 meters.);
- Q_i = the release rate of nuclide i, in Ci/year;
- λ_i = the radioactive decay constant of nuclide i, in day^{-1} ;
- t_h = the time period over which the accumulation is evaluated, in days;
- DFI_{ija} = the dose conversion factor for the ingestion of nuclide i, organ j, and age group a, in mrem/pCi;
- t_e = the holdup time that represents the time interval between harvest and consumption of the food, in days;
- r = the fraction of the deposited activity retained on crops, dimensionless;
- λ_{Ei} = the effective removal rate constant for nuclide i from crops, in $days^{-1}$, where $\lambda_{Ei} = \lambda_i + \lambda_w$, and λ_w is the removal rate constant for physical loss by weathering;
- t_e = the time period that crops are exposed to contamination during the growing season, in days;
- Y_v = the agricultural productivity, in kg (wet weight)/ m^2 ;
- B_{iv} = the concentration factor for the uptake of nuclide i in pathway p, expressed as the ratio of the concentration in biota (in pCi/kg) to the nuclide concentration in water (in pCi/liter), in liters/kg;
- P = the effective surface density for soil, in kg (dry soil)/ m^2 .

* For iodines, this factor is changed to $1.4E+09$.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_{ijb}}{Q_i} = 2.7E+9 U_a f_i \delta_i \sum_j DFI_{ija} e^{-\lambda_i t_b} \left\{ \frac{r(1 - e^{-\lambda_{ei} t_e})}{Y_v \lambda_{ei}} + \frac{B_{iv}(1 - e^{-\lambda_i t_b})}{P \lambda_i} \right\}$$

The values used in the equation above are:

U_a	=	Infant - 0, Child - 26, Teen - 42, and Adult - 64 kg/year;
f_i	=	1;
δ_i	=	18.8E-09 m ² (This value taken from Table I.4-2 of the FSAR, release mode 1B, growing season, site boundary.);
DFI_{ija}	=	Values used are taken from Tables E-11 through E-14 of RG 1.109;
t_b	=	1 day;
r	=	0.25, 1.0 for iodines, and 0.20 for noble gases, tritium, and carbon-14;
λ_{ei}	=	0.0504 day ⁻¹ ;
t_e	=	60 days;
Y_v	=	0.7 kg/m ³ ;
B_{iv}	=	Values used are taken from Table E-1 of RG 1.109;
P	=	240 kg/m ³ ;
t_b	=	5458 days (15 years).

C1.3 Atmospheric Release Dose Factors: Noble Gases

The equations and values used to calculate the total dose factors for noble gases released to the atmosphere using Regulatory Guide 1.109, Rev. 1, 1977 is shown below. The dose factor in mrem/Ci and mrad/Ci released for each radionuclide is presented in Section 5, Table 5-1.

C1.3.1 Annual Gamma and Beta Air Dose From All Noble Gas Releases

The dose from the submersion of individuals in air containing noble gases was calculated using the equation:

$$Dose^{\gamma} \text{ or } Dose^{\beta} = 3.17E+04 \left(\frac{\chi}{Q} \right) \sum_i Q_i (DF_i^{\gamma} \text{ or } DF_i^{\beta})$$

where:

- $Dose^{\gamma}$ or $Dose^{\beta}$ = the annual gamma and beta air dose, in mrad/year;
- $3.17E+04$ = the number of pCi/Ci divided by the number of sec/year;
- χ/Q = the annual average atmosphere dispersion factor, in sec/m³ (The location at which the dose was calculated was the site boundary in the south sector - a distance of 1270 meters.);
- Q_i = the release rate of nuclide i, in Ci/year;
- DF_i^{γ} or DF_i^{β} = the gamma and beta air dose factors for a uniform semi-infinite cloud of radionuclide i, in mrad-m³/pCi-year.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_i^{\gamma} \text{ or } Dose_i^{\beta}}{Q_i} = 3.17E+04 \left(\frac{\chi}{Q} \right) (DF_i^{\gamma} \text{ or } DF_i^{\beta})$$

The values used in the equation above are:

- χ/Q = $9.36E-07$ seconds/m³ (This value taken from Table I.4-2 of the FSAR, release mode 1B, intermittent, annual average, site boundary.);
- DF_i^{γ} or DF_i^{β} = Values used are taken from Table B-1 of RG 1.109.

C1.3.2 Annual Skin Dose From All Noble Gas Releases

The skin dose from the submersion of individuals in air containing noble gases was calculated using the equation:

$$Dose = 3.17E+04 \left(\frac{\lambda}{Q} \right) (1.11 S_F \sum_i Q_i DF_i^{\gamma} + \sum_i Q_i DFS_i^{\beta})$$

- where:
- Dose = the annual skin dose due to immersion in a semi-infinite cloud, in mrem/year;
 - 3.17E+04 = the number of pCi/Ci divided by the number of sec/year;
 - 1.11 = the average ratio of tissue to air energy absorption coefficients;
 - S_F = the attenuation factor that accounts for the dose reduction due to shielding provided by residential structures, dimensionless;
 - λ/Q = the annual average atmosphere dispersion factor, in sec/m³ (The location at which the dose was calculated was the site boundary in the south sector - a distance of 1270 meters.);
 - Q_i = the release rate of nuclide i, in Ci/year;
 - DF_i^{γ} = the annual gamma air dose factor for a uniform semi-infinite cloud of nuclide i, in mrad-m³/pCi-year;
 - DFS_i^{β} = the beta skin dose factor for a semi-infinite cloud of nuclide i, which includes the attenuation by 7 mg/cm² of skin, in mrem-m³/pCi-year.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_i}{Q_i} = 3.17E+04 \left(\frac{\chi}{Q} \right) (1.11 S_F DF_i^Y + DFS_i)$$

The values used in the equation above are:

- S_F = 1 (No structural shielding is assumed.);
- χ/Q = $9.36E-07$ seconds/ m^3 (This value taken from Table I.4-2 of the FSAR, release mode 1B, annual average, site boundary.);
- DF_i^Y = Values used are taken from Table B-1 of RG 1.109;
- DFS_i = Values used are taken from Table B-1 of RG 1.109.

C1.3.3 Annual Total Body Dose From All Noble Gas Releases

The total body dose from the submersion of individuals in air containing noble gases was calculated using the equation:

$$Dose = 3.17E+04 S_F \left(\frac{\chi}{Q} \right) \sum_i Q_i DFB_i$$

- where: Dose = the annual total body dose due to immersion in a semi-infinite cloud, in mrem/year;
- $3.17E+04$ = the number of pCi/Ci divided by the number of sec/year;
- S_F = the attenuation factor that accounts for the dose reduction due to shielding provided by residential structures, dimensionless;
- χ/Q = the annual average atmosphere dispersion factor, in sec/ m^3 (The location at which the dose was calculated was the site boundary in the south sector - a distance of 1270 meters.);
- Q_i = the release rate of nuclide i, in Ci/year;
- DFB_i = the total body dose factor for a uniform semi-infinite cloud of nuclide i, which includes the attenuation of 5 g/ cm^2 of tissue, in mrem- m^3 /pCi-year.

To calculate the dose per curie released, the equation above was rearranged and the calculation performed for each nuclide. The rearranged equation is shown below:

$$\frac{Dose_i}{Q_i} = 3.17E+04 S_F \left(\frac{\chi}{Q} \right) DFB_i$$

The values used in the equation above are:

- S_F = 1 (No structural shielding is assumed.);
- χ/Q = $9.36E-07$ seconds/ m^3 (This value taken from Table I.4-2 of the FSAR, release mode 1B, annual average, site boundary.);
- DFB_i = Values used are taken from Table B-1 of RG 1.109.

APPENDIX D

DERIVATION OF DILUTION FACTORS

USING

REGULATORY GUIDE 1.113

D1.0 LIQUID EFFLUENT DILUTION FACTOR CALCULATIONS

D1.1 Methodology

The dilution factors used for calculating the doses from liquid effluent released to Lake Michigan were calculated using the methodology of Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I." The parameters used in the calculation and the results of the calculation are given in Table D-1. The results are presented graphically in Figure D-1.

The centerline and shoreline values were calculated using Reg Guide 1.113 formulae 17 and 18 which apply to discharges to the Great Lakes. (The formulae are not presented here. See Section 5 of the PBNP FSAR for the formulae and origin of values used.) These results are applied as calculated for fish caught near PBNP. But for other pathways, an extra factor of two (2) is applied to account for current reversals which occur in Lake Michigan as described in the Appendix I, Section 5, of the PBNP FSAR.

TABLE D-1
SURFACE DILUTION FACTORS
LIQUID EFFLUENTS IN A LARGE LAKE


Downstream Distance (meters)	Plume Centerline	Shoreline
10	8.81	
20	8.81	
30	8.81	
40	8.81	
50	8.81	
60	8.81	
70	8.81	
80	8.81	
90	8.81	
100	8.81	
200	8.81	
300	8.81	
400	8.81	
500	8.81	
600	8.81	
700	8.81	
800	8.81	
900	8.81	
1000	8.81	122000
2000	8.86	1758
3000	9.01	401
4000	9.25	186
5000	9.53	116
6000	9.85	83.8
7000	10.2	65.9
8000	10.5	54.9
9000	10.8	47.4
10000	11.1	42.1
20000	14.0	24
30000	16.1	20.1
40000	17.7	18.7
50000	18.8	18.3
60000	19.6	18.2
70000	20.3	18.3
80000	20.9	18.6
90000	21.4	18.9
100000	21.9	19.2
200000	25.9	23.2
300000	29.2	26.9
400000	32.3	30.3
500000	35.2	33.3
600000	37.8	36.0
700000	40.2	38.6
800000	42.6	41.0
900000	44.8	43.3
1000000	46.9	45.5

Note: These values were calculated using the equation described in section 5.2 of the PBNP FSAR and the following values:

ϵ_y =	900 cm ² /sec	z_e =	0 meters
ϵ_z =	2 cm ² /sec	d =	10 meters
U =	12.2 cm/sec	h =	10 meters
y_e =	152.5 meters	b =	305 meters

and a discharge rate of 42.2 m³/sec.

Dilution Factor at Surface Liquid Effluents in a Large Lake

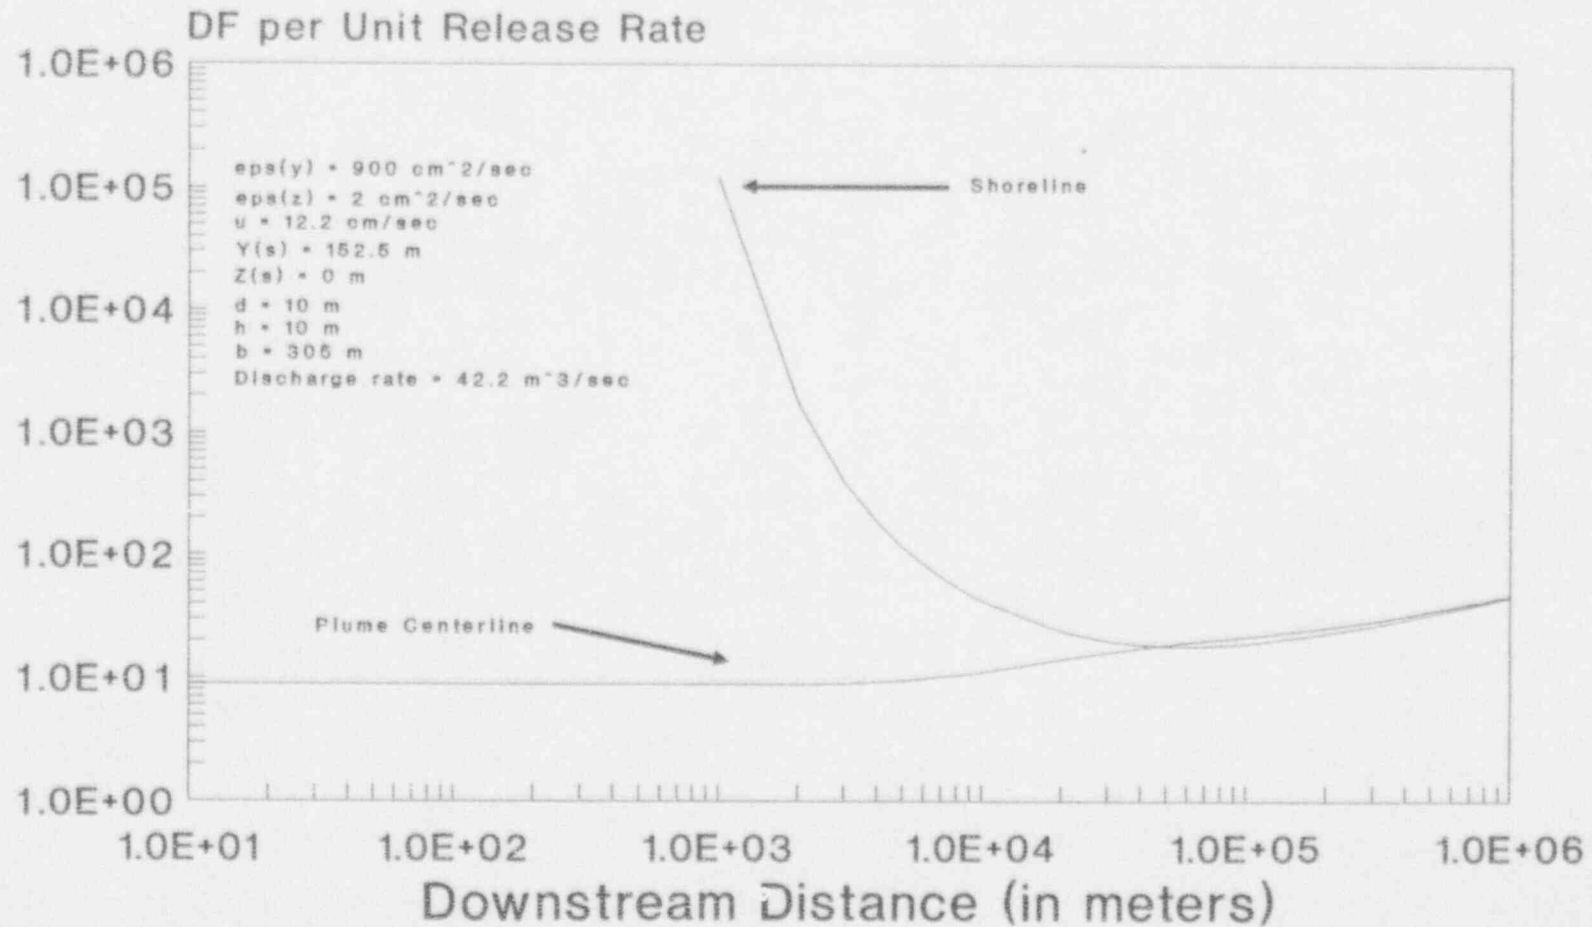

Area source, width 305 m and height 10 m

D1.2 Dilution Factor Twelve Miles Downstream: Two Rivers Water Intake

The dilution factor used at the Two Rivers water intake twelve miles downstream from PBNP included the factor of two described in Section D1.1. However, instead of using the straight centerline dilution factor shown in Table 1, the weighted average dilution factor calculated over the width of the plume was used.

This approach was used for the following reasons. First, the path that the current takes to reach the Two Rivers water intake is not straight. In order to reach Two Rivers, the water must flow southeast around Point Beach State Park, which juts into Lake Michigan, and then curves back 90 degrees towards Two Rivers. As a result of this deviation from straight line flow, any part of the plume or possibly none of the plume would impinge upon the intake structure.

Second, there is a difference in the distance offshore of the PBNP discharge and the Two Rivers water intake. The Two Rivers water intake is located 5080 feet offshore. By contrast, PBNP discharges close to the shoreline through two flumes, one directed north and one directed south, and is modeled as a source that extends 1000 feet out into the lake from the shoreline.

Based on these two considerations, it was concluded that the weighted average dilution across the width of the plume as it diverges while flowing south would constitute a better estimate of the dilution factor instead of the calculated for the centerline of an area source as is assumed for the FSAR calculation. The calculation and the values used are shown below.

The average dilution factor at 12 miles downstream was calculated in the following manner:

1. The standard deviation of the radionuclide concentration in the y direction at 12 miles downstream on the surface of the lake was calculated. This calculation used the following formula:

$$\sigma_y = \sqrt{\frac{2 \times \epsilon_y \times X}{u}}$$

where ϵ_y = lateral turbulent diffusion coefficient in cm^2/sec
 x = the downstream distance in cm
 u = current in cm/sec

Substituting the values for ϵ_y , x , and u of $900 \text{ cm}^2/\text{sec}$, 19308 m , and 12.2 cm/sec , respectively, into the equation yields

$$\sigma_y = \sqrt{\frac{2 \times 900 \frac{\text{cm}^2}{\text{sec}} \times 19308 \text{ m} \times 100 \frac{\text{cm}}{\text{m}}}{12.2 \frac{\text{cm}}{\text{sec}} \times 100 \frac{\text{cm}}{\text{m}}}} = 168.8 \text{ meters}$$

2. At distances of 0.1σ , 0.2σ , etc., off the plume centerline, the dilution factor was calculated using the equation shown in section 5.2 of the PBNP FSAR. The distances off the plume centerline, the calculated dilution factor, and the fraction of the area under the normal distribution curve is listed below.

<u>Distance Off Plume Centerline</u>			
Fraction of Standard Deviation	Equivalent Distance (m)	Fraction of Total Area Under the Curve* for Interval	Dilution Factor
0.1 σ	16.9	0.080	13.8
0.2 σ	33.8	0.080	14.0
0.3 σ	50.6	0.078	14.3
0.4 σ	67.5	0.075	14.7
0.5 σ	84.4	0.072	15.2
0.6 σ	101.3	0.068	15.8
0.7 σ	118.1	0.065	16.6
0.8 σ	135.0	0.060	17.6
0.9 σ	151.9	0.056	18.8
1.0 σ	168.8	0.051	20.2
1.1 σ	185.6	0.046	21.9
1.2 σ	202.5	0.042	23.9
1.3 σ	219.4	0.037	26.3
1.4 σ	236.3	0.032	29.2
1.5 σ	253.2	0.028	32.6
1.75 σ	295.4	0.053	44.7
2.0 σ	337.6	0.035	64.7
2.25 σ	379.8	0.021	98.4
2.5 σ	421.9	0.012	158.4
3.0 σ	506.3	0.010	482
Totals		1.00	

It is assumed that the standard deviation of the radionuclide concentrations across the plume can be represented by a normal distribution curve. The fraction of the total area under the curve is that fraction of the area under the curve that lies between, for example, the interval 0.1σ and 0.2σ which also includes the area of the curve in the interval -0.1σ and -0.2σ .

The average dilution factor over the width of the plume was calculated by multiplying the dilution factor at each of the locations off of the plume centerline by the fraction of the total area of the curve occupied by that interval and then summing over all the intervals. An average dilution factor of 29 was calculated.

APPENDIX E

Wisconsin Electric submittal to the United States Nuclear Regulatory Commission, dated October 8, 1987 (VPNPD-87-430, NRC-87-104)

The submittal consists of the letter and two Attachments. Attachment II contains Appendices A - G.



Wisconsin Electric POWER COMPANY
231 W MICHIGAN P.O. BOX 2046 MILWAUKEE, WI 53201

(414) 277-2345

VPNPD-87-430
NRC-87-104

October 8, 1987

U.S. NUCLEAR REGULATORY COMMISSION
Document Control Desk
Washington, D.C. 20555

Gentlemen:

DOCKET NOS. 50-266 AND 50-301
RESPONSE TO REQUEST FOR ADDITIONAL INFORMATION
FOR 10 CFR 20.302 APPLICATION
POINT BEACH NUCLEAR PLANT

On July 14, 1987, Wisconsin Electric Power Company submitted an application, under the provisions of 10 CFR 20.302, for approval of a proposed procedure to dispose of sewage treatment sludge containing minute quantities of radioactive materials. Subsequent to the application, Mr. Ted Quay of the NRC staff requested additional information regarding the environmental characteristics of the area surrounding the Point Beach Nuclear Plant. The responses to this request were furnished in our submittal dated August 6, 1987.

By letter dated September 9, 1987, the NRC has requested Wisconsin Electric supply additional information in order to complete the review of our application. This Request for Additional Information (RAI) contains ten specific items which require responses or commitments from Wisconsin Electric. In addition, the NRC requests the previously submitted information and the information supplied in response to the RAI be compiled into "one complete, extensive, and self-contained package". To facilitate your review, Attachment I is included to provide direct responses to the ten items contained in the RAI. Attachment II is provided as the complete application, including the information from our letters dated July 14, 1987, and August 6, 1987, and information supplied in response to the NRC RAI.

We request that you complete your review of this complete, self-contained package and issue an approval of our application

NRC Document Control Desk

October 8, 1987

Page 2

as soon as possible. In order to facilitate your review and to expedite processing, we would be pleased to discuss these matters or provide additional information by telephone. Please feel free to contact us.

Very truly yours,

C. W. Fay
C. W. Fay
Vice President
Nuclear Power

bjm

Attachments

Copies to NRC Resident Inspector
NRC Regional Administrator, Region III

Blind copies to Britt/Gorske/Finke, Burstein, Charnoff,
Fay, Krieser, ~~Lapke~~, Newton, Zach

ATTACHMENT I

RESPONSES TO QUESTIONS CONTAINED IN THE
REQUEST FOR ADDITIONAL INFORMATION (RAI)
ON POINT BEACH 1 AND 2 REQUEST
FOR DISPOSAL OF LOW LEVEL RADIOACTIVITY
CONTAMINATED SEWAGE SLUDGE BY LAND APPLICATION
WISCONSIN ELECTRIC POWER COMPANY
UNDER 10 CFR 20.302(a)

The numbering system used in these responses corresponds directly to numbering used in the NRC RAI, dated September 9, 1987.

1. a. This request is for multiple applications, approximately 2 to 4 per year.
b. This request is for multiple years, expiration to coincide with conclusion of decommissioning activities associated with retirement of PBNP Units 1 & 2.
c. Please refer to the response to question number 10.

2. The pathways used to determine doses to both the maximally exposed individual and the inadvertent intruder are documented in Attachment II, Appendices D and E.

Due to the extremely low concentrations of radionuclides in the sewage sludge and the associated low doses, Wisconsin Electric will control access to the disposal sites by conditions of use defined in lease agreements with the lease. Use of the land is not controlled beyond the conditions of the lease, thereby not restraining a casual visitor from the disposal site. However continuous occupancy would be readily observed, and remedial action would be taken.

3. Information contained in previous submittals has been included in Attachment II with modifications to provide specific commitments to the NRC.
4. Please refer to the response to question number 10.
5. Site maps have been updated and are included in Attachment II, Appendix C.
6. The direct grazing of cattle on the proposed disposal sites is controlled by restrictions contained in the lease agreement.

There will be no restrictions placed on fishermen on Lake Michigan. Calculations of doses due to all pathways associated with a release to Lake Michigan (Attachment II, Appendix E) do not indicate a need to apply restrictions to fishermen.

7. Please refer to revised site maps included in Attachment II, Appendix C. Site number 5 is located on company owned land beyond the PBNP site boundary. All other sites are within the PBNP site boundary area.
8. a. Please refer to Attachment II, Section 3.2, Disposal Procedure.
b. Please refer to Attachment II, Section 3.2, Disposal Procedure.
c. Please refer to Attachment II, Section 3.2, Disposal Procedure.
d. Please refer to Attachment II, Appendix A.
9. Please refer to Attachment II, including Appendix D and Appendix E for additional pathways analyzed for this submittal. These identified pathways will be analyzed prior to all subsequent disposals to insure doses are maintained within prescribed limits, i.e., 1 mrem/year to the maximally exposed individual and 5 mrem/year to the inadvertent intruder.
10. A limiting concentration level for the sludge contained in the storage tank is discussed, in Attachment II, Appendix F. Since this application is for multiple applications over multiple years, Attachment II, Appendix F also addresses an activity limit.

ATTACHMENT II

COMPLETE ANALYSIS AND EVALUATION

POINT BEACH NUCLEAR PLANT

10 CFR 20.302(a) APPLICATION

1.0 Purpose

By this submittal Wisconsin Electric Power Company requests approval of the U.S. Nuclear Regulatory Commission for a proposed procedure to dispose of sewage treatment sludge containing trace quantities of radionuclides generated at the Point Beach Nuclear Plant. This request is submitted in accordance with the provisions of 10 CFR 20.302(a).

2.0 Waste Description

The waste involved in this disposal process consists of the residual solids remaining in solution upon completion of the aerobic digestion sewage treatment process utilized at PBNP. The PBNP sewage treatment plant is used to process waste water from the plant sanitary and potable water systems. These systems produce non-radioactive waste streams with the possible exception of wash basins located in the radiologically controlled area of the plant. These wash basins are believed to be the primary source of the extremely small quantities of radionuclides in the sludge.

The sewage sludge generated at PBNP is allowed to accumulate in the sewage plant digester and aeration basin. Two to four times annually, depending on work activities and corresponding work force at PBNP, the volume of the sludge in the digester and aeration basin needs to be reduced to allow continued efficient operation of the treatment facility. The total volume of sludge removed during each disposal operation is typically on the order of 15,000 gallons. The maximum capacity for the entire PBNP treatment facility and hence the maximum disposal volume is about 30,000 gallons. In the case of a maximum capacity disposal, doses would not necessarily increase in proportion to the volume, since more than one disposal site may be used.

Trace amounts of radionuclides have been identified in PBNP sludge currently being stored awaiting disposal. The radionuclides identified and their concentrations in the sludge are summarized below:

<u>Nuclide</u>	<u>Concentration ($\mu\text{Ci/cc}$)</u>
Co-60	2.33E-07
Cs-137	1.50E-07

The total activity of the radionuclides in the stored sludge, based on the identified concentrations and a total volume of 15,000 gallons of sewage sludge, are as follows:

<u>Nuclide</u>	<u>Activity (μCi)</u>
Co-60	13.2
Cs-137	8.5

These concentrations and activities are consistent with expected values based on prior analyses of sewage sludge. The radionuclide concentration in the sewage sludge has remained relatively constant during sampling conducted since December 30, 1983. A detailed summary of the results of this sampling program are contained in Appendix A for your review.

In addition to monitoring for the radionuclide content of the sludge, the WDNR requires several other physical and chemical properties of the sludge to be determined. These properties are the percent total solids, percent total nitrogen, percent ammonium nitrogen, pH, percent total phosphorus, percent total potassium, cadmium, copper, lead, nickel, mercury, zinc, and boron. An example of a typical sludge sample analysis is included in Appendix B.

3.0 Disposal Method

In the context of this application, Wisconsin Electric commits to the following methodology. No distinction is made or intended between "shall" or "will", as used in the descriptions contained in this section.

3.1 Transport of Sludge

The method used to dispose of the sludge shall utilize a technique approved by the WDNR. The process of transporting the sewage sludge for disposal involves pumping the sludge from the PBNP sewage treatment plant storage tanks into a truck mounted tank. The truck mounted tank shall be required to be maintained tightly closed to prevent spillage while in transit to the disposal site. The sludge shall be transported to one or more of the six sites approved by the WDNR for land application of the sewage sludge from PBNP.

3.2 Disposal Procedure

The radionuclide concentrations in the sludge shall be determined prior to each disposal by obtaining three representative samples from each of the sludge storage tanks. The sludge contained in the sludge tanks is prevented from going septic by a process known as complete mix and continuous aeration. This process completely mixes the sludge allowing for representative samples to be obtained.

The samples shall be counted utilizing a GeLi detector and multi-channel analyzer with appropriate geometry. The detection system is routinely calibrated and checked to ensure the lower limits of detection are within values specified in the Radiological Effluent Technical Specifications (RETS).

To insure the samples are representative of the overall concentration in the storage tanks, the radionuclide concentration determination for each of the three samples shall be analyzed to insure each sample is within two standard deviations of the average value of the three samples. If this criteria is not met, additional samples will be obtained and analyzed to insure a truly representative radionuclide concentration is utilized for dose calculations and concentration limit determinations. The average of all statistically valid concentration determinations will be utilized in determining the storage tank concentration values.

Prior to disposal the waste stream will be monitored to determine the physical and chemical properties of the sludge, as discussed in the last paragraph of Section 2.0, Waste Description. The results will be compared to State of Wisconsin limits to insure the sludge does not pose a chemical hazard to people or to the environment.

The radionuclides identified in the sludge, along with their respective concentrations, will be compared to concentration limits prior to disposal. The methodology discussed in Appendix F will be used in determining compliance with the proposed concentration limit. The total activity of the proposed disposal will be compared to the proposed activity limit as described in Appendix F.

If the concentration and activity limit criteria are met, the appropriate exposure pathways (as described in Appendix D) will be evaluated prior to each application of sludge. These exposures will be evaluated to insure the dose to the maximally exposed individual will be maintained less than 1 mrem/year and the dose to the inadvertent intruder is maintained less than 5 mrem/year. The exposures will be calculated utilizing the methodology used in Appendix E, including the current activity to be landspread along with the activity from all prior disposal. The remaining radioactivity from prior disposals will be corrected for radiological decay prior to performing dose calculations for the meat, milk, and vegetable ingestion pathways, the inhalation of resuspended radionuclides, and all pathways associated with a release to Lake Michigan. The residual radioactivity will be corrected for radiological decay and, if appropriate, the mixing of the radionuclides in the soil by plowing prior to performing external exposure calculations.

The sewage sludge is applied on the designated area of land utilizing the WDNR approved technique and adhering to the following requirements of WPDES Permit Number WI-0000957-3.

- ° Discharge to the land disposal system shall be limited so that during surface spreading all of the sludge and any precipitation falling onto or flowing onto the disposal field shall not overflow the perimeter of the system.
- ° Sludge shall not be land spread on land with a slope greater than 12%. During the period from December 15 through March 31 sludge shall not be land spread on land with a slope greater than 6% unless the wastes are injected immediately into the soil.
- ° Sludge shall not be surface spread closer than 500 feet from the nearest inhabited dwelling except that this distance may be reduced with the dwelling owner's written consent.
- ° Sludge shall not be spread closer than 1,000 feet from a public water supply well or 250 feet from a private water supply well.
- ° Sludge shall not be land spread within 200 feet of any surface water unless a vegetative buffer strip is maintained between the surface watercourse and the land spreading system, in which case a minimum separation distance of at least 100 feet is required between the system and the surface watercourse.

- ° Depth to groundwater and bedrock shall be greater than 3 feet from the land surface elevation during use of any site.
- ° Sludge shall not be land spread in a floodway.
- ° Sludge shall not be land spread within 50 feet of a property line road or ditch unless the sludge is incorporated with the soil, in which case a minimum separation distance of at least 25 feet is required.
- ° The pH of the sludge-soil mixture shall be maintained at 6.5 or higher.
- ° Low areas of the approved fields, subject to seasonally high groundwater levels, are excluded from the sludge application.
- ° Crops for human consumption shall not be grown on the land for up to one year following the application of the sludge.
- ° The sludge shall be plowed, disked, injected or otherwise incorporated into the surface soil layer at appropriate intervals.

The flexibility implied in the latter provision for soil incorporation is intended to allow for crops which require more than a one year cycle. For the Point Beach disposal sites, alfalfa is a common crop which is harvested for several years after a single planting. Sludge disposal on an alfalfa plot constitutes good fertilization, but the plot cannot be plowed without destroying the crop. The alfalfa in this case aids in binding the layer of sludge on the surface of the plot. At a minimum, however, plowing (or disking or other method of injection and mixing to a nominal depth of 6 inches) shall be done prior to planting any new crop, regardless of the crop.

3.3 Administrative Procedures

Complete records of each disposal will be maintained. These records will include the concentration of radionuclides in the sludge, the total volume of sludge disposed, the total activity, the plot on which the sludge was applied, the results of the chemical composition determinations, and all dose calculations.

The annual disposal rate for each of the approved land spread sites will be limited to 4,000 gallons/acre, provided WDNR chemical composition, NRC dose guidelines, and concentration and activity limits are maintained within the appropriate values.

The farmer leasing the site used for the disposal will be notified of the applicable restrictions placed on the site due to the land spreading of sewage sludge.

4.0 Evaluation of Environmental Impact

4.1 Site Characteristics

4.1.1 Site Topography

The disposal sites are located in the Town of Two Creeks in the northeast corner of Manitowoc County, Wisconsin, on the

west shore of Lake Michigan about 30 miles southeast of the center of the city of Green Bay, and 90 miles NNE of Milwaukee. This site is located at longitude 87° 32.5'W and latitude 44° 17.0'N. The six sites are on property owned and controlled by Wisconsin Electric and are within or directly adjacent to the Point Beach site boundary. The sites are described below and are outlined on the map contained in Appendix C as Figure 3.

Site No. PB-01 - The approximately 15 acres located in the NE 1/4 of the NE 1/4 of Section 23, T. 21N - R. 24E.

Site No. PB-02 - The approximately 20 acres located in the SE 1/4 of the SE 1/4 of Section 14, T. 21N - R. 24E.

Site No. PB-03 - The approximately 5 acres located in the NW 1/4 of Section 24, T. 21N - R. 24E.

Site No. PB-04 - The approximately 5 acres located in the NW 1/4 of the SW 1/4 of Section 24, T. 21N - R. 24E.

Site No. PB-05 - The approximately 5 acres located in the NE 1/4 of the NW 1/4 of Section 25, T. 21N - R. 24E.

Site No. PB-06 - The approximately 5 acres located in the NE 1/4 of the SW 1/4 of Section 14, T. 21N - R. 24E.

The overall ground surface at the site of the Point Beach Nuclear Plant is gently rolling to flat with elevations varying from 5 to 60 feet above the level of Lake Michigan. Subdued knob and kettle topography is visible from aerial photographs. The land surface slopes gradually toward the lake from the higher glacial moraine areas west of the site. Higher ground adjacent to the lake, however, diverts the drainage to the north and south.

The major surface drainage features are two small creeks which drain to the north and south. One creek discharges into the lake about 1500 feet above the northern corner of the site and the other near the center of the site. During the spring, ponds of water may occupy the shallow depressions. As mentioned in Section 3.2, Disposal Procedure, these low areas are excluded from the sludge application.

A site topographic map covering details out to a 5 mile radius may be found in the FSAR at Figure 2.2-3 and is included in Appendix C as Figure 2.

The disposal of sewage sludge at these six sites will have no impact on the topography of this area.

4.1.2 Site Geology

Prior to construction of the Point Beach Nuclear Plant, an evaluation of the geological characteristics of the area in and surrounding the site was made. The geologic structure of the region is essentially simple. Gently dipping sedimentary rock

strata of Paleozoic age outcrop in a horseshoe pattern around a shield of Precambrian crystalline rock which occupies the western part of the region. The site is located on the western flank of the Michigan Basin, which is a broad downwarp ringed by discontinuous outcrops of more resistant formations. The bedrock formations are principally limestones, dolomites, and sandstones with subordinate shale layers. The rocks form a succession of extensive layers that are relatively uniform in thickness. The bedrock strata dip very gently towards Lake Michigan at rates from 15 to 35 feet per mile.

The uppermost bedrock under the site is Niagara Dolomite. Bedrock does not outcrop on the site but is covered by glacial till and lake deposits. The soils contain expansive clay minerals and have moderately high base exchange capacity.

In the area of the site, the overburden soils are approximately 70 to 100 feet in thickness. Although the character of the glacial deposits may vary greatly within relatively short distances, a generalized section through the overburden soils adjacent to Lake Michigan at the site consists of the following sequence:

1. An upper layer of brown clay silt topsoil underlain with several feet of brown silty clay with layers of silty sand;
2. A layer of 20 feet of reddish-brown silty clay with some sand and gravel and occasional lenses of silt;
3. A layer of 25 feet of reddish-brown silty clay with layers of silty sand and lenses of silt;
4. A layer of 50 feet of reddish-brown silty clay with some sand and gravel, the lower portion of which contains gravels, cobbles, and boulders resting on a glacial eroded surface of Niagara dolomite bedrock.

Site drainage is poor due to the high clay content of the soil combined with the pock-marked surface. Additional information on site geology may be found in Section 2.8 of the FSAR.

The use of these sites for disposal of sewage sludge will not impact the geology of the area.

4.2 Area Characteristics

4.2.1 Meteorology

The climate of the site region is influenced by the general storms which move eastward along the northern tier of the United States and by those which move northeastward from the southwestern part of the country to the Great Lakes. This continental type of climate is modified by Lake Michigan. During spring, summer, and fall months the lake temperature differs markedly from the air temperature. Wind shifts from westerly to easterly directions produce marked cooling of day-time

temperatures in spring and summer. In autumn the relatively warm water to the lake prevents night-time temperatures from falling as low as they do a few miles inland from the shoreline. Summer time temperatures exceed 90°F for six days on the average. Freezing temperatures occur 147 days and below zero on 14 days of the winter on the average. Rainfall averages about 28 inches per year with 55 percent falling in the months of May through September. Snowfall averages about 45 inches per year. Sludge spreading shall be managed such that the surface spreading together with any precipitation falling on the field shall not overflow the perimeter of the field. Additional information on site meteorology may be found in Section 2.6 of the FSAR.

There will be no impact on the meteorology of the area due to the disposal of the sewage sludge.

4.2.2 Hydrology

The dominant hydrological feature of this site is Lake Michigan, one of the largest of the Great Lakes. The normal water level in Lake Michigan is approximately 580 feet above mean sea level. In the general vicinity of the site, the 30 foot depth contour is between 1 and 1-1/2 miles offshore and the 60 foot contour is 3 to 3-1/2 miles off shore. The disposal sites are twenty or more feet above the normal lake level. There is no record that the sites have been flooded by the lake during modern times. There are no rivers or large streams which could create a flood hazard at or near the sites.

The subsurface water table at the Point Beach site has a definite slope eastward toward the lake. The gradient indicated by test drilling on the site is approximately 30 feet per mile. It is therefore extremely unlikely that any release of radioactivity on the site could spread inland. Furthermore, the rate of subsurface flow is small due to the relative impervious nature of the soil and will not promote the spread of releases. Further information on site hydrology is detailed in the PBNP FSAR Section 2.5.

There will be no adverse impact on hydrology of the area due to disposal of sewage sludge by land spreading.

4.3 Water Usage

4.3.1 Surface Water

Lake Michigan is used as the source of potable water supplies in the vicinity of the site for the cities of Two Rivers (12 miles south), Manitowoc (16 miles south), Sheboygan (40 miles south), and Green Bay (intake at Rostok 1 mile north of Kewaunee, 13 miles north). No other potable water uses are recorded within 50 miles of the site along the lake shore. All public water supplies drawn from Lake Michigan are treated in purification plants. The nearest surface water used for drinking other than Lake Michigan are the Fox River 30 miles NW and

Lake Winnebago 40 miles W of the site.

Lake Michigan is also utilized by various recreational activities, including fishing, swimming and boating.

There will be no impact on surface water usage due to the disposal of sewage sludge.

4.3.2 Ground Water

Ground water provides the remaining population with potable supplies. Public ground water supplies within a 20 mile radius of the site are listed in Table 2.5-3 of the FSAR. Additional wells for private use are in existence throughout the region. The location of private wells within a two mile radius of PBNP are indicated on Figure 3, Appendix C.

The potable water for use at the Point Beach Nuclear Plant is drawn from a 257 feet deep well located at the southwest corner of the plant yard. Water from this well is routinely sampled as part of the environmental monitoring program.

There will be no adverse impact on ground water usage due to the disposal of sewage sludge.

4.4 Land Usage

Manitowoc County, in which the site is located, and the adjacent counties of Kewaunee, Brown, Calumet, and Sheboygan are predominantly rural. Agricultural pursuits account for approximately 90% of the total county acreage. With the exception of the Kewaunee Nuclear Plant located 4.5 miles north, the region within a radius of five miles of the site is presently devoted exclusively to agriculture. Dairy products and livestock account for 85% of the counties' farm production, with field crops and vegetables accounting for most of the remainder. The principal crops are grain corn, silage corn, oats, barley, hay, potatoes, green peas, lima beans, snap beans, beets, cabbage, sweet corn, cucumbers, and cranberries. Within the township of Two Creeks surrounding the site (15 sq. miles), there are about 800 producing cows on about 40 dairy farms. Some beef cattle are raised 2.5 miles north of the site. Cows are on pasture from the first of June to late September or early October. During the winter, cows are fed on locally produced hay and silage. Of the milk produced in this area, about 25 percent is consumed as fluid milk and 50 percent is converted to cheese, with the remainder being used in butter making and other by-products.

It has been the policy of Wisconsin Electric to permit the controlled use of crop land and pasture land on company owned property. No direct grazing of dairy or beef cattle or other animals is permitted on these company owned properties. Crops intended for human consumption shall not be grown on the disposal sites for at least one year following the application of the sludge.

The proposed land application of sewage sludge will not have any direct effect on the adjacent facilities. Additional land use

information may be found in Section 2.4 of the FSAR.

4.5 Radiological Impact

The rate of sewage sludge application on each of the six proposed sites will be monitored to insure doses are maintained within applicable limits. These limits are based on NRC Nuclear Reactor Regulation (NRR) staff proposed guidance (described in AIF/NESP-037, August, 1986). These limits require doses to the maximally exposed member of the general public to be maintained less than 1 mrem/year due to the disposal material. In addition, NRR guidance requires doses of less than 5 mrem/year to an inadvertent intruder.

To assess the doses received by the maximally exposed individual and the inadvertent intruder, six credible pathways have been identified for the maximally exposed individual and four credible pathways for the inadvertent intruder. The identified credible pathways are described in Appendix D.

Calculations detailed in Appendix E demonstrate the disposal of the currently stored PBNP sewage sludge would remain below these limits. The total annual exposure to the maximally exposed individual based on the identified exposure pathways is equal to 0.072 mrem. The dose to a hypothetical intruder assuming an overly conservative occupancy factor of 100% is calculated to be 0.115 mrem/year. By definition, the inadvertent intruder would not be exposed to the processed food pathways (meat and milk).

The calculational methodology used in determining doses for the proposed disposal of sludge stored at PBNP shall be utilized prior to each additional land application to insure doses are maintained less than those proposed by NRR. This calculation will include radionuclides disposed of in previous sludge applications. The activity from these prior disposals will be corrected for radiological decay prior to performing dose calculations for the meat, milk, and vegetable ingestion pathways, the inhalation of resuspended radionuclides, and all pathways associated with a potential release to Lake Michigan. The residual radioactivity will be corrected for radiological decay and, if applicable, the mixing of radionuclides in the soil prior to performing external exposure calculations. In addition, the dose to a farmer potentially leasing more than one application site will be addressed by summing the doses received from the external exposure from a ground plane source and resuspension inhalation pathways for each leased site. In addition, the maximum site specific dose due to the other pathways identified in Appendix D, will be utilized in the total exposure estimation.

5.0 Radiation Protection

The disposal operation will follow the applicable PBNP procedures to maintain doses as low as reasonably achievable. Technical review and guidance will be provided by the PBNP Superintendent - Health Physics.

APPENDIX A

SUMMARY OF RADIOLOGICAL ANALYSES
OF SEWAGE SLUDGE SINCE DECEMBER 30, 1983

<u>Sample Date</u>	<u>Tank</u>	<u>Tank Volume (Gallons)</u>	<u>Radionuclide</u>	<u>Concentration (μCi/cc)</u>
12-30-83	Digester	8400	Co-58	5.58E-07
			Co-60	1.87E-06
			Cr-51	4.88E-07
			Cs-134	1.59E-07
			Cs-137	3.57E-07
4-06-84	Digester	7560	Co-60	7.89E-07
	Aeration	6667	Co-60	1.87E-07
12-05-84	Digester	7560	Co-58	1.75E-07
	Aeration	6667	Co-60	8.29E-07
6-03-85	Digester	7560	Co-60	8.29E-07
			Cs-137	2.46E-07
	Aeration	6700	Co-60	3.27E-07
			Cs-137	1.33E-07
4-10-86	Digester	7560	Co-60	6.79E-07
			Cs-137	1.72E-07
			Mn-54	4.91E-08
			Co-60	1.65E-07
11-04-86	Digester Aeration & Clarifier	7560	Co-58	8.04E-08
		25100	Co-58	1.37E-07
			Co-60	2.18E-07
			Cs-137	1.64E-07

APPENDIX B

CHEMICAL COMPOSITION ANALYSIS
OF SEWAGE SLUDGE

Wastewater Treatment Plant Sludge

Please complete this form and send to the Department of Natural Resources appropriate District/Area Office. Keep one copy for your records.
For additional forms, please contact your appropriate District/Area Office.

PERMITTEE Wisconsin Electric Power Company	WIDES PERMIT NUMBER WI 00 0 2 9 5 7
STREET OR ROUTE 231 W. Michigan Street	COUNTY Milwaukee
CITY, STATE, ZIP CODE Milwaukee, WI 53203	TELEPHONE NUMBER (INCLUDE AREA CODE) 414-277-2153

1. Please report laboratory testing results for the following parameters:

*Parameter	Abbreviation	Result	*Parameter	Abbreviation	Result
Total Solids, %	—	<u>1.63</u>	Chromium, ppm	Cr	<u>—</u>
Total Nitrogen, %	TOT N	<u>1.0</u>	Copper, ppm	Cu	<u>2200</u>
Ammonium Nitrogen, %	NH ₄ ⁺ -N	<u>0.34</u>	Lead, ppm	Pb	<u>190</u>
Total Phosphorus, %	P	<u>< 0.01</u>	Mercury, ppm	Hg	<u>3.0</u>
Total Potassium, %	K	<u>0.25</u>	Nickel, ppm	Ni	<u>12</u>
Arsenic, ppm	As	<u>1.0</u>	Zinc, ppm	Zn	<u>2800</u>
Cadmium, ppm	Cd	<u>12.</u>	pH	—	<u>7.0</u>


*Suggested analysis procedures for the above parameters can be found in NR 218, analytical tests and procedures, Wisconsin Administrative Code. All parameters other than percent solids and pH shall be reported on a dry weight basis.

2. What is the name of the laboratory that did the analysis and when was it performed?

Laboratory Name Wisconsin Electric Power Co. Date sent to lab April 12, 1983
Laboratory Services Division


3. Where at the treatment plant was the sample taken? From sludge holding tank prior to hauling


When was the sample taken? April 12, 1983

SIGNATURE 	TITLE Water Quality Engineer	DATE <u>—</u>
--	--	------------------

APPENDIX C

SITE MAPS

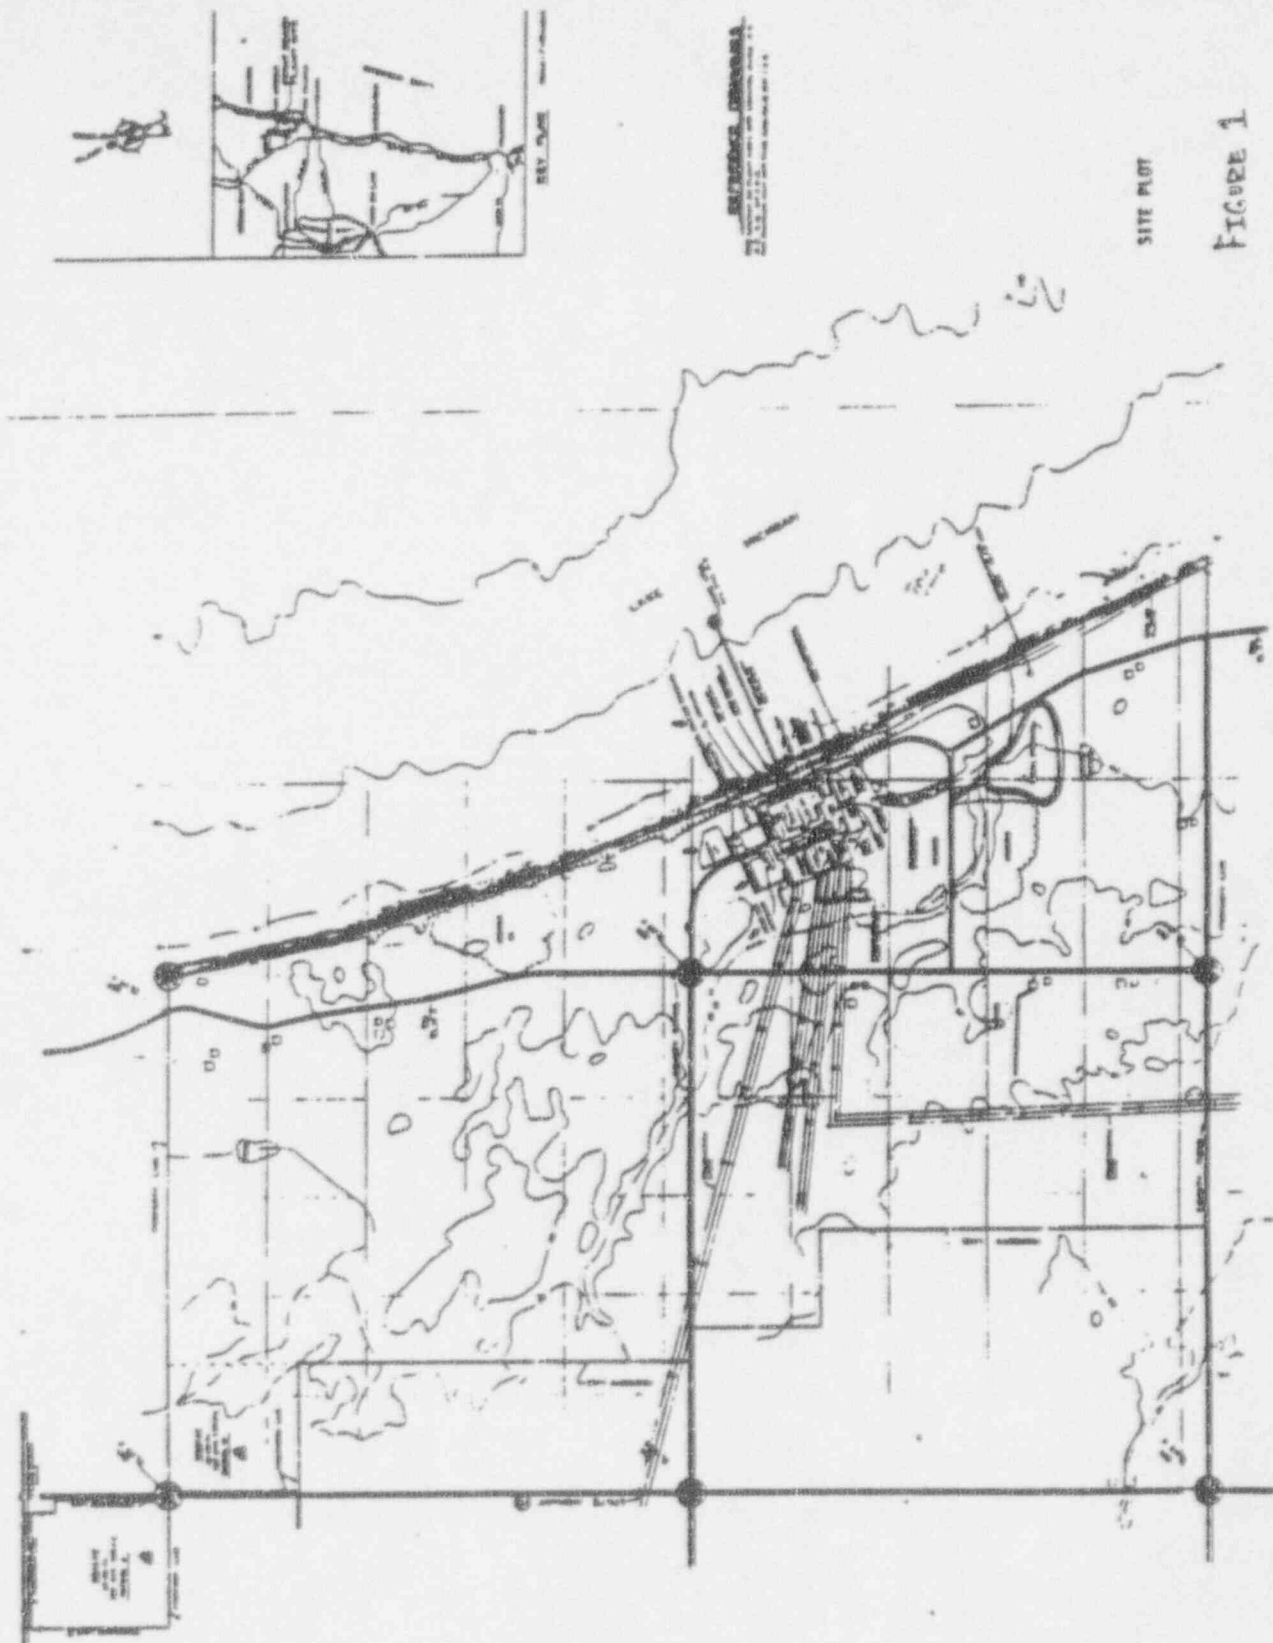

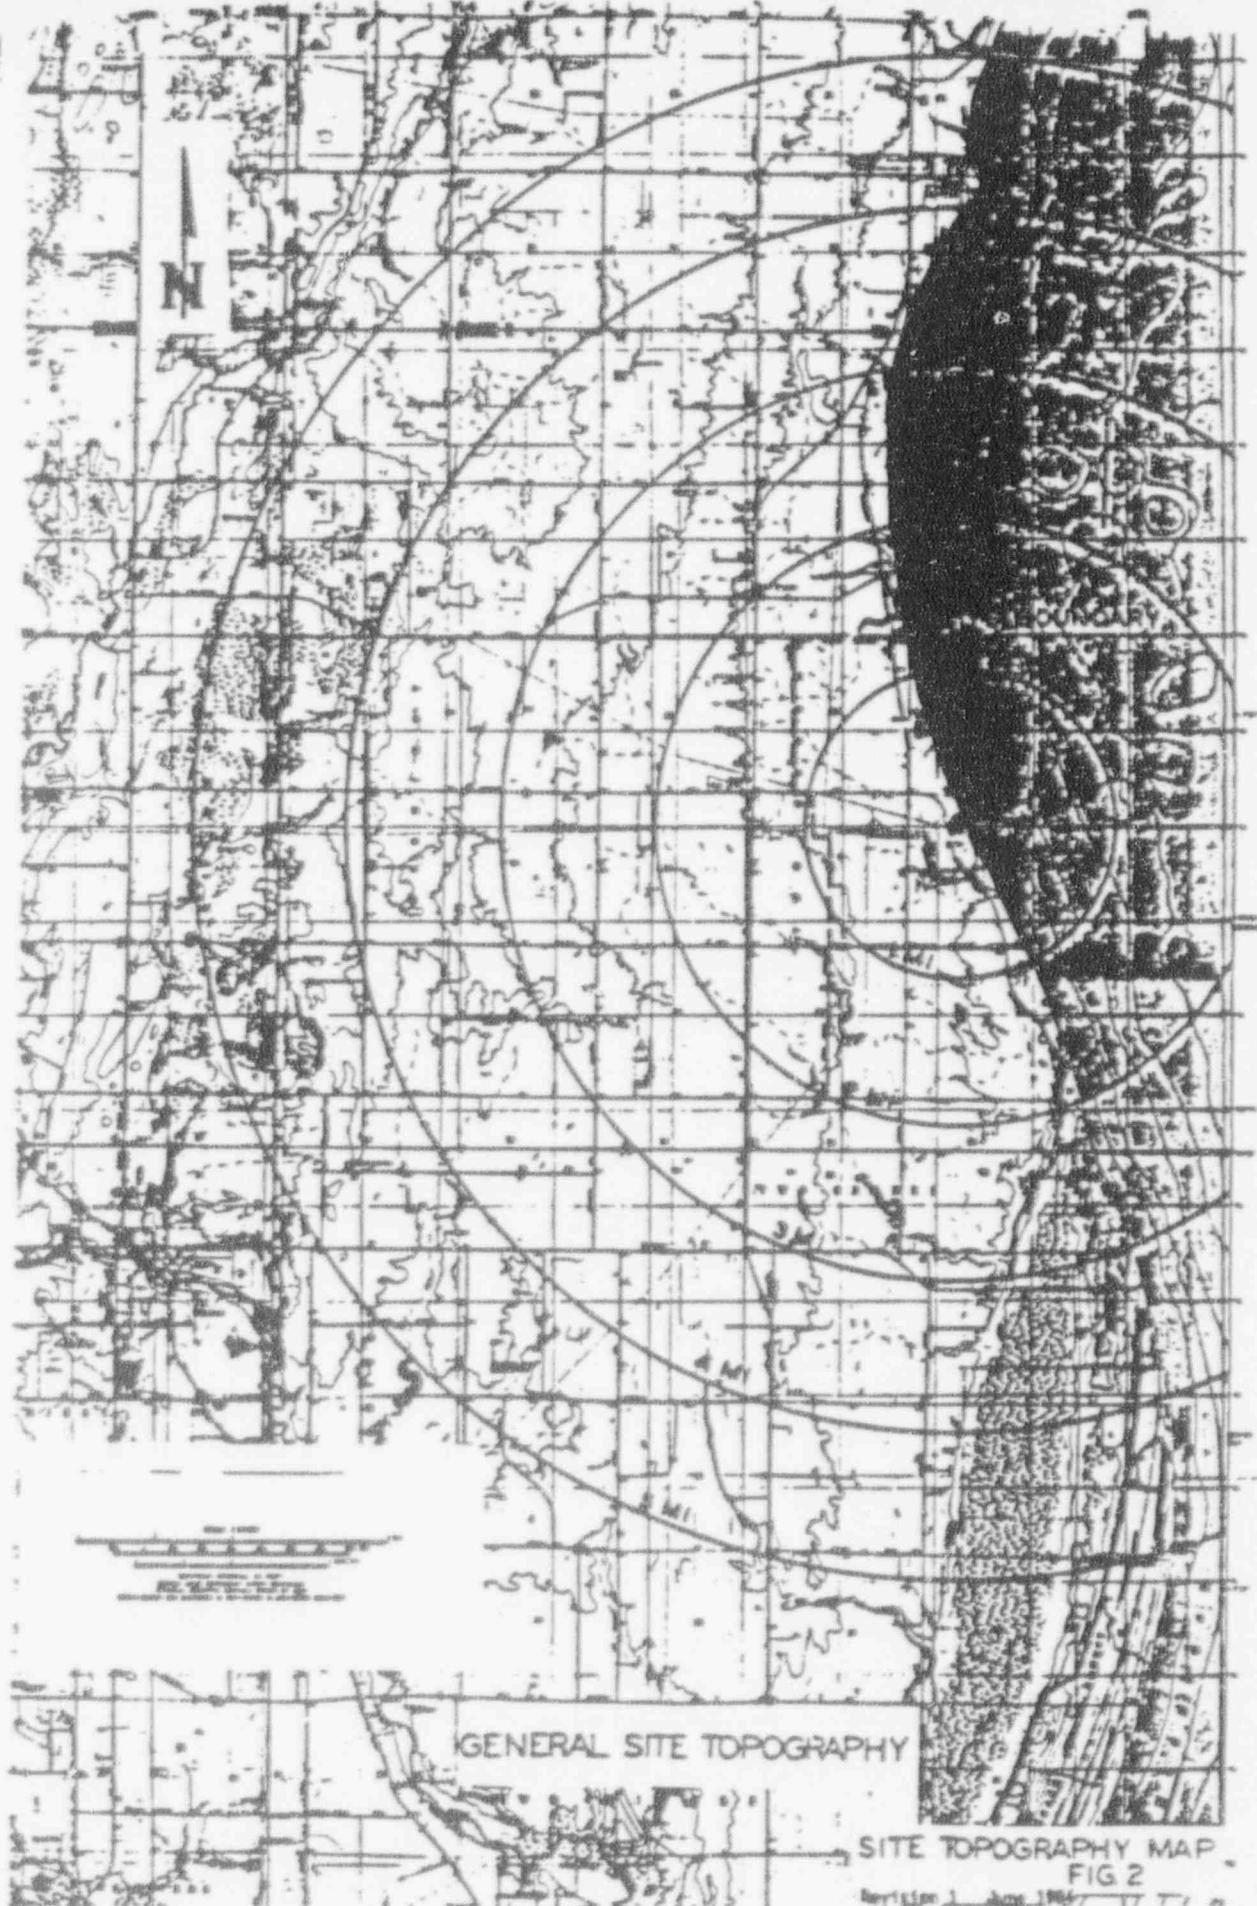

GENERAL SITE TOPOGRAPHY

SITE TOPOGRAPHY MAP
FIG 2

Revised 1 Aug 1967 TT 1

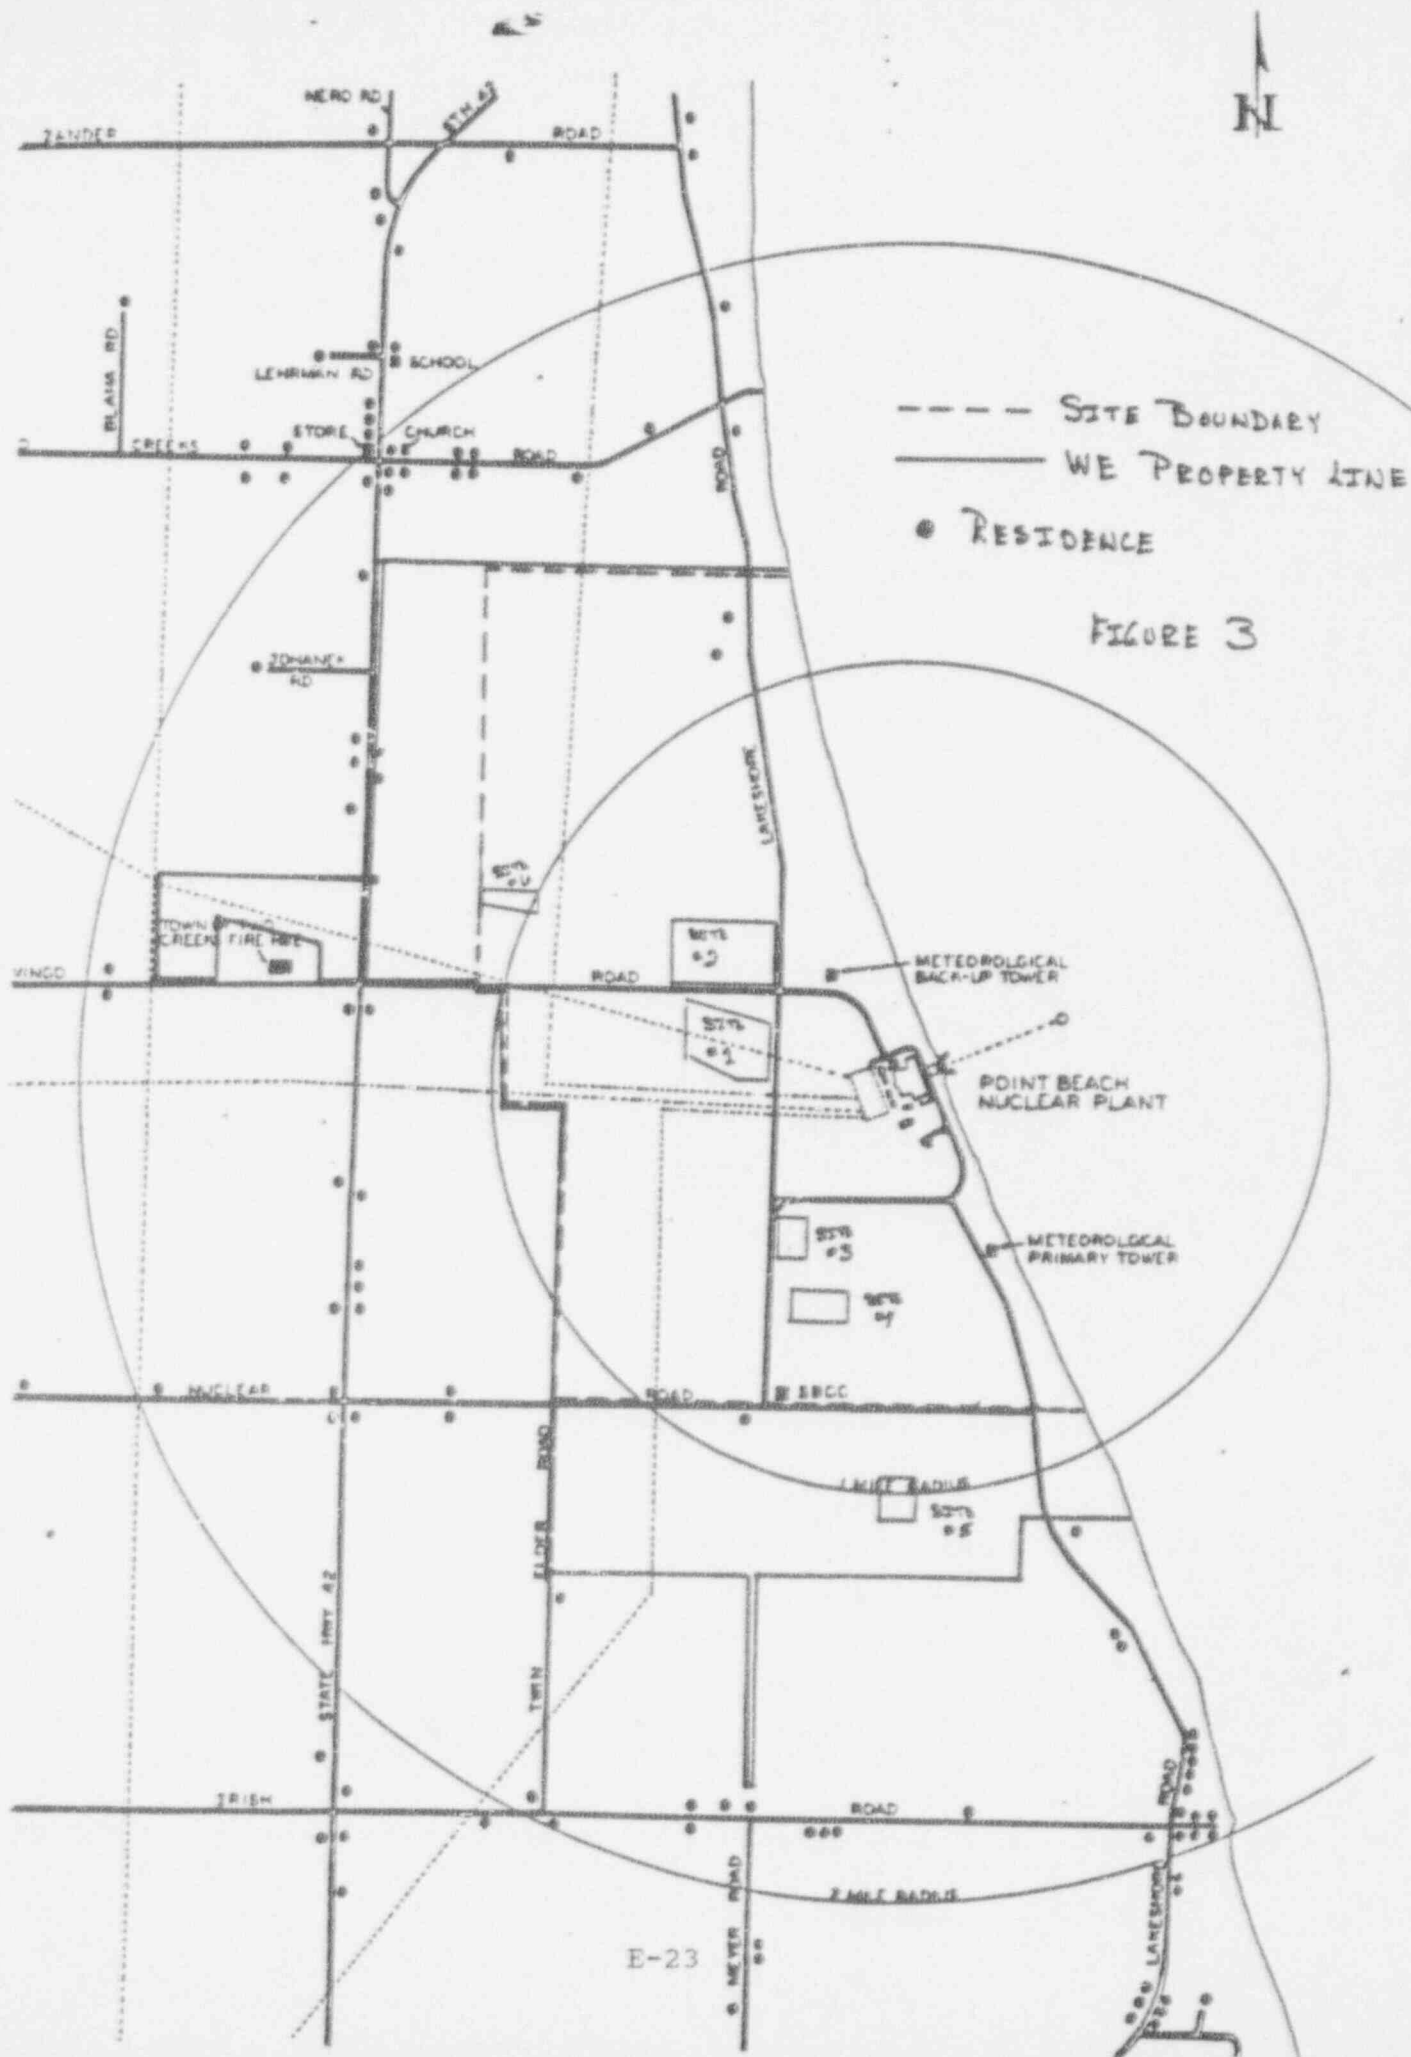


FIGURE 3

APPENDIX D

EXPOSURE PATHWAYS

I. EXPOSURE PATHWAYS - MAXIMALLY EXPOSED INDIVIDUAL

1. External whole body exposure due to a ground plane source of radionuclides.
2. Milk ingestion pathway from cows fed alfalfa grown on plot.
3. Meat ingestion pathway from cows fed alfalfa grown on plot.
4. Vegetable ingestion pathway from vegetables grown on plot.
5. Inhalation of radioactivity resuspended in air above application site.
6. Pathways associated with a release to Lake Michigan. Ingestion of potable water at Two Rivers, Wisconsin municipal water supply, ingestion of fish from edge of initial mixing zone of radionuclide release, ingestion of fresh and stored vegetables irrigated with water source as Lake Michigan, ingestion of milk and meat from cows utilizing Lake Michigan as drinking water source, swimming and boating activities at edge of initial mixing zone, and shoreline deposits.

II. EXPOSURE PATHWAYS - INADVERTENT INTRUDER

1. External whole body exposure due to a ground plane source of radionuclides.
2. Vegetable ingestion pathway from vegetables grown on plot.
3. Inhalation of radioactivity resuspended in air above application site.
4. Pathways associated with a release to Lake Michigan. Ingestion of potable water at Two Rivers, Wisconsin municipal water supply, ingestion of fish from edge of initial mixing zone of radionuclide release, ingestion of fresh and stored vegetables irrigated with water source as Lake Michigan, ingestion of milk and meat from cows utilizing Lake Michigan as drinking water source, swimming and boating activities at edge of initial mixing zone, and shoreline deposits.

The milk and meat pathways are not included in calculating the dose to the inadvertent intruder. The doses due to these pathways are calculated based on feeding the cows alfalfa grown on the sludge applied land. Since direct grazing on these lands is prohibited, the alfalfa must be cropped prior to being used as feed. This effectively removes the availability of these pathways to the inadvertent intruder, who by definition occupies the sludge applied land continuously.

III. GROUND WATER PATHWAY

The ingestion of groundwater is not a credible exposure pathway. The two factors contributing to this determination are as follows:

1. The site map in Appendix C, Figure 3 details the spatial relationship between the proposed disposal sites and the local ground water wells. The flow gradient of ground water was determined for the PBNP FSAR to be towards Lake Michigan. Reviewing the sites and local wells shows no private well located in the path of radionuclide migration towards Lake Michigan.

The PBNP site well is located on the plant site, potentially in a path of radionuclide migration. The PBNP well is routinely sampled as a requirement of the PBNP environmental monitoring program.

2. The cation exchange capacity (CEC) of the soils at each site has been determined.

<u>Site</u>	<u>Cation Exchange Capacity (MEQ/100g)</u>
1	16
2	11
3	11
4	10
5	8
6	9

The cation exchange capacity of soil is dependent on the valance of the radionuclides and is determined by the relation:

$$\text{MEQ} = \frac{\text{ATOMIC WEIGHT}}{\text{VALANCE}} * 1.0\text{E-}03$$

<u>Radionuclide</u>	<u>Valance</u>	<u>CEC (MEQ/100g)</u>
Co-60	+2	3.00E-02
Co-58	+2	2.90E-02
Cs-137	+1	1.37E-01
Mn-54	+2	2.70E-02
Cr-51	+3	1.70E-02
Cs-134	+1	1.34E-01

Using the values for Cs-137 and site 5 which has the lowest CEC, the total exchange capacity of the soil is

$$\frac{1.10 \text{ grams of Cs-137}}{100 \text{ grams of soil}}$$

Calculating the specific activity of Cs-137,

$$\begin{aligned} \text{Specific Activity} &= \frac{3.578\text{E}+05}{T_{1/2}(\text{yrs.}) \cdot \text{ATOMIC MASS}} = \frac{3.578\text{E}+05}{30 \cdot 137} \\ &= 87.1 \text{ Ci/gram} \end{aligned}$$

The cation exchange capacity of the soil expressed in the number of Curies of radionuclide per 100 grams of soil is

$$\frac{95.8 \text{ Ci Cs-137}}{100 \text{ grams of soil}}$$

Since the proposed disposal of sewage sludge contains quantities of radionuclides on the order of 10-100 μCi the soil at each site has the capacity to effectively eliminate the migration of the radionuclide to ground water.

APPENDIX E

EXPOSURE ANALYSIS

GENERAL ASSUMPTIONS

1. Sewage sludge is uniformly applied over plot acreage.
2. Sewage sludge is applied to one of the 5 acre plots, site PB-03, PB-04, PB-05, or PB-06. (Assuming the smallest site size is conservative for the calculation methodology herein.)
3. Based on the sewage sludge currently stored at PBNP, the following data is used in the calculations.

Radionuclide	Sludge Volume (Gallons)	Sludge Volume (cm ³)	Activity (μ Ci)	Concentration (μ Ci/cm ³)	Ground Plane Concentration (μ Ci/cm ²)
Co-60	15,000	5.68E+07	13.2	2.33E-07	6.53E-08
Cs-137	15,000	5.68E+07	8.5	1.50E-07	4.21E-08

I. CALCULATION OF EXTERNAL EXPOSURES

A. Specific Assumptions

1. Conservatively assume radioactivity remains on surface of land plot. Calculation ignores any plowing or mixing of radioactivity within soil. Calculations for the proposed disposal will therefore ignore self absorption or shielding from soil.

The external exposure at the application site due to prior disposals will be calculated utilizing the methodology in Appendix G and added to that calculated for the proposed disposal.

2. The plots are owned by Wisconsin Electric and have been approved by the Wisconsin Department of Natural Resources (DNR) as disposal sites. The land is leased and potentially farmed. Occupancy of the land can be realistically expected only during plowing, planting and harvesting. Occupancy has been estimated to be 64 hours per year.

B. Summary of Calculational Methodology

1. Calculate ground plane radionuclide concentrations in pCi/cm².
2. The dose from a plane of uniformly deposited radionuclides is calculated using Regulatory Guide 1.109, Revision 1, Appendix C, Formula C-2.
3. Dose rates were calculated assuming continuous occupancy then adjusted for realistic occupancy factors.

C. External Exposure Rate Calculations

The dose from a plane of uniformly deposited radionuclides is calculated using Regulatory Guide 1.109, Revision 1, Appendix C, formula C-2

$$D_j^G(r, \theta) = 8760 S_F \sum_i C_i^G(r, \theta) DFG_{ij}$$

where

$$D_j^G(r, \theta) = \text{yearly dose}$$

$$8760 = \text{hours per year}$$

$$S_F = 1.0, \text{ since no dose reduction due to residential shielding is applicable.}$$

$$C_i^G(r, \theta) = \text{ground plane radionuclide concentration (pCi/m}^2\text{)}$$

$$DFG(i, j) = \text{external dose factor for standing on contaminated ground as given in Table E-6 of Regulatory Guide 1.109, Revision 1.}$$

Radionuclide	γ Dose Factor (mrem/hr per pCi/m ²)	Ground Plane Concentration (pCi/cm ²)	Ground Plane Concentration (pCi/m ²)	γ Dose Rate (mrem/yr)
Co-60	1.70E-08	6.53E-08	6.53E+02	9.72E-02
Cs-137	4.20E-09	4.21E-08	4.21E+02	1.55E-02

TOTAL: 1.13E-01 mrem/year

These calculated dose rates assume continuous occupancy. In reality, these sites will be occupied only during plowing, planting, and harvesting. Assuming an occupancy of 2 hours per day, 1 day per week, and 32 weeks (8 month growing season) per year, the occupancy factor becomes

$$2 \text{ hr/day} * 1 \text{ day/week} * 32 \text{ weeks/yr} * 1/8760 \text{ hours/yr} = 7.3E-03.$$

EXTERNAL EXPOSURE DOSE RATE (mrem/year)

Radionuclide	Continuous Occupancy	Realistic Occupancy
Co-60	9.72E-02	7.10E-04
Cs-137	1.55E-02	1.13E-04
TOTAL:	1.13E-01	8.23E-04

11. CALCULATION OF MEAT AND MILK INGESTION PATHWAY EXPOSURES

A. Specific Assumptions

1. All feed consumed by cow is grown on sludge applied acreage.
2. All meat and milk consumed by human is from cattle exclusively fed feed from sludge applied land.
3. Stable element transfer coefficients (B_{iv}) are utilized from Regulatory Guide 1.109 to estimate the fraction of radioactivity which is transferred from the soil to the feed.

<u>Radionuclide</u>	<u>B_{iv}</u>
Co-60	9.4E-03
Cs-137	1.0E-02

4. Alfalfa has typically been grown on the plots. Soil tests have indicated a minimum alfalfa yield of 4.1 tons per acre can be expected.

B. Summary of Calculational Methodology

1. The concentration of radionuclides in feed grown on the disposal plot is estimated. Transfer coefficients (B_{iv}) from Table E-1 of Regulatory Guide 1.109 were used to estimate the fraction of radionuclide which may be expected to transfer to the feed from the soil.
2. Concentrations of radionuclides in milk and meat were estimated using Formula A-11 from Regulatory Guide 1.109.
3. Ingestion dose rates were estimated using Formula A-12 from Regulatory Guide 1.109.

C. Milk and Meat Ingestion Pathway Dose Rate Calculation

1. Concentration in feed.

$$\text{Activity in Feed} = B_{iv} * \text{Activity in Soil}$$

$$\text{Concentration in Feed} = \text{Activity in Feed} / \left(\frac{\text{kg of Feed}}{\text{Acre}} * 5 \text{ Acres} \right)$$

<u>Radionuclide</u>	<u>Activity in Soil (μCi)</u>	<u>Activity in Feed (μCi)</u>	<u>Radionuclide Concentration in Feed (pCi/kg)</u>
Co-60	13.2	1.24E-01	6.67E+00
Cs-137	8.5	8.50E-02	4.57E+00

2. Concentration in Milk and Meat

Calculate concentrations of radionuclides in milk and meat using

Formula A-11 in Regulatory Guide 1.109, Revision 1 which is

$$C_{iA} = F_{iA} * C_{iF} * Q_F$$

where C_{iA} = radionuclide concentration of i in component A
 F_{iA} = stable element transfer coefficient whose values are in Table E-1 of the Regulatory Guide
 C_{iF} = radionuclide concentration in feed
 Q_F = consumption rate of feed = 50 kg/d (wet weight) from Regulatory Guide 1.109

Use the following Regulatory Guide 1.109 values for F_{iA}

Element	$F_{iA} = F_m$ (d/l) for milk	$F_{iA} = F_f$ (d/kg) for meat
Co	1.0E-03	1.3E-02
Cs	1.2E-02	4.0E-03

Radionuclide	Concentration in Milk (pCi/l)	Concentration in Meat (pCi/kg)
Co-60	3.34E-01	4.34E+00
Cs-137	2.74E+00	9.14E-01

3. Calculated Dose rates

The formula for total dose from eating animal products fed vegetation (alfalfa) grown on PBNP sludge applied land is given by Regulatory Guide 1.109, Revision 1, Formula A-12, page 1.109-16. But, as noted following equation A-13, it is necessary to compute separately the milk and meat portions of the dose.

$$DOSE = \sum (U_{ap} * C_{iA} * D_{iapg} * \exp(-\lambda_i t_s))$$

where U_{ap} = consumption rate of animal product
 C_{iA} = conc of radionuclide i in animal product A
 D_{iapg} = dose factor
 t_s = average time between milking or slaughtering and consumption

	U_{ap} by Age Group			
	Infant	Child	Teenager	Adult
Milk (l/yr)	330	330	400	310
Meat (kg/yr)	-	41	65	110

C_{iA} = concentration calculated above

D_{iapg} = DF whole body dose factors, Regulatory Guide 1.109, Revision 1.

Whole Body Dose Factors (mrem/pCi Ingested)

<u>Nuclide</u>	<u>Infant Ingestion</u>	<u>Child Ingestion</u>	<u>Teenager Ingestion</u>	<u>Adult Ingestion</u>
Co-60	2.55E-05	1.56E-05	6.33E-06	4.72E-06
Cs-137	4.33E-05	4.62E-05	5.19E-05	7.14E-05

T₁ = 0 for milk (assume consumption on farm)

T₂ = 20 days for meat (Regulatory Guide 1.109, Revision 1, Table E-15)

MILK INGESTION DOSE RATE (mrem/year)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
Co-60	2.81E-03	1.72E-03	8.46E-04	4.89E-04
Cs-137	3.92E-02	4.18E-02	5.69E-02	6.06E-02
TOTALS:	4.20E-02	4.35E-02	5.77E-02	6.11E-02

MEAT INGESTION DOSE RATE (mrem/year)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
Co-60	-	2.76E-03	1.77E-03	2.24E-03
Cs-137	-	1.73E-03	3.08E-03	7.18E-03
TOTALS:	-	4.49E-03	4.85E-03	9.42E-03

MEAT AND MILK INGESTION PATHWAY DOSE RATES (mrem/year)

Infant - 4.20E-02
 Child - 4.80E-02
 Teenager - 6.26E-02
 Adult - 7.05E-02

III. CALCULATION OF VEGETABLE INGESTION PATHWAY EXPOSURES

A. Specific Assumptions

1. The WPDES permit issued to PBNP for the disposal of sewage sludge prohibits the growing of crops for human consumption for one year following the application of the sewage sludge. Therefore, prior to planting vegetables on the application site, the soil would be plowed. Plowing is assumed to uniformly mix the top 6 inches of soil.

2. The soil density is assumed to be 1.3 grams/cm³.
3. All vegetables consumed by the individual of interest are grown on the sludge applied acreage.
4. Stable element transfer coefficients (B_{fv}) from Regulatory Guide 1.109 are used to estimate the fraction of radioactivity transferred from the soil to the vegetables.

<u>Radionuclide</u>	<u>B_{fv}</u>
Co-60	9.4E-03
Cs-137	1.0E-02

5. The consumption factors of food medium (U_{ap}) and the mass basis distributions from Regulatory Guide 1.109, Table E-5 are used to determine annual consumption of vegetables.

<u>U_{ap} by Age Group*</u>			
<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
-	280 kg/yr	340 kg/yr	280 kg/yr

*Based on 54% vegetable consumption by mass of fruit, vegetable, and grain.

6. The Ingestion Dose Factors by age group are from Regulatory Guide 1.109, Tables E-11, E-12, E-13, and E-14.

Whole Body Ingestion Dose Factors (mrem/pCi ingested)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Co-60	2.55E-05	1.56E-05	6.33E-06	4.72E-06
Cs-137	4.33E-05	4.62E-05	5.19E-05	7.14E-05

7. Radiological decay of the radionuclides applied to the plot is not taken into account in these calculations.

B. Summary of Calculational Methodology

1. The radionuclide concentration in the soil is calculated in units of pCi/kg based on uniform application over 5 acre plot, plowing to a depth of 6 inches, and a soil density of 1.3 g/cm³.
2. The B_{fv} values are applied to the soil concentration values to obtain the radionuclide concentration in the vegetables.
3. The consumption factors (U_{ap}) for each age group are then used to determine the annual radionuclide intake by age group due to eating these vegetables.

4. Finally, the age dependent ingestion dose factors are used to obtain annual doses by age group.

C. Vegetable Pathway Ingestion Dose Rate Calculations

1. Concentration in soil

Radionuclide	Activity Applied (μCi)	Soil Volume (cm^3)	Soil Mass (kg)	Concentration In Soil (pCi/kg)
Co-60	13.2	$3.08\text{E}+09$	$4.00\text{E}+06$	$3.30\text{E}+00$
Cs-137	8.5	$3.08\text{E}+09$	$4.00\text{E}+06$	$2.13\text{E}+00$

2. Concentration in vegetables

Radionuclide	Concentration In Soil (pCi/kg)	B_{iv}	Concentration In Vegetables (pCi/kg)
Co-60	$3.30\text{E}+00$	$9.4\text{E}-03$	$3.10\text{E}-02$
Cs-137	$2.13\text{E}+00$	$1.0\text{E}-02$	$2.13\text{E}-02$

3. Calculated Dose Rates

The dose rate for direct ingestion of vegetables grown on the sludge applied land is given by the equation.

$$\text{DOSE RATE} = \sum U_{ap} * D_{iapj} * \text{EXP}(-\lambda_i t) * C_i$$

where

U_{ap} = consumption rate of food medium
 D_{iapj} = dose factor for radionuclide, i
 λ_i = radiological decay constant
 t = time between harvest and consumption
 C_i = concentration of radionuclide, i, in food medium.

t , the time between harvest and ingestion, is assumed to be zero for this calculation.

VEGETABLE INGESTION DOSE RATE (mrem/year)

Radionuclide	Infant	Child	Teen	Adult
Co-60	-	$1.35\text{E}-04$	$6.67\text{E}-05$	$4.10\text{E}-05$
Cs-137	-	$2.75\text{E}-04$	$3.76\text{E}-04$	$4.26\text{E}-04$
TOTAL	-	$4.11\text{E}-04$	$4.43\text{E}-04$	$4.67\text{E}-04$

IV. CALCULATION OF INHALATION OF RESUSPENDED RADIONUCLIDES PATHWAY EXPOSURE

A. Specific Assumptions

1. The model used to determine the radionuclide concentration in air above the sludge applied land is taken from WASH-1400, USNRC, Reactor Safety Study - An Assessment of Accident Risks in Commercial Nuclear Power Plants, Appendix VI.
2. The radionuclide concentration in air remains constant for year of interest, i.e., radiological decay and decrease in resuspension factor are not taken into account for this calculation.
3. The maximally exposed member of the general public is assumed to be the farmer using the plot of land with an occupancy of 64 hours per year.
4. The inadvertent intruder is assumed to occupy the plot of land for the entire year.
5. The Inhalation Dose Factors by age group are from Regulatory Guide 1.109, Tables E-7, E-8, E-9, and E-10.

WHOLE BODY INHALATION DOSE FACTORS (mrem/pCi inhaled)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Co-60	8.41E-06	6.12E-06	2.48E-06	1.85E-06
Cs-137	3.25E-05	3.47E-05	3.89E-05	5.35E-05

LUNG INHALATION DOSE FACTORS (mrem/pCi inhaled)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Co-60	3.22E-03	1.91E-03	1.09E-03	7.46E-04
Cs-137	5.09E-05	2.81E-05	1.51E-05	9.40E-06

6. The age dependent inhalation rates are obtained from Regulatory Guide 1.109, Table E-5.

Inhalation Rates (m³/yr)

<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
1400	3700	8000	8000

B. Summary of Calculational Methodology

1. The ground plane radionuclide concentrations in pCi/m².
2. Calculate the resuspension factor utilizing equation given in WASH-1400.
3. Obtain the radionuclide concentration in air (pCi/m³) above plot utilizing methodology in WASH-1400.
4. Using parameters contained in Regulatory Guide 1.109, calculate annual dose for continuous occupancy and for realistic occupancy.

C. Inhalation of Resuspended Radionuclides in Air Pathway Dose Rate Calculations - Resuspension of Radionuclide in Air

1. Ground plane radionuclide concentration

<u>Radionuclide</u>	<u>Ground Plane Concentration (pCi/cm²)</u>	<u>Ground Plane Concentration (pCi/m²)</u>
Co-60	6.53E-08	6.53E+02
Cs-137	4.21E-08	4.21E+02

2. Calculation of resuspension factor, $K (m^{-1})$

From WASH-1400,

$$K(t) = 1.0E-09 + 1.0E-05 * EXP [-0.6769 * t]$$

where t = time since radionuclides were deposited on ground surface.

t is assumed to be 0 for these calculations, thereby maximizing the resuspension factor.

Therefore,

$$K = 1.0E-05 m^{-1}$$

3. Calculate radionuclide concentration (pCi/m³) in air.

From WASH-1400,

$$K(m^{-1}) = \frac{\text{air concentration (pCi/m}^3\text{)}}{\text{surface deposit (pCi/m}^2\text{)}}$$

or

$$\text{Air Concentration (pCi/m}^3\text{)} = \text{surface deposit (pCi/m}^2\text{)} * K(m^{-1})$$

AIR CONCENTRATIONS

<u>Radionuclide</u>	<u>Air Concentrations (pCi/m³)</u>
Co-60	6.53E-03
Cs-137	4.21E-03

4. Dose Rate Calculations

$$\text{Dose Rate (mrem/yr)} = \text{Inhalation Rate (m}^3\text{/yr)} * \text{Air Conc. (pCi/m}^3\text{)} * \text{Dose Conversion Factor (mrem/pCi)}$$

WHOLE BODY INHALATION DOSE RATE (mrem/year)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Co-60	7.69E-05	1.48E-04	1.30E-04	9.66E-05
Cs-137	1.92E-04	5.41E-04	1.31E-03	1.80E-03
TOTAL	2.69E-04	6.89E-04	1.44E-03	1.90E-03

LUNG INHALATION DOSE RATE (mrem/year)

<u>Radionuclide</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Co-60	2.94E-02	4.61E-02	5.69E-02	3.90E-02
Cs-137	3.00E-04	4.38E-04	5.09E-04	3.17E-04
TOTAL	2.97E-02	4.65E-02	5.74E-02	3.93E-02

INHALATION OF RESUSPENDED RADIONUCLIDES IN AIR DOSE RATES

WHOLE BODY DOSE RATE (mrem/year)

<u>Occupancy</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Continuous	2.69E-04	6.89E-04	1.44E-03	1.90E-03
Realistic	1.96E-06	5.03E-06	1.05E-05	1.39E-05

LUNG DOSE RATE (mrem/year)

<u>Occupancy</u>	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
Continuous	2.97E-02	4.65E-02	5.74E-02	3.93E-02
Realistic	2.17E-04	3.39E-04	4.19E-04	2.87E-04

V. CALCULATION OF WHOLE BODY EXPOSURES DUE TO RELEASE TO LAKE MICHIGAN

A. Specific Assumptions

1. The methodology contained in the PBNP Offsite Dose Calculation Manual (ODCM) is used to perform this calculation.

2. The entire activity contained in the sludge is released into Lake Michigan.
3. The exposure pathways addressed by the ODCM methodology are ingestion of potable water from Two Rivers, WI water supply, ingestion of fish at edge of initial mixing zone, ingestion of fresh and stored vegetables, irrigated with Lake Michigan as source of water, ingestion of milk and meat from cows utilizing Lake Michigan as drinking water source, swimming and boating activities at edge of initial mixing zone, and shoreline deposits.

B. Summary of Calculational Methodology

1. The activity released in the sludge is converted into Co-60 dose equivalent Curies.
2. The annual design release limit from the ODCM is 94.7 Co-60 equivalent curies.
3. The annual design release limit is based on a limiting dose of 6 mrem adult whole body. The annual dose due to sewage sludge is calculated by a ratio of calculated release compared to release limit.

C. Whole Body Exposure Calculations

1. Co-60 equivalent Curies

<u>Radionuclide</u>	<u>Activity (μCi)</u>	<u>DF₁/DF_{Co-60}</u>	<u>Co-60 eq. Activity (μCi)</u>
Co-60	13.2	1.00E+00	13.2
Cs-137	8.5	1.51E+01	128.4
TOTAL			141.6 μ Ci Co-60 equivalent

2. Ratio of dose limit to annual design release limit

$$\frac{6 \text{ mrem}}{94.7 \text{ Co-60 equivalent curies}}$$

3. Whole Body Dose Calculation

$$\frac{\text{Dose}}{141.6 \mu\text{Ci}} = \frac{6 \text{ mrem}}{94.7 \times 10^6 \mu\text{Ci}}$$

$$\text{Dose} = 8.97\text{E-}06 \text{ mrem}$$

WHOLE BODY DOSE RATE (mrem/year)

DOSE SUMMARY

Maximally Exposed Individual

The identified credible exposure pathways for the maximally exposed individual are:

- 1.) External exposure from ground plane source (realistic occupancy)
- 2.) Milk ingestion pathway
- 3.) Meat ingestion pathway
- 4.) Vegetable ingestion pathway
- 5.) Resuspension inhalation pathway (realistic occupancy)
- 6.) Pathways identified due to release to Lake Michigan.

<u>Pathway</u>	<u>AGE GROUP</u>			
	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
External	8.23E-04	8.23E-04	8.23E-04	8.23E-04
Milk	4.20E-02	4.35E-02	5.77E-02	6.11E-02
Meat	-	4.49E-03	4.85E-03	9.42E-03
Vegetable	-	4.11E-04	4.43E-04	4.67E-04
Inhalation	1.96E-06	5.03E-06	1.05E-05	1.39E-05
Water	8.97E-06	8.97E-06	8.97E-06	8.97E-06
TOTAL: (mrem/year)	0.043	0.049	0.064	0.072

Inadvertent Intruder

The identified credible exposure pathways for the inadvertent intruder are:

- 1.) External exposure from ground plane source (continuous occupancy)
- 2.) Vegetable ingestion pathway
- 3.) Resuspension inhalation pathway (continuous occupancy)
- 4.) Pathways identified due to release to Lake Michigan.

<u>Pathway</u>	<u>AGE GROUP</u>			
	<u>Infant</u>	<u>Child</u>	<u>Teen</u>	<u>Adult</u>
External	1.13E-01	1.13E-01	1.13E-01	1.13E-01
Vegetable	-	4.11E-04	4.43E-04	4.67E-04
Inhalation	2.96E-04	6.89E-04	1.44E-03	1.90E-03
Water	8.97E-06	8.97E-06	8.97E-06	8.97E-06
TOTAL: (mrem/year)	0.113	0.114	0.115	0.115

Reviewing these tables, the calculated limiting doses for both the maximally exposed individual and the inadvertent intruder occur for the adult age group. These doses are:

Maximally Exposed Individual:	0.072 mrem/year
Inadvertent Intruder:	0.115 mrem/year

APPENDIX F

BASIS FOR SETTING CONCENTRATION LIMITS AND ACTIVITY LIMIT
FOR DISPOSAL OF SLUDGE

Analyses of previously disposed sewage sludge have identified six different radionuclides in the sludge. All six radionuclides did not occur in each disposal. Therefore, it is difficult to determine a single concentration limit for regulating the disposal of the sludge from the storage tanks.

To provide a basis to regulate the disposal of the sewage sludge based on identified radionuclide concentrations, the following relation is proposed.

$$\sum_{i=1}^N \frac{C_i}{0.1 \times MPC_i} \leq 1$$

where

- N = number of different radionuclides identified in the sewage sludge.
- C_i = concentration of the ith radionuclide in the sewage sludge.
- MPC_i = the MPC value of the ith radionuclide in the sewage sludge, as listed in 10 CFR Part 20 Appendix B, Table II, Column 2.

If this criteria is met, the sewage sludge may be disposed of by land spreading provided the dose calculations (as identified in Appendix E) indicate dose rates within the prescribed limits.

The attachment to this Appendix details calculations performed to determine doses from four radionuclides identified in the sludge. The calculations are based on an identified concentration equal to 10% of the 10 CFR Part 20, Appendix B, Table II, Column 2 values. The calculations use the methodology in Appendix E along with the exposure pathways identified in Appendix D to determine the dose rates. These calculations indicate the use of this methodology will maintain radiation doses within the appropriate limits.

The maximum allowable activity disposed of per year per acre is calculated utilizing 10% of the MPC value, 10 CFR Part 20, Appendix B, Table II, Column 2, for Co-58. Volume limit per acre has been proposed at 4,000 gallons/acre/year. Then,

$$\begin{aligned} 1.0E-05 \text{ } \mu\text{Ci/cc} &\times 4,000 \text{ gallons/acre/year} \times 3.785.43 \text{ cc/gallon} \\ &= 151.4 \text{ } \mu\text{Ci/acre/year} \end{aligned}$$

Cs-134Concentration in Sludge: $9.0\text{E-}07$ mCi/ml

<u>Sludge Volume</u> (Gallons)	<u>(cm³)</u>	<u>Concentration</u> ($\mu\text{Ci/cm}^3$)	<u>Activity</u> (μCi)	<u>Ground Plane</u> <u>Concentration ($\mu\text{Ci/cm}^2$)</u>
15000	$5.68\text{E+}07$	$9.00\text{E-}07$	$5.11\text{E+}01$	$2.53\text{E-}07$

External Exposure

<u>γ Dose Factor</u> (mrem/hr. per $\mu\text{Ci/m}^2$)	<u>Ground Plane Concentration</u> ($\mu\text{Ci/m}^2$)	<u>γ Dose Rate</u> (mrem/year)
$1.20\text{E-}08$	$2.53\text{E+}03$	$2.66\text{E-}01$

Continuous Occupancy: $2.66\text{E-}01$ mrem/year
 Realistic Occupancy: $1.94\text{E-}03$ mrem/year

Meat & Milk Pathway

<u>Activity in</u> <u>Soil (μCi)</u>	<u>Activity in</u> <u>Feed (μCi)</u>	<u>Concentration in</u> <u>Feed ($\mu\text{Ci/Kg}$)</u>	<u>Concentration in</u> <u>Milk ($\mu\text{Ci/l}$)</u>	<u>Concentration in</u> <u>Meat ($\mu\text{Ci/kg}$)</u>
$5.22\text{E+}01$	$5.11\text{E-}01$	$2.75\text{E+}01$	$1.65\text{E+}01$	$5.50\text{E+}00$

Milk Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
$3.87\text{E-}01$	$4.41\text{E-}01$	$6.03\text{E-}01$	$6.19\text{E-}01$

Meat Dose Rate (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	$1.83\text{E-}02$	$3.27\text{E-}02$	$7.32\text{E-}02$

Vegetable Pathway

<u>Activity</u> (μCi)	<u>Soil Volume</u> (cm^3)	<u>Soil Mass</u> (Kg)	<u>Concentration</u> <u>in Soil ($\mu\text{Ci/Kg}$)</u>	<u>Concentration</u> <u>in Vegetables ($\mu\text{Ci/Kg}$)</u>
$5.11\text{E+}01$	$3.08\text{E+}09$	$4.00\text{E+}06$	$1.28\text{E+}01$	$1.28\text{E-}01$

Vegetable Pathway Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	2.90E-03	3.98E-03	4.34E-03

Inhalation Pathway

<u>Ground Plane Concentration (pCi/m²)</u>	<u>K₁ (m⁻¹)</u>	<u>Air Concentration (pCi/m³)</u>
2.53E+03	1.0E-05	2.53E-02

Inhalation Pathway Dose Rates (mrem/year)

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
Continuous Occupancy	1.88E-03	5.68E-03	1.39E-02	1.84E-02
Realistic Occupancy	1.38E-05	4.15E-05	1.01E-04	1.35E-04

Release to Lake Michigan

<u>Activity (μCi)</u>	<u>DF_i/DF_{Co-60}</u>	<u>Co-60 eq. activity (μCi)</u>
5.11E+01	2.56E+01	1.31E+03

$$\frac{6 \text{ mrem}}{94.7 \text{ Ci}} \times 1.31E+03 \times \frac{1 \text{ Ci}}{1.0E+06 \text{ } \mu\text{Ci}} = 8.29E-05 \text{ mrem}$$

Maximally Exposed Individual

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	1.94E-03	1.94E-03	1.94E-03	1.94E-03
Milk	3.87E-01	4.41E-01	6.03E-01	6.19E-01
Meat	-	1.83E-02	3.27E-02	7.32E-02
Vegetable	-	2.90E-03	3.98E-03	4.34E-03
Inhalation	1.38E-05	4.15E-05	1.01E-04	1.35E-04
Water	8.29E-05	8.29E-05	8.29E-05	8.29E-05
Totals:	3.89E-01	4.64E-01	6.42E-01	6.99E-01

Inadvertent Intruder

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	2.66E-01	2.66E-01	2.66E-01	2.66E-01
Vegetable	-	2.90E-03	3.98E-03	4.34E-03
Inhalation	1.88E-03	5.68E-03	1.39E-02	1.84E-02
Water	8.29E-05	8.29E-05	8.29E-05	8.29E-05
Totals:	2.68E-01	2.75E-01	2.84E-01	2.89E-01

Cs-137

Concentration in Sludge: $2.0\text{E}-06 \text{ } \mu\text{Ci/ml}$

<u>Sludge Volume</u> <u>(Gallons)</u>	<u>Sludge Volume</u> <u>(cm³)</u>	<u>Concentration</u> <u>($\mu\text{Ci/cm}^3$)</u>	<u>Activity</u> <u>(μCi)</u>	<u>Ground Plane</u> <u>Concentration ($\mu\text{Ci/cm}^2$)</u>
15000	$5.68\text{E}+07$	$2.00\text{E}-06$	$1.14\text{E}+02$	$5.62\text{E}-07$

External Exposure

<u>γ Dose Factor</u> <u>(mrem/hr. per $\mu\text{Ci/m}^2$)</u>	<u>Ground Plane Concentration</u> <u>($\mu\text{Ci/m}^2$)</u>	<u>γ Dose Rate</u> <u>(mrem/year)</u>
$4.20\text{E}-09$	$5.62\text{E}+03$	$2.07\text{E}-01$

Continuous Occupancy: $2.07\text{E}-01 \text{ mrem/year}$
Realistic Occupancy: $1.51\text{E}-03 \text{ mrem/year}$

Meat & Milk Pathway

<u>Activity in</u> <u>Soil (μCi)</u>	<u>Activity in</u> <u>Feed (μCi)</u>	<u>Concentration in</u> <u>Feed ($\mu\text{Ci/Kg}$)</u>	<u>Concentration in</u> <u>Milk ($\mu\text{Ci/l}$)</u>	<u>Concentration in</u> <u>Meat ($\mu\text{Ci/kg}$)</u>
$1.14\text{E}+02$	$1.14\text{E}+00$	$6.13\text{E}+01$	$3.68\text{E}+01$	$1.23\text{E}+01$

Milk Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
$5.26\text{E}-00$	$5.61\text{E}-01$	$7.64\text{E}-01$	$8.15\text{E}-01$

Meat Dose Rate (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	$2.33\text{E}-02$	$4.15\text{E}-02$	$9.56\text{E}-02$

Vegetable Pathway

<u>Activity</u> <u>(μCi)</u>	<u>Soil Volume</u> <u>(cm^3)</u>	<u>Soil Mass</u> <u>(Kg)</u>	<u>Concentration</u> <u>in Soil ($\mu\text{Ci/Kg}$)</u>	<u>Concentration</u> <u>in Vegetables ($\mu\text{Ci/Kg}$)</u>
$1.14\text{E}+02$	$3.08\text{E}+09$	$4.00\text{E}+06$	$2.85\text{E}+01$	$2.85\text{E}-01$

Vegetable Pathway Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	3.69E-03	5.03E-03	5.70E-03

Inhalation Pathway

<u>Ground Plane Concentration (pCi/m²)</u>	<u>K_{a1} (m⁻¹)</u>	<u>Air Concentration (pCi/m³)</u>
5.62E+03	1.0E-05	5.62E-02

Inhalation Pathway Dose Rates (mrem/year)

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
Continuous Occupancy	2.56E-03	7.22E-03	1.75E-02	2.41E-02
Realistic Occupancy	1.87E-05	5.27E-05	1.28E-04	1.76E-04

Release to Lake Michigan

<u>Activity (μCi)</u>	<u>DF₁/DF_{Co-60}</u>	<u>Co-60 eq. activity (μCi)</u>
1.14E+02	1.51E+01	1.72E+03

$$\frac{6 \text{ mrem}}{94.7 \text{ Ci}} * 1.72E+03 * \frac{1 \text{ Ci}}{1.0E+06 \text{ } \mu\text{Ci}} = 1.09E-04 \text{ mrem}$$

Maximally Exposed Individual

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	1.51E-03	1.51E-03	1.51E-03	1.51E-03
Milk	5.26E-01	5.61E-01	7.64E-01	8.15E-01
Meat	-	2.33E-02	4.15E-02	5.70E-03
Vegetable	-	3.69E-03	5.03E-03	5.70E-03
Inhalation	1.87E-05	5.27E-05	1.28E-04	1.76E-04
Water	1.09E-04	1.09E-04	1.09E-04	1.09E-04
Totals:	5.28E-01	5.90E-01	8.12E-01	9.19E-01

Inadvertent Intruder

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	2.07E-01	2.07E-01	2.07E-01	2.07E-01
Vegetable	-	3.69E-03	5.03E-03	5.70E-03
Inhalation	2.56E-03	7.22E-03	1.75E-02	2.41E-02
Water	1.09E-04	1.09E-04	1.09E-04	1.09E-04
Totals:	2.10E-01	2.18E-01	2.30E-01	2.37E-01

Co-58Concentration in Sludge: 1.00E-05 $\mu\text{Ci}/\text{ml}$

<u>Sludge Volume</u> <u>(Gallons)</u>	<u>(cm³)</u>	<u>Concentration</u> <u>($\mu\text{Ci}/\text{cm}^3$)</u>	<u>Activity</u> <u>(μCi)</u>	<u>Ground Plane</u> <u>Concentration ($\mu\text{Ci}/\text{cm}^2$)</u>
15000	5.68E+07	1.00E-05	5.68E+02	2.81E-06

External Exposure

<u>y Dose Factor</u> <u>(mrem/hr. per pCi/m²)</u>	<u>Ground Plane Concentration</u> <u>(pCi/m²)</u>	<u>y Dose Rate</u> <u>(mrem/year)</u>
7.00E-09	2.81E+04	1.72E+00

Continuous Occupancy: 1.72E+00 mrem/year

Realistic Occupancy: 1.26E-02 mrem/year

Meat & Milk Pathway

<u>Activity in</u> <u>Soil (μCi)</u>	<u>Activity in</u> <u>Feed (μCi)</u>	<u>Concentration in</u> <u>Feed (pCi/Kg)</u>	<u>Concentration in</u> <u>Milk (pCi/l)</u>	<u>Concentration in</u> <u>Meat (pCi/kg)</u>
5.68E+02	5.34E+00	2.87E+02	1.44E+01	1.87E+02

Milk Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
4.27E-02	2.62E-02	1.29E-02	7.45E-03

Meat Dose Rate (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	4.22E-02	2.72E-02	3.44E-02

Vegetable Pathway

<u>Activity</u> <u>(μCi)</u>	<u>Soil Volume</u> <u>(cm³)</u>	<u>Soil Mass</u> <u>(Kg)</u>	<u>Concentration</u> <u>in Soil (pCi/Kg)</u>	<u>Concentration</u> <u>in Vegetables (pCi/Kg)</u>
5.68E+02	3.08E+09	4.07E+06	1.42E-04	1.33E+00

Vegetable Pathway Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	2.05E-03	1.01E-03	6.22E-04

Inhalation Pathway

<u>Ground Plane Concentration (pCi/m²)</u>	<u>K₁ (m⁻¹)</u>	<u>Air Concentration (pCi/m³)</u>
2.81E+04	1.0E-05	2.81E-01

Inhalation Pathway Dose Rates (mrem/year)

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
Continuous Occupancy	5.11E-04	8.89E-04	7.80E-04	5.82E-04
Realistic Occupancy	3.74E-06	6.49E-06	5.70E-06	4.25E-06

Release to Lake Michigan

<u>Activity (μCi)</u>	<u>DF₁/DF_{Co-60}</u>	<u>Co-60 eq. activity (μCi)</u>
5.68E+02	3.54E-01	2.01E+02

$$\frac{6 \text{ mrem}}{94.7 \text{ Ci}} \times 2.01E+02 \text{ } \mu\text{Ci} \times \frac{1 \text{ Ci}}{1.0E+06 \text{ } \mu\text{Ci}} = 1.27E-05 \text{ mrem}$$

Maximally Exposed Individual

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	1.26E-02	1.26E-02	1.26E-02	1.26E-02
Milk	4.27E-02	2.62E-02	1.29E-02	7.45E-03
Meat	-	4.22E-02	2.72E-02	3.44E-02
Vegetable	-	2.05E-03	1.01E-03	6.22E-04
Inhalation	3.74E-06	6.49E-06	5.70E-06	4.25E-06
Water	1.27E-05	1.27E-05	1.27E-05	1.27E-05
Totals:	5.53E-02	8.31E-02	5.37E-02	5.51E-02

Inadvertent Intruder

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	1.72E+00	1.72E+00	1.72E+00	1.72E+00
Vegetable	-	2.05E-03	1.01E-03	6.22E-04
Inhalation	5.11E-04	8.89E-04	7.80E-04	5.82E-04
Water	1.27E-05	1.27E-05	1.27E-05	1.27E-05
Totals:	1.72E+00	1.72E+00	1.72E+00	1.72E+00

Co-60Concentration in Sludge: $5.0\text{E-}06 \text{ } \mu\text{Ci/ml}$

<u>Sludge Volume</u> <u>(Gallons)</u>	<u>Volume</u> <u>(cm³)</u>	<u>Concentration</u> <u>($\mu\text{Ci/cm}^3$)</u>	<u>Activity</u> <u>(μCi)</u>	<u>Ground Plane</u> <u>Concentration ($\mu\text{Ci/cm}^2$)</u>
15000	$5.68\text{E}+07$	$5.00\text{E-}06$	$2.84\text{E}+02$	$1.41\text{E-}06$

External Exposure

<u>γ Dose Factor</u> <u>(mrem/hr. per $\mu\text{Ci/m}^2$)</u>	<u>Ground Plane Concentration</u> <u>($\mu\text{Ci/m}^2$)</u>	<u>γ Dose Rate</u> <u>(mrem/year)</u>
$1.70\text{E-}08$	$1.41\text{E}+04$	$2.09\text{E}+00$

Continuous Occupancy: $2.09\text{E}+00 \text{ mrem/year}$ Realistic Occupancy: $1.53\text{E-}02 \text{ mrem/year}$ Meat & Milk Pathway

<u>Activity in</u> <u>Soil (μCi)</u>	<u>Activity in</u> <u>Feed (μCi)</u>	<u>Concentration in</u> <u>Feed ($\mu\text{Ci/Kg}$)</u>	<u>Concentration in</u> <u>Milk ($\mu\text{Ci/l}$)</u>	<u>Concentration in</u> <u>Meat ($\mu\text{Ci/kg}$)</u>
$2.84\text{E}+02$	$2.67\text{E}+00$	$1.44\text{E}+02$	$7.18\text{E}+00$	$9.33\text{E}+01$

Milk Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
$6.04\text{E-}02$	$3.70\text{E-}02$	$1.82\text{E-}02$	$1.05\text{E-}02$

Meat Dose Rate (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	$5.97\text{E-}02$	$3.84\text{E-}02$	$4.84\text{E-}02$

Vegetable Pathway

<u>Activity</u> <u>(μCi)</u>	<u>Soil Volume</u> <u>(cm³)</u>	<u>Soil Mass</u> <u>(Kg)</u>	<u>Concentration</u> <u>in Soil ($\mu\text{Ci/Kg}$)</u>	<u>Concentration</u> <u>in Vegetables ($\mu\text{Ci/Kg}$)</u>
$2.84\text{E}+02$	$3.08\text{E}+09$	$4.00\text{E}+06$	$7.10\text{E}+01$	$6.67\text{E-}01$

Vegetable Pathway Dose Rates (mrem/year)

<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
-	2.91E-03	1.44E-03	8.82E-04

Inhalation Pathway

<u>Ground Plane Concentration (pCi/m²)</u>	<u>K₁ (m⁻¹)</u>	<u>Air Concentration (pCi/m³)</u>
1.41E+04	1.0E-05	1.41E-01

Inhalation Pathway Dose Rates (mrem/year)

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
Continuous Occupancy	1.66E-03	3.19E-03	2.80E-03	2.09E-03
Realistic Occupancy	1.21E-05	2.33E-05	2.05E-05	1.53E-05

Release to Lake Michigan

<u>Activity (μCi)</u>	<u>DF₁/DF_{Co-60}</u>	<u>Co-60 eq. activity (μCi)</u>
---------------------------	--	-------------------------------------

$$\frac{6 \text{ mrem}}{94.7 \text{ Ci}} \times 2.84\text{E}+02 \mu\text{Ci} \times \frac{1 \text{ Ci}}{1.0\text{E}+06 \mu\text{Ci}} = 1.80\text{E}-05 \text{ mrem}$$

Maximally Exposed Individual

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	1.53E-02	1.53E-02	1.53E-02	1.53E-02
Milk	6.04E-02	3.70E-02	1.82E-02	1.05E-02
Meat	-	5.97E-02	3.84E-02	4.84E-02
Vegetable	-	2.91E-03	1.44E-03	8.82E-04
Inhalation	1.21E-05	2.33E-05	2.05E-05	1.53E-05
Water	1.80E-05	1.80E-05	1.80E-05	1.80E-05
Totals:	7.57E-02	1.15E-01	7.34E-02	7.51E-02

Inadvertent Intruder

	<u>Infant</u>	<u>Child</u>	<u>Teenager</u>	<u>Adult</u>
External	2.09E+00	2.09E+00	2.09E+00	2.09E+00
Vegetable	-	2.91E-03	1.44E-03	8.82E-04
Inhalation	1.66E-03	3.19E-03	2.80E-03	2.09E-03
Water	1.80E-05	1.80E-05	1.80E-03	1.80E-03
Totals:	2.09E+00	2.10E+00	2.10E+00	2.09E+00

APPENDIX G

CALCULATIONAL METHODOLOGY FOR DETERMINING
EXTERNAL DOSE RATES FROM RADIONUCLIDES
AFTER INCORPORATION INTO SOIL

Wisconsin Electric utilizes QAD, a nationally recognized computer code, to perform shielding and dose rate analyses. The QAD computer code utilizes a point kernel methodology to calculate the dose rate at a specified point due to a given source of radiation.

QAD will be used to calculate the dose rate due to standing on a plot of land utilized for sludge disposal after the radionuclides have been incorporated into the plot by plowing. The following parameters will be used in the calculation:

- ° The total activity from all previous disposals will be corrected for radiological decay and used as the radionuclide source term.
- ° Appropriate values will be used to represent the surface area of the plot.
- ° The radionuclides will be assumed to be incorporated uniformly into the top six inches of soil.
- ° The dose rate will be calculated at a height of 1 meter above the ground plane at a depth of 5 centimeters in tissue. (Regulatory Guide 1.109 values).
- ° The density of the soil will be assumed to be 1.3 grams/cubic centimeter.

This calculated dose rate will be used to assess the radiological consequences of past disposals in conjunction with the consequences of proposed future disposals. The total radiological dose consequence of the past and the proposed disposal will be compared to the applicable limits to insure the dose is maintained at or below the limits.

APPENDIX F

Modifications to the Wisconsin Electric submittal to the United States Nuclear Regulatory Commission dated October 8, 1987 (VPNPD-87-430, NRC-87-104), Disposal by Land Application of Sewage Sludge Containing Minute Quantities of Radioactive Material.

MODIFICATION #1CHANGE TO ORIGINAL SUBMITTAL

Section 3.2, Disposal Procedure (page 3)

Section 3.3, Administrative Procedure (page 4)

The requirements for sludge characterization (the determination of the chemical and physical properties of the sludge) contained in the sections referenced above are modified to allow characterization of the sludge on an annual basis.

BASIS/EXPLANATION

The October 8, 1987 submittal to the USNRC for permission to dispose of sewage treatment sludge containing minute quantities of radioactive material requires that, "prior to disposal the waste stream will be monitored to determine the physical and chemical properties of the sludge. ..." Subsequent to the submittal and the approval by the NRC, a new Wisconsin Pollutant Discharge Elimination System (WPDES) permit was issued to the Point Beach Nuclear Plant by the Wisconsin Department of Natural Resources on November 30, 1988. Both the new WPDES permit and the Point Beach Nuclear Plant Sludge Management Plan specify an annual required frequency for the evaluation of the sludge characteristics.

The original requirement to perform the characterization of the chemical and physical properties of the sewage sludge prior to each disposal has proven time consuming and costly for Wisconsin Electric Lab Services. Preparation of special analytical standards are required to complete the characterization study. The preparation of these standards, sample preparation, and the actual analyses are all manpower intensive and difficult to perform on a timely basis. This has led to requiring overtime for Lab Services personnel and support from outside companies. In order to better utilize the resources of Lab Services while maintaining the requirements of the WPDES permit, the frequency of sludge characterization in the October 8, 1987 submittal to the NRC should be changed to an annual requirement.

This change in the required frequency for determination of the sludge characteristics does not change the requirement to analyze the sewage sludge for radionuclide content or perform dose evaluations prior to each disposal.