


FORT CALHOUN STATION PERFORMANCE INDICATORS

FEBRUARY 1993

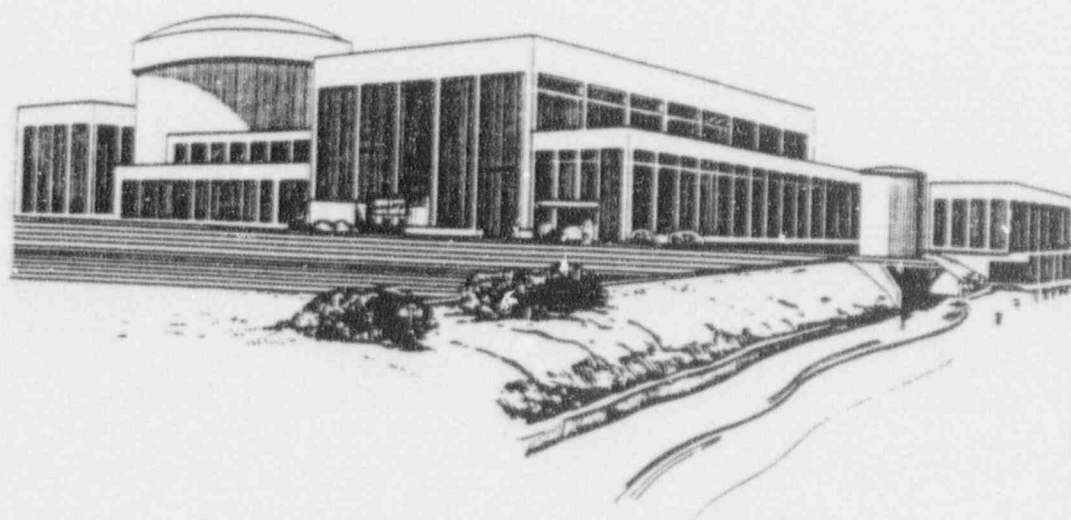

Prepared by:

Production Engineering Division
System Engineering
Test and Performance Group

Pursuit of excellence is an attitude...
it involves wisdom and sound judgment...
it is a lifetime, career-long commitment...
it is a way of life...it is doing the job
right the first time, every time. It is
inner-directed, not the result of external
pressure, it is our own self worth—who
we are and the pride and satisfaction
that comes from being the right kind of
person, not just in doing the right things.

James J. O'Connor

OMAHA PUBLIC POWER DISTRICT
FORT CALHOUN STATION
PERFORMANCE INDICATORS REPORT

Prepared By:
Production Engineering Division
System Engineering
Test and Performance Group

FEBRUARY 1993

ABSTRACT

PURPOSE

The "Performance Indicators Program" is intended to provide selected Fort Calhoun plant performance information to OPPD's personnel responsible for optimizing unit performance. The information is presented in a way that provides ready identification of trends and a means to track progress toward reaching corporate goals. The information can be used for assessing and monitoring Fort Calhoun's plant performance, with emphasis on safety and reliability. Some performance indicators show company goals or industry information. This information can be used for comparison or as a means of promoting pride and motivation.

SCOPE

The conditions, goals, and projections reflected within this report are current as of the end of the month being reported, unless otherwise stated.

In order for the Performance Indicator Program to be effective, the following guidelines were followed while implementing the program:

- 1) Data was selected which most effectively monitors Fort Calhoun's performance in key areas
- 2) Established corporate goals and industry information were included for comparison.
- 3) Formal definitions were developed for each performance parameter to ensure consistency in future reports and allow comparison with industry averages where appropriate.

Comments and input are encouraged to ensure that this program is tailored to address the areas which are most meaningful to the people using the report. Please refer comments to the System Engineering Department's Test and Performance Group. To increase personnel awareness of Fort Calhoun Station's plant performance, it is suggested that this report be distributed throughout your respective departments.

REFERENCES

INPO Good Practices OA-102, "Performance Monitoring - Management Information"

INPO Report Dated November 1984, "Nuclear Power Plant Operational Data"

NUMARC 87-00, "Guidelines and Technical Bases for NUMARC Initiatives Addressing Station Black-out at Light Water Reactors", Revision 1, Appendix D, "EDG Reliability Program", dated April 6, 1990.

FORT CALHOUN STATION PERFORMANCE INDICATORS REPORT

FEBRUARY 1993 - SUMMARY

POSITIVE TREND REPORT

The Positive Trend Report highlights several Performance Indicators with data representing continued performance above the stated goal and indicators with data representing significant improvement in recent months.

The following indicators have been selected as exhibiting positive trends for the reporting month:

Emergency Diesel Generator Unit Reliability (Page 24)

There have been no failures in the last 50 demands (starts and load-runs combined) for the emergency diesel generators.

Maintenance Work Order Breakdown (Page 29)

The total number of open MWOs has declined each month since November 1992.

Expedited Purchases (Page 63)

There have been no expedited purchases since September 1992.

End of Positive Trend Report

ADVERSE TREND REPORT

A Performance Indicator which has data representing three (3) consecutive months of declining performance constitutes an adverse trend. The Adverse Trend Report explains the conditions under which certain indicators are showing adverse trends.

The following indicators were exhibiting adverse trends for the reporting month.

Thermal Performance (Page 10)

The Manager - Station Engineering has identified an adverse trend based on continued performance below the goal.

Repeat Failures (Page 43)

The Manager - Station Engineering has identified an adverse trend based on an increase in the number of components with more than two failures since September 1992.

End of Adverse Trend Report.

INDICATORS NEEDING INCREASED MANAGEMENT ATTENTION REPORT

This section lists the indicators which show inadequacies when compared to the OPPD goal.

Forced Outage Rate (Page 2)

The forced outage rate for the twelve months from 3/1/92 through 2/28/93 (10.11%) is above the 1992 and 1993 Fort Calhoun goals of a maximum of 2.4%.

Document Review (Page 23)

The number of documents greater than 6 months overdue for the reporting month (4) is above the 1993 monthly goal of no (0) documents greater than 6 months old.

Number of Control Room Equipment Deficiencies (Page 33)

The number of control room equipment deficiencies for the reporting month (67) is above the 1993 monthly goal of a maximum of 45.

Percent of Completed Scheduled Maintenance Activities (Pages 36 through 39)

The percent of completed scheduled maintenance activities for electrical maintenance, pressure equipment, general maintenance and mechanical maintenance for the reporting month is less than the 1993 goal of $\geq 85\%$.

In-Line Chemistry Instruments Out-of-Service (Page 48)

The number of in-line chemistry instruments out-of-service for the reporting month (18) is above the 1993 monthly goal of a maximum of 5.

Inventory Accuracy (Page 62)

The inventory accuracy value for the reporting month (97%) is below the 1993 monthly goal of a minimum value of 98%.

Violations Per 1,000 Inspection Hours (Page 77)

The number of violations per 1,000 inspection hours for the last 12 months (2.68) exceeds the 1993 and 1992 Fort Calhoun goals of a maximum of 1.5.

End of Management Attention Report.

PERFORMANCE INDICATOR REPORT IMPROVEMENTS/CHANGES

This section lists significant changes made to the report and to specific indicators within the report since the previous month.

Station Net Generation

(Page 1)

The station net generation for the month of January 1993 was revised to 361,239 Mwh.

Number of Control Room Equipment Deficiencies

(Page 33)

A graph of "Operator Work Arounds" was added to this indicator.

Maintenance Overtime

(Page 34)

The maintenance overtime for the month of January 1993 was revised to 9.0%.

Number of NPRDS Multiple Failures

This indicator has been deleted from the report.

Repeat Failures

(Page 43)

This indicator was formerly titled "Maintenance Effectiveness".

Hazardous Material

(Page 49)

The goal of a maximum of 100 kilograms per month of hazardous waste was changed to an "average" monthly goal because the waste is counted based on a full drum, which contains 150 kilograms.

Contaminations >5,000 DPM/100 CM²

(Page 51)

This indicator was formerly titled "Total Skin and Clothing Contaminations".

Significant Events

(Page 80)

A graph of INPO Significant Event Reports (SERs) was added to this indicator.

End of Performance Indicator Report Improvements/
Changes Report

Table of Contents/Summary

INPO INDUSTRY KEY PARAMETERS

PAGE

	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	
UNPLANNED AUTOMATIC REACTOR SCRAMS PER 7,000 HOURS CRITICAL	0.6	0	0	0	3
SAFETY SYSTEM PERFORMANCE (year-to-date values):					
HIGH PRESSURE SAFETY INJECTION SYSTEM	0.0012	≤0.008	0.0003	0.0006	6
AUXILIARY FEEDWATER SYSTEM	0.0038	≤0.01	0.0026	0.0049	7
EMERGENCY AC POWER SYSTEM	0.0055	≤0.023	0.0059	0.0	8
THERMAL PERFORMANCE	99.8%	≥99.4%	98.9%	99.1%	10
UNIT CAPABILITY FACTOR	89.6%	≥74.1%	100%	100%	12
UNPLANNED CAPABILITY LOSS FACTOR	1.85%	≤4.5%	0%	0%	13
FUEL RELIABILITY INDICATOR (microcuries/gram)	NA	≤7.5x10 ⁻⁴	2.16x10 ⁻⁴	1.98x10 ⁻⁴	15
COLLECTIVE RADIATION EXPOSURE (person-rem)	115.6/YR	≤200/YR	3.52	1.85	16
VOLUME OF LOW-LEVEL SOLID RADIOACTIVE WASTE (cubic ft.)	2,077.9/YR	≤1,000/YR	8.1	0.0	17
INDUSTRIAL SAFETY ACCIDENT RATE/DISABLING INJURY/ILLNESS FREQUENCY RATE					
	0.12	≤0.50	0.0	0.0	18
CHEMISTRY INDEX/SECONDARY SYSTEM CHEMISTRY					
	0.20	≤0.60	0.53	0.582	45

INDUSTRIAL SAFETY

PAGE

	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	TREND	
DISABLING INJURY/ILLNESS FREQUENCY RATE	0.12	≤0.50	0.0	0.0	NA	18
RECORDABLE INJURY/ILLNESS CASES FREQUENCY RATE						
	NA	≤2.0	0.76	0.0	D	19

OPERATIONS

PAGE

	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	TREND	
STATION NET GENERATION (10,000 Mwh)	NA	NA	32.5	36.1	NA	1
FORCED OUTAGE RATE	0.25%	≤2.4%	10.11%	10.09%	NMA	2
UNPLANNED AUTOMATIC REACTOR SCRAMS PER 7,000 CRITICAL HOURS						
	0.6	0	0	0	NA	3
UNPLANNED SAFETY SYSTEM ACTUATIONS - (INPO DEFINITION)						
	0	0	0	0	NA	4

OPERATIONS (cont'd)PAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
UNPLANNED SAFETY SYSTEM ACTUATIONS - (NRC DEFINITION)	0	0	0	0	NA	5
SAFETY SYSTEM PERFORMANCE (year-to-date values):						
HIGH PRESSURE SAFETY INJECTION SYSTEM	0.0012	≤0.008	0.0003	0.0006	NA	6
AUXILIARY FEEDWATER SYSTEM	0.0038	≤0.01	0.0028	0.0049	NA	7
EMERGENCY AC POWER SYSTEM	0.0055	≤0.023	0.0059	0.0	NA	8
GROSS HEAT RATE	NA	≤10,168/yr.	10,061	10,043	D	9
THERMAL PERFORMANCE	99.8%	≥99.4%	98.95%	99.1%	A	10
EQUIVALENT AVAILABILITY FACTOR	NA	NA	100%	100%	NA	11
UNIT CAPABILITY FACTOR	89.6%	≥74.1%	100%	100%	NA	12
UNPLANNED CAPABILITY LOSS FACTOR	1.85%	≤4.5%	0%	0%	NA	13
PLANNED CAPABILITY LOSS FACTOR	8.55%	≤21.4%	0%	0%	NA	14
FUEL RELIABILITY INDICATOR (microcuries/gram)	NA	≤7.5x10 ⁻⁴	2.16x10 ⁻⁴	1.98x10 ⁻⁴	NA	15
DAILY THERMAL OUTPUT (Mwth)	NA	≥1,495	NA	NA	NA	20
EQUIPMENT FORCED OUTAGES PER 1,000 CRITICAL HOURS	NA	≤0.2	0	0	NA	21
OPERATIONS AND MAINTENANCE BUDGET	NA	NA	NA	NA	NA	22
DOCUMENT REVIEW	NA	0>6 mos.	NA	NA	NMA	23

MAINTENANCEPAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
EMERGENCY DIESEL GENERATOR UNIT RELIABILITY	NA	NA	NA	NA	NA	24
DIESEL GENERATOR RELIABILITY (25 DEMANDS)	NA	<4	NA	NA	NA	25
EMERGENCY DIESEL GENERATOR UNRELIABILITY	NA	NA	NA	NA	NA	26
DIESEL GENERATOR UNAVAILABILITY (cumulative hrs.)	NA	≤201.5/DG	NA	NA	NA	27
AGE OF OUTSTANDING MAINTENANCE WORK ORDERS (CORRECTIVE NON-OUTAGE)	NA	NA	NA	NA	NA	28
MAINTENANCE WORK ORDER BREAKDOWN (CORRECTIVE NON-OUTAGE)	NA	≤325	91	120	I	29
CORRECTIVE MAINTENANCE BACKLOG GREATER THAN 3 MONTHS OLD (NON-OUTAGE)	NA	NA	87.9%	89.2%	NA	30

MAINTENANCE (cont'd)

PAGE

	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	TREND	
RATIO OF PREVENTIVE TO TOTAL MAINTENANCE	NA	NA	88.1%	64.5%	NA	31
PREVENTIVE MAINTENANCE ITEMS OVERDUE	NA	≤0.5%	0.4%	0%	D	32
NUMBER OF CONTROL ROOM EQUIPMENT DEFICIENCIES	NA	≤45	67	62	NMA	33
MAINTENANCE OVERTIME	NA	≤10%	8.8%	9.0%	I	34
PROCEDURAL NONCOMPLIANCE INCIDENTS (MAINTENANCE)	NA	0	0	0	NA	35
PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (ELECTRICAL MAINTENANCE)	NA	≥85%	70.7%	70.3%	NMA	36
PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (PRESSURE EQUIPMENT)	NA	≥85%	81.0%	78.3%	NMA	37
PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (GENERAL MAINTENANCE)	NA	≥85%	65.1%	53.9%	NMA	38
PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (MECHANICAL MAINTENANCE)	NA	≥85%	80.2%	65.6%	NMA	39
PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (INSTRUMENTATION & CONTROL)	NA	≥85%	90.7%	87.5%	I	40
NUMBER OF MISSED SURVEILLANCE TESTS RESULTING IN LICENSEE EVENT REPORTS	NA	0	0	0	NA	41
COMPONENT FAILURE ANALYSIS REPORT (CFAR) SUMMARY	NA	NA	NA	NA	NA	42
REPEAT FAILURES	NA	NA	NA	NA	A	43
CHECK VALVE FAILURE RATE	NA	≤2.00E-4	1.21E-4	1.21E-4	NA	44

CHEMISTRY AND RADIOLOGICAL PROTECTION

PAGE

	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	TREND	
COLLECTIVE RADIATION EXPOSURE (person-rem)	115.6/YR	≤200/YR	3.52	1.85	NA	16
VOLUME OF LOW-LEVEL SOLID RADIOACTIVE WASTE	2.078/YR	≤1,000/YR	8.1	0	NA	17
SECONDARY SYSTEM CHEMISTRY	0.20	≤0.60	0.53	0.582	I	45

CHEMISTRY AND RADIOLOGICAL PROTECTION (cont'd)PAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
PRIMARY SYSTEM CHEMISTRY						
PERCENT OF HOURS OUT OF LIMIT	NA	≤ 0%	0%	0%	NA	46
AUXILIARY SYSTEM (CCW) CHEMISTRY PERCENT						
OF HOURS OUTSIDE STATION LIMITS	NA	NA	0%	0%	NA	47
IN-LINE CHEMISTRY INSTRUMENTS						
OUT-OF-SERVICE	NA	≤ 5	18	16	NMA	48
HAZARDOUS WASTE PRODUCED (Kg)	NA	≤ 100 /mo	0	0	NA	49
MAXIMUM INDIVIDUAL						
RADIATION EXPOSURE (mRem)	NA	≤ 1,500/YR	103	121	I	50
CONTAMINATIONS >5,000 DPM/100 CM ²	NA	≤ 144	1	7	I	51
DECONTAMINATED RADIATION						
CONTROLLED AREA	NA	≥ 85.0%	89.0%	89.1%	NA	52
RADIOLOGICAL WORK						
PRACTICES PROGRAM	NA	NA	1	3	I	53
NUMBER OF HOT SPOTS	NA	remove 1/mo	64	90	I	54
GASEOUS RADIOACTIVE WASTE BEING						
DISCHARGED TO THE ENVIRONMENT (curies)	NA	≤ 340/yr	157.5	157.5	NA	55
LIQUID RADIOACTIVE WASTE BEING						
DISCHARGED TO THE ENVIRONMENT (curies)	NA	≤ 225/yr	106.3	106.3	NA	56

SECURITYPAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
LOGGABLE/REPORTABLE						
INCIDENTS (SECURITY)	NA	NA	34	41	I	57
SECURITY NON-SYSTEM FAILURES	NA	NA	NA	NA	NA	58
SECURITY SYSTEM FAILURES	NA	NA	NA	NA	NA	59

MATERIALS AND OUTSIDE SERVICESPAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
AMOUNT OF WORK ON HOLD						
AWAITING PARTS (NON-OUTAGE)	NA	≤ 3.5%	2.5%	2.37%	D	60
SPARE PARTS INVENTORY VALUE (\$ million)	NA	NA	13.7	13.3	NA	61
SPARE PARTS ISSUED (\$ thousands)	NA	NA	NA	182.8	NA	61
INVENTORY ACCURACY	NA	≥ 98%	97%	94%	NMA	62
STOCKOUT RATE	NA	≤ 0%	0%	0%	NA	62

MATERIALS AND OUTSIDE SERVICES (cont'd)PAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
EXPEDITED PURCHASES	NA	≤0.5%	0%	0%	NA	63
INVOICE BREAKDOWN	NA	NA	NA	NA	NA	64
MATERIAL REQUEST PLANNING	NA	NA	29.9%	39.3%	I	64

DESIGN ENGINEERINGPAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
OUTSTANDING MODIFICATIONS	NA	≤150	133	136	I	65
TEMPORARY MODIFICATIONS (EXCLUDING SCAFFOLDING)	NA	NA	24	25	I	66
ENGINEERING ASSISTANCE REQUEST (EAR) BREAKDOWN	NA	≤150	140	129	D	67
ENGINEERING CHANGE NOTICE STATUS	NA	NA	181	166	NA	68
ENGINEERING CHANGE NOTICE BREAKDOWN	NA	≤150>6mo.	NA	NA	NA	69

HUMAN RESOURCESPAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
NUMBER OF PERSONNEL ERRORS REPORTED IN LERs	NA	NA	0	1	I	70
LER ROOT CAUSE BREAKDOWN	NA	NA	NA	NA	NA	71
STAFFING LEVEL	NA	NA	NA	NA	NA	72
PERSONNEL TURNOVER RATE	NA	NA	NA	NA	NA	72

TRAINING AND QUALIFICATIONPAGE

	<u>INDUSTRY</u> <u>UPPER 10%</u>	<u>OPPD</u> <u>GOAL</u>	<u>OPPD</u> <u>THIS MONTH</u>	<u>OPPD</u> <u>LAST MONTH</u>	<u>TREND</u>	
LICENSED OPERATOR REQUALIFICATION TRAINING	NA	NA	NA	NA	NA	73
LICENSE CANDIDATE EXAMS	NA	NA	NA	NA	NA	74
TOTAL INSTRUCTION HOURS	NA	NA	1,104	1,578	NA	75
TOTAL HOURS OF STUDENT TRAINING	NA	NA	4,604	6,964	NA	76

QUALITY ASSURANCE

PAGE


	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	TREND	
VIOLATIONS PER 1,000 INSPECTION HOURS	NA	≤1.5	2.66	3.03	NMA	77
COMPARISON OF VIOLATIONS AMONG REGION IV PLANTS	NA	NA	NA	NA	NA	78
CUMULATIVE VIOLATIONS AND NCVs (TWELVE-MONTH RUNNING TOTAL)	NA	NA	20.0	19.1	D	79
SIGNIFICANT EVENTS	NA	NA	NA	NA	NA	80
OUTSTANDING CORRECTIVE ACTION REPORTS	NA	NA	74	72	D	81
OVERDUE AND EXTENDED CORRECTIVE ACTION REPORTS	NA	NA	1/3	1/9	I	82
CARs ISSUED vs. SIGNIF. CARs vs. NRC VIOLATIONS ISSUED vs. LERs REPORTED	NA	NA	NA	NA	NA	83

REFUELING OUTAGE

	INDUSTRY UPPER 10%	OPPD GOAL	OPPD THIS MONTH	OPPD LAST MONTH	TREND	
MWO PLANNING STATUS	NA	NA	NA	NA	NA	84
OVERALL PROJECT STATUS	NA	NA	NA	NA	NA	85
PROGRESS OF CYCLE 15 OUTAGE MODIFICATION PLANNING	NA	NA	NA	NA	NA	86
PERFORMANCE INDICATOR DEFINITIONS						87
SAFETY ENHANCEMENT PROGRAM INDEX						95
REPORT DISTRIBUTION LIST						97

TABLE OF CONTENTS/SUMMARY TREND SYMBOLS

A = ADVERSE TREND
 I = IMPROVED PERFORMANCE
 D = DECLINING PERFORMANCE
 NMA = NEEDS MANAGEMENT ATTENTION
 NA = NOT APPLICABLE/AVAILABLE

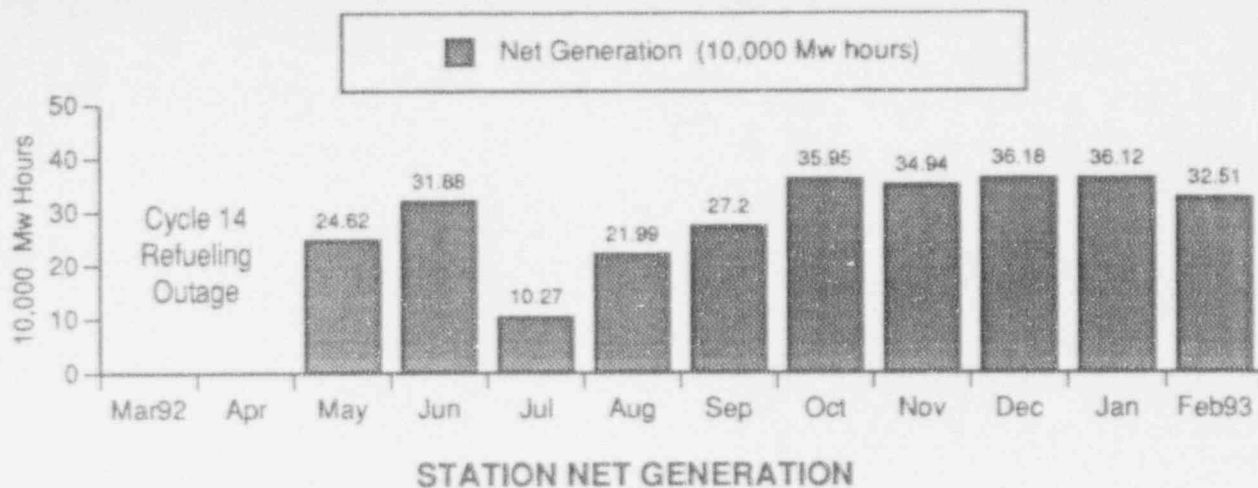

During the month of February 1993 a net total of 325,149 MWH was generated by the Fort Calhoun Station. Late in the month, power was slightly reduced to maintain the peak linear heat rate at less than 90% of the maximum allowed value.

Unplanned energy losses for the month of September 1992 were attributable to the forced outage which began on 8/22/92 when an AC/DC converter failed in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure and the plant tripped on TM/LP. The generator was brought on-line at 2101 hours on 9/5/92.

Unplanned energy losses during August 1992 were the result of the forced outage on 8/22/92 (described above) and the forced outage that began on 8/5/92 when a feeder breaker to the 125V DC panel AI-41A failed resulting in a controlled shutdown to Mode 2. The turbine generator was synchronized to the grid on 8/6/92.


Unplanned energy losses for the month of July 1992 were a result of the forced outage that occurred on 7/3/92 due to the loss of an inverter and the subsequent reactor trip. The generator was brought on-line at 0610 hours on 7/23.

During the month of June 1992 unplanned energy losses were a result of a forced outage that occurred on 6/1/92 due to a dropped control rod. The plant was returned to 100% power on 6/4/92.

The station was returned to service after the Cycle 14 Refueling Outage when the reactor was taken critical on 5/1/92 at 1035 hours and the generator was put on-line on 5/3/92. A forced outage occurred on 5/14/92 when the turbine generator tripped on a false high level moisture separator trip signal which caused a simultaneous reactor trip. The reactor was returned to critical and the generator was put on-line on 5/15/92.

Unplanned energy losses for May 1992 were: 1) the Cycle 14 Refueling Outage extension; 2) the reduction to 58% power for repair of an inoperable condenser valve; 3) the reactor trip; 4) the hold at 48% power for repair on a feedwater pump suction valve; and 5) the 5/31 dropped control rod caused by a faulty clutch coil.

Data Source: Station Generation Report
 Accountability: Chase
 Adverse Trend: None

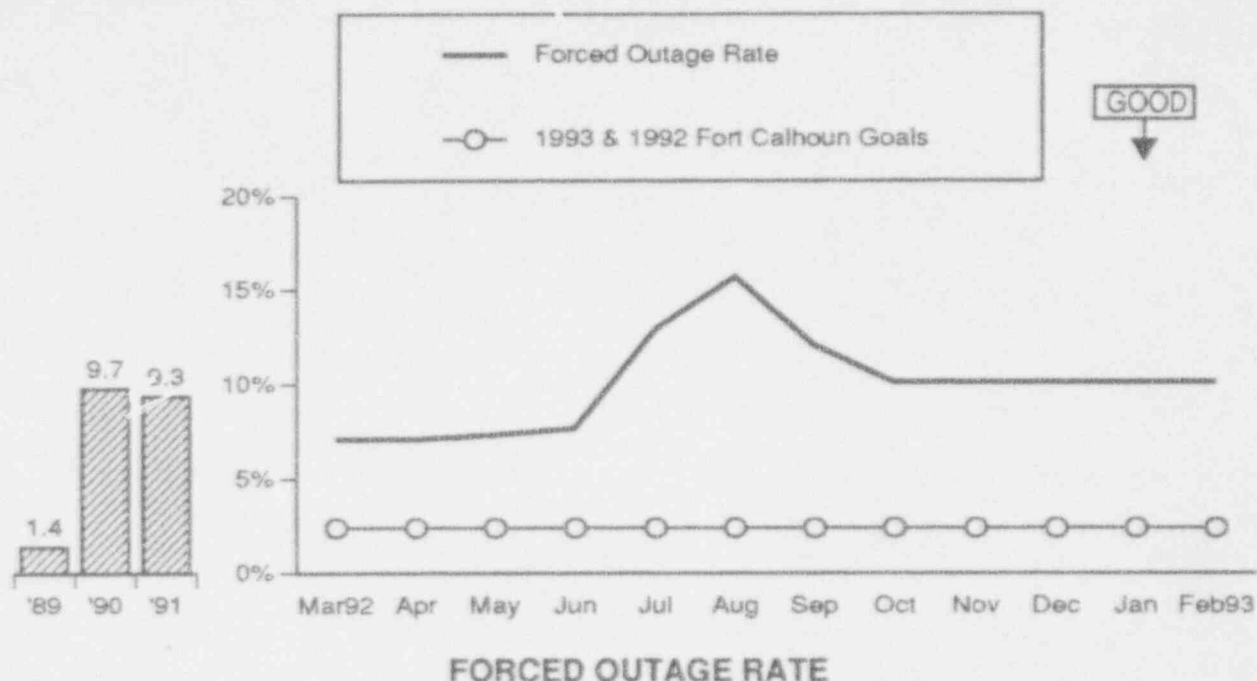

The forced outage rate (FOR) was reported as 10.11% for the twelve months from 3/1/92 to 2/28/93. There were no forced outage hours during the month of February 1993. Because this is a twelve month rate, assuming no additional forced outages, the FOR indicator will not improve until May 1993, when the May 1992 forced outage drops from the twelve month interval.

Forced outage hours for September 1992 were due to the forced outage that began on 8/22/92 when an AC/DC converter failed in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure and the plant tripped on TM/LP. The generator was brought on-line at 2101 hours on 9/5/92.

During the month of August 1992 forced outage hours were due to the forced outage on 8/22/92 (described above) and the forced outage on 8/5/92 when the turbine was taken off-line to replace a feeder breaker to the 125V DC panel AI-41A. The turbine generator was synchronized to the grid on 8/6/92.


A forced outage caused by the loss of an inverter and the subsequent reactor trip occurred on 7/3/92. Additionally, RC-142 opened and failed to reclose. The generator was brought on-line at 0610 hours on 7/23/92.

A forced outage occurred on 6/1/92 when the unit was shutdown due to a dropped control rod. The generator was brought on-line at 0852 on 6/2/92.

A forced outage occurred on 5/14/92 at 1557 hours when the turbine generator tripped on a false high level moisture separator trip signal which caused a simultaneous reactor trip. The generator was brought on-line at 1150 hours at 5/15/92 following repairs.

The 1993 and 1992 Fort Calhoun goals for the Forced Outage Rate are a maximum of 2.4%.

Data Source: Monthly Operations Report & NERC GAD Forms
 Accountability: Chase
 Adverse Trend: None

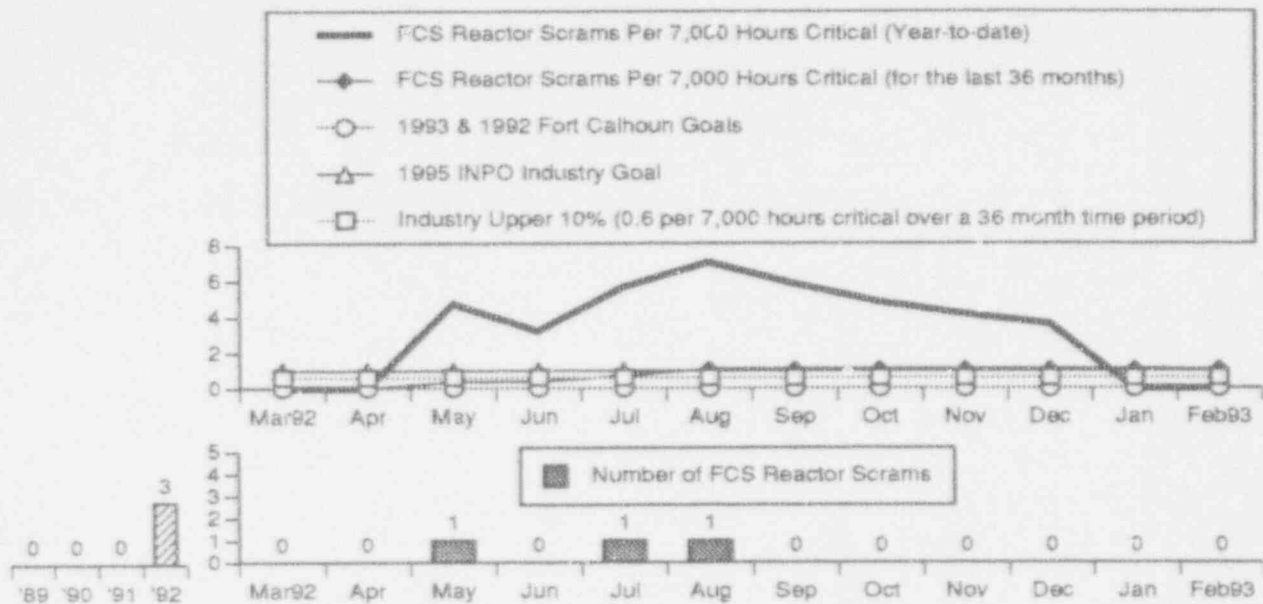

UNPLANNED AUTOMATIC REACTOR SCRAMS PER 7,000 HOURS CRITICAL

The upper graph shows the number of unplanned automatic reactor scrams per 7,000 hours critical (as defined in INPO's 11/91 publication "Detailed Descriptions of International Nuclear Power Plant Performance Indicators and Other Indicators") for Fort Calhoun Station. This value is calculated by multiplying the total number of scrams in a specified time period by 7,000 hours, then dividing that number by the total number of critical hours in the same time period.

The year-to-date station value is 0.0 for the month of February 1993. The value for the last 36 months is 1.07 and it will remain at this value until May 1995, assuming no additional scrams occur.

The lower graph shows the number of unplanned automatic reactor scrams that occurred during each month for the last twelve months.


The last unplanned automatic reactor scram occurred on August 22, 1992 as a result of the failure of an AC/DC converter in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure and the plant tripped on TM/LP.

There was one unplanned automatic reactor scram in July 1992. This scram occurred on July 3 at 2336 as a result of the loss of inverter No. 2.

There was one unplanned automatic reactor scram in May 1992. This scram occurred on May 14 at 1557 when the turbine generator tripped on a false high level moisture separator trip signal which caused a simultaneous reactor trip. The last unplanned automatic reactor scram prior to this occurred on July 2, 1986.

The 1993 and 1992 goals for unplanned automatic reactor scrams per 7,000 hours critical have been set at zero. The 1995 INPO industry goal is one unplanned automatic reactor scram per 7,000 hours critical. The industry upper ten percentile value is approximately 0.6 scrams per 7,000 hours critical for the 36 month time period from 7/89 through 6/92.

Data Source: Monthly Operations Report & Plant Licensee Event Reports (LERs)
 Accountability: Chase
 Adverse Trend: None

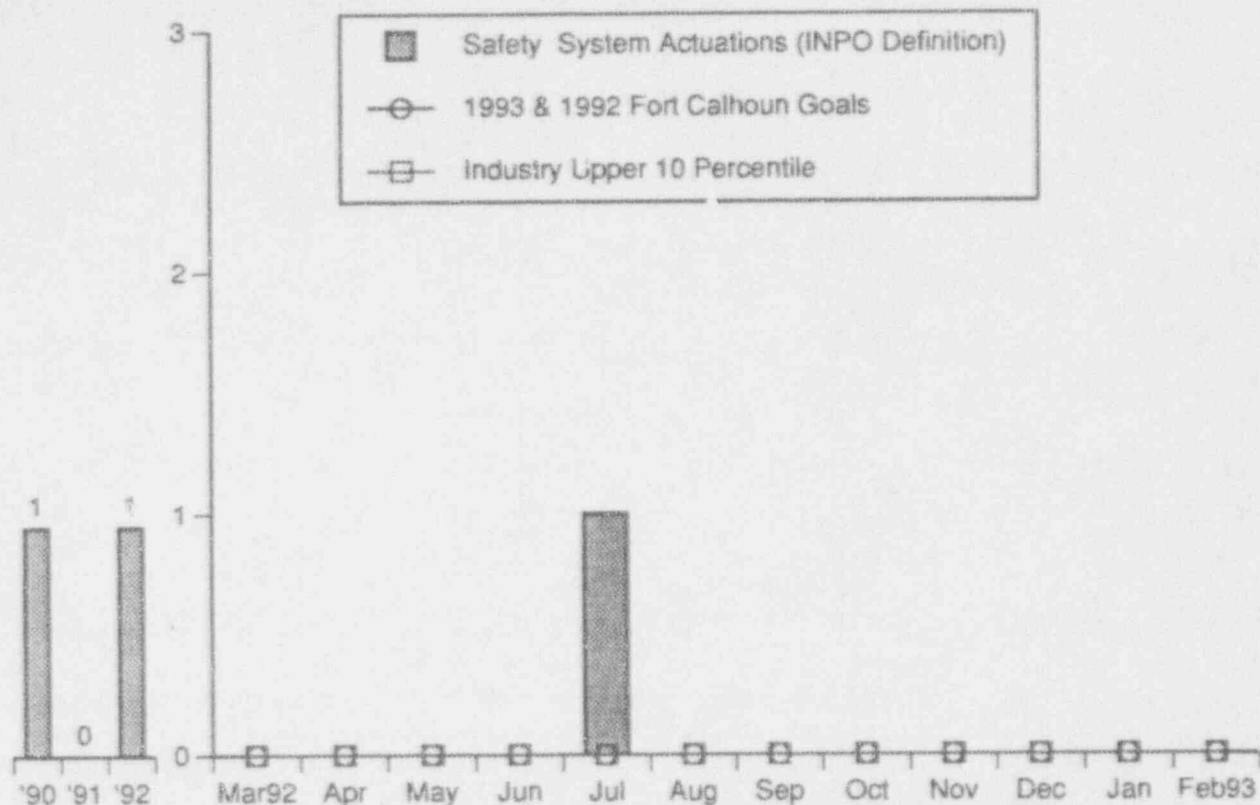

UNPLANNED SAFETY SYSTEM ACTUATIONS - (INPO DEFINITION)

There were no unplanned safety system actuations during the month of February 1993.


There was one unplanned safety system actuation during the month of July 1992 due to the loss of an inverter and the subsequent reactor trip on 7/3/92.

The 1993 and 1992 goals for the number of unplanned safety system actuations are zero.

Data Source: Monthly Operations Report & Plant Licensee Event Reports (LERs)

Accountability: Jaworski/Foley/Ronning

Adverse Trend: None

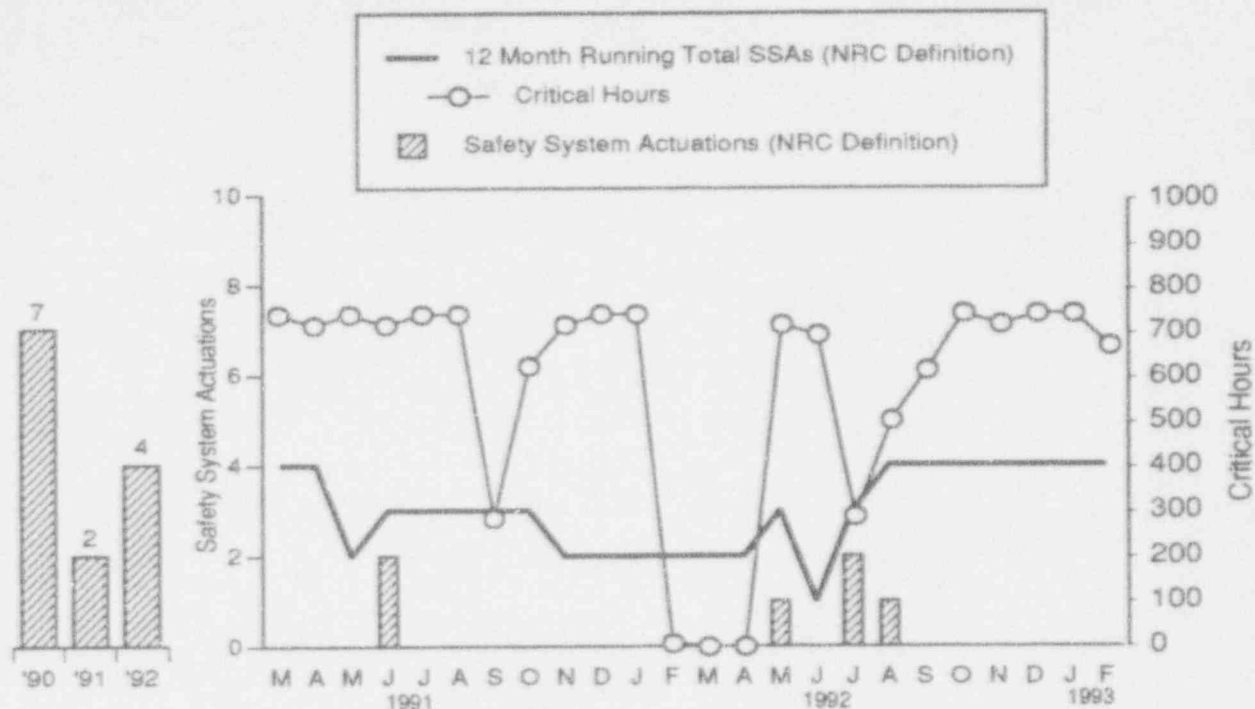

UNPLANNED SAFETY SYSTEM ACTUATIONS - (NRC DEFINITION)

This indicator shows the number of unplanned safety system actuations (SSAs), which includes the High and Low Pressure Safety Injection Systems, the Safety Injection Tanks, and the Emergency Diesel Generators. The NRC classification of SSAs includes actuations when major equipment is operated and when the logic systems for these safety systems are challenged.

There were no unplanned safety system actuations during the month of February 1993.


The last unplanned safety system actuation occurred on August 22, 1992 due to the failure of an AC/DC converter in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure during a plant transient and trip.

Two unplanned safety system actuations occurred in July 1992: 1) On July 3 there was an inverter failure and the subsequent reactor trip; 2) On July 23 there was an unplanned diesel generator start when an operator performing a surveillance test inadvertently pushed the normal start button instead of the alarm acknowledge button.

An unplanned safety system actuation occurred on May 14, 1992 when the turbine generator tripped on a false high level moisture separator trip signal which caused a simultaneous reactor trip and subsequent anticipatory start signal to both diesel generators.

The 1993 and 1992 Fort Calhoun goals for this indicator are 0.

Data Source: Monthly Operations Report & Plant Licensee Event Reports (LERs)
 Accountability: Jaworski/Foley/Ronning
 Adverse Trend: None

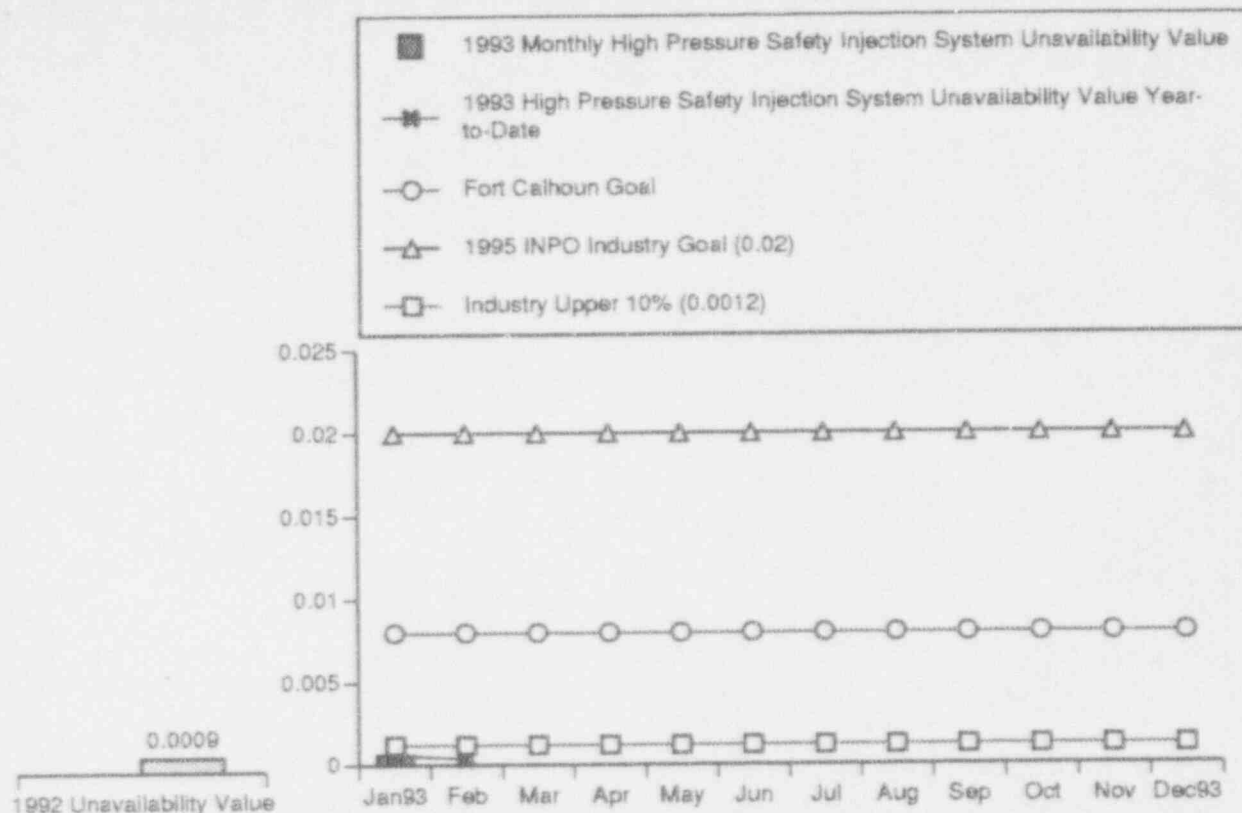

HIGH PRESSURE SAFETY INJECTION SYSTEM SAFETY SYSTEM PERFORMANCE

This indicator shows the High Pressure Safety Injection System unavailability value, as defined by INPO in the Safety System Performance Indicator Definitions, for the reporting month.

The High Pressure Safety injection System unavailability value for the month of February 1993 was 0.0. There were no hours of planned or unplanned unavailability during the month. The 1993 year-to-date HPSI unavailability value was 0.0003 at the end of February.


There were 1.48 hours of planned unavailability for surveillance tests and no hours of unplanned unavailability during the month of January.

In November 1992 there were no (0) hours of planned or unplanned unavailability. There were 1.05 hours of planned unavailability in October. There were no (0) hours of planned or unplanned unavailability in September. There were 1.1 hours of planned unavailability for surveillance tests in August.

In July there were no (0) hours of planned or unplanned unavailability. In June there were 1.5 hours of planned unavailability for surveillance tests and in May there were 1.5 hours of planned unavailability for surveillance tests.

The 1993 and 1992 Fort Calhoun goals for this indicator are a maximum of 0.008. The 1995 INPO industry goal is 0.02 and the industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 0.0012.

Data Source: Jaworski/Schaffer
Accountability: Jaworski/Schaffer
Adverse Trend: None

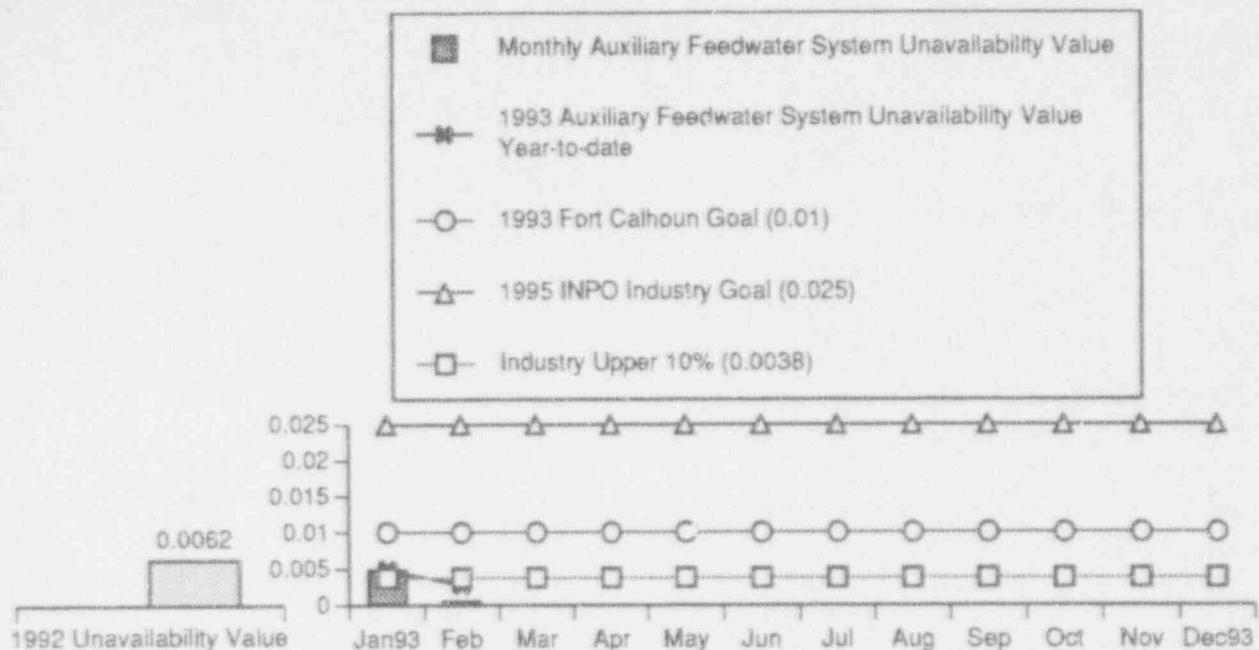

AUXILIARY FEEDWATER SYSTEM SAFETY SYSTEM PERFORMANCE

This indicator shows the Auxiliary Feedwater System Unavailability value, as defined by INPO in the Safety System Performance Indicator Definitions, for the reporting month.

The Auxiliary Feedwater System Unavailability Value for February 1993 was 0.0005. There were 0.73 hours of planned unavailability for surveillance tests during the month. The 1993 year-to-date AFW unavailability value was 0.0028 at the end of February.

There were 7.23 hours of planned unavailability for surveillance tests during January 1993.

There were 4.33 hours of planned unavailability for surveillance tests and FW-6 maintenance during the month of December 1992.

In November, there were 0.35 hours of planned unavailability for surveillance tests.


There were 4.45 hours of planned unavailability for surveillance tests and 16.43 hours of unplanned unavailability for FW-6 during October due to problems incurred during surveillance testing.

There were 0.67 hours of planned unavailability for surveillance tests in September and 16.43 hours of unplanned unavailability for repair of YCV-1045.

There were 1.2 hours of planned unavailability for surveillance tests in August and 1.6 hours of planned unavailability for surveillance tests in July.

The 1993 and 1992 Fort Calhoun year-end goals for this indicator are a maximum value of 0.01. The 1995 INPO industry goal is 0.025 and the industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 0.0038.

Data Source: Jaworski/Nay
Accountability: Jaworski/Nay
Adverse Trend: None

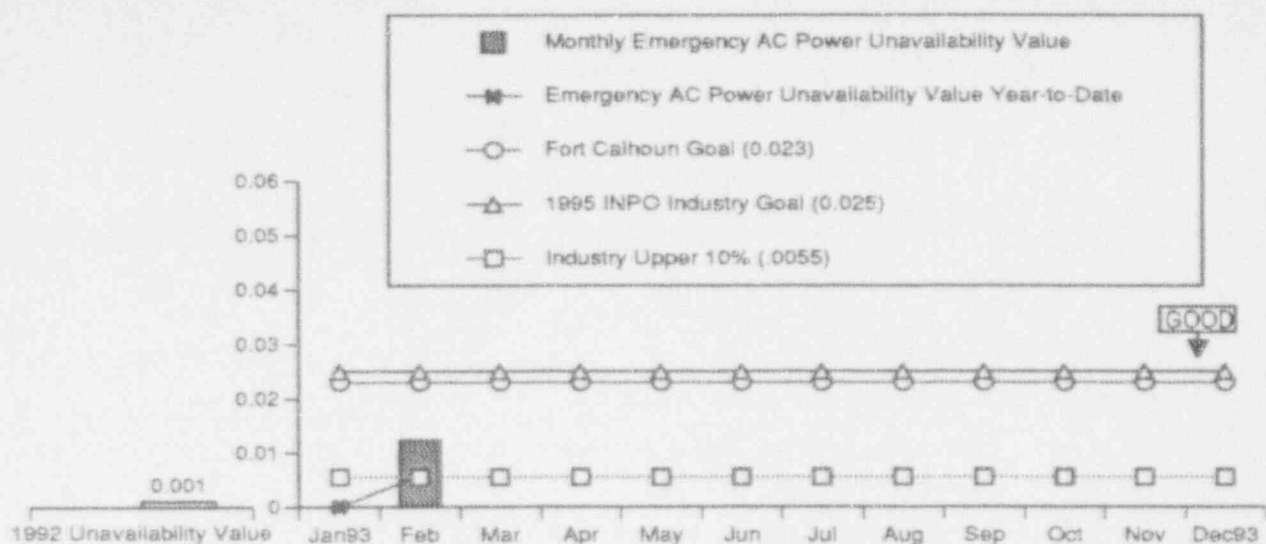

EMERGENCY AC POWER SYSTEM SAFETY SYSTEM PERFORMANCE

This indicator shows the Emergency AC Power System unavailability value, as defined by INPO in the Safety System Performance Indicator Definitions, for the reporting month.

The Emergency AC Power System unavailability value for February 1993 is 0.012. There were no (0) hours of unplanned unavailability and 16.6 hours of planned unavailability for a diesel maintenance outage for DG-2 in February. There were no (0) hours of planned or unplanned unavailability for DG-1 in February. The Emergency AC Power System unavailability value year-to-date is 0.006.

There were no (0) hours of planned or unplanned unavailability for DG-1 in December 1992. There were 6.67 hours of planned unavailability for maintenance and no (0) hours of unplanned unavailability for DG-2 in December.


There were no (0) hours of planned or unplanned unavailability for DG-1 or DG-2 from September through October. There were 2.9 hours of planned unavailability for DG-1 in August to inspect relays for contact degradation.

In July there were no (zero) hours of planned or unplanned unavailability. In June 1992 there were 9 hours of planned unavailability for DG-2 for retorquing radiator fan retaining bolts.

In May 1992 there were 7.9 hours of planned unavailability for DG-1 to tighten the fan blades and repair a starting air solenoid valve.

The 1993 Fort Calhoun goal for this indicator is 0.023. The 1992 goal was 0.024. The 1995 INPO industry goal is 0.025 and the industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 0.0055.

Data Source: Jaworski/Ronning
Accountability: Jaworski/Ronning
Adverse Trend: None

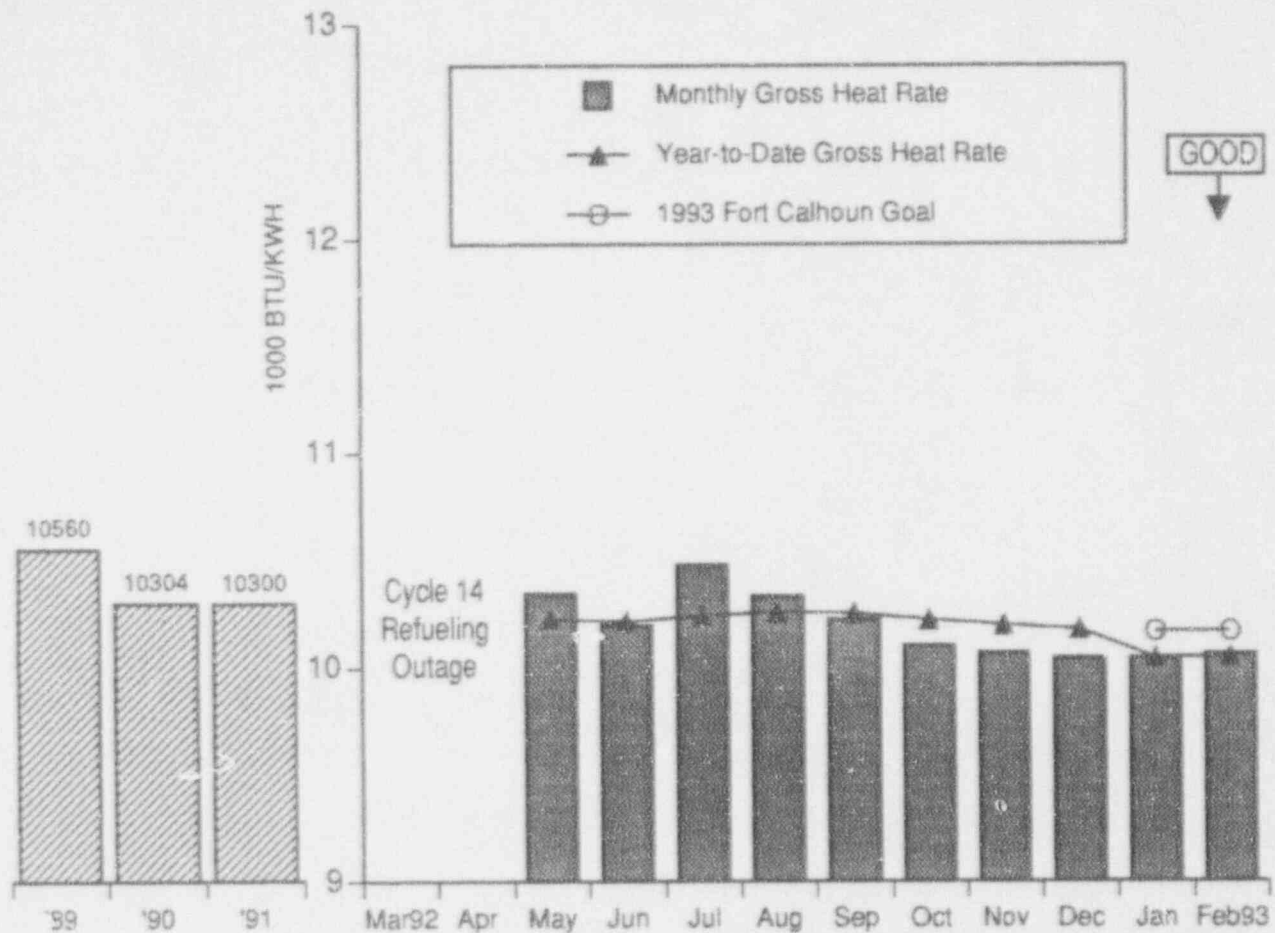

GROSS HEAT RATE

This indicator shows the Gross Heat Rate (GHR) for the reporting month, the year-to-date GHR, the 1993 goal and the year-end GHR for the previous 3 years.

The gross heat rate for the Fort Calhoun Station was reported as 10,061 BTU/KWH for the month of February 1993. When the plant operates at a nominal 100% power, the monthly gross heat rate improves during winter months as a result of the decrease in river water temperature. This is because the gross heat rate is not normalized to the design river water temperature of 60 degrees Fahrenheit.


The year-to-date gross heat rate was reported as 10,051 BTU/KWH at the end of February.

The 1993 year-end gross heat rate goal is a maximum of 10,168 BTU/KWH.

Data Source: Holthaus/Gray (Manager/Source)

Accountability: Chase/Jaworski

Adverse Trends: None

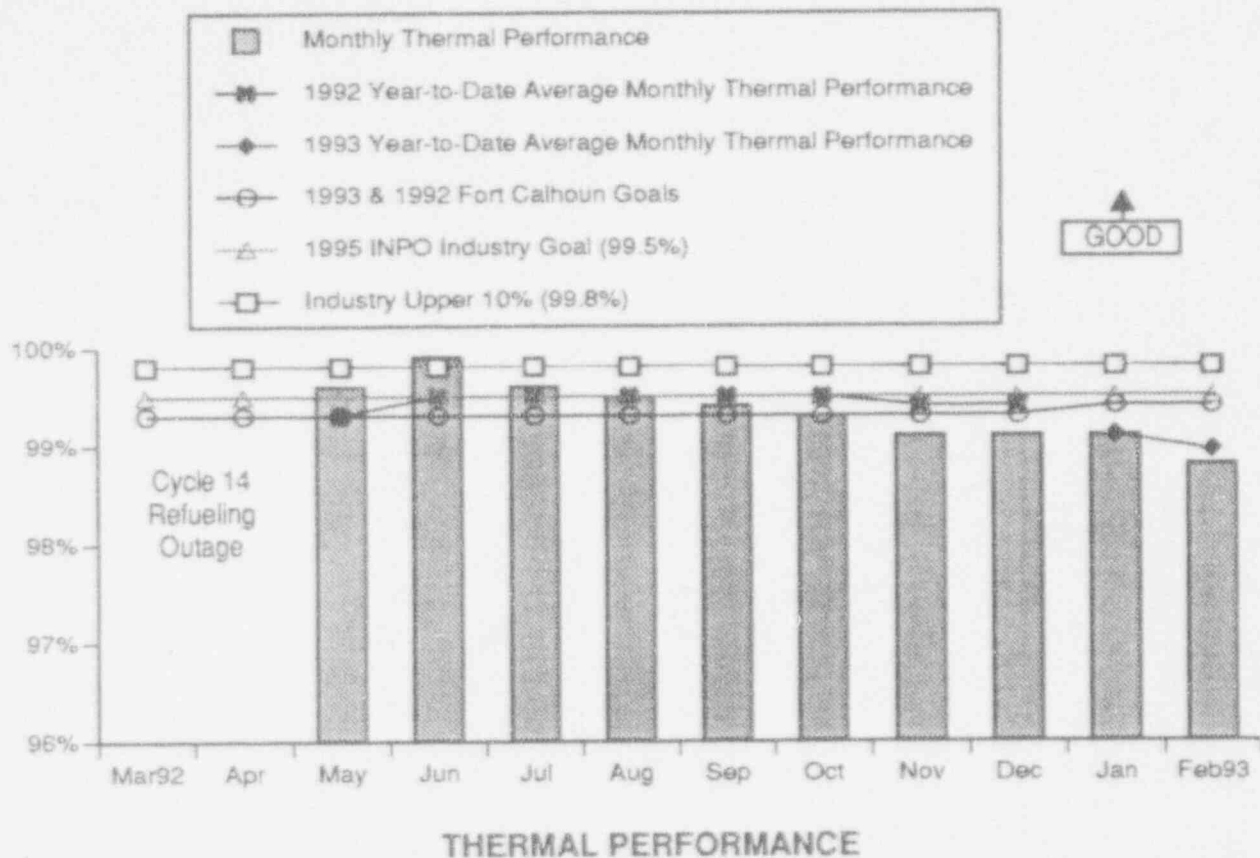

This indicator shows the Thermal Performance value for the reporting month, the year-to-date average thermal performance value, the 1993 and 1992 Fort Calhoun goals, the 1995 INPO industry goal and the approximate industry upper ten percentile value.

The thermal performance value for February 1993 was 98.8%. The year-to-date average monthly thermal performance value was 98.95%.

The continued decline in thermal performance values is attributed to circulating water flow reductions possibly caused by condenser fouling and/or circ. water pump degradation.


System Engineering Department plans to evaluate condenser and circ. water pump conditions during the next available power reduction.

The 1993 Fort Calhoun Goal for this indicator is a minimum of 99.4%. The 1992 goal was a minimum of 99.3%. The 1995 INPO industry goal is 99.5% and the industry upper ten percentile value (for the one year period from 7/91 through 6/92) is approximately 99.8%.

Data Source: Jaworski/Popek

Accountability: Jaworski/Popek

Adverse Trend: The Manager - Station Engineering has identified an adverse trend for this indicator based on continued performance below the goal.

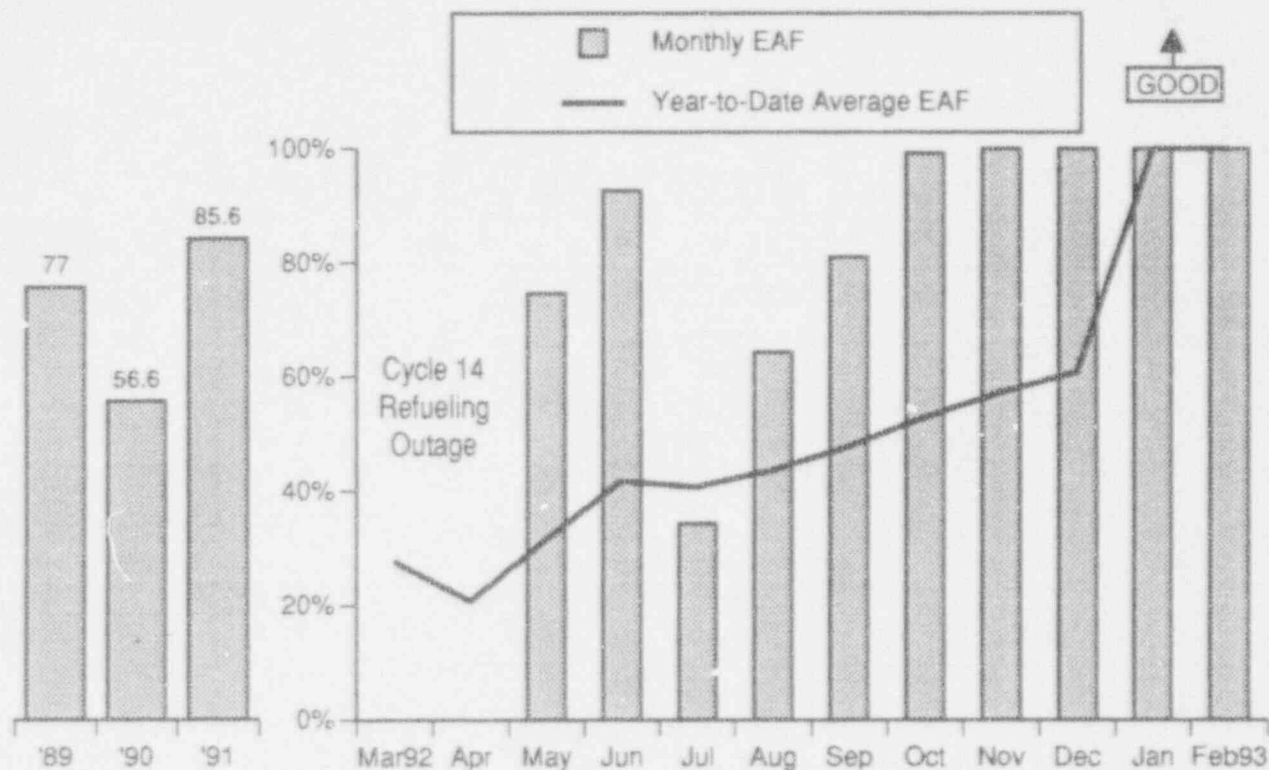

EQUIVALENT AVAILABILITY FACTOR

This indicator shows the plant monthly Equivalent Availability Factor (EAF), the year-to-date average monthly EAF for 1993, and the EAF for the previous 3 years.


The EAF for the month of February 1993 was reported as 100%. The year-to-date average monthly EAF was reported as 100% at the end of January.

The EAF for September 1992 was reported as 81%. This figure is the result of a forced outage that began on 8/22/92 when an AC/DC converter failed in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure during a plant transient and trip. The generator was brought on-line on 9/5/92.

The EAF for August 1992 was reported as 64.29%. This figure is a result of the 8/22/92 forced outage (described above) and a forced outage on 8/5/92 when a feeder breaker to the 125V DC panel AI-41A failed. The turbine generator was synchronized to the grid on 8/6/92.

The EAF for July 1992 was reported as 34.39%. This figure is a result of the forced outage caused by the loss of an inverter and the subsequent reactor trip on 7/3/92. The plant was brought to 90% power on 7/26/92.

Data Source: Dietz/Parra (Manager/Source)
 Accountability: Chase
 Adverse Trend: None

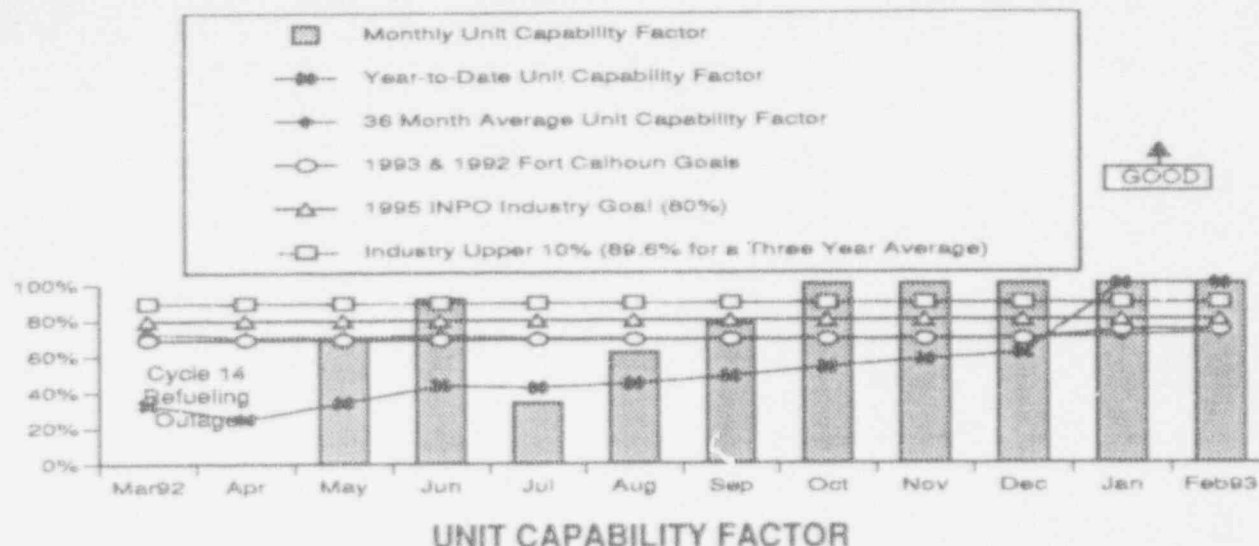

This indicator shows the plant monthly Unit Capability Factor (UCF) value, the 1993 and 1992 year-to-date UCFs, the goals, the 36 month average UCFs, the 1995 INPO industry goal and the approximate industry upper ten percentile value. UCF is defined as the ratio of the available energy generation over a given period of time to the reference energy generation (the energy that could be produced if the unit were operated continuously at full power under reference ambient conditions) over the same time period, expressed as a percentage.

The UCF was reported as 100% for the month of February 1993. The year-to-date unit capability factor was reported as 100%.

The UCF was reported as 77.5% for the month of September 1992. Unplanned energy losses for the month were a result of the forced outage that began on 8/22/92 when an AC/DC converter failed in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure during a plant transient and trip. The generator was brought on-line at 2101 hours on 9/5/92.

The UCF was reported as 62% for the month of August 1992. Unplanned energy losses for the month were a result of the 8/22/92 forced outage (described above) and the forced outage on 8/5/92 when a feeder breaker to the 125V DC panel AI-41A failed. The turbine generator was synchronized to the grid on 8/6/92.

The UCF was reported as 34% for the month of July 1992. Energy losses for the month were due to the forced outage caused by the loss of an inverter and the subsequent reactor trip on 7/3/92. The plant was brought to 90% power on 7/26/92.


The 1995 INPO industry goal is 80% and the industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 89.6%.

The 1993 Fort Calhoun goal for Unit Capability Factor is 74.1%. The basis for this goal is 56 days for the Cycle 15 Refueling Outage, 20 days rampup (10 full power equivalent days), unplanned loss of 11.5 full power equivalent days, and 10 day ramp up (5 full power equivalent days), mini outage of 7 full power equivalent days, and 10 day ramp up (5 full power equivalent days).

Data Source: Generation Totals Report & Monthly Operating Report

Accountability: Chase

Adverse Trend: None

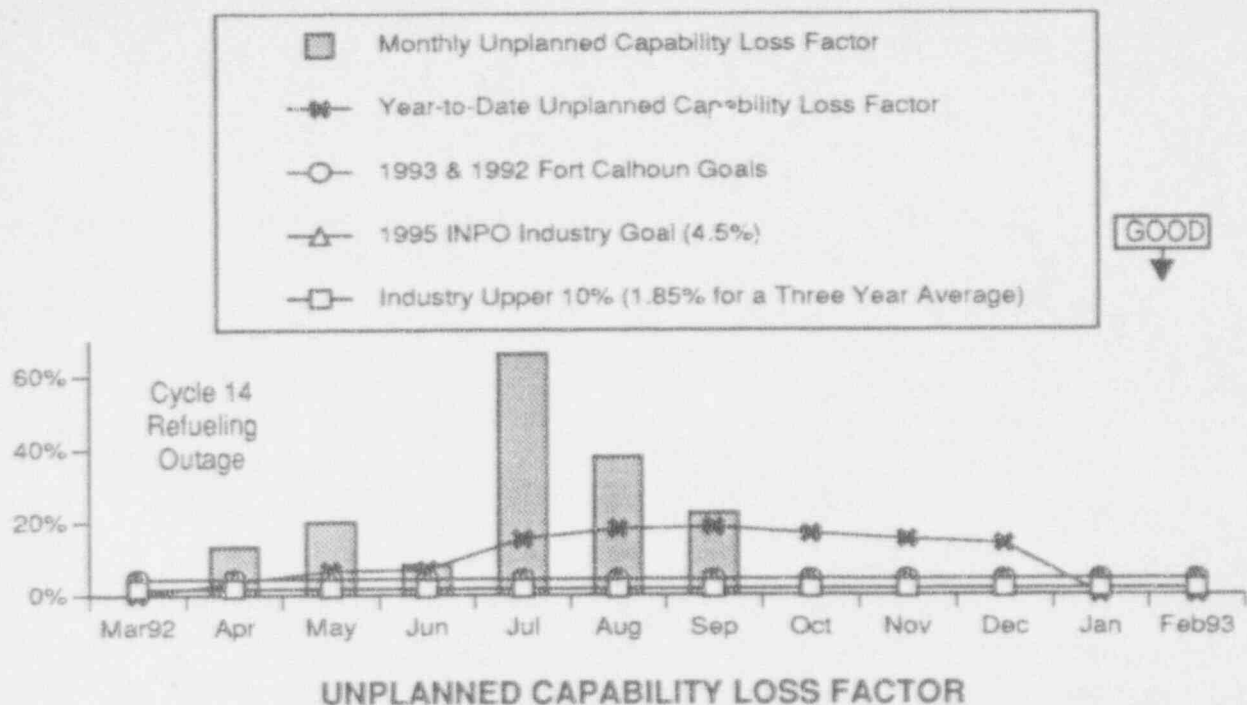

This indicator shows the plant monthly Unplanned Capability Loss Factor (UCLF), the 1993 and 1992 year-to-date UCLFs, the goals, the 1995 INPO industry goal and the approximate industry upper ten percentile value. UCLF is defined as the ratio of the unplanned energy losses during a given period of time, to the reference energy generation (the energy that could be produced if the unit were operated continuously at full power under reference ambient conditions), expressed as a percentage.

The UCLF was reported as 0% for the month of February 1993. The year-to-date UCLF for 1993 is 0%.

The UCLF was reported as 22.5% for the month of September 1992. Unplanned energy losses for the month were a result of the forced outage that began on 8/22/92 when an AC/DC converter failed in the Turbine Electro Hydraulic Control system.


The UCLF was reported as 38% for the month of August 1992. Unplanned energy losses for the month were a result of the 8/22/92 forced outage (described above) and the forced outage on 8/5/92 when a feeder breaker to the 125V DC panel AI-41A failed.

The UCLF was reported as 66% for the month of July 1992. Unplanned energy losses for the month were due to the forced outage caused by the loss of an inverter and the subsequent reactor trip on 7/3/92 and operating at less than full power from 7/23 through 7/31 after bringing the unit back on-line.

The 1995 INPO industry goal is 4.5% and the industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 1.85%.

The 1993 Fort Calhoun goal for Unplanned Capability Loss Factor is 4.5%. The basis for this goal is an unplanned loss of 11.5 full power equivalent days and 10 day ramp up (5 full power equivalent days).

Data Source: Generation Totals Report & Monthly Operating Report
 Accountability: Chase
 Adverse Trend: None

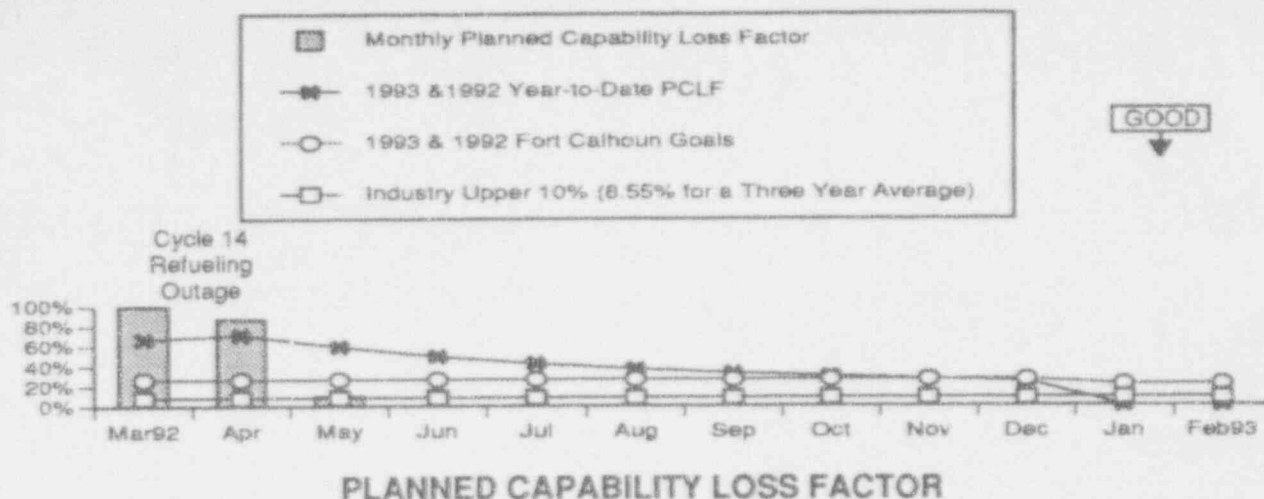

This indicator shows the plant monthly Planned Capability Loss Factor (PCLF), the PCLF year-to-date value, and the Fort Calhoun year-end goals for 1993 and 1992. PCLF is defined as the ratio of the planned energy losses during a given period of time, to the reference energy generation (the energy that could be produced if the unit were operated continuously at full power under reference ambient conditions), expressed as a percentage.

The PCLF was reported as 0% for the month of February 1993. The year-to-date PCLF was reported as 0%.

The PCLF was reported as 0% for the month of September 1992. Energy losses for the month were due to the forced outage that began on 8/22/92 when an AC/DC converter failed in the Turbine Electro Hydraulic Control system. These energy losses were classified as unplanned.


The PCLF was reported as 0% for the month of August 1992. Energy losses for the month were classified as unplanned and were due to the forced outage on 8/22/92 (described above) and the forced outage on 8/5/92 when a feeder breaker to the 125V dc panel AI-41A failed.

The PCLF was reported as 0% for the month of July 1992. Energy losses for July were due to the forced outage caused by the loss of an inverter and the subsequent reactor trip on 7/3/92. These energy losses were classified as unplanned.

The 1993 Fort Calhoun year-end Planned Capability Loss Factor goal is 21.4%. The basis for this goal is 56 days for the Cycle 15 Refueling Outage, and 20 days ramp up (10 full power equivalent days), and a mini outage of 7 full power equivalent days, and 10 day ramp up (5 full power equivalent days).

The PCLF industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 8.55%.

Data Source: Generation Totals Report & Monthly Operating Report
 Accountability: Chase
 Adverse Trend: None

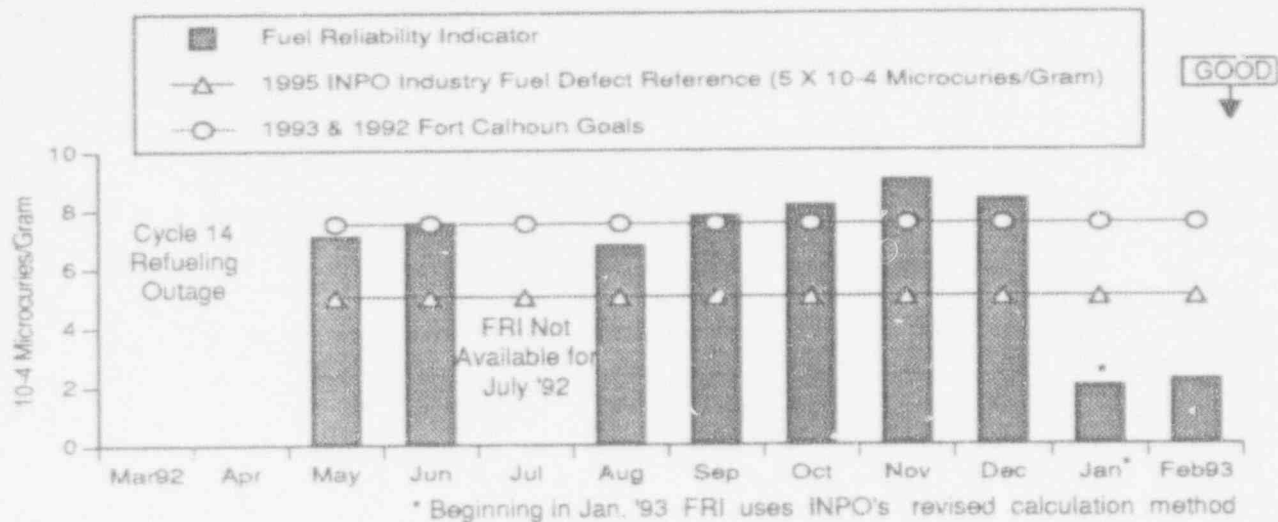

FUEL RELIABILITY INDICATOR

The Fuel Reliability Indicator (FRI) for February 1993 was 2.16×10^{-4} microcuries/gram. This value is comparable to the January FRI of 1.98×10^{-4} microcuries/gram and continues to indicate a defect free core. The monthly FRI is a calculated value based on fission product activities present in the reactor coolant. Its purpose is to monitor industry progress in achieving and maintaining a high level of fuel integrity.


On December 22, 1992 INPO issued changes to the FRI calculation. These changes are implemented in this FRI report. The changes include an improved correction for tramp materials from past fuel defects and the normalization of the indicator results to 100 percent power and a standard linear heat generation rate. The changes will allow the FRI to more consistently differentiate between defect-free cores and cores with one defect. Since the FCS reactor coolant contains relatively high tramp activity, the new INPO calculation results in a smaller FCS FRI value.

The FRI value, using the latest INPO calculation method, is expected to be below the 1993 goal of 7.5×10^{-4} microcuries/gram for the remainder of Cycle 14, without fuel failures. A value of 2.16×10^{-4} microcuries/gram is a favorable FRI for the Fort Calhoun Station at this time in core life and indicates a defect-free core when no Xe-133 activity increases and no iodine spiking are present. This has been confirmed with the Westinghouse Coolant Activity Data Evaluation Code, CADE, and with discussions with the Westinghouse technical expert on fuel failures. The last detected fuel failure was during Cycle 13.

The February 1993 FRI was calculated using the data from February 1 through 28.

The INPO September 1992 Report "Performance Indicators for U.S. Nuclear Utility Industry" (INPO No. 92-011) states that "...the 1995 industry goal for fuel reliability is that units should strive to operate with zero fuel defects. A value above 5.0×10^{-4} microcuries/gram indicates a high probability of unit operation with one or more fuel defects. The determination of current defect-free operation requires more sophisticated analysis by utility reactor engineers." The value of 5.0×10^{-4} microcuries/gram is not an INPO industry goal. It is defined as a "Fuel Defect Reference" number or a "Zero Leaker Threshold". Each utility will calculate whether the core is defect free or not.

Data Source: Holthaus/Guliani
 Accountability: Chase/Spilker
 Adverse Trend: None

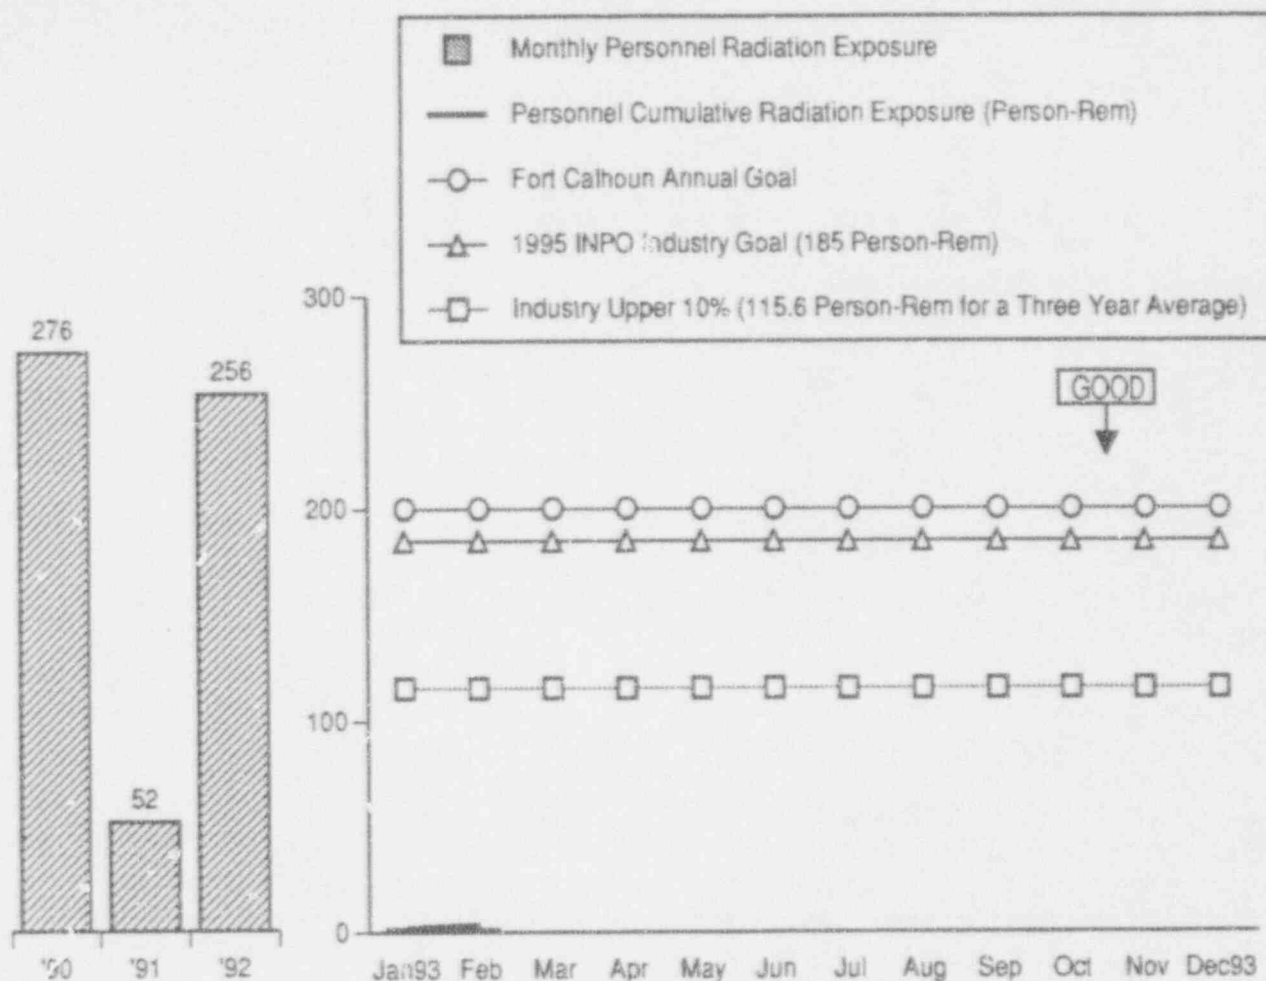

COLLECTIVE RADIATION EXPOSURE


During February 1993, 1.672 person-rem was recorded by TLDs worn by personnel while working at the Fort Calhoun Station. The year-to-date exposure is 3.523 person-rem.

The Fort Calhoun goal for collective radiation exposure during 1993 is a maximum of 200 person-rem.

The 1995 INPO industry goal is 185 person-rem per year. The industry upper ten percentile value (for the three year period from 7/89 through 6/92) is approximately 115.6 person-rem per year. The three year average for Fort Calhoun Station from 7/89 through 6/92 was 194.3 person-rem per year.

Data Source: Chase/Williams (Manager/Source)
 Accountability: Chase/Laurett
 Adverse Trend: None

SEP 54

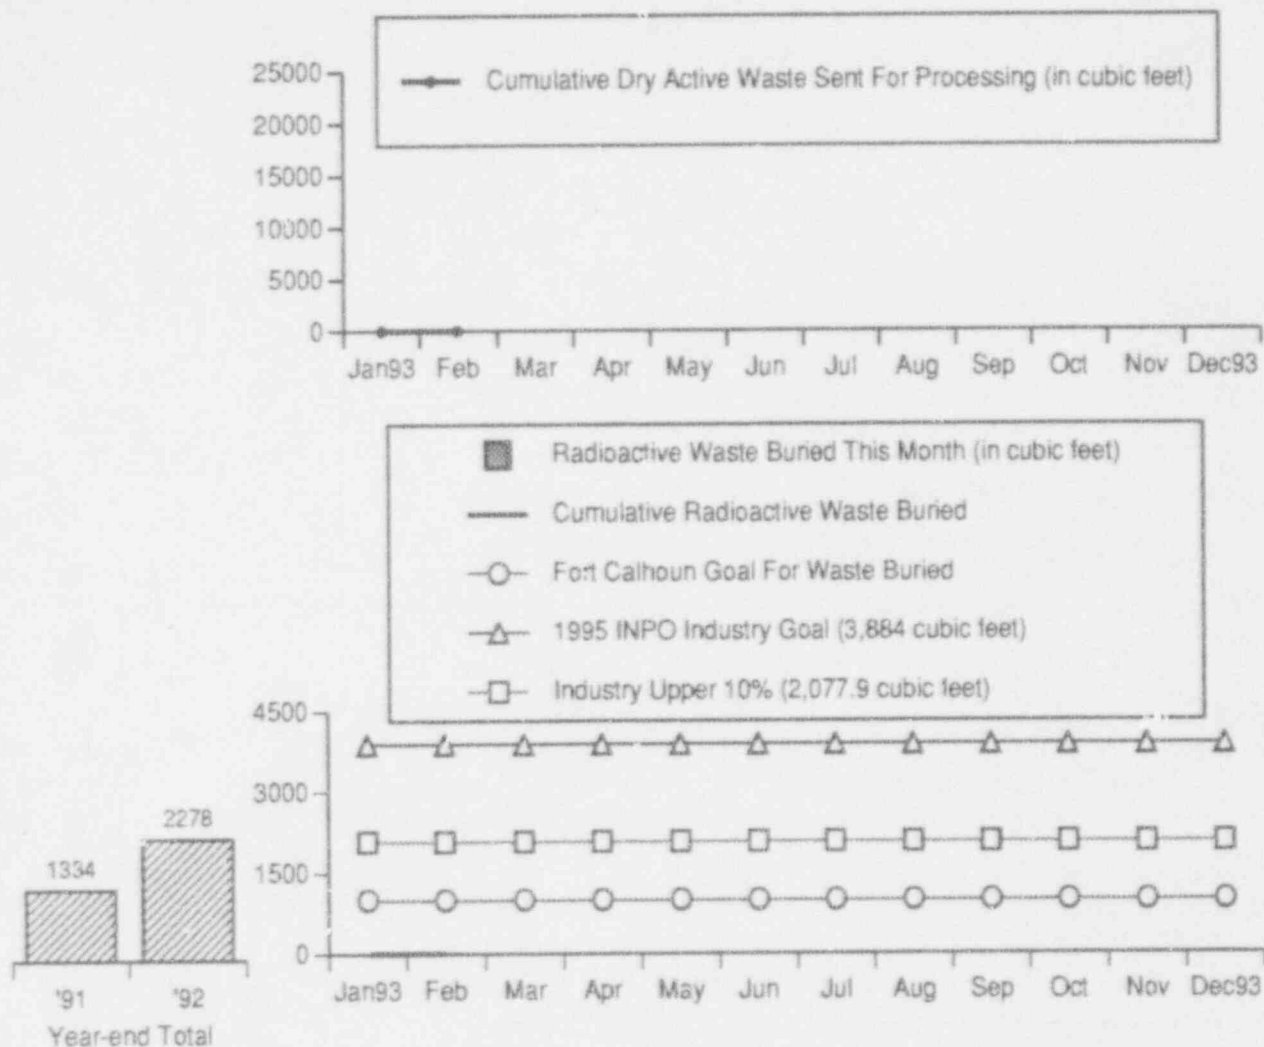

VOLUME OF LOW-LEVEL SOLID RADIOACTIVE WASTE


The upper graph shows the volume of dry radioactive waste sent for processing. The lower graph shows the volume of the monthly radioactive waste buried, the cumulative annual total for radioactive waste buried, and the year-end totals for radioactive waste buried the previous 2 years.

Cumulative amount of solid radwaste shipped off-site for processing (cubic feet)	0.0
Amount of solid radwaste shipped off-site for processing during February (cubic feet)	0.0
Volume of Solid Radwaste Buried during February (cubic feet)	8.1
Cumulative volume of solid radioactive waste buried in 1993 (cubic feet)	8.1
Amount of solid radioactive waste in temporary storage (cubic feet)	0.0

The 1993 Fort Calhoun goal for the volume of solid radioactive waste which has been buried is 1,000 cubic feet. The 1995 INPO industry goal is 110 cubic meters (3,884 cubic feet) per year. The industry upper ten percentile value is approximately 58.85 cubic meters (2,077.9 cubic feet) per year.

Data Source: Chase/Breuer (Manager/Source)
 Accountability: Chase/Lovett
 Adverse Trend: None

SEP 54

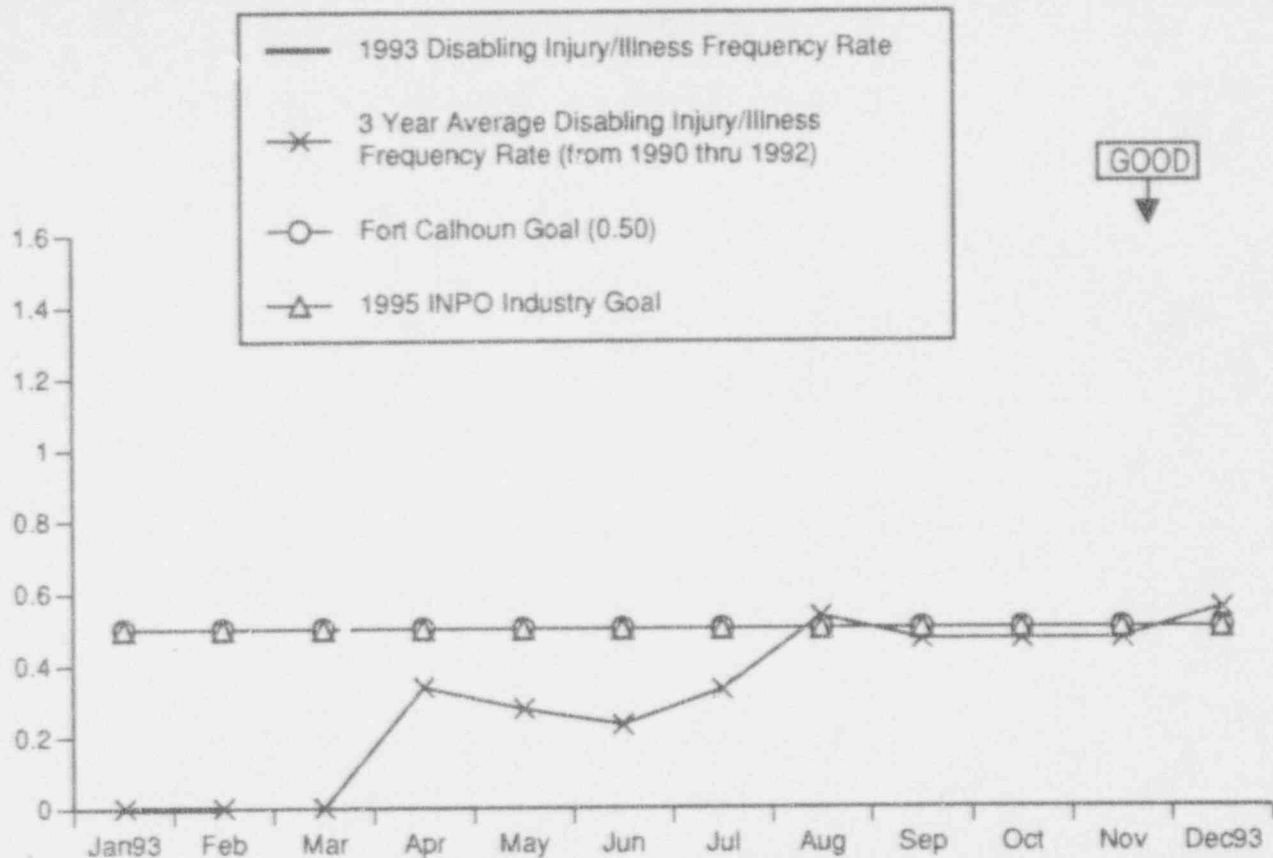

DISABLING INJURY/ILLNESS FREQUENCY RATE (LOST TIME ACCIDENT RATE)

This indicator shows the 1993 disabling injury/illness frequency rate. The 3 year average (from 1990 through 1992) disabling injury/illness frequency rate is also shown.

The disabling injury/illness frequency rate for February 1993 was 0.0. There were no lost time accidents reported for the month of February. The total number of lost time accidents that have been reported during 1993 is 0. The 1993 disabling injury/illness frequency rate goal is a maximum value of 0.50. The 1995 INPO Industry goal is 0.50.


The disabling injury/illness frequency rate for the past twelve months is 0.72.

The industry upper ten percentile disabling injury/illness frequency rate for the twelve months from 7/91 through 6/92 is approximately 0.12.

Year	Year-End Rate
1989	0.4
1990	0.5
1991	0.4
1992	1.05

Data Source: Sorenson/Skaggs (Manager/Source)
 Accountability: Chase/Richard
 Adverse Trend: None

SEP 25, 26 & 27

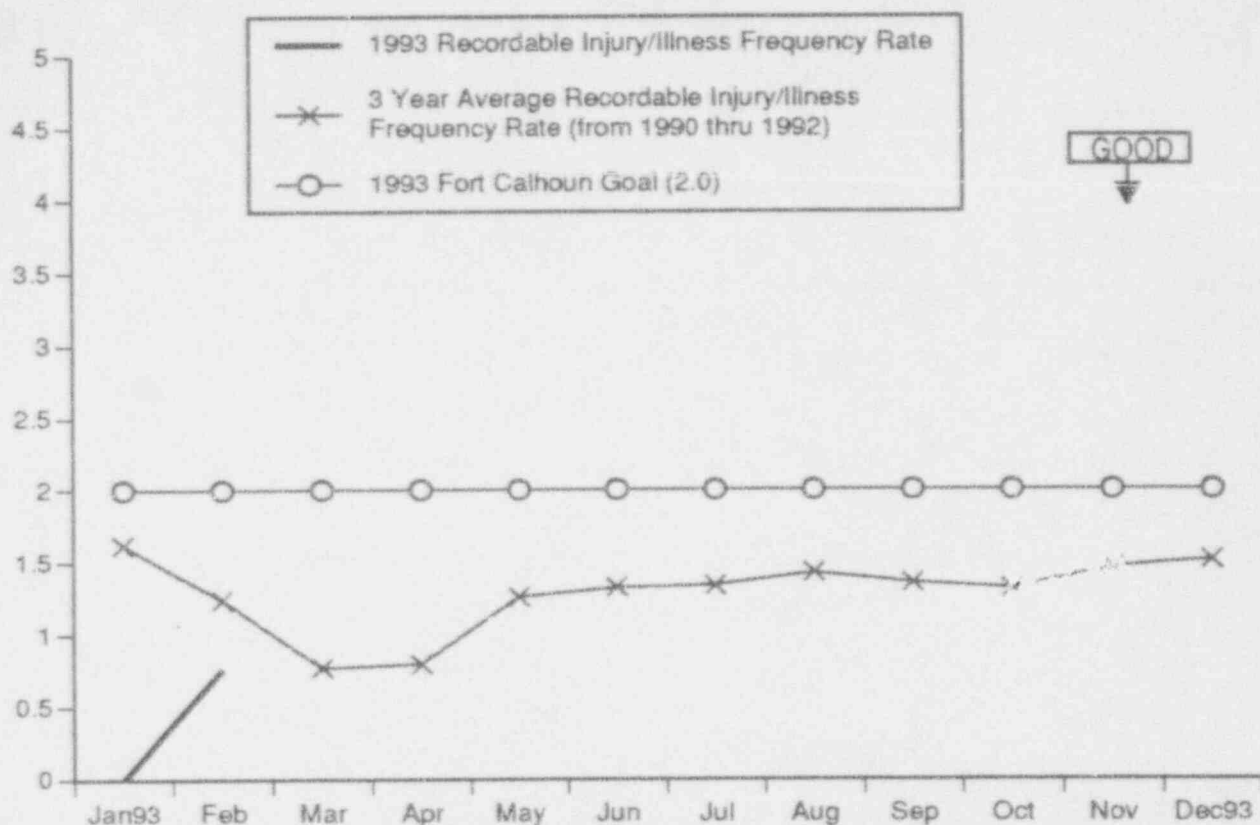

RECORDABLE INJURY/ILLNESS CASES FREQUENCY RATE

This indicator shows the 1993 recordable injury/illness cases frequency rate. The 3 year average (from 1990 through 1992) recordable injury/illness cases frequency rate is also shown.

A recordable injury/illness case is reported if any of the Nuclear Divisions' personnel are injured on the job and require corrective medical treatment beyond first aid. The recordable injury/illness cases frequency rate is computed on a year-to-date basis.

The recordable injury/illness rate for February 1993 was reported as 0.76. There was 1 recordable injury/illness case, a back injury that occurred while lifting, reported for the month of February. There has been 1 recordable injury/illness case in 1993.


The recordable injury/illness rate for the past twelve months is 1.67.

The 1993 goal for this indicator is a maximum value of 2.0.

Year	Recordable Cases	Year-End Rate
1989	11	2.2
1990	11	2.1
1991	18	3.3
1992	18	3.15

Data Source: Sorenson/Skaggs (Manager/Source)
 Accountability: Richard
 Adverse Trend: None

SEP 15, 25, 26 & 27

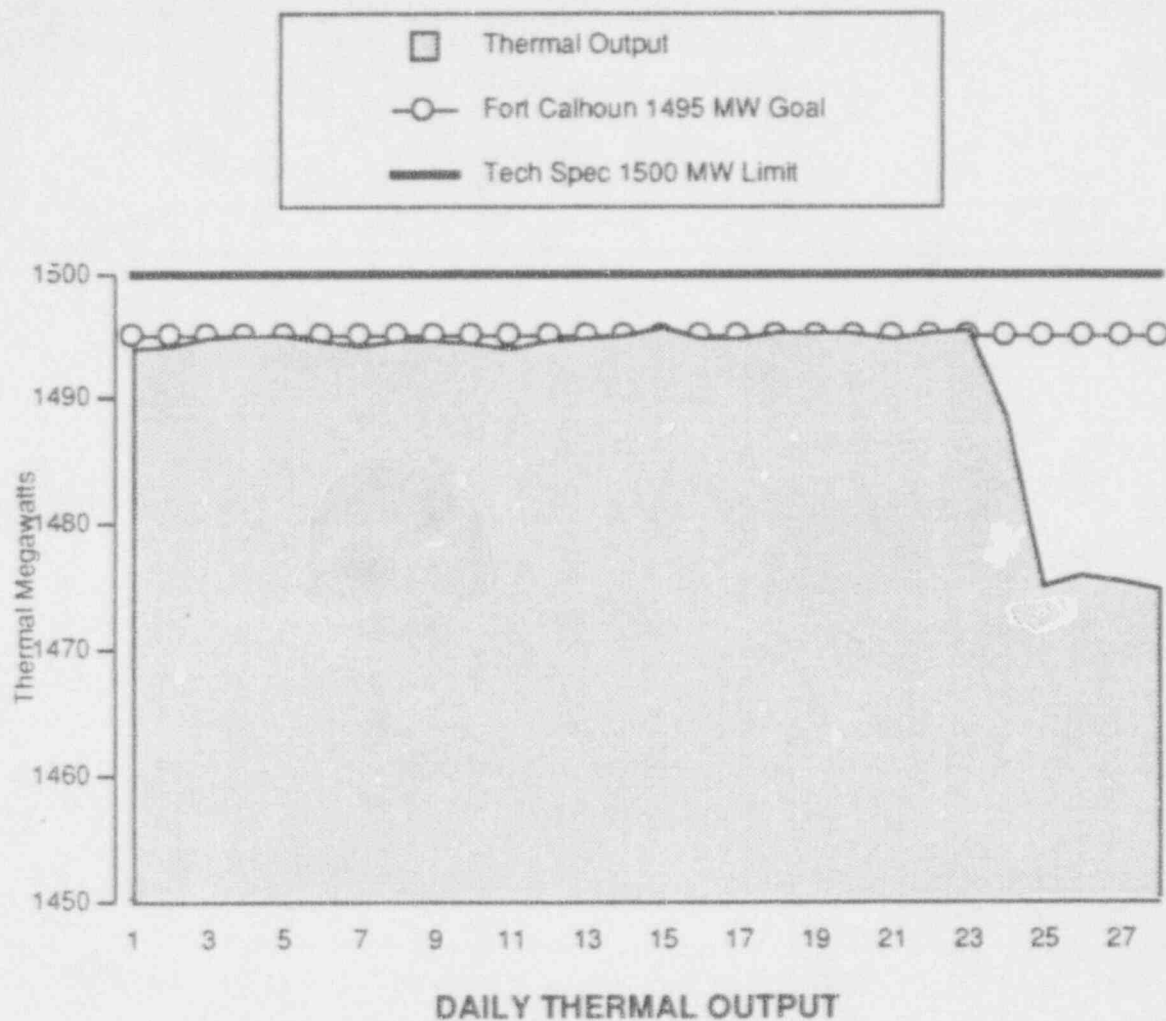


The above thermal output graph displays the daily operating power level during February 1993, the 1500 thermal megawatt average technical specification limit, and the 1495 thermal megawatt Fort Calhoun goal.

A planned power reduction to approximately 98% was initiated at the end of February to maintain the peak linear heat rate (PLHR) at less than 90% of the maximum allowed value and thereby avoid entry into a Tech. Spec. 2 hour LCO in the event of a loss of the ERF computer function to monitor PLHR.

Data Source: Holthaus/Gray (Manager/Source)

Accountability: Chase/Tills

Adverse Trend: None

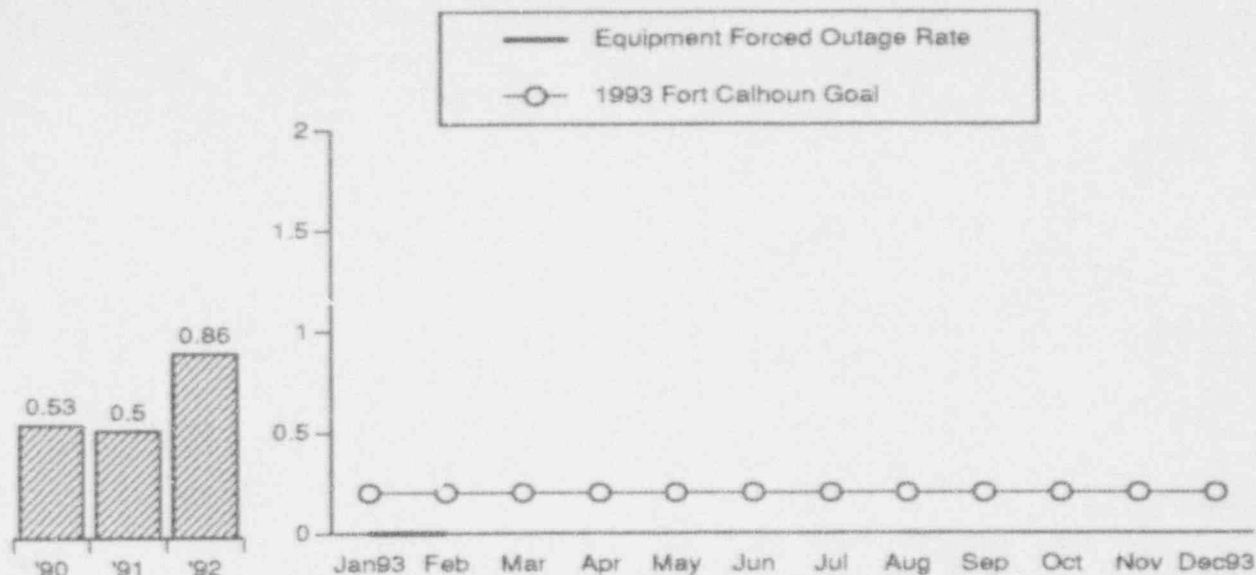

EQUIPMENT FORCED OUTAGES PER 1,000 CRITICAL HOURS

The equipment forced outage rate per 1,000 critical hours was 0.0 for the months from January through February 1993. There were no equipment forced outages during February.

The equipment forced outage that began on August 22, 1992 (described below) continued into September. The generator was brought on-line on 9/5/92.

The following two equipment forced outages occurred in August 1992: 1) on 8/5/92 a feeder breaker to the 125V DC panel AI-41A failed. The turbine generator was synchronized to the grid on 8/6/92; 2) on 8/22/92 an AC/DC converter failed in the Turbine Electro Hydraulic Control system. Pressurizer safety valve RC-142 then opened prior to reaching design pressure during a plant transient and trip. The plant was shutdown for the remainder of the month.



There was one equipment forced outage during July due to the loss of an inverter and the subsequent reactor trip on 7/3/92.

There was one equipment forced outage during June due to a dropped control rod. The rod was dropped at 2305 on 5/31/92 and reactor shutdown commenced at that time. The generator was taken off-line at 0234 on 6/1/92 and was brought back on-line at 0852 on 6/2/92.

There was one equipment forced outage during May. This equipment forced outage occurred on May 14 when the turbine generator tripped on a false high level moisture separator trip signal which caused a simultaneous reactor trip.

The 1993 Fort Calhoun goal for this indicator is a maximum of 0.20.

Data Source: Monthly Operations Report & Plant Licensee Event Reports (LERs)
 Accountability: Chase/Jaworski
 Adverse Trend: None

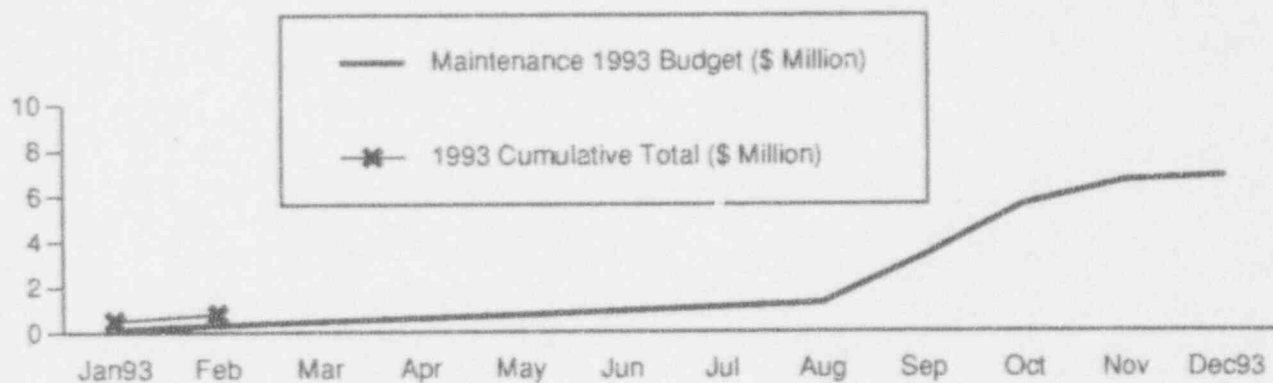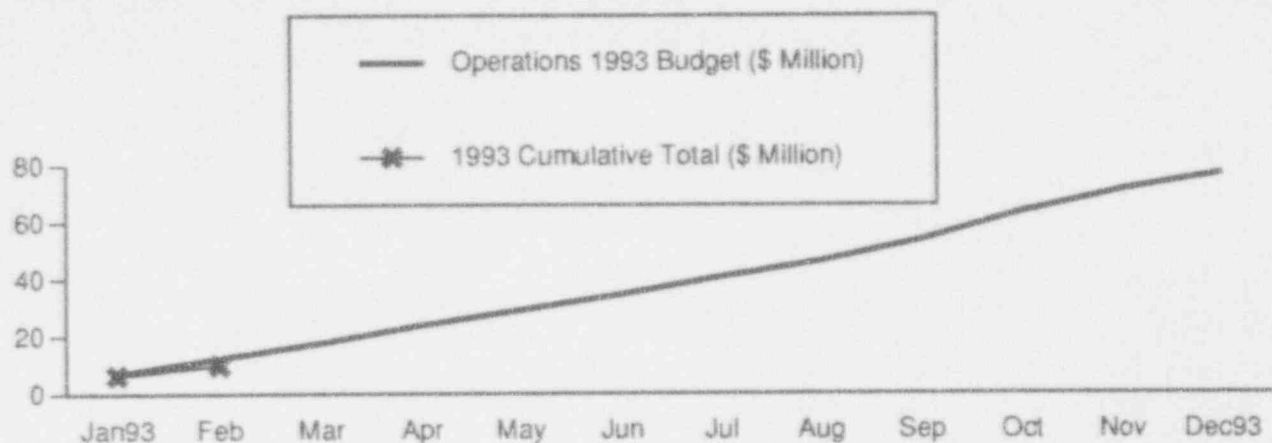

OPERATIONS AND MAINTENANCE BUDGET

The Operations and Maintenance Budget Indicator shows the budget year-to-date as well as the actual expenditures for operations and maintenance for the Fort Calhoun Station.


The budget year-to-date for Operations was 12,413,700 dollars for February 1993 while the actual cumulative expenditures through February totaled 9,918,000 dollars. The 1993 year-end budget for operations has been revised to 76,521,600 dollars, which is a decrease of 96,600 dollars.

The budget year-to-date for Maintenance was 302,100 dollars for February 1993 while the actual cumulative expenditures through February totaled 792,900 dollars. The 1993 year-end budget for maintenance remains at 6,807,900 dollars.

Data Source: Scofield/Parent (Manager/Source)

Accountability: Scofield

Adverse Trend: None

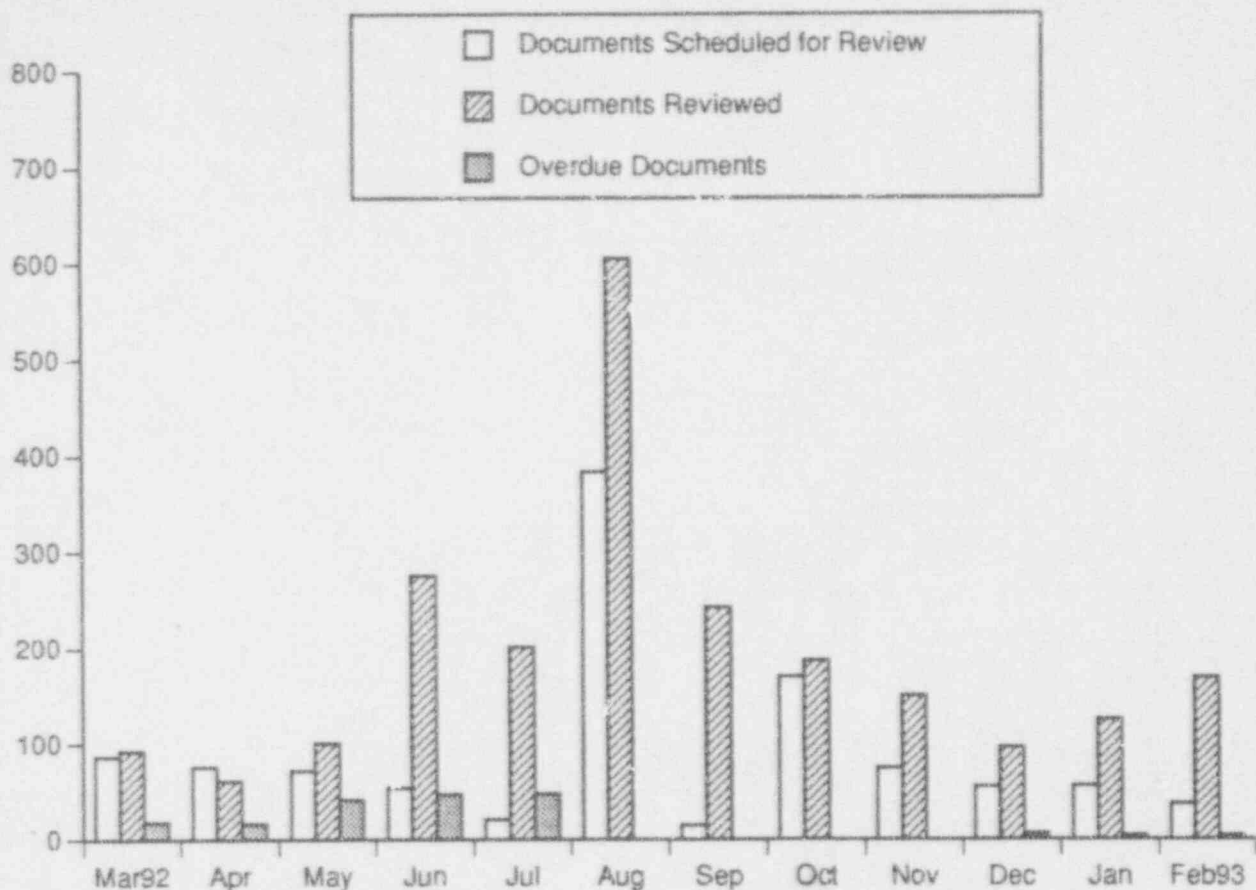

DOCUMENT REVIEW

This indicator shows the number of completed, scheduled, and overdue (greater than 6 months past the scheduled due date) biennial reviews for the reporting month. These document reviews are performed in-house and include Special Procedures, the Site Security Plan, Maintenance Procedures, Preventive Maintenance Procedures, and the Operating Manual.

During February 1993 there were 169 document reviews completed while 37 document reviews were scheduled. At the end of February, there were 4 document reviews more than 6 months overdue. The overdue documents were assigned to the System Engineering Department.


The 1993 monthly goal for this indicator is no (0) documents more than 6 months overdue.

Data Source: Chase/McKay (Manager/Source)

Accountability: Chase/Jaworski

Adverse Trend: None

SEP 46

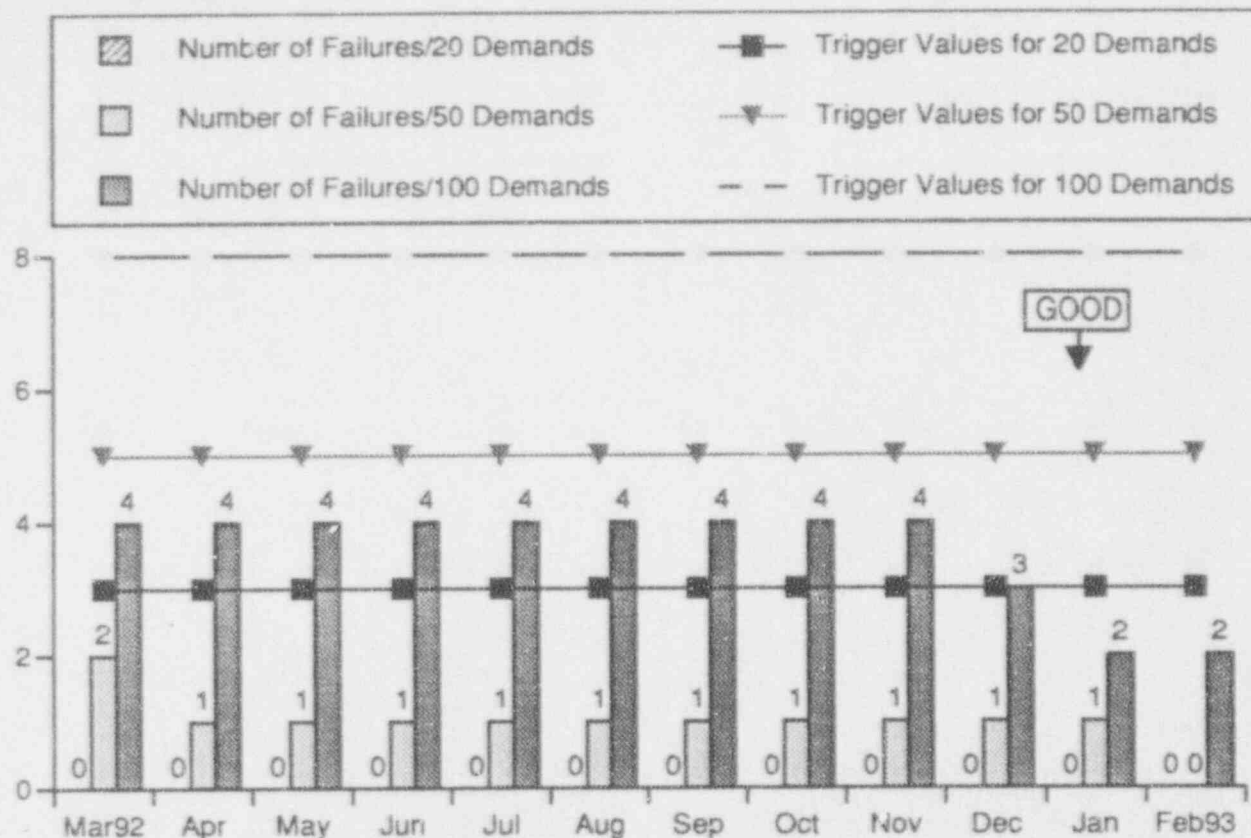


EMERGENCY DIESEL GENERATOR UNIT RELIABILITY

This bar graph shows three monthly indicators pertaining to the number of failures that were reported during the last 20, 50, and 100 emergency diesel generator demands at the Fort Calhoun Station. Also shown are trigger values which correspond to a high level of confidence that a unit's diesel generators have obtained a reliability of greater than or equal to 95% when the failure values are below the corresponding trigger values. The Fort Calhoun 1993 goal is to have fewer failures than these trigger values.

The demands counted for this indicator include the respective number of starts and the respective number of load-runs for both Diesel Generators combined. The number of start demands includes all valid and inadvertent starts, including all start-only demands and all start demands that are followed by load-run demands, whether by automatic or manual initiation. Load-run demands must follow successful starts and meet at least one of the following criteria: a load-run that is a result of a real load signal, a load-run test expected to carry the plant's load and duration as stated in the test specifications, and a special test in which a diesel generator was expected to be operated for a minimum of one hour and to be loaded with at least 50% of design load (see exceptions and other demand criteria in the Definition Section of this report).

Data Source: Jaworski/Ronning (Manager/Source)
 Accountability: Jaworski/Ronning
 Adverse Trend: None

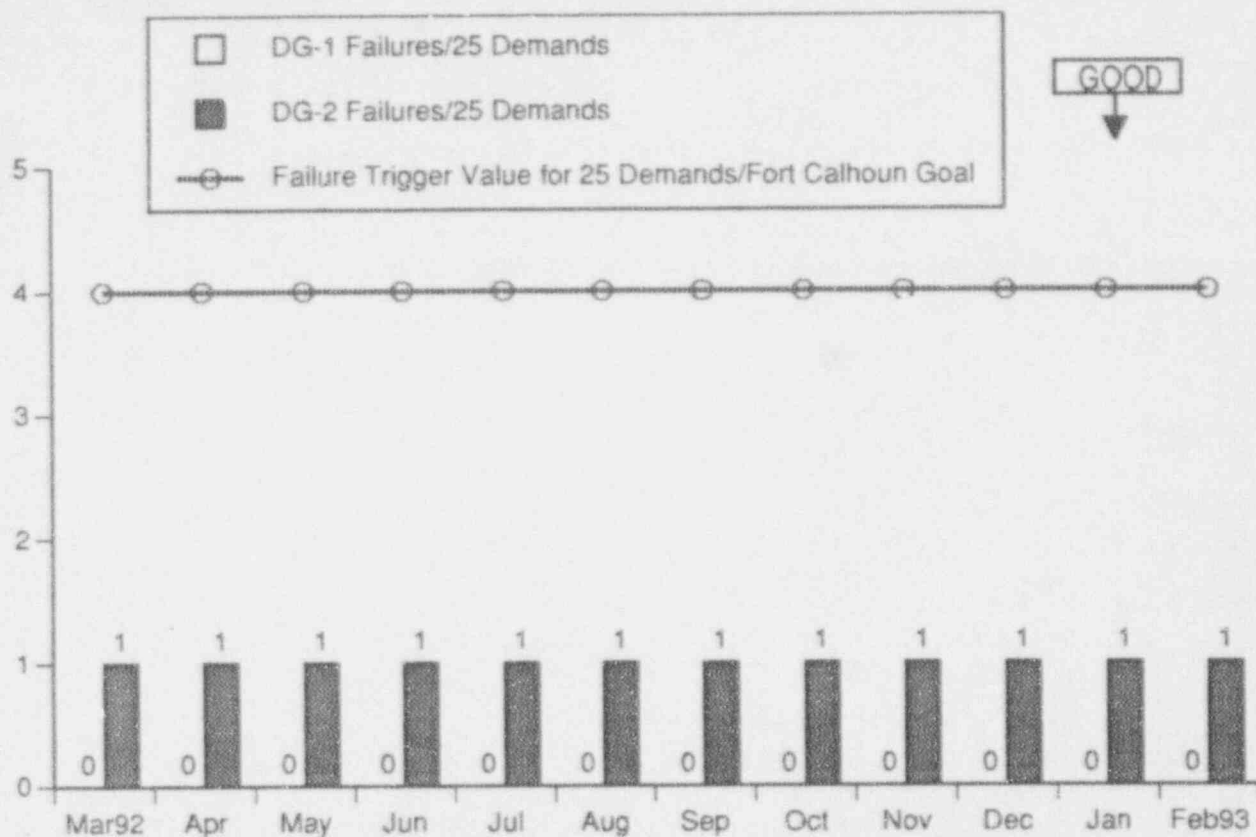

DIESEL GENERATOR RELIABILITY (25 DEMANDS)


This indicator shows the number of failures experienced by each emergency diesel generator during the last 25 start demands and the last 25 load-run demands. A trigger value of 4 failures within the last 25 demands is also shown. This trigger value of 4 failures within 25 demands is the Fort Calhoun goal for 1992.

It must be emphasized that in accordance with NUMARC criteria, certain actions will take place in the event that any one emergency diesel generator experiences 4 or more failures within the last 25 demands on the unit. These actions are described in the Definitions Section of this report. A System Engineering Instruction has been drafted for the Fort Calhoun Station to institutionalize and formally approve/adopt the required NUMARC actions.

Diesel Generator DG-1 has not experienced any failures during the last 25 demands on the unit.

Diesel Generator DG-2 has experienced 1 failure during the last 25 demands on the unit. An air damper roll pin failure occurred in July 1991.

Data Source: Jaworski/Ronning (Manager/Source)
 Accountability: Jaworski/Ronning
 Adverse Trend: None

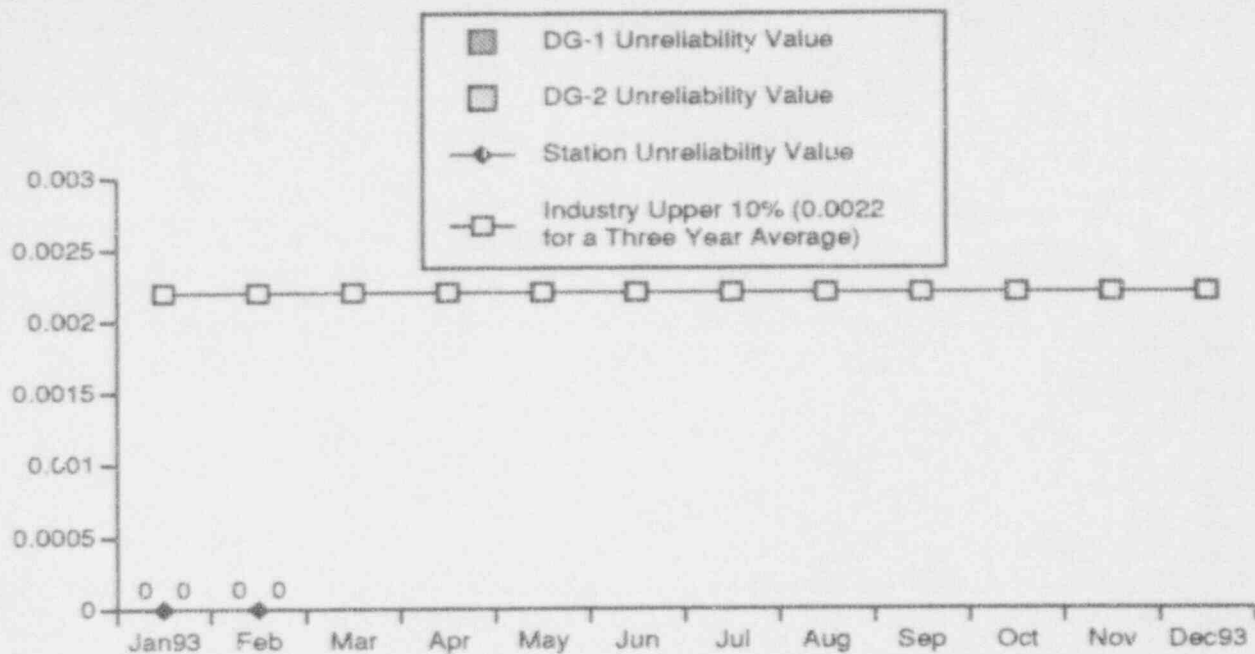

EMERGENCY DIESEL GENERATOR UNRELIABILITY

The purpose of this indicator is to monitor the likelihood that emergency AC power generators will respond to off-normal events or accidents. It also provides an indication of the effectiveness of maintenance, operation and test practices in controlling generator unreliability.

The year-to-date station EDG unreliability value for February 1993 was 0.0.

For DG-1: There were 2 start demands for the reporting month with no failures. In addition, there was 1 load-run demand with no failure.

For DG-2: There was 1 start demand for the reporting month with no failure. In addition, there was 1 load-run demand with no failure.

Emergency diesel generator unreliability is calculated as follows:

$$\text{value per DG} = \text{SU} + \text{LU} - (\text{SU} \times \text{LU})$$

$$\text{where SU} = \text{Start Unreliability} = \frac{\text{number of unsuccessful starts}}{\text{number of valid start demands}}$$



$$\text{LU} = \text{Load-run Unreliability} = \frac{\text{number of unsuccessful load-runs}}{\text{number of valid load-run demands}}$$

$$\text{Station Value} = \text{average of DG-1 and DG-2 values}$$

Data Source: Jaworski/Ronning (Manager/Source)

Accountability: Jaworski/Ronning

Adverse Trend: None

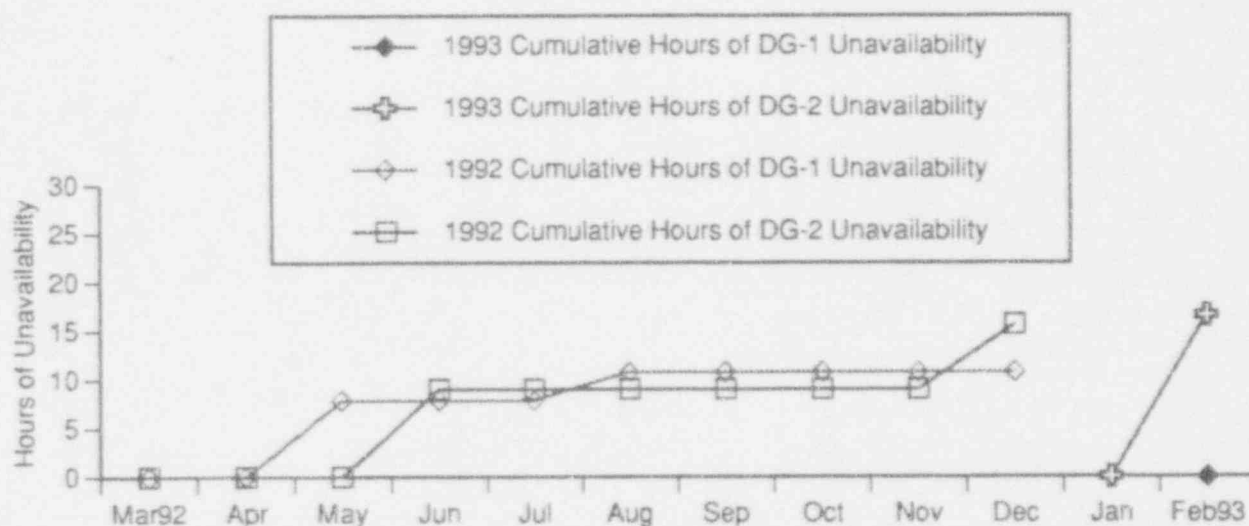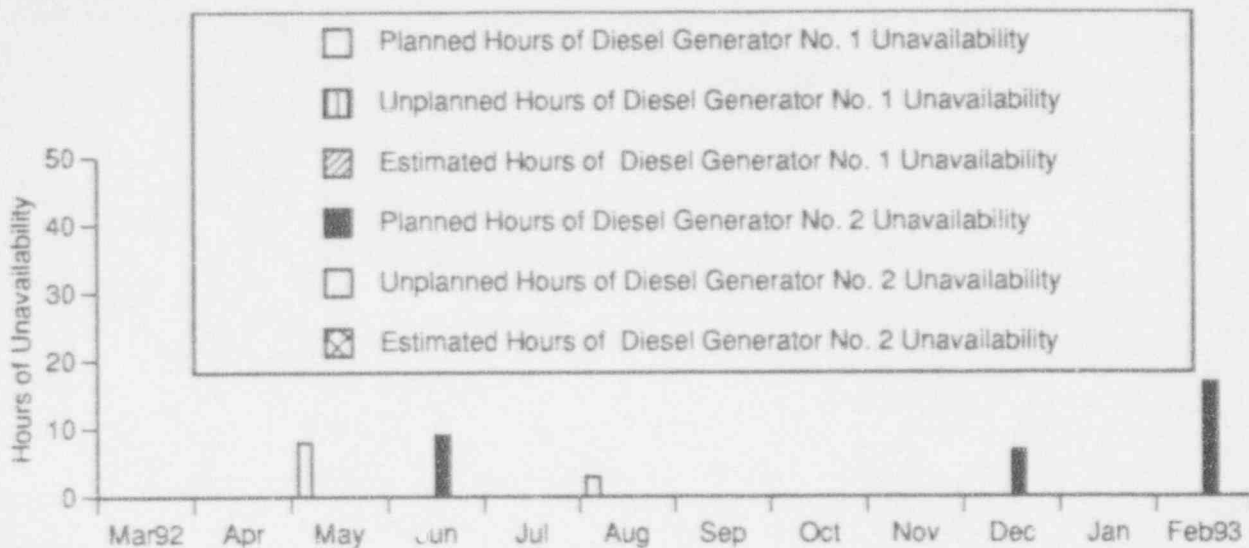


DIESEL GENERATOR UNAVAILABILITY

This indicator provides a monthly illustration of diesel generator unavailability. The top graph shows the diesel generator planned, unplanned, and estimated unavailable hours for DG-1 and DG-2 for each month. The lower graph shows the year-to-date cumulative hours of unavailability for each diesel generator.

During February 1993 there were no hours of planned and unplanned unavailability for DG-1. There were no hours of unplanned unavailability and 16.6 hours of planned unavailability for a diesel maintenance outage for DG-2 during the month to perform several MWOs which will maintain continued DG reliability.

The 1993 Fort Calhoun goal is a maximum of 201.48 hours of unavailability for each diesel generator.

Data Source: Jaworski/Ronning (Manager/Source)
 Accountability: Jaworski/Ronning
 Adverse Trend: None

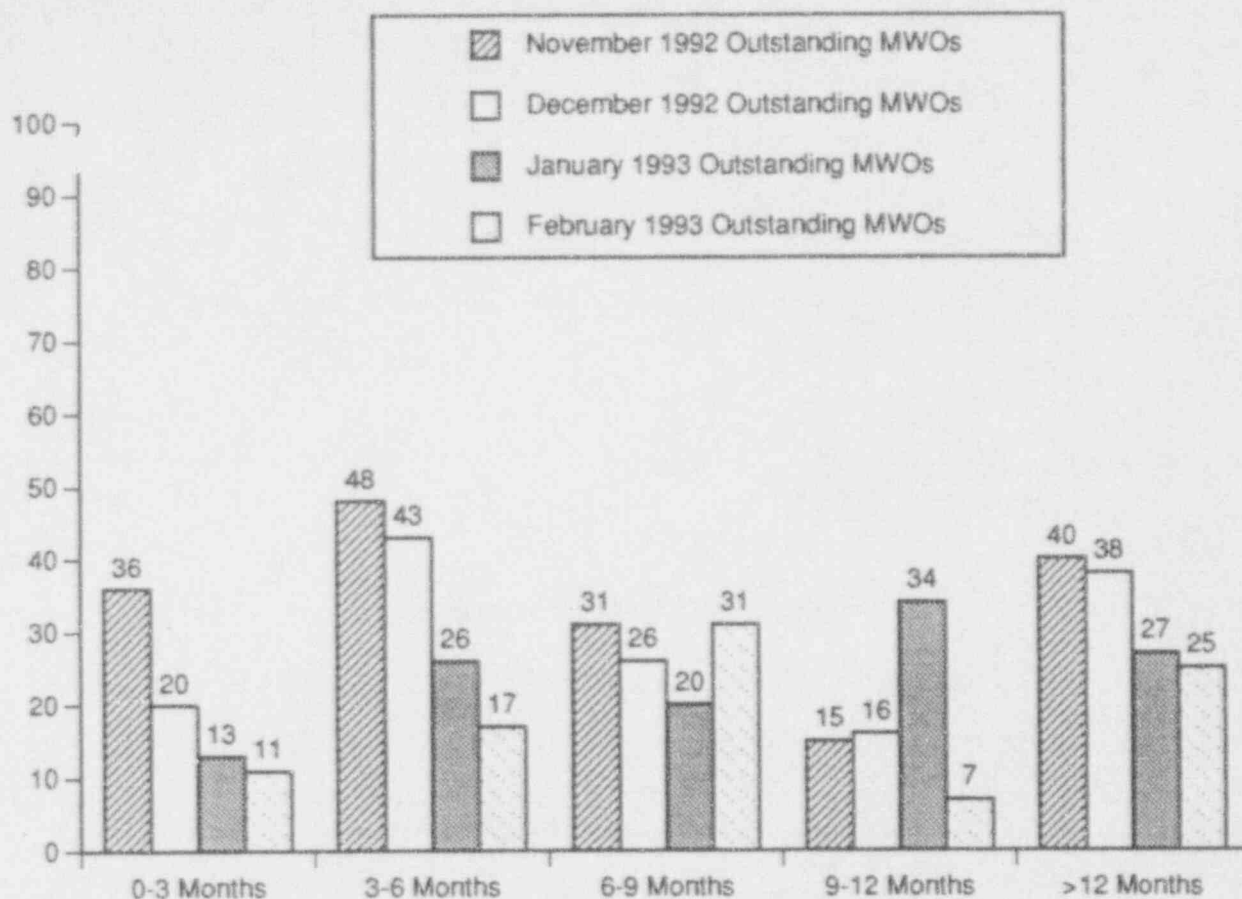


AGE OF OUTSTANDING MAINTENANCE WORK ORDERS (CORRECTIVE NON-OUTAGE)

This indicator shows the age of corrective non-outage maintenance work orders (MWOs) remaining open at the end of the reporting month.

Data Source: Chase/Schmitz (Manager/Source)

Accountability: Chase/ Bobba

Adverse Trend: None

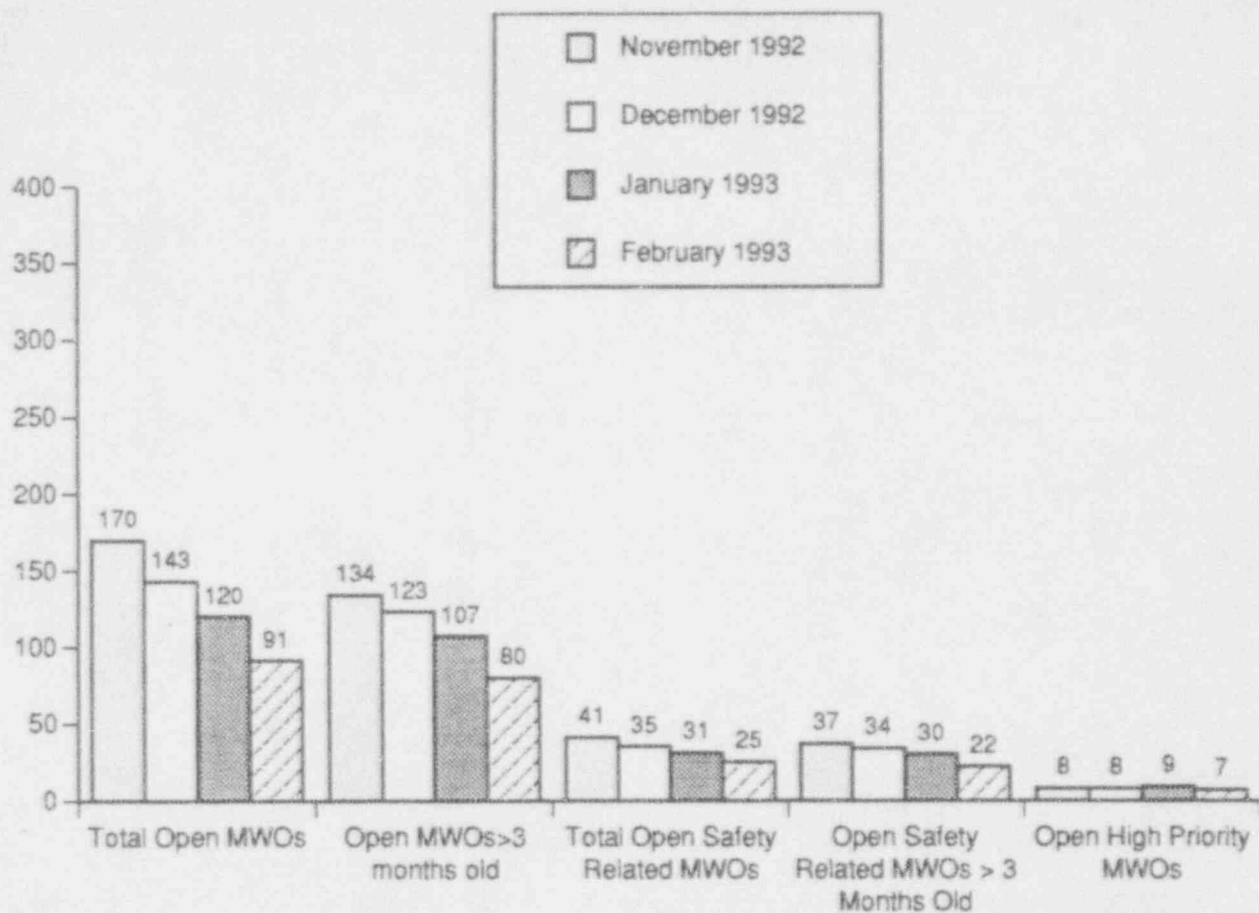

MAINTENANCE WORK ORDER BREAKDOWN (CORRECTIVE NON-OUTAGE)

This indicator shows the total number of corrective non-outage MWOs remaining open at the end of the reporting month, along with a breakdown by several key categories.


The 1993 monthly goal for this indicator is to have less than 325 total corrective non-outage maintenance work orders remaining open. The 1992 goal was to have less than 350 total corrective non-outage maintenance work orders remaining open.

Data Source: Chase/Schmitz (Manager/Source)

Accountability: Chase/Bobba

Adverse Trend: None

SEP 36

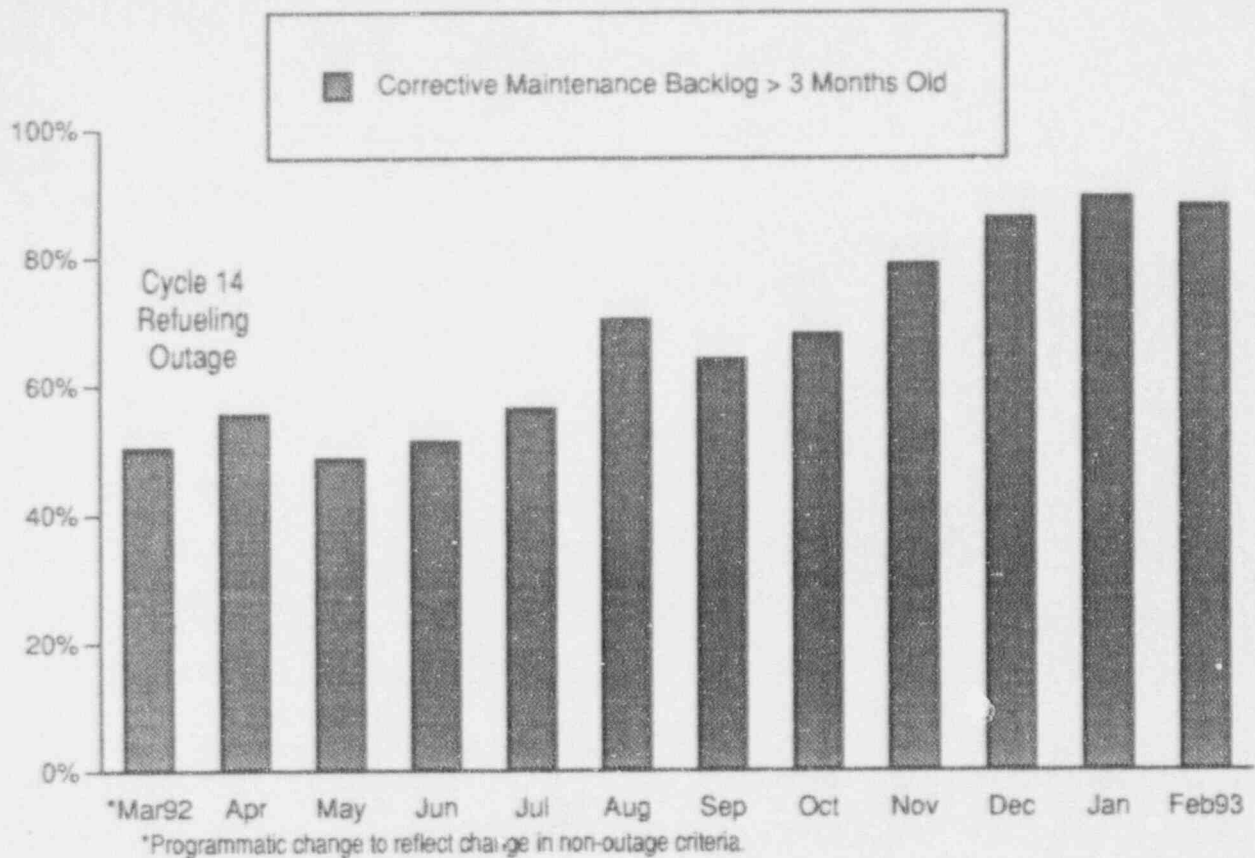

CORRECTIVE MAINTENANCE BACKLOG GREATER THAN 3 MONTHS OLD (NON-OUTAGE)

This indicator shows the percentage of open corrective non-outage maintenance work orders that were greater than three months old at the end of the reporting month.


The percentage of open corrective non-outage maintenance work orders that were greater than three months old at the end of February 1993 was reported as 87.9%. This percentage has increased due to the aggressive reduction in the total number of corrective maintenance work orders as shown on pages 28 and 29.

Data Source: Chase/Schmitz (Manager/Source)

Accountability: Chase/ Bobba

Adverse Trend: None

SEP 36

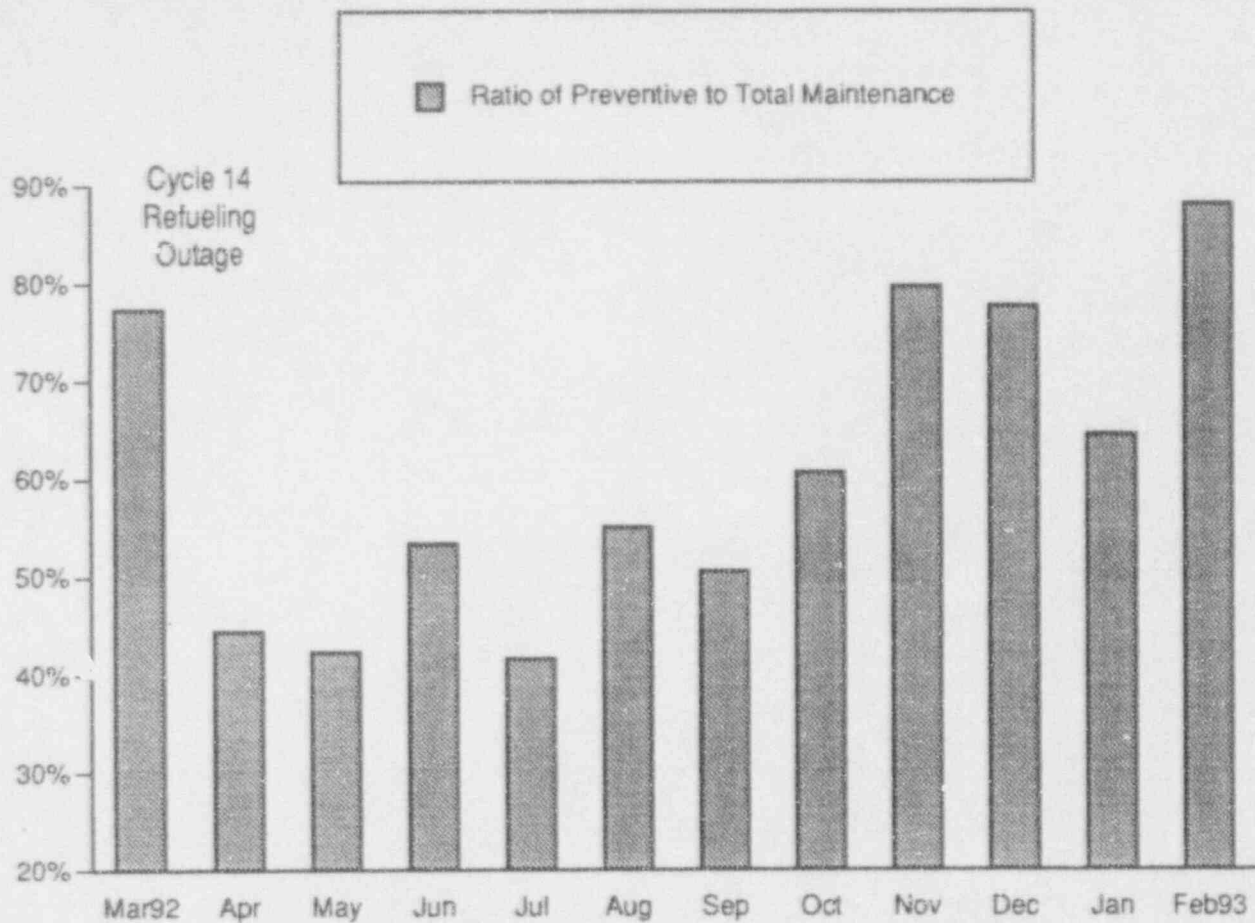

RATIO OF PREVENTIVE TO TOTAL MAINTENANCE

This indicator shows the ratio of completed non-outage preventive maintenance to total completed non-outage maintenance.


The ratio of preventive to total maintenance was 88.1% in February 1993.

Accountability: Chase/ Bobba

Data Source: Chase/Schmitz (Manager/Source)

Adverse Trend: None

SEP 41

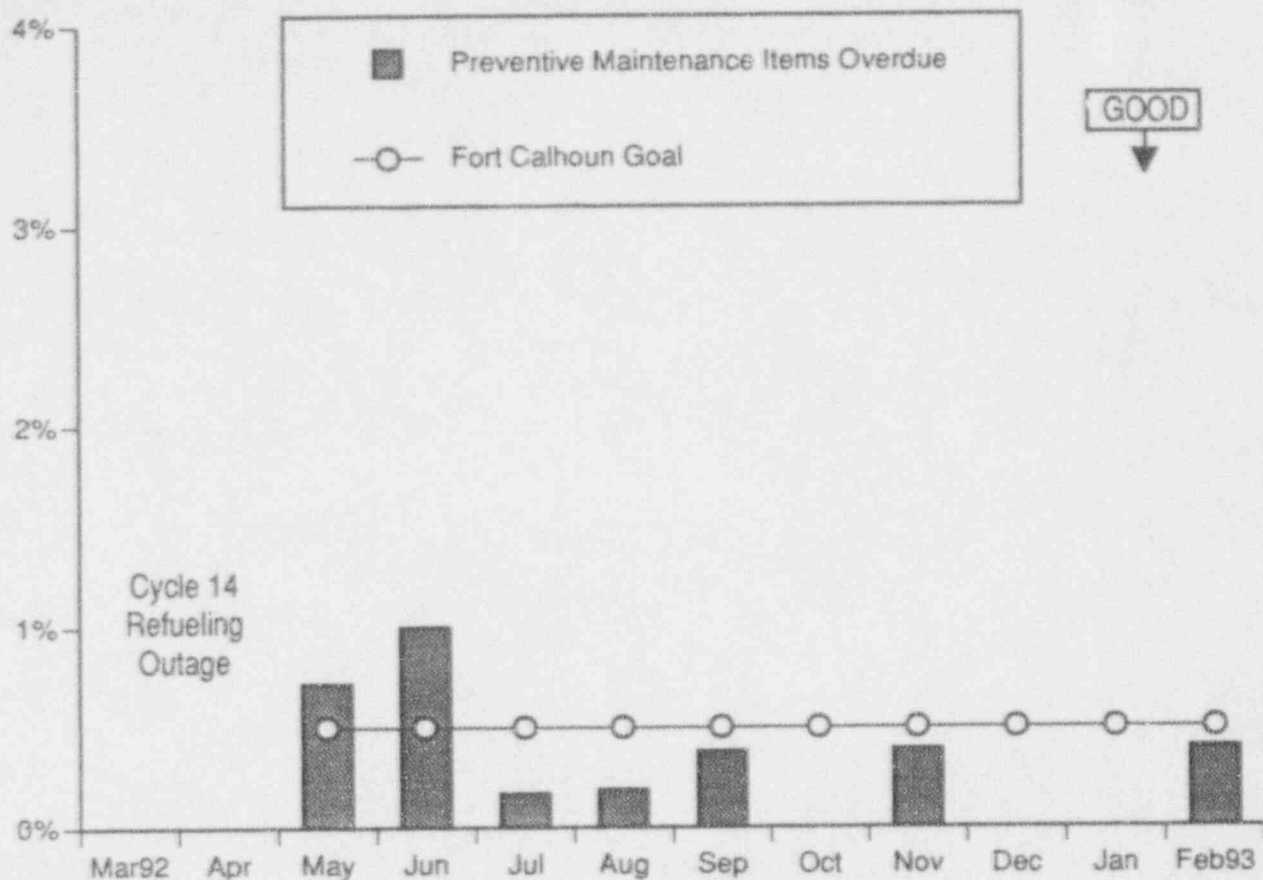

PREVENTIVE MAINTENANCE ITEMS OVERDUE

The purpose of this indicator is to monitor progress in the administration and execution of preventive maintenance (PM) programs. A small percentage of preventive maintenance items overdue indicates a station commitment to the preventive maintenance program and an ability to plan, schedule, and perform preventive maintenance tasks as programs require.

During February 1993, 498 PM items were completed. 2 of these PM items (0.4% of the total) were not completed within the allowable grace period.


The 1993 and 1992 Fort Calhoun goals are to have less than 0.5% per month of the preventive maintenance items overdue.

Data Source: Chase/Brady (Manager/Source)

Accountability: Chase/ Bobba

Adverse Trend: None

SEP 41

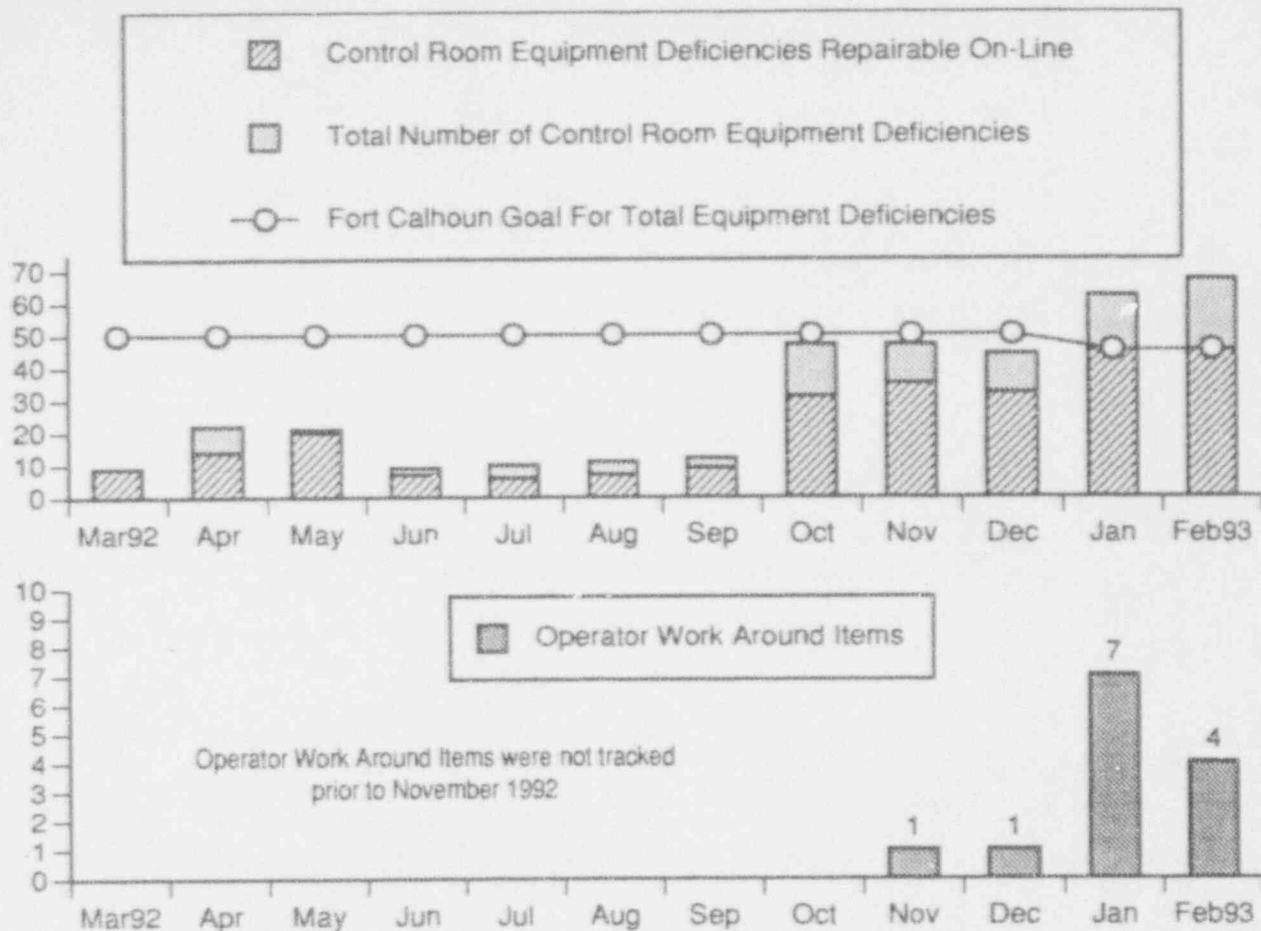

NUMBER OF CONTROL ROOM EQUIPMENT DEFICIENCIES


This indicator shows the number of control room equipment deficiencies, the number of deficiencies repairable during plant operations (on-line), the number of Operator Work Around Items and the 1993 and 1992 Fort Calhoun goals for total control room equipment deficiencies.

There was a total of 67 control room equipment deficiencies at the end of February 1993. 22 of these deficiencies require a plant outage to repair. There were 4 identified Operator Work Around Items at the end of the month.

The large increase in the number of out-of-service control room instruments that occurred in October 1992 was due to a change in the criteria for defining out-of-service control room instruments. This change was necessary because INPO no longer tracks this item due to difficulty in establishing consistency among plants reporting this indicator.

The 1993 Fort Calhoun monthly goal is to have a maximum of 45 control room equipment deficiencies. The 1992 monthly goal was a maximum of 50 control room equipment deficiencies.

Data Source: Chase/Tills (Manager/Source)
 Accountability: Chase/ Bobba
 Adverse Trend: None

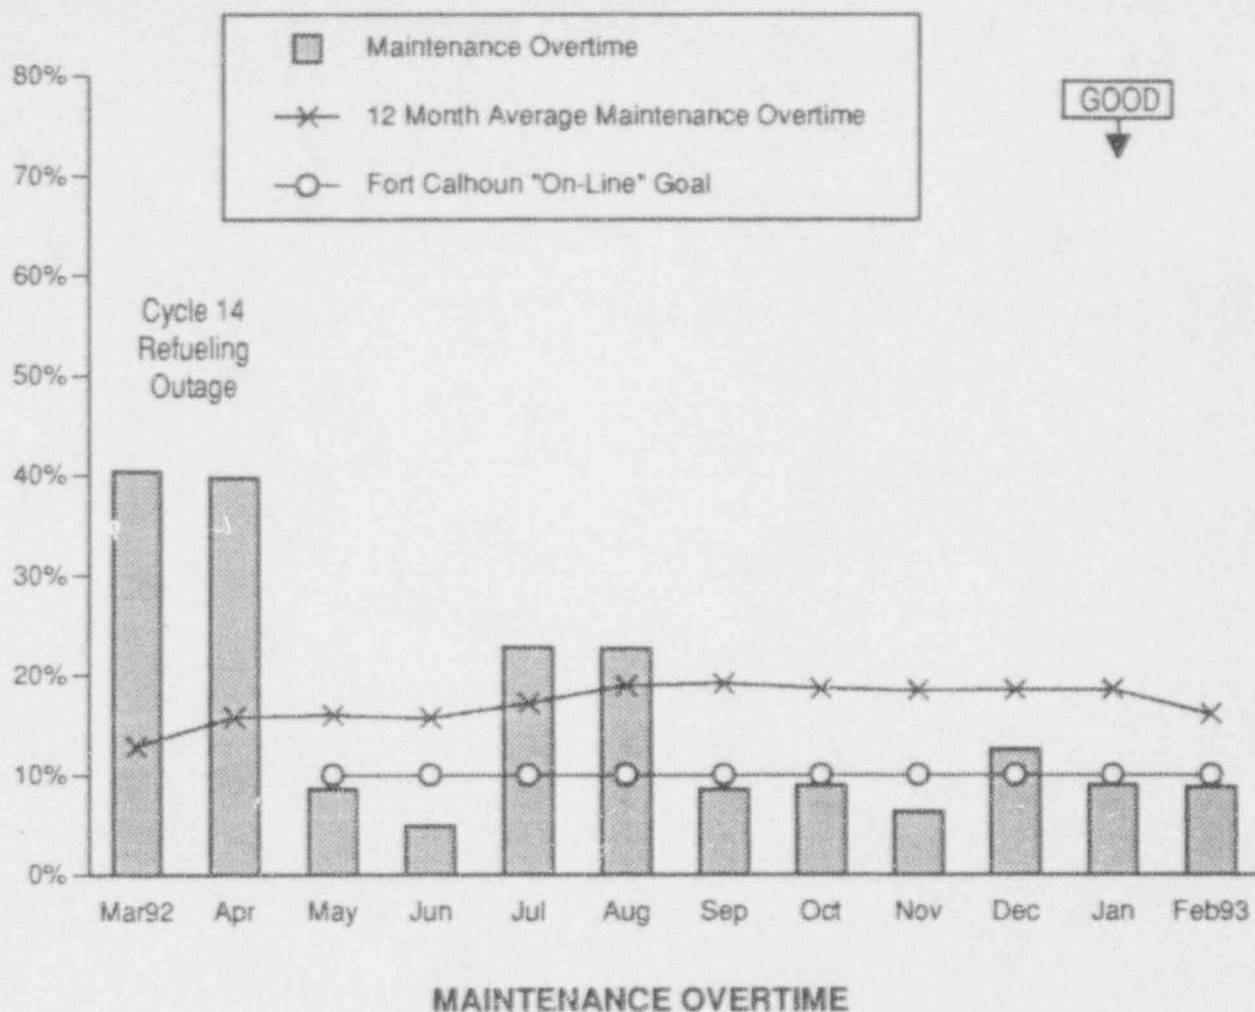

The Maintenance Overtime Indicator monitors the ability to perform the desired maintenance activities with the allotted resources.

The percent of overtime hours with respect to normal hours was reported as 8.8% for the month of February 1993. The 12 month average percentage of overtime hours with respect to normal hours was reported as 16.1% at the end of the month.


Both July and August 1992 overtime were high due to two long term (>2 weeks) forced outages.

The 1993 and 1992 Fort Calhoun goals for the "on-line" percentage of maintenance overtime hours worked are a maximum of 10%.

Data Source: Chase/Schmitz (Manager/Source)

Accountability: Chase/ Bobba

Adverse Trend: None

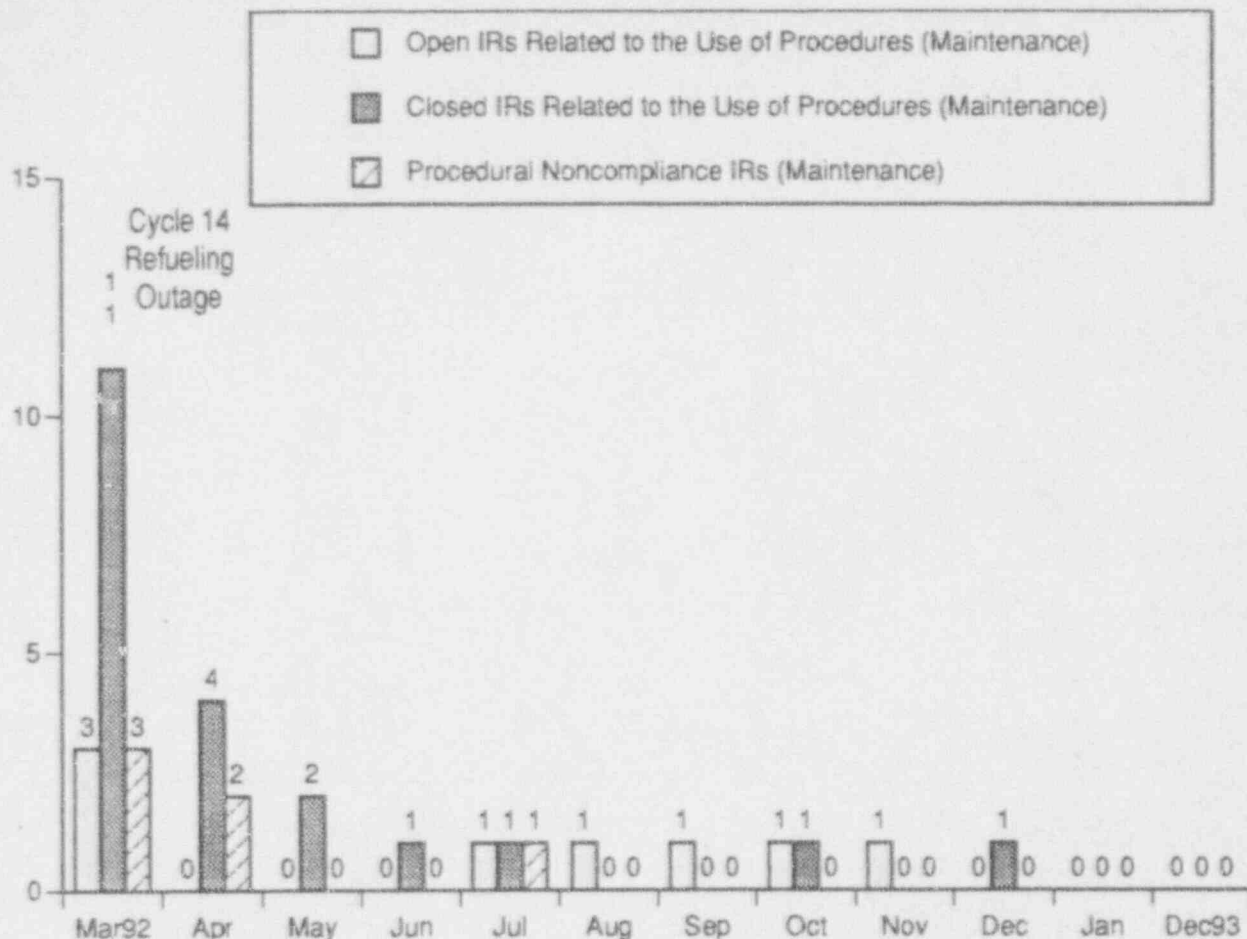

PROCEDURAL NONCOMPLIANCE INCIDENTS (MAINTENANCE)

This indicator shows the number of open Maintenance Incident Reports (IRs) that are related to the use of procedures, the number of closed IRs that are related to the use of procedures, and the number of open and closed IRs that received procedural noncompliance cause codes for each of the last twelve months.


There were no procedural noncompliance incidents for maintenance reported for the month of February 1993.

Data Source: Chase/McKay (Manager/Source)

Accountability: Chase/Bobba

Adverse Trend: None

SEP 15, 41 & 44

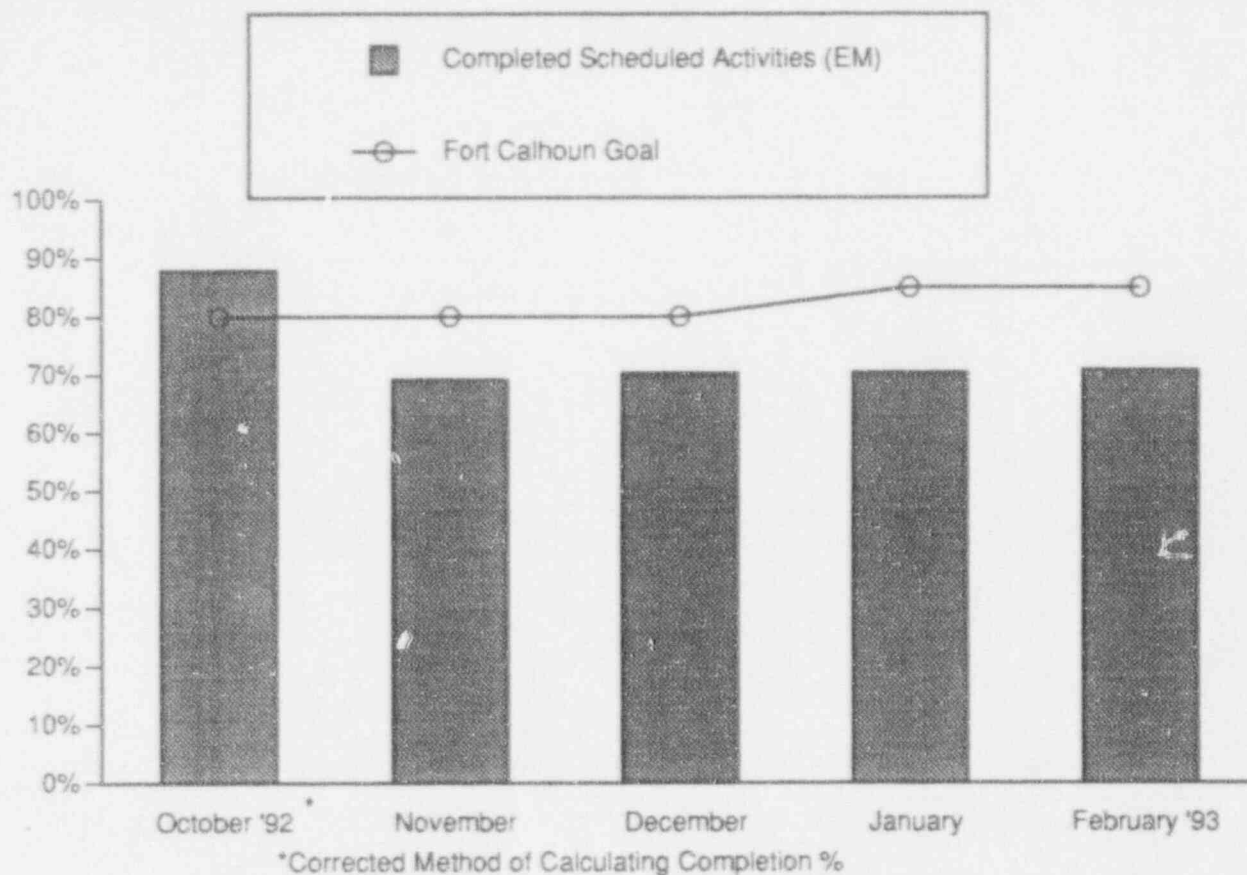

PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (ELECTRICAL MAINTENANCE)

This indicator shows the percent of the number of completed maintenance activities as compared to the number of scheduled maintenance activities concerning Electrical Maintenance. Maintenance activities include MWRs, MWOs, STs, PMOs, calibrations, and miscellaneous maintenance activities.

The 1993 Fort Calhoun Station monthly goal for this indicator is a minimum of 85%. The 1992 monthly goal was a minimum of 80%.


Reporting Month	Completed Scheduled Activities
October	87.9%
November	69.1%
December	70.2%
January	70.3%
February	70.7%

Data Source: Chase/Schmitz (Manager/Source)

Accountability: Chase/Bobba

Adverse Trend: None

SEP 33

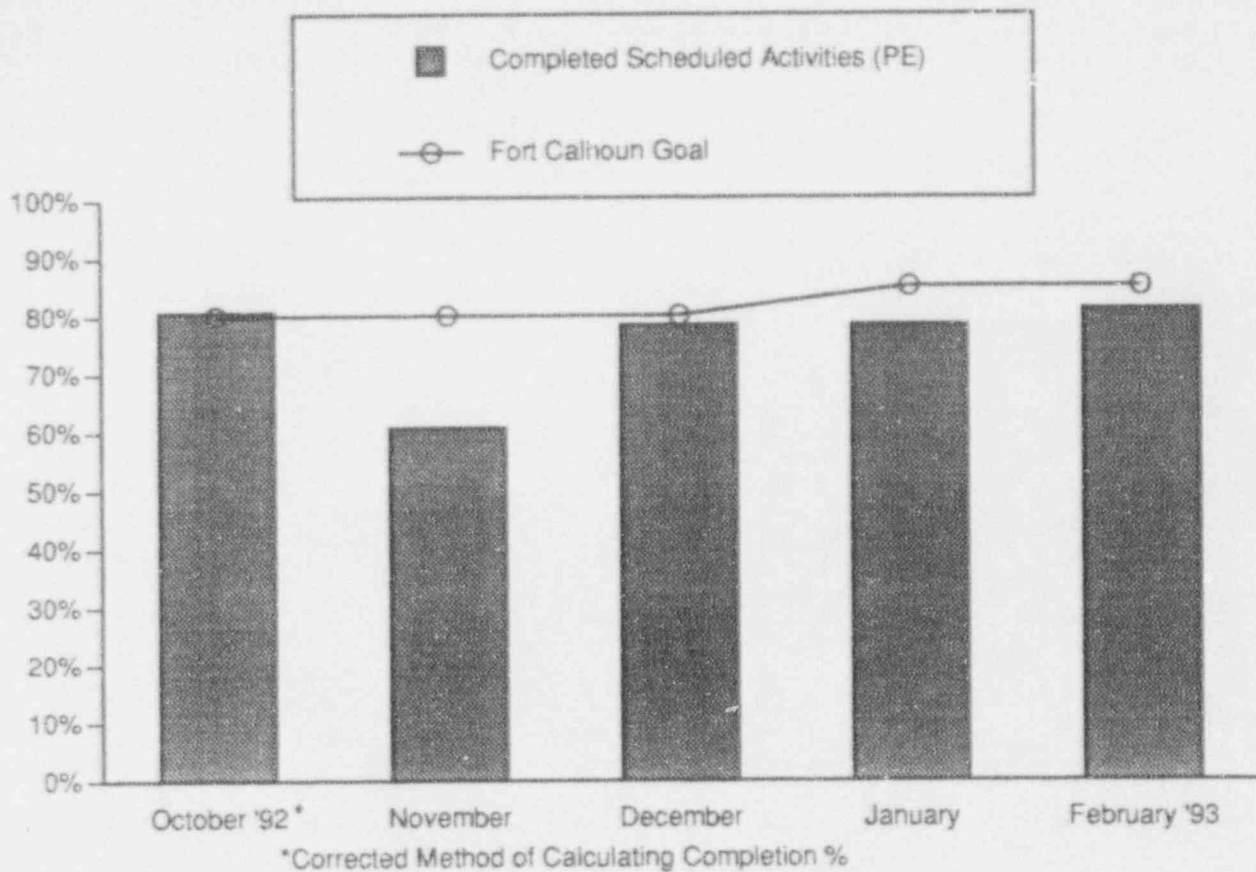

PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (PRESSURE EQUIPMENT)


This indicator shows the percent of the number of completed maintenance activities as compared to the number of scheduled maintenance activities concerning Pressure Equipment Maintenance. Maintenance activities include MWRs, MWOs, STs, PMOs, calibrations, and miscellaneous maintenance activities.

The 1993 Fort Calhoun Station monthly goal for this indicator is a minimum of 85%. The 1992 monthly goal was a minimum of 80%.

Reporting Month	Completed Scheduled Activities
October	80.7%
November	60.7%
December	78.3%
January	78.3%
February	81.0%

Data Source: Chase/Schmitz (Manager/Source)
 Accountability: Chase/Bobba
 Adverse Trend: None

SEP 33

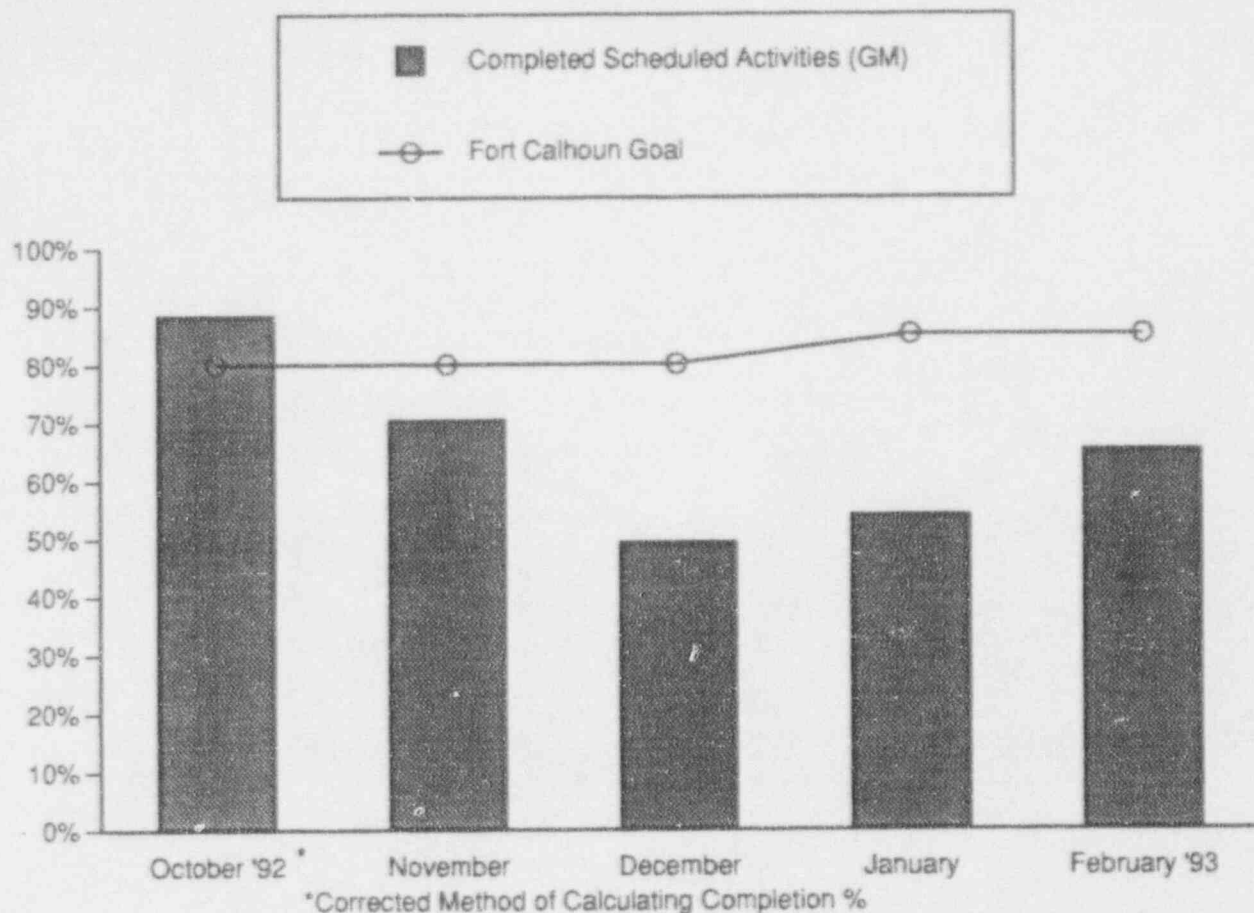

PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (GENERAL MAINTENANCE)


This indicator shows the percent of the number of completed maintenance activities as compared to the number of scheduled maintenance activities concerning General Maintenance. Maintenance activities include MWRs, MWOs, STs, PMOs, calibrations, and miscellaneous maintenance activities.

The 1993 Fort Calhoun Station monthly goal for this indicator is a minimum of 85%. The 1992 monthly goal was a minimum of 80%.

Reporting Month	Completed Scheduled Activities
October	88.4%
November	70.4%
December	49.2%
January	53.9%
February	65.1%

Data Source: Chase/Schmitz (Manager/Source)
 Accountability: Chase/Bobba
 Adverse Trend: None

SEP 33

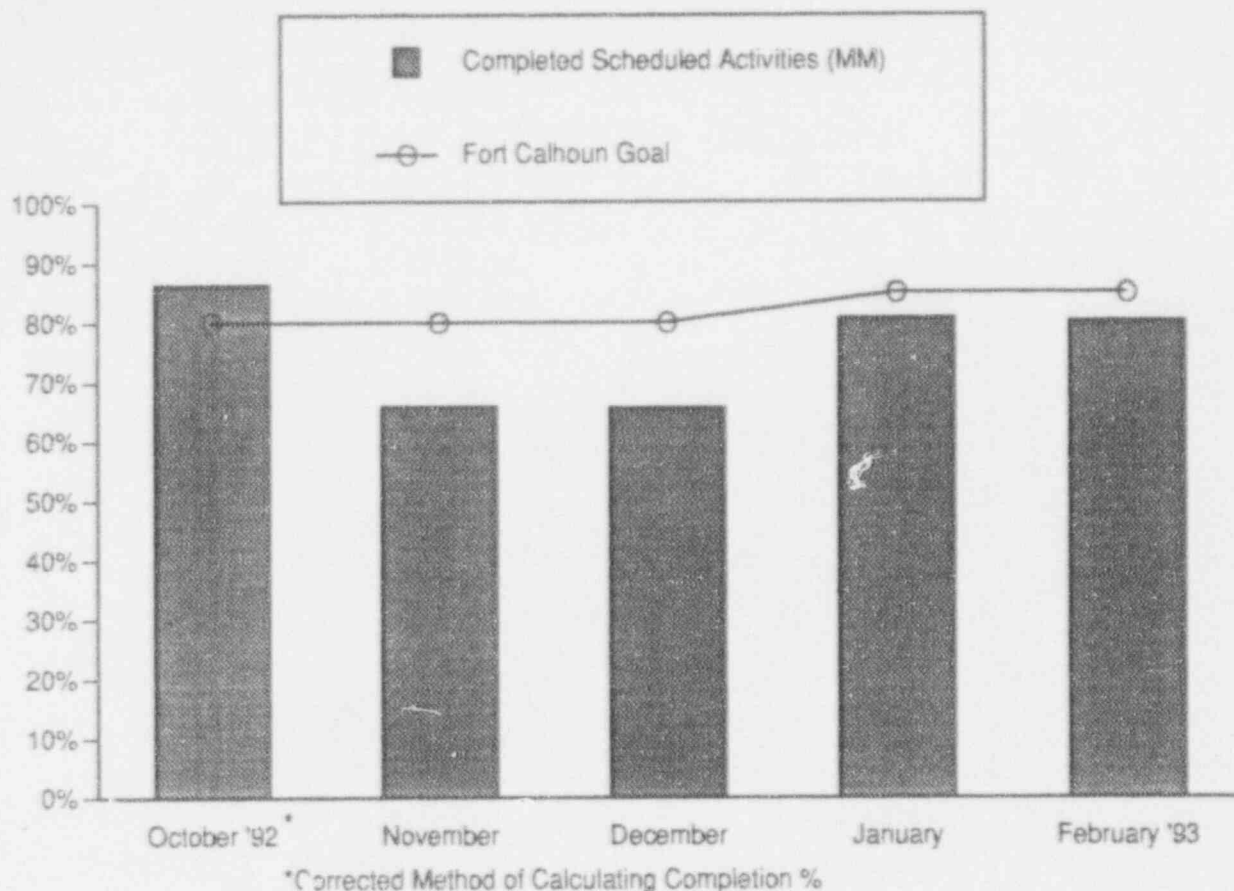

PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (MECHANICAL MAINTENANCE)

This indicator shows the percent of the number of completed maintenance activities as compared to the number of scheduled maintenance activities concerning Mechanical Maintenance. Maintenance activities include MWRs, MWOs, STs, PMOs, calibrations, and miscellaneous maintenance activities.

The 1993 Fort Calhoun Station monthly goal for this indicator is 85%. The 1992 monthly goal was a minimum of 80%.


Reporting Month	Completed Scheduled Activities
October	86.3%
November	65.8%
December	65.6%
January	80.7%
February	80.2%

Data Source: Chase/Schmitz (Manager/Source)

Accountability: Chase/Bobba

Adverse Trend: None

SEP 33

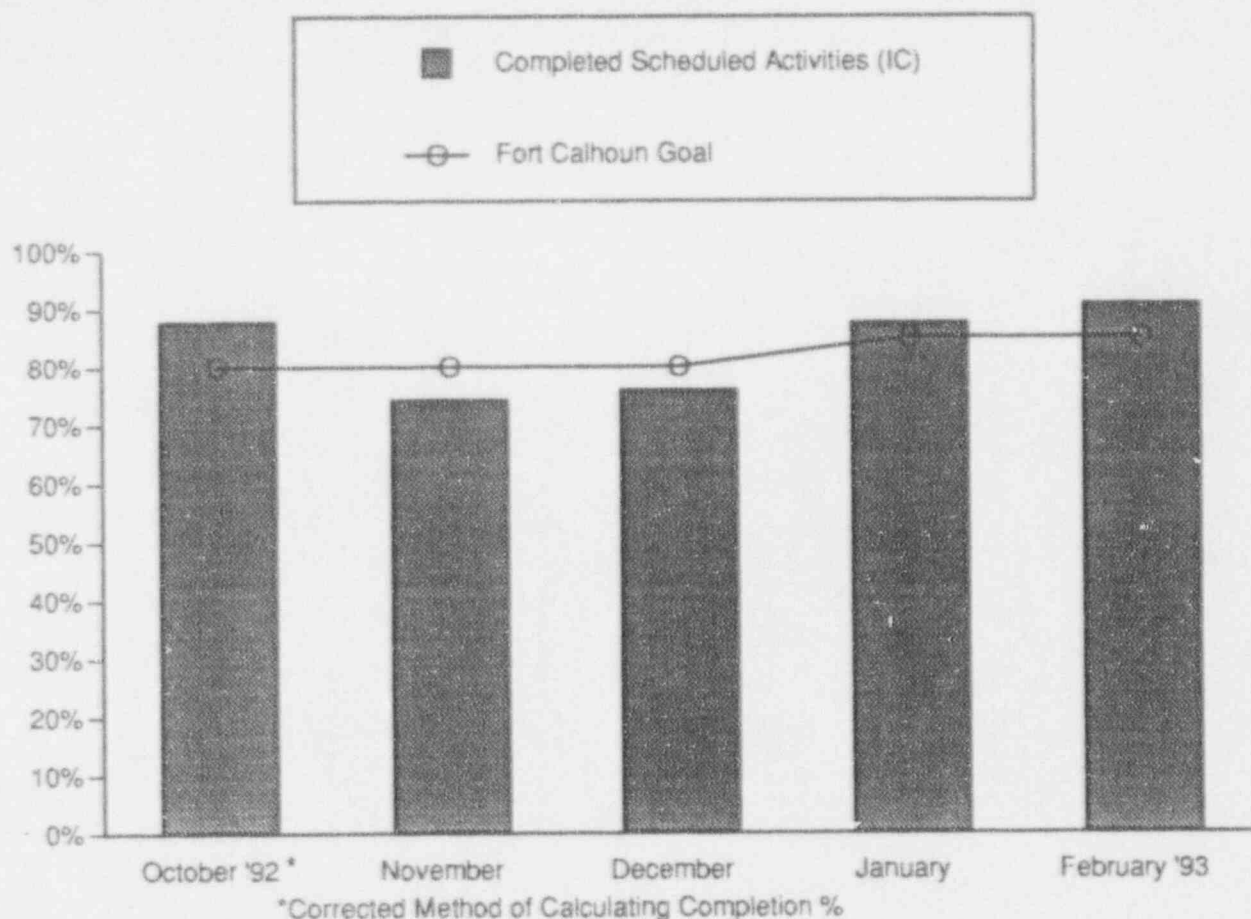

PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES (INSTRUMENTATION & CONTROL)


This indicator shows the percent of the number of completed maintenance activities as compared to the number of scheduled maintenance activities concerning Instrumentation & Control. Maintenance activities include MWRs, MWOs, STs, PMOs, calibrations, and miscellaneous maintenance activities.

The 1993 Fort Calhoun Station monthly goal for this indicator is a minimum of 85%. The 1992 monthly goal was a minimum of 80%.

<u>Reporting Month</u>	<u>Completed Scheduled Activities</u>
October	87.8%
November	74.2%
December	75.9%
January	87.5%
February	90.7%

Data Source: Chase/Schmitz (Manager/Source)
 Accountability: Chase/Bobba
 Adverse Trend: None

SEP 33

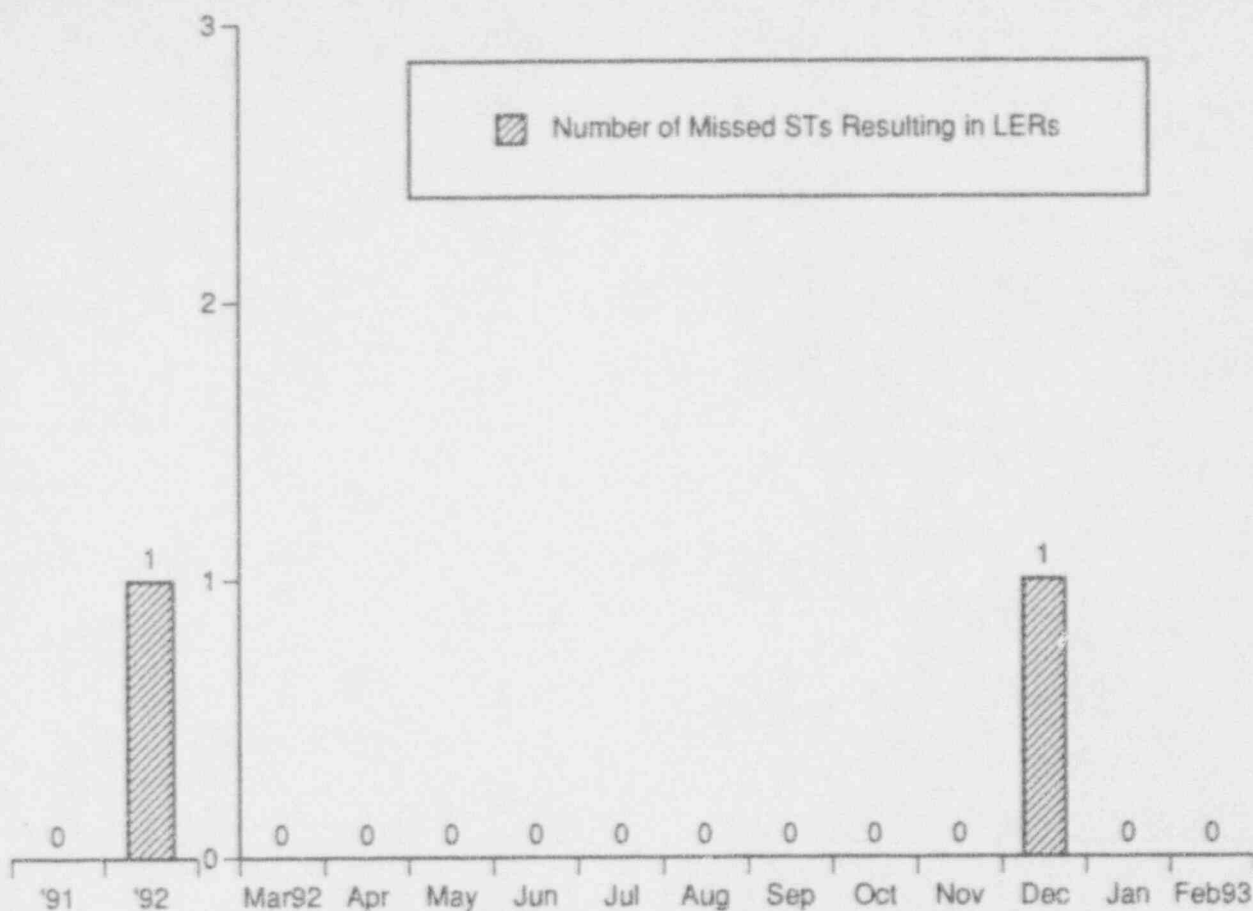

NUMBER OF MISSED SURVEILLANCE TESTS RESULTING IN LICENSEE EVENT REPORTS

This indicator shows the number of missed Surveillance Tests (STs) that result in Licensee Event Reports (LERs) during the reporting month. The graph on the left shows the yearly totals for the indicated years.

There were no missed surveillance tests resulting in LERs during February 1993.

During the month of January 1993 it was discovered that during December 1992 an ASME Section XI Code required surveillance was not completed nor corrective maintenance performed as a result of AC-10A falling into the "Alert Range" (LER 93-003) Failure to Satisfy Inservice Testing Requirements for Raw Water Pump.


The 1993 and 1992 Fort Calhoun goals for this indicator are zero.

Data Source: Monthly Operating Report & Plant Licensee Event Reports (LERs)

Accountability: Chase/Jaworski

Adverse Trend: None

SEP 60 & 61

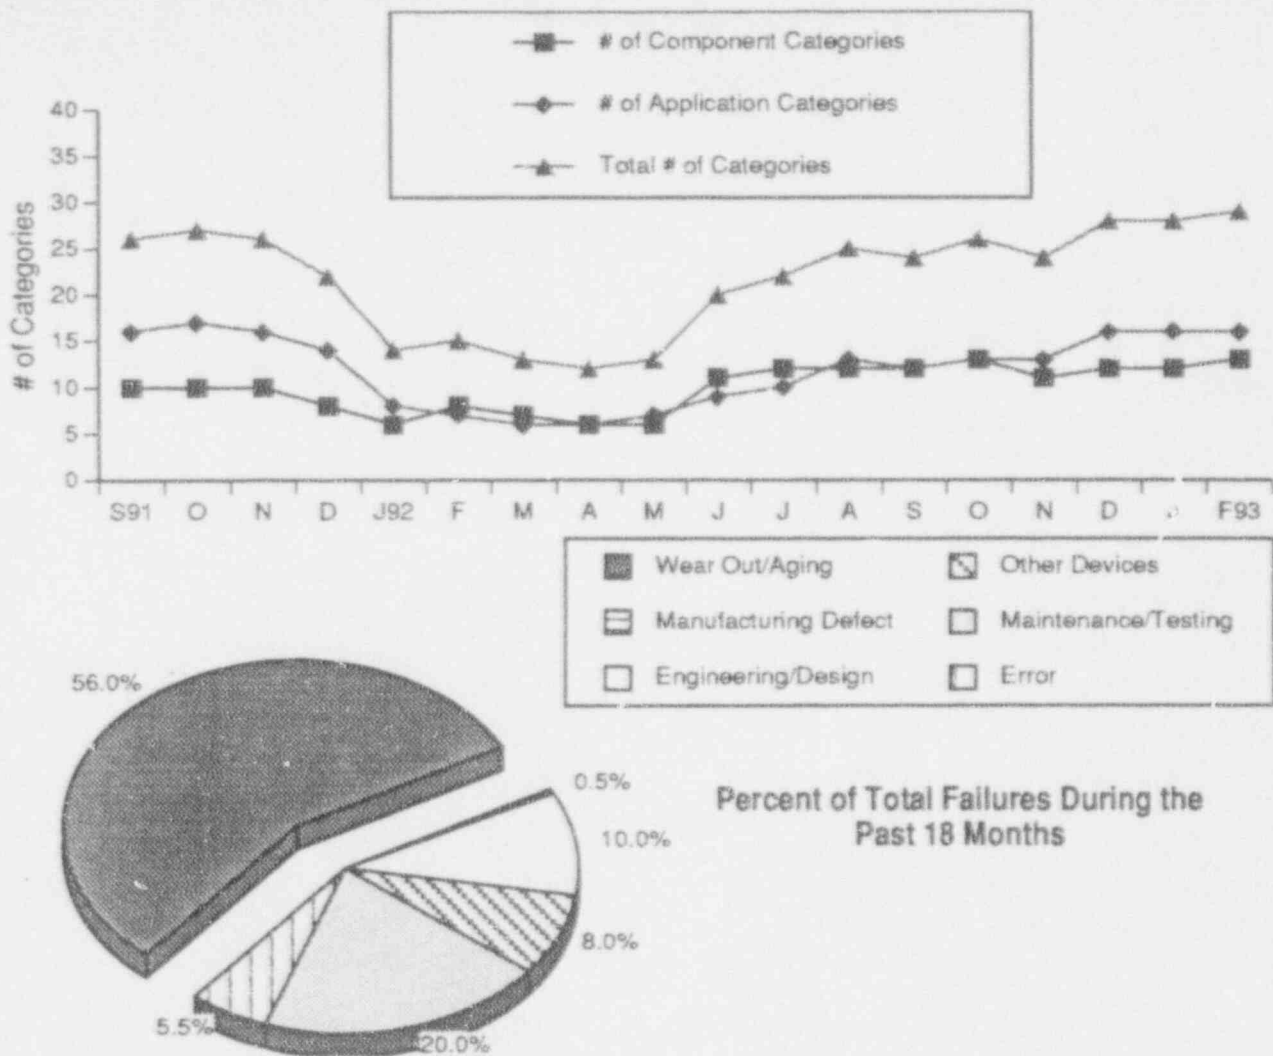


COMPONENT FAILURE ANALYSIS REPORT (CFAR) SUMMARY

The top chart illustrates the number of component categories, application categories and total categories in which the Fort Calhoun Station has significantly higher (1.645 standard deviations) failure rates than the industry failure rates during the past 18 months (from June 1991 through November 1992). Fort Calhoun Station reported a higher failure rate in 13 of the 87 component categories (valves, pumps, motors, etc.) during the past 18 months. The station reported a higher failure rate in 16 of the 140 application categories (main steam stop valves, auxiliary/emergency feedwater pumps, control element drive motors, etc.) during the past 18 months.

The pie chart depicts the breakdown by INPO cause categories (see the "Definitions" section of this report for descriptions of these categories) for the 194 failure reports that were submitted to INPO by Fort Calhoun Station during the past 18 months. Of these, the failure cause was known for 178. The pie chart reflects known failure causes.

The recent increase in the failure rate can be explained by an increase in failures reported to INPO due to changes in INPO reporting guidance. Also, 1992 was a refueling outage year, and refueling outage years historically have higher failure rates than non-outage years.

Data Source: Jaworski/Dowdy (Manager/Source)
 Accountability: Jaworski/Dowdy
 Adverse Trend: None

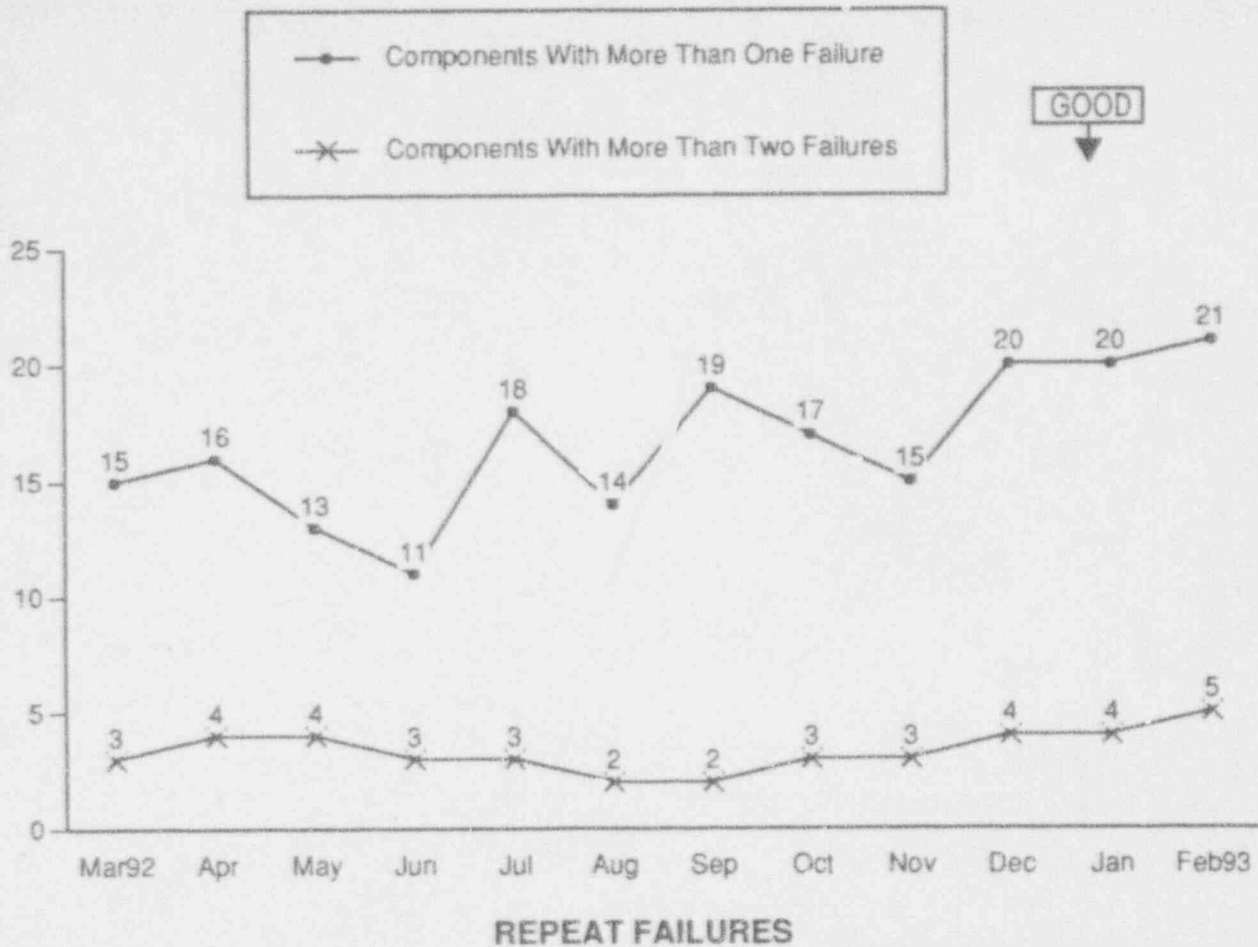

The Repeat Failures Indicator (formerly called the "Maintenance Effectiveness" performance indicator) was developed in response to guidelines set forth by the Nuclear Regulatory Commission's Office for Analysis and Evaluation of Operational Data (NRC/AEOD). The NRC requirement for a Maintenance Effectiveness Performance Indicator has been dropped, but station management considers it useful to continue to track repetitive component failures using the Nuclear Plant Reliability Data System (NPRDS).


This indicator shows the number of NPRDS components with more than one failure during the last eighteen months and the number of NPRDS components with more than two failures during the last eighteen months.

During the last 18 reporting months there were 21 NPRDS components with more than 1 failure. 5 of the 21 had more than two failures. The tag numbers of the components with more than two failures are AC-10C, CH-1A, CH-1B, EE-1G-M and RC-142. Recommendations and actions to correct these repeat component failures are listed in the quarterly Component Failure Analysis Report.

Data Source: Jaworski/Dowdy (Manager/Source)

Accountability: Chase/Bobba

Adverse Trend: The Manager - Station Engineering has identified an adverse trend based on an increase in the number of components with more than two failures since September 1992.

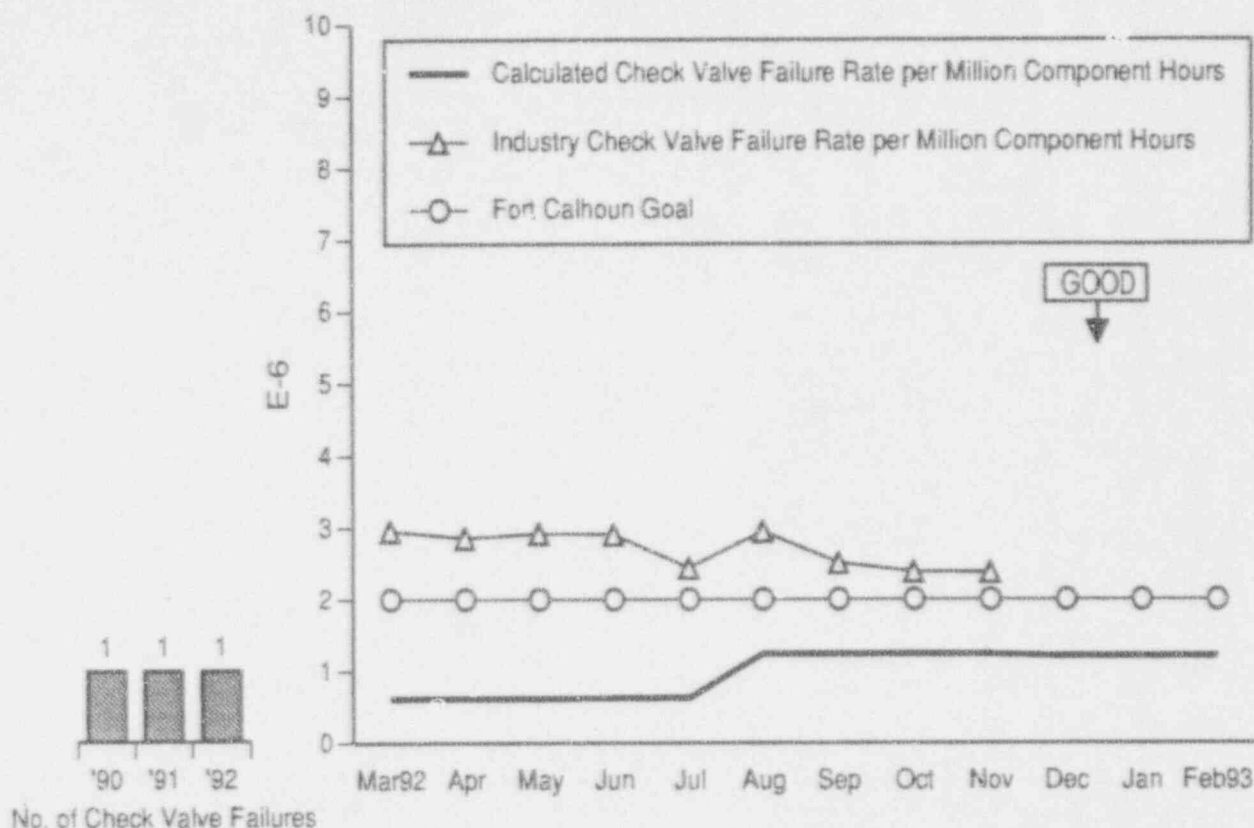

CHECK VALVE FAILURE RATE

This indicator shows the calculated Fort Calhoun check valve failure rate, the Fort Calhoun goal and the industry check valve failure rate. This rate is based upon failures during the previous 18 months. The number of check valve failures at Fort Calhoun Station for the previous three years are shown on the left.

The data for the industry check valve failure rate is three months behind the reporting month due to the time involved in collecting and processing the data.

For November 1992, the Fort Calhoun Station reported an actual check valve failure rate of 1.21 E-6, while the industry reported an actual failure rate of 2.38 E-6. The increase in the failure rate for the month of August 1992 is due to the failure of check valve CH-288. At the end of February 1993, the Fort Calhoun Station reported a calculated check valve failure rate of 1.21 E-6.


The 1993 and 1992 Fort Calhoun goals for this indicator are a maximum failure rate of 2.00 E-6.

Data Source: Jaworski/Dowdy (Manager/Source)

Accountability: Jaworski/Rollins

Adverse Trend: None

SEP 43

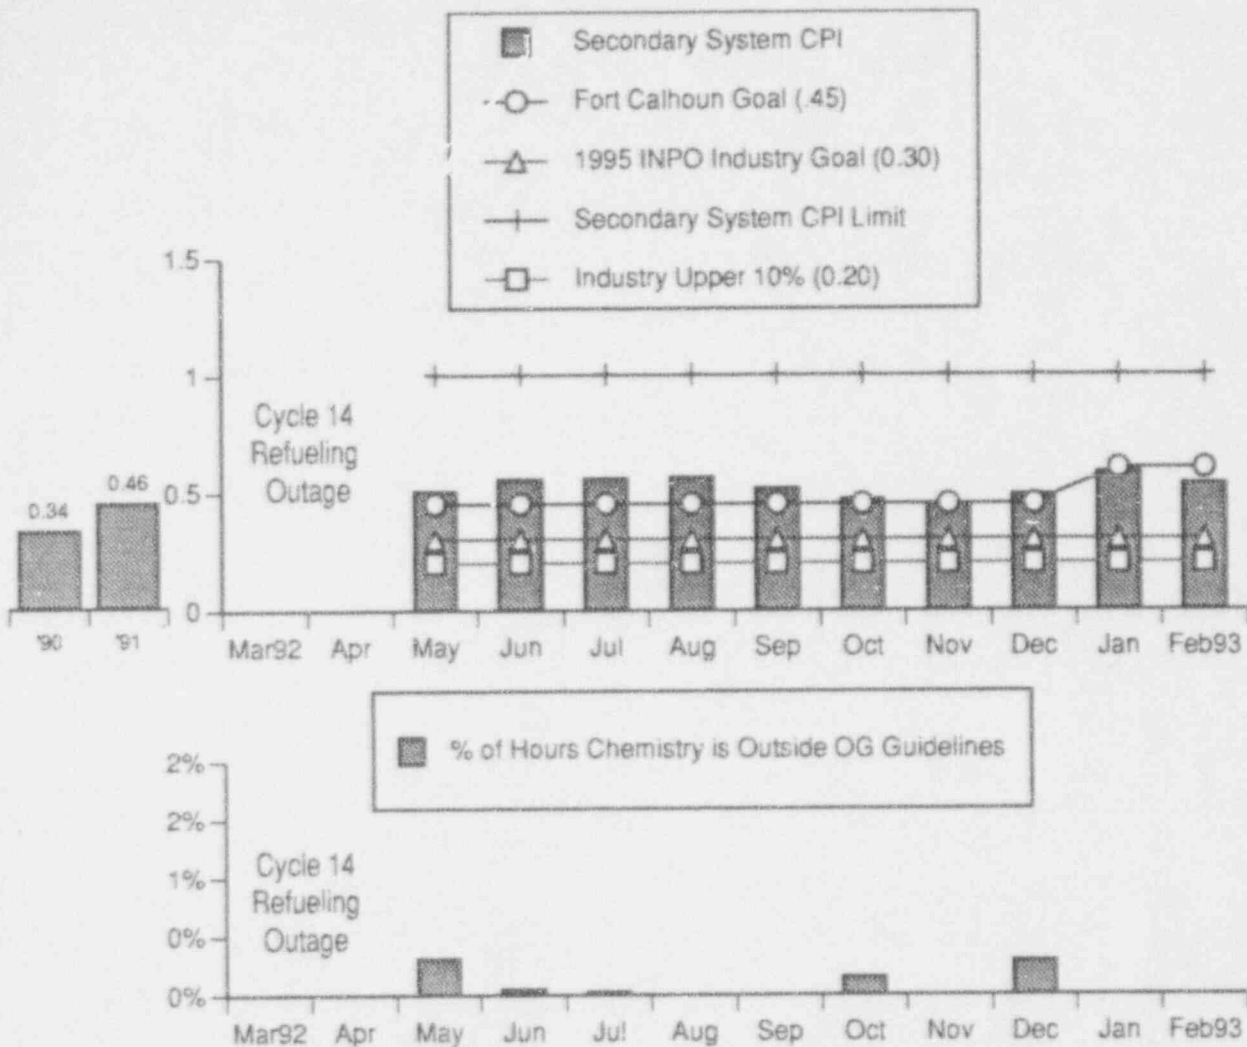


SECONDARY SYSTEM CHEMISTRY

The top graph, Secondary System Chemistry Performance Index (CPI), is calculated using the following three parameters: cation conductivity in steam generator blowdown, sodium in steam generator blowdown, and condensate pump discharge dissolved oxygen. The bottom graph shows the percent of total hours of 13 parameters exceeding the Owners Group (OG) guidelines during power operation.

The CPI was reported as 0.535 for the month of February 1993. The percent of hours outside the OG guidelines was reported as 0% for the month.

The 1993 Fort Calhoun monthly goal for the CPI is a maximum value of 0.60. The INPO 1995 Industry goal is 0.30. The industry upper ten percentile value for this indicator was approximately 0.20 for the twelve months from 7/91 through 6/92.

Data Source: Glantz (Source)
 Accountability: Chase/Schmidt
 Adverse Trend: None

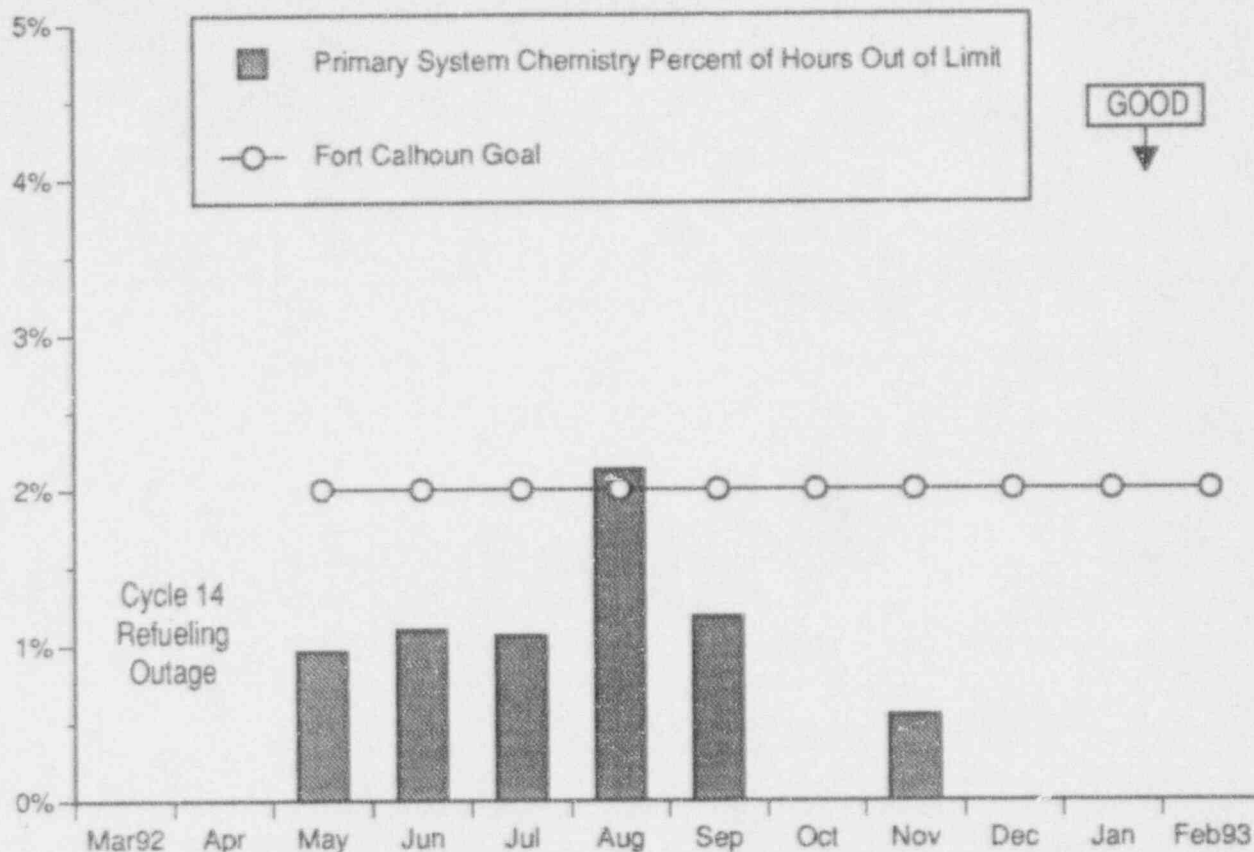

PRIMARY SYSTEM CHEMISTRY PERCENT OF HOURS OUT OF LIMIT

The Primary System Chemistry Percent of Hours Out of Limit indicator tracks the primary system chemistry performance by monitoring six key chemistry parameters. Typically, lithium is the parameter that is out of limit. 100% equates to all six parameters being out of limit for the month.


The Primary System Chemistry Percent of Hours Out of Limit was reported as 0% for the month of February 1993.

The 1993 and 1992 Fort Calhoun monthly goals for this indicator are a maximum of 2% Hours Out of Limit.

Data Source: Glantz (Source)

Accountability: Chase/Smith

Adverse Trend: None

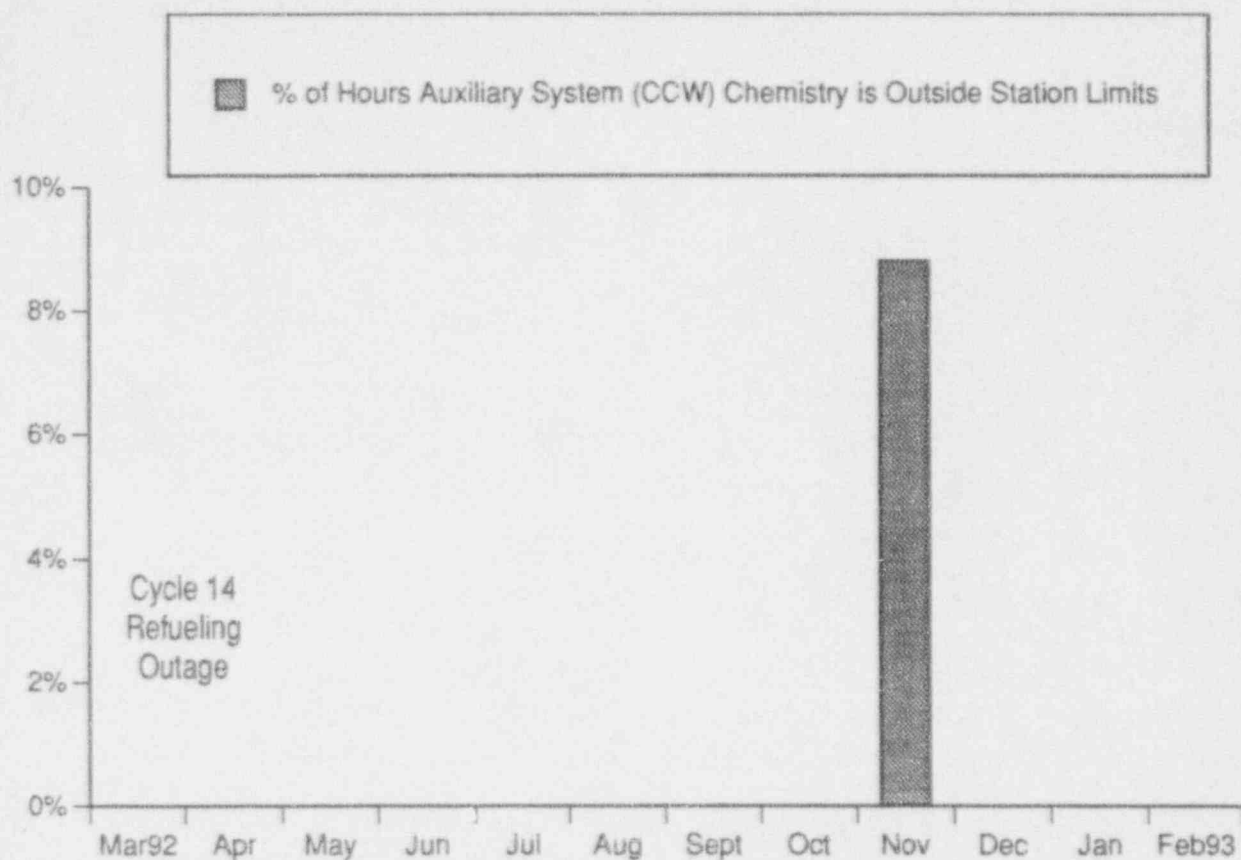

AUXILIARY SYSTEM (CCW) CHEMISTRY PERCENT OF HOURS OUTSIDE STATION LIMITS


The Auxiliary System Chemistry Percent of Hours Outside Station Limits indicator tracks the monthly percent of hours that the Component Cooling Water (CCW) system is outside the station chemistry limit.

The auxiliary system chemistry percent of hours outside station limits was reported as 0% for the month of February 1993. The high value (8.8%) reported for November 1992 was attributable to nitrites, which were lower than specifications. Prior to November 1992, the last outside of station limits condition occurred in June 1991 and was due to a low nitrite level in CCW coolant.

Data Source: Glantz (Source)

Accountability: Chase/Smith

Adverse Trend: None

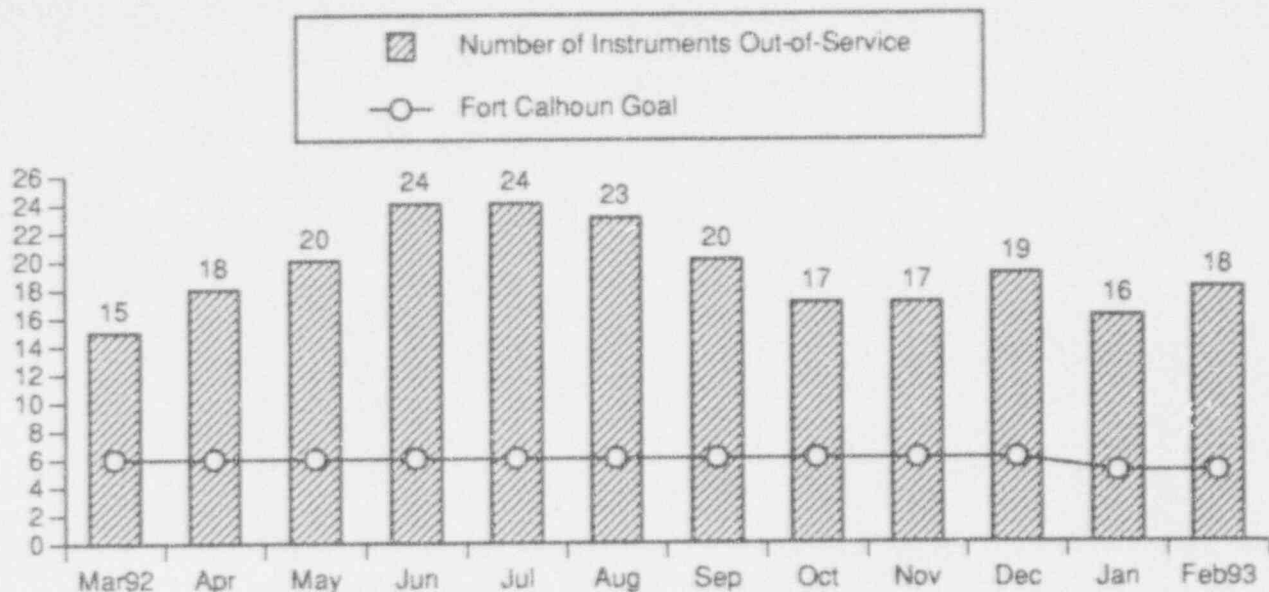

IN-LINE CHEMISTRY INSTRUMENTS OUT-OF-SERVICE

This indicator shows the total number of in-line chemistry system instruments out-of-service at the end of the reporting month. The chemistry systems involved in this indicator include the Secondary System and the Post Accident Sampling System (PASS).

At the end of February there was a total of 18 in-line chemistry instruments out-of-service. Of these 18 instruments, 14 were from the Secondary System and 4 were from PASS.

The trend for PASS instruments for this reporting period has increased due to PASS Gross Gamma Detectors not being calibrated and the Ion Chromatograph for boron and chloride being declared inoperable due to the sample being diluted prior to analysis. The trend for Secondary instruments this reporting period has not changed. The entire secondary panel remains out-of-service because of failure of the AI-125 data logger, which is scheduled for repair per MWO 93-0703. (ECN 92-469 was issued by DEN on 2/19/93 to replace the data logger). Three instruments are out-of-service on AI-107, two because of recorder failure and one because of instrument malfunction. One instrument is out-of-service on AI-105 because of malfunction.


The entire instrument channel is considered inoperative if: 1) the instrument is inoperative, 2) the chart recorder associated with the instrument is inoperative, 3) the alarm function associated with the instrument is inoperative. If any of the functions listed above are not operational, then the instrument is not performing its intended function.

The 1993 Fort Calhoun goal for the number of in-line chemistry system instruments that are out-of-service has been set at a maximum of 5. The 1992 goal was a maximum of 6. Six out-of-service chemistry instruments make up 10% of all the chemistry instruments that are counted for this indicator.

Data Source: Chase/Renaud (Manager/Source)

Accountability: Chase/Jaworski

Adverse Trend: None

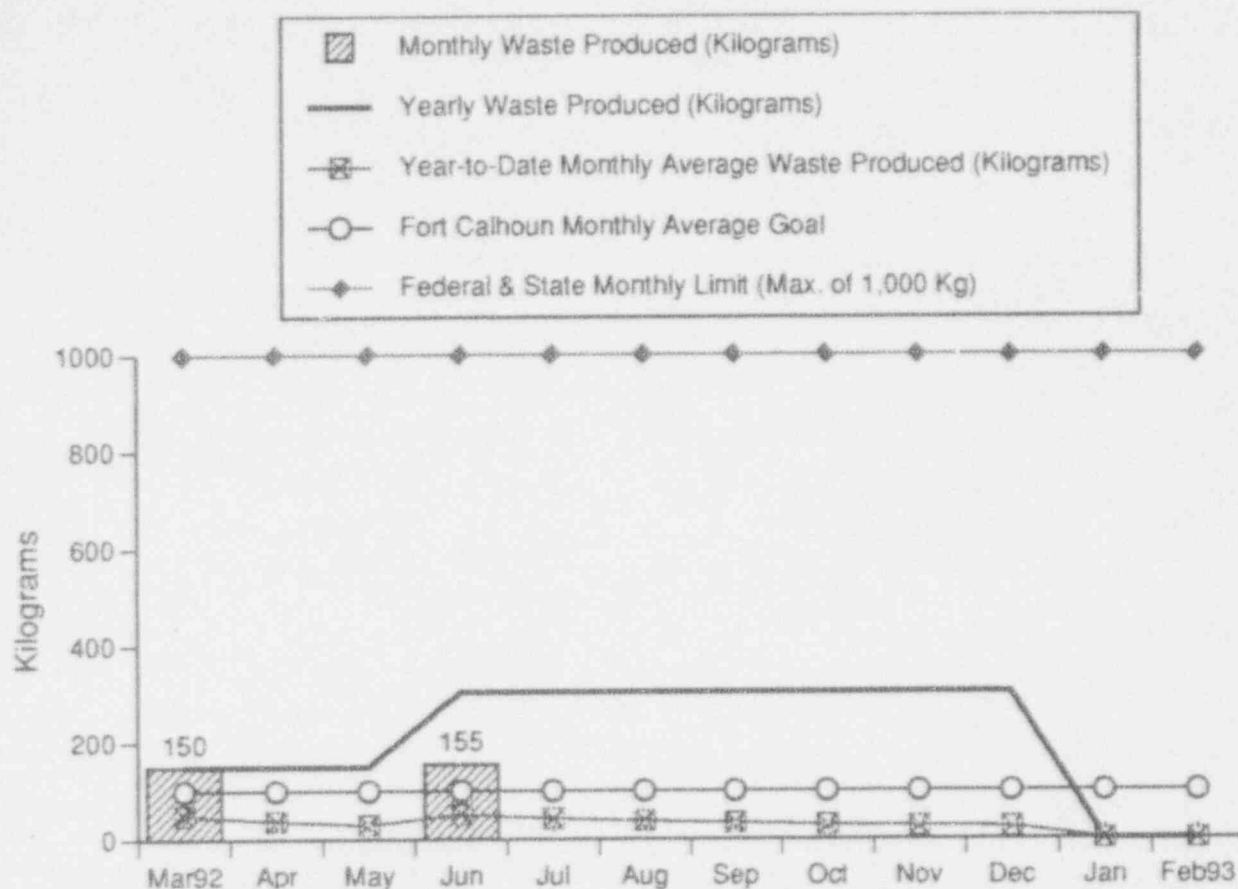

HAZARDOUS WASTE PRODUCED

This indicator shows the total amount of hazardous waste produced by Fort Calhoun each month, the monthly average goal and the year-to-date total for hazardous waste produced. This hazardous waste consists of non-halogenated hazardous waste, halogenated hazardous waste, and other hazardous waste produced.

During the month of February 1993, 0.0 kilograms of non-halogenated hazardous waste was produced, 0.0 kilograms of halogenated hazardous waste was produced, and 0.0 kilograms of other hazardous waste was produced. The yearly total for hazardous waste produced is 0.0 kilograms.


Hazardous waste is counted based upon a full drum of waste.

The 1993 and 1992 monthly average goals for hazardous waste produced are a maximum of 100 kilograms.

Date Source: Chase/Henning (Manager/Source)

Accountability: Chase/Henning

Adverse Trend: None

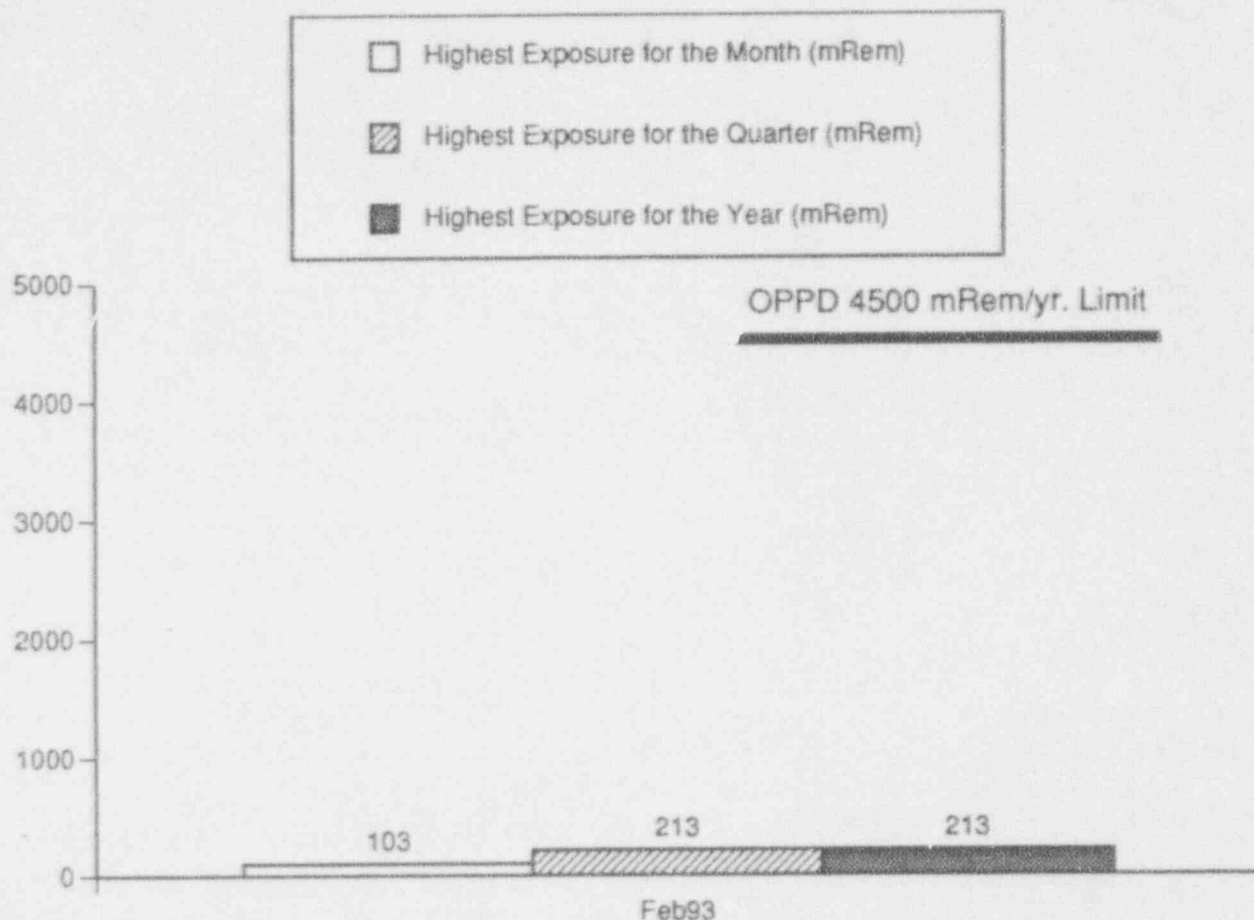

MAXIMUM INDIVIDUAL RADIATION EXPOSURE

During February 1993, an individual accumulated 103 mRem which was the highest individual exposure for the month.


The maximum individual exposure to date for the first quarter of 1993 was 213 mRem.

The OPPD limit for the maximum yearly individual radiation exposure is 4,500 mRem/year. The 1993 Fort Calhoun year-end goal is a maximum of 1,500 mRem.

Date Source: Chase/Williams (Manager/Source)

Accountability: Chase/Lovett

Adverse Trend: None

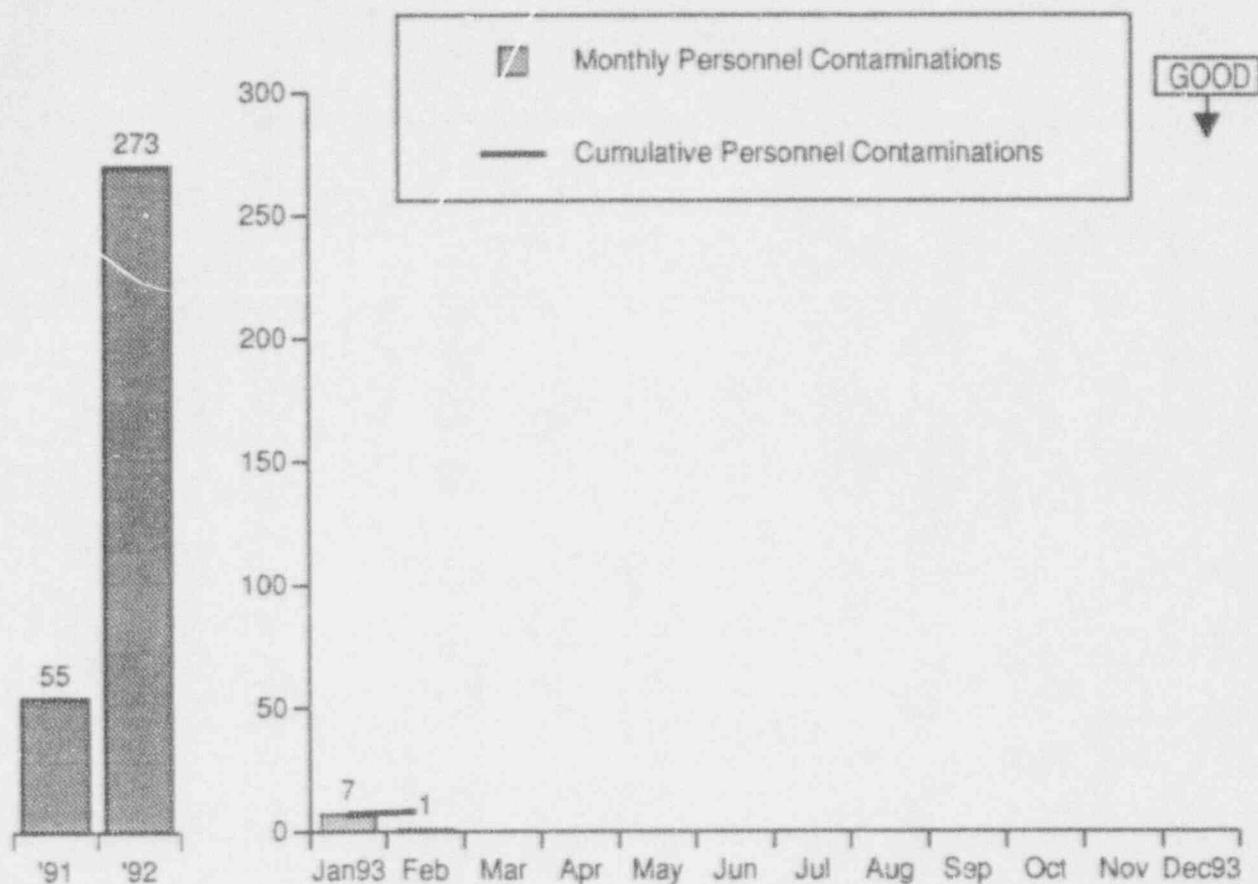

CONTAMINATIONS >5,000 DPM/100 CM²

This indicator shows the number of contaminations >5,000 dpm/100 cm² for the reporting month. 1 contamination occurred during February 1993. The contamination was:
1) An individual received a clothing contamination while removing the detector for RM 053.

There has been a total of 8 contaminations >5,000 dpm/100cm² in 1993.

There was a total of 273 contaminations >5,000 dpm/100cm² in 1992. There was a total of 55 contaminations >5,000 dpm/100cm² in 1991.


The 1993 goal for contaminations >5,000 dpm/100 cm² is 0.4 PCR/1,000 PWP hours (non-outage) and 1.5 PCR/1,000 RWP hours (outage).

Data Source: Chase/Williams (Manager/Source)

Accountability: Chase/Lovett

Adverse Trend: None

SEP 15 & 54

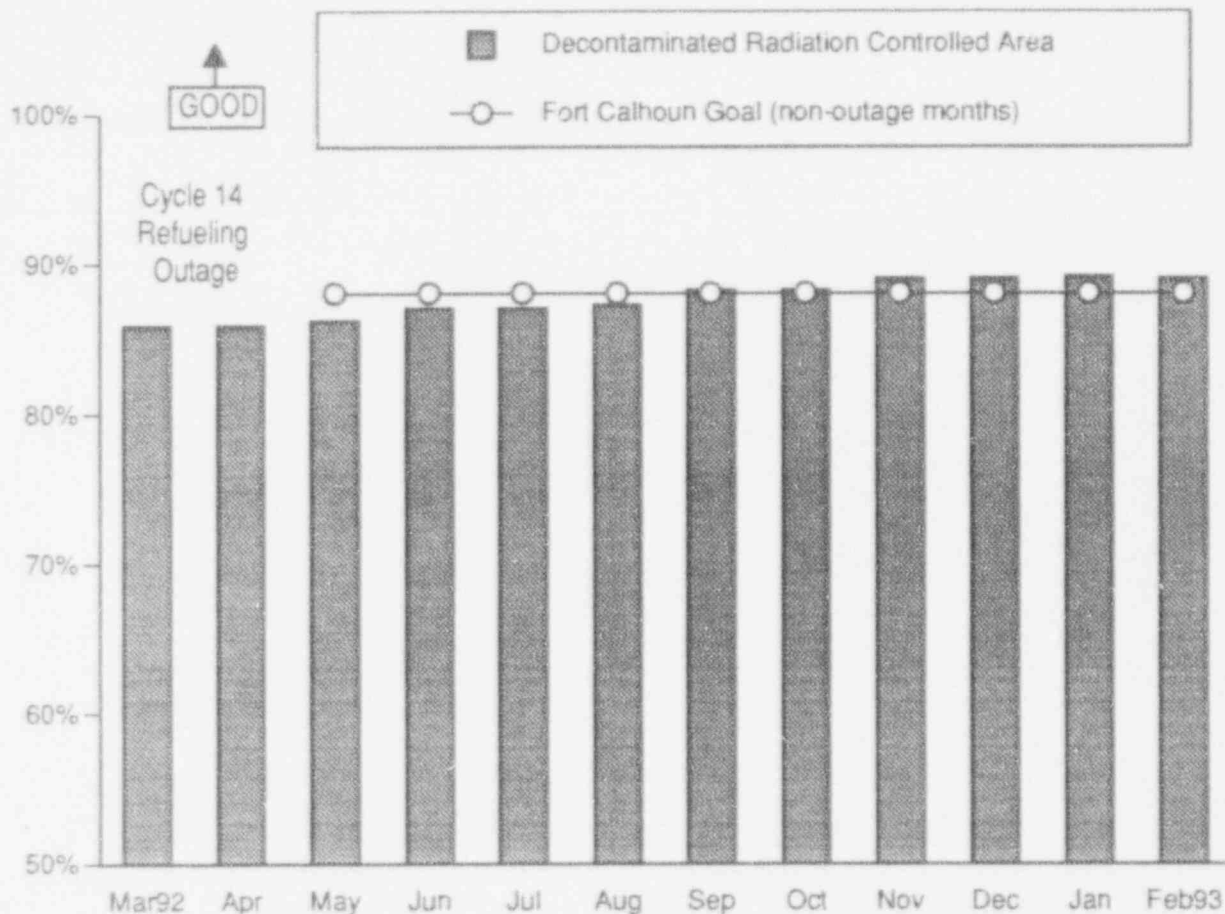

DECONTAMINATED RADIATION CONTROLLED AREA

This indicator shows the percentage of the RCA that is decontaminated (clean) based on the total square footage. The 1993 non-outage goal is a minimum of 88% decontaminated RCA and the outage goal is a minimum of 85% decontaminated RCA. The 1992 non-outage goal was a minimum of 88% decontaminated RCA.


At the end of the reporting month, 89% of the total square footage of the RCA was not contaminated.

Date Source: Chase/Gundal (Manager/Source)

Accountability: Chase/Lovett

Adverse Trend: None

SEP 54

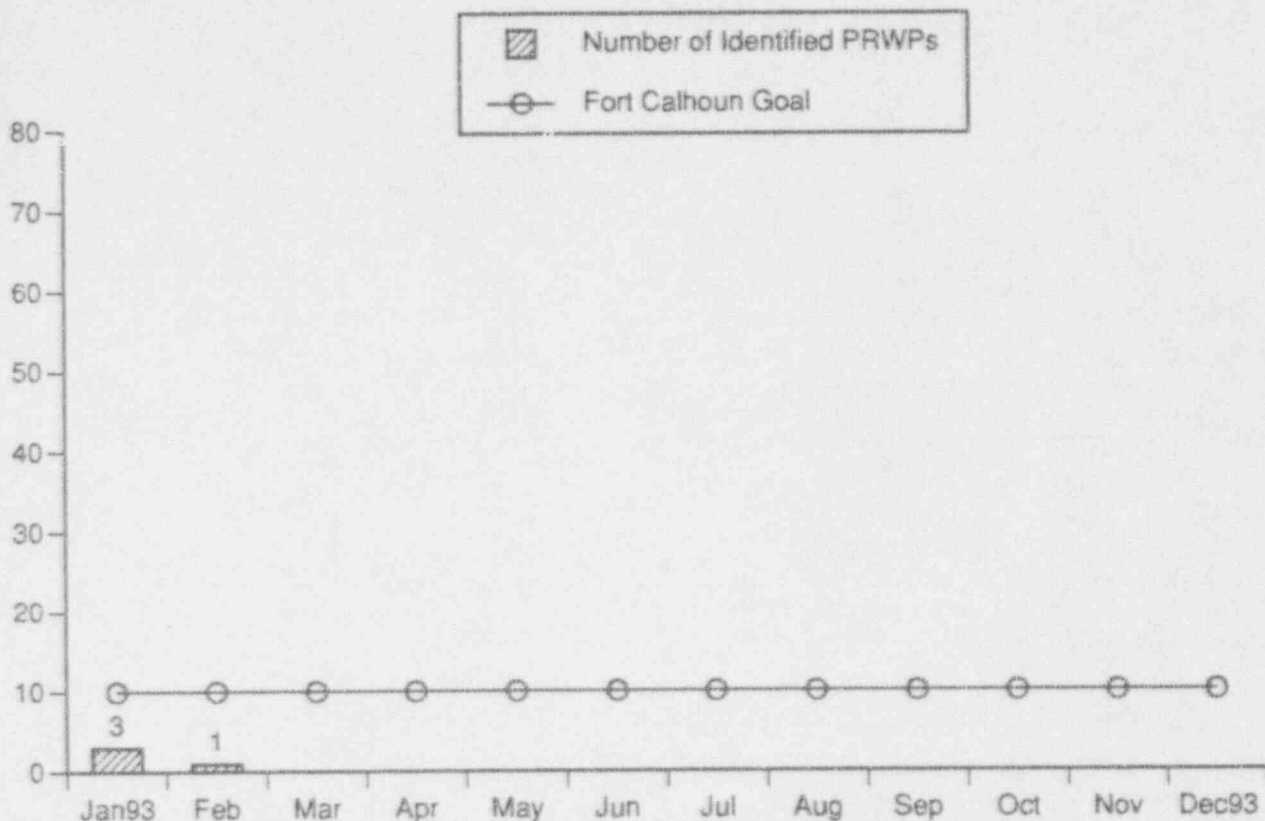

RADIOLOGICAL WORK PRACTICES PROGRAM

The Radiological Work Practices Program Indicator shows the number of Poor Radiological Work Practices (PRWPs) which were identified during the reporting month. The PRWPs are identified through supervisory review of the monthly Radiological Occurrence Reports and Personnel Contamination Reports written during the reporting month.

The number of PRWPs which are identified each month should indirectly provide a means to qualitatively assess supervisor accountability for their workers' radiological performance.

During the month of February 1993 the following PRWP (an ROR) was identified: An individual with expired qualifications was issued a TLD.


The 1993 monthly goal for the number of PRWPs is a maximum of 10 per month.

Data Source: Chase/Williams (Manager/Source)

Accountability: Chase/Lovett

Adverse Trend: None

SEP 52

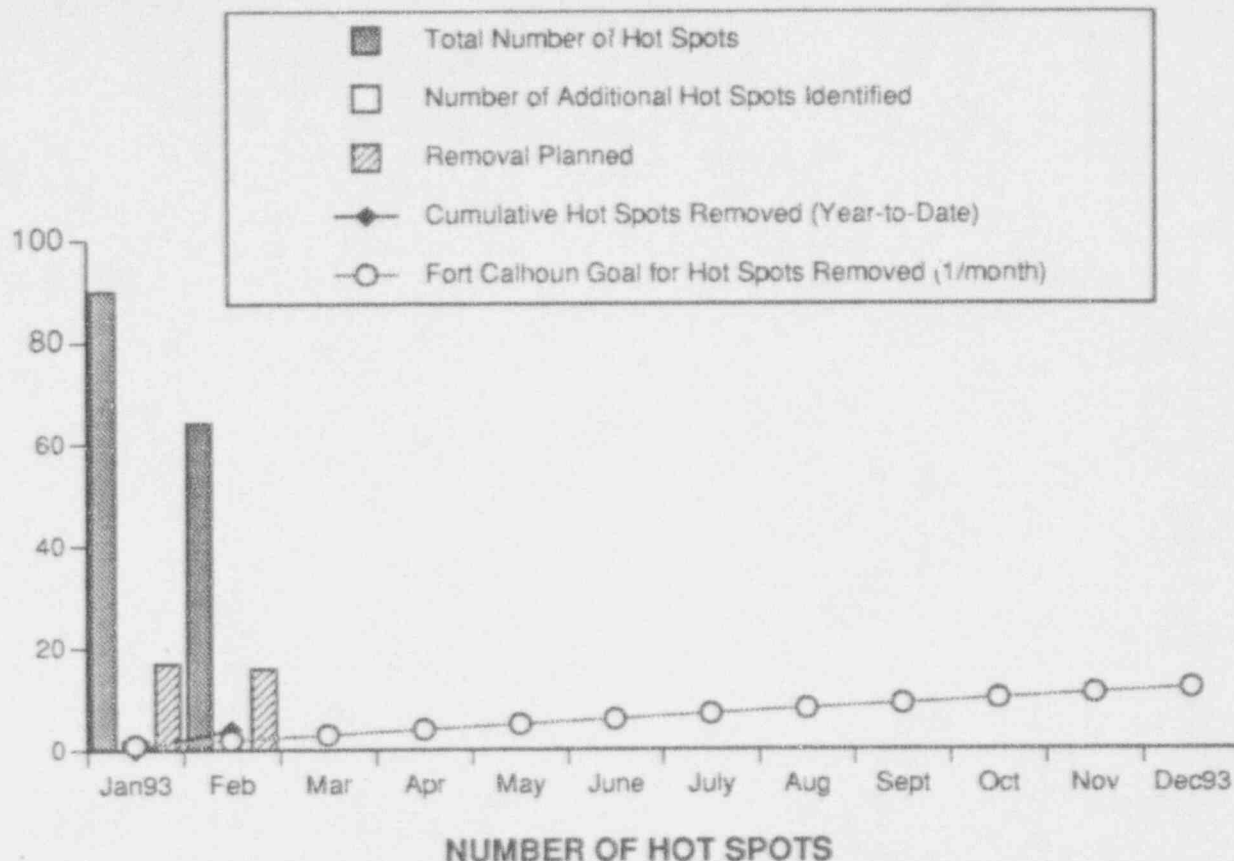

This indicator shows the total number of hot spots which have been identified to exist in the Fort Calhoun Station and have been documented through the use of a hot spot identification sheet. A hot spot is defined as a small localized source of high radiation. A hot spot occurs when the contact dose rate of an item or piece of equipment is at least 5 times the General Area dose rate and the item or piece of equipment's dose rate is equal to or greater than 100 mRem/hour in rad areas.

At the end of February 1993, there was a total of 64 hot spots identified. 4 hot spots were removed during the month in the following locations: 1) 1 hot spot was removed in Rm 5 in the AC-1113 valve body; 2) 3 hot spots were removed from Rm 59 as part of boronometer modification MR-FC-84-155A.

22 hot spots were reclassified as "not accessible" in February and are no longer tracked. No new hot spots were identified in February. Removal is planned for 16 hot spots.


There has been a total of 4 hot spots removed in 1993.

The 1993 Fort Calhoun goal is to remove one hot spot per month and achieve a net reduction of one hot spot per quarter.

Data Source: Chase/Williams (Manager/Source)

Accountability: Chase/Lovett

Adverse Trend: None

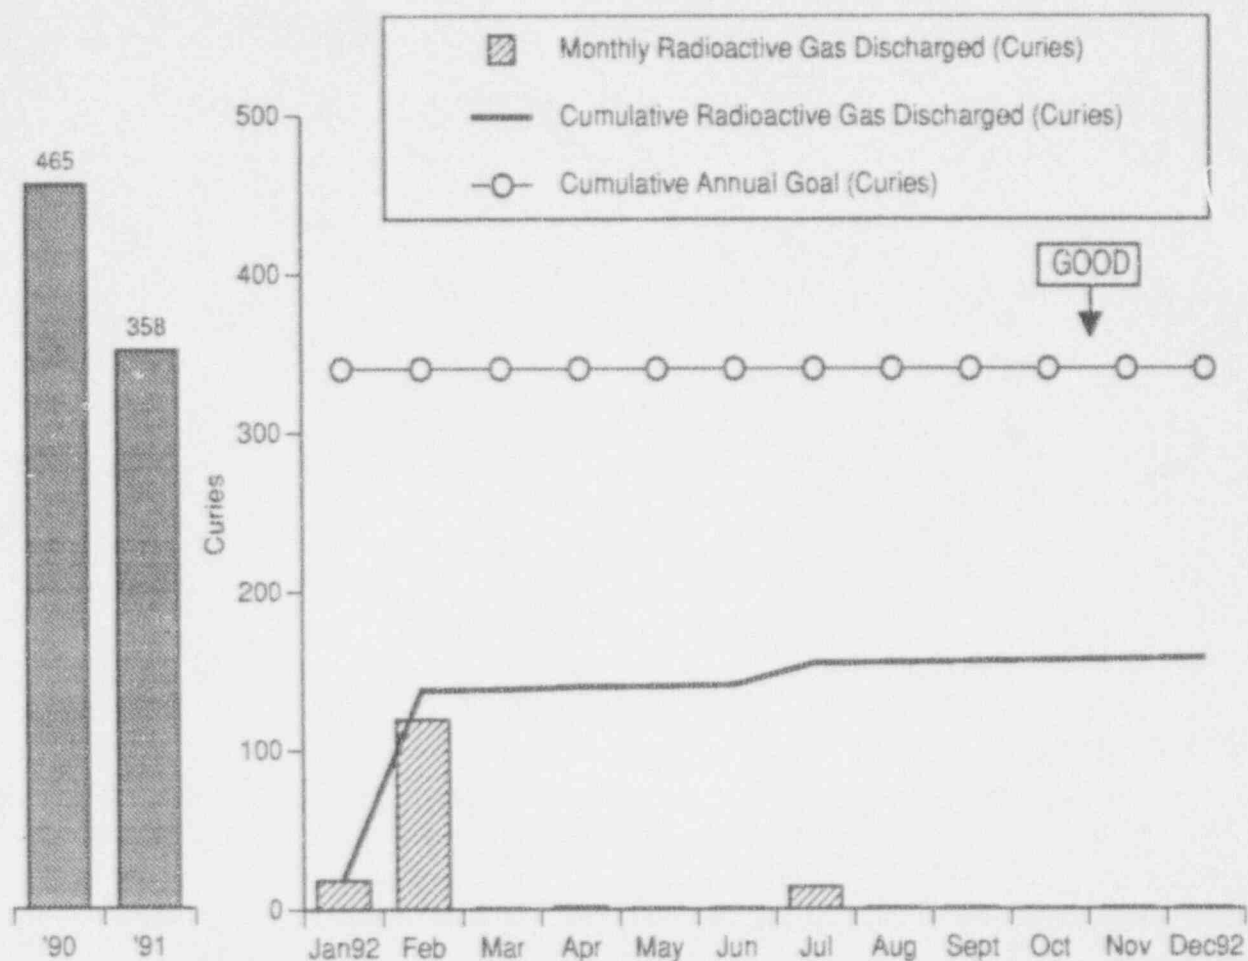

GASEOUS RADIOACTIVE WASTE BEING DISCHARGED TO THE ENVIRONMENT.

The gaseous radioactive waste being discharged to the environment is shown for January 1, 1992 through December 31, 1992. A total of 157.5 curies have been released to the environment during this time.


The Fort Calhoun Station cumulative annual goal for 1992 is a maximum of 340 curies.

The gaseous radioactive waste being discharged to the environment is calculated every six months.

Data Source: Jaworski/Krist (Manager/Source)

Accountability: Chase/Tills

Adverse Trend: None

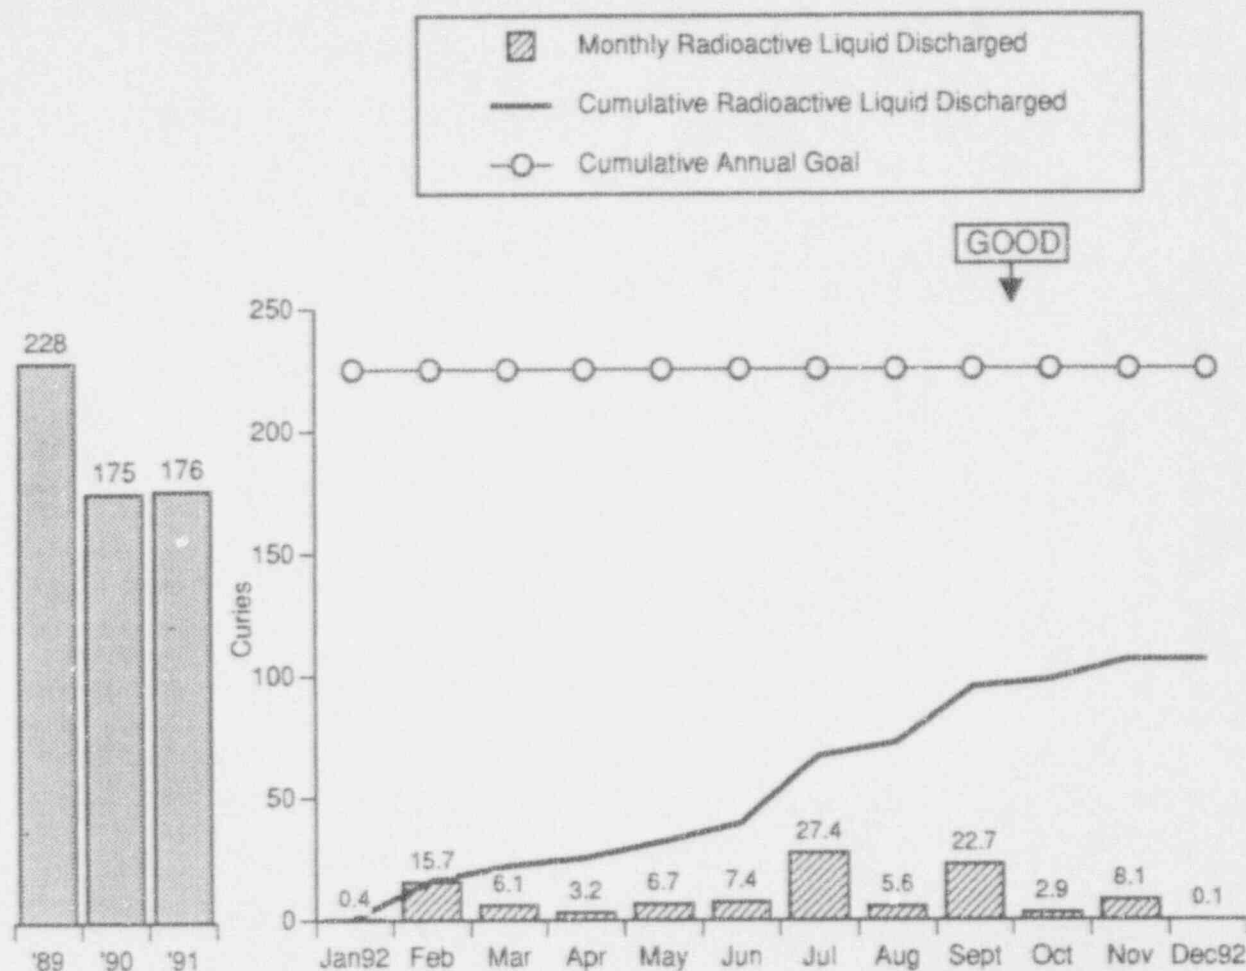

LIQUID RADIOACTIVE WASTE BEING DISCHARGED TO THE ENVIRONMENT

The liquid radioactive waste being discharged to the environment is shown for January 1, 1992 through December 31, 1992. The liquid radioactive waste that was discharged to the environment from all sources totaled 106.3 curies during this time.


The Fort Calhoun Station cumulative annual goal for 1992 is a maximum of 225 curies.

The liquid radioactive waste being discharged to the environment is calculated every six months.

Data Source: Jaworski/Krist (Manager/Source)

Accountability: Chase/Lovett

Adverse Trend: None

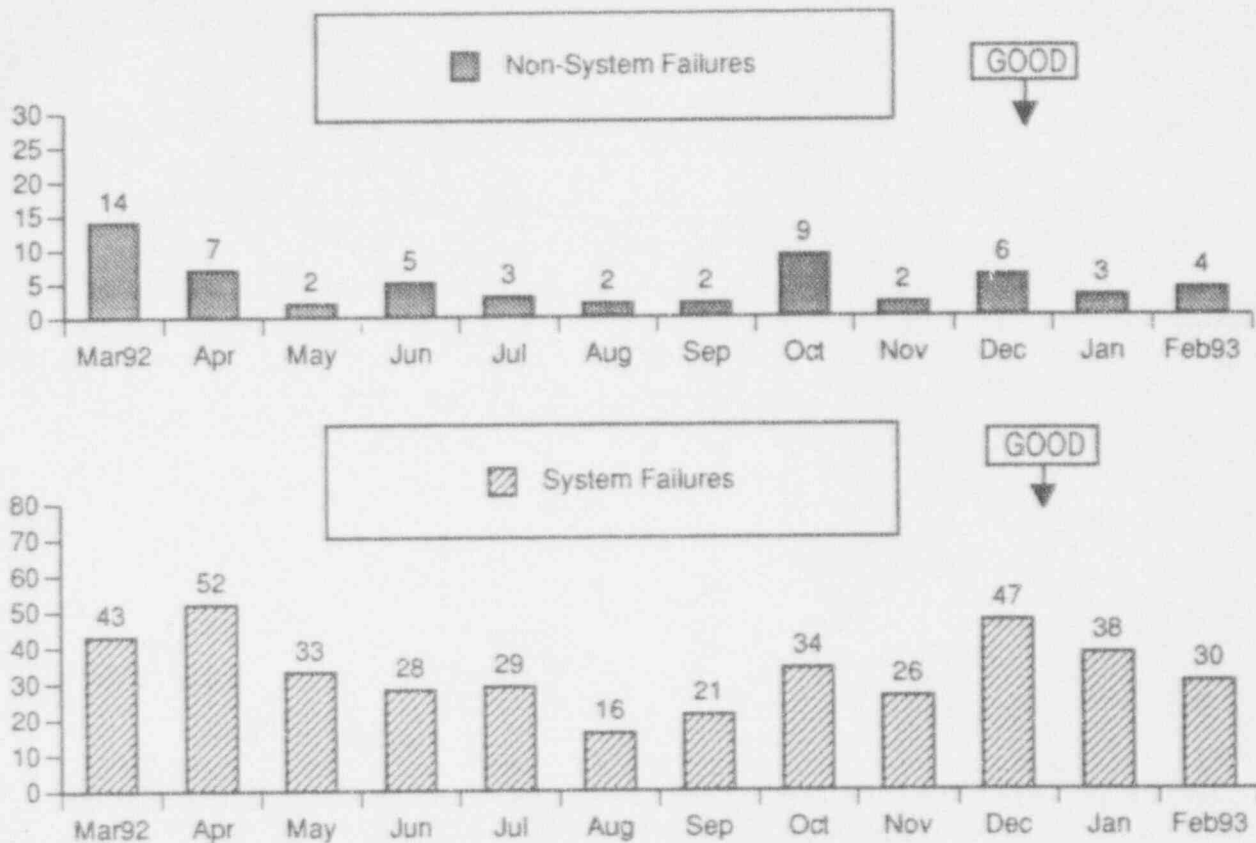


LOGGABLE/REPORTABLE INCIDENTS (SECURITY)

The Loggable/Reportable Incidents (Security) Indicator is depicted in two separate graphs. The top graph depicts the total number of loggable/reportable non-system failures concerning Security Badges, Access Control and Authorization, Security Force Error, and Unsecured Doors. The bottom graph shows the total number of loggable/reportable incidents concerning system failures which occurred during the reporting month.

During the month of February 1993, there were 34 loggable/reportable incidents identified. System failures accounted for 30 (88%) of the loggable/reportable incidents, and 18 (60%) of these were environmental failures. Due to the winter weather conditions during the month of February, the majority of the environmental failures were due to ice and snow. Weather conditions were much more severe in 1993 than 1992, yet system failures significantly decreased during the reporting period.

Data Source: Sefick/Woerner (Manager/Source)
 Accountability: Sefick
 Adverse Trend: None

SEP 58

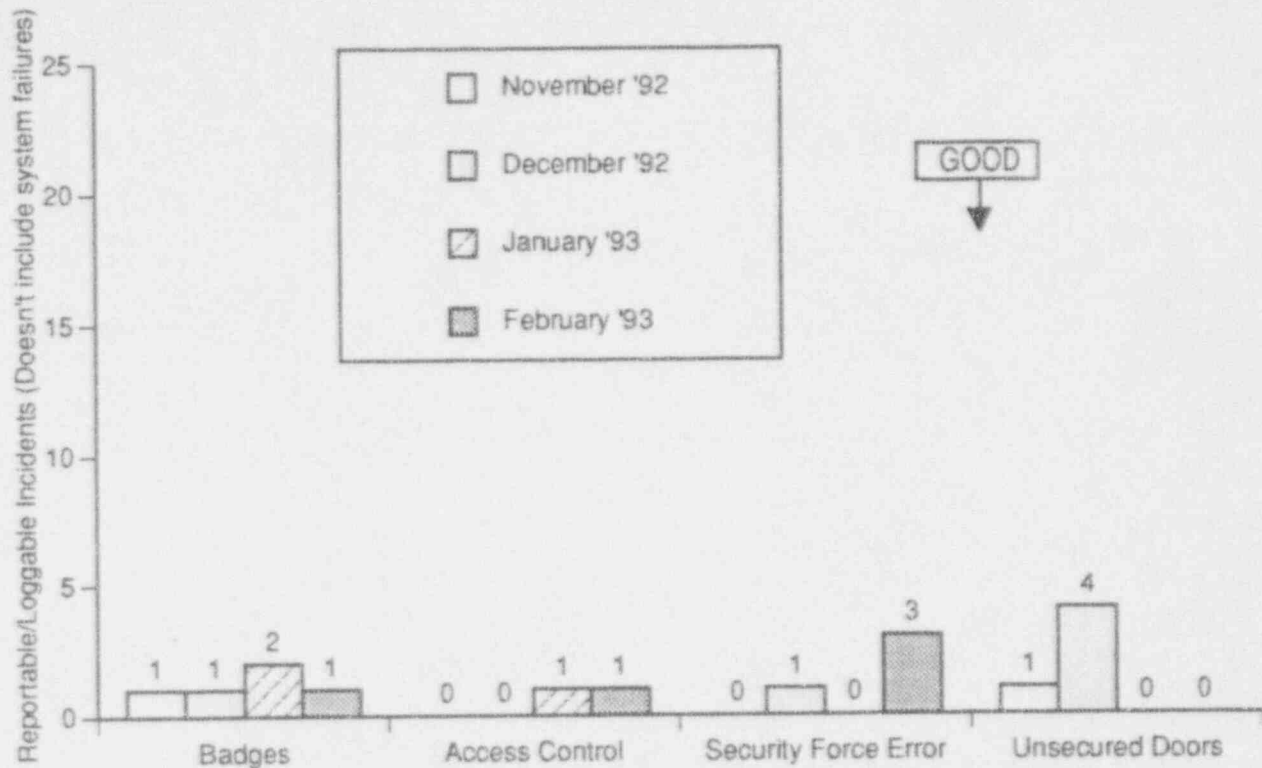

SECURITY NON-SYSTEM FAILURES

This indicator shows the number of loggable/reportable non-system failures for the reporting month. These items include: Security Badges, Access Control and Authorization, Security Force Error, and Unsecured Doors.

Non-System Failures

Number of Incidents



	<u>February '93</u>	<u>January '93</u>
Security Badges	1	2
Access Control and Authorization	1	1
Security Force Error	3*	0
Unsecured Doors	0	0
Total	5	3

*Includes the single Access Control incident (Wrong Badge Issued) above. Actual total of non-system failures in February is 4.

Data Source: Sefick/Woerner (Manager/Source)

Accountability: Sefick

Adverse Trend: None

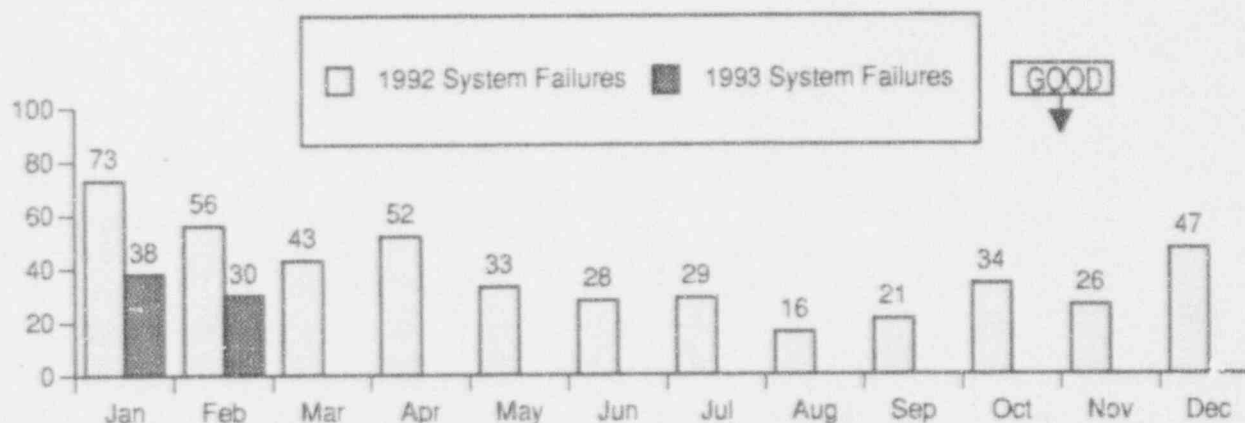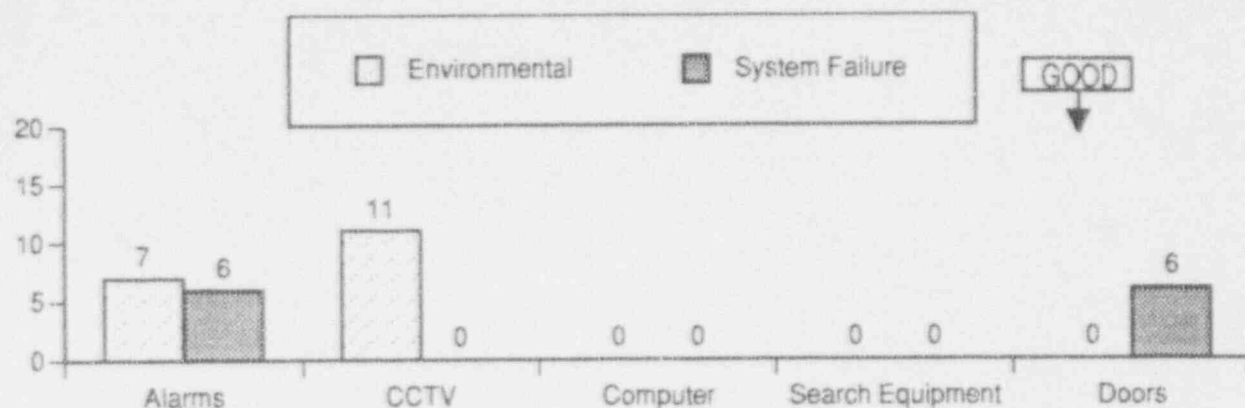


SECURITY SYSTEM FAILURES

This indicator shows the number of loggable/reportable system failures for the reporting month. These items include: Alarm System Failures, CCTV failures, Security Computer Failures, Search Equipment Failures and Door Hardware Failures. Alarm systems and CCTV failures will be divided into two categories: environmental failures and failures as defined in the performance indicator definitions. Also, the 1992 and 1993 System Failures will be compared on a monthly basis.

System	Number of Incidents			
	February '93		January '93	
	Environ	Failures	Environ	Failures
Alarms	7	6	10	6
CCTV	11	0	16	0
Computer	N/A	0	N/A	0
Search Equipment	N/A	0	N/A	3
Door Hardware	N/A	6	N/A	3
Totals	18	12	26	12

Data Source: Sefick/Woerner (Manager/Source)
 Accountability: Sefick/Chase
 Adverse Trend: None

SEP 58

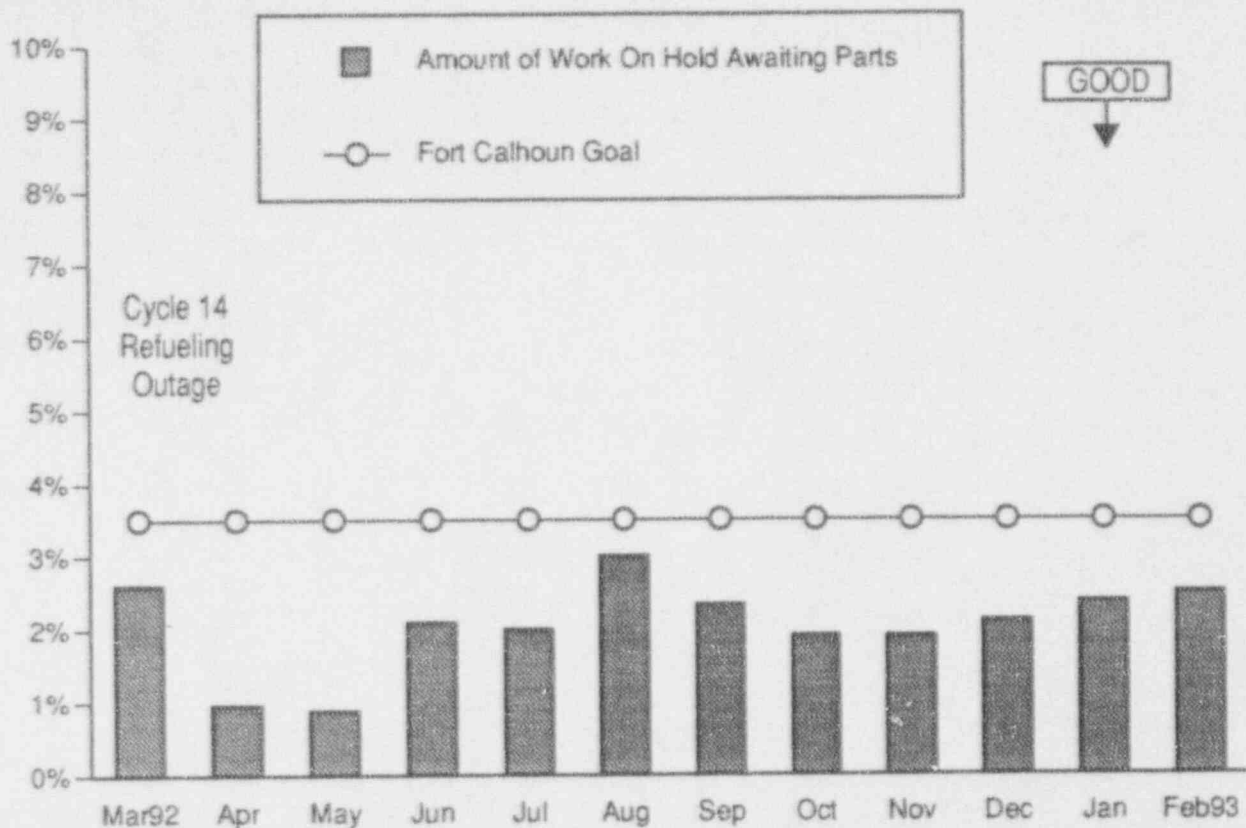

AMOUNT OF WORK ON HOLD AWAITING PARTS (NON-OUTAGE)

This procurement indicator displays the percentage of open, non-outage maintenance items that are on hold awaiting parts, to the total amount of open, non-outage maintenance items.


There was a total of 875 open, non-outage maintenance work orders (MWOs) with 22 (2.5%) of these MWOs on hold awaiting parts at the end of February 1993.

The 1993 and 1992 Fort Calhoun Goals for this indicator are to have less than 3.5% of the total number of open, non-outage MWOs awaiting parts.

Data Source: Willrett/CHAMPS (Manager/Source)

Accountability: Willrett/Fraser

Adverse Trend: None

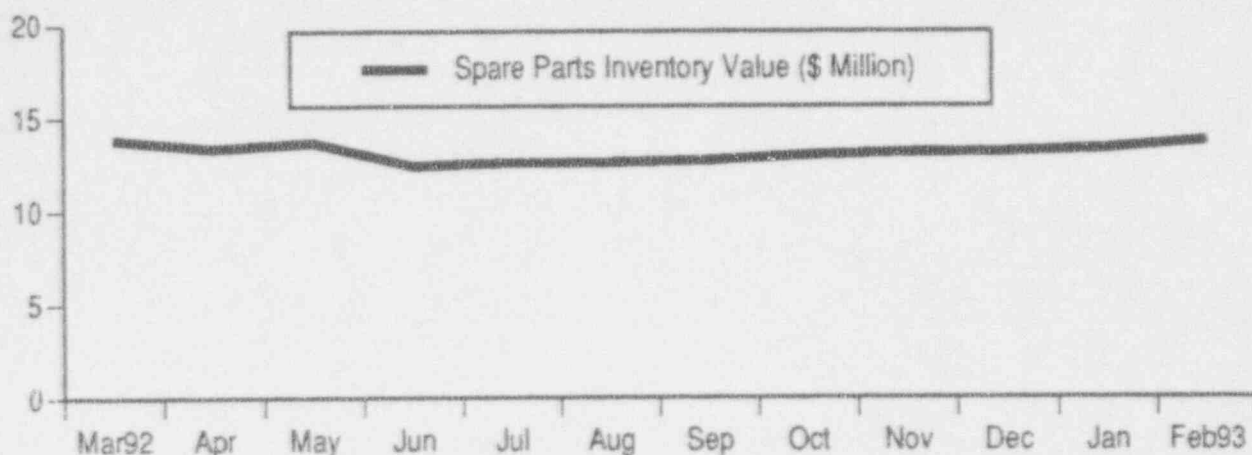


SPARE PARTS INVENTORY VALUE

The spare parts inventory value at the Fort Calhoun Station at the end of February 1993 was reported as \$13,744,525.

Data Source: Steele/Huliska (Manager/Source)

Accountability: Willrett/McCormick

Adverse Trend: None

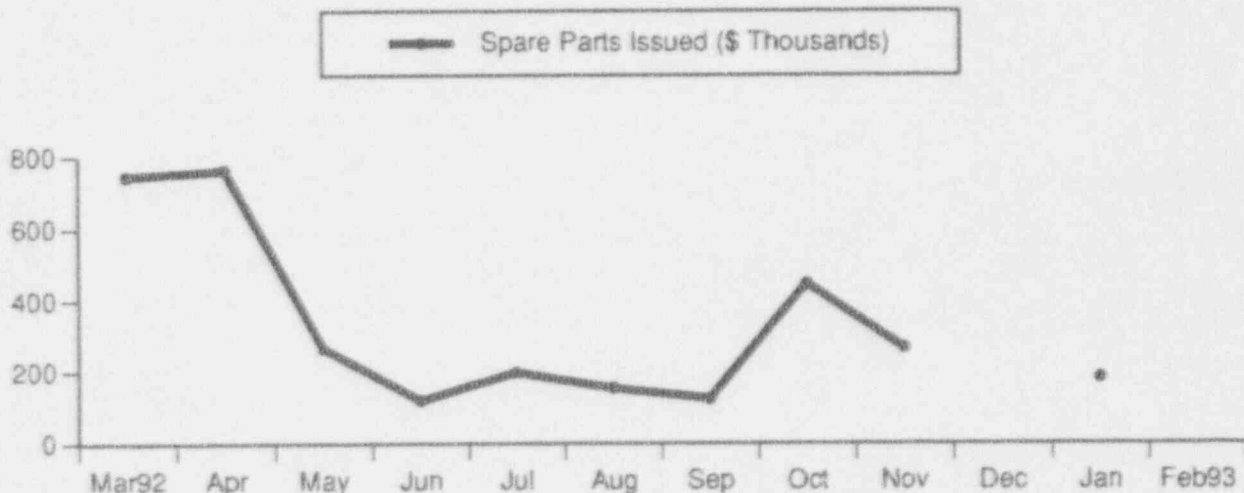


SPARE PARTS ISSUED

The value of the spare parts issued during February 1993 and December 1992 was unavailable due to a printer problem.

Data Source: Steele/Miser (Manager/Source)

Accountability: Willrett/McCormick

Adverse Trend: None

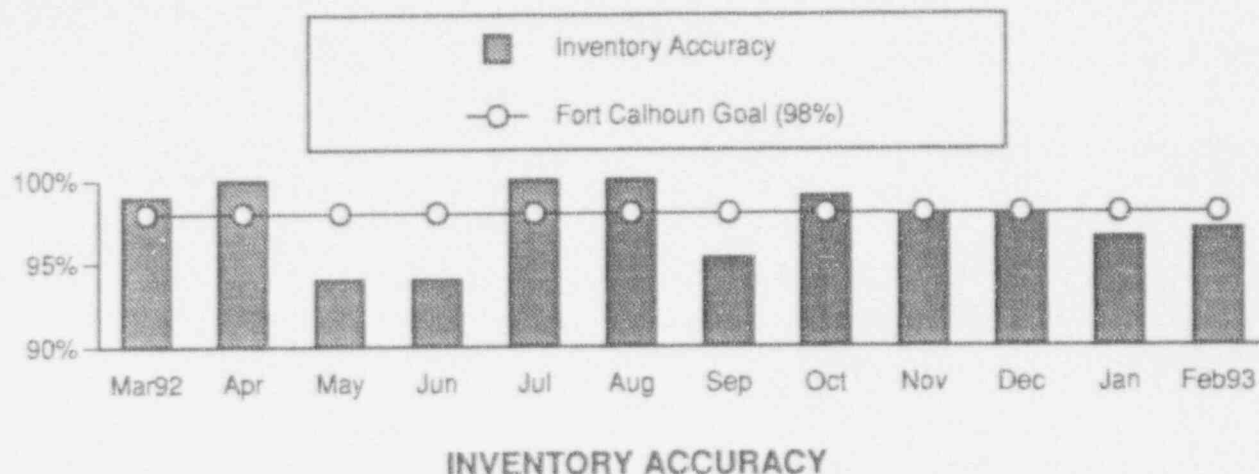


This indicator shows the accuracy of the actual parts count for the warehouse compared to the counts contained in the MMIS computer system for the reporting month.

During February 1993, 531 different line items were counted in the warehouse. Of the 531 line items counted, 15 items needed count adjustments. The inventory accuracy for the month of February was reported as 97%. The Fort Calhoun 1993 and 1992 monthly goals for this indicator are a minimum inventory accuracy of 98%.

Data Source: Willrett/McCormick (Manager/Source)

Accountability: Willrett/McCormick

Adverse Trend: None

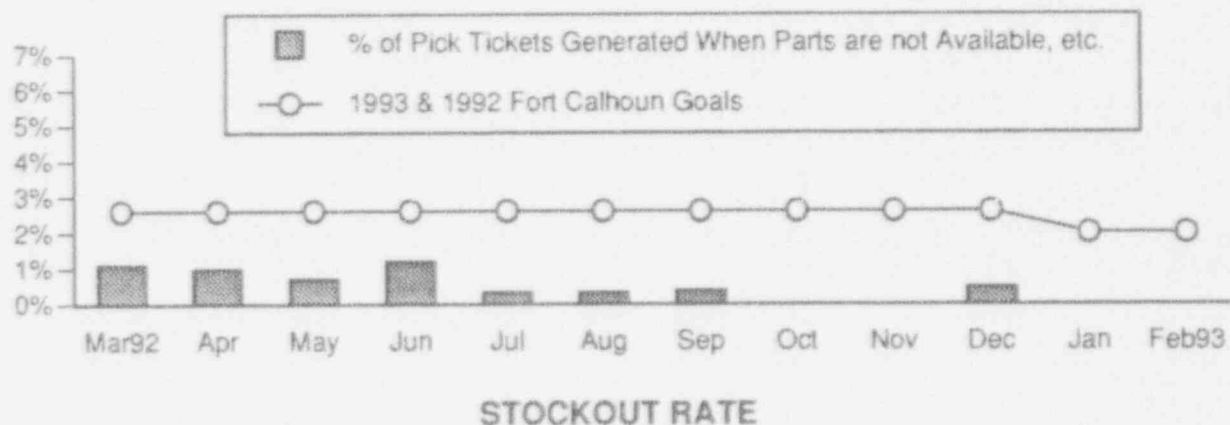


This indicator shows the percentage of the number of Pick Tickets generated when the amount of parts requested is equal to or less than the minimum stocking level and parts are not available.

During February 1993, a total of 1,257 Pick Tickets were generated. Of the 1,257 Pick Tickets generated, none were generated when the amount of parts requested was equal to or less than the minimum stocking level and parts were not available. The Fort Calhoun 1993 goal for this indicator is a maximum of 2.0%. The 1992 goal was 2.6%.

Data Source: Willrett/McCormick (Manager/Source)

Accountability: Willrett/McCormick

Adverse Trend: None

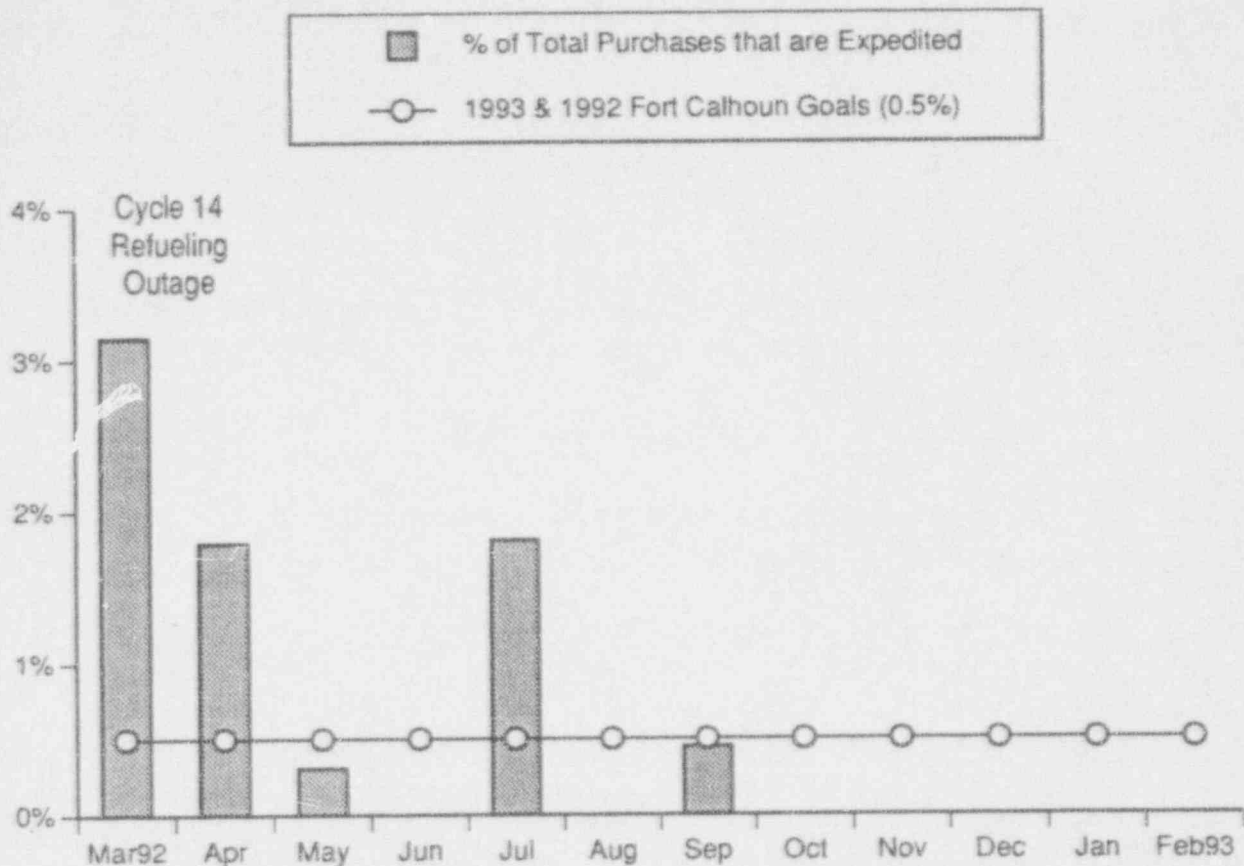

EXPEDITED PURCHASES

This indicator shows the percentage of expedited purchases compared to the total number of purchase orders generated during the reporting month.

During February, there was a total of 366 purchase orders generated. Of the 366 purchase orders generated, there were no expedited purchases.


The 1993 Fort Calhoun monthly goal for this indicator is a maximum of 0.5%.

The number of expedited purchases was above the Fort Calhoun goal during the months of March and April 1992 due to the ordering of items related to the Cycle 14 Refueling Outage.

Date Source: Willrett/Fraser (Manager/Source)

Accountability: Willrett/Fraser

Adverse Trend: None

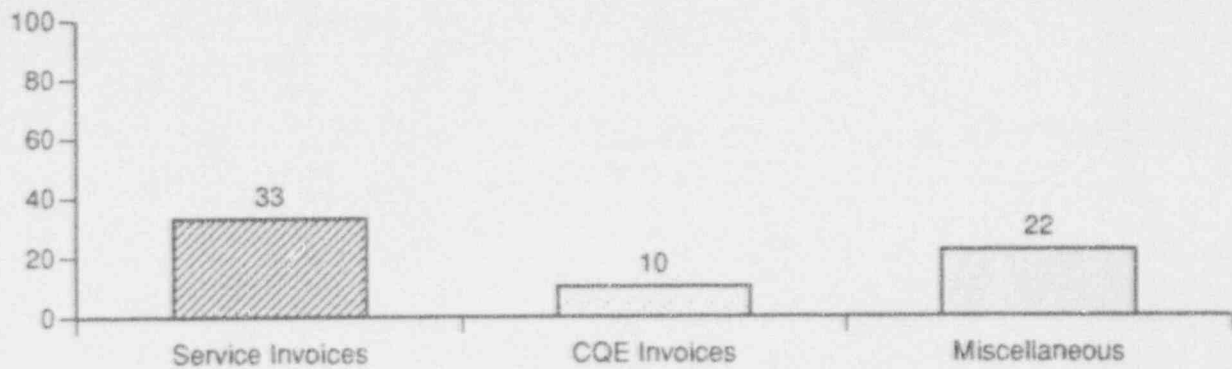


INVOICE BREAKDOWN

This indicator shows the number of service invoices, CQE invoices, and miscellaneous invoices for the month of February 1993.

Date Source: Willrett/Fraser (Manager/Source)

Accountability: Willrett/Fraser

Adverse Trend: None

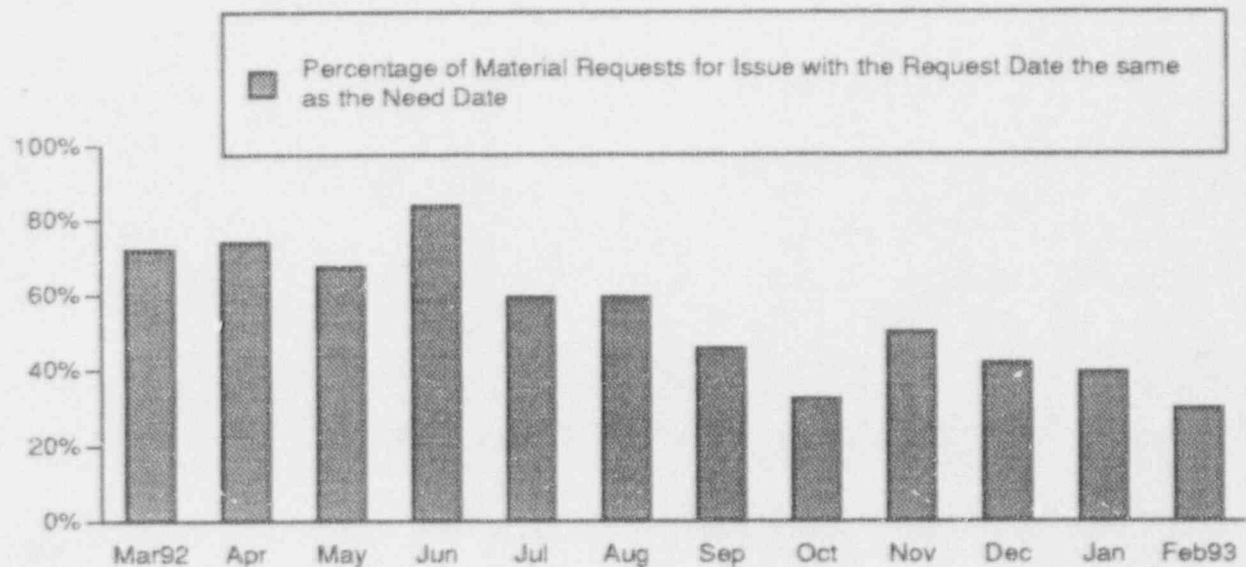

MATERIAL REQUEST PLANNING


This indicator shows the percentage of material requests (MRs) for issue with their request date the same as their need date compared to the total number of MRs for issue for the reporting month.

During the month of February 1993, a total of 1,257 MRs were received by the warehouse. Of the 1,257 total MRs received by the warehouse, 29.9% of the MRs (376) were for issue with their request date the same as their need date.

Data Source: Willrett/McCormick (Manager/Source)

Accountability: Willrett/McCormick

Adverse Trend: None

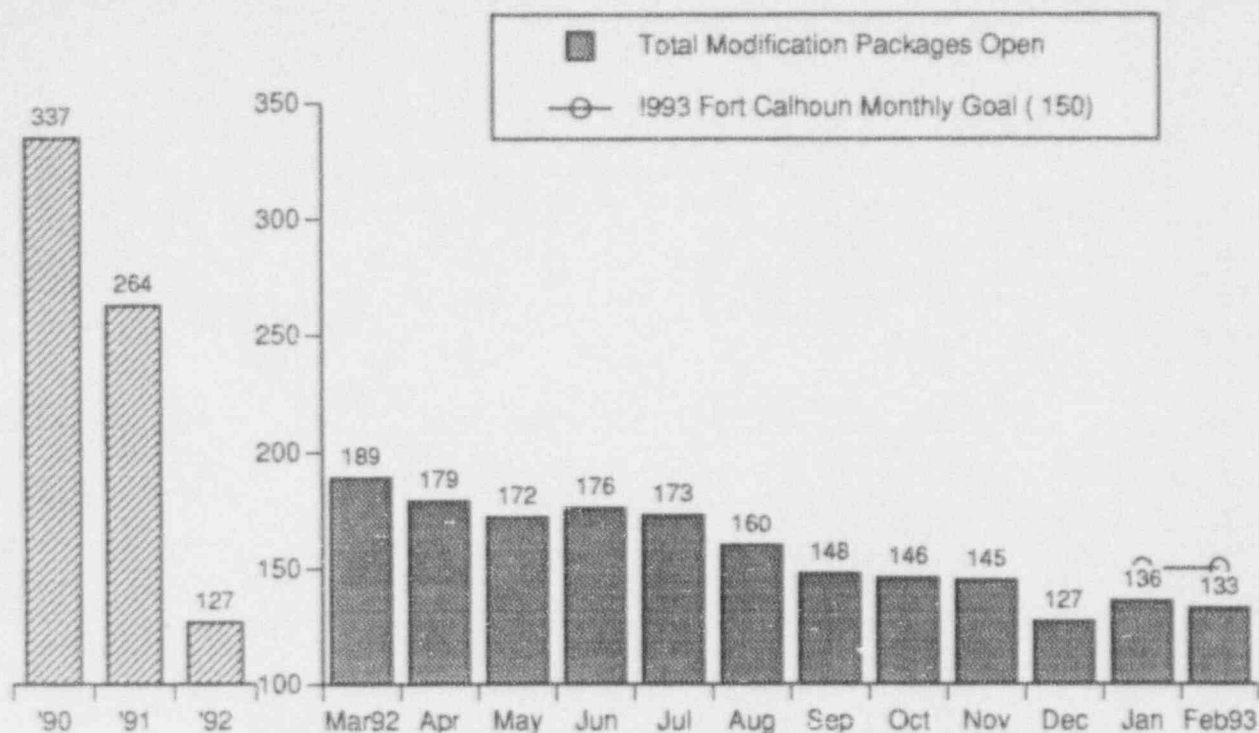

OUTSTANDING MODIFICATIONS

This indicator shows the total number of outstanding modifications (excluding outstanding modifications which are proposed to be cancelled).

Category	Reporting Month
Form FC-1133 Backlog/In Progress	10
Mod. Requests Being Reviewed	10
Design Engr. Backlog/In Progress	69
Construction Backlog/In Progress	36
Design Engr. Update Backlog/In Progress	8
Total	133


At the end of February 1993, 5 additional modification requests had been issued this year and 8 modification requests had been cancelled. The Nuclear Projects Review Committee (NPRC) had completed 44 backlog modification request reviews this year. The Nuclear Projects Committee (NPC) had completed 18 backlog modification request reviews this year.

The 1993 Fort Calhoun monthly goal is a maximum of 150 total outstanding modifications.

Data Source: Jaworski/Turner (Manager/Source)
Scofield/Lounsbery (Manager/Source)

Accountability: Scofield/Phelps

Adverse Trend: None

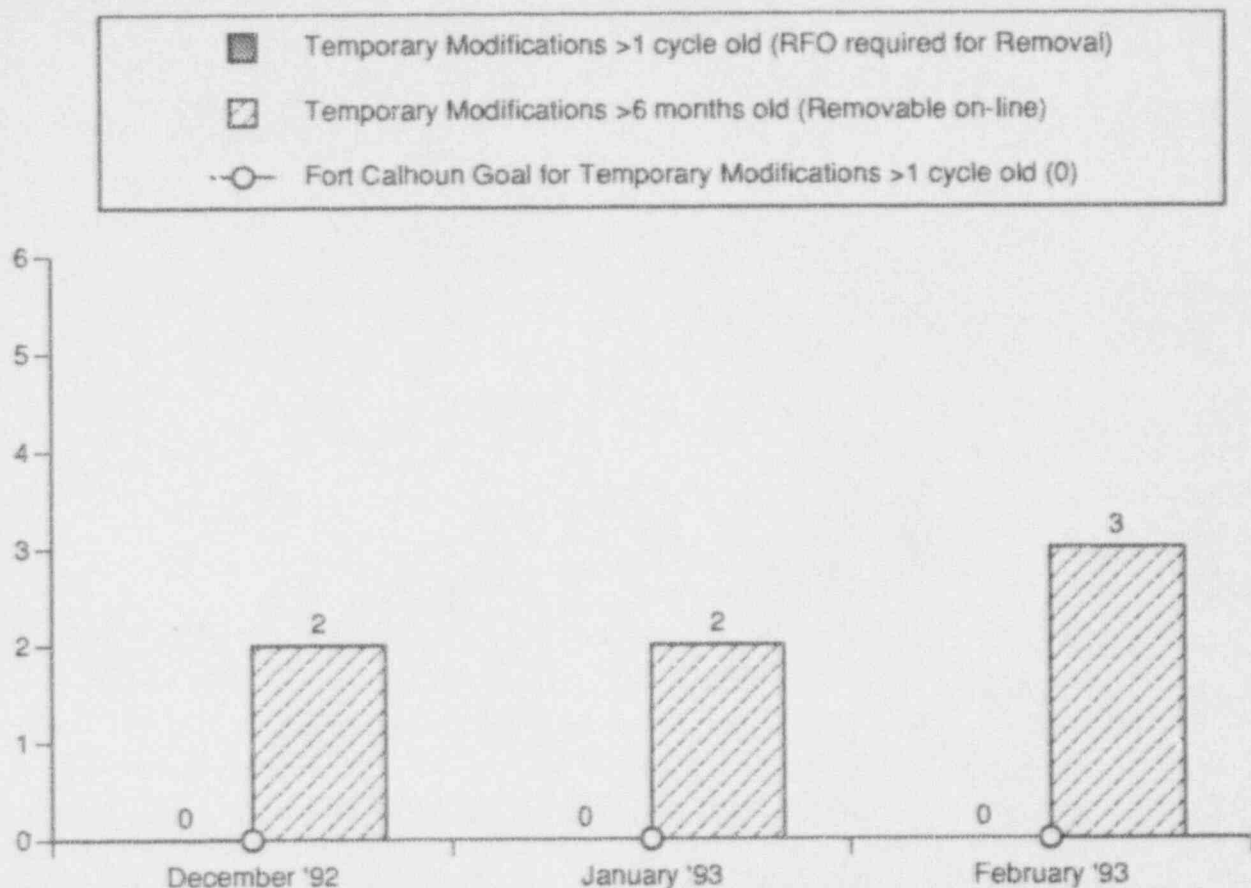

TEMPORARY MODIFICATIONS (EXCLUDING SCAFFOLDING)

This indicator provides information on the number of temporary modifications greater than one fuel cycle old requiring a refueling outage (RFO) for removal and the number of temporary modifications removable on-line that are greater than six months old. Also provided is the Fort Calhoun goal for temporary modifications.

There are currently no temporary modifications that are greater than one fuel cycle old requiring a refueling outage to remove. In addition, at the end of February 1993 there were 3 temporary modifications installed that were greater than six months old that can be removed on-line. These were: 1) potable water supply piping temporary repair, which is in progress awaiting completion of MWOs 894520 and 912718; 2) PTZ camera 51 power supply, in which DEN electrical is to respond to ECN 93-113; 3) HE-2 circuit board, in which DEN electrical is to respond to ECN 93-086.


At the end of February 1993, there was a total of 24 TMs installed in the Fort Calhoun Station. 16 of the 24 installed TMs require an outage for removal and 8 are removable on-line. In 1993 a total of 7 temporary modifications have been installed.

Data Source: Jaworski/Turner (Manager/Source)

Accountability: Jaworski/Gorence

Adverse Trend: None

SEP 62 & 71

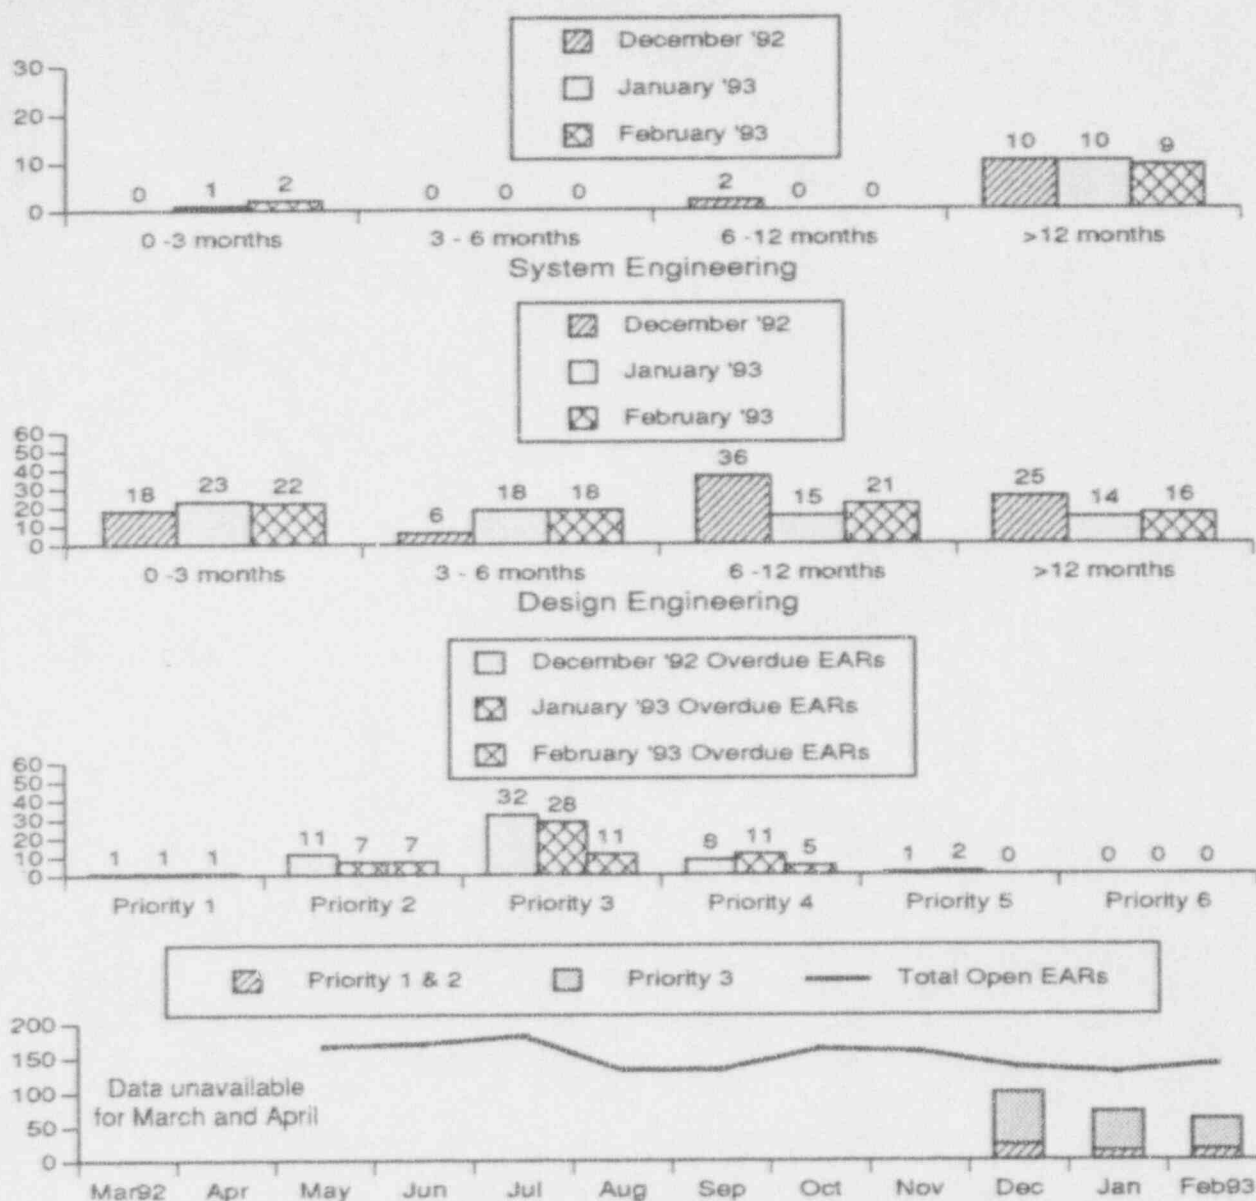

ENGINEERING ASSISTANCE REQUEST (EAR) BREAKDOWN

This indicator shows a breakdown of the number of EARs assigned to Design Engineering and System Engineering awaiting a technical response from engineering.

At the end of February 1993, 51 EARs had been resolved and were going through the closeout process. There was 1 EAR awaiting a technical response from Nuclear Projects.

Total EAR breakdown is as follows:


EARs opened during the month	15
EARs closed during the month	22
Total EARs open as of the end of the month	140

Data Source: Phelps/Pulverenti (Manager/Source)

Accountability: Jaworski/Phelps

Adverse Trend: None

SEP 62

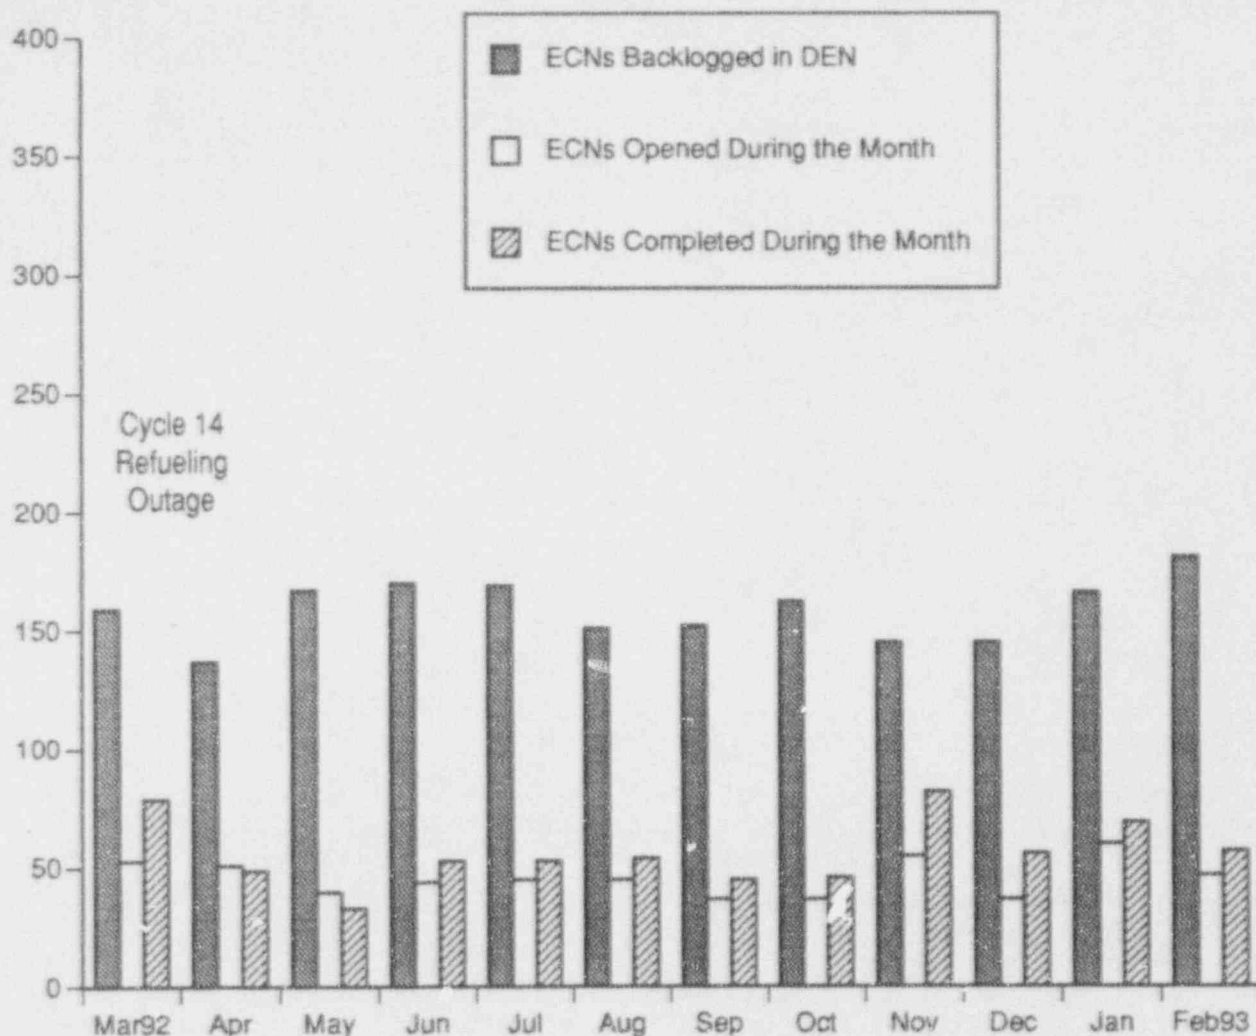

ENGINEERING CHANGE NOTICE STATUS

This indicator shows the number of Engineering Change Notices (ECNs) awaiting completion by DEN, the number of ECNs opened during the reporting month, and the number of ECNs completed by DEN during the reporting month.

At the end of February 1993, there was a total of 181 DEN backlogged open ECNs. There were 47 ECNs opened, and 57 ECNs completed during the month.




Although the number of open ECNs is currently high, activities are in progress to reduce the backlog of open ECNs. It is expected that the number of open ECNs will continue to decrease.

Data Source: Phelps/Pulverenti (Manager/Source)

Accountability: Phelps/Jaworski

Adverse Trend: None

SEP 62

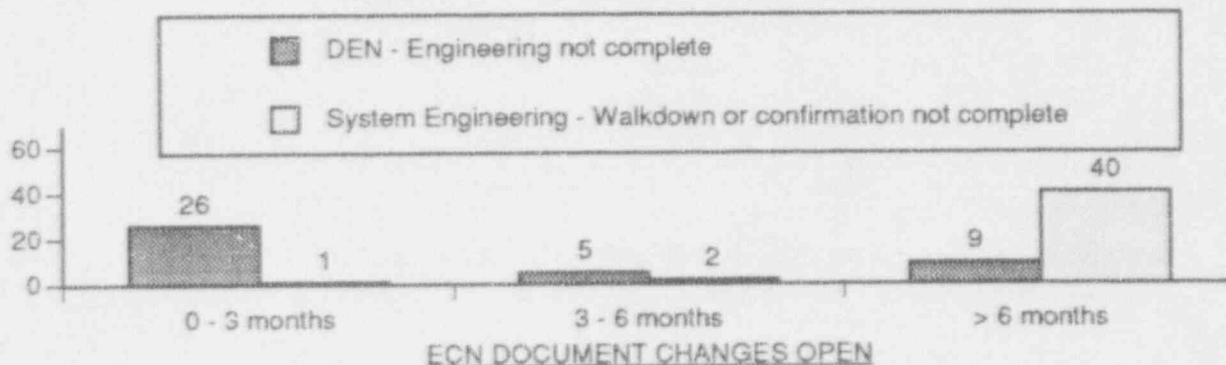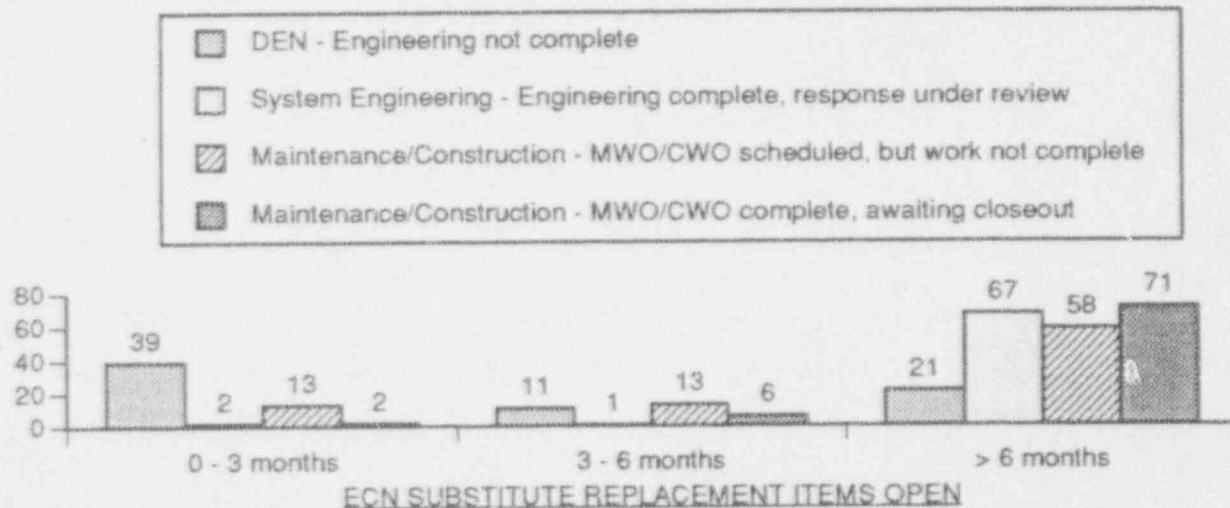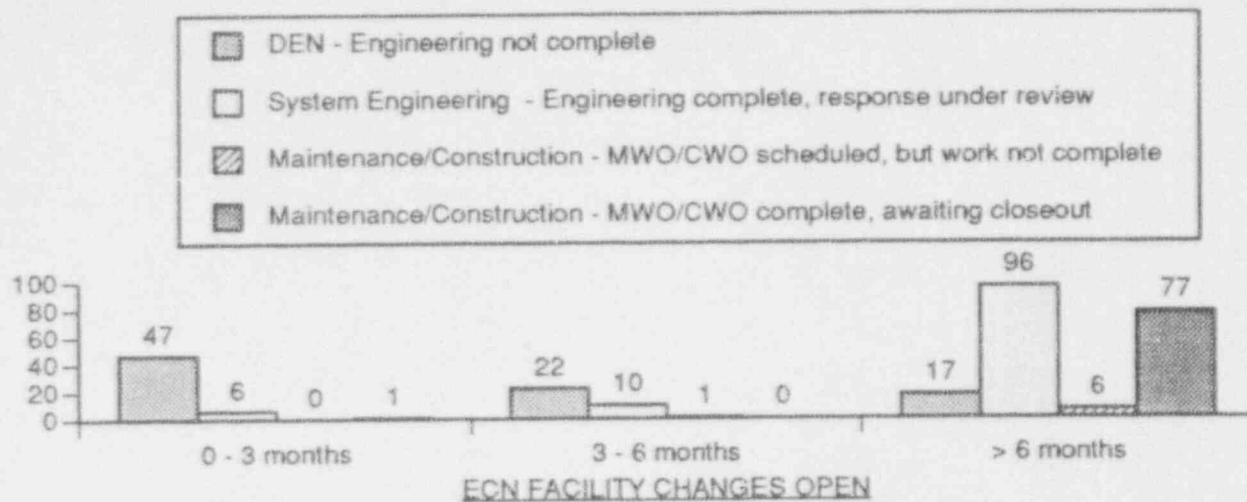

ENGINEERING CHANGE NOTICE BREAKDOWN


This indicator shows a breakdown of the number of Engineering Change Notices (ECNs) that are assigned to Design Engineering Nuclear (DEN), System Engineering, and Maintenance or Construction for the reporting month. The graphs provide data on ECN Facility Changes Open, ECN Substitute Replacement Items Open, and ECN Document Changes Open.

Data Source: Phelps/Pulverenti (Manager/Source)

Accountability: Phelps/Jaworski

Adverse Trend: None

SEP 62

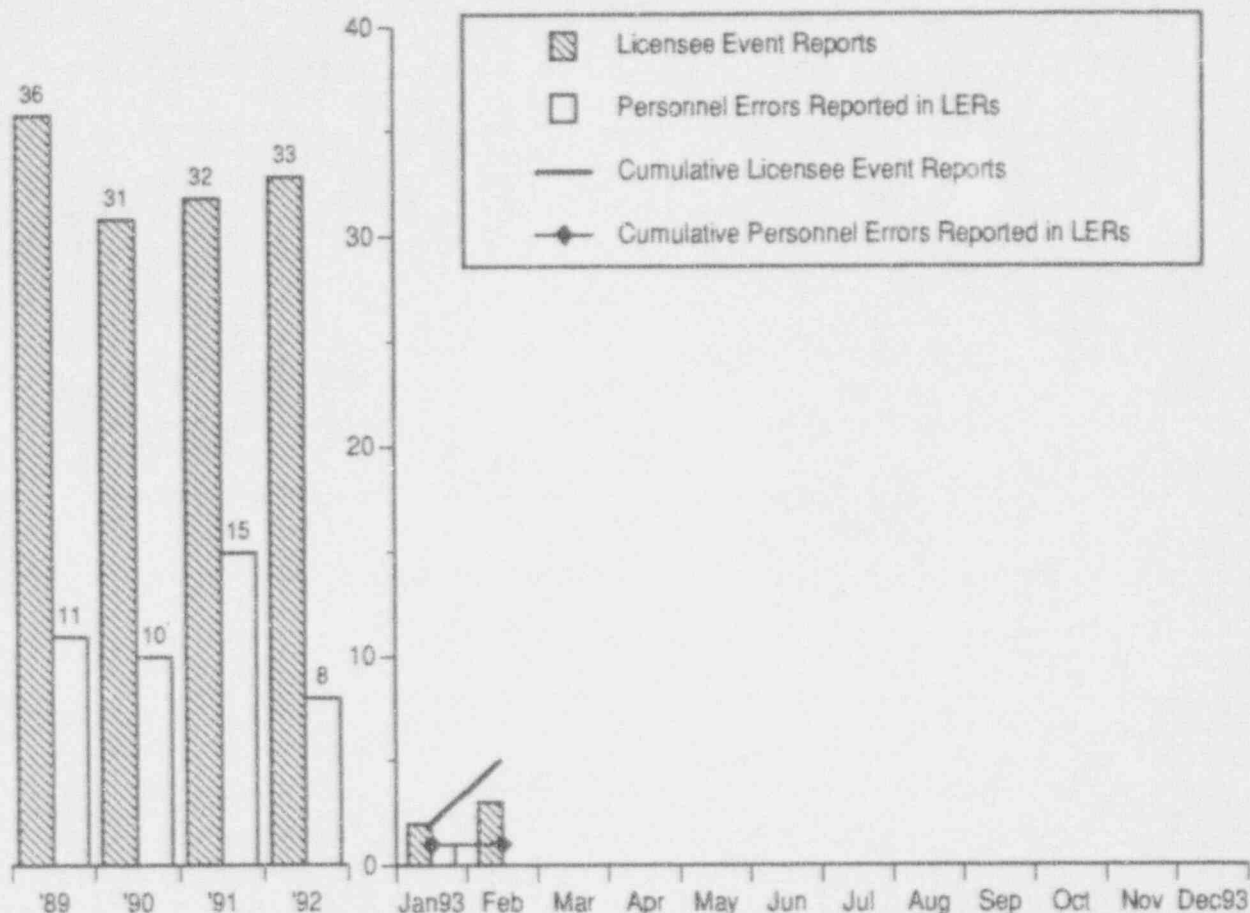

NUMBER OF PERSONNEL ERRORS REPORTED IN LERS

This indicator shows the number of Licensee Event Reports (LERs) submitted during each month in 1993, the LERs attributed to personnel error for each month, and the cumulative totals of both. The year-end totals for the four previous years are also shown.

In February, there was a total of 3 LERs reported, none of which were attributed to Licensed Operator error. The following LERs were submitted during this reporting period:

LER 93-001: Failure to Satisfy Surveillance Requirement for Boric Acid Tank Level Check

LER 93-002: Inappropriate Steam Generator Low Pressure Signal Block Reset Values

LER 93-003: Failure to Satisfy Inservice Testing Requirement for Raw Water Pump


Data Source: Short/Lippy (Manager/Source)

Accountability: Chase

Adverse Trend: None

70

SEP 15

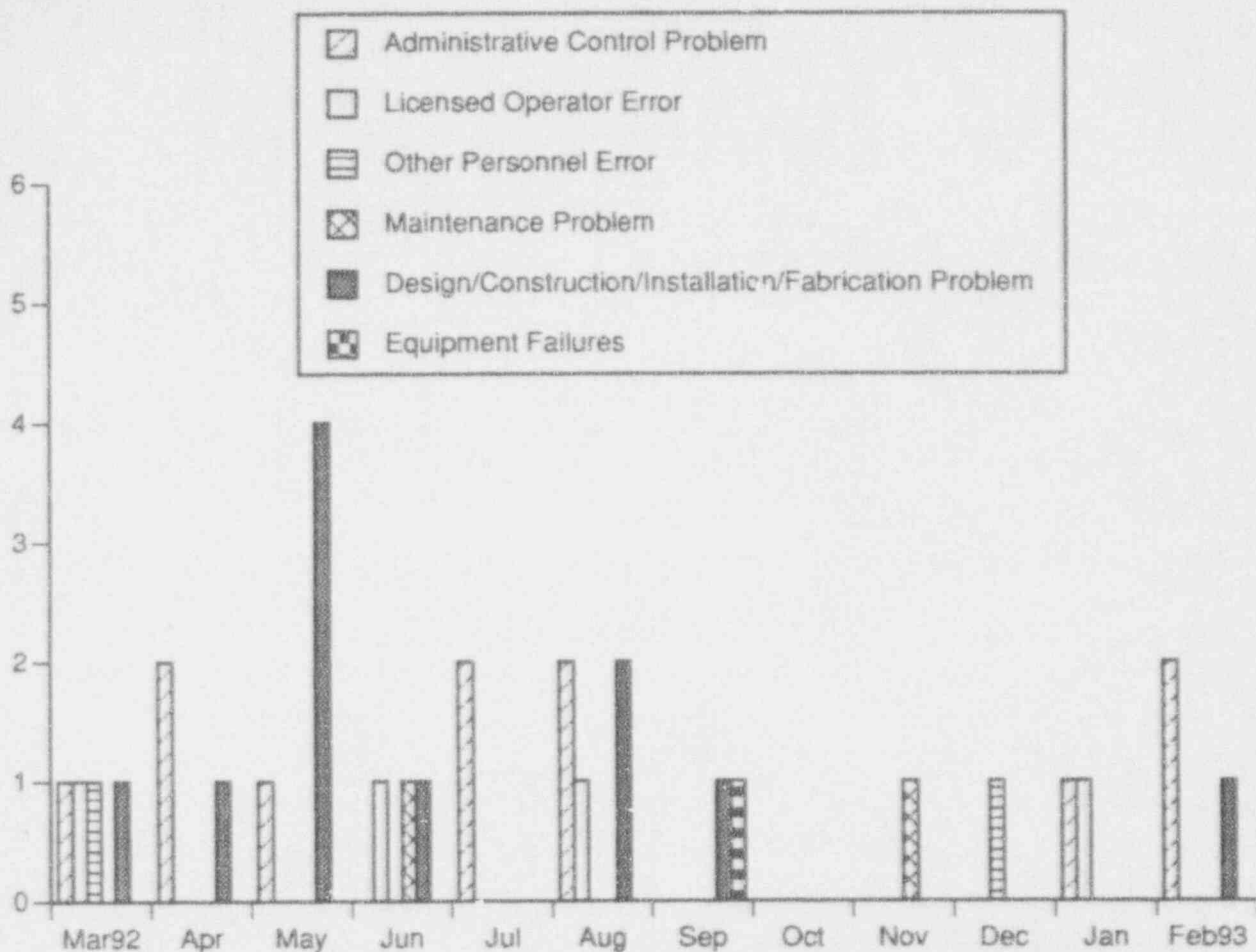

LICENSEE EVENT REPORT (LER) ROOT CAUSE BREAKDOWN

This indicator shows the LERs by report date broken down by Root Cause Code for each of the past twelve months from March 1, 1992 through February 28, 1993.


The cause codes are intended to identify possible programmatic deficiencies. In order to be consistent with industry reporting, the Root Cause Codes have been revised to reflect the NRC's sequence coding. For detailed descriptions of these codes, see the "Performance Indicator Definitions" section of this report.

There were 3 LERs submitted in February 1993, 2 of which were attributed to Administrative Control Problems and 1 other which was attributed to improper design.

Data Source: Short/Lippy (Manager/Source)

Accountability: Chase

Adverse Trend: None

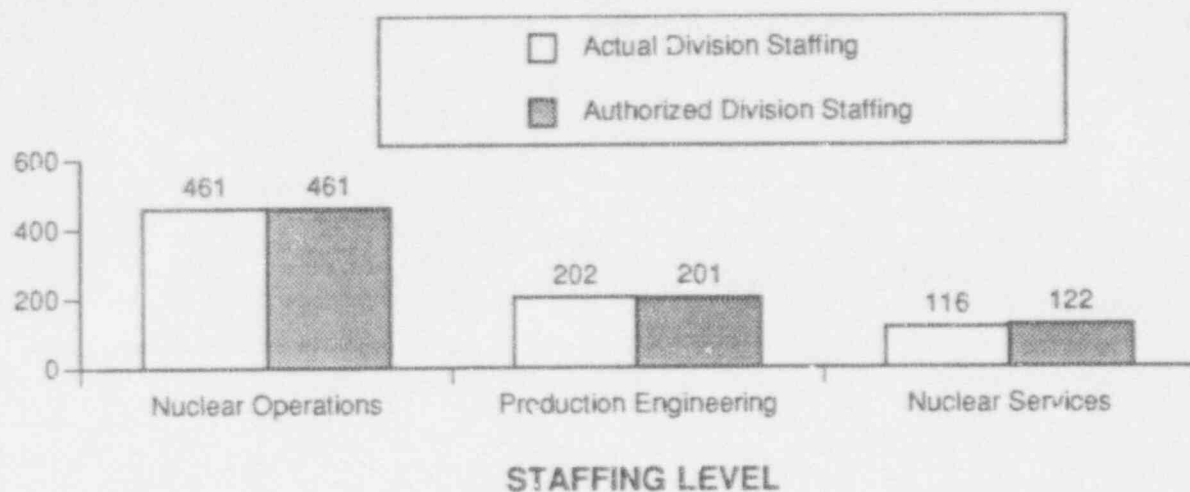


The authorized and actual staffing levels are shown for the three Nuclear Divisions.

Data Source: Sorenson/Burke (Manager/Source)

Accountability: Waszak

Adverse Trend: None

SEP 24

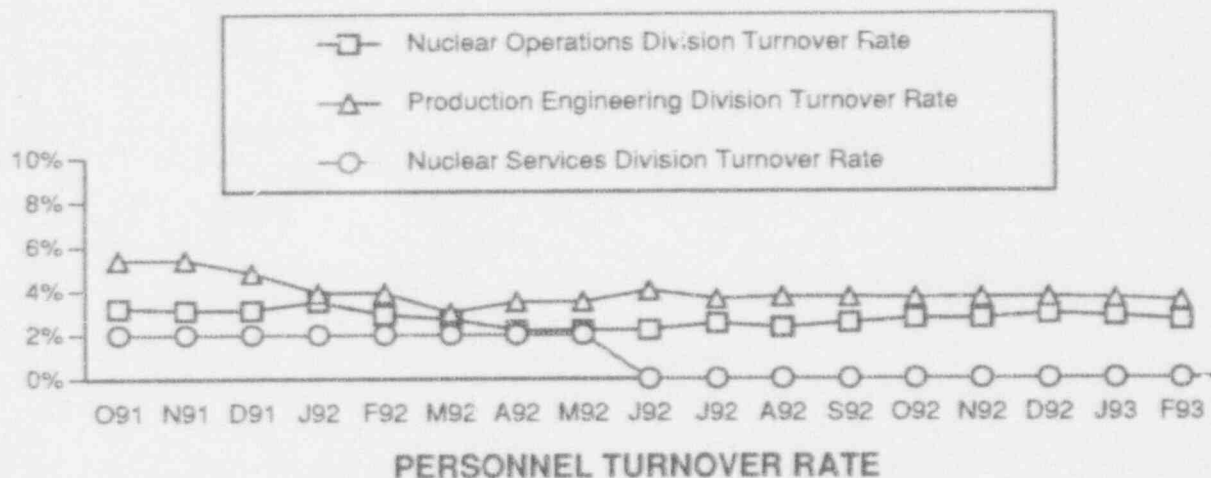

The turnover rates for the three Divisions are calculated using only resignations from OPPD.


<u>Division</u>	<u>Turnover Rate</u>
NOD	2.6%
PED	3.5%
NSD	0.0%

Currently, the OPPD corporate turnover rate is being reported as approximately 2.5%. This OPPD corporate turnover rate is based on the turnover rate over the last four years.

Data Source: Sorenson/Burke (Manager/Source)

Accountability: Waszak

Adverse Trend: None

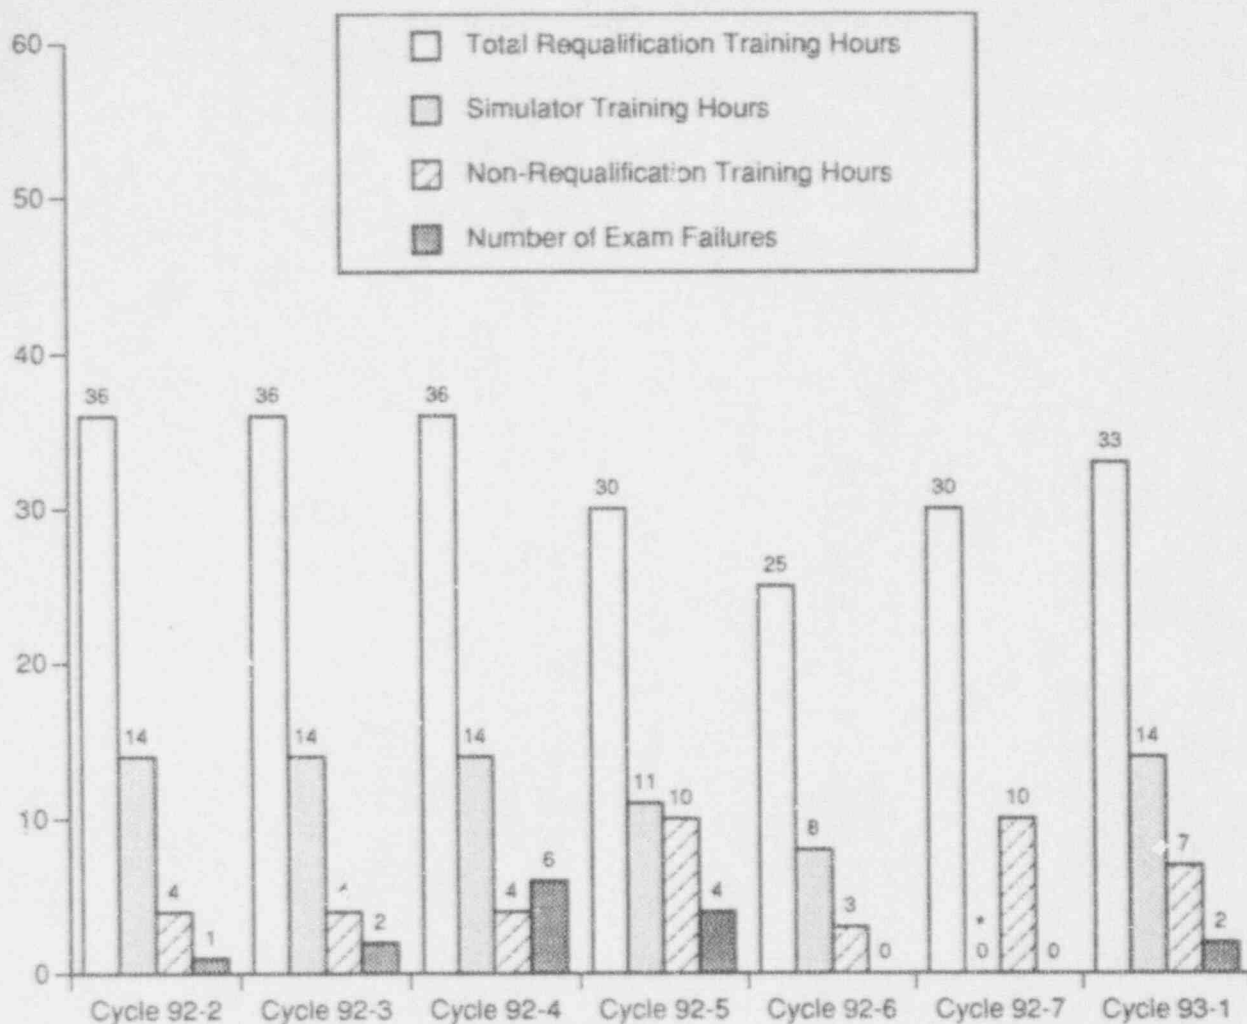

*Note: The Simulator was out-of-service for maintenance and modifications during Rotation 92-7.


LICENSED OPERATOR REQUALIFICATION TRAINING

This indicator provides information on the total number of hours of training given to each crew during each cycle. The Simulator training hours shown on the graph are a subset of the total training hours. Non-Requalification Training Hours are used for AOP/EOP verification & validation, INPO commitments, GET, Fire Brigade, Safety Meetings, and Division Manager lunches.

Exam failures are defined as failures in the written, simulator, and Job Performance Measures (JPMs) segments of the Licensed Operator Requalification Training.

Two individuals failed the evaluated simulator session during Cycle 93-1, causing one staff crew to also fail. The individuals and the crew were remediated and passed another scenario before the end of the week.

Data Source: Gasper/Guliani (Manager/Source)
 Accountability: Gasper/Guliani
 Adverse Trend: None

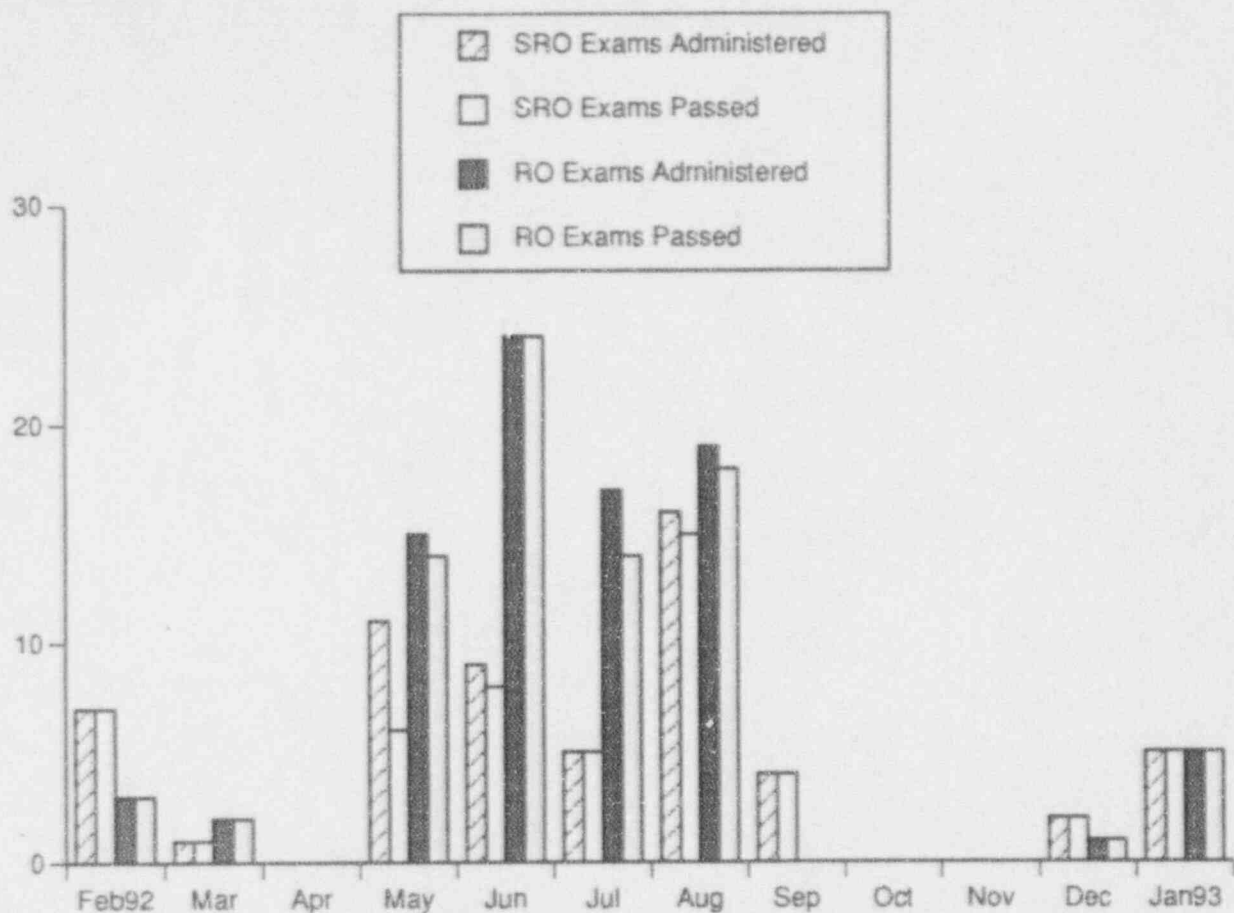

LICENSE CANDIDATE EXAMS

This indicator shows the number of Senior Reactor Operator (SRO) and Reactor Operator (RO) quizzes and exams taken and passed each month. These internally administered quizzes and exams are used to plot the SRO and RO candidates' monthly progress.

There were 5 Senior Reactor Operator and 5 Reactor Operator exams given during the month of January 1993. All individuals passed those exams.


There were no NRC administered SRO or RO exams during January 1993.

Data Source: Gasper/Guliani (Manager/Source)

Accountability: Gasper/Guliani

Adverse Trend: None

SEP 68

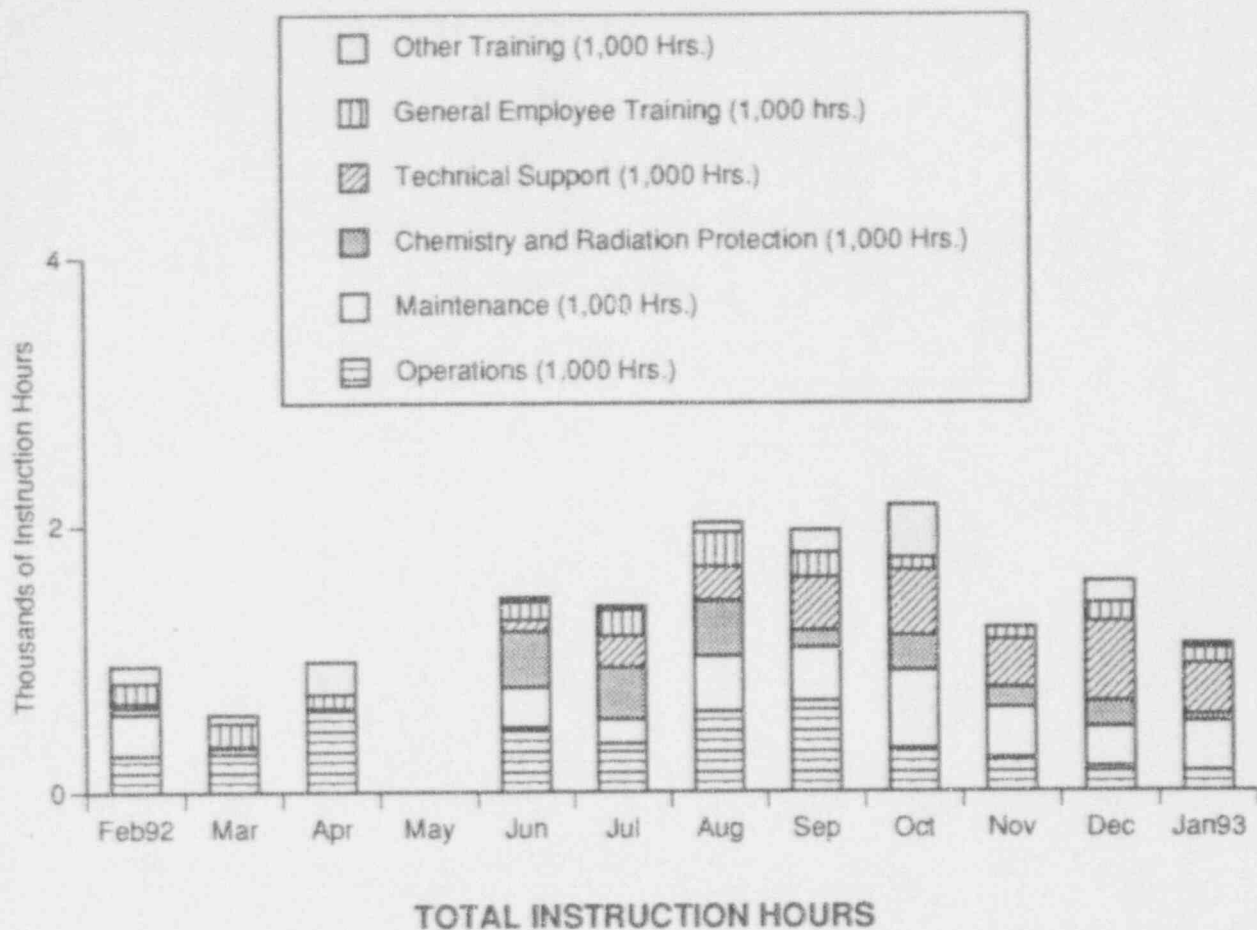


This indicator shows the total number of instruction hours for Operations, Maintenance, Chemistry and Radiation Protection, Technical Support, General Employee Training, and Other Training conducted for the Fort Calhoun Station.

Due to the transition of responsibilities for training performance indicators, data for the month of May was unavailable for this indicator.

This indicator is normally one month behind the reporting month due to the time required for data collection and processing.

DEPARTMENT	January '93
Operations	154
Maintenance	369
Chemistry and Radiation Protection	51
Technical Support	377
General Employee Training	118
Other	35
Total	1,104

Data Source: Gasper/Podoll (Manager/Source)
 Accountability: Gasper
 Adverse Trend: None

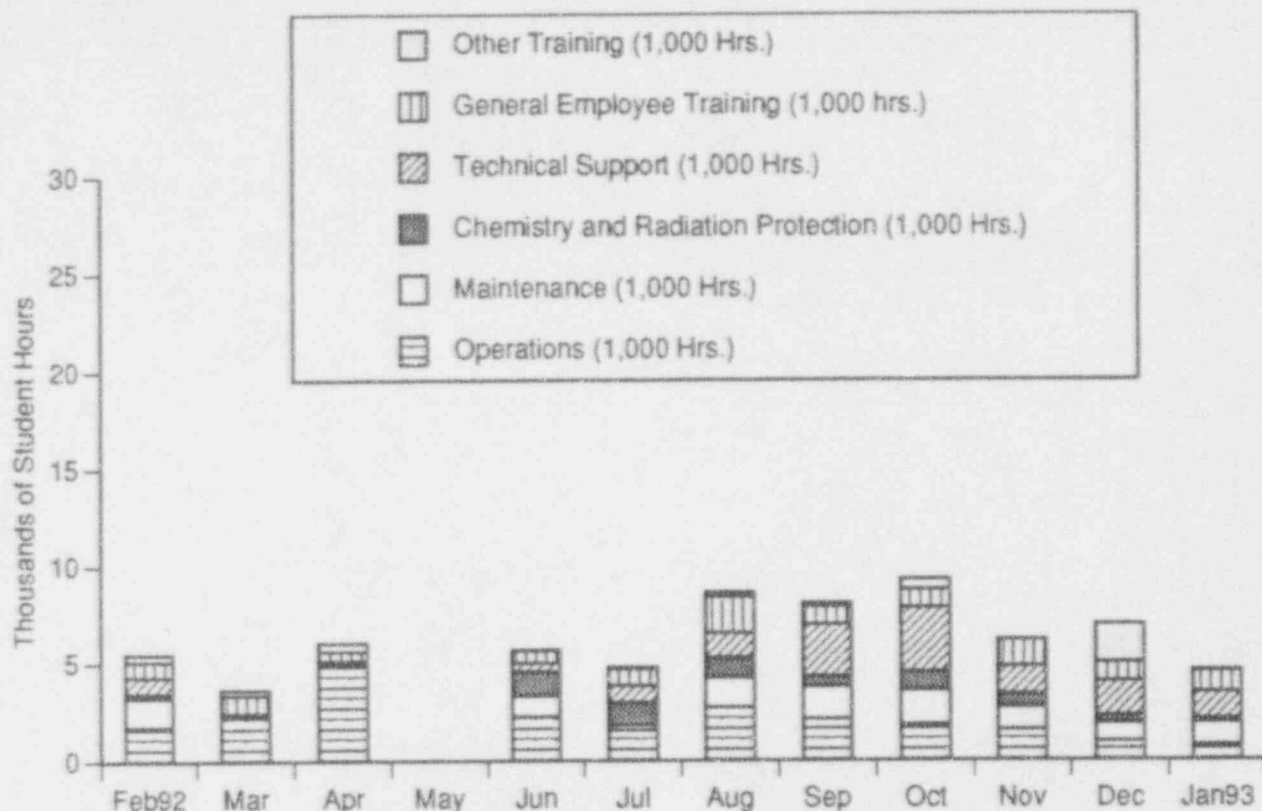

TOTAL HOURS OF STUDENT TRAINING

This indicator shows the total number of student hours for Operations, Maintenance, Chemistry and Radiation Protection, Technical Support, General Employee Training, and Other Training conducted for the Fort Calhoun Station.

Due to the transition of responsibilities for training performance indicators, data for the month of May was unavailable for this indicator.


This indicator is normally one month behind the reporting month due to the time needed to collect and evaluate the data.

DEPARTMENT	January '93
Operations	764
Maintenance	1,152
Chemistry and Radiation Protection	204
Technical Support	1,360
General Employee Training	1,089
Other	35
Total	4,604

Data Source: Gasper/Podoll (Manager/Source)

Accountability: Gasper

Adverse Trend: None

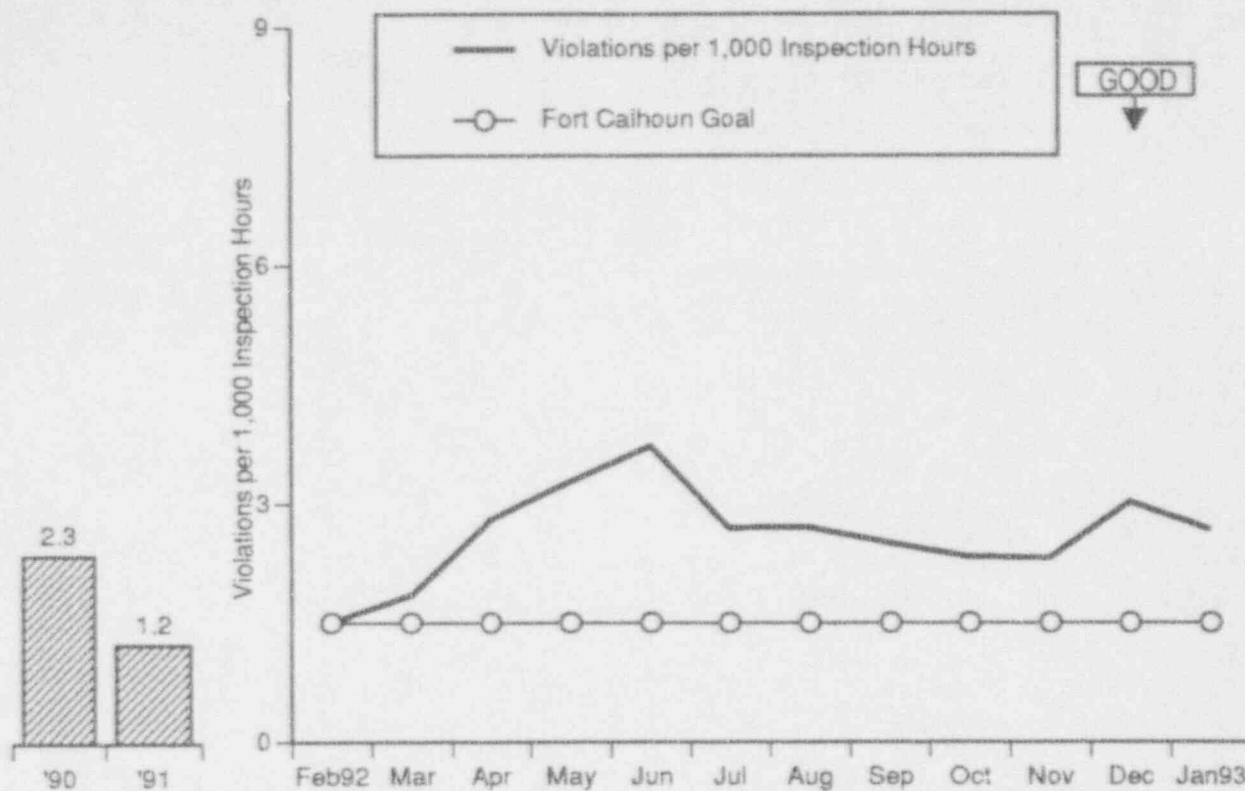

VIOLATIONS PER 1,000 INSPECTION HOURS

This indicator displays the number of NRC violations cited in inspection reports per 1,000 NRC inspection hours. This indicator is one month behind the reporting month due to the time involved with collecting and processing the data.

The violations per 1,000 inspection hours indicator was reported as 2.68 for the twelve months from February 1, 1992 through January 31, 1993.


The following NRC inspections ended during this reporting period:

<u>IER No.</u>	<u>Title</u>	<u>No. of Hrs.</u>
92-33	Residents' Monthly Inspection	624
93-01	Evaluation of Licensee Self-Assessment	40
93-02	Residents' Monthly Inspection	304

There was 1 violation issued during this reporting period in IER 92-33.

The 1993 and 1992 Fort Calhoun goals for this indicator are a maximum of 1.5 violations per 1,000 inspection hours.

Data Source: Short/Lippy (Manager/Source)
 Accountability: Short
 Adverse Trend: None

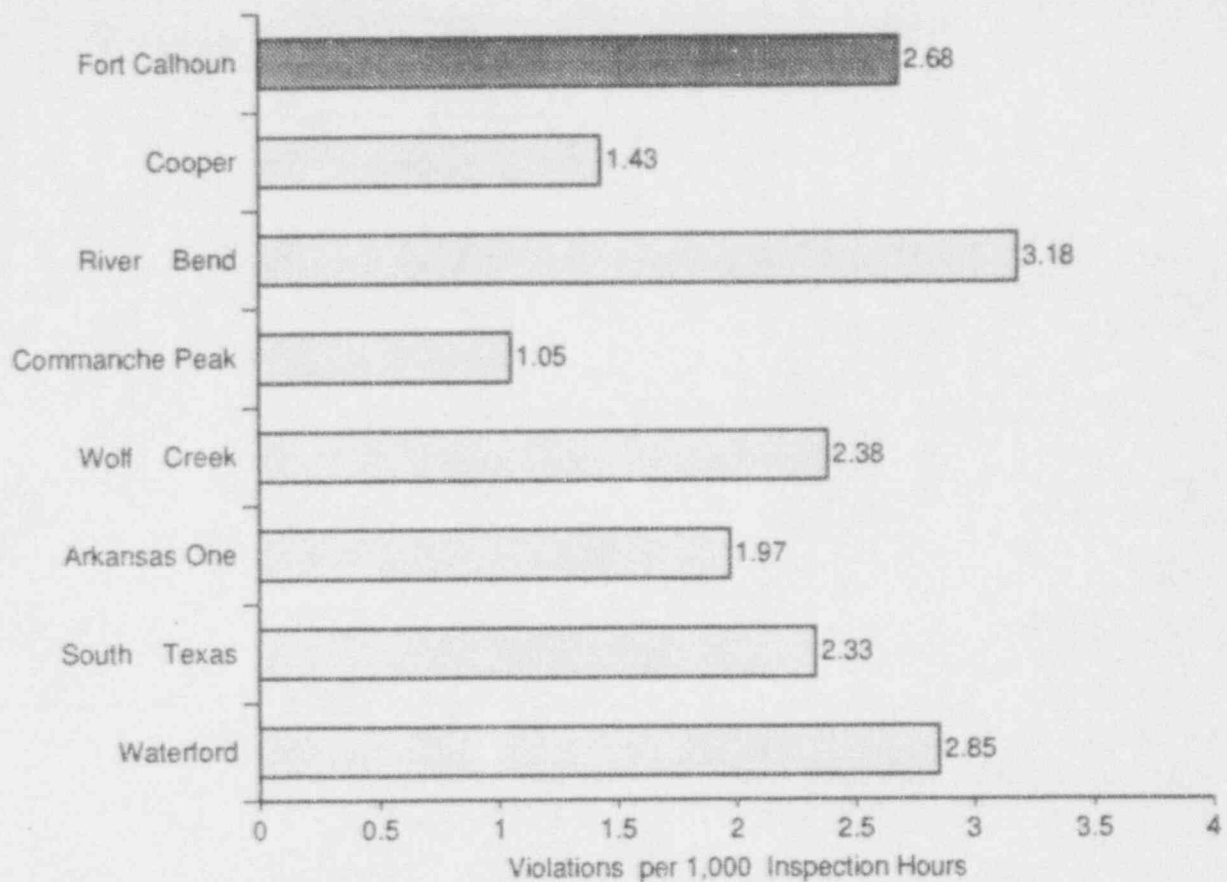

COMPARISON OF VIOLATIONS AMONG REGION IV PLANTS

This indicator provides a comparison of violations per 1,000 inspection hours among Region IV nuclear power plants. The data is compiled for a twelve month period from February 1, 1992 through January 31, 1993.


The Fort Calhoun goals for 1993 and 1992 are a maximum of 1.5 violations per 1,000 inspection hours.

This indicator is one month behind the reporting month due to the time involved with collecting and processing the data.

Data Source: Short/Lippy (Manager/Source)

Accountability: Short

Adverse Trend: None

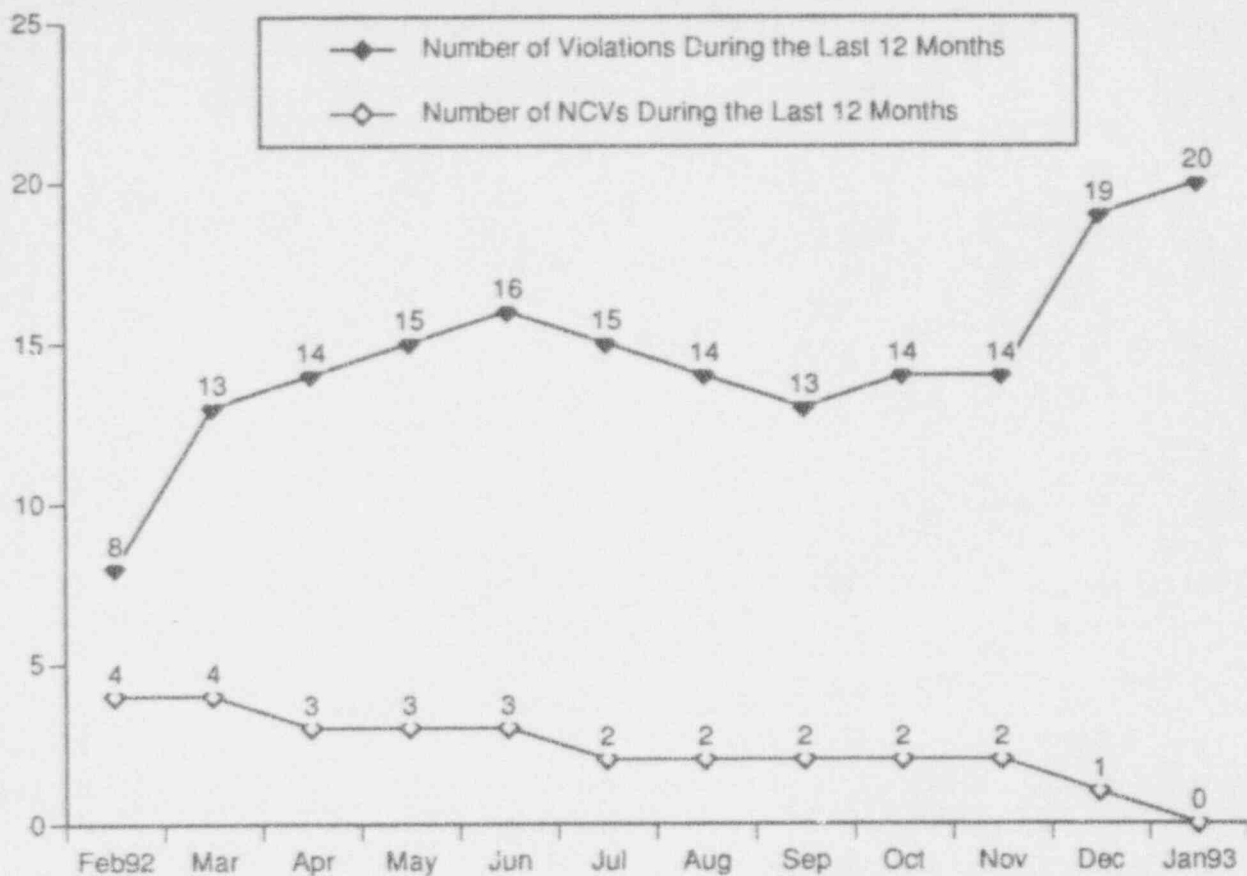

CUMULATIVE VIOLATIONS AND NCVs (TWELVE-MONTH RUNNING TOTAL)

The Cumulative Violations and Non-Cited Violations (NCVs) indicator shows the cumulative number of violations and the cumulative number of NCVs for the last twelve months.


There was 1 violation issued during this reporting period in IER 92-33 (Residents' Monthly Inspection) for failure to comply with the tagging requirements of S. O. O - 20.

This indicator is one month behind the reporting month due to the time involved with collecting and processing data.

Data Source: Short/Lippy (Manager/Source)

Accountability: Short

Adverse Trend: None

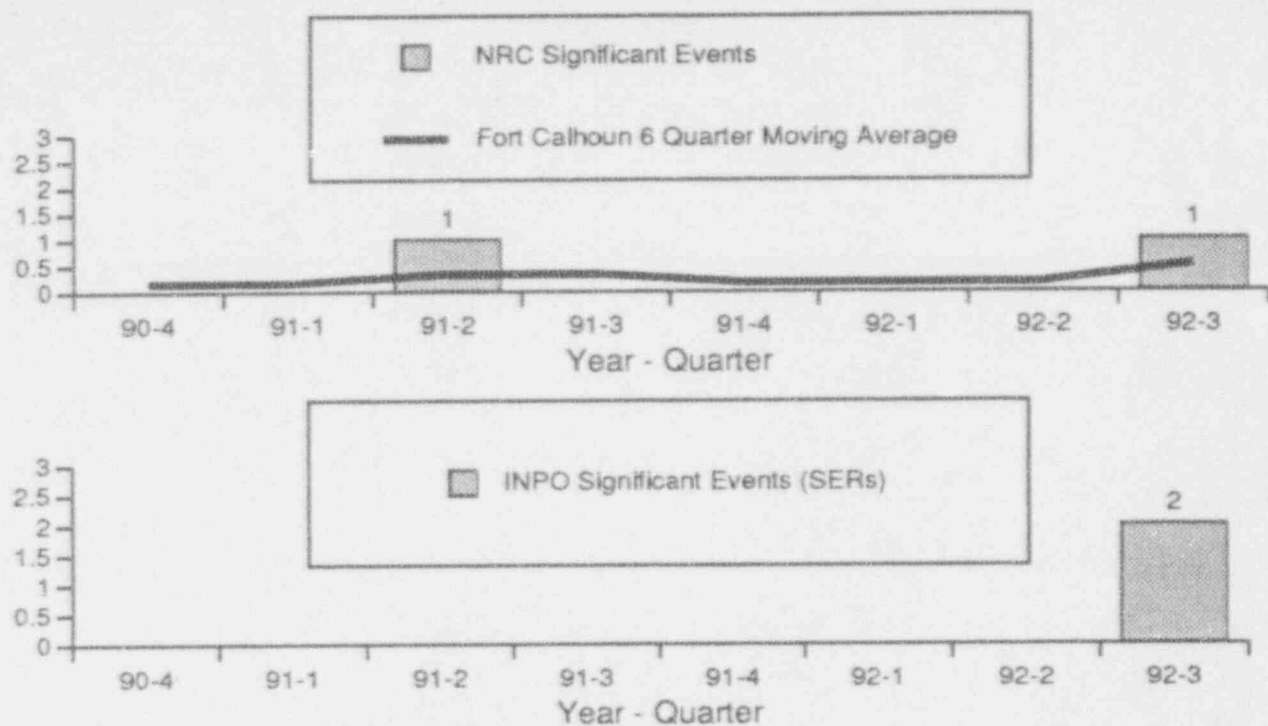

SIGNIFICANT EVENTS

This indicator illustrates the number of NRC and INPO Significant Events for Fort Calhoun Station as reported by the Nuclear Regulatory Commission's Office for Analysis and Evaluation of Operational Data in the quarterly "Performance Indicators for Operating Commercial Nuclear Power Reactors" report and INPO's Nuclear Network.

The following NRC significant events occurred between the fourth quarter of 1990 and the third quarter of 1992:


Second Quarter 1991: Safety related equipment was not adequately protected from a high energy line break.

Third Quarter 1992: The failure of a Pressurizer Code safety valve to reseal initiated a LOCA with the potential to degrade the reactor coolant pressure boundary.

The following INPO significant events, as reported in Significant Event Reports (SERs), occurred between the fourth quarter of 1990 and the third quarter of 1992:

Third Quarter 1992: 1) Personnel and accessible building areas were contaminated with transuranic, alpha-emitting radionuclides. 2) The failure of a nonessential inverter during troubleshooting caused a turbine load rejection. This resulted in a high reactor coolant pressure automatic scram and the opening of the pressure relief valves and one of two pressurizer safety valves. One pressurizer safety valve subsequently reopened at a lower reactor coolant system pressure and remained partially open, resulting in a release of reactor coolant to containment via the pressurizer quench tank.

Data Source: Nuclear Regulatory Commission & INPO
 Accountability: Chase
 Adverse Trend: None

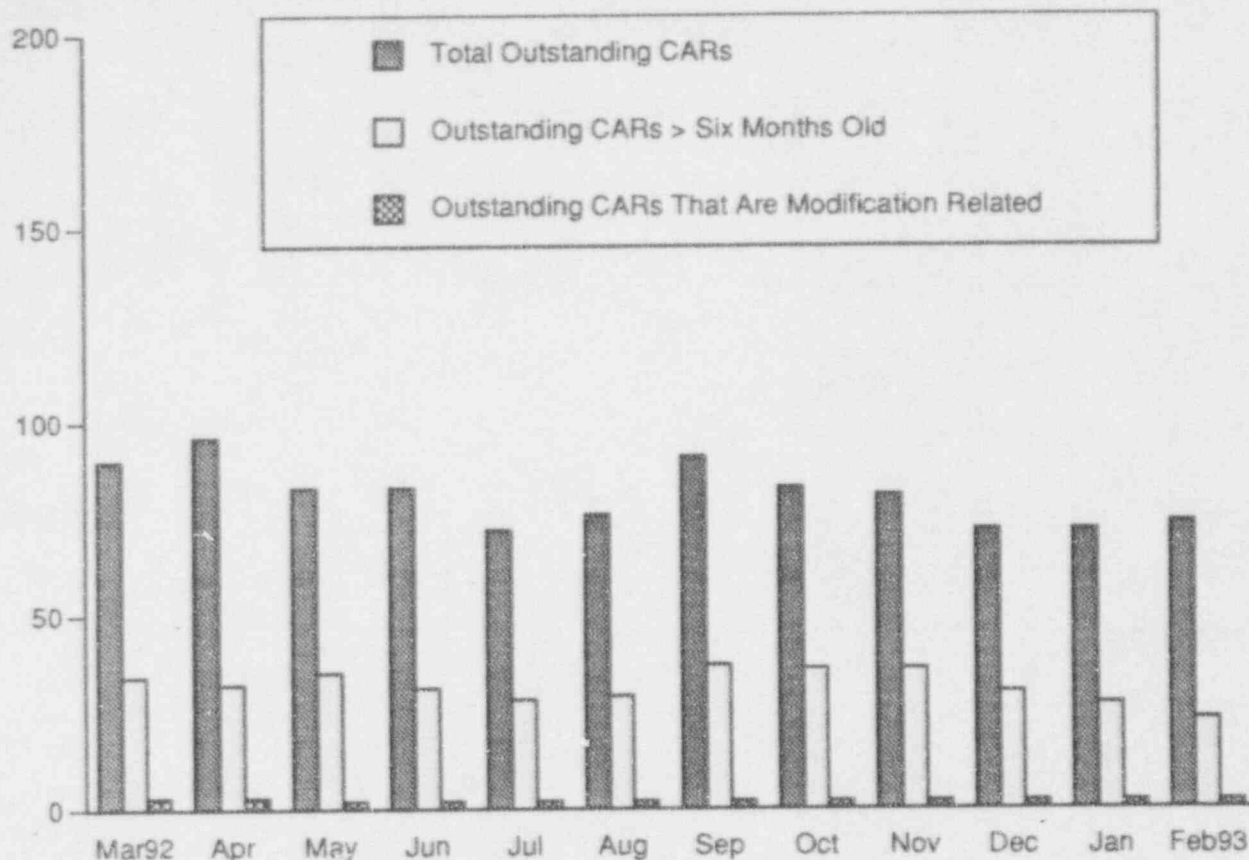

OUTSTANDING CORRECTIVE ACTION REPORTS

This indicator shows the total number of outstanding Corrective Action Reports (CARs), the number of outstanding CARs that are greater than six months old, and the number of outstanding CARs that are modification related.


At the end of February 1993 there were 74 outstanding CARs, 23 CARs that were greater than 6 months old, and 2 CARs that were modification related.

The 1993 monthly goal for this indicator is a maximum of 30 CARs greater than 6 months old.

Data Source: Orr/Gurtis (Manager/Source)

Accountability: Andrews/Gambhir/Gates

Adverse Trend: None

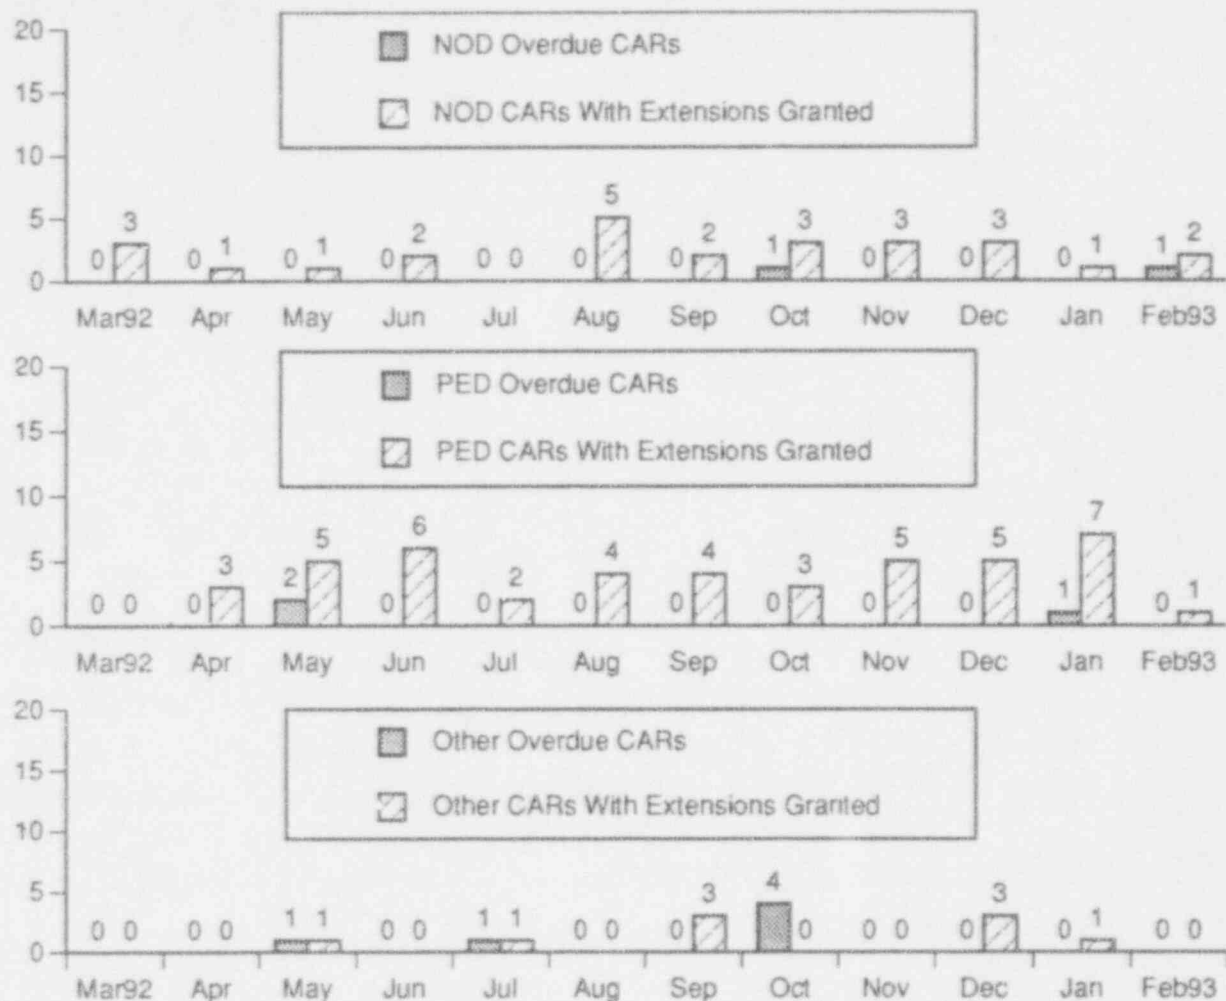

OVERDUE AND EXTENDED CORRECTIVE ACTION REPORTS

This indicator shows the number of overdue CARs and the number of CARs which received extensions broken down by organization.

Overdue CARs

Overdue CARs	December '92	January '93	February '93
NOD	0	0	1
PED	0	1	0
Others	0	0	0
Total	0	1	1

Extended CARs

Extended CARs	December '92	January '93	February '93
NOD	3	1	2
PED	5	7	1
Others	3	1	0
Total	11	9	3

Data Source: Orr/Gurtis (Manager/Source)

Accountability: Andrews/Gambhir/Gates

Adverse Trend: None

1992 SALP Funct. Area	CARs	Signif. CARs	NRC Viola.	LERs
A) Plant Operations	18	0	0	7
B) Radiolog. Controls	11	0	13	1
C) Maint/Surveil.	123	1	4	13
D) Emergency Preparedness	8	1	1	0
E) Security	14	0	1	0
F) Engr/Tech Support	63	0	0	12
G) Safety Assess/ Qual. Verif.	35	1	1	0
H) Other	0	0	0	0
Total	272	3	20	33

1993 SALP Funct. Area	CARs	Signif. CARs	NRC Viola.	LERs
A) Plant Operations	1 (1)	0	1 (1)	3 (1)
B) Radiolog. Controls	0	0	0	0
C) Maint/Surveil.	17 (9)	0	0	1 (1)
D) Emergency Preparedness	1 (1)	0	0	0
E) Security	1	0	0	0
F) Engr/Tech Support	19 (6)	0	0	1 (1)
G) Safety Assess/ Qual. Verif.	10 (7)	0	0	0
H) Other	0	0	0	0
Total	49 (24)	0	1 (1)	5 (3)

Note: () Indicates values for the reporting month.

CARs ISSUED vs. SIGNIFICANT CARs vs NRC VIOLATIONS ISSUED vs. LERs REPORTED


The above matrix shows the number of Corrective Action Reports (CARs) issued by the Nuclear Services Division (NSD) vs. the number of Significant CARs issued by NSD vs. the number of violations issued by the NRC for the Fort Calhoun Station in 1992 and 1993. Included in this table is the number of Licensee Event Reports (LERs) identified by the Station each year. The number of NRC violations reported is one month behind the reporting month due to the time involved in collecting and processing the violations.

Data Source: Orr/Gurtis (Manager/Source)
Short/Lippy (Manager/Source)

Accountability: Andrews/Gambhir/Gates

Adverse Trend: None

SEP 15, 20, 21

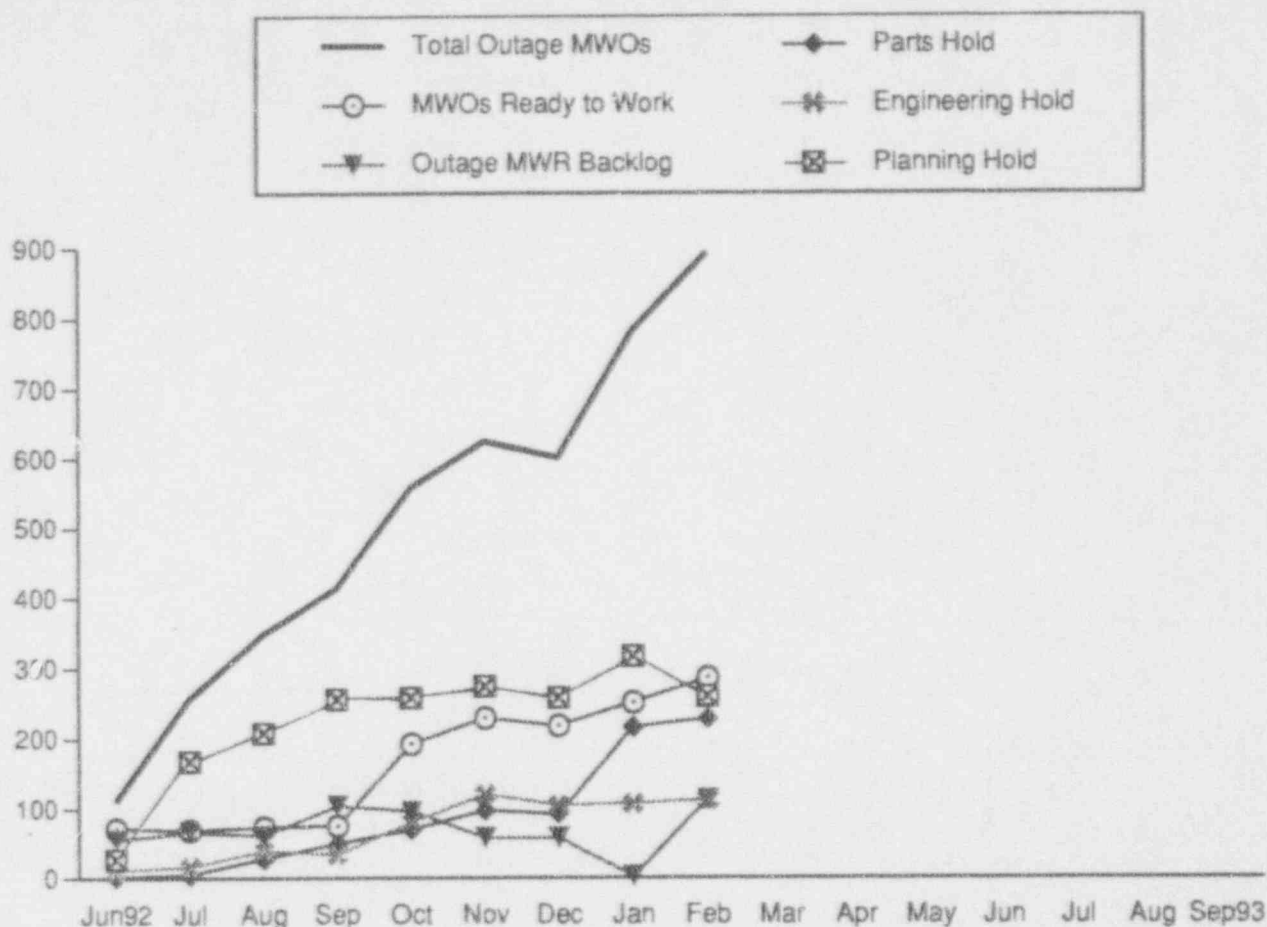

MWO PLANNING STATUS (CYCLE 15 REFUELING OUTAGE)

This indicator shows the total number of Maintenance Work Orders (MWOs) that have been approved for inclusion in the Cycle 15 Refueling Outage and the number of MWOs that are ready to work (parts staged, planning complete, and all other paperwork ready for field use). Also included is the number of MWOs that have engineering holds (ECNs, procedures and other miscellaneous engineering holds), parts hold, (parts staged, not yet inspected, parts not yet arrived) and planning hold (job scope not yet completed). Maintenance Work Requests (MWRs) will also be shown that have been identified for the Cycle 15 Refueling Outage and have not yet been converted to MWOs.

Approximately 2,176 Maintenance Work Orders were completed during the Cycle 14 Refueling Outage.


Data Source: Chase/Johansen (Manager/Source)

Accountability: Chase/Johansen

Adverse Trend: None

SEP 31

1993 OUTAGE PROJECTS STATUS REPORT

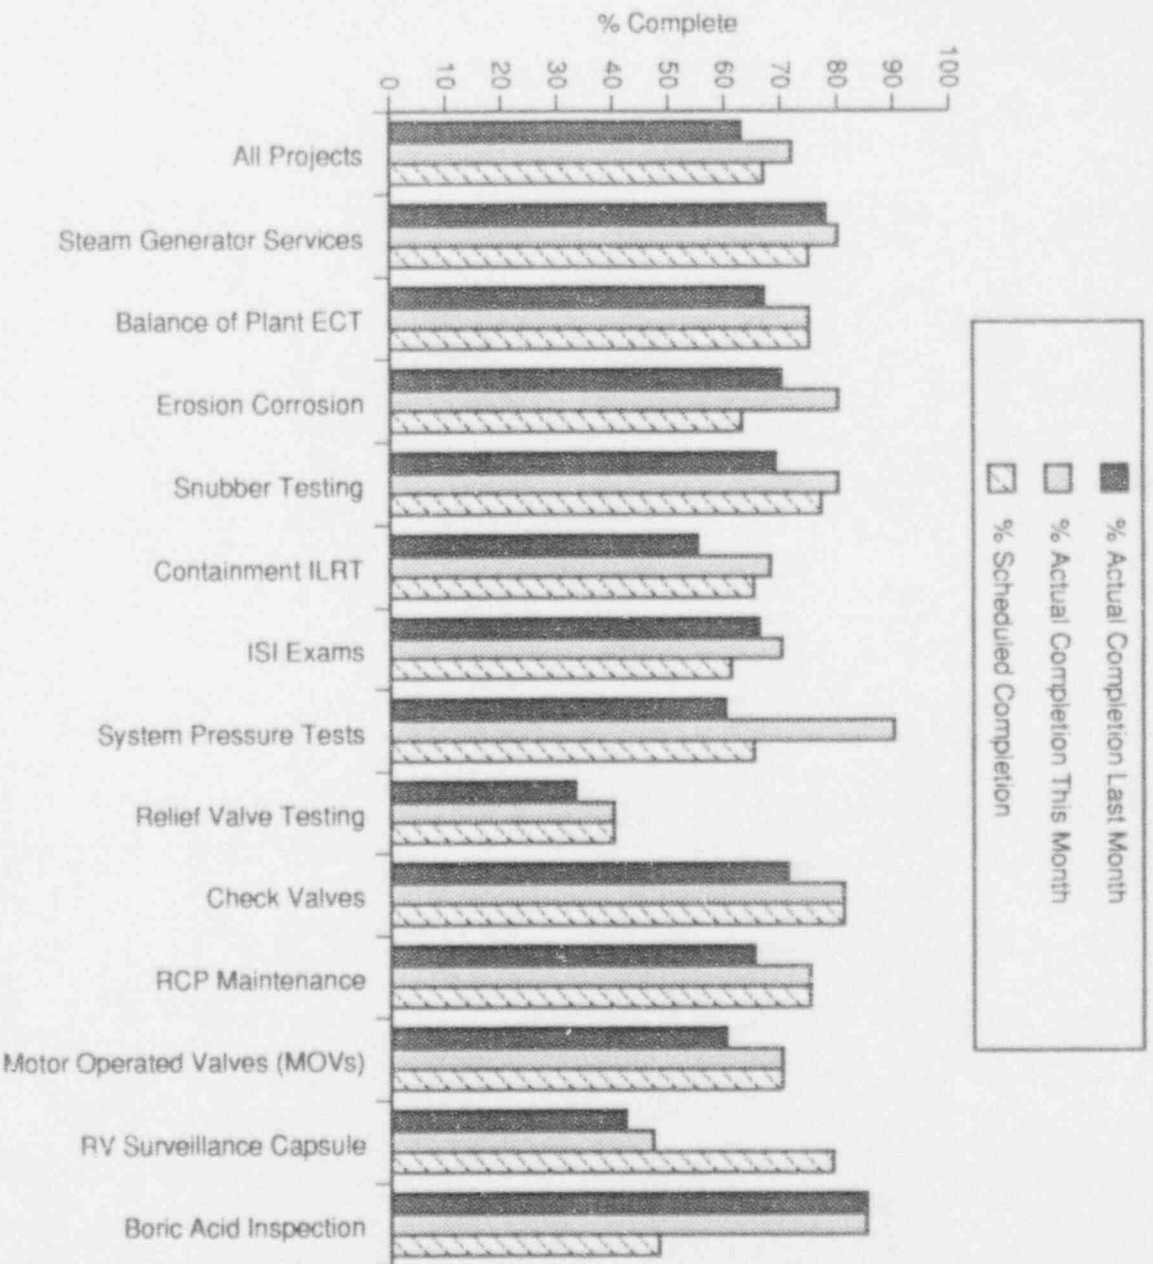

OVERALL PROJECT STATUS (CYCLE 15 REFUELING OUTAGE)

This indicator shows the status of the projects which are in the scope of the Cycle 15 Refueling Outage. There are currently 13 approved outage projects.

Additional data points will be added to this indicator as information becomes available.


The goal for this indicator is to have all projects 100% complete (ready to work) by July 16, 1993. The "% Scheduled Completion" category in the graph represents the percentage of the project that should be complete as of the end of January 1993.

Data Source: Jaworski/Swearngin (Manager/Source)

Accountability: Jaworski/Boughter

Adverse Trend: None

SEP 31

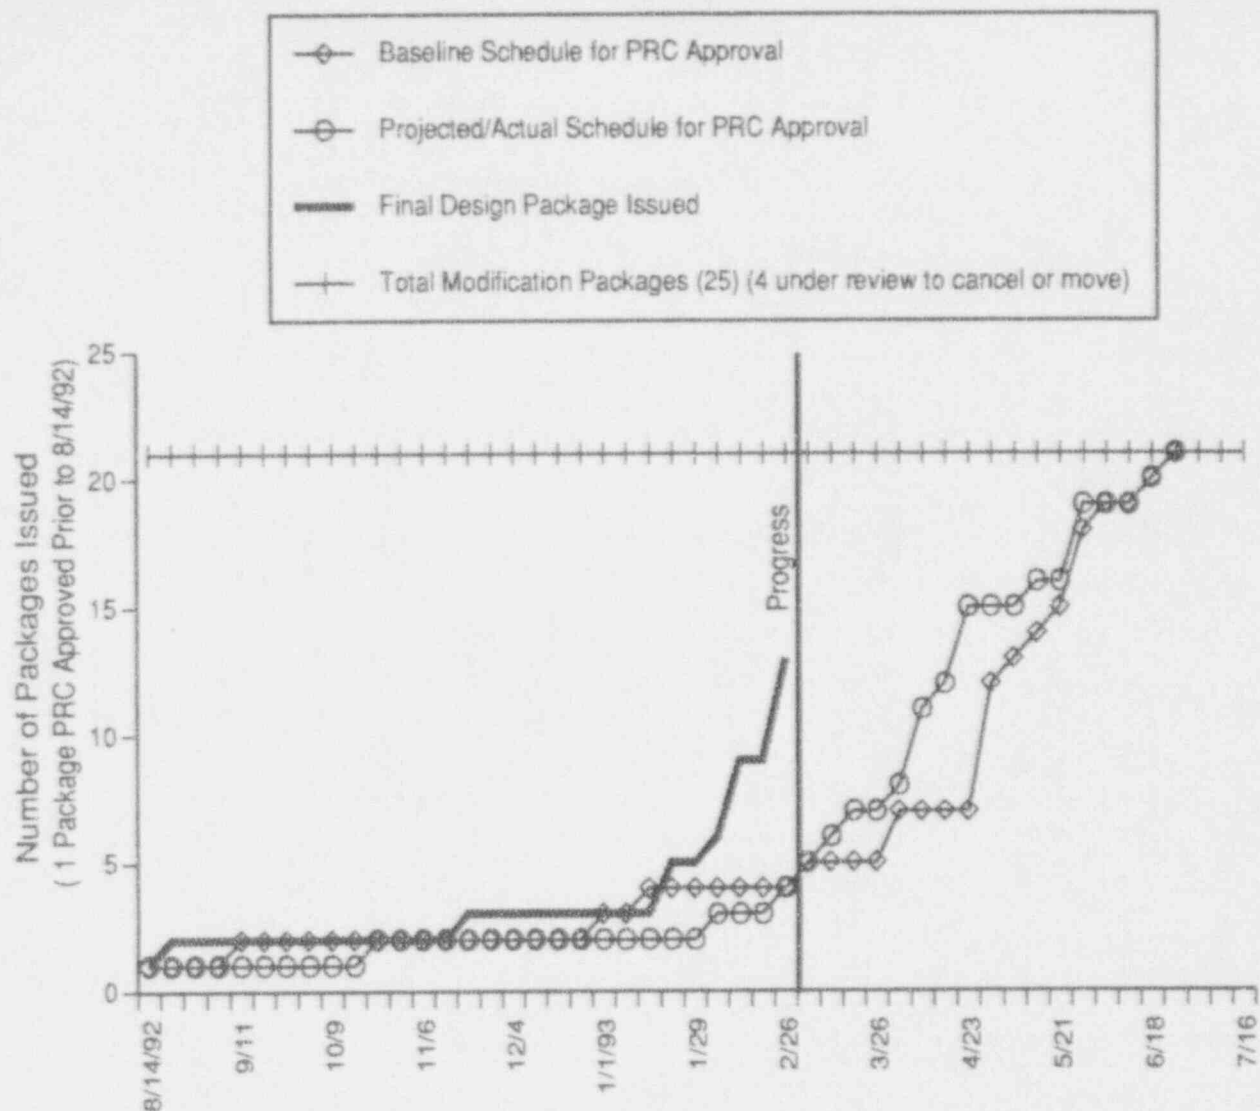

PROGRESS OF CYCLE 15 OUTAGE MODIFICATION PLANNING (FROZEN SCOPE OF 25 MODIFICATIONS)

This indicator shows the status of modifications approved for installation during the Cycle 15 Refueling Outage. The data is represented with respect to the baseline schedule (established 6/19/92) and the current schedule. This information is taken from the Modification Variance Report produced by the Design Engineering Nuclear group.

The goal for this indicator is to have all modification packages PRC approved by June 30, 1993.

Additional data points will be added to this indicator as information becomes available.

Data Source: Phelps/Ronne (Manager/Source)
 Accountability: Gambhir/Phelps
 Adverse Trend: None

SEP 31

PERFORMANCE INDICATOR DEFINITIONS

AGE OF OUTSTANDING MAINTENANCE WORK ORDERS

This indicator tracks the total number of outstanding corrective non-outage Maintenance Work Orders at the Fort Calhoun Station versus their age in months.

AMOUNT OF WORK ON HOLD AWAITING PARTS

This indicator is defined as the percentage of open, non-outage, maintenance work orders that are on hold awaiting parts, to the total number of open, non-outage, maintenance work orders.

AUXILIARY FEEDWATER SYSTEM SAFETY SYSTEM PERFORMANCE

The sum of the known (planned and unplanned) unavailable hours and the estimated unavailable hours for the auxiliary feedwater system for the reporting period divided by the critical hours for the reporting period multiplied by the number of trains in the auxiliary feedwater system.

AUXILIARY SYSTEMS CHEMISTRY PERCENT OF HOURS OUTSIDE STATION LIMITS

The cumulative hours that the Component Cooling Water system is outside the station chemistry limit. The hours are accumulated from the first sample exceeding the limit until additional sampling shows the parameter to be back within limits.

CARs ISSUED vs. SIGNIFICANT CARs vs. NRC VIOLATIONS vs. LERs REPORTED

Provides a comparison of CARs issued, NRC violations, and LERs reported. This indicator tracks performance for SEP #15, 20, & 21.

CHECK VALVE FAILURE RATE

Compares the Fort Calhoun check valve failure rate to the industry check valve failure rate (failures per 1 million component hours). The data for the industry failure rate is three months behind the PI Report reporting month. This indicator tracks performance for SEP #43.

COLLECTIVE RADIATION EXPOSURE

Collective radiation exposure is the total external whole-body dose received by all on-site personnel (including contractors and visitors) during a time period, as measured by the thermoluminescent dosimeter (TLD). Collective radiation exposure is reported in units of person-rem. This indicator tracks radiological work performance for SEP #54.

COMPARISON OF VIOLATIONS AMONG REGION IV PLANTS

Provides data on violations per 1,000 inspection hours for Region IV nuclear power plants.

COMPONENT FAILURE ANALYSIS REPORT (CFAR) SUMMARY

The number of INPO categories for Fort Calhoun Station with significantly higher (1.645 standard deviations) failure rates than the rest of the industry for an eighteen month time period. Failures are reported as component (i.e. pumps, motors, valves, etc.) and application (i.e. charging pumps, main steam stop valves, control element drive motors, etc.) categories.

Failure Cause Categories are:

Wear Out/Aging - a failure thought to be the consequence of expected wear or aging.

Manufacturing Defect - a failure attributable to inadequate assembly or initial quality of the responsible component or system.

Engineering/Design - a failure attributable to the inadequate design of the responsible component or system.

Other Devices - a failure attributable to a failure or misoperation of another component or system, including associated devices.

Maintenance/Testing - a failure that is a result of improper maintenance or testing, lack of maintenance, or personnel errors that occur during maintenance or testing activities performed on the responsible component or system, including failure to follow procedures.

Errors - failures attributable to incorrect procedures that were followed as written, improper installation of equipment, and personnel errors (including failure to follow procedures properly). Also included in this category are failures for which the cause is unknown or cannot be assigned to any of the preceding categories.

CONTAMINATIONS >5,000 DPM/100 CM²

Reportable skin and clothing contaminations above background levels greater than 5000 dpm/100 cm². This indicator trends personnel performance for SEP #15 & 54.

CORRECTIVE MAINTENANCE BACKLOG GREATER THAN 3 MONTHS OLD

The percentage of total outstanding corrective maintenance items, not requiring an outage, that are greater than three months old at the end of the period reported.

CUMULATIVE VIOLATIONS & NON-CITED VIOLATIONS (12 MONTH RUNNING TOTAL)

The cumulative number of violations and Non-Cited Violations for the last 12 months.

DAILY THERMAL OUTPUT

This indicator shows the daily core thermal output as measured from computer point XC105 (in thermal megawatts). The 1500 MW Tech Spec limit, and the unmet portion of the 1495 MW FCS daily goal for the reporting month are also shown.

DIESEL GENERATOR RELIABILITY (25 DEMANDS)

This indicator shows the number of failures occurring for each emergency diesel generator during the last 25 start demands and the last 25 load-run demands.

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

DIESEL GENERATOR UNAVAILABILITY

This indicator provides monthly data on the number of hours of diesel generator planned and unplanned unavailability.

DECONTAMINATED RADIATION CONTROLLED AREA

The percentage of the Radiation Controlled Area, which includes the auxiliary building, the radwaste building, and areas of the C/RP building, that is decontaminated based on the total square footage. This indicator tracks performance for SEP # 54.

DISABLING INJURY/ILLNESS FREQUENCY RATE (LOST TIME ACCIDENT RATE)

This indicator is defined as the number of accidents for all utility personnel permanently assigned to the station, involving days away from work per 200,000 man-hours worked (100 man-years). This does not include contractor personnel. This indicator tracks personnel performance for SEP #25 & 26.

DOCUMENT REVIEW (BIENNIAL)

The Document Review Indicator shows the number of documents reviewed, the number of documents scheduled for review, and the number of document reviews that are overdue for the reporting month. A document review is considered overdue if the review is not complete within 6 months of the assigned due date. This indicator tracks performance for SEP #46.

EMERGENCY AC POWER SYSTEM SAFETY SYSTEM PERFORMANCE

The sum of the known (planned and unplanned) unavailable and the estimated unavailable hours for the emergency AC power system for the reporting period divided by the number of hours in the reporting period multiplied by the number of trains in the emergency AC power system.

EMERGENCY DIESEL GENERATOR UNIT RELIABILITY

This indicator shows the number of failures that were reported during the last 20, 50, and 100 emergency diesel generator demands at the Fort Calhoun Station. Also shown are trigger values which correlate to a high level of confidence that a unit's diesel generators have obtained a reliability of greater than or equal to 95% when the demand failures are less than the trigger values.

1) Number of Start Demands: All valid and inadvertent start demands, including all start-only demands and all start demands that are followed by load-run demands, whether by automatic or manual initiation. A start-only demand is a demand in which the emergency generator is started, but no attempt is made to load the generator.

2) Number of Start Failures: Any failure within the emergency generator system that prevents the generator from achieving specified frequency and voltage is classified as a valid start failure. This includes any condition identified in the course of maintenance inspections (with the emergency generator in standby mode) that definitely would

have resulted in a start failure if a demand had occurred.

3) Number of Load-Run Demands: For a valid load-run demand to be counted the load-run attempt must meet one or more of the following criteria:

A) A load-run of any duration that results from a real automatic or manual initiation.

B) A load-run test to satisfy the plant's load and duration as stated in each test's specifications.

C) Other special tests in which the emergency generator is expected to be operated for at least one hour while loaded with at least 50% of its design load.

4) Number of Load-Run Failures: A load-run failure should be counted for any reason in which the emergency generator does not pick up load and run as predicted. Failures are counted during any valid load-run demands.

5) Exceptions: Unsuccessful attempts to start or load-run should not be counted as valid demands or failures when they can be attributed to any of the following:

A) Spurious trips that would be bypassed in the event of an emergency.

B) Malfunction of equipment that is not required during an emergency.

C) Intentional termination of a test because of abnormal conditions that would not have resulted in major diesel generator damage or repair.

D) Malfunctions or operating errors which would have not prevented the emergency generator from being restarted and brought to load within a few minutes.

E) A failure to start because a portion of the starting system was disabled for test purpose, if followed by a successful start with the starting system in its normal alignment.

Each emergency generator failure that results in the generator being declared inoperable should be counted as one demand and one failure. Exploratory tests during corrective maintenance and the successful test that follows repair to verify operability should not be counted as demands or failures when the EDG has not been declared operable again.

EMERGENCY DIESEL GENERATOR UNRELIABILITY

This indicator measures the total unreliability of emergency diesel generators. In general, unreliability is the ratio of unsuccessful operations (starts or load-runs) to the number of valid demands. Total unreliability is a combination of start unreliability and load-run unreliability.

ENGINEERING ASSISTANCE REQUEST (EAR) BREAKDOWN

This indicator shows a breakdown, by age and priority of the EAR, of the number of EARs assigned to Design Engineering Nuclear and System Engineering. This indicator tracks performance for SEP #62.

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

ENGINEERING CHANGE NOTICE (ECN) BREAK-DOWN

This indicator breaks down the number of Engineering Change Notices (ECNs) that are assigned to Design Engineering Nuclear (DEN), System Engineering, and Maintenance. The graphs provide data on ECN Facility Changes open, ECN Substitute Replacement Parts open, and ECN Document Changes open. This indicator tracks performance for SEP #62.

ENGINEERING CHANGE NOTICE (ECN) STATUS

The number of ECNs that were opened, ECNs that were completed, and open backlog ECNs awaiting completion by DEN for the reporting month. This indicator tracks performance for SEP #62.

EQUIPMENT FORCED OUTAGES PER 1,000 CRITICAL HOURS

Equipment forced outages per 1000 critical hours is the inverse of the mean time between forced outages caused by equipment failures. The mean time is equal to the number of hours the reactor is critical in a period (1000 hours) divided by the number of forced outages caused by equipment failures in that period.

EQUIVALENT AVAILABILITY FACTOR

This indicator is defined as the ratio of gross available generation to gross maximum generation, expressed as a percentage. Available generation is the energy that can be produced if the unit is operated at the maximum power level permitted by equipment and regulatory limitations. Maximum generation is the energy that can be produced by a unit in a given period if operated continuously at maximum capacity.

EXPEDITED PURCHASES

The percentage of expedited purchases occurring during the reporting month compared to the total number of purchase orders generated.

FORCED OUTAGE RATE

This indicator is defined as the percentage of time that the unit was unavailable due to forced events compared to the time planned for electrical generation. Forced events are failures or other unplanned conditions that require removing the unit from service before the end of the next weekend. Forced events include start-up failures and events initiated while the unit is in reserve shut-down (i.e., the unit is available but not in service).

FUEL RELIABILITY INDICATOR

This indicator is defined as the steady-state primary coolant I-131 activity, corrected for the tramp uranium contribution and normalized to a common purification rate. Tramp uranium is fuel which has been deposited on reactor core internals from previous defective fuel or is present on the surface of fuel elements from the manufacturing process. Steady state is defined as continuous operation for at least three days at a power level that does not vary more than + or - 5%. Plants should collect data for this indicator at a power level above 85%, when possible. Plants that did not operate at steady-state

power above 85% should collect data for this indicator at the highest steady-state power level attained during the month.

The density correction factor is the ratio of the specific volume of coolant at the RCS operating temperature (540 degrees F., $V_f = 0.02146$) divided by the specific volume of coolant at normal letdown temperature (120 degrees F at outlet of the letdown cooling heat exchanger, $V_f = 0.016204$), which results in a density correction factor for FCS equal to 1.32.

GASEOUS RADIOACTIVE WASTE BEING DISCHARGED TO THE ENVIRONMENT

This indicator displays the total number of Curies of all gaseous radioactive nuclides released from FCS.

GROSS HEAT RATE

Gross heat rate is defined as the ratio of total thermal energy in British Thermal Units (BTU) produced by the reactor to the total gross electrical energy produced by the generator in kilowatt-hours (KWH).

HAZARDOUS WASTE PRODUCED

The total amount (in Kilograms) of non-halogenated hazardous waste, halogenated hazardous waste, and other hazardous waste produced by FCS each month.

HIGH PRESSURE SAFETY INJECTION SYSTEM SAFETY SYSTEM PERFORMANCE

The sum of the known (planned and unplanned) unavailable hours and the estimated unavailable hours for the high pressure safety injection system for the reporting period divided by the critical hours for the reporting period multiplied by the number of trains in the high pressure safety injection system.

IN-LINE CHEMISTRY INSTRUMENTS OUT OF SERVICE

Total number of in-line chemistry instruments that are out-of-service in the Secondary System and the Post Accident Sampling System (PASS).

INVENTORY ACCURACY

The percentage of line items that are counted each month by the warehouse which need count adjustments.

INVOICE BREAKDOWN

The number of invoices that are on hold due to shelf life, COE, and miscellaneous reasons.

LICENSE CANDIDATE EXAMS

This indicator shows the number of SRO and/or RO quizzes and exams that are administered and passed each month. This indicator tracks training performance for SEP #68.

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

LICENSED OPERATOR REQUALIFICATION TRAINING

The total number of hours of training given to each crew during each cycle. Also provided are the simulator training hours (which are a subset of the total training hours), the number of non-requalification training hours and the number of exam failures. This indicator tracks training performance for SEP #68.

LICENSEE EVENT REPORT (LER) ROOT CAUSE BREAKDOWN

This indicator shows the number and root cause code for Licensee Event Reports. The root cause codes are as follows:

- 1) Administrative Control Problem - Management and supervisory deficiencies that affect plant programs or activities (i.e., poor planning, breakdown or lack of adequate management or supervisory control, incorrect procedures, etc.)
- 2) Licensed Operator Error - This cause code captures errors of omission/commission by licensed reactor operators during plant activities.
- 3) Other Personnel Error - Errors of omission/commission committed by non-licensed personnel involved in plant activities.
- 4) Maintenance Problem - The intent of this cause code is to capture the full range of problems which can be attributed in any way to programmatic deficiencies in the maintenance functional organization. Activities included in this category are maintenance, testing, surveillance, calibration and radiation protection.
- 5) Design/Construction/Installation/Fabrication Problem - This cause code covers a full range of programmatic deficiencies in the areas of design, construction, installation, and fabrication (i.e., loss of control power due to underrated fuse, equipment not qualified for the environment, etc.).
- 6) Equipment Failures (Electronic Piece-Parts or Environmental-Related Failures) - This code is used for spurious failures of electronic piece-parts and failures due to meteorological conditions such as lightning, ice, high winds, etc. Generally, it includes spurious or one-time failures. Electric components included in this category are circuit cards, rectifiers, bistables, fuses, capacitors, diodes, resistors, etc.

LIQUID RADIOACTIVE WASTE BEING DISCHARGED TO THE ENVIRONMENT

This indicator displays the total number of curies from all liquid releases from FCS to the Missouri River.

LOGGABLE/REPORTABLE INCIDENTS (SECURITY)

The total number of security incidents for the reporting month depicted in two graphs. This indicator tracks security performance for SEP #58.

MAINTENANCE WORK ORDER BREAKDOWN

This indicator is a breakdown of corrective non-outage maintenance work orders by several categories that remain open at the end of the reporting month. This indicator tracks maintenance performance for SEP #36.

MAINTENANCE OVERTIME

The % of overtime hours compared to normal hours for maintenance. This includes OPPD personnel as well as contract personnel.

MATERIAL REQUEST PLANNING

The percent of material requests (MRs) for issues with their request date the same as their need date compared to the total number of MRs.

MAXIMUM INDIVIDUAL RADIATION EXPOSURE

The total maximum amount of radiation received by an individual person working at FCS on a monthly, quarterly, and annual basis.

MWO PLANNING STATUS (CYCLE 15 REFUELING OUTAGE)

The total number of Maintenance Work Orders that have been approved for inclusion in the Cycle 15 Refueling Outage and the number that are ready to work (parts staged, planning complete, and all other paperwork ready for field use). Also included is the number of MWOs that have engineering holds (ECNs, procedures and other miscellaneous engineering holds), parts hold, (parts staged, not yet inspected, parts not yet arrived) and planning hold (job scope not yet completed). Maintenance Work Requests (MWRs) are also shown that have been identified for the Cycle 15 Refueling Outage and have not yet been converted to MWOs.

NUMBER OF CONTROL ROOM EQUIPMENT DEFICIENCIES

A control room equipment deficiency is defined as any component which is operated or controlled from the Control Room, provides indication or alarm to the Control Room, provides testing capabilities from the Control Room, provides automatic actions from or to the Control Room, or provides a passive function for the Control Room and has been identified as deficient, i.e., does not perform under all conditions as designed. This definition also applies to the Alternate Shutdown Panels AI-179/AI-185/AI-212.

A plant component which is deficient or inoperable is considered an "Operator Work Around Item" if some other action is required by an operator to compensate for the condition of the component. Some examples are: 1) The control room level instrument does not work but a local sightglass can be read by an operator out in the plant; 2) A pump cannot be operated because of replacement parts which require a long lead time for purchase/delivery, thus requiring the redundant pump to be operated continuously; 3) Special actions required by an operator because of equipment design problems. These actions may be described in operations memorandums, operator notes, or may require changes to operating procedures.

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

NUMBER OF HOT SPOTS

The number of radiological hot spots which have been identified and documented to exist at FCS at the end of the reporting month. A hot spot is a small localized source of radiation. A hot spot occurs when the contact dose rate of an item is at least 5 times the General Area dose rate and the item's dose rate is equal to or greater than 100 mRem/hour.

NUMBER OF PERSONNEL ERRORS REPORTED IN LERS

The number of Licensee Event Reports (LERs) attributed to personnel error on the original LER submittal. A Personnel Error is an event for which the root cause is inappropriate action on the part of one or more specified individuals (as opposed to being attributed to a department or a general group). Also, the inappropriate action must have occurred within approximately two years of the "Event Date" specified in the LER. This indicator trends personnel performance for SEP #15.

NUMBER OF MISSED SURVEILLANCE TESTS RESULTING IN LICENSEE EVENT REPORTS

The number of Surveillance Tests (STs) that result in Licensee Event Reports (LERs) during the reporting month. This indicator tracks missed STs for SEP #60 & 61.

OPERATIONS AND MAINTENANCE BUDGET

The year-to-date budget compared to the actual expenditures for Operations and Maintenance departments.

OUTSTANDING CORRECTIVE ACTION REPORTS

This indicator displays the total number of outstanding Corrective Action Reports (CARs), the number of CARs that are older than six months and the number of modification related CARs.

OUTSTANDING MODIFICATIONS

The number of Modification Requests (MRs) in any state between the issuance of a Modification Number and the completion of the drawing update.

- 1) Form FC-1133 Backlog/In Progress. This number represents modification requests that have not been plant approved during the reporting month.
- 2) Modification Requests Being Reviewed. This category includes:
 - A.) Modification Requests that are not yet reviewed.
 - B.) Modification Requests being reviewed by the Nuclear Projects Review Committee (NPRC).
 - C.) Modification Requests being reviewed by the Nuclear Projects Committee (NPC).

These Modification Requests may be reviewed several times before they are approved for accomplishment or cancelled. Some of these Modification Requests are returned to Engineering for more information, some approved for evaluation, some approved for study, and some approved for planning. Once planning is completed and the scope of the work is clearly defined, these Modification Requests may be approved for accomplishment with a year assigned for construction or they may be cancelled. All of these different phases require review.

3) Design Engineering Backlog/In Progress. Nuclear Planning has assigned a year in which construction will be completed and design work may be in progress.

4) Construction Backlog/In Progress. The Construction Package has been issued or construction has begun but the modification has not been accepted by the System Acceptance Committee (SAC).

5) Design Engineering Update Backlog/In Progress. PED has received the Modification Completion Report but the drawings have not been updated.

The above mentioned outstanding modifications do not include modifications which are proposed for cancellation.

OVERALL PROJECT STATUS (CYCLE 15 REFUELING OUTAGE)

This indicator shows the status of the projects which are in the scope of the Cycle 15 Refueling Outage.

OVERDUE AND EXTENDED CORRECTIVE ACTION REPORTS

The number of overdue Corrective Action Reports (CARs) and the number of CARs which received extensions broken down by organization for the last 6 months.

PERCENT OF COMPLETED SCHEDULED MAINTENANCE ACTIVITIES

The % of the number of completed maintenance activities as compared to the number of scheduled maintenance activities each month. This % is shown for each maintenance craft. Maintenance activities include MWRs, MWOs, STs, PMOs, calibrations, and other miscellaneous activities. These indicators track Maintenance performance for SEP #33.

PERSONNEL TURNOVER RATE

The ratio of the number of turnovers to average employment. A turnover is a vacancy created by voluntary resignation from the company. Retirement, death, termination, transfers within the company, and part-time employees are not considered in turnover.

PLANNED CAPABILITY LOSS FACTOR

The ratio of the planned energy losses during a given period of time, to the reference energy generation (the energy that could be produced if the unit were operated continuously at full power under reference ambient conditions), expressed as a percentage.

PREVENTIVE MAINTENANCE ITEMS OVERDUE

This indicator is defined as the % of preventive maintenance items in the month that were not completed by the scheduled date plus a grace period equal to 25 % of the scheduled interval. This indicator tracks preventive maintenance activities for SEP #41.

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

PRIMARY SYSTEM CHEMISTRY % OF HOURS OUT OF LIMIT

The % of hours out of limit are for six primary chemistry parameters divided by the total number of hours possible for the month. The key parameters used are: Lithium, Chloride, Hydrogen, Dissolved Oxygen, Fluoride, and Suspended Solids. EPRI limits are used.

PROCEDURAL NONCOMPLIANCE INCIDENTS (MAINTENANCE)

The number of identified incidents concerning maintenance procedural problems, the number of closed IRs related to the use of procedures (includes the number of closed IRs caused by procedural noncompliance), and the number of closed procedural noncompliance IRs. This indicator trends personnel performance for SEP #15, 41 & 44.

PROGRESS OF CYCLE 15 OUTAGE MODIFICATION PLANNING (FROZEN SCOPE OF 24 MODIFICATIONS)

This indicator shows the status of modifications approved for completion during the Cycle 15 Refueling Outage.

RADIOLOGICAL WORK PRACTICES PROGRAM

The number of identified poor radiological work practices (PRWPs) for the reporting month. This indicator tracks radiological work performance for SEP #52.

RATIO OF PREVENTIVE TO TOTAL MAINTENANCE

The ratio of preventive maintenance (including surveillance testing and calibration procedures) to the sum of non-outage corrective maintenance and preventive maintenance completed over the reporting period. The ratio, expressed as a percentage, is calculated based on man-hours. This indicator tracks preventive maintenance activities for SEP #41.

RECORDABLE INJURY/ILLNESS CASES FREQUENCY RATE

The number of injuries requiring more than normal first aid per 200,000 man-hours worked. This indicator trends personnel performance for SEP #15, 25 & 26.

REPEAT FAILURES

The number of Nuclear Plant Reliability Data System (NPRDS) components with more than 1 failure and the number of NPRDS components with more than 2 failures for the last eighteen months.

SECONDARY SYSTEM CHEMISTRY PERFORMANCE INDEX

The Chemistry Performance Index (CPI) is a calculation based on the concentration of key impurities in the secondary side of the plant. These key impurities are the most likely cause of deterioration of the steam generators. The chemistry parameters are reported only for the period of time when the plant is operated at greater than 30 percent power.

The CPI is calculated using the following equation: $CPI = (Ka/0.8) + (Na/20) + (O_2/10) / 3$ where the following are monthly averages of: Ka = average blowdown cation conductivity, Na = average blowdown sodium concentration, O₂ = average condensate pump discharge dissolved oxygen concentration.

SECURITY NON-SYSTEM FAILURES

The following components are the types of loggable/reportable non-system failures represented in this indicator. Incidents in this category include security badges, access control and authorization, security force error, and unsecured doors.

- 1) Security Badges - Incidents associated with improper use and handling of security badges. Incidents include security badges that are lost, taken out of the protected area, out of control on-site, or inadvertently destroyed or broken.
 - 2) Access Control and Authorization - Administrative and procedural errors associated with the use of the card-access system such as tailgating, incorrect security badge issued, and improper escort procedures. This also includes incidents that were caused by incorrect access authorization information entered into the security system computer.
 - 3) Security Force Error - Events caused by members of the security force that are found to be inattentive to their duties or who neglected to properly perform assigned functions (e.g., required search procedure or patrol).
 - 4) Unsecured Doors - Doors which are found to be unsecured with no compensatory officer posted or where the individual causing the alarm did not remain at the alarmed door until a security officer responded. Events where an unsecured door is caused by air pressure are included in this category unless there is an indication that an adjustment was made to the door.
- This indicator tracks security performance for SEP #58.

SECURITY SYSTEM FAILURES

The following components are the types of loggable/reportable SECURITY SYSTEM FAILURES represented in this indicator. Incidents in this category include alarm system failures, CCTV failures, security computer failures, search equipment failures, and door hardware failures. These system failures are further categorized as follows:

- 1) Alarm System Failure - Detection system incidents involving false/nuisance alarms and mechanical failures.
- 2) Alarm System Environs - Degradations to detection system performance as a result of environmental conditions (i.e., rain, snow, frost).

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

3) CCTV Failures - Mechanical failures to all CCTV hardware components.

4) CCTV Environs - Degradations to CCTV performance as a result of environmental conditions (i.e., rain, snow, frost, fog, sunspots, shade).

5) Security Computer Failures - Failure of the multiplexer, central processing unit, and other computer hardware and software. This category does not include software problems caused by operator error in using the software.

6) Search Equipment Failures - Failures of x-ray, metal, or explosive detectors and other equipment used to search for contraband. This also includes incidents where the search equipment is found to be defective or did not function properly during testing.

7) Door Hardware Failure - Failure of the door alarm and other door hardware such as latches, electric strikes, doorknobs, locks, etc.

8) 1992 versus 1993 System Failures - Statistics from 1992 will be compared on a monthly basis with 1993 loggable/reportable system failures. This indicator tracks security performance for SEP #58.

SIGNIFICANT EVENTS

Significant events are those events identified by NRC staff through detailed screening and evaluation of operating experience. The screening process includes the daily review and discussion of all reported operating reactor events, as well as other operational data such as special tests or construction activities. An event identified from the screening process as a significant event candidate is further evaluated to determine if any actual or potential threat to the health and safety of the public was involved. Specific examples of the type of criteria are summarized as follows: 1) Degradation of important safety equipment; 2) Unexpected plant response to a transient; 3) Degradation of fuel integrity, primary coolant pressure boundary, important associated features; 4) Scram with complication; 5) Unplanned release of radioactivity; 6) Operation outside the limits of the Technical Specifications; 7) Other.

INPO significant events reported in this indicator are SERs (Significant Event Reports) which inform utilities of significant events and lessons learned identified through the SEE-IN screening process.

SPARE PARTS INVENTORY VALUE

The dollar value of the spare parts inventory for FCS during the reporting period.

SPARE PARTS ISSUED

The dollar value of the spare parts issued for FCS during the reporting period.

STAFFING LEVEL

The actual staffing level and the authorized staffing level for the Nuclear Operations Division, the Production Engineering Division, and the Nuclear Services Division. This indicator tracks performance for SEP #24.

STATION NET GENERATION

The net generation (sum) produced by the FCS during the reporting month.

STOCKOUT RATE

The total number of Pick Tickets that were generated during the reporting month and the total number of Pick Tickets that were generated during the reporting month when the amount of parts requested is equal to or less than the minimum stocking level and parts are not available.

TEMPORARY MODIFICATIONS

The number of temporary mechanical and electrical configurations to the plant's systems.

1) Temporary configurations are defined as electrical jumpers, electrical blocks, mechanical jumpers, or mechanical blocks which are installed in the plant operating systems and are not shown on the latest revision of the P&ID, schematic, connection, wiring, or flow diagrams.
2) Jumpers and blocks which are installed for Surveillance Tests, Maintenance Procedures, Calibration Procedures, Special Procedures, or Operating Procedures are not considered as temporary modifications unless the jumper or block remains in place after the test or procedure is complete. Jumpers and blocks installed in test or lab instruments are not considered as temporary modifications.

3) Scaffolding is not considered a temporary modification. Jumpers and blocks which are installed and for which MRs have been submitted will be considered as temporary modifications until final resolution of the MR and the jumper or block is removed or is permanently recorded on the drawings. This indicator tracks temporary modifications for SEP #62 & 71.

THERMAL PERFORMANCE

The ratio of the design gross heat rate (corrected) to the adjusted actual gross heat rate, expressed as a percentage.

TOTAL HOURS OF STUDENT TRAINING

The total number of student hours of training for Operations, Maintenance, Chemistry/Radiation Protection, Technical Support, General Employee Training, and Other Training conducted for FCS.

TOTAL INSTRUCTION HOURS

The total number and department breakdown of training instruction hours administered by the Training Center.

UNIT CAPABILITY FACTOR

The ratio of the available energy generation over a given time period to the reference energy generation (the energy that could be produced if the unit were operated continuously at full power under reference ambient conditions) over the same time period, expressed as a percentage.

PERFORMANCE INDICATOR DEFINITIONS (cont'd)

UNPLANNED AUTOMATIC REACTOR SCRAMS PER 7,000 CRITICAL HOURS

This indicator is defined as the number of unplanned automatic scrams (reactor protection system logic actuations) that occur per 7,000 hours of critical operation. The value for this indicator is calculated by multiplying the total number of unplanned automatic reactor scrams in a specific time period by 7,000 hours, then dividing that number by the total number of hours critical in the same time period. The indicator is further defined as follows:

- 1) Unplanned means that the scram was not an anticipated part of a planned test.
- 2) Scram means the automatic shutdown of the reactor by a rapid insertion of negative reactivity (e.g., by control rods, liquid injection system, etc.) that is caused by actuation of the reactor protection system. The scram signal may have resulted from exceeding a setpoint or may have been spurious.
- 3) Automatic means that the initial signal that caused actuation of the reactor protection system logic was provided from one of the sensors monitoring plant parameters and conditions, rather than the manual scram switches or, in manual turbine trip switch or push-buttons) provided in the main control room.
- 4) Critical means that during the steady-state condition of the reactor prior to the scram, the effective multiplication factor (k_{eff}) was essentially equal to one.

UNPLANNED CAPABILITY LOSS FACTOR

The ratio of the unplanned energy losses during a given period of time, to the reference energy generation (the energy that could be produced if the unit were operated continuously at full power under reference ambient conditions) over the same time period, expressed as a percentage.

UNPLANNED SAFETY SYSTEM ACTUATIONS - (INPO DEFINITION)

This indicator is defined as the sum of the following safety system actuations:

- 1) The number of unplanned Emergency Core Cooling System (ECCS) actuations that result from reaching an ECCS actuation setpoint or from a spurious/inadvertent ECCS signal.
- 2) The number of unplanned emergency AC power system actuations that result from a loss of power to a safeguards bus. An unplanned safety system actuation occurs when an actuation setpoint for a safety system is reached or when a spurious or inadvertent signal is generated (ECCS only), and major equipment in the system is actuated. Unplanned means that the system actuation was not part of a planned test or evolution. The ECCS actuations to be counted are actuations of the high pressure injection system, the low pressure injection system, or the safety injection tanks.

UNPLANNED SAFETY SYSTEM ACTUATIONS (NRC DEFINITION)

The number of safety system actuations which include (only) the High Pressure Safety Injection System, the Low Pressure Safety Injection System, the Safety Injection Tanks, and the Emergency Diesel Generators. The NRC classification of safety system actuations includes actuations when major equipment is operated and when the logic systems for the above safety systems are challenged.

VIOLATIONS PER 1,000 INSPECTION HOURS

This indicator is defined as the number of violations cited in NRC inspection reports for FCS per 1,000 NRC inspection hours. The violations are reported in the year that the inspection was actually performed and not based on when the inspection report is received. The hours reported for each inspection report are used as the inspection hours.

VOLUME OF LOW-LEVEL SOLID RADIOACTIVE WASTE

This indicator is defined as the volume of low-level solid radioactive waste actually shipped for burial. This indicator also shows the volume of low-level radioactive waste which is in temporary storage, the amount of radioactive oil that has been shipped off-site for processing, and the volume of solid dry radioactive waste which has been shipped off-site for processing. Low-level solid radioactive waste consists of dry active waste, sludges, resins, and evaporator bottoms generated as a result of nuclear power plant operation and maintenance. Dry radioactive waste includes contaminated rags, cleaning materials, disposable protective clothing, plastic containers, and any other material to be disposed of at a low-level radioactive waste disposal site, except resin, sludge, or evaporator bottoms. Low-level refers to all radioactive waste that is not spent fuel or a by-product of spent fuel processing. This indicator tracks radiological work performance for SEP #54.

SAFETY ENHANCEMENT PROGRAM INDEX

The purpose of the Safety Enhancement Program (SEP) Performance Indicators Index is to list performance indicators related to SEP items with parameters that can be trended.

<u>SEP Reference Number</u>	<u>Page</u>
<u>SEP Reference Number 15</u>	
Increase HPES and IR Accountability Through Use of Performance Indicators	
Procedural Noncompliance Incidents (Maintenance)	35
Contaminations >5,000 DPM/100 CM ²	51
Recordable Injury/Illness Cases Frequency Rate	19
Number of Personnel Errors Reported in LERs	70
CARs Issued vs Significant CARs Issued vs NRC Violations Issued vs LERs Reported	83
<u>SEP Reference Number 20</u>	
Quality Audits and Surveillance Programs are Evaluated, Improved in Depth and Strengthened	
CARs Issued vs Significant CARs Issued vs NRC Violations Issued vs LERs Reported	83
<u>SEP Reference Number 21</u>	
Develop and Conduct Safety System Functional Inspections	
CARs Issued vs Significant CARs Issued vs NRC Violations Issued vs LERs Reported	83
<u>SEP Reference Number 24</u>	
Complete Staff Studies	
Staffing Level	72
<u>SEP Reference Number 25</u>	
Training Program for Managers and Supervisors Implemented	
Disabling Injury/Illness Frequency Rate	18
Recordable Injury/Illness Cases Frequency Rate	19
<u>SEP Reference Number 26</u>	
Evaluate and Implement Station Standards for Safe Work Practice Requirements	
Disabling Injury/Illness Frequency Rate	18
Recordable Injury/Illness Cases Frequency Rate	19
<u>SEP Reference Number 27</u>	
Implement Supervisory Enforcement of Industrial Safety Standards	
Disabling Injury/Illness Frequency Rate	18
Recordable Injury/Illness Cases Frequency Rate	19
<u>SEP Reference Number 31</u>	
Develop Outage and Maintenance Planning Manual and Conduct Project Management Training	
MWO Planning Status	84
Overall Project Status	85
Progress of Cycle 15 Outage Modification Planning	86
<u>SEP Reference Number 33</u>	
Develop On-Line Maintenance and Modification Schedule	
Percent of Completed Scheduled Maintenance Activities	
(Electrical Maintenance)	36
(Pressure Equipment)	37
(General Maintenance)	38
(Mechanical Maintenance)	39
(Instrumentation & Control)	40
<u>SEP Reference Number 36</u>	
Reduce Corrective Non-Outage Backlog	
Maintenance Work Order (MWO) Breakdown (Corrective Non-Outage Maintenance)	29
Corrective Maintenance Backlog Greater than 3 Months Old (Non-Outage) ...	30

<u>SEP Reference Number</u>	<u>Page</u>
<u>SEP Reference Number 41</u>	
Develop and Implement a Preventive Maintenance Schedule	31
Ratio of Preventive to Total Maintenance	32
Preventive Maintenance Items Overdue	35
Procedural Noncompliance Incidents	35
<u>SEP Reference Number 43</u>	
Implement the Check Valve Test Program	44
Check Valve Failure Rate	44
<u>SEP Reference Number 44</u>	
Compliance With and Use of Procedures	35
Procedural Noncompliance Incidents (Maintenance)	35
<u>SEP Reference Number 46</u>	
Design a Procedures Control and Administrative Program	23
Document Review	23
<u>SEP Reference Number 52</u>	
Establish Supervisory Accountability for Workers Radiological Practices	53
Radiological Work Practices Program	53
<u>SEP Reference Number 54</u>	
Complete Implementation of Radiological Enhancement Program	16
Collective Radiation Exposure	17
Volume of Low-Level Solid Radioactive Waste	51
Contaminations >5,000 DPM/100 CM ²	52
Decontaminated Radiation Controlled Area	52
<u>SEP Reference Number 58</u>	
Revise Physical Security Training and Procedure Program	57
Loggable/Reportable Incidents (Security)	58
Security Non-System Failures	59
Security System Failures	59
<u>SEP Reference Number 60</u>	
Improve Controls Over Surveillance Test Program	41
Number of Missed Surveillance Tests Resulting in Licensee Event Reports	41
<u>SEP Reference Number 61</u>	
Modify Computer Program to Correctly Schedule Surveillance Tests	41
Number of Missed Surveillance Tests Resulting in Licensee Event Reports	41
<u>SEP Reference Number 62</u>	
Establish Interim System Engineers	66
Temporary Modifications	67
Engineering Assistance Request (EAR) Breakdown	68
Engineering Change Notice Status	69
Engineering Change Notice Breakdown	69
<u>SEP Reference Number 68</u>	
Assess Root Cause of Poor Operator Training and Establish Means to Monitor Operator Training	73
Licensed Operator Regualification Training	74
License Candidate Exams	74
<u>SEP Reference Number 71</u>	
Improve Controls over Temporary Modifications	66
Temporary Modifications	66

REPORT DISTRIBUTION LIST

R. L. Andrews	M. J. Guinn	R. J. Mueller
G. L. Anglehart	G. E. Guliani	M. W. Nichols
W. R. Bateman	K. B. Guliani	C. W. Norris
K. L. Belek	E. R. Gunda	Nuclear Licensing
T. G. Blair	R. H. Guy	& Industry Affairs
B. H. Blome	R. M. Hawkins	J. T. O'Connor
C. N. Bloyd	M. C. Hendrickson	W. W. Orr
J. P. Bobba	R. R. Henning	L. L. Parent
C. E. Boughter	K. R. Henry	T. L. Patterson
M. A. Breuer	J. B. Herman	R. T. Pearce
C. J. Brunner	G. J. Hill	R. L. Phelps
M. W. Butt	K. C. Holthaus	W. J. Ponc
C. A. Carlson	C. K. Huang	L. M. Pulverenti
J. W. Chase	L. G. Hulis a	T. M. Reisdorff
G. R. Chatfield	C. J. Husk	A. W. Richard
A. G. Christensen	R. L. Jaworski	R. T. Ridenour
A. J. Clark	R. A. Johansen	D. G. Ried
O. J. Clayton	W. C. Jones	G. K. Samide
R. P. Clemens	J. D. Kacy	T. J. Sandene
J. L. Connolly	J. D. Keppler	M. J. Sandhoefer
G. M. Cook	D. D. Kloock	B. A. Schmidt
J. E. Cook	J. C. Knight	S. T. Schmitz
M. R. Core	D. M. Kobunski	F. C. Scofield
S. R. Crites	G. J. Krause	H. J. Sefick
D. W. Dale	J. G. Krist	J. W. Shannon
R. C. DeMeulmeester	L. T. Kusek	R. W. Short
D. C. Dietz	L. E. Labs	C. F. Simmons
K. S. Dowdy	M. P. Lazar	E. L. Skaggs
J. A. Drahota	R. C. Learch	J. L. Skiles
T. R. Dukarski	R. E. Lewis	F. K. Smith
R. G. Eurich	R. C. Liebenritt	R. L. Sorenson
H. J. Faulhaber	D. L. Lippy	J. A. Spilker
M. A. Ferdig	B. Lisowyj	D. E. Spires
F. F. Franco	B. R. Livingston	K. E. Steele
M. T. Frans	J. H. MacKinnon	W. Steele
H. K. Fraser	G. D. Mamoran	H. F. Sterba
J. F. W. Friedrichsen	J. W. Marcil	G. A. Teeple
S. K. Gambhir	N. L. Marice	M. A. Tesar
J. K. Gasper	R. D. Martin	J. W. Tills
W. G. Gates	D. J. Matthews	D. R. Trausch
M. O. Gautier	J. M. Mattice	P. R. Turner
S. W. Gebers	T. J. McIvor	J. M. Uhland
J. M. Glantz	K. S. McCormick	C. F. Vanecek
J. T. Gleason	R. F. Mehaffey	J. M. Waszak
L. V. Goldberg	K. G. Melstad	G. R. Williams
D. J. Golden	K. J. Morris	S. J. Willrett
D. C. Gorence	D. C. Mueller	W. C. Woerner
R. E. Gray		

**FORT CALHOUN STATION
OPERATING CYCLES AND REFUELING OUTAGE DATES**

Event	Date Range	Production (MWH)	Cumulative (MWH)
Cycle 1	09/26/73 - 02/01/75	3,299,639	3,299,639
1st Refueling	02/01/75 - 05/09/75	*	*
Cycle 2	05/09/75 - 10/01/76	3,853,322	7,152,961
2nd Refueling	10/01/76 - 12/13/76	*	*
Cycle 3	12/13/76 - 9/30/77	2,805,927	9,958,888
3rd Refueling	09/30/77 - 12/09/77	*	*
Cycle 4	12/09/77 - 10/14/78	3,026,832	12,985,720
4th Refueling	10/14/78 - 12/24/78	*	*
Cycle 5	12/24/78 - 01/18/80	3,882,734	16,868,454
5th Refueling	01/18/80 - 06/11/80	*	*
Cycle 6	06/11/80 - 09/18/81	3,899,714	20,768,168
6th Refueling	09/18/81 - 12/21/81	*	*
Cycle 7	12/21/81 - 12/06/82	3,561,866	24,330,034
7th Refueling	12/06/82 - 04/07/83	*	*
Cycle 8	04/07/83 - 03/03/84	3,406,371	27,736,405
8th Refueling	03/03/84 - 07/12/84	*	*
Cycle 9	07/12/84 - 09/28/85	4,741,488	32,477,893
9th Refueling	09/28/85 - 01/16/86	*	*
Cycle 10	01/16/86 - 03/07/87	4,356,753	36,834,646
10th Refueling	03/07/87 - 06/08/87	*	*
Cycle 11	06/08/87 - 09/27/88	4,936,859	41,771,505
11th Refueling	09/27/88 - 01/31/89	*	*
Cycle 12	01/31/89 - 02/17/90	3,817,954	45,589,459
12th Refueling	02/17/90 - 05/29/90	*	*
Cycle 13	05/29/90 - 02/01/92	5,451,069	51,040,528
13th Refueling	02/01/92 - 05/03/92	*	*
Cycle 14#	05/03/92 - 09/18/93	(Planned Dates)	
14th Refueling	09/18/93 - 11/13/93	*	*
Cycle 15	11/13/93 - 03/11/95	*	*
15th Refueling	03/11/95 - 05/06/95	*	*

**FORT CALHOUN STATION
CURRENT PRODUCTION AND OPERATIONS "RECORDS"**

First Sustained Reaction	August 5, 1973 (5:47 p.m.)
First Electricity Supplied to the System	August 25, 1973
Commercial Operation (180,000 KWH)	September 26, 1973
Achieved Full Power (100%)	May 4, 1974
Longest Run (477 days)	June 8, 1987-Sept. 27, 1988
Highest Monthly Net Generation (364,468,800 KWH)	October 1987
Most Productive Fuel Cycle (5,451,069 MWH)(Cycle 13)	May 29, 1990-Feb. 1, 1992