




Northern States Power Company

414 Nicollet Mall
Minneapolis, Minnesota 55401
Telephone (612) 330-5500

Monticello Nuclear Generating Plant
P.O. Box 600
Monticello, MN 55362

April 22, 1982

Director - Region III
Office of Inspection and Enforcement
United States Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

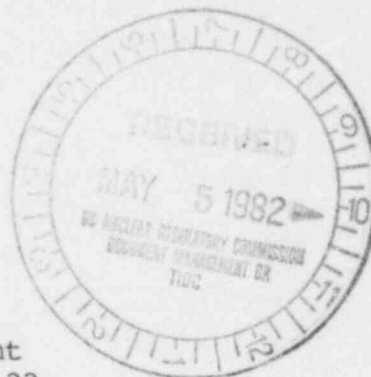

Monticello Nuclear Generating Plant
Docket No. 50-263 License No. DPR-22

Dear Sir:

The following information is submitted in response to IE Bulletin 79-02, Revision 2, item 8 which requires a final report upon completion of action.

Inspection and testing of expansion anchor bolts in all identified Seismic Category I piping supports was completed on March 26, 1980. Modifications and repairs were completed on May 20, 1980. An additional hanger was discovered and subsequently inspected, tested and repaired on August 18, 1981. Inspection of block walls in inaccessible areas was completed on March 12, 1980. This inspection revealed that no Seismic Category I piping supports are attached.

In addition to the supports reported in our July 6, 1979 submittal, three more supports were found to have a factor of safety less than two. These supports are as follows:

Hanger No.	System	Evaluation
CH 180	Condensate supply to RHR	Bechtel Power Corporation determined that the system is operable without this support.
PS 30	Main Steam	Bechtel Power Corporation determined that the system is operable without this support.
PS 160	Main Steam Equalizing Drain	Bechtel Power Corporation determined that the system is operable without this support.


8205060339 820422
PDR ADOCK 05000263
Q PDR

IE 11
APR 30 1982

Supports were upgraded as necessary to bring anchor bolt safety factors within Bulletin requirements.

This is our final submittal regarding IE Bulletin 79-02. If additional information is required, please communicate directly with plant management.

Very truly yours,



D. E. Gilberts, P.E.
Sr. Vice President
Power Supply

DEG/hdz

c: US NRC
Office of Inspection & Enforcement
Division of Reactor Operations Inspection
Washington, D.C. 20555

G Charnoff
C H Brown