



**LOUISIANA**  
**POWER & LIGHT**


142 DELARONDE STREET  
P O BOX 6008 • NEW ORLEANS, LOUISIANA 70174 • (504) 366-2345

May 11, 1982

G. D. McLENDON  
Senior Vice President

W3K-82-0270  
Q-3-A35.07

Mr. John T. Collins, Regional Administrator, Region IV  
U. S. Nuclear Regulatory Commission  
611 Ryan Plaza Drive, Suite 1000  
Arlington, Texas 76012

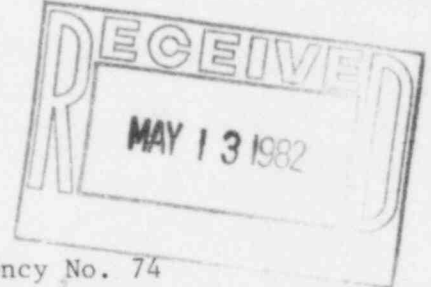

Subject: Waterford SES Unit No. 3  
Docket No. 50-382  
Final Report of Potentially Reportable Deficiency No. 74  
"Diesel Generator High Speed Differential Relay Seismic  
Qualification"

Reference: Telecon - R. Bennett (LP&L) to B. Crossman (NRC) on April 8, 1982

Dear Mr. Collins:

Evaluation of the significance of Potentially Reportable Deficiency No. 74 has been completed in accordance with 10CFR50.55(e), and this item is considered nonreportable.

Review of documentation and inspection of Emergency Diesel Generator Sets A and B confirm that General Electric Company High Speed Differential Relays, Model No. GE-12CFD12B1A, are not utilized or installed at the Waterford 3 Site. Therefore, based on this information, Potentially Reportable Deficiency No. 74 is considered nonreportable under the requirements of 10CFR50.55(e).

If you have any questions, please let us know.

Very truly yours,

*G. D. McLendon*

GDMcL/LLB/grf

- cc: 1) Director  
Office of Inspection & Enforcement  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555
- 2) Director  
Office of Management  
Information and Program Control  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

IE-27  
5  
/1

8205180320