



**LOUISIANA
POWER & LIGHT**

142 DELARONDE STREET
P. O. BOX 6008 • NEW ORLEANS, LOUISIANA 70174 • (504) 366-2345

June 8, 1982

G. D. McLendon
Senior Vice President

W3K-82-0330
Q-3-A35.07

Mr. John T. Collins, Regional Administrator, Region IV
U. S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76012

SUBJECT: Waterford SES Unit No. 3
Docket No. 50-382
Interim Report of Potentially Reportable Incident No. 52
"Reactor Coolant Pump Supports - A-490 Bolts"
Third Interim Report

Reference: 1) Telecon - R. G. Bennett (LP&L) to L. Martin (NRC) on 6/1/82
2) Telecon - R. G. Bennett (LP&L) to L. Martin (NRC) on 7/7/82

Dear Mr. Collins:

In reference 1, LP&L committed to submit a final report by June 7, 1982 on Potentially Reportable Incident No. 52.

The rework of the ASTM-A-490 bolts is now complete, however, it has been discovered that the 2,000 lb. torque wrench which was used to verify bolt torquing was out of calibration in the 1100-1200 foot-pound range. This has been documented on NISCO Nonconformance Report No. 221 and will be processed and evaluated.

A final report on this item will be submitted by July 6, 1982.

If there are any questions, please let us know.


Very truly yours,

G. D. McLendon

8206150126 820608
PDR ADDCK 05000382
S PDR

GDMcL/LLB/grf

- 1) Director
Office of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555
- 2) Director
Office of Management
Information and Program Control
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

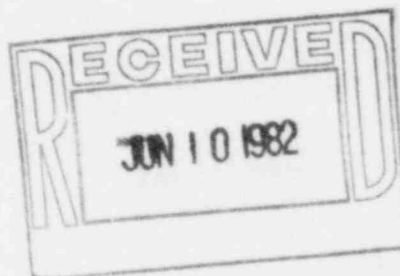

1E-27