

ATTACHMENT B

Core Operating Limits Report

for

LaSalle County Station

Unit 2, Reload 5 (Cycle 6)

9310070142 930930
PDR ADOCK 05000374
P PDR
ZMLAP

CORE OPERATING LIMITS REPORT

ISSUANCE OF CHANGES SUMMARY

Affected Section	Affected Pages	Summary of Changes	Date
All	All	Original Issue (Cycle 4)	4/90
All	All	Original Issue (Cycle 5)	3/92
2.0	2-2	Revised MCPR Power Distribution Limits (all fuel types) for New TCV Analysis Slow Closure Event	6/93
2.0	2-4	MCPR Power Distribution Limits (all fuel types) for Coastdown Analysis	6/93
All	7	Original Issue (Cycle 6)	9/93

CORE OPERATING LIMITS REPORT

TABLE OF CONTENTS

	<u>Page</u>
REFERENCES	iii
1.0 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (3/4.2.1).	1-1
1.1 Tech Spec Reference	1-1
1.2 Description	1-1
2.0 MINIMUM CRITICAL POWER RATIO (3/4.2.3).	2-1
2.1 Tech Spec Reference	2-1
2.2 Description	2-1
3.0 LINEAR HEAT GENERATION RATE (3/4.2.4)	3-1
3.1 Tech Spec Reference	3-1
3.2 Description	3-1
4.0 CONTROL ROD WITHDRAWAL BLOCK INSTRUMENTATION (3/4.3.6).	4-1
4.1 Tech Spec Reference	4-1
4.2 Description	4-1

CORE OPERATING LIMITS REPORT

REFERENCES

1. Commonwealth Edison Company Docket No. 50-373, LaSalle County Station, Unit 2 Facility Operating License, License No. NPF-18.
2. Letter from D. M. Crutchfield to All Power Reactor Licensees and Applicants, Generic Letter 88-16; Concerning the Removal of Cycle-Specific Parameter Limits from Tech Specs, dated October 4, 1988.
3. Supplemental Reload License Submittal for LaSalle County Station, Unit 2, Reload 5 (Cycle 6), 23A7209, Rev. 0, June, 1993.
4. LaSalle County Station, Units 1 and 2, SAFER/GESTR LOCA Loss-of-Coolant-Accident Analysis, NEDC, 3151OP (latest approved version).
5. General Electric Standard Application for Reactor Fuel (GESTAR), NEDE-24011-P-A (latest approved version).
6. Extended Operating Domain and Equipment Out-of-Service for LaSalle County Station Units 1 and 2, NEDE-31455, (latest approved version).
7. Equipment Out-of-Service In The Increased Core Flow Domain For LaSalle County Station Units 1 and 2, GE-NE-187-62-1191 (latest approved version).
8. Evaluation of a Postulated Slow Turbine Control Valve Closure Event for LaSalle County Station, Unit 1 and 2, GE-NE-187-13-0792, February, 1993.
9. Analysis of EFPC Coastdown With Load Following for LaSalle 1 and 2. GENE-637-016-0693, June, 1993.

CORE OPERATING LIMITS REPORT

1.0 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (3/4.2.1)

1.1 Tech Spec REFERENCE:

Tech Spec 3.2.1.

1.2

TABLE for
Maximum Average
Planar Heat
Generation Rates
(MAPLHGR)

Fuel Type

1.2-1	BC320C
1.2-2	BC300D
1.2-3	P8CWB303-9GZ
1.2-4	P8CWB303-10GZ
1.2-5	P8CWB302-9GZ
1.2-6	P8CWB300-9GZ
1.2-7	P8CWB313-9GZ
1.2-8	P8CWB316-9GZ

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR)
vs. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE BC320C (GE8B-P8CQB320-7GZ)

CORE OPERATING LIMITS REPORT

TABLE 1.2-1

CMC BUNDLE TYPE 7

<u>Exposure (MWd/ST)</u>	<u>LATTICE SPECIFIC MAPLHGR (kw/ft)</u>			
	<u>P8CQ071</u> <u>NOG</u>	<u>P8CQL340</u> <u>7G4.0</u>	<u>P8CQL340</u> <u>7G3.0</u>	<u>P8CQL071</u> <u>7GE</u>
0.0	12.44	11.57	11.63	12.44
200	12.36	-	-	12.36
1000	12.15	-	-	12.15
2000	12.08	-	-	12.08
3000	12.08	-	12.21	12.08
4000	12.10	12.23	12.41	12.10
6000	-	12.57	12.83	-
8000	-	12.94	13.06	-
10000	12.25	13.12	-	12.25
12500	-	13.03	13.04	-
15000	-	12.71	12.72	-
25000	10.11	-	-	10.11
35000	8.53	10.15	10.16	8.53
45000	-	8.50	8.55	-
45600	5.09	-	-	5.09
50000	-	6.08	6.12	-
CMC LATTICE TYPE	10	13	14	15

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLEGR)
vs. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE BC300D (GE8B-P8CQB300-6G3.0)

CORE OPERATING LIMITS REPORT

TABLE 1.2-2

CMC BUNDLE TYPE 6

<u>Exposure (MWd/ST)</u>	<u>LATTICE SPECIFIC MAPLHGR (kw/ft)</u>		
	<u>P8CQL071</u> <u>NOG</u>	<u>P8CQL319</u> <u>6G3.0</u>	<u>P8CQL071</u> <u>6GE</u>
0.0	12.44	11.77	12.44
200	12.36	-	12.36
1000	12.15	-	12.15
2000	12.08	12.33	12.08
3000	12.08	12.61	12.08
4000	12.10	12.91	12.10
5000	-	13.22	-
10000	12.25	13.45	12.25
15000	-	13.17	-
25000	10.11	-	10.11
35000	8.53	10.65	8.53
45000	-	8.73	-
45600	5.09	-	5.09
50000	-	6.62	-
CMC LATTICE TYPE	10	11	12

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR)
vs. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE P8CWB303-9GZ

CORE OPERATING LIMITS REPORT

TABLE 1.2-3

CMC BUNDLE TYPE 8

<u>Exposure</u> <u>(MWd/ST)</u>	<u>LATTICE SPECIFIC MAPLHGR (kw/ft)</u>				
	<u>P8CWL071</u> <u>NOG</u>	<u>P8CWL327</u> <u>9G5.0</u>	<u>P8CWL338</u> <u>4G5.0/5G4.0</u>	<u>P8CWL327</u> <u>4G5.0/5G4.0</u>	<u>P8CWL071</u> <u>9GE</u>
0.0	12.74	11.98	11.35	12.01	12.74
200	12.67	12.05	11.39	12.08	12.67
1000	12.48	12.17	11.48	12.22	12.48
2000	12.42	12.37	11.67	12.43	12.42
3000	12.41	12.56	11.90	12.61	12.41
4000	12.44	12.69	12.16	12.78	12.44
5000	12.46	12.81	12.38	12.91	12.46
6000	12.49	12.92	12.56	13.03	12.49
7000	12.51	13.04	12.75	13.15	12.51
8000	12.54	13.16	12.94	13.27	12.54
9000	12.55	13.29	13.13	13.37	12.55
10000	12.57	13.41	13.29	13.47	12.57
12500	12.41	13.49	13.33	13.51	12.41
15000	12.04	13.18	13.05	13.20	12.04
20000	11.27	12.54	12.46	12.55	11.27
25000	10.49	11.84	11.87	11.84	10.49
35000	8.95	10.35	10.54	10.36	8.95
45000	6.15	9.02	9.14	9.02	6.15
46900	5.21	-	-	-	5.21
51500	-	-	5.90	-	-
51800	-	5.82	-	5.81	-
CMC LATTICE TYPE 16		17	18	19	20

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR)
vs. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE P8CWB303-10GZ

CORE OPERATING LIMITS REPORT

TABLE 1.2-4

CMC BUNDLE TYPE 9

Exposure (MWD/ST)	LATTICE SPECIFIC MAPLHGR (kw/ft)				
	P8CWL071 NOG	P8CWL326 5G5.0/4G4.0	P8CWL338 10G4.0	P8CWL326 10G4.0	P8CWL071 10GE
0.0	12.74	12.02	11.69	12.07	12.74
200	12.67	12.08	11.75	12.14	12.67
1000	12.48	12.23	11.91	12.30	12.48
2000	12.42	12.44	12.09	12.55	12.42
3000	12.41	12.68	12.25	12.81	12.41
4000	12.44	12.89	12.40	12.98	12.44
5000	12.46	13.04	12.56	13.15	12.46
6000	12.49	13.18	12.72	13.29	12.49
7000	12.51	13.33	12.88	13.36	12.51
8000	12.54	13.49	13.05	13.44	12.54
9000	12.55	13.57	13.21	13.53	12.55
10000	12.57	13.59	13.33	13.60	12.57
12500	12.41	13.61	13.29	13.63	12.41
15000	12.04	13.29	12.97	13.31	12.04
20000	11.27	12.63	12.33	12.64	11.27
25000	10.49	11.84	11.70	11.85	10.49
35000	8.95	10.35	10.40	10.36	8.95
45000	6.15	9.00	8.97	9.01	6.15
46900	5.21	-	-	-	5.21
51100	-	-	5.90	-	-
51900	-	5.78	-	-	-
52000	-	-	-	5.79	-
CMC LATTICE TYPE 16		4	5	6	7

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR)
VS. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE P8CWB302-9GZ

CORE OPERATING LIMITS REPORT

TABLE 1.2-5

CMC BUNDLE TYPE 10

LATTICE SPECIFIC MAPLHGR (KW/FT)

EXPOSURE (MWD/ST)	P8CWL071 9GE	P8CWL326 5G5.0/4G4.0	P8CWL337 9G4.0	P8CWL326 9G4.0	P8CWL071 NOG
0	12.74	11.99	11.38	12.04	12.74
200	12.67	12.07	11.42	12.11	12.67
1000	12.48	12.21	11.53	12.27	12.48
2000	12.42	12.41	11.74	12.48	12.42
3000	12.41	12.58	11.99	12.63	12.41
4000	12.44	12.72	12.26	12.76	12.44
5000	12.46	12.85	12.46	12.89	12.46
6000	12.49	12.97	12.65	13.03	12.49
7000	12.51	13.08	12.86	13.17	12.51
8000	12.54	13.19	13.07	13.31	12.54
9000	12.55	13.31	13.20	13.43	12.55
10000	12.57	13.41	13.31	13.51	12.57
12500	12.41	13.49	13.34	13.51	12.41
15000	12.04	13.19	13.05	13.19	12.04
20000	11.27	12.55	12.47	12.55	11.27
25000	10.49	11.85	11.88	11.85	10.49
35000	8.95	10.38	10.56	10.38	8.95
45000	6.15	9.05	9.18	9.06	6.15
46850	5.21	-	-	-	5.21
51790	-	-	5.86	-	-
52120	-	5.80	-	-	-
52130	-	-	-	5.80	-
CMC LATTICE TYPE	25	22	23	24	21
LATTICE No.	887	879	880	882	733

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLEGR)
VS. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE P8CWB300-9GZ

CORE OPERATING LIMITS REPORT

TABLE 1.2-6

CMC BUNDLE TYPE 11

LATTICE SPECIFIC MAPLEGR (KW/FT)

EXPOSURE (MWD/ST)	P8CWL071 9GE	P8CWL320		P8CWL338		P8CWL071 NOG
		4G4.0/ 3G3.0	P8CWL338 7G3.0	2G4.0/ 7G3.0	P8CWL320 7G3.0	
0	12.74	12.41	11.89	11.39	12.48	12.74
200	12.67	12.47	11.96	11.47	12.49	12.67
1000	12.48	12.60	12.12	11.65	12.55	12.48
2000	12.42	12.71	12.29	11.90	12.64	12.42
3000	12.41	12.82	12.43	12.17	12.73	12.41
4000	12.44	12.92	12.51	12.43	12.82	12.44
5000	12.46	13.03	12.58	12.54	12.90	12.46
6000	12.49	13.13	12.65	12.63	12.98	12.49
7000	12.51	13.17	12.71	12.69	13.04	12.51
8000	12.54	13.16	12.75	12.73	13.08	12.54
9000	12.55	13.14	12.78	12.76	13.11	12.55
10000	12.57	13.13	12.80	12.80	13.14	12.57
12500	12.41	13.10	12.72	12.71	13.11	12.41
15000	12.04	12.80	12.41	12.41	12.81	12.04
20000	11.27	12.21	11.82	11.81	12.22	11.27
25000	10.49	11.63	11.23	11.22	11.64	10.49
35000	8.95	10.29	10.04	10.03	10.29	8.95
45000	6.15	8.99	8.31	8.30	9.00	6.15
46850	5.21	-	-	-	-	5.21
49960	-	-	5.84	5.83	-	-
51240	-	-	-	-	5.88	-
51290	-	5.86	-	-	-	-
CMC						
LATTICE TYPE	30	26	27	28	29	21
LATTICE No.	1204	1200	1201	1202	1203	733

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR)
VS. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE P8CWB313-9GZ

CORE OPERATING LIMITS REPORT

TABLE 1.2-7

CMC BUNDLE TYPE 12

LATTICE SPECIFIC MAPLHGR (KW/FT)

EXPOSURE (MWD/ST)	P8CWL071 9GE	P8CWL339 7G4.0	P8CWL350 2G4.0/5G3.0	P8CWL350 4G4.0/5G3.0	P8CWL339 2G4.0/5G3.0	P8CWL071 NOG
0	12.74	12.34	11.79	11.32	12.35	12.74
200	12.67	12.39	11.84	11.40	12.40	12.67
1000	12.48	12.49	11.96	11.55	12.52	12.48
2000	12.42	12.63	12.12	11.73	12.68	12.42
3000	12.41	12.74	12.28	11.92	12.83	12.41
4000	12.44	12.85	12.40	12.11	12.96	12.44
5000	12.46	12.97	12.49	12.27	13.10	12.46
6000	12.49	13.10	12.58	12.39	13.19	12.49
7000	12.51	13.22	12.67	12.52	13.29	12.51
8000	12.54	13.34	12.76	12.65	13.37	12.54
9000	12.55	13.38	12.84	12.78	13.45	12.55
10000	12.57	13.38	12.91	12.89	13.41	12.57
12500	12.41	13.36	12.85	12.85	13.36	12.41
15000	12.04	13.01	12.56	12.56	13.01	12.04
20000	11.27	12.34	11.98	11.97	12.33	11.27
25000	10.49	11.69	11.38	11.37	11.69	10.49
35000	8.95	10.46	10.12	10.11	10.46	8.95
45000	6.15	9.12	8.53	8.50	9.13	6.15
46850	5.21	-	-	-	-	5.21
50360	-	-	-	5.84	-	-
50390	-	-	5.85	-	-	-
51860	-	5.84	-	-	-	-
51880	-	-	-	-	5.84	-
CMC LATTICE TYPE	9	1	2	3	8	31
LATTICE No.	1581	1577	1578	1579	1580	733

MAXIMUM AVERAGE PLANAR LINEAR HEAT GENERATION RATE (MAPLHGR)
VS. AVERAGE PLANAR EXPOSURE FOR FUEL TYPE P8CWB316-9GZ

CORE OPERATING LIMITS REPORT

TABLE 1.2-8

CMC BUNDLE TYPE 13

LATTICE SPECIFIC MAPLHGR (KW/FT)

EXPOSURE (MWD/ST)	P8CWL071 9GE	P8CWL339 7G4.0	P8CWL355 4G4.0/3G3.0	P8CWL355 6G4.0/3G3.0	P8CWL339 4G4.0/3G3.0	P8CWL071 NOG
0	12.74	12.34	11.87	11.34	12.36	12.74
200	12.67	12.39	11.94	11.43	12.41	12.67
1000	12.48	12.49	12.10	11.61	12.53	12.48
2000	12.42	12.63	12.27	11.86	12.65	12.42
3000	12.41	12.74	12.41	12.05	12.77	12.41
4000	12.44	12.85	12.53	12.23	12.89	12.44
5000	12.46	12.97	12.61	12.38	13.02	12.46
6000	12.49	13.10	12.69	12.50	13.14	12.49
7000	12.51	13.22	12.77	12.62	13.23	12.51
8000	12.54	13.34	12.87	12.75	13.34	12.54
9000	12.55	13.38	12.96	12.90	13.43	12.55
10000	12.57	13.38	13.04	13.02	13.39	12.57
12500	12.41	13.36	13.01	13.00	13.36	12.41
15000	12.04	13.01	12.70	12.70	13.01	12.04
20000	11.27	12.34	12.10	12.10	12.33	11.27
25000	10.49	11.69	11.49	11.47	11.69	10.49
35000	8.95	10.46	10.19	10.18	10.46	8.95
45000	6.15	9.12	8.70	8.67	9.13	6.15
46850	5.21	-	-	-	-	5.21
50690	-	-	-	5.85	-	-
50720	-	-	5.85	-	-	-
51860	-	5.84	-	-	5.84	-
CMC LATTICE TYPE	36	32	33	34	35	31
LATTICE No.	1581	1700	1701	1702	1703	733

CORE OPERATING LIMITS REPORT

2.0 MINIMUM CRITICAL POWER RATIO (3/4.2.3)

2.1 Tech Spec REFERENCE:

Tech Spec 3.2.3.

2.2 DESCRIPTION:

a. Single Recirculation Loop Operation

The MCPR limit when in Single Recirculation Loop Operation is determined from Figure 2.2-1* plus 0.01, times the Kf factor determined from Figure 2.2-2.

b. Two Recirculation Loop Operation

The MCPR limit when in Dual Recirculation Loop Operation is determined from Figure 2.2-1* times the Kf factor determined from Figure 2.2-2.


c. Two Recirculation Loop Operation with Main Turbine Bypass Inoperable

The MCPR limit when in Dual Recirculation Loop Operation with the Main Turbine Bypass Inoperable (per Tech Spec 3.7.10) is determined from Figure 2.2-1* times the Kf factor determined from Figure 2.2-2.


d. Two Recirculation Loop Operation with End-of-Cycle Recirculation Pump Trip System Inoperable and/or a Postulated Slow Turbine Control Valve Closure Event

The MCPR limit when in Dual Recirculation Loop Operation with the End-of-Cycle Recirculation Pump Trip System (RPT) Inoperable (per Tech Spec 3.3.4.2) and/or one or more Turbine Control Valve Slow Closing is determined from Figure 2.2-1* times the Kf factor determined from Figure 2.2-2.


- * If, during Unit Coastdown, power operation exceeding the equilibrium power level is desired, then Figure 2.2-3 shall be used.

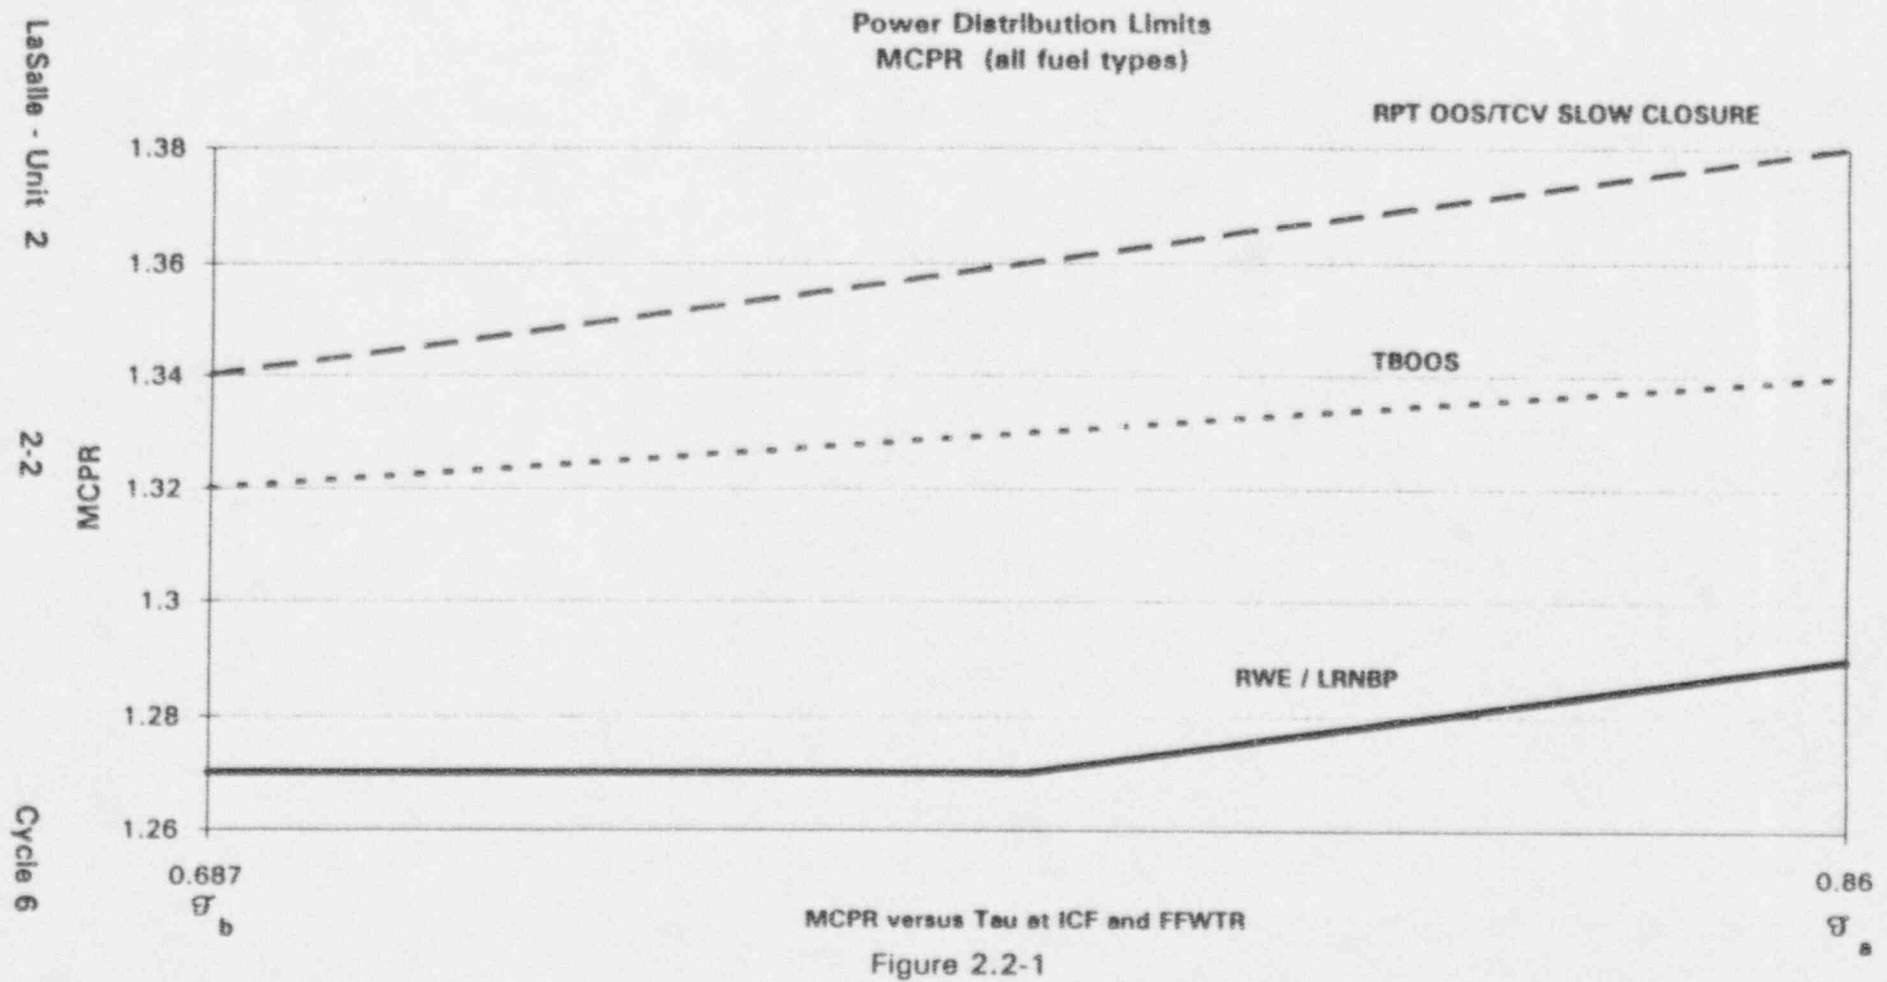

Kf FACTOR
Figure 2.2-2

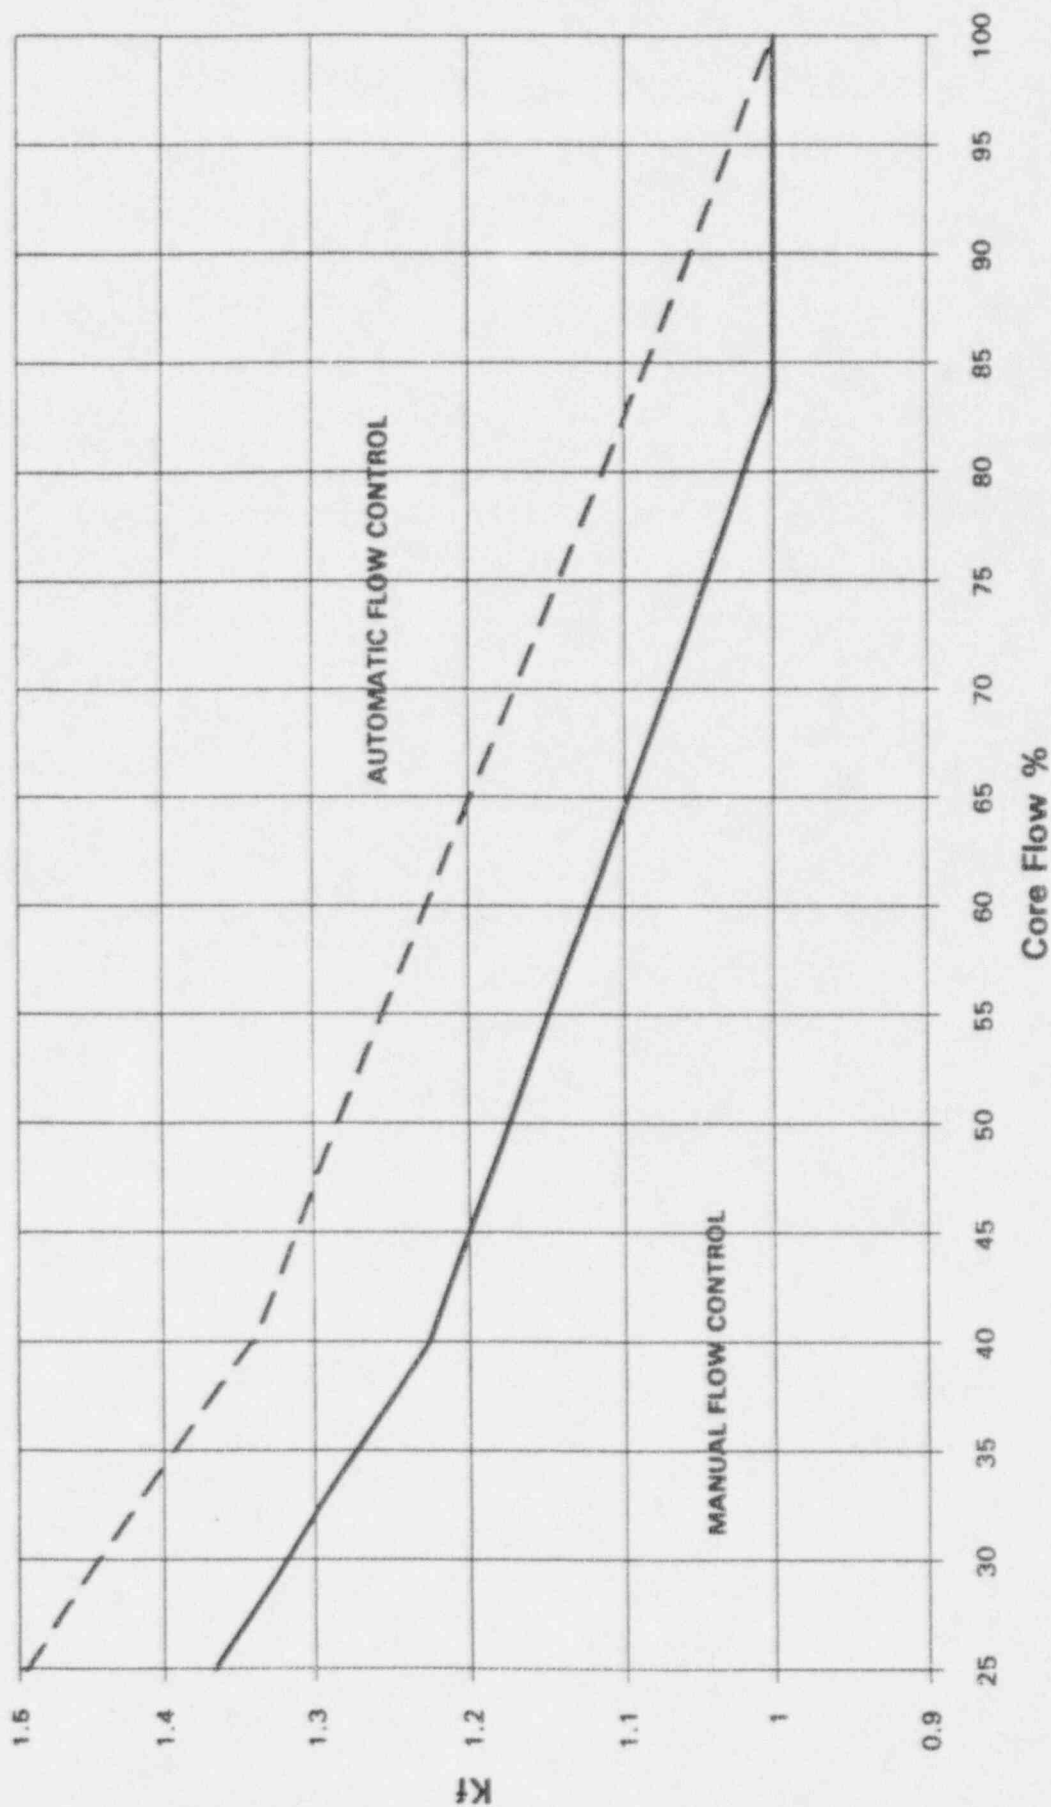

Power Distribution Limits
MCPR (all fuel types) During Coastdown

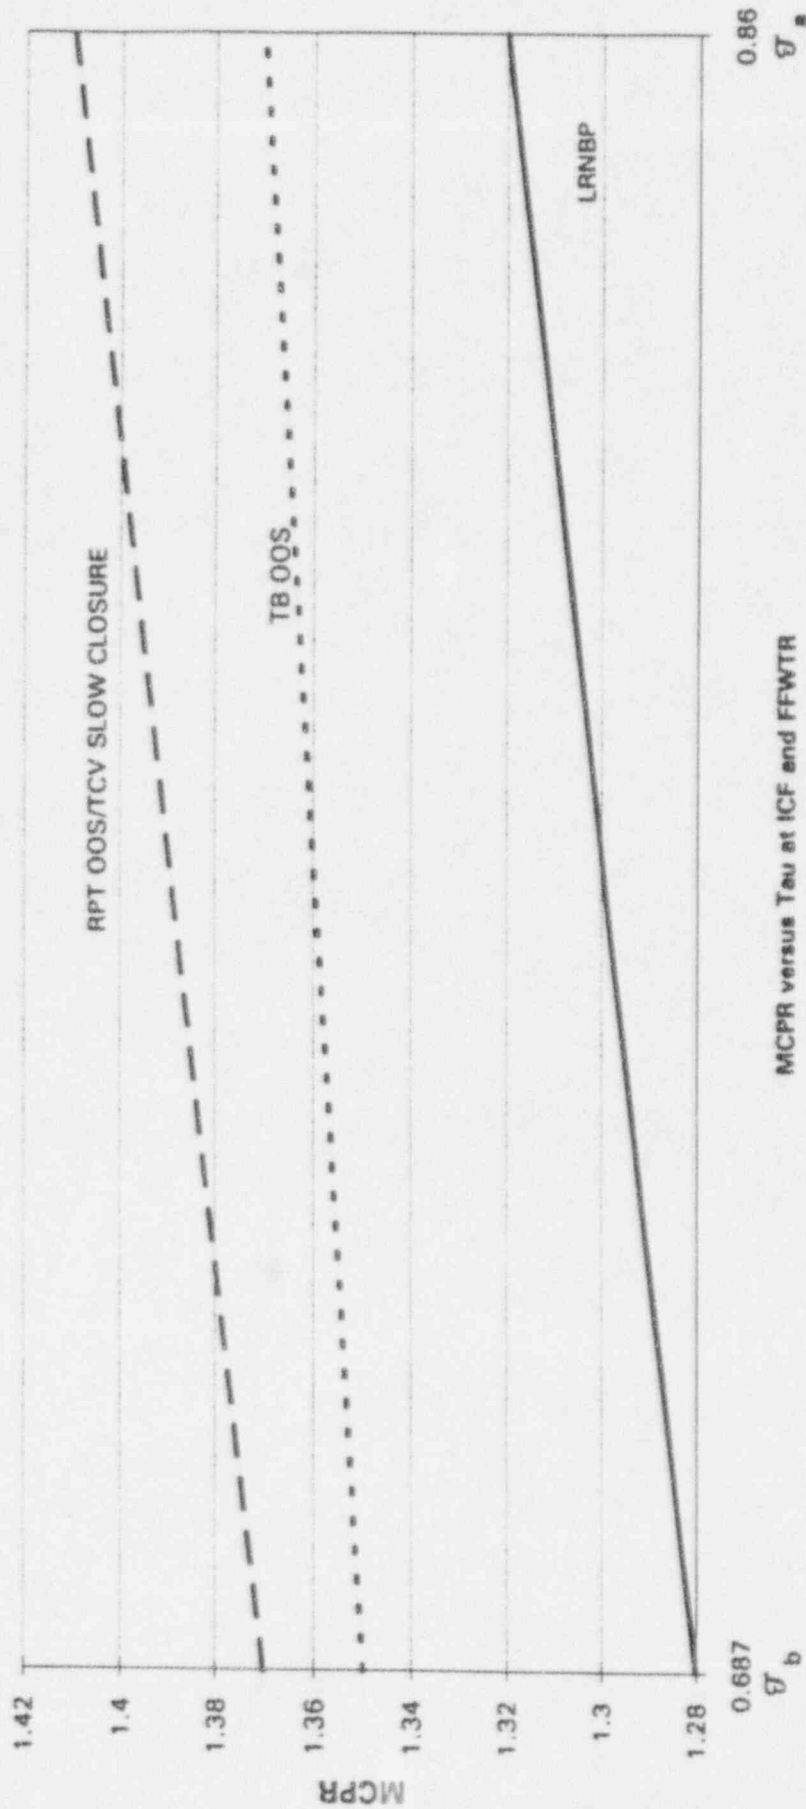

MCPR versus T_b at ICF and FFWR
Figure 2.2-3

CORE OPERATING LIMITS REPORT

3.0 LINEAR HEAT GENERATION RATE (3/4.2.4)

3.1 Tech Spec REFERENCE:

Tech Spec 3.2.4.

3.2 DESCRIPTION:

a. The LHGR limit is 14.4 kw/ft for fuel types:

1. BC300D
2. BC320C
3. P8CWB303-9GZ
4. P8CWB303-10GZ
5. P8CWB300-9GZ
6. P8CWB302-9GZ
7. P8CWB313-9GZ
8. P8CWB316-9GZ

CORE OPERATING LIMITS REPORT

4.0 CONTROL ROD WITHDRAWAL BLOCK INSTRUMENTATION (3/4.3.6)

4.1 Tech Spec REFERENCE:

Tech Spec Table 3.3.6-2.

4.2 DESCRIPTION:

- a. The Rod Block Monitor Upscale Instrumentation Setpoints are determined from the relationships shown in Table 4.2-1.

TABLE 4.2-1

CONTROL ROD WITHDRAWAL BLOCK INSTRUMENTATION SETPOINTS

<u>TRIP FUNCTION</u>	<u>TRIP SETPOINT</u>	<u>ALLOWABLE VALUE</u>
1.0 <u>ROD BLOCK MONITOR</u>		
A. <u>UPSCALE</u>		
1. Two Recirculation * Loop Operation	$\leq 0.66 W + 45 \%^{**}$	$\leq 0.66 W + 48 \%^{**}$
2. Single Recirculation * Loop Operation	$\leq 0.66 W + 39.7 \%^{**}$	$\leq 0.66 W + 42.7 \%^{**}$

* Clamped, with an allowable value not to exceed the allowable value for recirculation loop flow (W) of 100%.

** This setpoint may be lower and will still comply with the RWE Analysis. |