



5501 North State Route 2
Oak Harbor, Ohio 43449

Mark B. Bezilla
Vice President - Nuclear

419-321-7676
Fax: 419-321-7582

February 26, 2020
L-20-063

ATTN: Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001


SUBJECT:
Davis-Besse Nuclear Power Station, Unit No. 1
Docket No. 50-346, License No. NPF-3
Core Operating Limits Report, Cycle 21, Revision 3

Enclosed is Revision 3 to the Davis-Besse Nuclear Power Station, Unit No. 1 (DBNPS) Cycle 21 Core Operating Limits Report (COLR). A Cycle 21 license length extension evaluation concluded that Cycle 21 can be operated up to a licensed cycle length of 692 effective full power days (EFPD). The numerical value in section 1 of the COLR for the revised license length of 692 EFPD was updated from 690 EFPDs.

Submittal of this revision is in accordance with DBNPS Technical Specification 5.6.3, "CORE OPERATING LIMITS REPORT (COLR)."

There are no regulatory commitments contained in this letter. If there are any questions or if additional information is required, please contact Mr. Phil H. Lashley, Acting Manager, Nuclear Licensing and Regulatory Affairs, at (330) 315-6808.

Sincerely,

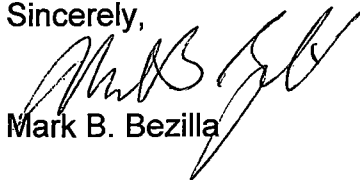

Mark B. Bezilla

Enclosure:
Cycle 21, Core Operating Limits Report, Revision 3

cc: NRC Region III Administrator
NRC Resident Inspector
NRR Project Manager
Utility Radiological Safety Board


ADD!
NRR

Enclosure
L-20-063

Cycle 21, Core Operating Limits Report, Revision 3

(28 pages follow)

FIRSTENERGY NUCLEAR OPERATING COMPANY
DAVIS-BESSE UNIT 1
CYCLE 21
CORE OPERATING LIMITS REPORT

Prepared by  2/15/20
D. B. Kelley

Reviewed by  2/17/2020
C. Glass

Approved by  2/18/20
J. D. Brown

1.0 Core Operating Limits

This CORE OPERATING LIMITS REPORT for DB-1 Cycle 21 has been prepared in accordance with the requirements of Technical Specification 5.6.3. The Core Operating Limits have been developed using the methodology provided in Reference 2.0 (1). The licensed length of Cycle 21 is 692 EFPDs.

The following cycle-specific core Operating Limits, Protective Limit and Flux - Δ Flux -Flow Reactor Protection System Allowable Values are included in this report:

1. SL 2.1.1.1 Reactor Core Safety Limits
2. LCO 3.1.1 SHUTDOWN MARGIN (SDM)
3. LCO 3.1.3 Moderator Temperature Coefficient (MTC)
4. LCO 3.1.7 Position Indicator Channels
5. LCO 3.1.8 PHYSICS TESTS Exceptions – MODE 1
6. LCO 3.1.9 PHYSICS TESTS Exceptions – MODE 2
7. LCO 3.2.1 Regulating Rod Insertion Limits
8. LCO 3.2.2 AXIAL POWER SHAPING ROD (APSR) Insertion Limits
9. LCO 3.2.3 AXIAL POWER IMBALANCE Operating Limits
10. LCO 3.2.4 QUADRANT POWER TILT (QPT)
11. LCO 3.2.5 Power Peaking Factors
12. LCO 3.3.1 Reactor Protection Systems (RPS) Instrumentation
Function 8: (Flux - Δ Flux – Flow) Allowable Values
13. LCO 3.9.1 Boron Concentration
14. TRM 8.1.3 Rod Program

2.0 References

- 1) BAW-10179P-A, Rev. 9, "Safety Criteria and Methodology for Acceptable Cycle Reload Analyses", November 2017.

Table of Contents


	<u>Page</u>
Reactor Core Safety Limits	
Figure 1 AXIAL POWER IMBALANCE Protective Limits Davis-Besse 1, Cycle 21	5
SHUTDOWN MARGIN (SDM)	
Table 1 Shutdown Margin Requirements for Davis-Besse, Cycle 21	6
Moderator Temperature Coefficient (MTC)	
Table 2 Moderator Temperature Coefficient Limit for Davis-Besse, Cycle 21	7
Position Indicator Channels	
Table 3 Absolute Position Indicator (API) / Relative Position Indicator (RPI) Agreement Limit for Davis-Besse, Cycle 21	8
Regulating Rod Insertion Limits	
Figure 2a Regulating Group Position Operating Limits 0 to 300 ± 10 EFPD, Four RC Pumps Davis-Besse 1, Cycle 21	9
Figure 2b Regulating Group Position Operating Limits After 300 ± 10 EFPD, Four RC Pumps Davis-Besse 1, Cycle 21	10
Figure 2c Regulating Group Position Operating Limits 0 to 300 ± 10 EFPD, Three RC Pumps Davis-Besse 1, Cycle 21	11
Figure 2d Regulating Group Position Operating Limits After 300 ± 10 EFPD, Three RC Pumps Davis-Besse 1, Cycle 21	12
AXIAL POWER SHAPING ROD (APSR) Insertion Limits	
Figure 3 APSR Position Operating Limits for Davis-Besse, Cycle 21	13
AXIAL POWER IMBALANCE Operating Limits	
Figure 4a AXIAL POWER IMBALANCE Operating Limits 0 to 200 ± 10 EFPD, Four RC Pumps Davis-Besse 1, Cycle 21	14
Figure 4b AXIAL POWER IMBALANCE Operating Limits 200 ± 10 EFPD to 450 ± 10 EFPD, Four RC Pumps Davis-Besse 1, Cycle 21	15
Figure 4c AXIAL POWER IMBALANCE Operating Limits 450 ± 10 EFPD to EOC, Four RC Pumps Davis-Besse 1, Cycle 21	16
Figure 4d AXIAL POWER IMBALANCE Operating Limits 0 to 200 ± 10 EFPD, Three RC Pumps Davis-Besse 1, Cycle 21	17

Table of Contents

	<u>Page</u>
Figure 4e AXIAL POWER IMBALANCE Operating Limits 200 \pm 10 EFPD to 450 \pm 10 EFPD, Three RC Pumps Davis-Besse 1, Cycle 21	18
Figure 4f AXIAL POWER IMBALANCE Operating Limits 450 \pm 10 EFPD to EOC, Three RC Pumps Davis-Besse 1, Cycle 21	19
QUADRANT POWER TILT (QPT)	
Table 4 QUADRANT POWER TILT Limits for Davis-Besse, Cycle 21	20
Power Peaking Factors	
Table 5 Power Peaking Factors - F_Q for Davis-Besse, Cycle 21	21
Table 6 Power Peaking Factors - $F_{\Delta H}^N$ for Davis-Besse, Cycle 21	23
Figure 5 Maximum Allowable Radial Peak for $F_{\Delta H}^N$ for Davis-Besse, Cycle 21	23
Table 7 Maximum Allowable Radial Peak for $F_{\Delta H}^N$ for Davis-Besse, Cycle 21	24
Reactor Protection System (RPS) Instrumentation	
Figure 6a Flux- Δ Flux-Flow (or Power/Imbalance/Flow) Allowable Values Davis-Besse 1, Cycle 21 Before EC 19-0137	25
Figure 6b Flux- Δ Flux-Flow (or Power/Imbalance/Flow) Allowable Values Davis-Besse 1, Cycle 21 After EC 19-0137	26
Boron Concentration	
Table 8 Refueling Boron Concentration Limit for Davis-Besse, Cycle 21	27
Rod Program	
Figure 7 Control Rod Core Locations and Group Assignments for Davis-Besse, Cycle 21	28

Figure 1 AXIAL POWER IMBALANCE Protective Limits
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 2.1.1.1

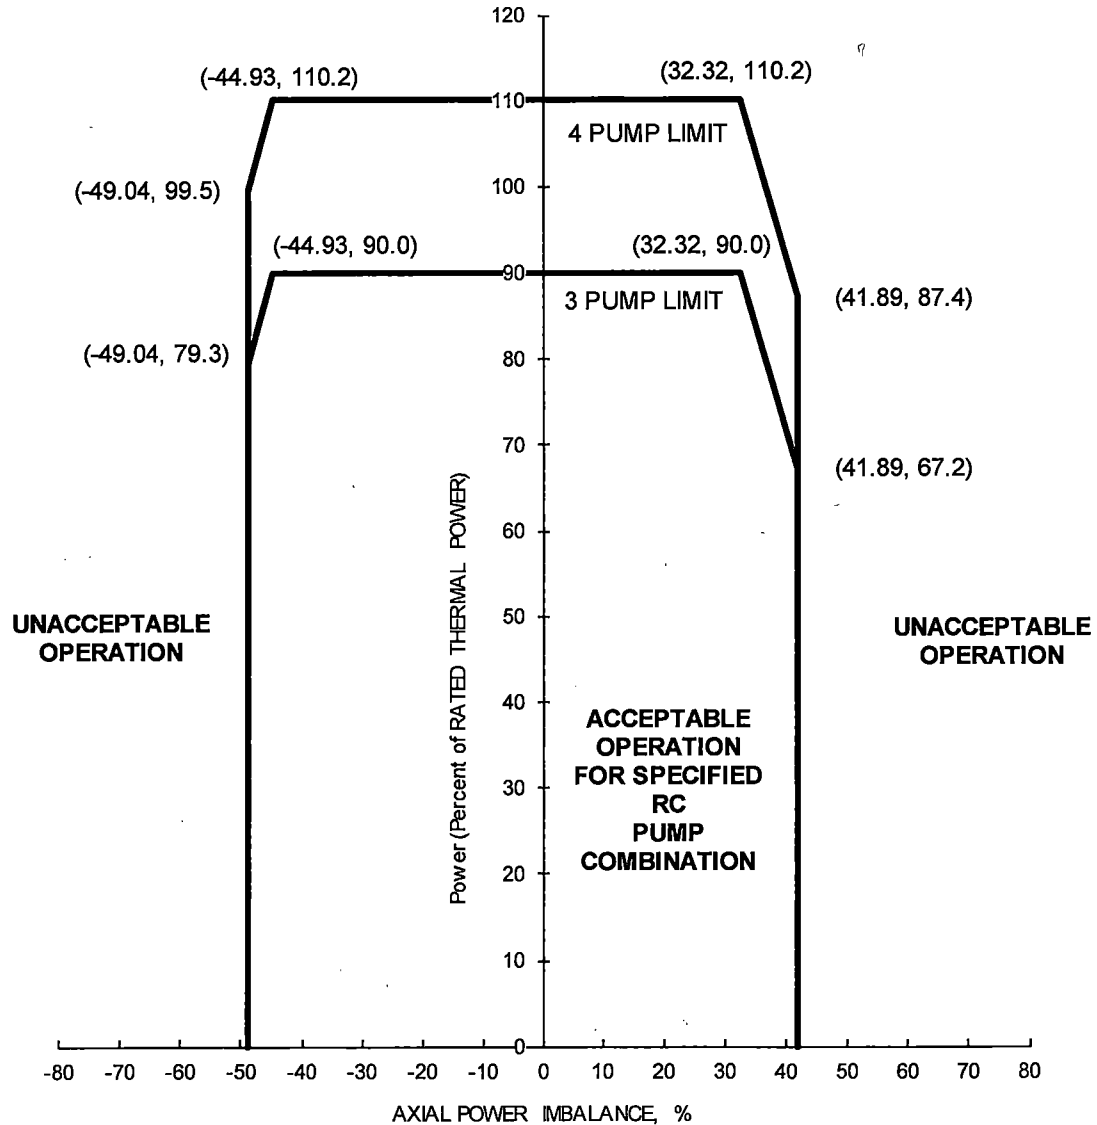

Pumps Operating	Reactor Coolant Flow, gpm	Required Measured Flow to Ensure Compliance, gpm
4	380,000	389,500
3	283,860	290,957

4 Pump		
Power Level	Negative Imbalance	Positive Imbalance
110.2	-44.93	32.32
99.5	-49.04	—
87.4	-49.04	41.89
0.0	-49.04	41.89

3 Pump		
Power Level	Negative Imbalance	Positive Imbalance
90.0	-44.93	32.32
79.3	-49.04	—
67.2	-49.04	41.89
0.0	-49.04	41.89

Table 1 Shutdown Margin Requirements for Davis-Besse, Cycle 21

Verify SHUTDOWN MARGIN per the table below.

APPLICABILITY	REQUIRED SHUTDOWN MARGIN	TECHNICAL SPECIFICATIONS REFERENCE
MODE 1 *	$\geq 1 \% \Delta k/k$ ***	3.1.4, 3.1.5
MODE 2 *	$\geq 1 \% \Delta k/k$	3.1.4, 3.1.5, 3.3.9
MODE 3	$\geq 1 \% \Delta k/k$	3.1.1, 3.3.9
MODE 4	$\geq 1 \% \Delta k/k$	3.1.1, 3.3.9
MODE 5	$\geq 1 \% \Delta k/k$	3.1.1, 3.3.9
MODE 1 PHYSICS TESTS Exceptions **	$\geq 1 \% \Delta k/k$	3.1.8
MODE 2 PHYSICS TESTS Exceptions	$\geq 1 \% \Delta k/k$	3.1.9

* The required Shutdown Margin capability of $1 \% \Delta k/k$ in MODE 1 and MODE 2 is preserved by the Regulating Rod Insertion Limits specified in Figures 2a through 2d as required by Technical Specification 3.2.1.

** Entry into Mode 1 Physics Tests Exceptions is not supported by existing analyses. For example, Regulating Rod Shutdown Margin Insertion Limits assumptions may not be met and as such requires actual shutdown margin to be $\geq 1 \% \Delta k/k$ via alternate verification or calculation.

***For the period from 0 to 300 EFPD and for power levels 60 %FP and above, rod insertion limits are established that reserve an additional $0.5 \% \Delta k/k$ required rod worth to accommodate the implementation of an update to the SBLOCA model.

Table 2 Moderator Temperature Coefficient Limit for Davis-Besse, Cycle 21

These limits are referred to by Technical Specifications 3.1.3

1. Lower Limit:

MTC at HFP $\geq -3.775 \times 10^{-4} \Delta k/k/^{\circ}F$ (-37.75 pcm/ $^{\circ}F$)

2. The following Upper Limits may not be exceeded without prior NRC approval:

MTC $< 0.9 \times 10^{-4} \Delta k/k/^{\circ}F$ when Thermal Power $< 95\%$ RTP

MTC $< 0.0 \times 10^{-4} \Delta k/k/^{\circ}F$ when Thermal Power $\geq 95\%$ RTP

3. The following Upper Limits may not be exceeded for operation in Modes 1 and 2:

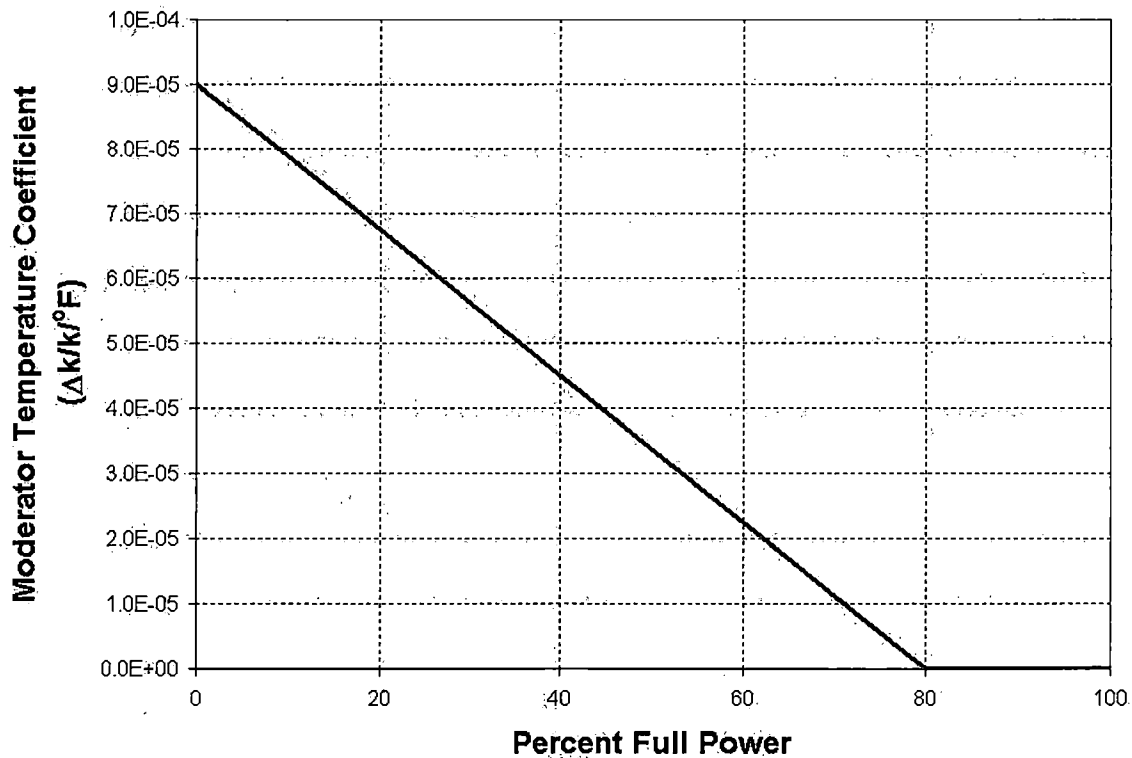



Table 3 Absolute Position Indicator (API) / Relative Position Indicator (RPI)
Agreement Limit for Davis-Besse, Cycle 21

This limit is referred to by Technical Specifications 3.1.7

The absolute position indicator channels and the relative position indicator channels agree within 3.00%.

Figure 2a Regulating Group Position Operating Limits
0 to 300 ± 10 EFPD, Four RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specifications 3.2.1

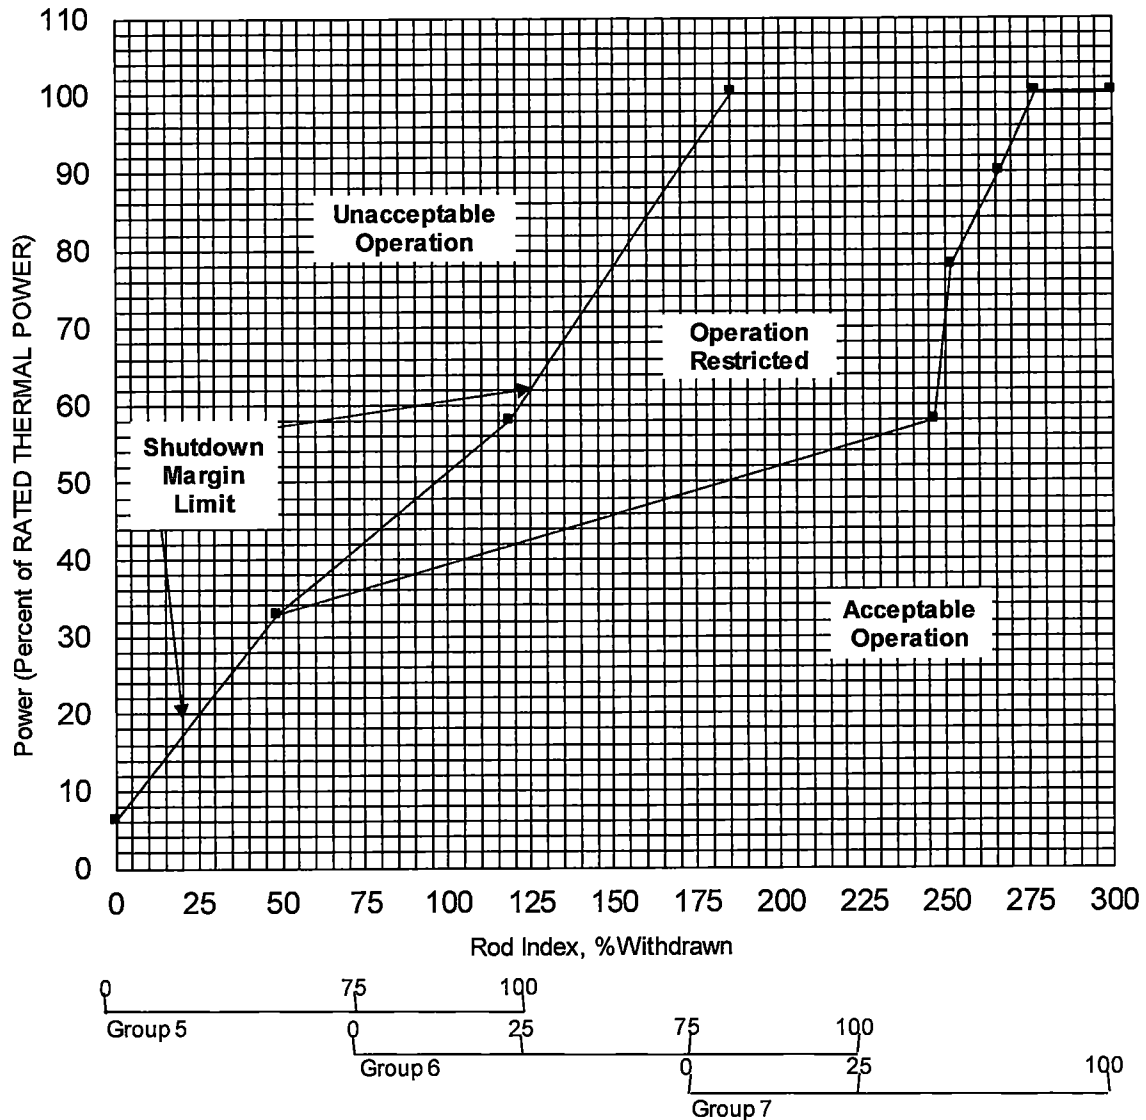

Note 1: A Rod Group overlap of 25 +/- 5% between sequential withdrawn groups 5 and 6, and 6 and 7, shall be maintained.

Note 2: Instrument error is accounted for in these Operating Limits.


Note 3: Maximum plotted power level is 100.37 %RTP.

SDM Limit	
Power	RI
100.37	185.70
58.00	118.50
33.00	48.50
6.30	0.00

RI Limit	
Power	RI
100.37	300.00
100.37	277.40
90.00	266.50
78.00	251.50
58.00	246.50
33.00	48.50
6.30	0.00

Figure 2b Regulating Group Position Operating Limits
After 300 ±10 EFPD, Four RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specifications 3.2.1

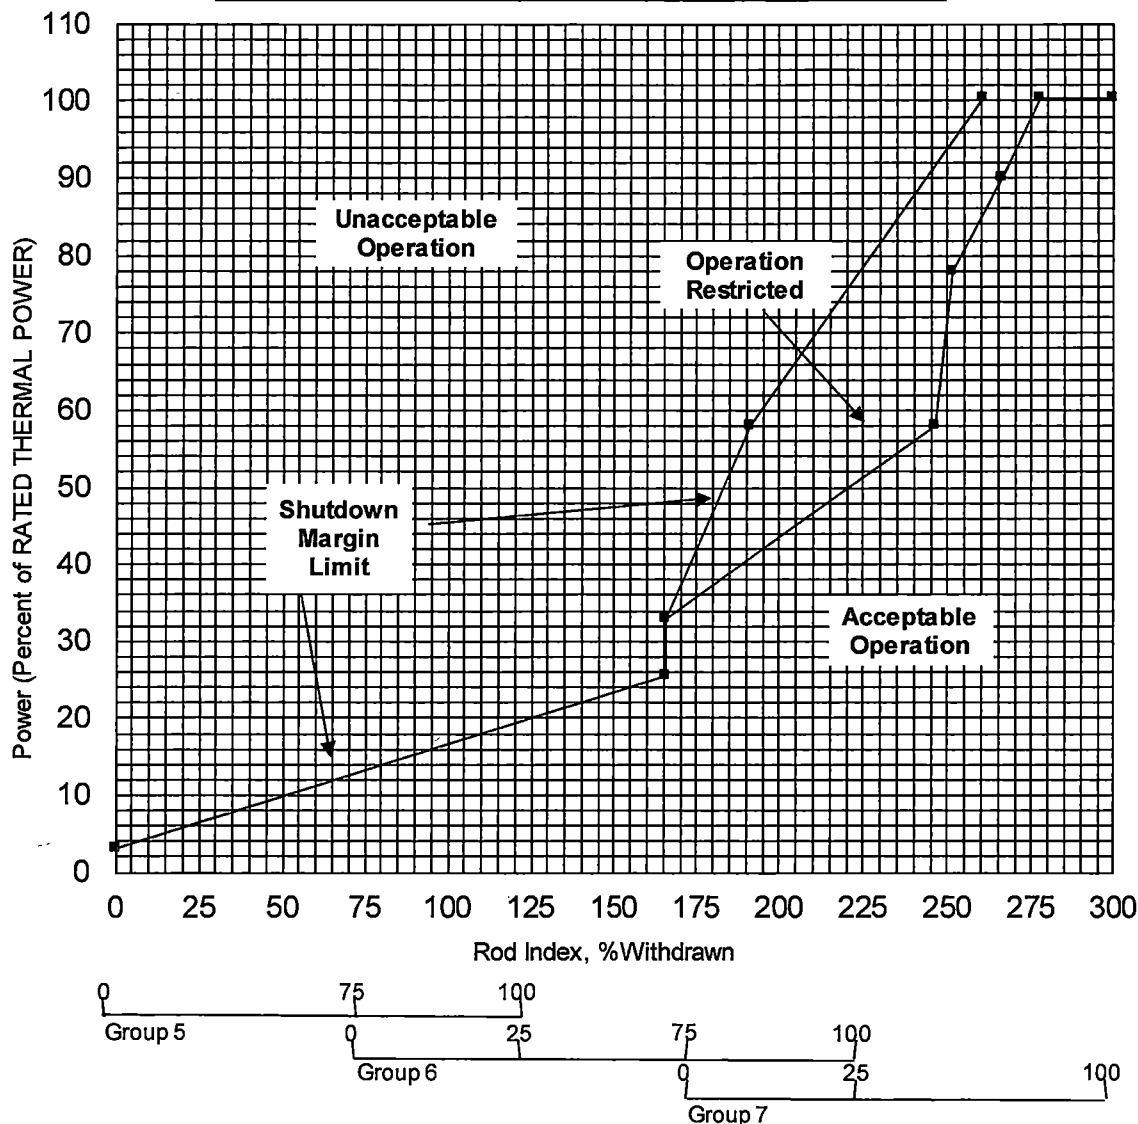

Note 1: A Rod Group overlap of 25 ± 5% between sequential withdrawn groups 5 and 6, and 6 and 7, shall be maintained.

Note 2: Instrument error is accounted for in these Operating Limits.


Note 3: Maximum plotted power level is 100.37 %RTP.

SDM Limit	
Power	RI
100.37	260.80
58.00	191.50
33.00	165.50
25.50	165.50
3.00	0.00

RI Limit	
Power	RI
100.37	300.00
100.37	277.40
90.00	266.50
78.00	251.50
58.00	246.50
33.00	165.50
25.50	165.50
3.00	0.00

Figure 2c Regulating Group Position Operating Limits
0 to 300 ± 10 EFPD, Three RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specifications 3.2.1

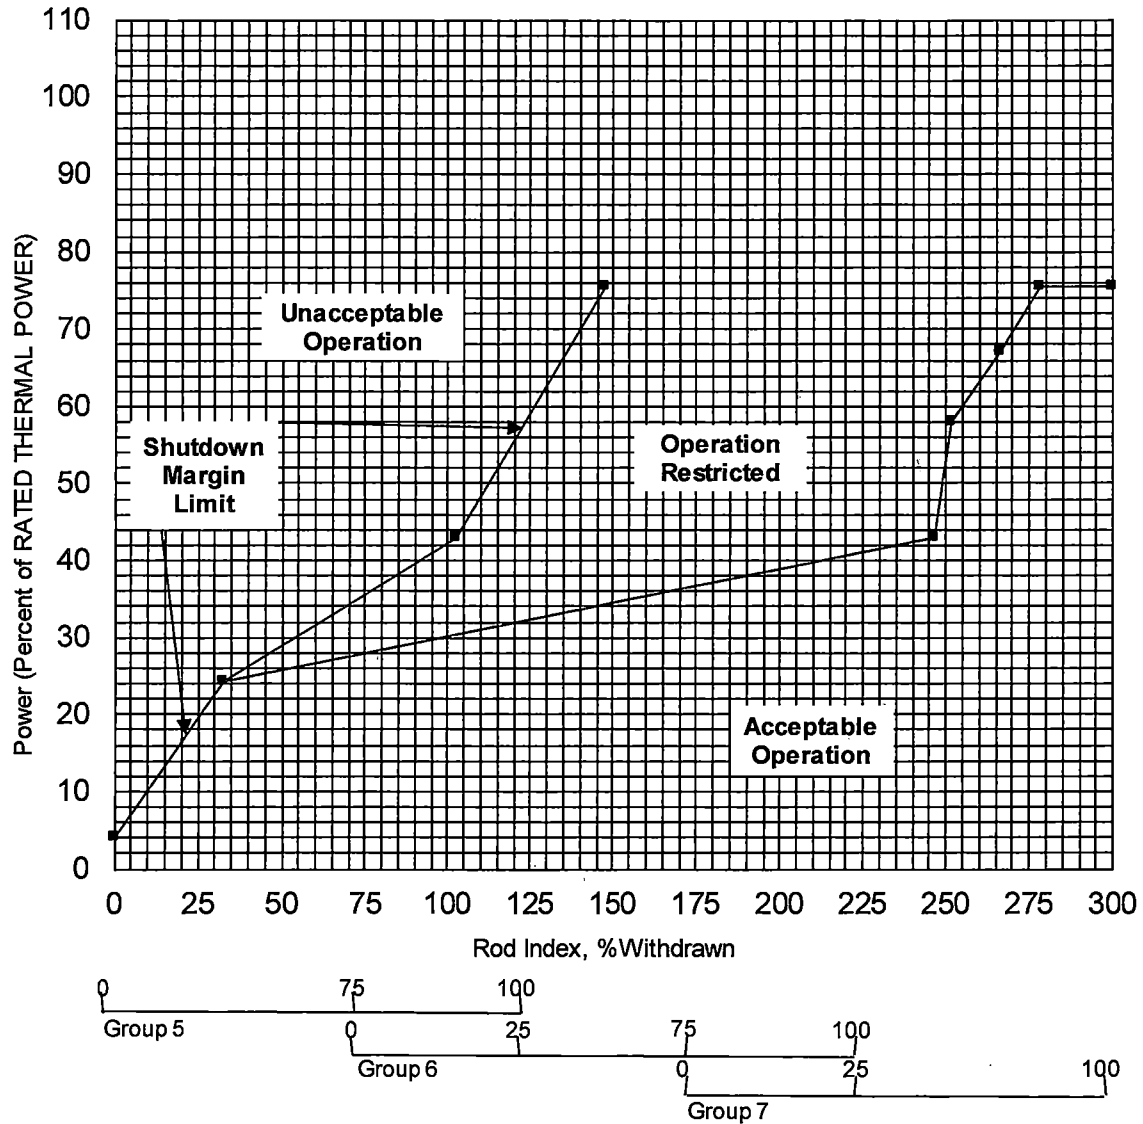

Note 1: A Rod Group overlap of 25 \pm 5% between sequential withdrawn groups 5 and 6, and 6 and 7, shall be maintained.

Note 2: Instrument error is accounted for in these Operating Limits.


Note 3: Maximum plotted power level is 75.37 %RTP.

SDM Limit	
Power	RI
75.37	147.30
43.10	102.50
24.20	32.50
4.00	0.00

RI Limit	
Power	RI
75.37	300.00
75.37	278.10
67.00	266.50
58.00	251.50
43.00	246.50
24.20	32.50
4.00	0.00

Figure 2d Regulating Group Position Operating Limits
After 300 ± 10 EFPD, Three RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specifications 3.2.1

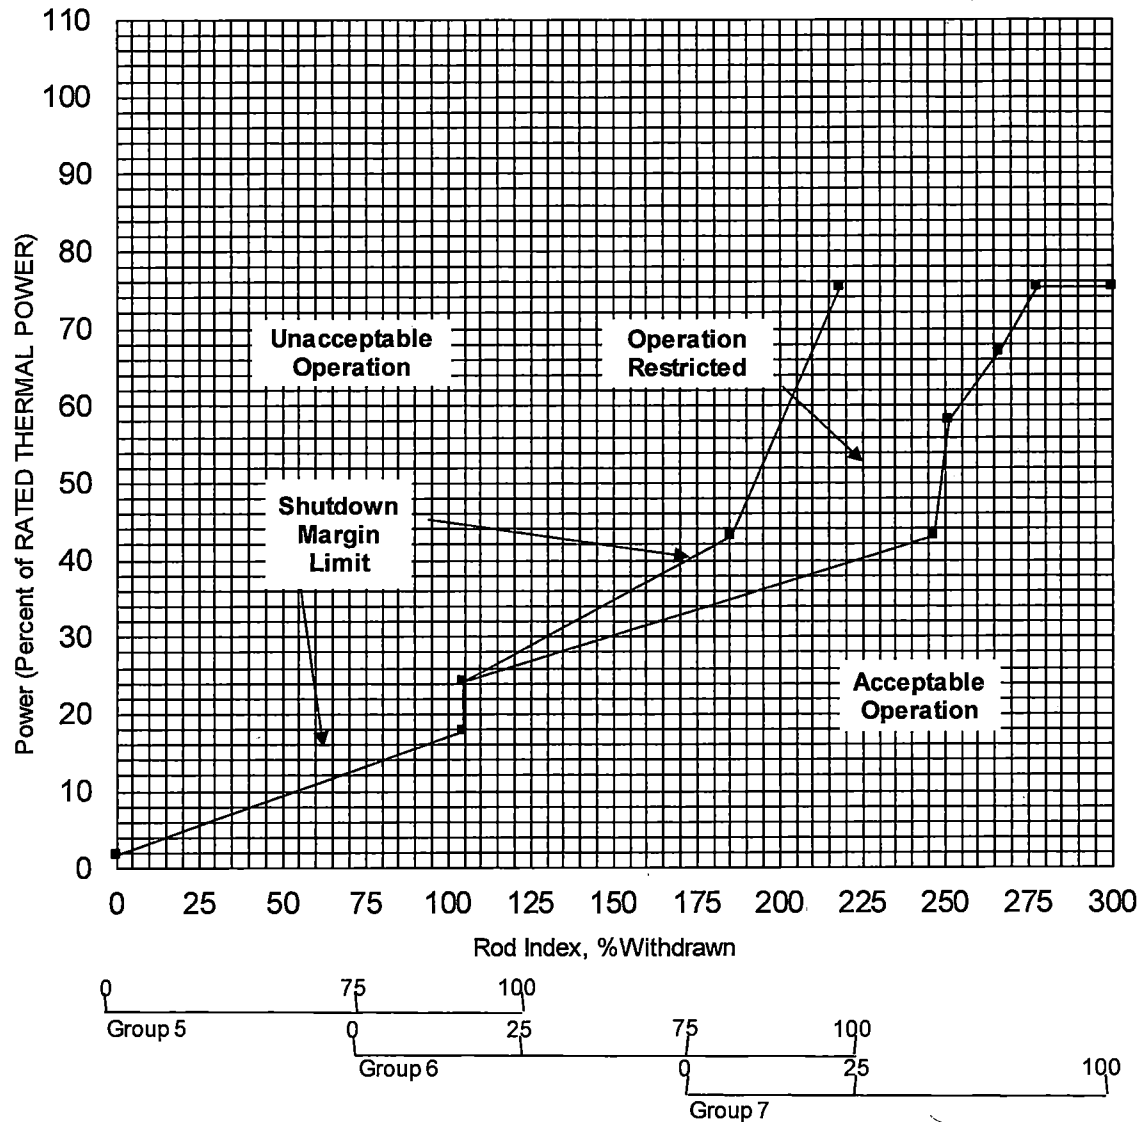

Note 1: A Rod Group overlap of $25 \pm 5\%$ between sequential withdrawn groups 5 and 6, and 6 and 7, shall be maintained.

Note 2: Instrument error is accounted for in these Operating Limits.

Note 3: Maximum plotted power level is 75.37 %RTP.

SDM Limit	
Power	RI
75.37	218.50
43.10	185.50
24.20	104.50
17.70	104.50
1.90	0.00

RI Limit	
Power	RI
75.37	300.00
75.37	278.10
67.00	266.50
58.00	251.50
43.00	246.50
24.20	104.50
17.70	104.50
1.90	0.00

Figure 3 APSR Position Operating Limits for Davis-Besse, Cycle 21

This Figure is referred to by Technical Specifications 3.2.2

**Before APSR Pull: 0 EFPD to 630 ± 10 EFPD,
Three or Four RC pumps operation***

Lower Limit: 0 %WD

Upper Limit: 100 %WD

**After APSR Pull: 630 ± 10 EFPD to End-of-Cycle
Three or Four RC pumps operation***


Insertion Prohibited (maintain $\geq 99\%$ WD) **

* Power restricted to 75.37% for 3-pump operation, however, steam generator analyses limits power to 73.46 %RTP.

** Reinsertion is allowed only during the end of cycle shutdown when the reactor power is equal to, or less than, 30%RTP.

Figure 4a AXIAL POWER IMBALANCE Operating Limits
0 to 200 \pm 10 EFPD, Four RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 3.2.3

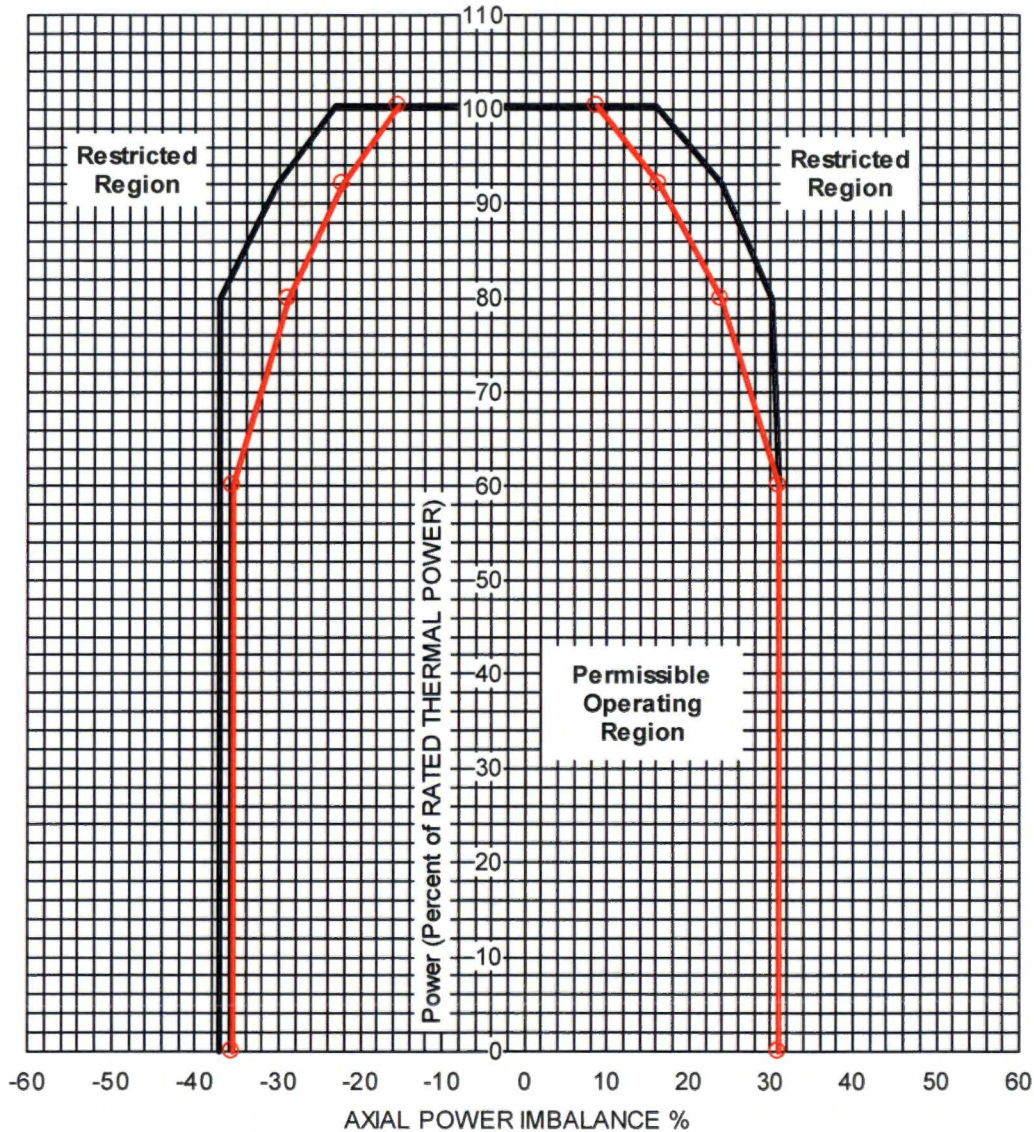

Note 1: Instrument error is accounted for in these Operating Limits.

Note 2: The Excore Imbalance Operating Limits are available for use when the Full Incore system is non-functional.

Note 3: Maximum plotted power level is 100.37 %RTP.

LEGEND
FULL INCORE

EXCORE




Full Incore		
Power	Negative Imbalance	Positive Imbalance
100.37	-23.17	15.98
92.00	-30.11	23.90
80.00	-37.00	30.06
60.00	-37.00	31.00
0.00	-37.00	31.00

Excore		
Power	Negative Imbalance	Positive Imbalance
100.37	-15.42	8.69
92.00	-22.16	16.34
80.00	-28.94	23.96
60.00	-35.48	31.00
0.00	-35.48	31.00

Figure 4b AXIAL POWER IMBALANCE Operating Limits
200 ± 10 EFPD to 450 ± 10 EFPD, Four RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 3.2.3

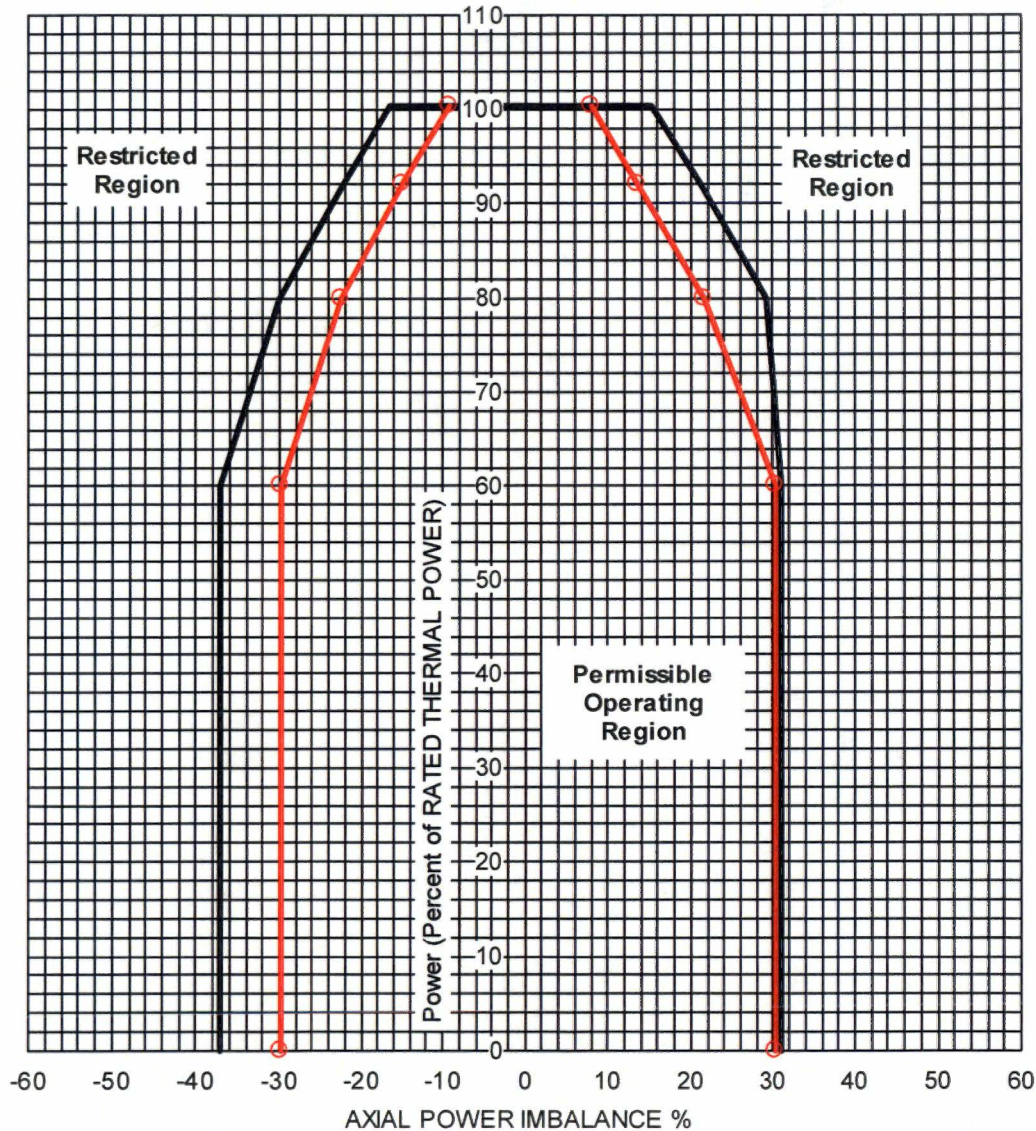

Note 1: Instrument error is accounted for in these Operating Limits.

Note 2: The Excore Imbalance Operating Limits are available for use when the Full Incore system is non-functional.

Note 3: Maximum plotted power level is 100.37 %RTP.

LEGEND
FULL INCORE


EXCORE

Full Incore		
Power	Negative Imbalance	Positive Imbalance
100.37	-16.42	15.27
92.00	-22.21	21.08
80.00	-29.99	29.27
60.00	-37.00	31.00
0.00	-37.00	31.00

Excore		
Power	Negative Imbalance	Positive Imbalance
100.37	-9.10	8.01
92.00	-14.75	13.69
80.00	-22.36	21.69
60.00	-29.81	30.26
0.00	-29.81	30.26

Figure 4c AXIAL POWER IMBALANCE Operating Limits
450 ± 10 EFPD to EOC, Four RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 3.2.3

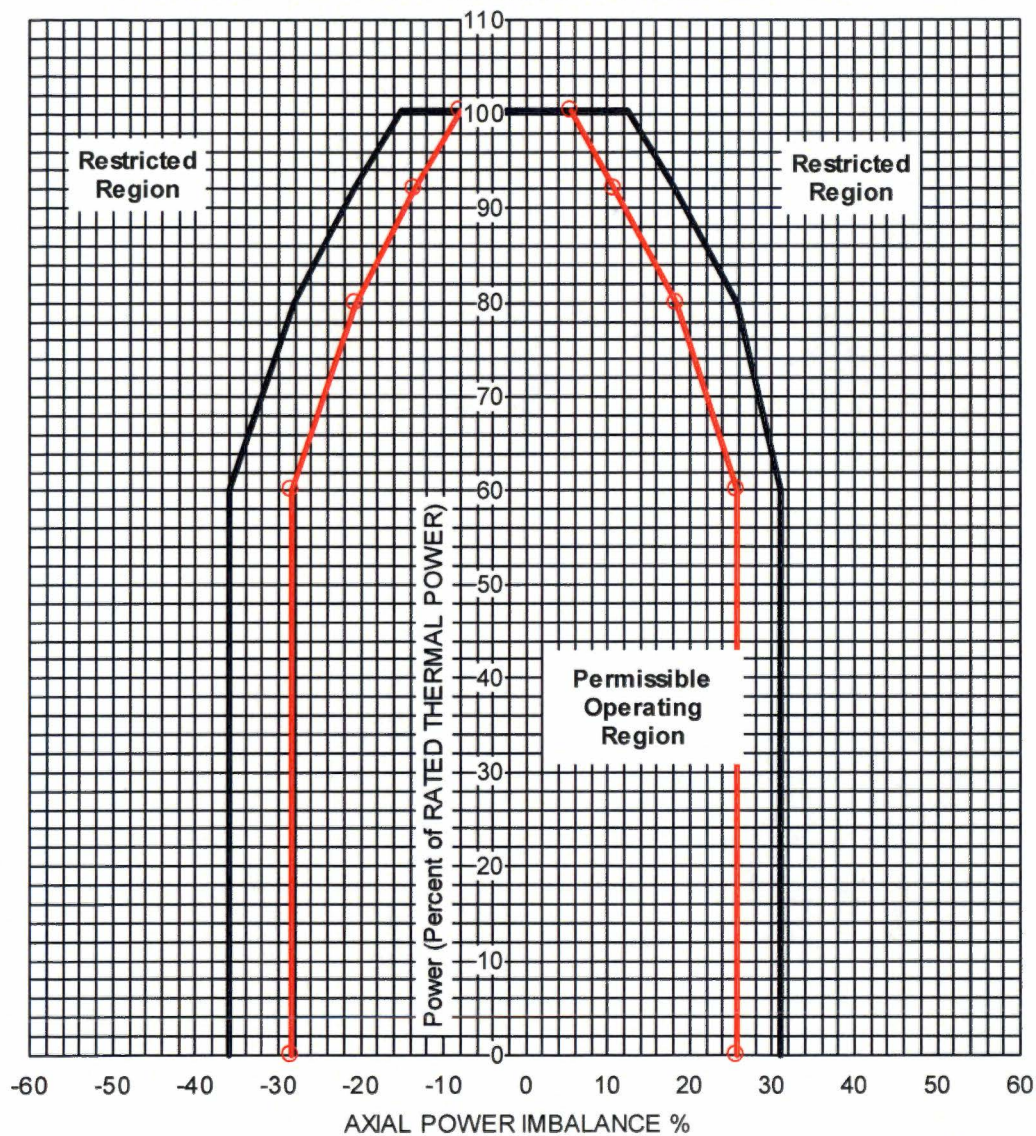

Note 1: Instrument error is accounted for in these Operating Limits.

Note 2: The Excore Imbalance Operating Limits are available for use when the Full Incore system is non-functional.

Note 3: Maximum plotted power level is 100.37 %RTP.

LEGEND
FULL INCORE


EXCORE

Full Incore		
Power	Negative Imbalance	Positive Imbalance
100.37	-15.18	12.57
92.00	-20.88	18.17
80.00	-28.20	25.71
60.00	-35.88	31.00
0.00	-35.88	31.00

Excore		
Power	Negative Imbalance	Positive Imbalance
100.37	-7.93	5.49
92.00	-13.50	10.96
80.00	-20.68	18.35
60.00	-28.35	25.80
0.00	-28.35	25.80

Figure 4d AXIAL POWER IMBALANCE Operating Limits
0 to 200 \pm 10 EFPD, Three RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 3.2.3

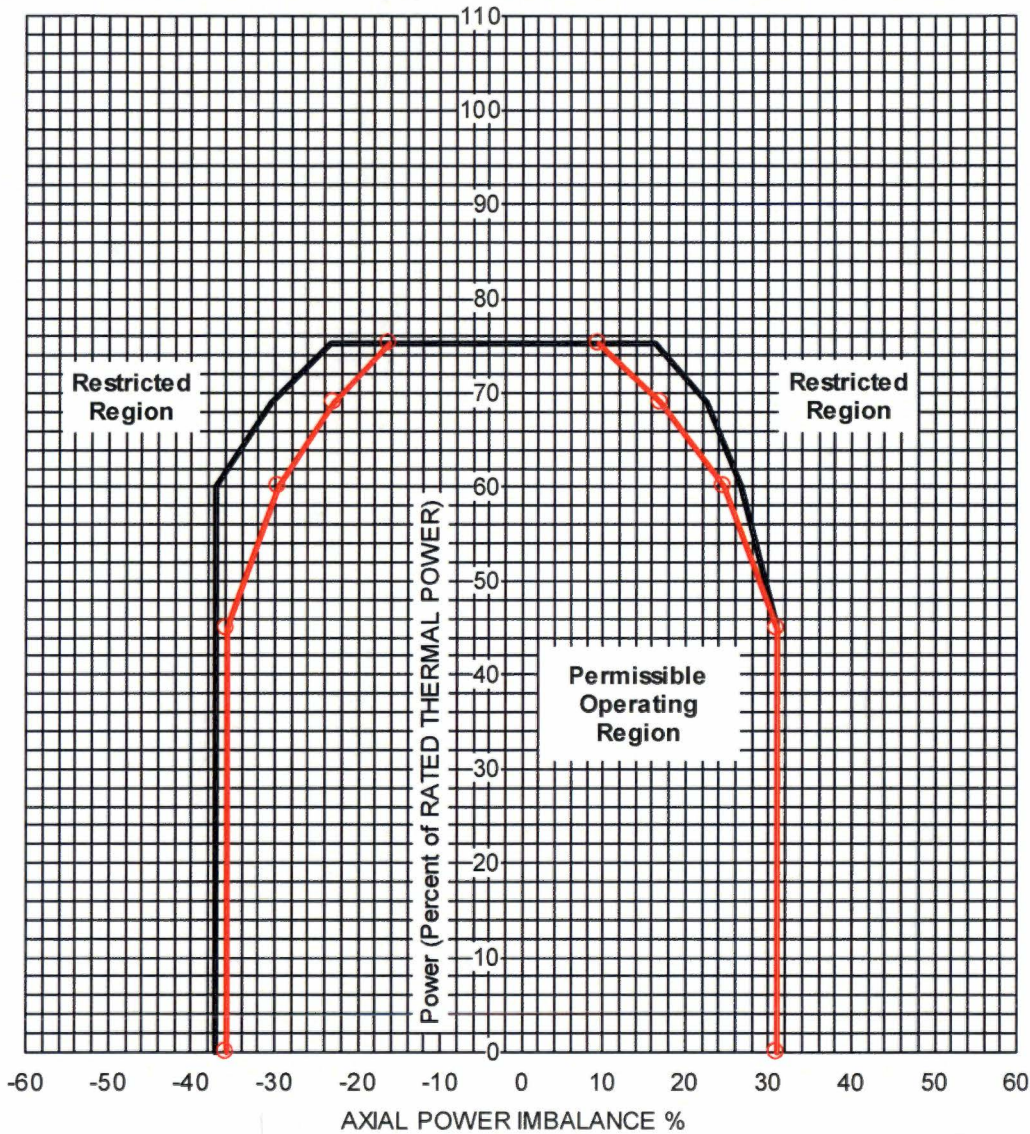

Note 1: Instrument error is accounted for in these Operating Limits.

Note 2: The ExcORE Imbalance Operating Limits are available for use when the Full Incore system is non-functional.

Note 3: Maximum plotted power level is 75.37 %RTP.

LEGEND
FULL INCORE


EXCURE

Full Incore		
Power	Negative Imbalance	Positive Imbalance
75.37	-23.45	16.27
69.00	-30.38	22.45
60.00	-37.00	26.65
45.00	-37.00	31.00
0.00	-37.00	31.00

ExcORE		
Power	Negative Imbalance	Positive Imbalance
75.37	-16.29	9.56
69.00	-22.93	17.11
60.00	-29.55	24.57
45.00	-35.80	31.00
0.00	-35.80	31.00

Figure 4e AXIAL POWER IMBALANCE Operating Limits
200 ± 10 EFPD to 450 ± 10 EFPD, Three RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 3.2.3

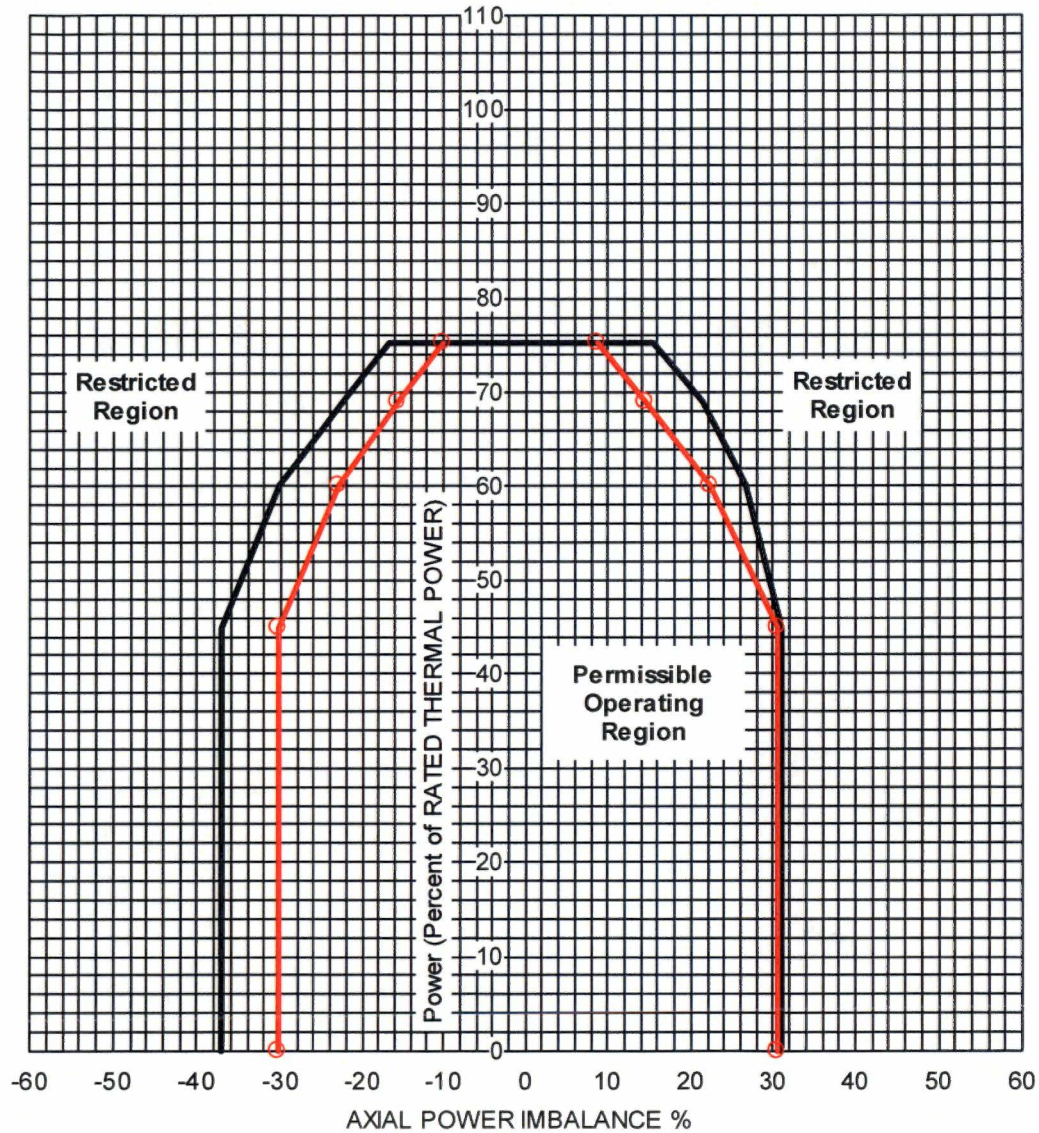

Note 1: Instrument error is accounted for in these Operating Limits.

Note 2: The Excore Imbalance Operating Limits are available for use when the Full Incore system is non-functional.

Note 3: Maximum plotted power level is 75.37 %RTP.

LEGEND
FULL INCORE


EXCORE

Full Incore		
Power	Negative Imbalance	Positive Imbalance
75.37	-16.71	15.55
69.00	-22.48	21.34
60.00	-30.22	26.65
45.00	-37.00	31.00
0.00	-37.00	31.00

Excore		
Power	Negative Imbalance	Positive Imbalance
75.37	-9.97	8.89
69.00	-15.53	14.46
60.00	-22.97	22.30
45.00	-30.13	30.57
0.00	-30.13	30.57

Figure 4f AXIAL POWER IMBALANCE Operating Limits
450 ± 10 EFPD to EOC, Three RC Pumps
Davis-Besse 1, Cycle 21

This Figure is referred to by Technical Specification 3.2.3

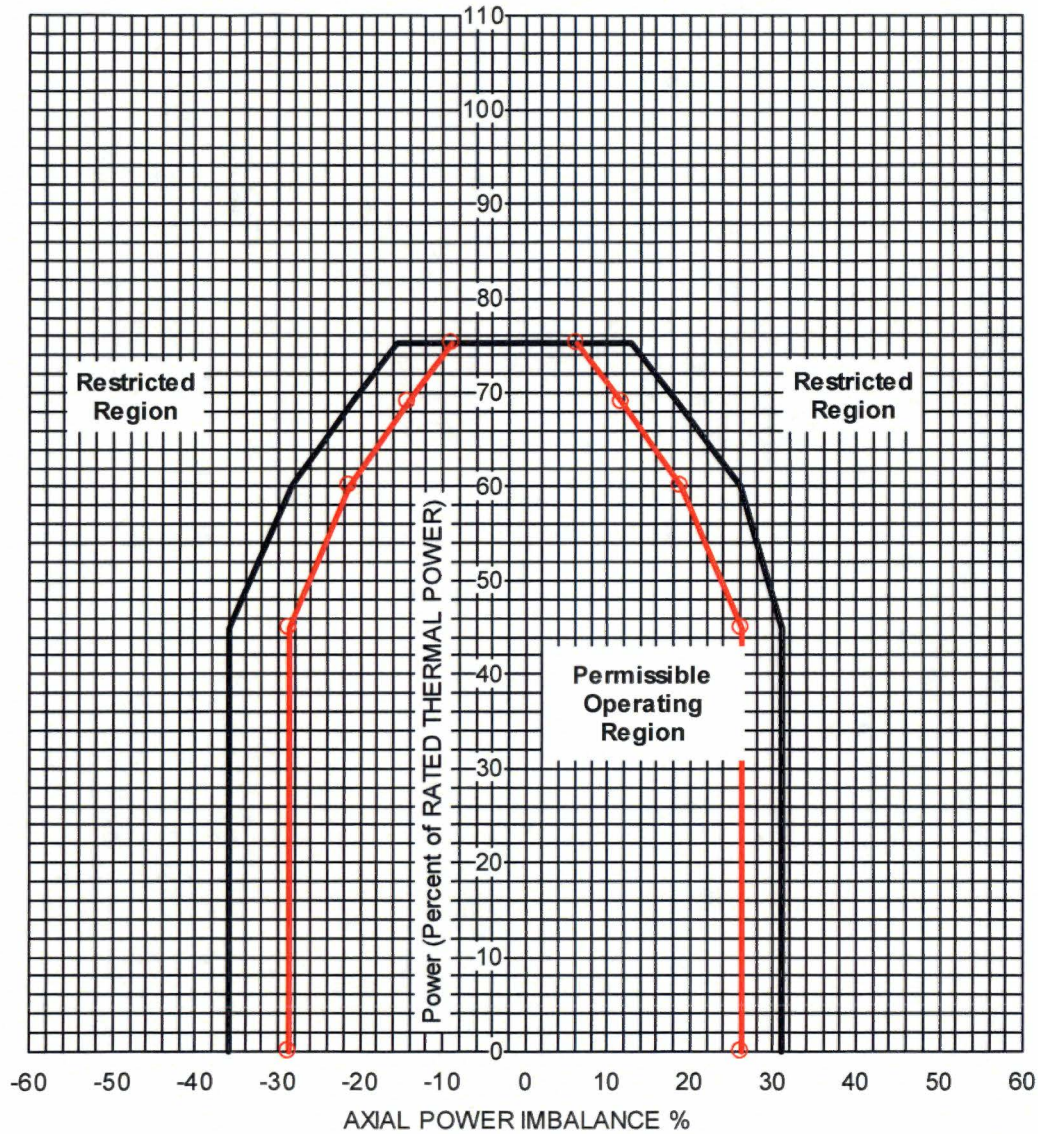

Note 1: Instrument error is accounted for in these Operating Limits.

Note 2: The Excore Imbalance Operating Limits are available for use when the Full Incore system is non-functional.

Note 3: Maximum plotted power level is 75.37 %RTP.

LEGEND
FULL INCORE

EXCORE



Full Incore		
Power	Negative Imbalance	Positive Imbalance
75.37	-15.47	12.86
69.00	-21.14	18.44
60.00	-28.42	25.94
45.00	-36.05	31.00
0.00	-36.05	31.00

Excore		
Power	Negative Imbalance	Positive Imbalance
75.37	-8.80	6.36
69.00	-14.27	11.74
60.00	-21.29	18.97
45.00	-28.66	26.12
0.00	-28.66	26.12

Table 4 QUADRANT POWER TILT Limits for Davis-Besse, Cycle 21

This Table is referred to by Technical Specifications 3.2.4

QUADRANT POWER TILT as measured by:	From 0 EFPD to EOC			
	Steady-state Limit for THERMAL POWER \leq 60% (%)	Steady-state Limit for THERMAL POWER >60% (%)	Transient Limit (%)	Maximum Limit (%)
Symmetric Incore Detector System	7.90	6.23	10.03	20.00
Minimum Incore Detector System with no dropped rod*	3.84	2.65	4.40	20.00
Minimum Incore Detector System with a dropped rod*	3.35	2.32	4.40	20.00

* These operating limits are based on the condition that no individual long emitter detector affecting the Minimum Incore Detector System tilt calculation exceeds 73% sensitivity depletion, which is the case for Cycle 21.

Table 5 Power Peaking Factors - F_Q for Davis-Besse, Cycle 21

This Table is referred to by Technical Specifications 3.2.5

Heat Flux Hot Channel Factor F_Q

F_Q shall be limited by the following relationships:

$$F_Q \leq \text{LHR}^{\text{allow}} (\text{Bu}) / [\text{LHR}^{\text{avg}} * P] \text{ (for } P \leq 1.0)$$

$\text{LHR}^{\text{allow}} (\text{Bu})$ = See the following tables

LHR^{avg} = 6.4265 kW/ft at 2817 MWt for all fuel

P = ratio of THERMAL POWER / RATED THERMAL POWER (current fraction of power)

Bu = fuel burnup (MWd/mtU)

Note: The measured F_Q shall be increased by 1.4% to account for manufacturing tolerances and further increased by 7.5% to account for measurement uncertainty before comparing to the limits. The core monitoring system computer-generated F_Q values are augmented by the required uncertainties.

UO₂ Fuel (Mark-B-HTP) – All Batches except Batch 23A $\text{LHR}^{\text{ALLOW}}$ kW/ft^(a)

	0	34,000	62,000
<u>Core Elevation (ft)</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>
0	17.35	14.95	10.85
2.506	17.35	14.95	10.85
4.264	17.25	14.85	10.85
6.021	16.8	14.8	11.1
7.779	17.0	14.7	11.1
9.536	16.2	14.3	11.1
12.000	15.4	13.5	10.4

^(a) Linear interpolation for allowable LHR between specified burnup points is valid for these tables.

Table 5 (continued)

UO₂ Fuel (Mark-B-HTP) – Batch 23A LHR^{ALLOW} kW/ft^(a)

	0	34,000
<u>Core Elevation (ft)</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>
0	16.95	14.95
2.506	16.95	14.95
4.264	16.85	14.85
6.021	16.4	14.8
7.779	16.6	14.7
9.536	15.8	14.3
12.000	15.0	13.5

4 wt% Gad Fuel (Mark-B-HTP) – All Batches LHR^{ALLOW} kW/ft^(a)

	0	34,000	62,000
<u>Core Elevation (ft)</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>
0	15.55	13.45	9.55
2.506	15.55	13.45	9.55
4.264	15.45	13.25	9.55
6.021	15.1	13.2	9.8
7.779	15.3	13.2	9.8
9.536	14.6	12.8	9.8
12.000	13.8	12.1	9.2

8 wt% Gad Fuel (Mark-B-HTP) – All Batches LHR^{ALLOW} kW/ft^(a)

	0	34,000	62,000
<u>Core Elevation (ft)</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>	<u>MWd/mtU</u>
0	14.65	12.65	8.75
2.506	14.65	12.65	8.75
4.264	14.55	12.65	8.75
6.021	14.2	12.5	9.0
7.779	14.4	12.5	9.0
9.536	13.7	12.2	9.0
12.000	13.0	11.5	8.4

^(a) Linear interpolation for allowable LHR between specified burnup points is valid for these tables.

Table 6 Power Peaking Factors - $F_{\Delta H}^N$ for Davis-Besse, Cycle 21

This Table is referred to by Technical Specifications 3.2.5

Enthalpy Rise Hot Channel Factors - $F_{\Delta H}^N$

$F_{\Delta H}^N \leq \text{MARP} [1 + (1/\text{RH}) (1 - P/P_m)]$ (see note below)

MARP = Maximum Allowable Radial Peak, see MARP Figures and data Tables

P = THERMAL POWER / RATED THERMAL POWER and $P \leq 1.0$

P_m = 1.00 for 4-RCP operation


P_m = 0.75 for 3-RCP operation

1/RH = 0.3

RH = 3.33

Note: The measured $F_{\Delta H}^N$ shall be increased by 5.0% to account for measurement uncertainty prior to comparing to the limits. The core monitoring system-generated $F_{\Delta H}^N$ values are augmented by the required uncertainties.

Figure 5 Maximum Allowable Radial Peak for $F_{\Delta H}^N$ for Davis-Besse, Cycle 21 *

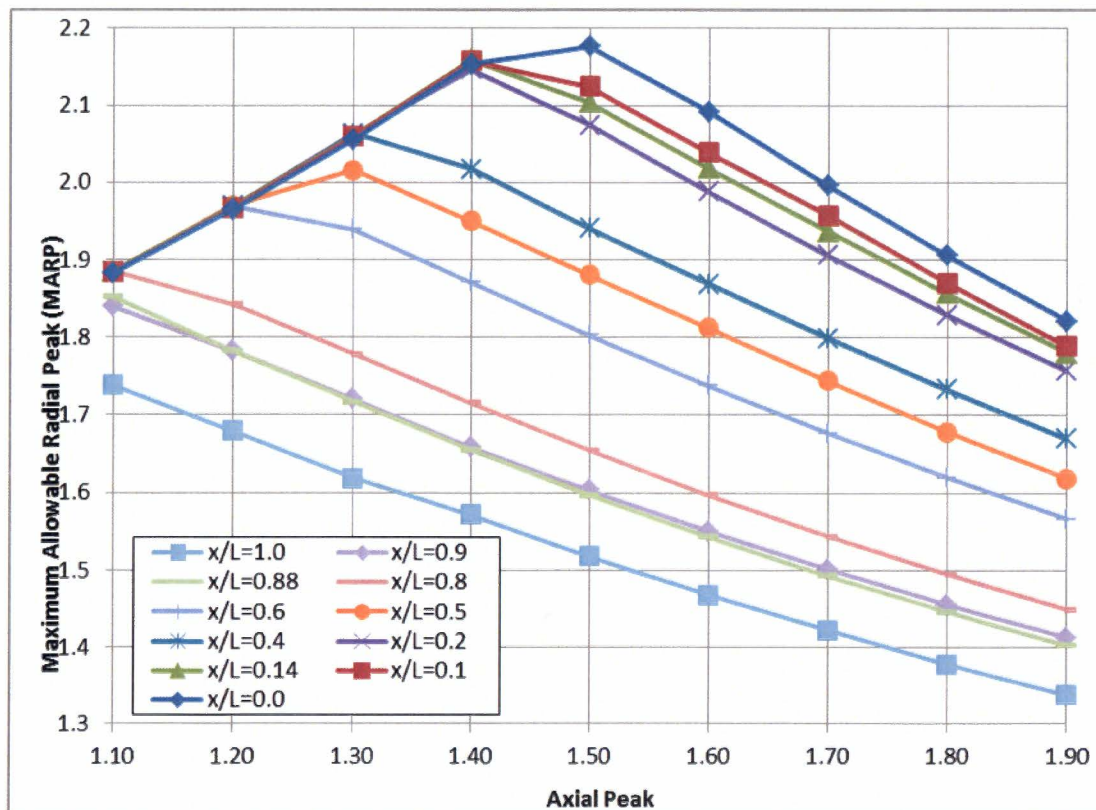


* Linear interpolation is acceptable.

Table 7 Maximum Allowable Radial Peak for $F_{\Delta H}^N$ for Davis-Besse, Cycle 21

Axial Peak	x/L	Axial Height (inches)	MARP Limit	Axial Peak	x/L	Axial Height (inches)	MARP Limit
1.1	0.0	0.00	1.88299	1.6	0.0	0.00	2.09189
	0.1	14.30	1.88398		0.1	14.30	2.03919
	0.14	20.02	1.88428		0.14	20.02	2.01827
	0.2	28.60	1.88461		0.2	28.60	1.98801
	0.4	57.20	1.88490		0.4	57.20	1.86840
	0.5	71.50	1.88439		0.5	71.50	1.81257
	0.6	85.80	1.88451		0.6	85.80	1.73794
	0.8	114.40	1.88421		0.8	114.40	1.59754
	0.88	125.84	1.85239		0.88	125.84	1.54331
	0.9	128.70	1.83969		0.9	128.70	1.55084
	1.0	143.00	1.73842		1.0	143.00	1.46874
1.2	0.0	0.00	1.96511	1.7	0.0	0.00	1.99604
	0.1	14.30	1.96705		0.1	14.30	1.95702
	0.14	20.02	1.96804		0.14	20.02	1.93661
	0.2	28.60	1.96825		0.2	28.60	1.90615
	0.4	57.20	1.96936		0.4	57.20	1.79933
	0.5	71.50	1.96984		0.5	71.50	1.74468
	0.6	85.80	1.96919		0.6	85.80	1.67736
	0.8	114.40	1.84278		0.8	114.40	1.54415
	0.88	125.84	1.78287		0.88	125.84	1.49299
	0.9	128.70	1.78220		0.9	128.70	1.50138
	1.0	143.00	1.67994		1.0	143.00	1.42245
1.3	0.0	0.00	2.05580	1.8	0.0	0.00	1.90606
	0.1	14.30	2.05912		0.1	14.30	1.87049
	0.14	20.02	2.06036		0.14	20.02	1.85710
	0.2	28.60	2.06155		0.2	28.60	1.82954
	0.4	57.20	2.06343		0.4	57.20	1.73365
	0.5	71.50	2.01583		0.5	71.50	1.67902
	0.6	85.80	1.93900		0.6	85.80	1.62023
	0.8	114.40	1.77864		0.8	114.40	1.49550
	0.88	125.84	1.71670		0.88	125.84	1.44607
	0.9	128.70	1.72105		0.9	128.70	1.45590
	1.0	143.00	1.61890		1.0	143.00	1.37861
1.4	0.0	0.00	2.15314	1.9	0.0	0.00	1.82131
	0.1	14.30	2.15758		0.1	14.30	1.78903
	0.14	20.02	2.15910		0.14	20.02	1.78024
	0.2	28.60	2.14648		0.2	28.60	1.75713
	0.4	57.20	2.01712		0.4	57.20	1.67040
	0.5	71.50	1.95015		0.5	71.50	1.61847
	0.6	85.80	1.87083		0.6	85.80	1.56653
	0.8	114.40	1.71630		0.8	114.40	1.44958
	0.88	125.84	1.65545		0.88	125.84	1.40281
	0.9	128.70	1.65903		0.9	128.70	1.41322
	1.0	143.00	1.57207		1.0	143.00	1.33783
1.5	0.0	0.00	2.17667		0.0	0.00	
	0.1	14.30	2.12413		0.1	14.30	
	0.14	20.02	2.10403		0.14	20.02	
	0.2	28.60	2.07451		0.2	28.60	
	0.4	57.20	1.94104		0.4	57.20	
	0.5	71.50	1.88067		0.5	71.50	
	0.6	85.80	1.80330		0.6	85.80	
	0.8	114.40	1.65555		0.8	114.40	
	0.88	125.84	1.59706		0.88	125.84	
	0.9	128.70	1.60415		0.9	128.70	
	1.0	143.00	1.51859		1.0	143.00	


Figure 6a Flux- Δ Flux-Flow
(or Power/Imbalance/Flow)
Allowable Values
Davis-Besse 1, Cycle 21 Before EC 19-0137

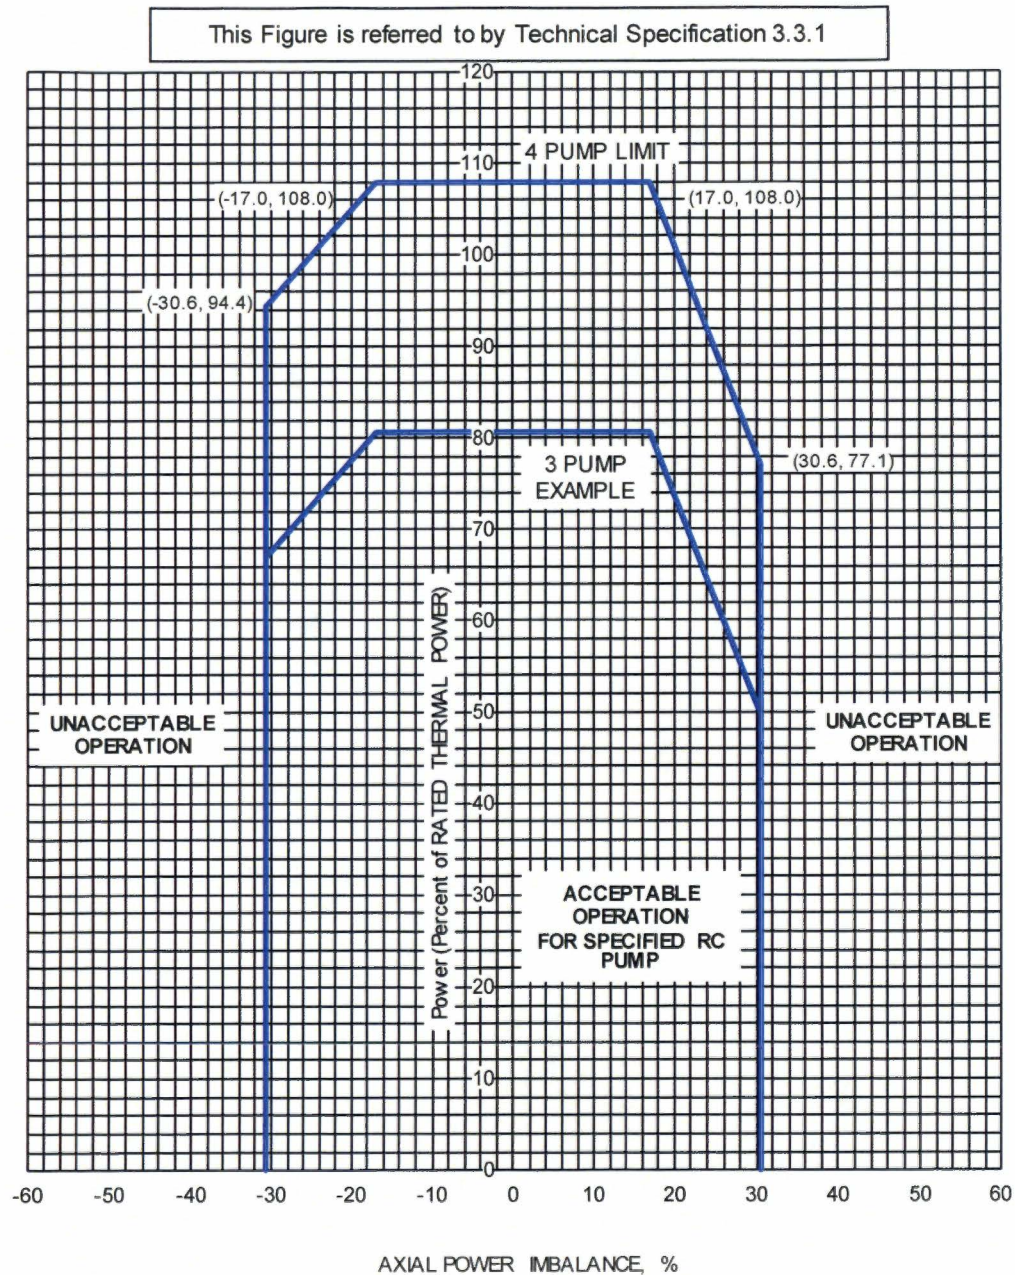

The 3 pump example curve shows allowable values for an approximately 25% flow reduction for three pump operation (283,860 gpm). The actual setpoint will be calculated by the Reactor Protection System and will be directly proportional to the actual reactor coolant system flow with three pumps. These limits are based on Cycle 9 and are conservative relative to the actual Cycle 21 limits.

Figure 6b Flux- Δ Flux-Flow
(or Power/Imbalance/Flow)
Allowable Values
Davis-Besse 1, Cycle 21 **After EC 19-0137**

This Figure is referred to by Technical Specification 3.3.1

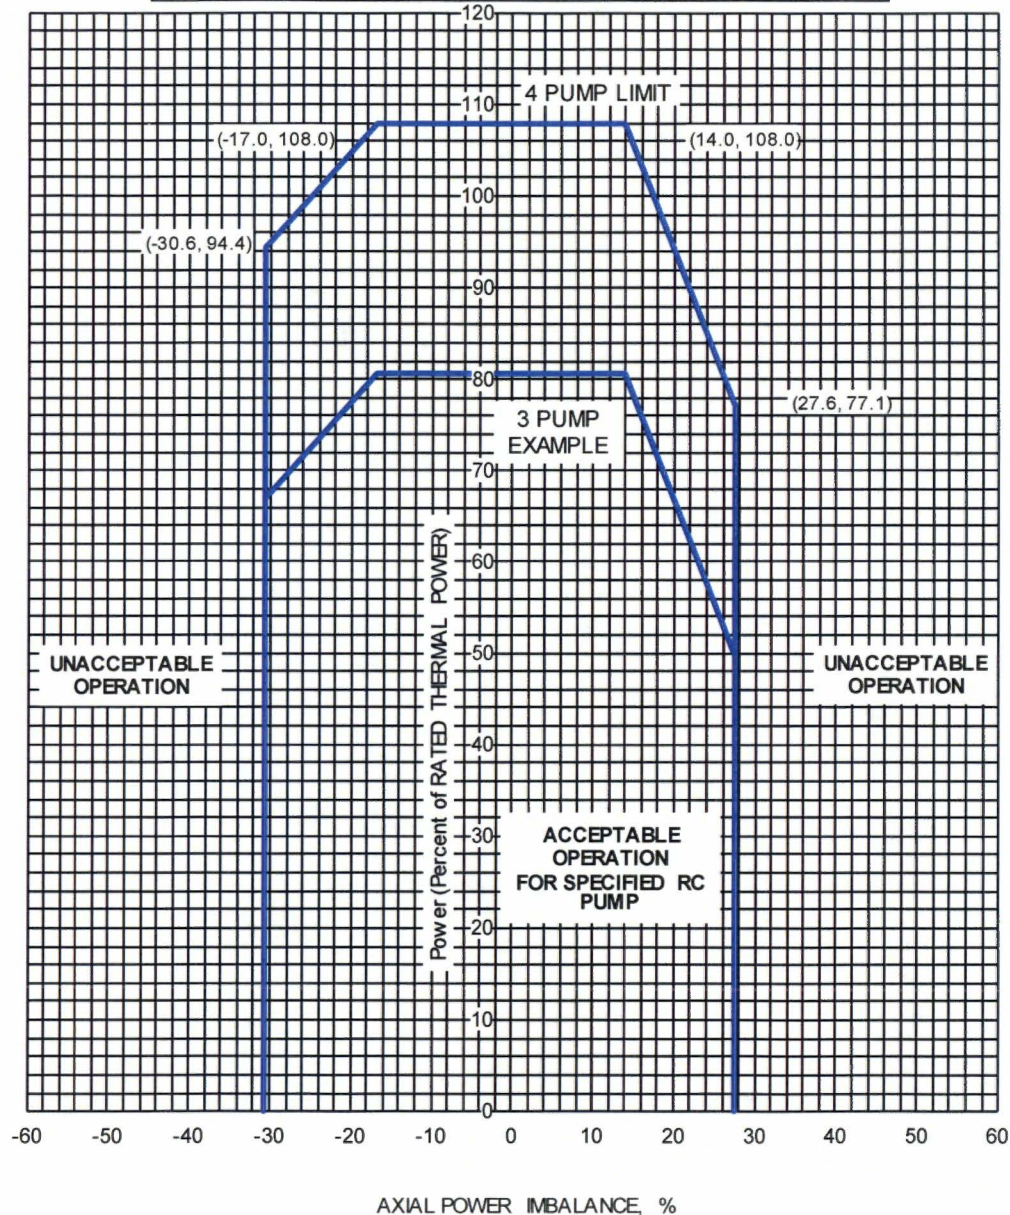

The 3 pump example curve shows allowable values for an approximately 25% flow reduction for three pump operation (283,860 gpm). The actual setpoint will be calculated by the Reactor Protection System and will be directly proportional to the actual reactor coolant system flow with three pumps. These limits are based on EC 19-0137 and are conservative relative to the actual Cycle 21 limits.


Table 8 Refueling Boron Concentration Limit for Davis-Besse, Cycle 21

This limit is referred to by Technical Specifications 3.9.1

The minimum required boron concentration for Mode 6 shall be sufficient to ensure a K_{eff} of 0.95 or less, plus an additional 1% $\Delta k/k$ conservatism allowance for uncertainties.

Figure 7 Control Rod Core Locations and Group Assignments for Davis-Besse, Cycle 21

This Figure is referred to by Technical Requirements Manual 8.1.3

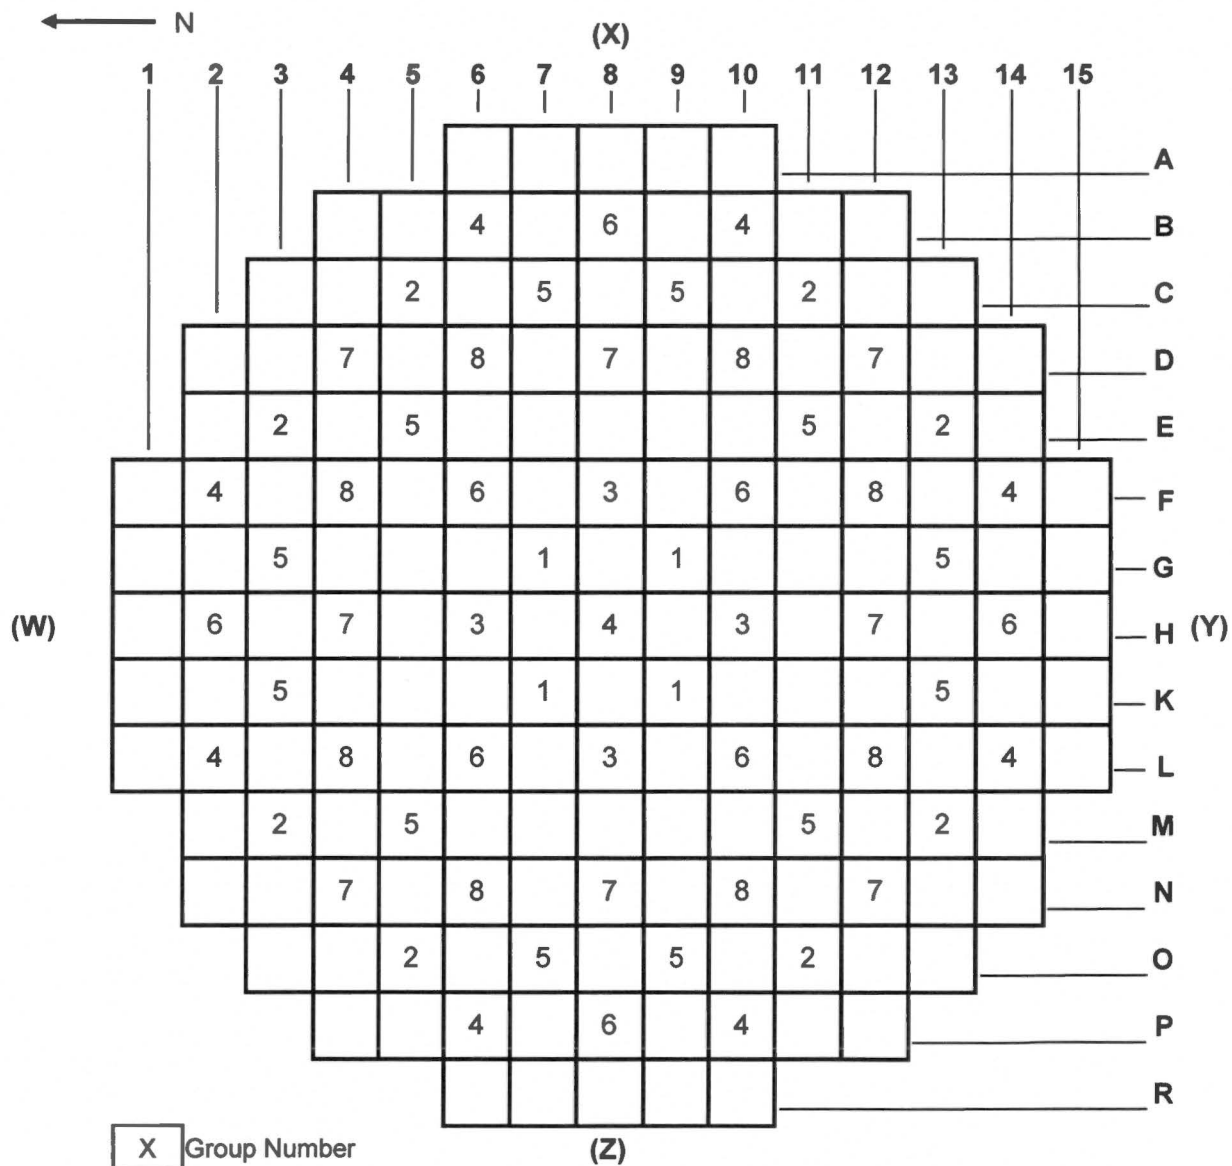

Group	No of Rods	Function	Group	No of Rods	Function
1	4	Safety	5	12	Control
2	8	Safety	6	8	Control
3	4	Safety	7	8	Control
4	9	Safety	8	8	APSRs
		Total		61	