



**Commonwealth Edison**

One First National Plaza, Chicago, Illinois  
Address Reply to: Post Office Box 767  
Chicago, Illinois 60690

February 4, 1983

Director of Nuclear Reactor Regulation  
Attention: Mr. A. Schwencer, Chief  
Licensing Branch #2  
Division of Licensing  
U. S. Nuclear Regulatory Commission  
Washington, DC 20555

Subject: LaSalle County Station Units 1 and 2  
Verification Testing of Separation  
Between Class 1E and Non-Class 1E  
Power Cable in Raceways  
NRC Docket Nos. 50-373 and 50-374

Reference (a): License NPF-11, Condition 2.C(24).

(b): C. W. Schroeder letter to Director of  
Nuclear Reactor Regulation dated  
January 28, 1983.

Dear Sir:

Reference (a) requires, in part, "Prior to startup after the first refueling outage, the licensee shall provide adequate separation or barriers between Class 1E and adjacent non-Class 1E cable trays."

Reference (b) transmitted Wyle Test Procedure No. 46511, Revision A, 1/20/83, "Verification Testing of Separation Between Class 1E and Non-Class 1E Power Cable in Raceways for Commonwealth Edison Company for use in LaSalle Nuclear Generating Station - Units 1 and 2."

As a result of ongoing telecons with Dr. A. Bournia and Mr. John Knox of your staff, Commonwealth Edison Company has agreed to provide temperature monitoring during performance of the testing. Enclosed please find Wyle Test Procedure No. 46511-1, January 24, 1982, "Addendum Number 1 to Verification Testing of Separation Between Class 1E and Non-Class 1E Power Cable in Raceways for Commonwealth Edison Company for use in LaSalle County Generating Station - Units 1 and 2."

*Boa*

February 4, 1983

This test procedure is provided for your review, as previously requested during telecons with Dr. A. Bournia, et. al. Because testing is currently scheduled to begin at the Wyle Laboratories Huntsville Facility on February 15, 1983, it is requested that you notify this office by telephone no later than February 10, 1983 if there are any further comments on this subject.

Very truly yours,

*CW Schroeder 2/4/83*

C. W. Schroeder  
Nuclear Licensing Administrator


lm

cc: NRC Resident Inspector - LSCS 1/0

5935N

**WYLE**

LABORATORIES SCIENTIFIC SERVICES & SYSTEMS GROUP

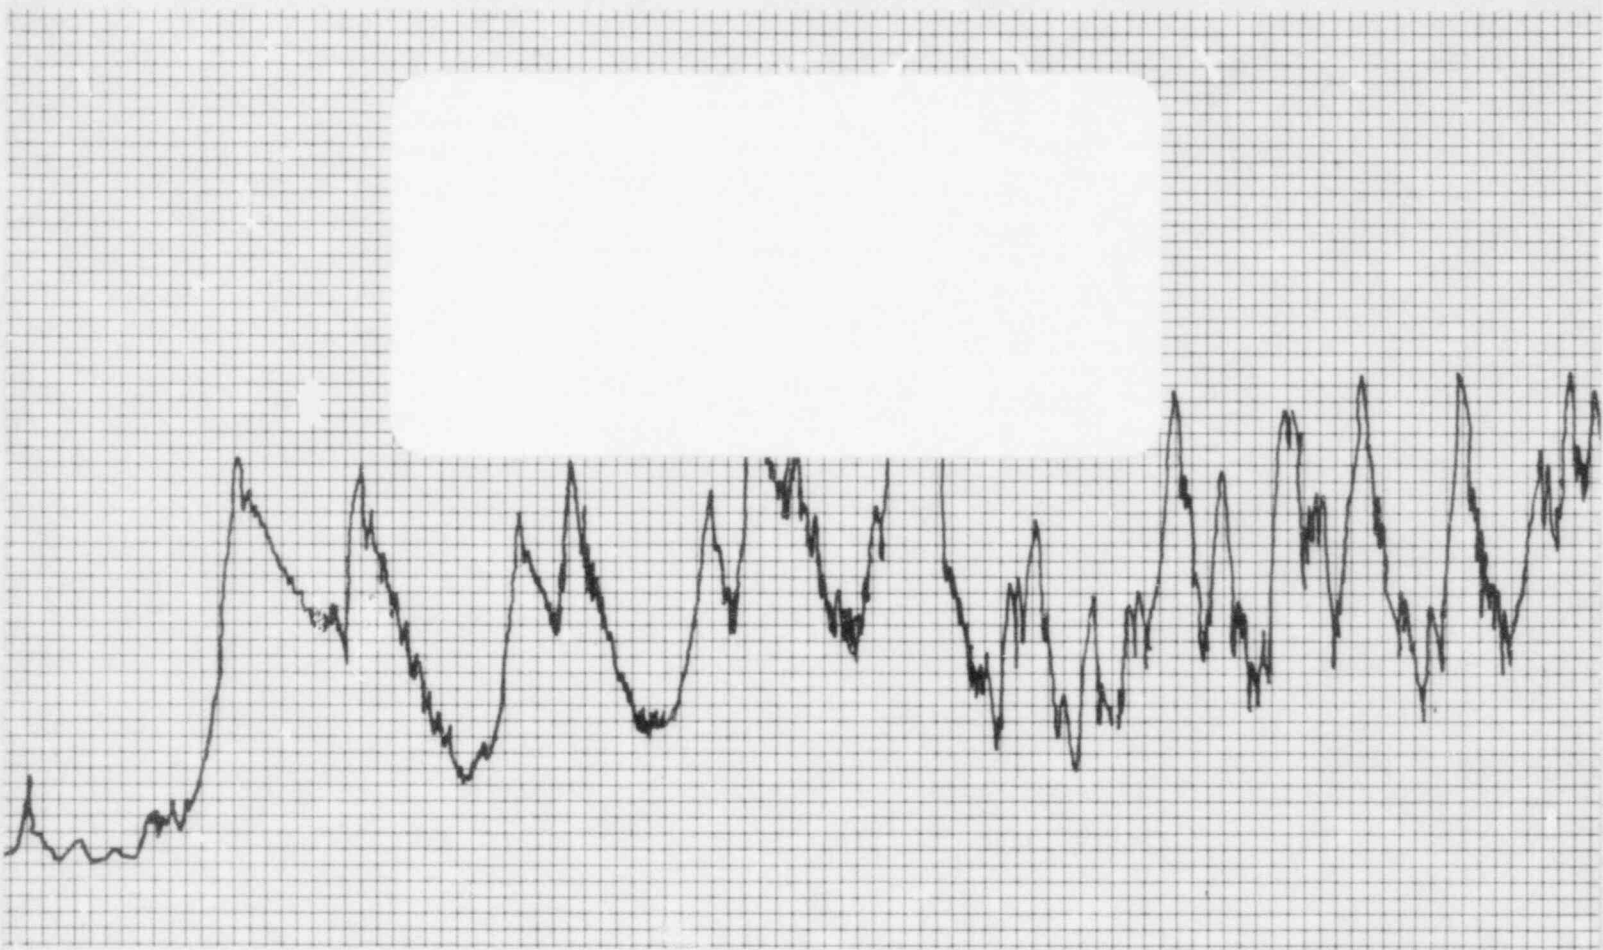

test PROCEDURE