

Docket No. 50-423  
B13800

Attachment 1  
Millstone Nuclear Power Station, Unit No. 3  
Proposed Technical Specification Change  
Hydrogen Recombiners

April 1991

91C4180021 910408  
PDR ADOCK 05000423  
P FDR

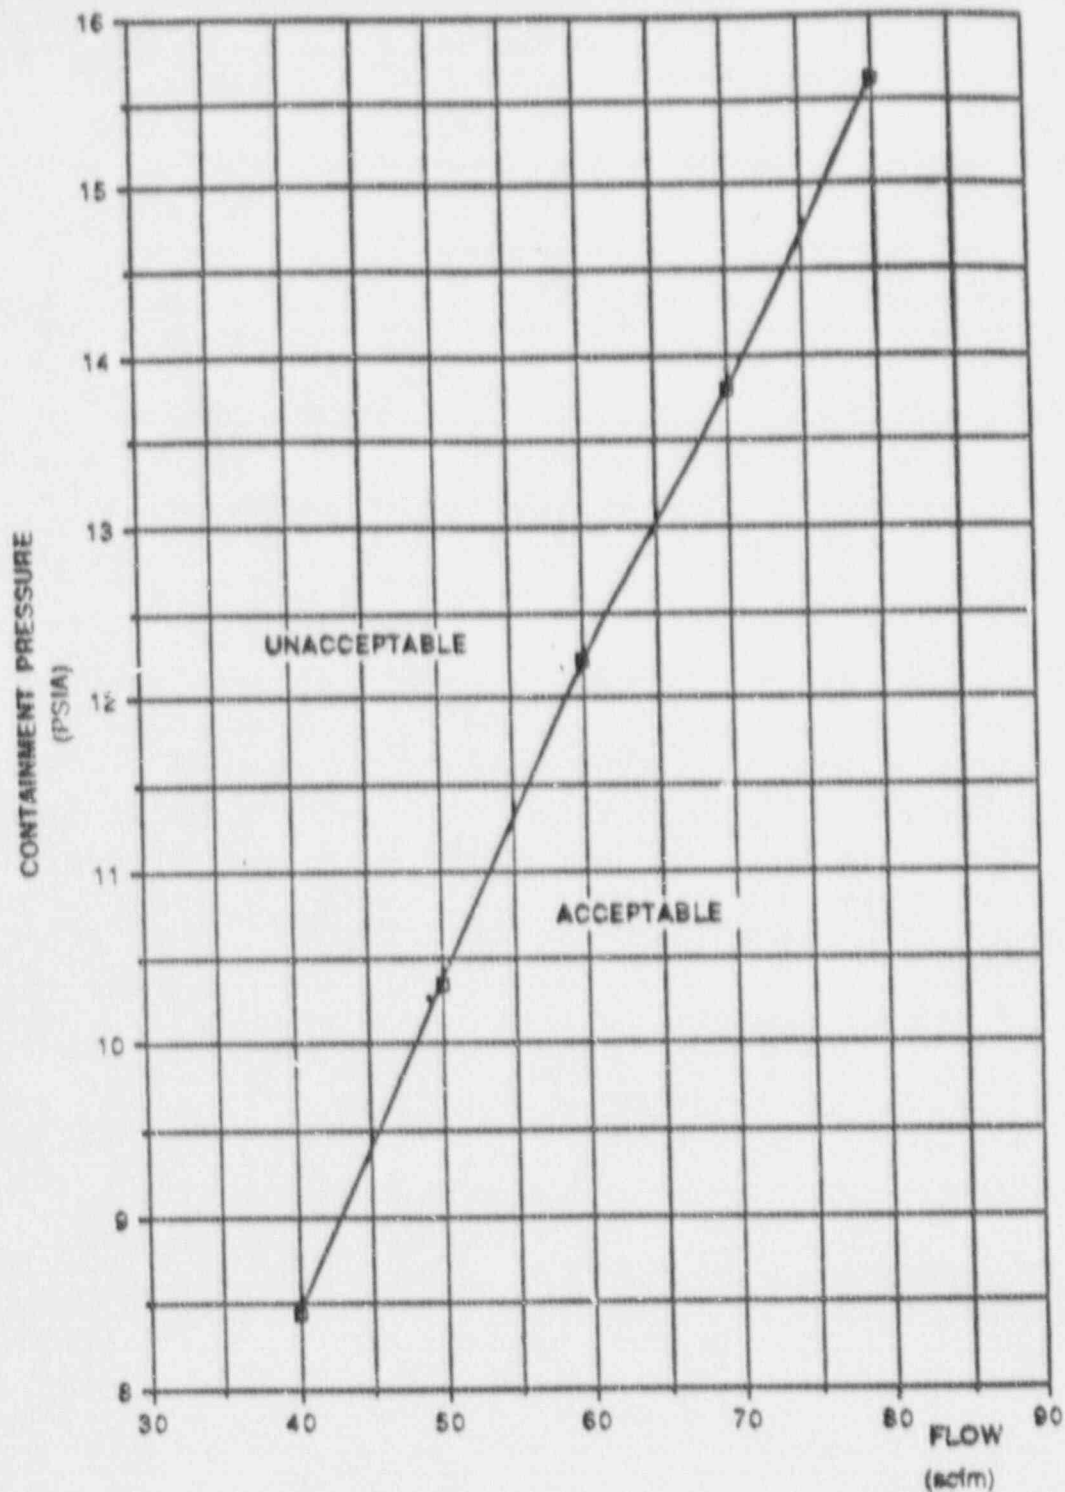


FIGURE 3.6-2  
HYDROGEN RECOMBINER ACCEPTANCE CRITERIA  
FLOW VS CONTAINMENT PRESSURE \*

3/4 6-36a

Amendment No. 47

MILLSTONE - UNIT 3

\*Until September 30, 1991, a flow rate of 72.4 scfm or greater at a pressure of 14.5 to 14.8 psia is acceptable in lieu of the values indicated by Figure 3.6-2.