


## Omaha Public Power District

1623 HARNEY ■ OMAHA, NEBRASKA 68102 ■ TELEPHONE 536-4000 AREA CODE 402

March 10, 1983  
LIC-83-065

Mr. W. C. Seidle, Chief  
Reactor Project Branch 2  
U. S. Nuclear Regulatory Commission  
Region IV  
611 Ryan Plaza Drive, Suite 1000  
Arlington, Texas 76011

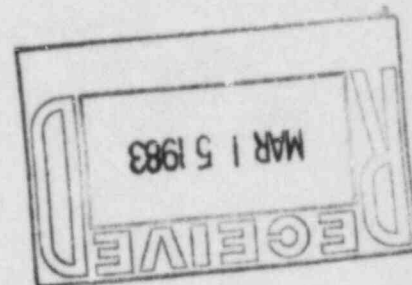

Reference: Dock:t No. 50-285

Dear Mr. Seidle:

### IE Inspection Report 83-01

The subject Inspection Report, dated February 11, 1983, identified one violation regarding the apparent failure to follow written procedures by not recording a jumper in the jumper log at Fort Calhoun Station. The Omaha Public Power District's response to the subject violation is attached.

Sincerely,

W. C. Jones  
Division Manager  
Production Operations

WCJ/TLP:jmm

Attachment

cc: LeBoeuf, Lamb, Leiby & MacRae  
1333 New Hampshire Avenue, N.W.  
Washington, D.C. 20036

Mr. L. A. Yandell, NRC  
Senior Resident Inspector

OMAHA PUBLIC POWER DISTRICT'S RESPONSE  
TO IE INSPECTION REPORT 83-01

Violation

Failure to Follow Procedures

Technical Specification 5.8.1 requires that "written procedures . . . be established, implemented, and maintained that meet or exceed the minimum requirements of Sections 5.1 and 5.3 of ANSI N18.7-1972, and Appendix A of USNRC Regulatory Guide 1.33 . . . ."

Standing Order G-7 establishes the Operating Manual and states in Section 1.3 that "adherence to (the) Operating Manual is mandatory."

Contrary to the above, the licensee failed to enter temporary jumpers (wire HCV-1749 and V6 to VIAS) into the jumper log as required by Step F.1.a(18) of Surveillance Procedure ST-CONT-7, "Type 'A' Test (Containment)."

Response

1. Corrective steps which have been taken and the results achieved.

Verification that the jumpers were, in fact, removed from the circuit in question was made on January 5, 1983, when the incident was discovered. All personnel involved in this incident have been reinstructed on the use of jumpers at the Fort Calhoun Station. The reinstruction of these personnel should reduce the probability for recurrence of this incident.

2. Corrective steps which will be taken to avoid further violations.

In addition to retraining individuals involved with jumper installation, the District is revising Standing Order O-25 which governs the use of electrical jumpers and blocks. The new procedure will include the use and documentation of jumpers used in the performance of surveillance tests. With the revision of Standing Order O-25, the increased requirements will preclude further violations. The completion of this item is scheduled for June, 1983 due to the necessity to train all personnel that work at the Fort Calhoun Station.

3. Date when full compliance will be achieved.

The District is presently in full compliance with respect to control of temporary jumpers referenced in ST-CONT-7, Step F.1.a(18).