




GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704

AREA CODE 713 838-6631

April 6, 1983
RBG-14,751
File Nos. G9.5, G9.25.1.1

Mr. John T. Collins, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV, Office of Inspection and Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

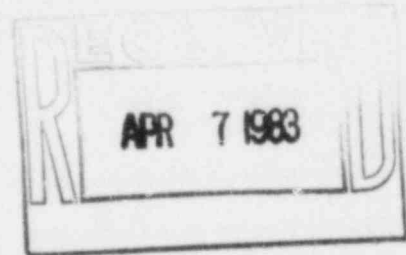

Dear Mr. Collins:

River Bend Station Unit 1
Docket No. 50-458
Interim Report/DR-61

On June 18, 1982, Gulf States Utilities Company (GSU) notified Region IV of a condition potentially reportable under 10CFR50.55(e) concerning the length of the capscrew which holds the starting air valve assembly in the cylinder head of the River Bend Station standby emergency diesel generators supplied by Transamerica Delaval. Delaval previously informed the NRC of this condition pursuant 10CFR21 in a letter dated May 13, 1982.

GSU has not completed its evaluation. Since our Interim Report dated September 2, 1982, GSU has been informed by our architect-engineer that access to the diesel generators to determine the capscrew length will be impractical until May 1983 because of construction in the area. An interim or final status report will be provided by June 7, 1983.

Sincerely,

William J. Booker
for J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

8304110565 830406
PDR ADOCK 05000458
S PDR

JEB
JEB/PJD/kt

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555
R. L. Brown (SRI)

IE 27