

McGuire Unit 1 Cycle 10
Core Operating Limits Report
September 1994

Duke Power Company

		Date
Prepared By:	<u>David F. Borty</u>	<u>9/14/94</u>
Checked By:	<u>W.H.A. Jpl</u>	<u>14 Sep 94</u>
Checked By:	<u>Christy L. Ray</u>	<u>9/14/94</u>
Approved By:	<u>Richard H. Clark</u>	<u>9/14/94</u>

QA Condition 1

NOTE

The contents of this document have been reviewed to verify that no material herein either directly or indirectly changes or affects the results and conclusions presented in the 10CFR50.59 M1C10 Reload Safety Evaluation (calculation file: MCC-1552.08-00-0245).

McGuire 1 Cycle 10 Core Operating Limits Report**REVISION LOG**

<u>Revision</u>	<u>Effective Date</u>	<u>Effective Pages</u>	<u>COLR</u>
Original Issue	May 24, 1993	Pages 6, 12, 13, 15-153	M1C09
Revision 1	May 27, 1993	Page 9	M1C09
Revision 2	February 24, 1994	Page 8	M1C09
Revision 3	June 20, 1994	Pages 1-3, 3A, 4, 5, 5A, 5B, 7, 7A, 10, 11, 14, 14A	M1C09
Revision 4	September 13, 1994	Pages 1 - 19	M1C10

McGuire 1 Cycle 10 Core Operating Limits Report

INSERTION SHEET

Remove pages

Pages 1-153 (rev. 1 - 3)

Insert . pages

Pages 1-19 (rev. 4)

McGuire 1 Cycle 10 Core Operating Limits Report

1.0 Core Operating Limits Report

This Core Operating Limits Report, (COLR) for McGuire Unit 1, Cycle 10 has been prepared in accordance with the requirements of Technical Specification 6.9.1.9.

The Technical Specifications affected by this report are listed below, along with the location of the affected Technical Specification within this report.

Technical Specifications	Section	Page
2.2.1 - Reactor Trip System Instrumentation Setpoint	2.0	5
3/4.1.1.3 - Moderator Temperature Coefficient	3.0	7
3/4.1.2.5 - Borated Water Source - Shutdown	3.1	9
3/4.1.2.6 - Borated Water Source - Operating	3.2	10
3/4.1.3.5 - Shutdown Rod Insertion Limit	3.3	10
3/4.1.3.6 - Control Rod Insertion Limit	3.4	10
3/4.2.1 - Axial Flux Difference	3.5	10
3/4.2.2 - Heat Flux Hot Channel Factor	3.6	13
3/4.2.3 - Nuclear Enthalpy Rise Hot Channel Factor	3.7	16
3/4.5.1.1 - Accumulators	3.8	18
3/4.5.5 - Refueling Water Storage Tank	3.9	18

McGuire 1 Cycle 10 Core Operating Limits Report

1.1 Operating Limits

The cycle-specific parameter limits for the specifications listed in section 1.0 are presented in the following subsections. These limits have been developed using NRC approved methodologies specified in Technical Specification 6.9.1.9.

2.0 Tech Spec 2.2.1 - Reactor Trip System Instrumentation Setpoints

2.1 Overtemperature ΔT Setpoint Parameter Values

<u>Parameter</u>	<u>Value</u>
Overtemperature ΔT reactor trip setpoint	$K_1 < 1.1988$
Overtemperature ΔT reactor trip heatup setpoint penalty coefficient	$K_2 = 0.03354/^{\circ}\text{F}$
Overtemperature ΔT reactor trip depressurization setpoint penalty coefficient	$K_3 = 0.001522/\text{psi}$
Measured reactor vessel ΔT lead/lag time constants	$\tau_1 \geq 8 \text{ sec.}$ $\tau_2 \leq 3 \text{ sec.}$
Measured ΔT lag time constant	$\tau_3 \leq 2 \text{ sec.}$
Measured reactor vessel average temperature lead/lag time constants	$\tau_4 \geq 28 \text{ sec.}$ $\tau_5 \leq 4 \text{ sec.}$
Measure reactor vessel average temperature lag time constant	$\tau_6 \leq 2 \text{ sec.}$
$f_1(\Delta I)$ "positive" breakpoint	$= 12.0 \% \Delta I$
$f_1(\Delta I)$ "negative" breakpoint	$= -44.0 \% \Delta I$
$f_1(\Delta I)$ "positive" slope	$= 1.619 \% \Delta T_o / \% \Delta I$
$f_1(\Delta I)$ "negative" slope	$= 3.436 \% \Delta T_o / \% \Delta I$

McGuire 1 Cycle 10 Core Operating Limits Report

2.2 Overpower ΔT Setpoint Parameter Values

<u>Parameter</u>	<u>Value</u>
Overpower ΔT reactor trip setpoint	$K_4 \leq 1.0851$
Overpower ΔT reactor trip heatup setpoint penalty coefficient	$K_6 = 0.001207/^{\circ}\text{F}$
Measured reactor vessel ΔT lead/lag time constants	$\tau_1 \geq 8 \text{ sec.}$ $\tau_2 \leq 3 \text{ sec.}$
Measured ΔT lag time constant	$\tau_3 \leq 2 \text{ sec.}$
Measure reactor vessel average temperature lag time constant	$\tau_6 \leq 2 \text{ sec.}$
Measure reactor vessel average temperature rate-lag time constant	$\tau_7 \geq 5 \text{ sec.}$
$f_2(\Delta I)$ "positive" breakpoint	$= 35.0 \% \Delta I$
$f_2(\Delta I)$ "negative" breakpoint	$= -35.0 \% \Delta I$
$f_2(\Delta I)$ "positive" slope	$= 7.0 \% \Delta T_0 / \% \Delta I$
$f_2(\Delta I)$ "negative" slope	$= 7.0 \% \Delta T_0 / \% \Delta I$

McGuire 1 Cycle 10 Core Operating Limits Report

3.0 Tech Spec 3/4.1.1.3 - Moderator Temperature Coefficient

3.0.1 The Moderator Temperature Coefficient (MTC) Limits are:

The MTC shall be less positive than the limits shown in Figure 1. The BOC, ARO, HZP MTC shall be less positive than $0.7\text{E-}04 \Delta\text{K/K/}^\circ\text{F}$.

The EOC, ARO, RTP MTC shall be less negative than $-4.1\text{E-}04 \Delta\text{K/K/}^\circ\text{F}$.

3.0.2 The MTC Surveillance Limit is:

The 300 PPM ARO, RTP MTC should be less negative than or equal to $-3.2\text{E-}04 \Delta\text{K/K/}^\circ\text{F}$.

Where: BOC stands for Beginning of Cycle
 EOC stands for End of Cycle
 ARO stands for All Rods Out
 HZP stands for Hot Zero Thermal Power
 RTP stands for Rated Thermal Power

McGuire 1 Cycle 10 Core Operating Limits Report

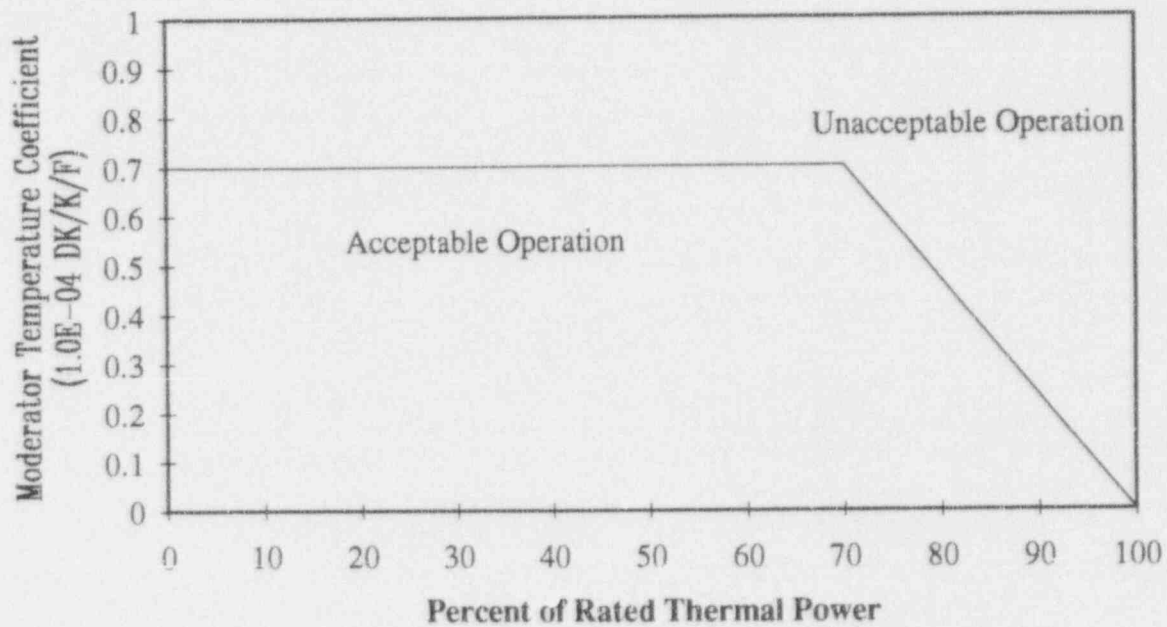


Figure 1

Moderator Temperature Coefficient Versus Power Level

NOTE: Compliance with Technical Specification 3.1.1.3 may require rod withdrawal limits. Refer to OP/1/A/6100/22 Unit 1 Data Book for details.

McGuire 1 Cycle 10 Core Operating Limits Report

3.1 Tech Spec 3/4.1.2.5 - Borated Water Source - Shutdown

3.1.1 Volume and boron concentrations for the Boric Acid Storage System and the Refueling Water Storage Tank (RWST) during modes 5 & 6:

<u>Parameter</u>	<u>Limit</u>
Boric Acid Storage System minimum contained borated water volume for LCO 3.1.2.5a	6,132 gallons
Boric Acid Storage System minimum boron concentration for LCO 3.1.2.5a	7,000 ppm
Boric Acid Storage System minimum water volume required to maintain SDM at 7,000 ppm	585 gallons
Refueling Water Storage Tank minimum contained borated water volume for LCO 3.1.2.5b	26,000 gallons
Refueling Water Storage Tank minimum boron concentration for LCO 3.1.2.5b	2,175 ppm
Refueling Water Storage Tank minimum water volume required to maintain SDM at 2,175 ppm	3,500 gallons

McGuire 1 Cycle 10 Core Operating Limits Report

3.2 Tech Spec 3/4.1.2.6 - Borated Water Source - Operating

3.2.1 Volume and boron concentrations for the Boric Acid Storage System and the Refueling Water Storage Tank (RWST) during modes 1, 2, 3, & 4:

<u>Parameter</u>	<u>Limit</u>
Boric Acid Storage System minimum contained borated water volume for LCO 3.1.2.6a	20,453 gallons
Boric Acid Storage System minimum boron concentration for LCO 3.1.2.6a	7,000 ppm
Boric Acid Storage System minimum water volume required to maintain SDM at 7,000 ppm	9,851 gallons
Refueling Water Storage Tank minimum contained borated water volume for LCO 3.1.2.6b	91,000 gallons
Refueling Water Storage Tank minimum boron concentration for LCO 3.1.2.6b	2,175 ppm
Refueling Water Storage Tank maximum boron concentration for LCO 3.1.2.6b	2,275 ppm
Refueling Water Storage Tank minimum water volume required to maintain SDM at 2,175 ppm	57,107 gallons

3.3 Tech Spec 3/4.1.3.5 - Shutdown Rod Insertion Limit

3.3.1 The shutdown rods shall be withdrawn to at least 222 steps.

3.4 Tech Spec 3/4.1.3.6 - Control Rod Insertion Limits

3.4.1 The control rod banks shall be limited to physical insertion as shown in Figure 2.

3.5 Tech Spec 3/4.2.1 - Axial Flux Difference

3.5.1 The Axial Flux Difference (AFD) Limits are provided in Figure 3.

McGuire 1 Cycle 10 Core Operating Limits Report

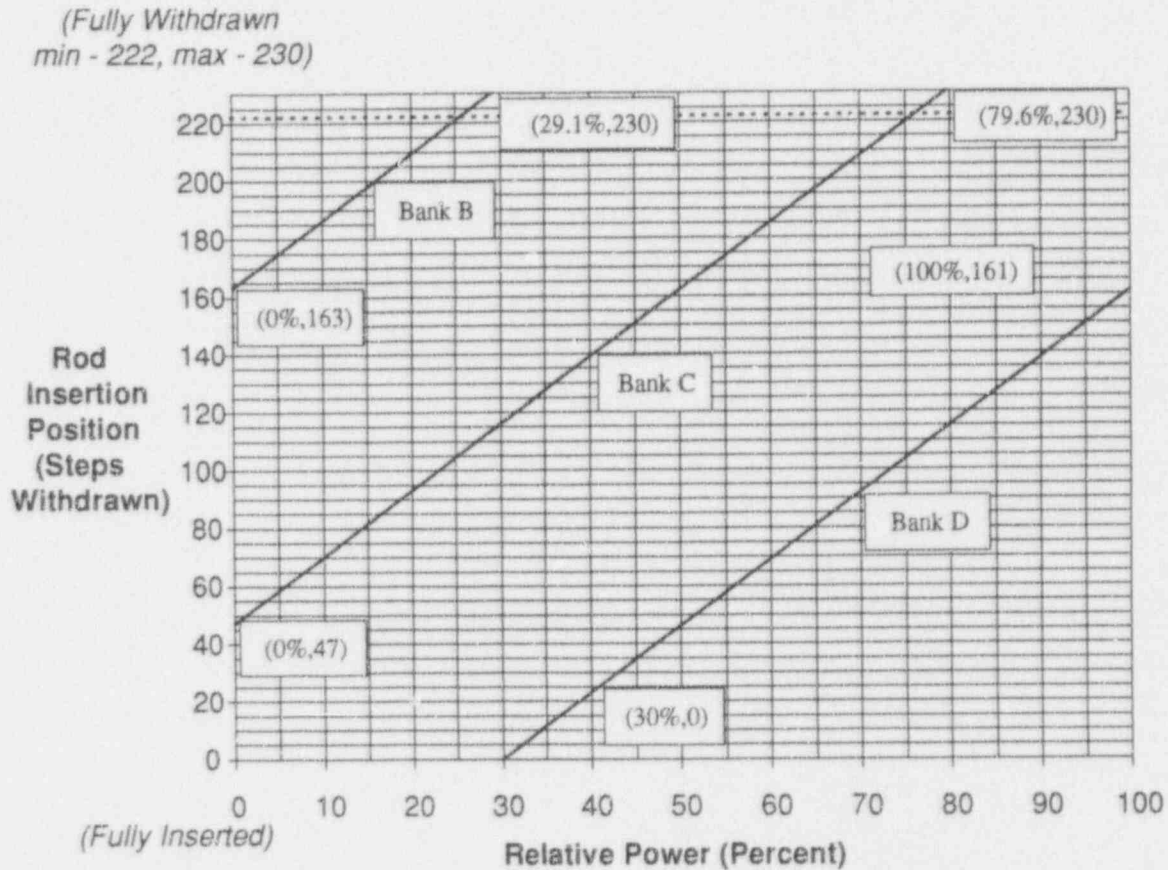


Figure 2

Control Rod Bank Insertion Limits Versus Percent Rated Thermal Power

NOTE: Compliance with Technical Specification 3.1.1.3 may require rod withdrawal limits. Refer to OP/1/A/6100/22 Unit 1 Data Book for details.
If reactor power is turbine limited, a penalty of 2.3 steps for each percent power below 100% to which the reactor is limited will be required. Refer to OP/1/A/6100/22 Unit 1 Data Book for details.

McGuire 1 Cycle 10 Core Operating Limits Report

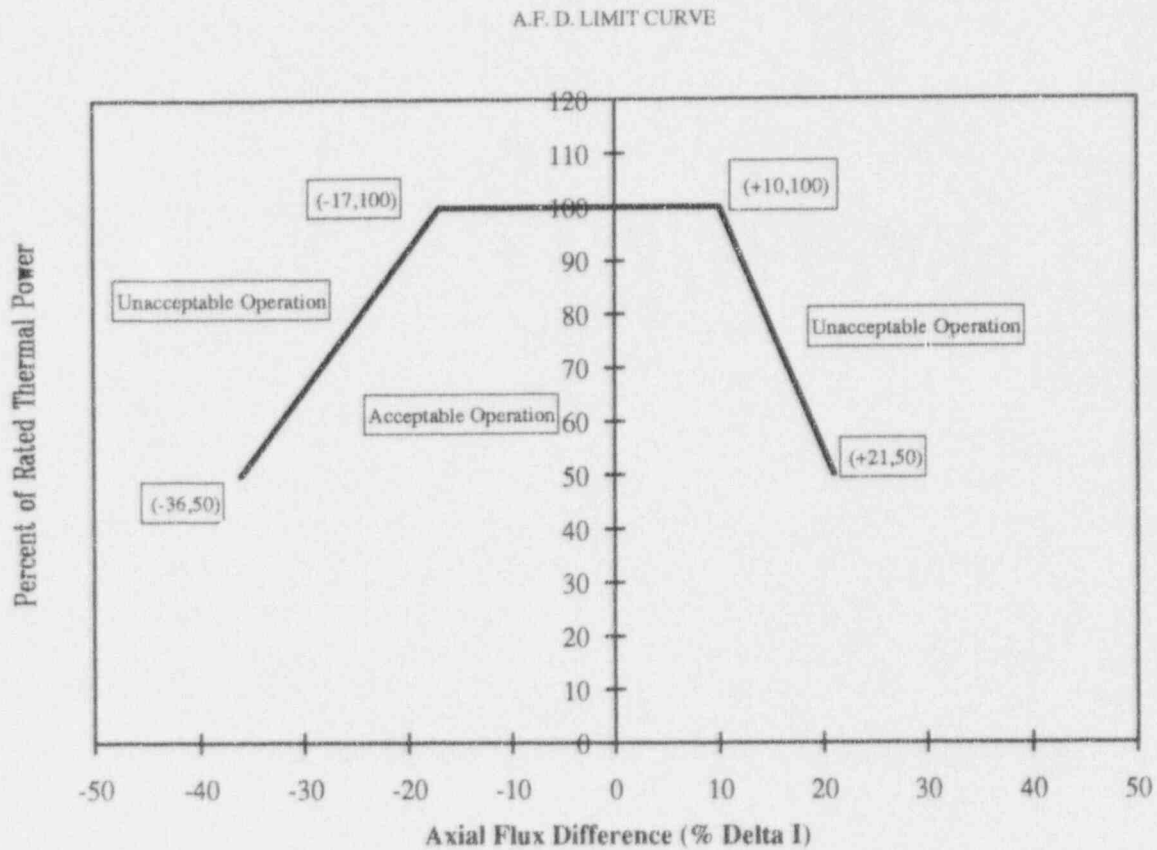


Figure 3

Percent of Rated Thermal Power Versus Axial Flux Difference Limits

NOTE: Compliance with Technical Specification 3.2.2 may require more restrictive AFD limits. Refer to OP/1/A/6100/22 Unit 1 Data Book for details.

McGuire 1 Cycle 10 Core Operating Limits Report

3.6 Tech Spec 3/4.2.2 - Heat Flux Hot Channel Factor, $F_Q(X,Y,Z)$

3.6.1 $F_Q^{RTP} = 2.32$

3.6.2 $K(Z)$ is provided in Figure 4 for Mark-BW fuel.

The following parameters are required for core monitoring per the Surveillance Requirements of Specification 3/4.2.2:

3.6.3 $[F_Q^L(X,Y,Z)]^{OP} = F_Q^D(X,Y,Z) \times M_Q(X,Y,Z) / (UMT \times MT \times TILT)$

where $[F_Q^L(X,Y,Z)]^{OP}$ = cycle dependent maximum allowable design peaking factor which ensures that the $F_Q(X,Y,Z)$ limit will be preserved for operation within the LCO limits $[F_Q^L(X,Y,Z)]^{OP}$. $[F_Q^L(X,Y,Z)]^{OP}$ includes allowances for calculational and measurement uncertainties.

$F_Q^D(X,Y,Z)$ = the design power distribution for F_Q . $F_Q^D(X,Y,Z)$ is provided in Table 1, Appendix A, for normal operating conditions and in Table 2, Appendix A for power escalation testing during initial startup operations.

$M_Q(X,Y,Z)$ = the margin remaining in core location X,Y,Z to the LOCA limit in the transient power distribution. $M_Q(X,Y,Z)$ is provided in Table 1, Appendix A for normal operating conditions and in Table 2, Appendix A for power escalation testing during initial startup operations.

UMT = Measurement Uncertainty, = 1.05.

MT = Engineering Hot Channel Factor, = 1.03.

TILT = Peaking penalty that accounts for allowable quadrant power tilt ratio of 1.02. (TILT = 1.035)

NOTE: $[F_Q^L(X,Y,Z)]^{OP}$ is the parameter identified as $F_Q^{MAX}(X,Y,Z)$ in DPC-NE-2011PA.

McGuire 1 Cycle 10 Core Operating Limits Report

$$3.6.4 \quad [F_Q^L(X,Y,Z)]^{RPS} = F_Q^D(X,Y,Z) \times (M_C(X,Y,Z)/(UMT \times MT \times TILT))$$

where $[F_Q^L(X,Y,Z)]^{RPS}$ = cycle dependent maximum allowable design peaking factor which ensures that the centerline fuel melt limit will be preserved for operation within the LCO limits. $[F_Q^L(X,Y,Z)]^{RPS}$ includes allowances for calculational and measurement uncertainties.

$F_Q^D(X,Y,Z)$ = the design power distributions for F_Q . $F_Q^D(X,Y,Z)$ is provided in Table 1, Appendix A for normal operating conditions and in Table 2, Appendix A for power escalation testing during initial startup operations.

$M_C(X,Y,Z)$ = the margin remaining to the CFM limit in core location X,Y,Z from the transient power distribution. $M_C(X,Y,Z)$ calculations parallel the $M_Q(X,Y,Z)$ calculations described in DPC-NE-2011PA, except that the LOCA limit is replaced with the CFM limit. $M_C(X,Y,Z)$ is provided in Table 3, Appendix A for normal operating conditions and in Table 4, Appendix A for power escalation testing during initial startup operations.

UMT = Measurement Uncertainty, = 1.05.

MT = Engineering Hot Channel Factor, = 1.03.

TILT = Peaking penalty that accounts for allowable quadrant power tilt ratio of 1.02. (TILT = 1.035)

NOTE: $[F_Q^L(X,Y,Z)]^{RPS}$ is the parameter identified as $F_Q^{MAX}(X,Y,Z)$ in DPC-NE-2011PA, except that $M_Q(X,Y,Z)$ is replaced by $M_C(X,Y,Z)$.

3.6.5 KSLOPE = 0.0725

KSLOPE is the adjustment to the K_1 value from OTΔT required to compensate for each 1% that $[F_Q^L(X,Y,Z)]^{RPS}$ exceeds its limit.

McGuire 1 Cycle 10 Core Operating Limits Report

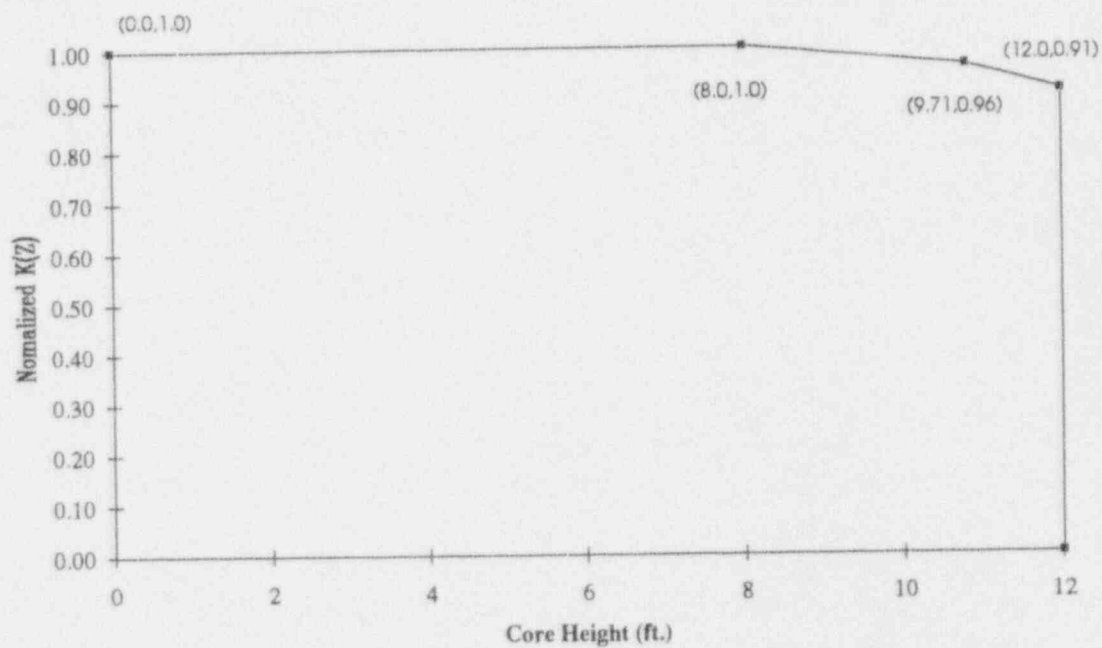


Figure 4

$K(Z)$, Normalized $F_Q(X,Y,Z)$ as a Function of Core Height for MkBW Fuel

McGuire 1 Cycle 10 Core Operating Limits Report

3.7 Tech Spec 3/4.2.3 - Nuclear Enthalpy Rise Hot Channel Factor, $F_{\Delta H}(X,Y,Z)$

The following parameters are required for the LCO requirements of T.S. 3/4.2.3.

$$3.7.1 \quad [F_{\Delta H}(X,Y)]^{LCO} = \text{MARP}(X,Y) \times [1.0 + (1/\text{RRH}) \times (1.0 - P)]$$

where $\text{MARP}(X,Y)$ = McGuire 1 Cycle 10 Operating Limit Maximum Allowable Radial Peaks. $\text{MARP}(X,Y)$ radial peaking limits, are provided in Table 7, Appendix A.

$$P = \frac{\text{Thermal Power}}{\text{Rated Thermal Power}}$$

RRH is defined in section 3.7.3

The following parameters are required for core monitoring per the Surveillance requirements of T.S. 3/4.2.3.

$$3.7.2 \quad [F_{\Delta H}^L(X,Y)]^{SURV} = F_{\Delta H}^D(X,Y) \times M_{\Delta H}(X,Y)/(\text{UMR} \times \text{TILT})$$

where, $[F_{\Delta H}^L(X,Y)]^{SURV}$ = cycle dependent maximum allowable design peaking factor which ensures that the $F_{\Delta H}(X,Y)$ limit will be preserved for operation within the LCO limits. $[F_{\Delta H}^L(X,Y)]^{SURV}$ includes allowances for calculational and measurement uncertainty.

$F_{\Delta H}^D(X,Y)$ = the design power distribution for $F_{\Delta H}$. $F_{\Delta H}^D(X,Y)$ is provided in Table 5, Appendix A for normal operation and in Table 6, Appendix A for power escalation testing during initial startup operations.

McGuire 1 Cycle 10 Core Operating Limits Report

$M_{\Delta H}(X,Y)$ = the margin remaining in core location X,Y relative to the Operational DNB limit in the transient power distribution.
 $M_{\Delta H}(X,Y)$ is provided in Table 5, Appendix A for normal operation and in Table 6, Appendix A for power escalation testing during initial startup operations.

UMR = Uncertainty value for measured radial peaks, = 1.04.

TILT = Factor to account for a peaking increase due to the allowed quadrant tilt ratio of 1.02. (TILT = 1.035).

NOTE: $[F_{\Delta H}^L(X,Y)]^{SURV}$ is the parameter identified as $[F_{\Delta H}(X,Y)]^{MAX}$ in DPC-NE-2011PA.

3.7.3 $RRH = 3.34$ when $0.0 < P \leq 1.0$,

where RRH = Thermal Power reduction required to compensate for each 1% that $F_{\Delta H}(X,Y)$ exceeds its limit.

3.7.4 $TRH = 0.04$

where TRH = Reduction in $OT\Delta T K_1$ setpoint required to compensate for each 1% that $F_{\Delta H}(X,Y)$ exceeds its limit.

McGuire 1 Cycle 10 Core Operating Limits Report

3.8 Tech Spec 3/4.5.1.1 - Accumulators

3.8.1 Boron concentration limits during modes 1, 2, & 3:

<u>Parameter</u>	<u>Limit</u>
Cold Leg Accumulator minimum boron concentration for LCO 3.5.1.1c	2,000 ppm
Cold Leg Accumulator maximum boron concentration for LCO 3.5.1.1c	2,275 ppm
Minimum Cold Leg Accumulator boron concentration required to ensure post-LOCA subcriticality	1,900 ppm

3.9 Tech Spec 3/4.5.5 - Refueling Water Storage Tank

3.9.1 Boron concentration limits during modes 1, 2, 3, & 4:

<u>Parameter</u>	<u>Limit</u>
Refueling Water Storage Tank minimum boron concentration for LCO 3.5.5b	2,175 ppm
Refueling Water Storage Tank maximum boron concentration for LCO 3.5.5b	2,275 ppm

McGuire 1 Cycle 10 Core Operating Limits Report

Note:

Data contained in Tables in the Appendix to this document were generated in the McGuire 1 Cycle 10 Maneuvering Analysis calculational file (MCC-1553.05-00-0119.) The McGuire Reactor Engineering Group will control this information via computer file(s) and should be contacted if there is a need to access this information.

**McGuire 1 Cycle 10
Core Operating Limits Report
Appendix A**

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 1 of 143

TABLE 1

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.6619	.8257	.7061	.8547	.7476	.7015	.6426	.5409
	* 2.1738	* 1.8753	* 2.0636	* 1.7852	* 2.0361	* 2.1323	* 2.2977	* 2.7046
9	.8257	.7443	.7336	.7775	.8547	.7251	.7154	.5087
	* 1.8753	* 2.0666	* 2.1300	* 1.9792	* 1.7933	* 2.0941	* 2.0744	* 2.8813
10	.7561	.7336	.7176	.8525	.7829	.8118	.6415	.4466
	* 2.0636	* 2.1323	* 2.1767	* 1.8263	* 1.9772	* 1.9015	* 2.3549	* 3.3253
11	.8547	.7775	.8525	.7133	.8097	.7186	.6629	.4038
	* 1.7852	* 1.9792	* 1.8263	* 2.2182	* 1.9188	* 2.1640	* 2.3749	* 3.7958
12	.7476	.8547	.7818	.8086	.6255	.6683	.5644	
	* 2.0361	* 1.7949	* 1.9792	* 1.9206	* 2.3003	* 2.1510	* 2.7076	
13	.7015	.7251	.8118	.7176	.6683	.5419	.3909	
	* 2.1323	* 2.0941	* 1.9033	* 2.1640	* 2.1510	* 2.5965	* 3.8129	
14	.6426	.7154	.6426	.6629	.5644	.3909		
	* 2.2977	* 2.0744	* 2.3549	* 2.3749	* 2.7076	* 3.8182		
15	.5409	.5087	.4466	.4027	F-SUB-Q			
	* 2.7046	* 2.8813	* 3.3253	* 3.7958	M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.9757	1.1578	1.1074	1.1781	1.0389	1.0292	.9725	.8718
	* 1.6242	* 1.4235	* 1.4731	* 1.3580	* 1.5231	* 1.5152	* 1.5854	* 1.7506
9	1.1578	1.1053	1.0646	1.0849	1.1513	1.0217	1.0656	.7850
	* 1.4235	* 1.4814	* 1.5537	* 1.4807	* 1.3870	* 1.5371	* 1.4603	* 1.9466
10	1.1074	1.0646	.9950	1.1481	1.0913	1.1224	.9146	.6737
	* 1.4731	* 1.5549	* 1.6356	* 1.4222	* 1.4817	* 1.4603	* 1.7266	* 2.2995
11	1.1781	1.0849	1.1470	.9821	1.1224	1.0667	1.0592	.6244
	* 1.2580	* 1.4817	* 1.4232	* 1.6756	* 1.4627	* 1.5308	* 1.5512	* 2.5593
12	1.0389	1.1513	1.0903	1.1224	.9104	1.0432	.8954	
	* 1.5231	* 1.3879	* 1.4828	* 1.4630	* 1.7147	* 1.5189	* 1.7962	
13	1.0292	1.0217	1.1212	1.0656	1.0421	.8579	.6073	
	* 1.5152	* 1.5359	* 1.4603	* 1.5317	* 1.5189	* 1.8074	* 2.5965	
14	.9725	1.0656	.9146	1.0592	.8954	.6073		
	* 1.5854	* 1.4603	* 1.7266	* 1.5512	* 1.7966	* 2.5965		
15	.8718	.7861	.6737	.6233	F-SUB-Q			
	* 1.7506	* 1.9447	* 2.2996	* 2.5625	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 2 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 BFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1610	* 1.3730	* 1.2938	* 1.3827	* 1.1888	* 1.2017	* 1.1599	* 1.0742
	* 1.4857	* 1.2669	* 1.3257	* 1.2184	* 1.3962	* 1.3591	* 1.3914	* 1.4874
9	* 1.3730	* 1.3077	* 1.2338	* 1.2391	* 1.3452	* 1.1856	* 1.2809	* .9457
	* 1.2669	* 1.3290	* 1.4174	* 1.3618	* 1.2481	* 1.3755	* 1.2730	* 1.6927
10	* 1.2938	* 1.2338	* 1.1374	* 1.3398	* 1.2499	* 1.3259	* 1.0753	* .8000
	* 1.3257	* 1.4174	* 1.5116	* 1.2825	* 1.3582	* 1.2988	* 1.5623	* 2.0259
11	* 1.3827	* 1.2391	* 1.3388	* 1.1235	* 1.3291	* 1.2723	* 1.3045	* .7593
	* 1.2184	* 1.3627	* 1.2833	* 1.5423	* 1.2999	* 1.3540	* 1.3213	* 2.2288
12	* 1.1888	* 1.3441	* 1.2488	* 1.3280	* 1.0839	* 1.2873	* 1.1021	*
	* 1.3962	* 1.2481	* 1.3591	* 1.3008	* 1.5618	* 1.3125	* 1.5424	*
13	* 1.2017	* 1.1867	* 1.3248	* 1.2713	* 1.2873	* 1.0496	* .7390	*
	* 1.3591	* 1.3746	* 1.2996	* 1.3546	* 1.3125	* 1.5909	* 2.2661	*
14	* 1.1599	* 1.2809	* 1.0742	* 1.3034	* 1.1010	* .7379	*	*
	* 1.3914	* 1.2722	* 1.5611	* 1.3213	* 1.5427	* 2.2661	*	*
15	* 1.0742	* .9468	* .8000	* .7583	* F-SUB-Q			
	* 1.4874	* 1.6913	* 2.0279	* 2.2288	* M-SUB-Q			

AT 100% POWER, 4 BFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2638	* 1.5112	* 1.4105	* 1.5133	* 1.2895	* 1.3109	* 1.2809	* 1.2017
	* 1.4436	* 1.2157	* 1.2870	* 1.1737	* 1.3585	* 1.3114	* 1.3290	* 1.4006
9	* 1.5112	* 1.4298	* 1.3345	* 1.3409	* 1.4791	* 1.2981	* 1.4223	* 1.0496
	* 1.2157	* 1.2839	* 1.3793	* 1.3282	* 1.2016	* 1.3256	* 1.2085	* 1.6086
10	* 1.4105	* 1.3345	* 1.2231	* 1.4716	* 1.3612	* 1.4683	* 1.1856	* .8814
	* 1.2870	* 1.3800	* 1.4846	* 1.2380	* 1.3181	* 1.2380	* 1.5072	* 1.9403
11	* 1.5133	* 1.3409	* 1.4705	* 1.2209	* 1.4716	* 1.4094	* 1.4630	* .8450
	* 1.1737	* 1.3282	* 1.2388	* 1.4969	* 1.2325	* 1.2878	* 1.2363	* 2.1116
12	* 1.2895	* 1.4780	* 1.3591	* 1.4705	* 1.1910	* 1.4480	* 1.2370	*
	* 1.3585	* 1.2022	* 1.3197	* 1.2330	* 1.5021	* 1.2366	* 1.4532	*
13	* 1.3109	* 1.2981	* 1.4673	* 1.4094	* 1.4480	* 1.1727	* .8247	*
	* 1.3114	* 1.3248	* 1.2388	* 1.2884	* 1.2366	* 1.5135	* 2.1538	*
14	* 1.2809	* 1.4223	* 1.1856	* 1.4630	* 1.2359	* .8247	*	*
	* 1.3290	* 1.2085	* 1.5061	* 1.2363	* 1.4540	* 2.1544	*	*
15	* 1.2017	* 1.0507	* .8814	* .8439	* F-SUB-Q			
	* 1.4006	* 1.6074	* 1.9421	* 2.1138	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 3 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2916	* 1.5551	* 1.4448	* 1.5562	* 1.3195	* 1.3462	* 1.3227	* 1.2499
	* 1.4980	* 1.2408	* 1.3319	* 1.2100	* 1.4092	* 1.3533	* 1.3664	* 1.4302

9	* 1.5551	* 1.4641	* 1.3612	* 1.3720	* 1.5283	* 1.3355	* 1.4748	* 1.0849
	* 1.2408	* 1.3176	* 1.4158	* 1.3771	* 1.2340	* 1.3673	* 1.2361	* 1.6527

10	* 1.4448	* 1.3612	* 1.2424	* 1.5197	* 1.4052	* 1.5240	* 1.2252	* .9082
	* 1.3319	* 1.4158	* 1.5429	* 1.2579	* 1.3596	* 1.2485	* 1.5470	* 1.9980

11	* 1.5562	* 1.3720	* 1.5187	* 1.2520	* 1.5294	* 1.4619	* 1.5262	* .8729
	* 1.2100	* 1.3771	* 1.2587	* 1.5323	* 1.2429	* 1.3029	* 1.2392	* 2.1458

12	* 1.3195	* 1.5283	* 1.4030	* 1.5283	* 1.2306	* 1.5123	* 1.2873	*
	* 1.4092	* 1.2347	* 1.3616	* 1.2437	* 1.5324	* 1.2466	* 1.4673	*

13	* 1.3462	* 1.3355	* 1.5240	* 1.4619	* 1.5123	* 1.2177	* .8547	*
	* 1.3533	* 1.3664	* 1.2467	* 1.3037	* 1.2467	* 1.5383	* 2.1932	*

14	* 1.3227	* 1.4748	* 1.2252	* 1.5262	* 1.2863	* .8547	*	*
	* 1.3664	* 1.2354	* 1.5470	* 1.2399	* 1.4683	* 2.1932	*	*

15	* 1.2499	* 1.0860	* .9071	* .8729	* F-SUB-Q			
	* 1.4302	* 1.6514	* 1.9998	* 2.1480	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.3559	* 1.6397	* 1.5219	* 1.6440	* 1.3912	* 1.4223	* 1.4041	* 1.3313
	* 1.4982	* 1.2356	* 1.3297	* 1.2183	* 1.4243	* 1.3628	* 1.3733	* 1.4309

9	* 1.6397	* 1.5412	* 1.4298	* 1.4469	* 1.6204	* 1.4148	* 1.5690	* 1.1503
	* 1.2356	* 1.3153	* 1.4137	* 1.3836	* 1.2321	* 1.3750	* 1.2372	* 1.6624

10	* 1.5219	* 1.4298	* 1.3034	* 1.6097	* 1.4908	* 1.6204	* 1.3013	* .9596
	* 1.3297	* 1.4140	* 1.5486	* 1.2471	* 1.3418	* 1.2323	* 1.5280	* 2.0111

11	* 1.6440	* 1.4469	* 1.6086	* 1.3205	* 1.6290	* 1.5562	* 1.6311	* .9264
	* 1.2183	* 1.3836	* 1.2480	* 1.5204	* 1.2259	* 1.2815	* 1.2146	* 2.1237

12	* 1.3912	* 1.6194	* 1.4887	* 1.6279	* 1.3055	* 1.6151	* 1.3741	*
	* 1.4243	* 1.2328	* 1.3435	* 1.2266	* 1.5290	* 1.2308	* 1.4434	*

13	* 1.4223	* 1.4159	* 1.6194	* 1.5551	* 1.6151	* 1.2959	* .9071	*
	* 1.3628	* 1.3742	* 1.2330	* 1.2823	* 1.2308	* 1.5286	* 2.1797	*

14	* 1.4041	* 1.5690	* 1.3013	* 1.6301	* 1.3741	* .9071	*	*
	* 1.3733	* 1.2372	* 1.5280	* 1.2148	* 1.4444	* 2.1797	*	*

15	* 1.3313	* 1.1513	* .9596	* .9264	* F-SUB-Q			
	* 1.4309	* 1.6599	* 2.0130	* 2.1258	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report Appendix A

Page 4 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3677	* 1.6643	* 1.5412	* 1.6718	* 1.4116	* 1.4459	* 1.4298	* 1.3591
	* 1.5630	* 1.2800	* 1.3808	* 1.2628	* 1.4871	* 1.4234	* 1.4319	* 1.4890
9	* 1.6643	* 1.5594	* 1.4459	* 1.4694	* 1.6547	* 1.4394	* 1.6033	* 1.1695
	* 1.2800	* 1.3678	* 1.4737	* 1.4345	* 1.2683	* 1.4338	* 1.2834	* 1.7362
10	* 1.5412	* 1.4459	* 1.3152	* 1.6418	* 1.5219	* 1.6590	* 1.3259	* .9735
	* 1.3808	* 1.4737	* 1.6157	* 1.2863	* 1.3826	* 1.2659	* 1.5777	* 2.1000
11	* 1.6718	* 1.4683	* 1.6408	* 1.3398	* 1.6675	* 1.5894	* 1.6718	* .9414
	* 1.2628	* 1.4355	* 1.2875	* 1.5766	* 1.2569	* 1.3186	* 1.2455	* 2.1924
12	* 1.4116	* 1.6536	* 1.5197	* 1.6665	* 1.3302	* 1.6558	* 1.4052	*
	* 1.4871	* 1.2690	* 1.3847	* 1.2576	* 1.5766	* 1.2593	* 1.4826	*
13	* 1.4459	* 1.4405	* 1.6579	* 1.5894	* 1.6558	* 1.3227	* .9221	*
	* 1.4234	* 1.4329	* 1.2673	* 1.3189	* 1.2593	* 1.5712	* 2.2452	*
14	* 1.4298	* 1.6033	* 1.3259	* 1.6718	* 1.4041	* .9211	*	*
	* 1.4319	* 1.2826	* 1.5777	* 1.2455	* 1.4833	* 2.2452	*	*
15	* 1.3591	* 1.1706	* .9725	* .9403	* F-SUB-Q			
	* 1.4890	* 1.7348	* 2.1000	* 2.1946	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3570	* 1.6643	* 1.5358	* 1.6750	* 1.4084	* 1.4448	* 1.4309	* 1.3623
	* 1.6588	* 1.3477	* 1.4555	* 1.3261	* 1.5719	* 1.5080	* 1.5143	* 1.5703
9	* 1.6643	* 1.5519	* 1.4384	* 1.4683	* 1.6633	* 1.4405	* 1.6119	* 1.1685
	* 1.3477	* 1.4475	* 1.5584	* 1.5108	* 1.3253	* 1.5141	* 1.3465	* 1.8367
10	* 1.5358	* 1.4373	* 1.3045	* 1.6504	* 1.5294	* 1.6708	* 1.3291	* .9703
	* 1.4555	* 1.5584	* 1.7081	* 1.3414	* 1.4448	* 1.3162	* 1.6499	* 2.2176
11	* 1.6750	* 1.4673	* 1.6493	* 1.3377	* 1.6815	* 1.5979	* 1.6858	* .9393
	* 1.3261	* 1.5118	* 1.3422	* 1.6622	* 1.3115	* 1.3787	* 1.2937	* 2.2980
12	* 1.4084	* 1.6622	* 1.5262	* 1.6804	* 1.3313	* 1.6697	* 1.4116	*
	* 1.5719	* 1.3261	* 1.4459	* 1.3118	* 1.6570	* 1.3128	* 1.5525	*
13	* 1.4448	* 1.4316	* 1.6697	* 1.5969	* 1.6697	* 1.3238	* .9200	*
	* 1.5080	* 1.5112	* 1.3177	* 1.3796	* 1.3128	* 1.6494	* 2.3625	*
14	* 1.4309	* 1.6129	* 1.3280	* 1.6847	* 1.4105	* .9200	*	*
	* 1.5143	* 1.3465	* 1.6499	* 1.2945	* 1.5532	* 2.3625	*	*
15	* 1.3623	* 1.1695	* .9693	* .9382	* F-SUB-Q			
	* 1.5703	* 1.8352	* 2.2188	* 2.3005	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 5 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3730	* 1.6943	* 1.5604	* 1.7093	* 1.4330	* 1.4716	* 1.4598	* 1.3923 *
	* 1.6523	* 1.3405	* 1.4519	* 1.3225	* 1.5766	* 1.5330	* 1.5440	* 1.6142 *
9	* 1.6943	* 1.5754	* 1.4576	* 1.4962	* 1.7040	* 1.4705	* 1.6515	* 1.1920 *
	* 1.3405	* 1.4403	* 1.5539	* 1.5095	* 1.3249	* 1.5352	* 1.3658	* 1.8869 *
10	* 1.5604	* 1.4576	* 1.3216	* 1.6890	* 1.5669	* 1.7147	* 1.3580	* .9864 *
	* 1.4519	* 1.5539	* 1.7111	* 1.3380	* 1.4470	* 1.3192	* 1.6676	* 2.2826 *
11	* 1.7093	* 1.4962	* 1.6868	* 1.3602	* 1.7254	* 1.6376	* 1.7329	* .9564 *
	* 1.3225	* 1.5095	* 1.3388	* 1.6625	* 1.3160	* 1.3886	* 1.3097	* 2.3623 *
12	* 1.4330	* 1.7029	* 1.5637	* 1.7243	* 1.3591	* 1.7157	* 1.4469	*
	* 1.5766	* 1.3257	* 1.4499	* 1.3168	* 1.6714	* 1.3273	* 1.5708	*
13	* 1.4716	* 1.4716	* 1.7125	* 1.6365	* 1.7157	* 1.3516	* .9371	*
	* 1.5330	* 1.5341	* 1.3200	* 1.3895	* 1.3273	* 1.6831	* 2.4230	*
14	* 1.4598	* 1.6515	* 1.3580	* 1.7329	* 1.4459	* .9371	*	
	* 1.5440	* 1.3658	* 1.6676	* 1.3105	* 1.5720	* 2.4230	*	
15	* 1.3923	* 1.1931	* .9853	* .9564	* F-SUB-Q			
	* 1.6142	* 1.8853	* 2.2850	* 2.3648	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3302	* 1.6547	* 1.5176	* 1.6740	* 1.3955	* 1.4341	* 1.4244	* 1.3645 *
	* 1.6612	* 1.3347	* 1.4538	* 1.3113	* 1.5731	* 1.5341	* 1.5440	* 1.6022 *
9	* 1.6547	* 1.5305	* 1.4148	* 1.4598	* 1.6740	* 1.4351	* 1.6204	* 1.1620 *
	* 1.3347	* 1.4461	* 1.5595	* 1.5033	* 1.3105	* 1.5287	* 1.3513	* 1.8820 *
10	* 1.5176	* 1.4148	* 1.2820	* 1.6579	* 1.5347	* 1.6868	* 1.3280	* .9607 *
	* 1.4538	* 1.5595	* 1.7138	* 1.3241	* 1.4346	* 1.3026	* 1.6561	* 2.2898 *
11	* 1.6740	* 1.4587	* 1.6558	* 1.3259	* 1.6986	* 1.6054	* 1.7061	* .9328 *
	* 1.3113	* 1.5043	* 1.3257	* 1.6587	* 1.2995	* 1.3762	* 1.2925	* 2.3648 *
12	* 1.3955	* 1.6718	* 1.5326	* 1.6975	* 1.3291	* 1.6890	* 1.4180	*
	* 1.5731	* 1.3113	* 1.4374	* 1.3002	* 1.6612	* 1.3097	* 1.5595	*
13	* 1.4341	* 1.4362	* 1.6858	* 1.6054	* 1.6890	* 1.3216	* .9136	*
	* 1.5341	* 1.5276	* 1.3042	* 1.3771	* 1.3097	* 1.6779	* 2.4339	*
14	* 1.4244	* 1.6215	* 1.3280	* 1.7050	* 1.4169	* .9136	*	
	* 1.5440	* 1.3513	* 1.6574	* 1.2933	* 1.5595	* 2.4367	*	
15	* 1.3645	* 1.1631	* .9596	* .9318	* F-SUB-Q			
	* 1.6022	* 1.8804	* 2.2898	* 2.3674	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 6 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.3377	* 1.6718	* 1.5337	* 1.6975	* 1.4116	* 1.4523	* 1.4448	* 1.3869
	* 1.6058	* 1.2841	* 1.4012	* 1.2587	* 1.5159	* 1.4703	* 1.4739	* 1.5192

9	* 1.6718	* 1.5433	* 1.4266	* 1.4769	* 1.6997	* 1.4555	* 1.6472	* 1.1781
	* 1.2841	* 1.3957	* 1.5053	* 1.4461	* 1.2558	* 1.4643	* 1.2914	* 1.7895

10	* 1.5337	* 1.4255	* 1.2916	* 1.6825	* 1.5604	* 1.7157	* 1.3495	* .9714
	* 1.4012	* 1.5064	* 1.6561	* 1.2690	* 1.3727	* 1.2457	* 1.5858	* 2.1820

11	* 1.6975	* 1.4769	* 1.6804	* 1.3398	* 1.7286	* 1.6333	* 1.7404	* .9446
	* 1.2587	* 1.4470	* 1.2705	* 1.5963	* 1.2392	* 1.3144	* 1.2308	* 2.2631

12	* 1.4116	* 1.6986	* 1.5572	* 1.7275	* 1.3473	* 1.7211	* 1.4437	*
	* 1.5159	* 1.2565	* 1.3754	* 1.2400	* 1.5905	* 1.2471	* 1.4868	*

13	* 1.4523	* 1.4566	* 1.7147	* 1.6322	* 1.7211	* 1.3420	* .9253	*
	* 1.4703	* 1.4633	* 1.2464	* 1.3152	* 1.2464	* 1.6034	* 2.3318	*

14	* 1.4448	* 1.6483	* 1.3484	* 1.7393	* 1.4426	* .9253	*	*
	* 1.4739	* 1.2910	* 1.5870	* 1.2315	* 1.4878	* 2.3343	*	*

15	* 1.3869	* 1.1792	* .9703	* .9436	* F-SUB-Q			
	* 1.5192	* 1.7880	* 2.1842	* 2.2655	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.3066	* 1.6429	* 1.5037	* 1.6718	* 1.3848	* 1.4255	* 1.4201	* 1.3666
	* 1.5895	* 1.2531	* 1.3628	* 1.2176	* 1.4681	* 1.4204	* 1.4228	* 1.4628

9	* 1.6429	* 1.5112	* 1.3955	* 1.4512	* 1.6772	* 1.4309	* 1.6258	* 1.1578
	* 1.2531	* 1.3688	* 1.4693	* 1.4029	* 1.2134	* 1.4124	* 1.2412	* 1.7295

10	* 1.5037	* 1.3955	* 1.2627	* 1.6590	* 1.5380	* 1.6954	* 1.3270	* .9521
	* 1.3628	* 1.4693	* 1.6118	* 1.2304	* 1.3328	* 1.2038	* 1.5357	* 2.1130

11	* 1.6718	* 1.4501	* 1.6568	* 1.3141	* 1.7082	* 1.6108	* 1.7211	* .9275
	* 1.2176	* 1.4038	* 1.2318	* 1.5576	* 1.2064	* 1.2780	* 1.1879	* 2.1837

12	* 1.3848	* 1.6761	* 1.5347	* 1.7072	* 1.3248	* 1.7018	* 1.4244	*
	* 1.4681	* 1.2145	* 1.3356	* 1.2071	* 1.5624	* 1.2153	* 1.4434	*

13	* 1.4255	* 1.4319	* 1.6943	* 1.6097	* 1.7018	* 1.3216	* .9082	*
	* 1.4204	* 1.4115	* 1.2049	* 1.2788	* 1.2153	* 1.5688	* 2.2667	*

14	* 1.4201	* 1.6258	* 1.3270	* 1.7211	* 1.4234	* .9082	*	*
	* 1.4228	* 1.2409	* 1.5368	* 1.1886	* 1.4444	* 2.2667	*	*

15	* 1.3666	* 1.1588	* .9510	* .9264	* F-SUB-Q			
	* 1.4628	* 1.7281	* 2.1151	* 2.1859	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 7 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 RFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2434	* 1.5744	* 1.4362	* 1.6044	* 1.3227	* 1.3612	* 1.3580	* 1.3098 *
	* 1.5743	* 1.2387	* 1.3542	* 1.2039	* 1.4602	* 1.4145	* 1.4154	* 1.4525 *

9	* 1.5744	* 1.4405	* 1.3302	* 1.3880	* 1.6129	* 1.3577	* 1.5615	* 1.1053 *
	* 1.2387	* 1.3586	* 1.4616	* 1.3920	* 1.1975	* 1.4044	* 1.2283	* 1.7240 *

10	* 1.4362	* 1.3302	* 1.2038	* 1.5947	* 1.4748	* 1.6322	* 1.2702	* .9071 *
	* 1.3542	* 1.4616	* 1.6057	* 1.2134	* 1.3167	* 1.1859	* 1.5217	* 2.1080 *

11	* 1.6044	* 1.3869	* 1.5926	* 1.2552	* 1.6440	* 1.5455	* 1.6558	* .8846 *
	* 1.2039	* 1.3928	* 1.2148	* 1.5454	* 1.1854	* 1.2612	* 1.1701	* 2.1740 *

12	* 1.3227	* 1.6108	* 1.4716	* 1.6429	* 1.2659	* 1.6376	* 1.3645	*
	* 1.4602	* 1.1985	* 1.3194	* 1.1860	* 1.5412	* 1.1924	* 1.4243	*

13	* 1.3612	* 1.3687	* 1.6301	* 1.5444	* 1.6376	* 1.2638	* .8664	*
	* 1.4145	* 1.4030	* 1.1870	* 1.2619	* 1.1924	* 1.5478	* 2.2484	*

14	* 1.3580	* 1.5615	* 1.2691	* 1.6547	* 1.3634	* .8664	*	
	* 1.4154	* 1.2279	* 1.5217	* 1.1703	* 1.4252	* 2.2484	*	

15	* 1.3098	* 1.1053	* .9061	* .8836	* F-SUB-Q			
	* 1.4525	* 1.7226	* 2.1101	* 2.1762	* M-SUB-Q			

AT 100% POWER, 4 RFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2188	* 1.5497	* 1.4137	* 1.5829	* 1.3023	* 1.3388	* 1.3355	* 1.2884 *
	* 1.5156	* 1.1909	* 1.3026	* 1.1558	* 1.4056	* 1.3661	* 1.3662	* 1.4031 *

9	* 1.5497	* 1.4159	* 1.3077	* 1.3677	* 1.5926	* 1.3462	* 1.5390	* 1.0849 *
	* 1.1909	* 1.3065	* 1.4079	* 1.3373	* 1.1488	* 1.3533	* 1.1822	* 1.6694 *

10	* 1.4137	* 1.3077	* 1.1824	* 1.5744	* 1.4566	* 1.6119	* 1.2509	* .8900 *
	* 1.3026	* 1.4079	* 1.5482	* 1.1640	* 1.2616	* 1.1374	* 1.4640	* 2.0439 *

11	* 1.5829	* 1.3677	* 1.5722	* 1.2349	* 1.6236	* 1.5251	* 1.6365	* .8686 *
	* 1.1558	* 1.3382	* 1.1653	* 1.4865	* 1.1347	* 1.2090	* 1.1206	* 2.1014 *

12	* 1.3023	* 1.5904	* 1.4533	* 1.6226	* 1.2456	* 1.6172	* 1.3462	*
	* 1.4056	* 1.1501	* 1.2642	* 1.1353	* 1.4784	* 1.1407	* 1.3666	*

13	* 1.3388	* 1.3473	* 1.6097	* 1.5240	* 1.6172	* 1.2434	* .8504	*
	* 1.3661	* 1.3525	* 1.1383	* 1.2097	* 1.1407	* 1.4866	* 2.1724	*

14	* 1.3355	* 1.5390	* 1.2499	* 1.6354	* 1.3452	* .8504	*	
	* 1.3662	* 1.1822	* 1.4640	* 1.1209	* 1.3675	* 2.1724	*	

15	* 1.2884	* 1.0860	* .8889	* .8675	* F-SUB-Q			
	* 1.4031	* 1.6668	* 2.0467	* 2.1035	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 8 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1331	* 1.4501	* 1.3205	* 1.4844	* 1.2145	* 1.2434	* 1.2391	* 1.1952
	* 1.5491	* 1.2096	* 1.3280	* 1.1732	* 1.4354	* 1.4028	* 1.4052	* 1.4438
9	* 1.4501	* 1.3195	* 1.2199	* 1.2798	* 1.4930	* 1.2520	* 1.4341	* 1.0035
	* 1.2096	* 1.3325	* 1.4367	* 1.3607	* 1.1654	* 1.3875	* 1.2088	* 1.7219
10	* 1.3205	* 1.2188	* 1.1021	* 1.4780	* 1.3623	* 1.5101	* 1.1620	* .8225
	* 1.3280	* 1.4377	* 1.5816	* 1.1791	* 1.2816	* 1.1539	* 1.4973	* 2.1088
11	* 1.4844	* 1.2788	* 1.4758	* 1.1513	* 1.5197	* 1.4234	* 1.5262	* .8022
	* 1.1732	* 1.3615	* 1.1804	* 1.5145	* 1.1502	* 1.2301	* 1.1414	* 2.1660
12	* 1.2145	* 1.4919	* 1.3602	* 1.5187	* 1.1588	* 1.5090	* 1.2509	*
	* 1.4354	* 1.1663	* 1.2843	* 1.1508	* 1.5087	* 1.1589	* 1.3961	*
13	* 1.2434	* 1.2531	* 1.5080	* 1.4223	* 1.5101	* 1.1524	* .7850	*
	* 1.4028	* 1.3862	* 1.1548	* 1.2312	* 1.1585	* 1.5210	* 2.2333	*
14	* 1.2391	* 1.4341	* 1.1620	* 1.5251	* 1.2499	* .7850	*	*
	* 1.4052	* 1.2088	* 1.4983	* 1.1420	* 1.3970	* 2.2333	*	*
15	* 1.1952	* 1.0046	* .8215	* .8011	* F-SUB-Q			
	* 1.4438	* 1.7206	* 2.1120	* 2.1682	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0699	* 1.3666	* 1.2477	* 1.4052	* 1.1524	* 1.1642	* 1.1535	* 1.1021
	* 1.5764	* 1.2325	* 1.3504	* 1.1907	* 1.4538	* 1.4418	* 1.4520	* 1.5058
9	* 1.3666	* 1.2456	* 1.1524	* 1.2177	* 1.4148	* 1.1738	* 1.3377	* .9296
	* 1.2325	* 1.3563	* 1.4611	* 1.3733	* 1.1809	* 1.4227	* 1.2458	* 1.7892
10	* 1.2477	* 1.1524	* 1.0464	* 1.4019	* 1.2948	* 1.4244	* 1.0881	* .7636
	* 1.3504	* 1.4611	* 1.6005	* 1.1924	* 1.2951	* 1.1733	* 1.5352	* 2.1873
11	* 1.4052	* 1.2177	* 1.4009	* 1.0956	* 1.4319	* 1.3409	* 1.4201	* .7411
	* 1.1907	* 1.3738	* 1.1937	* 1.5285	* 1.1707	* 1.2526	* 1.1759	* 2.2536
12	* 1.1524	* 1.4137	* 1.2916	* 1.4309	* 1.0892	* 1.4105	* 1.1642	*
	* 1.4538	* 1.1819	* 1.2974	* 1.1717	* 1.5378	* 1.1881	* 1.4380	*
13	* 1.1642	* 1.1749	* 1.4234	* 1.3398	* 1.4105	* 1.0721	* .7283	*
	* 1.4418	* 1.4218	* 1.1743	* 1.2537	* 1.1879	* 1.5653	* 2.3141	*
14	* 1.1535	* 1.3377	* 1.0881	* 1.4191	* 1.1631	* .7272	*	*
	* 1.4520	* 1.2451	* 1.5352	* 1.1765	* 1.4395	* 2.3152	*	*
15	* 1.1021	* .9307	* .7626	* .7401	* F-SUB-Q			
	* 1.5058	* 1.7877	* 2.1895	* 2.2560	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 9 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .9478 *	* 1.1888 *	* 1.0839 *	* 1.2391 *	* 1.0249 *	* 1.0046 *	* .9757 *	* .9018 *
	* 1.7283 *	* 1.3731 *	* 1.5111 *	* 1.3105 *	* 1.5873 *	* 1.6250 *	* 1.6697 *	* 1.7897 *

9	* 1.1888 *	* 1.0860 *	* 1.0035 *	* 1.0849 *	* 1.2434 *	* 1.0303 *	* 1.1299 *	* .7786 *
	* 1.3731 *	* 1.5105 *	* 1.6317 *	* 1.4964 *	* 1.3031 *	* 1.5752 *	* 1.4316 *	* 2.0766 *

10	* 1.0839 *	* 1.0035 *	* .9339 *	* 1.2370 *	* 1.1470 *	* 1.2434 *	* .9403 *	* .6458 *
	* 1.5111 *	* 1.6322 *	* 1.7438 *	* 1.3102 *	* 1.4164 *	* 1.3028 *	* 1.7238 *	* 2.5131 *

11	* 1.2391 *	* 1.0849 *	* 1.2359 *	* .9832 *	* 1.2541 *	* 1.1610 *	* 1.1770 *	* .6137 *
	* 1.3105 *	* 1.4975 *	* 1.3118 *	* 1.6492 *	* 1.2933 *	* 1.4022 *	* 1.3750 *	* 2.6473 *

12	* 1.0249 *	* 1.2424 *	* 1.1449 *	* 1.2531 *	* .9575 *	* 1.1942 *	* .9725 *	
	* 1.5873 *	* 1.3039 *	* 1.4188 *	* 1.2949 *	* 1.6966 *	* 1.3590 *	* 1.6692 *	

13	* 1.0046 *	* 1.0303 *	* 1.2424 *	* 1.1599 *	* 1.1942 *	* .9157 *	* .6126 *	
	* 1.6250 *	* 1.5752 *	* 1.3039 *	* 1.4031 *	* 1.3590 *	* 1.7771 *	* 2.6683 *	

14	* .9757 *	* 1.1299 *	* .9403 *	* 1.1770 *	* .9725 *	* .6126 *		
	* 1.6697 *	* 1.4307 *	* 1.7238 *	* 1.3750 *	* 1.6704 *	* 2.6702 *		

15	* .9018 *	* .7797 *	* .6458 *	* .6126 *	* F-SUB-Q			
	* 1.7897 *	* 2.0754 *	* 2.5160 *	* 2.6487 *	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

6	* .6319 *	* .7958 *	* .6844 *	* .8236 *	* .6812 *	* .6340 *	* .5965 *	* .5162 *
	* 2.5435 *	* 2.0074 *	* 2.3471 *	* 1.9302 *	* 2.3370 *	* 2.5274 *	* 2.6796 *	* 3.0645 *

9	* .7958 *	* .6940 *	* .6405 *	* .7208 *	* .8450 *	* .6737 *	* .6972 *	* .4680 *
	* 2.0074 *	* 2.3192 *	* 2.5124 *	* 2.2055 *	* 1.8758 *	* 2.3640 *	* 2.2685 *	* 3.3921 *

10	* .6844 *	* .6405 *	* .6255 *	* .8397 *	* .7551 *	* .8365 *	* .5987 *	* .3973 *
	* 2.3471 *	* 2.5140 *	* 2.5542 *	* 1.8889 *	* 2.1107 *	* 1.8948 *	* 2.6552 *	* 4.0141 *

11	* .8236 *	* .7197 *	* .8386 *	* .6694 *	* .8493 *	* .7358 *	* .6865 *	* .3641 *
	* 1.9302 *	* 2.2068 *	* 1.8905 *	* 2.3769 *	* 1.8661 *	* 2.1680 *	* 2.3085 *	* 4.3804 *

12	* .6812 *	* .8450 *	* .7540 *	* .8493 *	* .6394 *	* .7497 *	* .5773 *	
	* 2.3370 *	* 1.8765 *	* 2.1127 *	* 1.8677 *	* 2.4880 *	* 2.1180 *	* 2.7571 *	

13	* .6340 *	* .6737 *	* .8354 *	* .7358 *	* .7497 *	* .5708 *	* .3738 *	
	* 2.5274 *	* 2.3640 *	* 1.8964 *	* 2.1702 *	* 2.1180 *	* 2.7926 *	* 4.2851 *	

14	* .5965 *	* .6972 *	* .5987 *	* .6865 *	* .5762 *	* .3738 *		
	* 2.6796 *	* 2.2685 *	* 2.6552 *	* 2.3085 *	* 2.7606 *	* 4.2088 *		

15	* .5162 *	* .4680 *	* .3973 *	* .3641 *	* F-SUB-Q			
	* 3.0645 *	* 3.3921 *	* 4.0173 *	* 4.3854 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 10 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 HFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.6779	.8579	.7861	.8975	.7829	.7422	.6833	.5869
	* 2.0682	* 1.7974	* 2.0047	* 1.7135	* 1.9565	* 2.0374	* 2.1859	* 2.5233
9	.8579	.7700	.7647	.8204	.9061	.7700	.7658	.5430
	* 1.7974	* 1.9910	* 2.0564	* 1.8961	* 1.7114	* 1.9936	* 1.9623	* 2.7286
10	.7861	.7636	.7593	.9039	.8257	.8675	.6790	.4841
	* 2.0047	* 2.0585	* 2.0789	* 1.7398	* 1.9016	* 1.8003	* 2.2551	* 3.1046
11	.8975	.8193	.9039	.7604	.8686	.7690	.7186	.4380
	* 1.7135	* 1.8970	* 1.7406	* 2.0728	* 1.7898	* 2.0237	* 2.1945	* 3.5369
12	.7829	.9061	.8257	.8675	.6551	.7251	.6073	
	* 1.9565	* 1.7114	* 1.9024	* 1.7900	* 2.1151	* 1.9831	* 2.5222	
13	.7422	.7700	.8675	.7679	.7251	.5837	.4295	
	* 2.0374	* 1.9927	* 1.8003	* 2.0237	* 1.9831	* 2.4087	* 3.4820	
14	.6833	.7658	.6790	.7186	.6073	.4295		
	* 2.1859	* 1.9613	* 2.2539	* 2.1945	* 2.5222	* 3.4820		
15	.5869	.5430	.4841	.4380	F-SUB-Q			
	* 2.5233	* 2.7286	* 3.1046	* 3.5369	M-SUB-Q			

AT 100% POWER, 100 HFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.9928	1.1824	1.1128	1.2188	1.0678	1.0517	.9939	.9104
	* 1.5873	* 1.3860	* 1.4730	* 1.3144	* 1.4892	* 1.4919	* 1.5615	* 1.6884
9	1.1824	1.1117	1.0678	1.1181	1.2092	1.0592	1.1063	.8043
	* 1.3860	* 1.4659	* 1.5408	* 1.4452	* 1.3325	* 1.5058	* 1.4163	* 1.9159
10	1.1128	1.0678	1.0260	1.2092	1.1310	1.1845	.9361	.7058
	* 1.4730	* 1.5420	* 1.6011	* 1.3667	* 1.4442	* 1.3916	* 1.6998	* 2.2107
11	1.2188	1.1181	1.2092	1.0303	1.1899	1.1074	1.0999	.6512
	* 1.3144	* 1.4452	* 1.3676	* 1.5919	* 1.3762	* 1.4708	* 1.4902	* 2.4771
12	1.0678	1.2092	1.1299	1.1888	.9553	1.0935	.9200	
	* 1.4892	* 1.3325	* 1.4447	* 1.3763	* 1.6219	* 1.4447	* 1.7469	
13	1.0517	1.0592	1.1845	1.1074	1.0935	.8921	.6437	
	* 1.4919	* 1.5053	* 1.3921	* 1.4708	* 1.4447	* 1.7416	* 2.4481	
14	.9939	1.1063	.9371	1.0999	.9189	.6437		
	* 1.5615	* 1.4159	* 1.6983	* 1.4912	* 1.7482	* 2.4486		
15	.9104	.8043	.7058	.6501	F-SUB-Q			
	* 1.6884	* 1.9141	* 2.2131	* 2.4771	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 11 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 MFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1610	* 1.3784	* 1.2713	* 1.4019	* 1.1995	* 1.1995	* 1.1513	* 1.0849 *
	* 1.4738	* 1.2510	* 1.3470	* 1.1903	* 1.3813	* 1.3621	* 1.4025	* 1.4727 *
9	* 1.3784	* 1.2884	* 1.2113	* 1.2563	* 1.3934	* 1.1974	* 1.2938	* .9371 *
	* 1.2510	* 1.3384	* 1.4288	* 1.3421	* 1.2081	* 1.3762	* 1.2599	* 1.7102 *
10	* 1.2713	* 1.2113	* 1.1470	* 1.3934	* 1.2766	* 1.3762	* 1.0624	* .8150 *
	* 1.3470	* 1.4303	* 1.4969	* 1.2406	* 1.3360	* 1.2519	* 1.5676	* 1.9937 *
11	* 1.4019	* 1.2552	* 1.3923	* 1.1620	* 1.3859	* 1.2884	* 1.3088	* .7615 *
	* 1.1903	* 1.3421	* 1.2410	* 1.4801	* 1.2389	* 1.3281	* 1.3084	* 2.2208 *
12	* 1.1995	* 1.3923	* 1.2756	* 1.3848	* 1.1203	* 1.3109	* 1.0903	*
	* 1.3813	* 1.2081	* 1.3369	* 1.2397	* 1.5025	* 1.2802	* 1.5502	*
13	* 1.1995	* 1.1974	* 1.3752	* 1.2873	* 1.3109	* 1.0635	* .7593	*
	* 1.3621	* 1.3757	* 1.2523	* 1.3282	* 1.2802	* 1.5624	* 2.1948	*
14	* 1.1513	* 1.2938	* 1.0624	* 1.3088	* 1.0892	* .7593	*	*
	* 1.4025	* 1.2599	* 1.5676	* 1.3084	* 1.5514	* 2.1948	*	*
15	* 1.0849	* .9382	* .8150	* .7615	* F-SUB-Q			
	* 1.4727	* 1.7088	* 1.9956	* 2.2220	* M-SUB-Q			

AT 100% POWER, 100 MFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2413	* 1.4898	* 1.3548	* 1.5080	* 1.2756	* 1.2798	* 1.2381	* 1.1813 *
	* 1.4530	* 1.2172	* 1.3245	* 1.1591	* 1.3598	* 1.3367	* 1.3647	* 1.4151 *
9	* 1.4898	* 1.3816	* 1.2852	* 1.3345	* 1.5037	* 1.2788	* 1.4009	* 1.0110 *
	* 1.2172	* 1.3121	* 1.4166	* 1.3228	* 1.1741	* 1.3484	* 1.2183	* 1.6590 *
10	* 1.3548	* 1.2841	* 1.2134	* 1.5037	* 1.3645	* 1.4930	* 1.1395	* .8750 *
	* 1.3245	* 1.4174	* 1.4829	* 1.2049	* 1.3100	* 1.2091	* 1.5347	* 1.9457 *
11	* 1.5080	* 1.3345	* 1.5026	* 1.2402	* 1.5048	* 1.3934	* 1.4255	* .8225 *
	* 1.1591	* 1.3228	* 1.2056	* 1.4568	* 1.1984	* 1.2891	* 1.2578	* 2.1590 *
12	* 1.2756	* 1.5026	* 1.3634	* 1.5037	* 1.2038	* 1.4362	* 1.1856	*
	* 1.3598	* 1.1741	* 1.3108	* 1.1991	* 1.4764	* 1.2343	* 1.5004	*
13	* 1.2798	* 1.2788	* 1.4919	* 1.3934	* 1.4362	* 1.1578	* .8247	*
	* 1.3367	* 1.3475	* 1.2095	* 1.2897	* 1.2343	* 1.5182	* 2.1372	*
14	* 1.2381	* 1.4009	* 1.1395	* 1.4255	* 1.1856	* .8247	*	*
	* 1.3647	* 1.2176	* 1.5347	* 1.2578	* 1.5013	* 2.1375	*	*
15	* 1.1813	* 1.0110	* .8739	* .8215	* F-SUB-Q			
	* 1.4151	* 1.6583	* 1.9466	* 2.1613	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 12 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2499	* 1.5080	* 1.3645	* 1.5262	* 1.2841	* 1.2884	* 1.2520	* 1.1995
	* 1.5129	* 1.2559	* 1.3812	* 1.2052	* 1.4235	* 1.3991	* 1.4221	* 1.4668

9	* 1.5080	* 1.3923	* 1.2884	* 1.3441	* 1.5272	* 1.2916	* 1.4212	* 1.0217
	* 1.2559	* 1.3609	* 1.4698	* 1.3827	* 1.2156	* 1.4084	* 1.2626	* 1.7292

10	* 1.3645	* 1.2884	* 1.2177	* 1.5262	* 1.3827	* 1.5197	* 1.1524	* .8814
	* 1.3812	* 1.4707	* 1.5465	* 1.2314	* 1.3603	* 1.2316	* 1.5984	* 2.0333

11	* 1.5262	* 1.3430	* 1.5251	* 1.2509	* 1.5326	* 1.4159	* 1.4512	* .8300
	* 1.2052	* 1.3832	* 1.2321	* 1.5076	* 1.2272	* 1.3245	* 1.2846	* 2.2295

12	* 1.2841	* 1.5262	* 1.3816	* 1.5315	* 1.2188	* 1.4662	* 1.2049	*
	* 1.4235	* 1.2159	* 1.3611	* 1.2279	* 1.5313	* 1.2680	* 1.5453	*

13	* 1.2884	* 1.2916	* 1.5197	* 1.4148	* 1.4662	* 1.1760	* .8354	*
	* 1.3991	* 1.4075	* 1.2323	* 1.3253	* 1.2680	* 1.5737	* 2.2177	*

14	* 1.2520	* 1.4223	* 1.1513	* 1.4512	* 1.2049	* .8354	*	*
	* 1.4221	* 1.2622	* 1.5984	* 1.2853	* 1.5461	* 2.2183	*	*

15	* 1.1995	* 1.0217	* .8814	* .8300	* F-SUB-Q			
	* 1.4668	* 1.7292	* 2.0333	* 2.2316	* M-SUB-Q			

AT 100% POWER, 100 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2938	* 1.5690	* 1.4159	* 1.5904	* 1.3345	* 1.3377	* 1.3034	* 1.2531
	* 1.5310	* 1.2592	* 1.3911	* 1.2210	* 1.4493	* 1.4259	* 1.4455	* 1.4864

9	* 1.5690	* 1.4448	* 1.3334	* 1.3966	* 1.5947	* 1.3441	* 1.4844	* 1.0624
	* 1.2592	* 1.3683	* 1.4795	* 1.3990	* 1.2216	* 1.4311	* 1.2779	* 1.7595

10	* 1.4159	* 1.3334	* 1.2606	* 1.5936	* 1.4437	* 1.5904	* 1.1995	* .9157
	* 1.3911	* 1.4795	* 1.5597	* 1.2293	* 1.3541	* 1.2267	* 1.6151	* 2.0667

11	* 1.5904	* 1.3955	* 1.5926	* 1.3002	* 1.6033	* 1.4791	* 1.5187	* .8632
	* 1.2210	* 1.3997	* 1.2300	* 1.5089	* 1.2199	* 1.3188	* 1.2755	* 2.2359

12	* 1.3345	* 1.5936	* 1.4416	* 1.6022	* 1.2681	* 1.5358	* 1.2595	*
	* 1.4493	* 1.2218	* 1.3558	* 1.2212	* 1.5448	* 1.2681	* 1.5427	*

13	* 1.3377	* 1.3441	* 1.5894	* 1.4780	* 1.5358	* 1.2274	* .8707	*
	* 1.4259	* 1.4302	* 1.2274	* 1.3188	* 1.2674	* 1.5847	* 2.2317	*

14	* 1.3034	* 1.4844	* 1.1995	* 1.5187	* 1.2595	* .8697	*	*
	* 1.4455	* 1.2772	* 1.6151	* 1.2755	* 1.5439	* 2.2317	*	*

15	* 1.2531	* 1.0635	* .9146	* .8632	* F-SUB-Q			
	* 1.4864	* 1.7595	* 2.0687	* 2.2359	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 13 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.2948	1.5797	1.4201	1.6044	1.3398	1.3430	1.3098	1.2638
	1.5998	1.3070	1.4490	1.2694	1.5184	1.5001	1.5180	1.5573
9	1.5797	1.4491	1.3355	1.4041	1.6108	1.3527	1.4983	1.0667
	1.3070	1.4268	1.5475	1.4558	1.2632	1.4974	1.3334	1.8492
10	1.4201	1.3355	1.2627	1.6108	1.4576	1.6086	1.2070	.9168
	1.4490	1.5486	1.6303	1.2726	1.4027	1.2669	1.6801	2.1700
11	1.6044	1.4030	1.6097	1.3066	1.6226	1.4930	1.5358	.8654
	1.2694	1.4568	1.2734	1.5715	1.2598	1.3650	1.3181	2.3221
12	1.3398	1.6108	1.4555	1.6215	1.2745	1.5551	1.2713	
	1.5184	1.2637	1.4045	1.2605	1.6031	1.3055	1.5963	
13	1.3430	1.3527	1.6076	1.4919	1.5551	1.2359	.8739	
	1.5001	1.4974	1.2677	1.3650	1.3055	1.6385	2.3141	
14	1.3098	1.4983	1.2070	1.5358	1.2702	.8739		
	1.5180	1.3330	1.6801	1.3189	1.5964	2.3141		
15	1.2638	1.0678	.9168	.8654	F-SUB-Q			
	1.5573	1.8492	2.1711	2.3246	M-SUB-Q			

AT 100% POWER, 100 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.2809	1.5744	1.4105	1.6022	1.3313	1.3334	1.3023	1.2584
	1.6985	1.3768	1.5280	1.3350	1.6074	1.5916	1.6103	1.6471
9	1.5744	1.4373	1.3227	1.3966	1.6108	1.3462	1.4962	1.0592
	1.3768	1.5106	1.6356	1.5352	1.3226	1.5793	1.4037	1.9624
10	1.4105	1.3227	1.2509	1.6097	1.4544	1.6108	1.2006	.9082
	1.5280	1.6365	1.7214	1.3296	1.4687	1.3207	1.7659	2.2970
11	1.6022	1.3955	1.6086	1.2981	1.6236	1.4898	1.5358	.8579
	1.3350	1.5356	1.3304	1.6565	1.3169	1.4309	1.3746	2.4420
12	1.3313	1.6108	1.4533	1.6226	1.2670	1.5562	1.2670	
	1.6074	1.3234	1.4707	1.3183	1.6929	1.3665	1.6778	
13	1.3334	1.3462	1.6097	1.4887	1.5562	1.2295	.8664	
	1.5916	1.5785	1.3215	1.4318	1.3657	1.7259	2.4415	
14	1.3023	1.4962	1.2006	1.5358	1.2659	.8664		
	1.6103	1.4034	1.7659	1.3749	1.6788	2.4415		
15	1.2584	1.0603	.9082	.8579	F-SUB-Q			
	1.6471	1.9606	2.2978	2.4438	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 14 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2981	* 1.6054	* 1.4341	* 1.6376	* 1.3537	* 1.3537	* 1.3248	* 1.2831
	* 1.7498	* 1.4177	* 1.5823	* 1.3806	* 1.6702	* 1.6578	* 1.6749	* 1.7074
9	* 1.6054	* 1.4598	* 1.3409	* 1.4223	* 1.6493	* 1.3709	* 1.5294	* 1.0774
	* 1.4177	* 1.5573	* 1.6910	* 1.5928	* 1.3658	* 1.6386	* 1.4526	* 2.0382
10	* 1.4341	* 1.3409	* 1.2681	* 1.6472	* 1.4876	* 1.6493	* 1.2242	* .9221
	* 1.5823	* 1.6910	* 1.7873	* 1.3713	* 1.5145	* 1.3604	* 1.8245	* 2.3848
11	* 1.6376	* 1.4223	* 1.6461	* 1.3205	* 1.6633	* 1.5230	* 1.5733	* .8718
	* 1.3806	* 1.5928	* 1.3722	* 1.7151	* 1.3536	* 1.4740	* 1.4125	* 2.5258
12	* 1.3537	* 1.6483	* 1.4855	* 1.6622	* 1.2884	* 1.5947	* 1.2938	*
	* 1.6702	* 1.3667	* 1.5173	* 1.3547	* 1.7512	* 1.4021	* 1.7229	*
13	* 1.3537	* 1.3709	* 1.6493	* 1.5230	* 1.5947	* 1.2520	* .8804	*
	* 1.6578	* 1.6386	* 1.3613	* 1.4750	* 1.4021	* 1.7791	* 2.5160	*
14	* 1.3248	* 1.5294	* 1.2242	* 1.5733	* 1.2938	* .8804	*	*
	* 1.6749	* 1.4526	* 1.8245	* 1.4131	* 1.7243	* 2.5170	*	*
15	* 1.2831	* 1.0785	* .9221	* .8718	* F-SUB-Q			
	* 1.7074	* 2.0382	* 2.3874	* 2.5278	* M-SUB-Q			

AT 100% POWER, 100 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2670	* 1.5797	* 1.4041	* 1.6151	* 1.3270	* 1.3248	* 1.2991	* 1.2616
	* 1.7413	* 1.4030	* 1.5697	* 1.3710	* 1.6612	* 1.6574	* 1.6884	* 1.7343
9	* 1.5797	* 1.4287	* 1.3109	* 1.3955	* 1.6290	* 1.3452	* 1.5069	* 1.0571
	* 1.4030	* 1.5462	* 1.6805	* 1.5812	* 1.3607	* 1.6386	* 1.4617	* 2.0709
10	* 1.4041	* 1.3109	* 1.2402	* 1.6268	* 1.4651	* 1.6311	* 1.2027	* .9029
	* 1.5697	* 1.6805	* 1.7785	* 1.3650	* 1.5138	* 1.3607	* 1.8373	* 2.4258
11	* 1.6151	* 1.3955	* 1.6247	* 1.2948	* 1.6451	* 1.5005	* 1.5530	* .8536
	* 1.3710	* 1.5823	* 1.3658	* 1.7097	* 1.3530	* 1.4796	* 1.4279	* 2.5727
12	* 1.3270	* 1.6279	* 1.4630	* 1.6440	* 1.2627	* 1.5754	* 1.2734	*
	* 1.6612	* 1.3615	* 1.5159	* 1.3539	* 1.7554	* 1.4130	* 1.7413	*
13	* 1.3248	* 1.3462	* 1.6301	* 1.4994	* 1.5754	* 1.2295	* .8622	*
	* 1.6574	* 1.6386	* 1.3615	* 1.4807	* 1.4130	* 1.8037	* 2.5635	*
14	* 1.2991	* 1.5069	* 1.2027	* 1.5530	* 1.2723	* .8622	*	*
	* 1.6884	* 1.4617	* 1.8389	* 1.4279	* 1.7413	* 2.5635	*	*
15	* 1.2616	* 1.0571	* .9018	* .8536	* F-SUB-Q			
	* 1.7343	* 2.0690	* 2.4258	* 2.5757	* M-SUB-Q			

Page 15 of 143

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

	H	G	F	E	D	C	B	A
8	1.2788	1.6108	1.4266	1.6536	1.3484	1.3452	1.3238	1.2927
	1.6208	1.2857	1.4410	1.2455	1.5206	1.5161	1.5335	1.5623
9	1.6108	1.4480	1.3259	1.4212	1.6718	1.3709	1.5455	1.0764
	1.2857	1.4267	1.5489	1.4477	1.2343	1.4941	1.3206	1.8758
10	1.4266	1.3259	1.2531	1.6675	1.5005	1.6772	1.2284	.9157
	1.4410	1.5489	1.6382	1.2398	1.3777	1.2318	1.6721	2.2030
11	1.6536	1.4201	1.6665	1.3141	1.6911	1.5369	1.5990	.8675
	1.2455	1.4480	1.2412	1.5714	1.2271	1.3463	1.2873	2.3367
12	1.3484	1.6708	1.4983	1.6890	1.2831	1.6215	1.3055	*
	1.5206	1.2350	1.3804	1.2285	1.6190	1.2810	1.5783	*
13	1.3452	1.3720	1.6761	1.5358	1.6215	1.2563	.8771	*
	1.5161	1.4939	1.2325	1.3471	1.2804	1.6441	2.3355	*
14	1.3238	1.5455	1.2284	1.5990	1.3055	.8761	*	*
	1.5335	1.3200	1.6721	1.2875	1.5791	2.3355	*	*
15	1.2927	1.0774	.9146	.8675	F-SUB-Q			
	1.5623	1.8742	2.2053	2.3386	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 16 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2424	* 1.5744	* 1.3912	* 1.6194	* 1.3152	* 1.3109	* 1.2927	* 1.2649
	* 1.5895	* 1.2573	* 1.4146	* 1.2184	* 1.4949	* 1.4910	* 1.5068	* 1.5319

9	* 1.5744	* 1.4105	* 1.2906	* 1.3869	* 1.6397	* 1.3388	* 1.5144	* 1.0507
	* 1.2573	* 1.4002	* 1.5233	* 1.4204	* 1.2056	* 1.4670	* 1.2920	* 1.8450

10	* 1.3912	* 1.2906	* 1.2188	* 1.6343	* 1.4683	* 1.6461	* 1.2006	* .8911
	* 1.4146	* 1.5233	* 1.6129	* 1.2108	* 1.3477	* 1.2017	* 1.6373	* 2.1715

11	* 1.6194	* 1.3869	* 1.6333	* 1.2809	* 1.6590	* 1.5037	* 1.5701	* .8461
	* 1.2184	* 1.4211	* 1.2121	* 1.5428	* 1.1959	* 1.3158	* 1.2548	* 2.2970

12	* 1.3152	* 1.6386	* 1.4662	* 1.6568	* 1.2509	* 1.5915	* 1.2777	*
	* 1.4949	* 1.2062	* 1.3496	* 1.1972	* 1.5837	* 1.2461	* 1.5414	*

13	* 1.3109	* 1.3388	* 1.6451	* 1.5037	* 1.5915	* 1.2263	* .8536	*
	* 1.4910	* 1.4663	* 1.2024	* 1.3164	* 1.2454	* 1.6078	* 2.2928	*

14	* 1.2927	* 1.5144	* 1.2006	* 1.5690	* 1.2766	* .8536	*	*
	* 1.5068	* 1.2918	* 1.6382	* 1.2548	* 1.5425	* 2.2928	*	*

15	* 1.2649	* 1.0507	* .8900	* .8450	* F-SUB-Q			
	* 1.5319	* 1.8435	* 2.1737	* 2.2994	* M-SUB-Q			

AT 100% POWER, 100 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2477	* 1.5872	* 1.4019	* 1.6365	* 1.3248	* 1.3195	* 1.3023	* 1.2766
	* 1.5045	* 1.1859	* 1.3351	* 1.1468	* 1.4105	* 1.4086	* 1.4218	* 1.4440

9	* 1.5872	* 1.4191	* 1.2981	* 1.3987	* 1.6568	* 1.3495	* 1.5294	* 1.0581
	* 1.1859	* 1.3231	* 1.4395	* 1.3394	* 1.1347	* 1.3839	* 1.2170	* 1.7427

10	* 1.4019	* 1.2981	* 1.2252	* 1.6515	* 1.4833	* 1.6643	* 1.2113	* .8964
	* 1.3351	* 1.4398	* 1.5270	* 1.1401	* 1.2685	* 1.1305	* 1.5452	* 2.0579

11	* 1.6365	* 1.3987	* 1.6504	* 1.2884	* 1.6772	* 1.5197	* 1.5894	* .8514
	* 1.1468	* 1.3397	* 1.1413	* 1.4579	* 1.1258	* 1.2391	* 1.1799	* 2.1757

12	* 1.3248	* 1.6558	* 1.4812	* 1.6750	* 1.2584	* 1.6097	* 1.2916	*
	* 1.4105	* 1.1353	* 1.2705	* 1.1270	* 1.4961	* 1.1724	* 1.4528	*

13	* 1.3195	* 1.3495	* 1.6633	* 1.5187	* 1.6108	* 1.2359	* .8579	*
	* 1.4086	* 1.3837	* 1.1316	* 1.2398	* 1.1718	* 1.5195	* 2.1735	*

14	* 1.3023	* 1.5305	* 1.2113	* 1.5894	* 1.2906	* .8579	*	*
	* 1.4218	* 1.2165	* 1.5452	* 1.1799	* 1.4535	* 2.1751	*	*

15	* 1.2766	* 1.0581	* .8954	* .8504	* F-SUB-Q			
	* 1.4440	* 1.7417	* 2.0599	* 2.1757	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 17 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1910 *	* 1.5230 *	* 1.3452 *	* 1.5744 *	* 1.2702 *	* 1.2638 *	* 1.2466 *	* 1.2220 *
	* 1.4896 *	* 1.1688 *	* 1.3184 *	* 1.1298 *	* 1.3954 *	* 1.3961 *	* 1.4118 *	* 1.4351 *
9	* 1.5230 *	* 1.3591 *	* 1.2445 *	* 1.3430 *	* 1.5947 *	* 1.2938 *	* 1.4683 *	* 1.0110 *
	* 1.1688 *	* 1.3061 *	* 1.4229 *	* 1.3214 *	* 1.1165 *	* 1.3692 *	* 1.2030 *	* 1.7332 *
10	* 1.3452 *	* 1.2434 *	* 1.1727 *	* 1.5904 *	* 1.4255 *	* 1.6022 *	* 1.1610 *	* .8547 *
	* 1.3184 *	* 1.4236 *	* 1.5117 *	* 1.1216 *	* 1.2494 *	* 1.1125 *	* 1.5266 *	* 2.0508 *
11	* 1.5744 *	* 1.3430 *	* 1.5883 *	* 1.2338 *	* 1.6140 *	* 1.4587 *	* 1.5283 *	* .8118 *
	* 1.1298 *	* 1.3220 *	* 1.1227 *	* 1.4406 *	* 1.1063 *	* 1.2204 *	* 1.1612 *	* 2.1629 *
12	* 1.2702 *	* 1.5936 *	* 1.4234 *	* 1.6129 *	* 1.2038 *	* 1.5476 *	* 1.2391 *	
	* 1.3954 *	* 1.1175 *	* 1.2514 *	* 1.1074 *	* 1.4779 *	* 1.1521 *	* 1.4327 *	
13	* 1.2638 *	* 1.2938 *	* 1.6001 *	* 1.4587 *	* 1.5487 *	* 1.1813 *	* .8172 *	
	* 1.3961 *	* 1.3692 *	* 1.1135 *	* 1.2214 *	* 1.1517 *	* 1.5035 *	* 2.1607 *	
14	* 1.2466 *	* 1.4694 *	* 1.1610 *	* 1.5283 *	* 1.2381 *	* .8172 *		
	* 1.4118 *	* 1.2028 *	* 1.5274 *	* 1.1614 *	* 1.4334 *	* 2.1607 *		
15	* 1.2220 *	* 1.0110 *	* .8534 *	* .8107 *	F-SUB-Q			
	* 1.4351 *	* 1.7328 *	* 2.0548 *	* 2.1650 *	M-SUB-Q			

AT 100% POWER, 100 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1524 *	* 1.4716 *	* 1.3045 *	* 1.5272 *	* 1.2349 *	* 1.2231 *	* 1.1984 *	* 1.1674 *
	* 1.4750 *	* 1.1579 *	* 1.3019 *	* 1.1152 *	* 1.3752 *	* 1.3844 *	* 1.4084 *	* 1.4419 *
9	* 1.4716 *	* 1.3163 *	* 1.2070 *	* 1.3098 *	* 1.5476 *	* 1.2541 *	* 1.4137 *	* .9693 *
	* 1.1579 *	* 1.2914 *	* 1.4050 *	* 1.2987 *	* 1.1023 *	* 1.3545 *	* 1.1984 *	* 1.7364 *
10	* 1.3045 *	* 1.2070 *	* 1.1395 *	* 1.5444 *	* 1.3891 *	* 1.5519 *	* 1.1235 *	* .8193 *
	* 1.3019 *	* 1.4050 *	* 1.4908 *	* 1.1051 *	* 1.2284 *	* 1.1000 *	* 1.5131 *	* 2.0549 *
11	* 1.5272 *	* 1.3098 *	* 1.5433 *	* 1.2006 *	* 1.5658 *	* 1.4137 *	* 1.4726 *	* .7765 *
	* 1.1152 *	* 1.2993 *	* 1.1062 *	* 1.4181 *	* 1.0915 *	* 1.2064 *	* 1.1547 *	* 2.1695 *
12	* 1.2349 *	* 1.5465 *	* 1.3859 *	* 1.5647 *	* 1.1674 *	* 1.4919 *	* 1.1931 *	
	* 1.3752 *	* 1.1028 *	* 1.2305 *	* 1.0924 *	* 1.4586 *	* 1.1434 *	* 1.4246 *	
13	* 1.2231 *	* 1.2541 *	* 1.5497 *	* 1.4126 *	* 1.4919 *	* 1.1331 *	* .7818 *	
	* 1.3844 *	* 1.3537 *	* 1.1010 *	* 1.2071 *	* 1.1434 *	* 1.4997 *	* 2.1652 *	
14	* 1.1984 *	* 1.4137 *	* 1.1224 *	* 1.4716 *	* 1.1931 *	* .7818 *		
	* 1.4084 *	* 1.1984 *	* 1.5131 *	* 1.1548 *	* 1.4246 *	* 2.1652 *		
15	* 1.1674 *	* .9703 *	* .8182 *	* .7765 *	F-SUB-Q			
	* 1.4419 *	* 1.7364 *	* 2.0568 *	* 2.1717 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 18 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 100 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0410	* 1.3152	* 1.1631	* 1.3698	* 1.1213	* 1.0871	* 1.0496	* .9917
	* 1.5831	* 1.2565	* 1.4172	* 1.2065	* 1.4696	* 1.5124	* 1.5628	* 1.6493
9	* 1.3152	* 1.1738	* 1.0806	* 1.1899	* 1.3837	* 1.1278	* 1.2338	* .8429
	* 1.2565	* 1.4042	* 1.5244	* 1.3871	* 1.1951	* 1.4614	* 1.3339	* 1.9422
10	* 1.1631	* 1.0796	* 1.0357	* 1.3837	* 1.2574	* 1.3805	* 1.0046	* .7165
	* 1.4172	* 1.5254	* 1.5918	* 1.1960	* 1.3153	* 1.1983	* 1.6415	* 2.2839
11	* 1.3698	* 1.1899	* 1.3827	* 1.0967	* 1.3987	* 1.2574	* 1.2702	* .6694
	* 1.2065	* 1.3877	* 1.1971	* 1.5063	* 1.1844	* 1.3145	* 1.2980	* 2.4469
12	* 1.1213	* 1.3827	* 1.2552	* 1.3966	* 1.0592	* 1.3023	* 1.0378	*
	* 1.4696	* 1.1958	* 1.3177	* 1.1855	* 1.5589	* 1.2691	* 1.5886	*
13	* 1.0871	* 1.1278	* 1.3794	* 1.2563	* 1.3023	* .9907	* .6812	*
	* 1.5124	* 1.4614	* 1.1994	* 1.3151	* 1.2691	* 1.6661	* 2.4149	*
14	* 1.0496	* 1.2338	* 1.0035	* 1.2702	* 1.0367	* .6801	*	*
	* 1.5628	* 1.3339	* 1.6415	* 1.2982	* 1.5897	* 2.4156	*	*
15	* .9917	* .8429	* .7165	* .6694	* F-SUB-Q			
	* 1.6493	* 1.9409	* 2.2857	* 2.4497	* M-SUB-Q			

AT 100% POWER, 100 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .7122	* .8954	* .7636	* .9275	* .7658	* .7133	* .6715	* .5933
	* 2.2708	* 1.8063	* 2.1173	* 1.7449	* 2.1126	* 2.2625	* 2.3963	* 2.7074
9	* .8954	* .7765	* .7144	* .8107	* .9564	* .7604	* .7915	* .5312
	* 1.8063	* 2.0837	* 2.2613	* 1.9954	* 1.6941	* 2.1281	* 2.0362	* 3.0248
10	* .7636	* .7144	* .7111	* .9521	* .8514	* .9446	* .6683	* .4573
	* 2.1173	* 2.2613	* 2.2750	* 1.7021	* 1.9030	* 1.7135	* 2.4197	* 3.5166
11	* .9275	* .8107	* .9510	* .7593	* .9618	* .8268	* .7775	* .4177
	* 1.7449	* 1.9573	* 1.7034	* 2.1329	* 1.6852	* 1.9598	* 2.0781	* 3.8543
12	* .7658	* .9553	* .8504	* .9607	* .7283	* .8493	* .6480	*
	* 2.1126	* 1.6945	* 1.9060	* 1.6865	* 2.2219	* 1.9072	* 2.4934	*
13	* .7133	* .7604	* .9446	* .8257	* .8493	* .6437	* .4305	*
	* 2.2625	* 2.1266	* 1.7149	* 1.9611	* 1.9072	* 2.5129	* 3.7428	*
14	* .6715	* .7915	* .6683	* .7765	* .6480	* .4305	*	*
	* 2.3963	* 2.0362	* 2.4197	* 2.0801	* 2.4956	* 3.7476	*	*
15	* .5933	* .5312	* .4562	* .4166	* F-SUB-Q			
	* 2.7074	* 3.0248	* 3.5181	* 3.8594	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 19 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.7733	.9885	.9157	1.0367	.9211	.8943	.8439	.7593
	1.7540	1.5780	1.7768	1.5369	1.7203	1.7551	1.8412	2.0334
9	.9885	.8986	.9029	.9607	1.0517	.9211	.9371	.6919
	1.5780	1.7417	1.8015	1.6764	1.5272	1.7292	1.6676	2.2393
10	.9157	.9018	.8986	1.0496	.9725	1.0271	.8343	.6351
	1.7768	1.8021	1.8172	1.5520	1.6714	1.5770	1.9126	2.4682
11	1.0367	.9596	1.0485	.9061	1.0249	.9264	.8932	.5783
	1.5369	1.6764	1.5525	1.7633	1.5494	1.7211	1.8163	2.7816
12	.9211	1.0517	.9725	1.0249	.7883	.8932	.7572	
	1.7203	1.5272	1.6714	1.5502	1.7271	1.6359	2.0734	
13	.8943	.9211	1.0271	.9264	.8932	.7476	.5741	
	1.7551	1.7292	1.5770	1.7211	1.6359	1.9631	2.6722	
14	.8439	.9371	.8343	.8932	.7572	.5730		
	1.8412	1.6662	1.9119	1.8163	2.0734	2.6722		
15	.7593	.6919	.6340	.5783	F-SUB-Q			
	2.0334	2.2393	2.4682	2.7816	M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.0603	1.2627	1.1610	1.3120	1.1395	1.1331	1.0881	1.0357
	1.5049	1.3078	1.4529	1.2549	1.4359	1.4294	1.4741	1.5374
9	1.2627	1.1652	1.1267	1.1920	1.3141	1.1513	1.2113	.9093
	1.3078	1.4203	1.4938	1.3958	1.2601	1.4307	1.3366	1.7583
10	1.1610	1.1256	1.1085	1.3109	1.2134	1.2948	1.0474	.8300
	1.4529	1.4956	1.5260	1.2906	1.3865	1.3064	1.5753	1.9503
11	1.3120	1.1920	1.3109	1.1278	1.3013	1.1995	1.2006	.7658
	1.2549	1.3958	1.2914	1.4766	1.2727	1.3850	1.3965	2.1762
12	1.1395	1.3141	1.2134	1.3002	1.0614	1.2124	1.0132	
	1.4359	1.2601	1.3870	1.2727	1.4818	1.3226	1.6192	
13	1.1331	1.1513	1.2948	1.1995	1.2124	1.0153	.7700	
	1.4294	1.4303	1.3064	1.3850	1.3226	1.5618	2.0910	
14	1.0881	1.2124	1.0474	1.2006	1.0132	.7700		
	1.4741	1.3363	1.5753	1.3965	1.6196	2.0917		
15	1.0357	.9093	.8290	.7658	F-SUB-Q			
	1.5374	1.7583	1.9514	2.1762	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 20 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1738	* 1.3944	* 1.2456	* 1.4276	* 1.2145	* 1.2145	* 1.1760	* 1.1449 *
	* 1.4739	* 1.2453	* 1.4023	* 1.1901	* 1.3920	* 1.3755	* 1.4073	* 1.4338 *
9	* 1.3944	* 1.2691	* 1.1995	* 1.3713	* 1.4330	* 1.2316	* 1.3259	* .9907 *
	* 1.2453	* 1.3715	* 1.4548	* 1.3530	* 1.1929	* 1.3789	* 1.2586	* 1.6662 *
10	* 1.2456	* 1.1995	* 1.1781	* 1.4309	* 1.3013	* 1.4212	* 1.1192	* .8986 *
	* 1.4023	* 1.4554	* 1.4881	* 1.2230	* 1.3395	* 1.2317	* 1.5244	* 1.8586 *
11	* 1.4276	* 1.2713	* 1.4309	* 1.2102	* 1.4362	* 1.3077	* 1.3248	* .8311 *
	* 1.1901	* 1.3530	* 1.2234	* 1.4387	* 1.2053	* 1.3264	* 1.3142	* 2.0749 *
12	* 1.2145	* 1.4330	* 1.3002	* 1.4351	* 1.1760	* 1.3602	* 1.1160	*
	* 1.3920	* 1.1929	* 1.3404	* 1.2058	* 1.4531	* 1.2521	* 1.5382	*
13	* 1.2145	* 1.2316	* 1.4201	* 1.3077	* 1.3602	* 1.1256	* .8493	*
	* 1.3755	* 1.3783	* 1.2320	* 1.3267	* 1.2521	* 1.4997	* 1.9963	*
14	* 1.1760	* 1.3259	* 1.1192	* 1.3248	* 1.1160	* .8482	*	*
	* 1.4073	* 1.2581	* 1.5244	* 1.3142	* 1.5385	* 1.9983	*	*
15	* 1.1449	* .9907	* .8986	* .8311	* F-SUB-Q			
	* 1.4338	* 1.6662	* 1.8586	* 2.0749	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1995	* 1.4405	* 1.2681	* 1.4641	* 1.2349	* 1.2349	* 1.2017	* 1.1802 *
	* 1.5112	* 1.2608	* 1.4295	* 1.2019	* 1.4174	* 1.3997	* 1.4251	* 1.4386 *
9	* 1.4405	* 1.2981	* 1.2156	* 1.2916	* 1.4748	* 1.2541	* 1.3634	* 1.0153 *
	* 1.2608	* 1.4016	* 1.4920	* 1.3800	* 1.2015	* 1.4035	* 1.2667	* 1.6808 *
10	* 1.2681	* 1.2156	* 1.1942	* 1.4737	* 1.3313	* 1.4673	* 1.1385	* .9189 *
	* 1.4295	* 1.4926	* 1.5218	* 1.2324	* 1.3612	* 1.2372	* 1.5513	* 1.8835 *
11	* 1.4641	* 1.2916	* 1.4737	* 1.2338	* 1.4855	* 1.3420	* 1.3645	* .8504 *
	* 1.2019	* 1.3800	* 1.2327	* 1.4725	* 1.2167	* 1.3462	* 1.3284	* 2.1044 *
12	* 1.2349	* 1.4737	* 1.3302	* 1.4855	* 1.2038	* 1.4105	* 1.1503	*
	* 1.4174	* 1.2015	* 1.3621	* 1.2169	* 1.4901	* 1.2675	* 1.5606	*
13	* 1.2349	* 1.2541	* 1.4662	* 1.3420	* 1.4105	* 1.1610	* .8750	*
	* 1.3997	* 1.4026	* 1.2372	* 1.3482	* 1.2669	* 1.5309	* 2.0375	*
14	* 1.2017	* 1.3634	* 1.1385	* 1.3645	* 1.1503	* .8739	*	*
	* 1.4251	* 1.2662	* 1.5513	* 1.3284	* 1.5617	* 2.0381	*	*
15	* 1.1802	* 1.0153	* .9178	* .8504	* F-SUB-Q			
	* 1.4386	* 1.6821	* 1.8845	* 2.1053	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 21 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1706	* 1.4137	* 1.2381	* 1.4341	* 1.2038	* 1.2049	* 1.1749	* 1.1588
	* 1.6049	* 1.3282	* 1.5123	* 1.2756	* 1.5128	* 1.4951	* 1.5174	* 1.5252
9	* 1.4137	* 1.2681	* 1.1824	* 1.2595	* 1.4469	* 1.2242	* 1.3377	* .9928
	* 1.3282	* 1.4828	* 1.5853	* 1.4711	* 1.2724	* 1.4956	* 1.3425	* 1.7902
10	* 1.2381	* 1.1824	* 1.1631	* 1.4469	* 1.3023	* 1.4416	* 1.1117	* .8954
	* 1.5123	* 1.5865	* 1.6095	* 1.2927	* 1.4387	* 1.2958	* 1.6523	* 2.0098
11	* 1.4341	* 1.2595	* 1.4469	* 1.2038	* 1.4608	* 1.3152	* 1.3398	* .8290
	* 1.2756	* 1.4711	* 1.2927	* 1.5593	* 1.2798	* 1.4221	* 1.3954	* 2.2363
12	* 1.2038	* 1.4469	* 1.3013	* 1.4608	* 1.1760	* 1.3869	* 1.1288	*
	* 1.5128	* 1.2724	* 1.4396	* 1.2803	* 1.5869	* 1.3408	* 1.6521	*
13	* 1.2049	* 1.2242	* 1.4416	* 1.3152	* 1.3869	* 1.1374	* .8557	*
	* 1.4951	* 1.4956	* 1.2958	* 1.4227	* 1.3408	* 1.6318	* 2.1743	*
14	* 1.1749	* 1.3377	* 1.1117	* 1.3398	* 1.1278	* .8557	*	*
	* 1.5174	* 1.3422	* 1.6523	* 1.3954	* 1.6534	* 2.1757	*	*
15	* 1.1588	* .9928	* .8954	* .8290	* F-SUB-Q			
	* 1.5252	* 1.7902	* 2.0107	* 2.2386	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1845	* 1.4384	* 1.2531	* 1.4576	* 1.2199	* 1.2188	* 1.1920	* 1.1802
	* 1.6394	* 1.3452	* 1.5392	* 1.3070	* 1.5580	* 1.5429	* 1.5626	* 1.5655
9	* 1.4384	* 1.2841	* 1.1952	* 1.2766	* 1.4726	* 1.2413	* 1.3612	* 1.0089
	* 1.3452	* 1.5076	* 1.6172	* 1.5038	* 1.2970	* 1.5347	* 1.3766	* 1.8409
10	* 1.2531	* 1.1952	* 1.1730	* 1.4726	* 1.3216	* 1.4694	* 1.1267	* .9082
	* 1.5392	* 1.6172	* 1.6395	* 1.3065	* 1.4550	* 1.3064	* 1.6890	* 2.0676
11	* 1.4576	* 1.2766	* 1.4716	* 1.2199	* 1.4876	* 1.3355	* 1.3634	* .8407
	* 1.3070	* 1.5038	* 1.3073	* 1.5822	* 1.2937	* 1.4402	* 1.4061	* 2.2760
12	* 1.2199	* 1.4726	* 1.3205	* 1.4876	* 1.1920	* 1.4126	* 1.1481	*
	* 1.5580	* 1.2974	* 1.4560	* 1.2945	* 1.6229	* 1.3647	* 1.6764	*
13	* 1.2188	* 1.2413	* 1.4683	* 1.3355	* 1.4126	* 1.1556	* .8697	*
	* 1.5429	* 1.5342	* 1.3064	* 1.4402	* 1.3647	* 1.6710	* 2.2196	*
14	* 1.1920	* 1.3623	* 1.1267	* 1.3634	* 1.1481	* .8686	*	*
	* 1.5626	* 1.3762	* 1.6890	* 1.4061	* 1.6776	* 2.2219	*	*
15	* 1.1802	* 1.0089	* .9082	* .8397	* F-SUB-Q			
	* 1.5655	* 1.8418	* 2.0685	* 2.2766	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 22 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.1727	* 1.4309	* 1.2424	* 1.4501	* 1.2092	* 1.2070	* 1.1824	* 1.1738 *
	* 1.7098	* 1.3954	* 1.6085	* 1.3613	* 1.6327	* 1.6261	* 1.6454	* 1.6447 *

9	* 1.4309	* 1.2723	* 1.1824	* 1.2649	* 1.4662	* 1.2306	* 1.3548	* 1.0003 *
	* 1.3954	* 1.5715	* 1.6937	* 1.5677	* 1.3471	* 1.6023	* 1.4407	* 1.9360 *

10	* 1.2424	* 1.1824	* 1.1631	* 1.4662	* 1.3130	* 1.4630	* 1.1171	* .8996 *
	* 1.6085	* 1.6937	* 1.7189	* 1.3575	* 1.5137	* 1.3548	* 1.7623	* 2.1701 *

11	* 1.4501	* 1.2649	* 1.4651	* 1.2070	* 1.4823	* 1.3259	* 1.3570	* .8311 *
	* 1.3613	* 1.5677	* 1.3575	* 1.6506	* 1.3396	* 1.4968	* 1.4583	* 2.3682 *

12	* 1.2092	* 1.4651	* 1.3109	* 1.4812	* 1.1802	* 1.4062	* 1.1406	*
	* 1.6327	* 1.3471	* 1.5148	* 1.3405	* 1.6879	* 1.4105	* 1.7395	*

13	* 1.2070	* 1.2306	* 1.4630	* 1.3259	* 1.4062	* 1.1460	* .8611	*
	* 1.6261	* 1.6023	* 1.3557	* 1.4969	* 1.4096	* 1.7324	* 2.3045	*

14	* 1.1824	* 1.3559	* 1.1171	* 1.3570	* 1.1395	* .8600	*	*
	* 1.6454	* 1.4397	* 1.7623	* 1.4583	* 1.7395	* 2.3069	*	*

15	* 1.1738	* 1.0003	* .8986	* .8311	* F-SUB-Q			
	* 1.6447	* 1.9370	* 2.1711	* 2.3708	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.1567	* 1.4201	* 1.2274	* 1.4384	* 1.1942	* 1.1910	* 1.1685	* 1.1620 *
	* 1.8041	* 1.4631	* 1.6875	* 1.4263	* 1.7218	* 1.7171	* 1.7377	* 1.7325 *

9	* 1.4201	* 1.2584	* 1.1663	* 1.2509	* 1.4555	* 1.2156	* 1.3441	* .9885 *
	* 1.4631	* 1.6561	* 1.7808	* 1.6469	* 1.4076	* 1.6848	* 1.5118	* 2.0423 *

10	* 1.2274	* 1.1663	* 1.1460	* 1.4555	* 1.3002	* 1.4533	* 1.1021	* .8868 *
	* 1.6875	* 1.7814	* 1.8053	* 1.4144	* 1.5837	* 1.4096	* 1.8504	* 2.2860 *

11	* 1.4384	* 1.2509	* 1.4544	* 1.1930	* 1.4716	* 1.3120	* 1.3452	* .8182 *
	* 1.4263	* 1.6469	* 1.4153	* 1.7372	* 1.3996	* 1.5684	* 1.5209	* 2.4846 *

12	* 1.1942	* 1.4555	* 1.2981	* 1.4716	* 1.1642	* 1.3955	* 1.1278	*
	* 1.7218	* 1.4076	* 1.5849	* 1.4001	* 1.7783	* 1.4746	* 1.8247	*

13	* 1.1910	* 1.2167	* 1.4533	* 1.3120	* 1.3955	* 1.1320	* .8482	*
	* 1.7171	* 1.6841	* 1.4096	* 1.5689	* 1.4746	* 1.8184	* 2.4245	*

14	* 1.1685	* 1.3452	* 1.1021	* 1.3452	* 1.1278	* .8482	*	*
	* 1.7377	* 1.5112	* 1.8504	* 1.5209	* 1.8262	* 2.4246	*	*

15	* 1.1620	* .9885	* .8857	* .8182	* F-SUB-Q			
	* 1.7325	* 2.0423	* 2.2860	* 2.4859	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 23 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1706 *	* 1.4469 *	* 1.2434 *	* 1.4641 *	* 1.2102 *	* 1.2059 *	* 1.1845 *	* 1.1824 *
	* 1.8636 *	* 1.5019 *	* 1.7482 *	* 1.4721 *	* 1.7852 *	* 1.7831 *	* 1.8011 *	* 1.7887 *
9	* 1.4469 *	* 1.2745 *	* 1.1802 *	* 1.2681 *	* 1.4833 *	* 1.2327 *	* 1.3698 *	* 1.0035 *
	* 1.5019 *	* 1.7088 *	* 1.8439 *	* 1.7045 *	* 1.4506 *	* 1.7438 *	* 1.5587 *	* 2.1113 *
10	* 1.2434 *	* 1.1802 *	* 1.1599 *	* 1.4823 *	* 1.3205 *	* 1.4823 *	* 1.1181 *	* .8986 *
	* 1.7482 *	* 1.8439 *	* 1.8688 *	* 1.4550 *	* 1.6330 *	* 1.4475 *	* 1.9116 *	* 2.3623 *
11	* 1.4641 *	* 1.2681 *	* 1.4823 *	* 1.2081 *	* 1.5005 *	* 1.3323 *	* 1.3687 *	* .8300 *
	* 1.4721 *	* 1.7052 *	* 1.4555 *	* 1.7927 *	* 1.4341 *	* 1.6149 *	* 1.5622 *	* 2.5618 *
12	* 1.2102 *	* 1.4833 *	* 1.3195 *	* 1.4994 *	* 1.1792 *	* 1.4212 *	* 1.1470 *	
	* 1.7852 *	* 1.4506 *	* 1.6342 *	* 1.4351 *	* 1.8339 *	* 1.5127 *	* 1.8698 *	
13	* 1.2059 *	* 1.2327 *	* 1.4823 *	* 1.3323 *	* 1.4212 *	* 1.1481 *	* .8600 *	
	* 1.7831 *	* 1.7438 *	* 1.4475 *	* 1.6156 *	* 1.5127 *	* 1.8691 *	* 2.4870 *	
14	* 1.1845 *	* 1.3698 *	* 1.1181 *	* 1.3687 *	* 1.1460 *	* .8600 *		
	* 1.8011 *	* 1.5587 *	* 1.9116 *	* 1.5622 *	* 1.8698 *	* 2.4899 *		
15	* 1.1824 *	* 1.0035 *	* .8986 *	* .8290 *	* F-SUB-Q			
	* 1.7887 *	* 2.1113 *	* 2.3648 *	* 2.5649 *	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1503 *	* 1.4309 *	* 1.2242 *	* 1.4480 *	* 1.1899 *	* 1.1845 *	* 1.1652 *	* 1.1663 *
	* 1.9376 *	* 1.5652 *	* 1.8188 *	* 1.5473 *	* 1.8739 *	* 1.8755 *	* 1.9018 *	* 1.8952 *
9	* 1.4309 *	* 1.2541 *	* 1.1588 *	* 1.2488 *	* 1.4673 *	* 1.2134 *	* 1.3527 *	* .9885 *
	* 1.5652 *	* 1.7770 *	* 1.9170 *	* 1.7888 *	* 1.5287 *	* 1.8389 *	* 1.6486 *	* 2.2378 *
10	* 1.2242 *	* 1.1588 *	* 1.1395 *	* 1.4673 *	* 1.3013 *	* 1.4673 *	* 1.0999 *	* .8825 *
	* 1.8188 *	* 1.9187 *	* 1.9568 *	* 1.5320 *	* 1.7219 *	* 1.5320 *	* 2.0226 *	* 2.5014 *
11	* 1.4480 *	* 1.2488 *	* 1.4662 *	* 1.1867 *	* 1.4855 *	* 1.3130 *	* 1.3527 *	* .8140 *
	* 1.5473 *	* 1.7888 *	* 1.5320 *	* 1.8836 *	* 1.5148 *	* 1.7057 *	* 1.6523 *	* 2.7179 *
12	* 1.1899 *	* 1.4673 *	* 1.3002 *	* 1.4844 *	* 1.1588 *	* 1.4041 *	* 1.1299 *	
	* 1.8739 *	* 1.5298 *	* 1.7233 *	* 1.5159 *	* 1.9324 *	* 1.5987 *	* 1.9765 *	
13	* 1.1845 *	* 1.2134 *	* 1.4673 *	* 1.3130 *	* 1.4041 *	* 1.1299 *	* .8450 *	
	* 1.8755 *	* 1.8373 *	* 1.5320 *	* 1.7057 *	* 1.5975 *	* 1.9765 *	* 2.6321 *	
14	* 1.1652 *	* 1.3527 *	* 1.0999 *	* 1.3527 *	* 1.1299 *	* .8439 *		
	* 1.9018 *	* 1.6486 *	* 2.0226 *	* 1.6523 *	* 1.9765 *	* 2.6321 *		
15	* 1.1663 *	* .9875 *	* .8825 *	* .8140 *	* F-SUB-Q			
	* 1.8952 *	* 2.2378 *	* 2.5043 *	* 2.7179 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 24 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1770	* 1.4694	* 1.2520	* 1.4865	* 1.2177	* 1.2113	* 1.1942	* 1.1984
	* 1.8173	* 1.4607	* 1.7070	* 1.4461	* 1.7583	* 1.7611	* 1.7836	* 1.7690
9	* 1.4694	* 1.2841	* 1.1845	* 1.2788	* 1.5080	* 1.2424	* 1.3891	* 1.0132
	* 1.4607	* 1.6663	* 1.8007	* 1.6779	* 1.4279	* 1.7247	* 1.5396	* 2.0909
10	* 1.2520	* 1.1845	* 1.1642	* 1.5069	* 1.3334	* 1.5080	* 1.1267	* .9050
	* 1.7070	* 1.8007	* 1.8389	* 1.4308	* 1.6130	* 1.4298	* 1.8952	* 2.3406
11	* 1.4865	* 1.2777	* 1.5069	* 1.2145	* 1.5262	* 1.3452	* 1.3880	* .8343
	* 1.4461	* 1.6779	* 1.4308	* 1.7683	* 1.4149	* 1.5987	* 1.5451	* 2.5440
12	* 1.2177	* 1.5080	* 1.3323	* 1.5262	* 1.1845	* 1.4416	* 1.1588	*
	* 1.7583	* 1.4279	* 1.6154	* 1.4158	* 1.8127	* 1.4929	* 1.8483	*
13	* 1.2113	* 1.2424	* 1.5080	* 1.3452	* 1.4426	* 1.1588	* .8654	*
	* 1.7611	* 1.7233	* 1.4298	* 1.5987	* 1.4929	* 1.8499	* 2.4644	*
14	* 1.1942	* 1.3891	* 1.1267	* 1.3880	* 1.1588	* .8654	*	*
	* 1.7836	* 1.5396	* 1.8952	* 1.5451	* 1.8483	* 2.4644	*	*
15	* 1.1984	* 1.0132	* .9039	* .8332	* F-SUB-Q			
	* 1.7690	* 2.0919	* 2.3431	* 2.5440	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1835	* 1.4855	* 1.2606	* 1.5005	* 1.2252	* 1.2177	* 1.2027	* 1.2102
	* 1.7413	* 1.3922	* 1.6330	* 1.3771	* 1.6799	* 1.6831	* 1.6990	* 1.6818
9	* 1.4855	* 1.2927	* 1.1910	* 1.2873	* 1.5240	* 1.2499	* 1.4030	* 1.0217
	* 1.3922	* 1.5951	* 1.7254	* 1.6034	* 1.3590	* 1.6467	* 1.4637	* 1.9919
10	* 1.2606	* 1.1910	* 1.1695	* 1.5230	* 1.3441	* 1.5251	* 1.1342	* .9104
	* 1.6330	* 1.7261	* 1.7611	* 1.3624	* 1.5412	* 1.3594	* 1.8082	* 2.2332
11	* 1.5005	* 1.2863	* 1.5219	* 1.2209	* 1.5422	* 1.3548	* 1.4009	* .8386
	* 1.3771	* 1.6040	* 1.3632	* 1.6937	* 1.3463	* 1.5271	* 1.4711	* 2.4258
12	* 1.2252	* 1.5240	* 1.3420	* 1.5422	* 1.1910	* 1.4566	* 1.1695	*
	* 1.6799	* 1.3590	* 1.5429	* 1.3471	* 1.7357	* 1.4223	* 1.7619	*
13	* 1.2177	* 1.2509	* 1.5240	* 1.3548	* 1.4566	* 1.1674	* .8707	*
	* 1.6831	* 1.6454	* 1.3598	* 1.5271	* 1.4223	* 1.7669	* 2.3507	*
14	* 1.2027	* 1.4041	* 1.1342	* 1.4009	* 1.1685	* .8707	*	*
	* 1.6990	* 1.4637	* 1.8082	* 1.4711	* 1.7626	* 2.3533	*	*
15	* 1.2102	* 1.0217	* .9093	* .8386	* F-SUB-Q			
	* 1.6818	* 1.9938	* 2.2344	* 2.4271	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 25 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1760	* 1.4833	* 1.2541	* 1.4983	* 1.2188	* 1.2102	* 1.1963	* 1.2081
	* 1.6890	* 1.3430	* 1.5794	* 1.3277	* 1.6269	* 1.6306	* 1.6448	* 1.6245
9	* 1.4833	* 1.2863	* 1.1835	* 1.2809	* 1.5230	* 1.2445	* 1.4009	* 1.0164
	* 1.3430	* 1.5434	* 1.6708	* 1.5512	* 1.3093	* 1.5928	* 1.4121	* 1.9298
10	* 1.2541	* 1.1835	* 1.1610	* 1.5208	* 1.3388	* 1.5240	* 1.1278	* .9039
	* 1.5794	* 1.6715	* 1.7077	* 1.3125	* 1.4878	* 1.3085	* 1.7498	* 2.1662
11	* 1.4983	* 1.2809	* 1.5208	* 1.2134	* 1.5412	* 1.3505	* 1.3998	* .8322
	* 1.3277	* 1.5512	* 1.3129	* 1.6404	* 1.2964	* 1.4741	* 1.4168	* 2.3546
12	* 1.2188	* 1.5219	* 1.3377	* 1.5412	* 1.1835	* 1.4544	* 1.1642	*
	* 1.6269	* 1.3093	* 1.4893	* 1.2967	* 1.6825	* 1.3702	* 1.7017	*
13	* 1.2102	* 1.2445	* 1.5230	* 1.3505	* 1.4544	* 1.1610	* .8643	*
	* 1.6306	* 1.5922	* 1.3089	* 1.4741	* 1.3697	* 1.7057	* 2.2766	*
14	* 1.1963	* 1.4019	* 1.1278	* 1.3998	* 1.1642	* .8643	*	*
	* 1.6448	* 1.4117	* 1.7498	* 1.4168	* 1.7017	* 2.2790	*	*
15	* 1.2081	* 1.0164	* .9029	* .8311	* F-SUB-Q			
	* 1.6245	* 1.9307	* 2.1684	* 2.3559	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2124	* 1.5358	* 1.2948	* 1.5508	* 1.2584	* 1.2488	* 1.2359	* 1.2499
	* 1.5829	* 1.2532	* 1.4785	* 1.2369	* 1.5169	* 1.5169	* 1.5234	* 1.4981
9	* 1.5358	* 1.3280	* 1.2209	* 1.3227	* 1.5765	* 1.2852	* 1.4512	* 1.0507
	* 1.2532	* 1.4451	* 1.5651	* 1.4479	* 1.2189	* 1.4827	* 1.3080	* 1.7831
10	* 1.2948	* 1.2199	* 1.1974	* 1.5744	* 1.3837	* 1.5787	* 1.1642	* .9339
	* 1.4785	* 1.5651	* 1.5987	* 1.2244	* 1.3894	* 1.2182	* 1.6264	* 2.0062
11	* 1.5508	* 1.3227	* 1.5744	* 1.2509	* 1.5969	* 1.3944	* 1.4480	* .8589
	* 1.2369	* 1.4489	* 1.2251	* 1.5363	* 1.2088	* 1.3761	* 1.3175	* 2.1843
12	* 1.2584	* 1.5765	* 1.3816	* 1.5958	* 1.2199	* 1.5048	* 1.2049	*
	* 1.5169	* 1.2189	* 1.3903	* 1.2095	* 1.5749	* 1.2780	* 1.5847	*
13	* 1.2488	* 1.2852	* 1.5787	* 1.3944	* 1.5058	* 1.1995	* .8921	*
	* 1.5169	* 1.4827	* 1.2182	* 1.3770	* 1.2780	* 1.5952	* 2.1264	*
14	* 1.2359	* 1.4512	* 1.1642	* 1.4480	* 1.2049	* .8911	*	*
	* 1.5234	* 1.3080	* 1.6264	* 1.3175	* 1.5858	* 2.1264	*	*
15	* 1.2499	* 1.0507	* .9328	* .8579	* F-SUB-Q			
	* 1.4981	* 1.7831	* 2.0081	* 2.1843	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 26 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 RPPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2059	* 1.5358	* 1.2916	* 1.5519	* 1.2531	* 1.2445	* 1.2327	* 1.2488
	* 1.5009	* 1.1833	* 1.3981	* 1.1680	* 1.4391	* 1.4400	* 1.4468	* 1.4221
9	* 1.5358	* 1.3238	* 1.2156	* 1.3195	* 1.5776	* 1.2809	* 1.4512	* 1.0474
	* 1.1833	* 1.3672	* 1.4824	* 1.3707	* 1.1500	* 1.4054	* 1.2368	* 1.6949
10	* 1.2916	* 1.2156	* 1.1910	* 1.5754	* 1.3827	* 1.5808	* 1.1610	* .9286
	* 1.3981	* 1.4824	* 1.5167	* 1.1549	* 1.3109	* 1.1476	* 1.5427	* 1.9103
11	* 1.5519	* 1.3195	* 1.5754	* 1.2456	* 1.5990	* 1.3934	* 1.4501	* .8536
	* 1.1680	* 1.3707	* 1.1549	* 1.4545	* 1.1386	* 1.2984	* 1.2418	* 2.0791
12	* 1.2531	* 1.5776	* 1.3805	* 1.5979	* 1.2145	* 1.5058	* 1.2027	*
	* 1.4391	* 1.1500	* 1.3125	* 1.1391	* 1.4906	* 1.2038	* 1.4968	*
13	* 1.2445	* 1.2820	* 1.5808	* 1.3934	* 1.5069	* 1.1942	* .8857	*
	* 1.4400	* 1.4045	* 1.1476	* 1.2991	* 1.2031	* 1.5083	* 2.0190	*
14	* 1.2327	* 1.4512	* 1.1610	* 1.4501	* 1.2027	* .8857	*	*
	* 1.4468	* 1.2368	* 1.5427	* 1.2418	* 1.4978	* 2.0209	*	*
15	* 1.2488	* 1.0474	* .9275	* .8536	* F-SUB-Q			
	* 1.4221	* 1.6962	* 1.9120	* 2.0811	* M-SUB-Q			

AT 100% POWER, 350 RPPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2231	* 1.5583	* 1.3130	* 1.5776	* 1.2756	* 1.2649	* 1.2520	* 1.2649
	* 1.4135	* 1.1126	* 1.3147	* 1.0974	* 1.3526	* 1.3560	* 1.3646	* 1.3451
9	* 1.5583	* 1.3452	* 1.2359	* 1.3430	* 1.6044	* 1.3023	* 1.4726	* 1.0624
	* 1.1126	* 1.2851	* 1.3935	* 1.2874	* 1.0810	* 1.3220	* 1.1654	* 1.6007
10	* 1.3130	* 1.2359	* 1.2092	* 1.6001	* 1.4084	* 1.6065	* 1.1802	* .9403
	* 1.3147	* 1.3935	* 1.4275	* 1.0853	* 1.2289	* 1.0783	* 1.4515	* 1.8065
11	* 1.5776	* 1.3430	* 1.5990	* 1.2659	* 1.6236	* 1.4169	* 1.4726	* .8643
	* 1.0974	* 1.2874	* 1.0859	* 1.3671	* 1.0692	* 1.2192	* 1.1679	* 1.9657
12	* 1.2756	* 1.6033	* 1.4073	* 1.6236	* 1.2338	* 1.5283	* 1.2220	*
	* 1.3526	* 1.0810	* 1.2303	* 1.0698	* 1.4007	* 1.1313	* 1.4071	*
13	* 1.2649	* 1.3034	* 1.6054	* 1.4169	* 1.5294	* 1.2081	* .8954	*
	* 1.3560	* 1.3220	* 1.0788	* 1.2192	* 1.1307	* 1.4229	* 1.9101	*
14	* 1.2520	* 1.4726	* 1.1802	* 1.4726	* 1.2209	* .8943	*	*
	* 1.3646	* 1.1654	* 1.4515	* 1.1679	* 1.4081	* 1.9118	*	*
15	* 1.2649	* 1.0624	* .9403	* .8643	* F-SUB-Q			
	* 1.3451	* 1.6019	* 1.8080	* 1.9674	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 27 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 100% POWER, 350 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1631	* 1.4651	* 1.2456	* 1.4898	* 1.2220	* 1.2006	* 1.1813	* 1.1706 *
	* 1.4369	* 1.1449	* 1.3416	* 1.1241	* 1.3670	* 1.3836	* 1.3998	* 1.4089 *
9	* 1.4651	* 1.2745	* 1.1792	* 1.2863	* 1.5144	* 1.2402	* 1.3805	* .9971 *
	* 1.1449	* 1.3115	* 1.4143	* 1.3005	* 1.1075	* 1.3441	* 1.2036	* 1.6545 *
10	* 1.2456	* 1.1792	* 1.1556	* 1.5090	* 1.3462	* 1.5133	* 1.1256	* .8836 *
	* 1.3416	* 1.4143	* 1.4475	* 1.1126	* 1.2147	* 1.1069	* 1.4741	* 1.8640 *
11	* 1.4898	* 1.2863	* 1.5090	* 1.2102	* 1.5305	* 1.3430	* 1.3762	* .8097 *
	* 1.1241	* 1.3012	* 1.1132	* 1.3827	* 1.0968	* 1.2444	* 1.2090	* 2.0358 *
12	* 1.2220	* 1.5144	* 1.3452	* 1.5294	* 1.1792	* 1.4319	* 1.1460	* .8365 *
	* 1.3670	* 1.1075	* 1.2444	* 1.0968	* 1.4172	* 1.1672	* 1.4514	* 1.9781 *
13	* 1.2006	* 1.2402	* 1.5123	* 1.3430	* 1.4319	* 1.1320	* .8365	* .8365 *
	* 1.3836	* 1.3433	* 1.1075	* 1.2444	* 1.1672	* 1.4691	* 1.9781	* .8354 *
14	* 1.1813	* 1.3805	* 1.1256	* 1.3762	* 1.1449	* .8354	* .8354	* 1.9817 *
	* 1.3998	* 1.2029	* 1.4741	* 1.2090	* 1.4524	* 1.9817		
15	* 1.1706	* .9971	* .8836	* .8086	* F-SUB-Q			
	* 1.4089	* 1.6545	* 1.8656	* 2.0377	* M-SUB-Q			

AT 100% POWER, 350 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8697	* 1.0689	* .9157	* 1.0881	* .9189	* .8825	* .8557	* .7990 *
	* 1.8767	* 1.5292	* 1.7824	* 1.5017	* 1.7766	* 1.8417	* 1.8899	* 2.0168 *
9	* 1.0689	* .9361	* .8729	* .9650	* 1.1192	* .9232	* .9939	* .7058 *
	* 1.5292	* 1.7450	* 1.8702	* 1.6945	* 1.4621	* 1.7636	* 1.6307	* 2.2827 *
10	* .9157	* .8729	* .8664	* 1.1149	* 1.0067	* 1.1160	* .8354	* .6276 *
	* 1.7824	* 1.8702	* 1.8849	* 1.4680	* 1.6234	* 1.4631	* 1.9425	* 2.5701 *
11	* 1.0881	* .9639	* 1.1149	* .9146	* 1.1267	* .9853	* .9650	* .5698 *
	* 1.5017	* 1.6945	* 1.4681	* 1.7884	* 1.4513	* 1.6569	* 1.6840	* 2.8325 *
12	* .9189	* 1.1181	* 1.0067	* 1.1267	* .8689	* 1.0335	* .8107	* .5880 *
	* 1.7766	* 1.4621	* 1.6246	* 1.4523	* 1.8370	* 1.5772	* 2.0037	* 2.7532 *
13	* .8825	* .9243	* 1.1160	* .9842	* 1.0335	* .8086	* .5880	* .5880 *
	* 1.8417	* 1.7636	* 1.4641	* 1.6569	* 1.5772	* 2.0074	* 2.7532	
14	* .8557	* .9939	* .8354	* .9639	* .8107	* .5869		
	* 1.8899	* 1.6307	* 1.9425	* 1.6840	* 2.0037	* 2.7567		
15	* .7990	* .7058	* .6265	* .5687	* F-SUB-Q			
	* 2.0168	* 2.2827	* 2.5731	* 2.8325	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 28 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.5558	.7604	.7379	.8589	.7497	.7122	.6565	.5526
	* 2.4482	* 2.1011	* 2.1889	* 1.8845	* 2.1599	* 2.2622	* 2.4387	* 2.8816
9	.7604	.6876	.7133	.7722	.8547	.7261	.7304	.5173
	* 2.1011	* 2.3222	* 2.2632	* 2.0938	* 1.8902	* 2.2150	* 2.1930	* 3.0801
10	.7379	.7133	.6961	.8386	.7722	.8011	.6405	.4434
	* 2.1889	* 2.2656	* 2.5151	* 1.9242	* 2.0905	* 2.0009	* 2.4985	* 3.5782
11	.8589	.7722	.8375	.6769	.7497	.6672	.6297	.3856
	* 1.8845	* 2.0938	* 1.9256	* 2.3711	* 2.1291	* 2.3790	* 2.5153	* 4.0969
12	.7497	.8547	.7711	.7486	.5226	.5633	.5044	
	* 2.1599	* 1.8913	* 2.0921	* 2.1295	* 2.5658	* 2.3831	* 3.0207	
13	.7122	.7261	.8011	.6672	.5633	.4327	.3267	
	* 2.2622	* 2.2150	* 2.0020	* 2.3806	* 2.3831	* 2.8982	* 4.3254	
14	.6565	.7315	.6405	.6297	.5044	.3267		
	* 2.4387	* 2.1925	* 2.4985	* 2.5153	* 3.0242	* 4.3281		
15	.5526	.5173	.4434	.3856	F-SUB-Q			
	* 2.8816	* 3.0801	* 3.5782	* 4.0969	M-SUB-Q			

AT 75% POWER, 4 RFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.7668	1.0753	1.0913	1.1920	1.0571	1.0549	1.0046	.9007
	* 1.8266	* 1.5813	* 1.5613	* 1.4327	* 1.6135	* 1.6080	* 1.6807	* 1.8634
9	1.0753	1.0207	1.0314	1.0871	1.1652	1.0389	1.0956	.8065
	* 1.5813	* 1.6602	* 1.6524	* 1.5672	* 1.4637	* 1.6276	* 1.5423	* 2.0822
10	1.0913	1.0303	.9778	1.1353	1.0871	1.1031	.9211	.6747
	* 1.5613	* 1.6544	* 1.7419	* 1.5017	* 1.5665	* 1.5346	* 1.8333	* 2.4803
11	1.1920	1.0871	1.1342	.9371	1.0474	.9939	1.0164	.6030
	* 1.4327	* 1.5675	* 1.5027	* 1.8108	* 1.6108	* 1.6853	* 1.6417	* 2.7646
12	1.0571	1.1652	1.0860	1.0464	.7176	.8846	.8054	
	* 1.6135	* 1.4637	* 1.5684	* 1.6118	* 1.9096	* 1.6796	* 2.0009	
13	1.0549	1.0399	1.1021	.9939	.8846	.6715	.5087	
	* 1.6080	* 1.6267	* 1.5355	* 1.6864	* 1.6796	* 2.0149	* 2.9437	
14	1.0046	1.0967	.9211	1.0164	.8043	.5077		
	* 1.6807	* 1.5421	* 1.8333	* 1.6417	* 2.0018	* 2.9457		
15	.9007	.8065	.6747	.6019	F-SUB-Q			
	* 1.8634	* 2.0805	* 2.4825	* 2.7654	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 29 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8900	* 1.2788	* 1.2788	* 1.3987	* 1.2113	* 1.2359	* 1.2017	* 1.1138
	* 1.6918	* 1.4337	* 1.4290	* 1.3047	* 1.5013	* 1.4640	* 1.4975	* 1.6067
9	* 1.2788	* 1.1995	* 1.1920	* 1.2445	* 1.3634	* 1.2199	* 1.3227	* .9735
	* 1.4337	* 1.5084	* 1.5350	* 1.4641	* 1.3359	* 1.4789	* 1.3638	* 1.8384
10	* 1.2788	* 1.1920	* 1.1149	* 1.3259	* 1.2499	* 1.3098	* 1.0721	* .8054
	* 1.4290	* 1.5358	* 1.6402	* 1.3774	* 1.4584	* 1.3824	* 1.5829	* 2.2203
11	* 1.3987	* 1.2434	* 1.3259	* 1.0667	* 1.2445	* 1.1910	* 1.2616	* .7326
	* 1.3047	* 1.4649	* 1.3781	* 1.7112	* 1.4541	* 1.5139	* 1.4165	* 2.4296
12	* 1.2113	* 1.3634	* 1.2488	* 1.2434	* .8332	* 1.0999	* 1.0003	*
	* 1.5013	* 1.3364	* 1.4599	* 1.4549	* 1.7595	* 1.4662	* 1.7376	*
13	* 1.2359	* 1.2209	* 1.3088	* 1.1899	* 1.0999	* .8311	* .6265	*
	* 1.4640	* 1.4781	* 1.3831	* 1.5148	* 1.4662	* 1.7944	* 2.5968	*
14	* 1.2017	* 1.3227	* 1.0731	* 1.2616	* .9992	* .6265	*	*
	* 1.4975	* 1.3633	* 1.6819	* 1.4173	* 1.7387	* 2.5993	*	*
15	* 1.1138	* .9746	* .8043	* .7315	* F-SUB-Q			
	* 1.6067	* 1.8372	* 2.2208	* 2.4317	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0239	* 1.4384	* 1.4062	* 1.5422	* 1.3205	* 1.3527	* 1.3302	* 1.2488
	* 1.6778	* 1.4013	* 1.4168	* 1.2799	* 1.4884	* 1.4366	* 1.4565	* 1.5407
9	* 1.4384	* 1.3377	* 1.3034	* 1.3580	* 1.5058	* 1.3409	* 1.4748	* 1.0828
	* 1.4013	* 1.4846	* 1.5393	* 1.4547	* 1.3077	* 1.4515	* 1.3180	* 1.7794
10	* 1.4062	* 1.3034	* 1.2102	* 1.4694	* 1.3730	* 1.4705	* 1.1813	* .8921
	* 1.4168	* 1.5402	* 1.6501	* 1.3516	* 1.4415	* 1.3383	* 1.6508	* 2.1620
11	* 1.5422	* 1.3570	* 1.4683	* 1.1727	* 1.4116	* 1.3537	* 1.4416	* .8257
	* 1.2799	* 1.4554	* 1.3529	* 1.7089	* 1.4025	* 1.4630	* 1.3509	* 2.3347
12	* 1.3205	* 1.5058	* 1.3709	* 1.4105	* .9768	* 1.2938	* 1.1567	*
	* 1.4884	* 1.3083	* 1.4430	* 1.4033	* 1.7233	* 1.4046	* 1.6675	*
13	* 1.3527	* 1.3420	* 1.4694	* 1.3527	* 1.2927	* .9875	* .7304	*
	* 1.4366	* 1.4505	* 1.3393	* 1.4638	* 1.4046	* 1.7394	* 2.5135	*
14	* 1.3302	* 1.4748	* 1.1813	* 1.4416	* 1.1567	* .7304	*	*
	* 1.4565	* 1.3174	* 1.6494	* 1.3512	* 1.6681	* 2.5135	*	*
15	* 1.2488	* 1.0839	* .8911	* .8257	* F-SUB-Q			
	* 1.5407	* 1.7783	* 2.1637	* 2.3356	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 30 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.1760	* 1.5380	* 1.4619	* 1.6011	* 1.3612	* 1.3977	* 1.3784	* 1.3013
	* 1.7735	* 1.4634	* 1.5054	* 1.3468	* 1.5776	* 1.5080	* 1.5225	* 1.5991

9	* 1.5380	* 1.4212	* 1.3591	* 1.4052	* 1.5754	* 1.3869	* 1.5390	* 1.1224
	* 1.4634	* 1.5613	* 1.6467	* 1.5442	* 1.3715	* 1.5233	* 1.3694	* 1.8576

10	* 1.4619	* 1.3591	* 1.2477	* 1.5465	* 1.4287	* 1.5572	* 1.2359	* .9253
	* 1.5054	* 1.6477	* 1.7622	* 1.4220	* 1.5231	* 1.4020	* 1.7384	* 2.2662

11	* 1.6011	* 1.4041	* 1.5455	* 1.2370	* 1.5230	* 1.4576	* 1.5422	* .8697
	* 1.3468	* 1.5446	* 1.4230	* 1.8125	* 1.4469	* 1.5201	* 1.4146	* 2.4624

12	* 1.3612	* 1.5754	* 1.4266	* 1.5219	* 1.1481	* 1.4523	* 1.2584	*
	* 1.5776	* 1.3722	* 1.5251	* 1.4477	* 1.8023	* 1.4490	* 1.7237	*

13	* 1.3977	* 1.3880	* 1.5562	* 1.4566	* 1.4523	* 1.1320	* .8043	*
	* 1.5080	* 1.5221	* 1.4030	* 1.5209	* 1.4490	* 1.8127	* 2.6176	*

14	* 1.3784	* 1.5390	* 1.2349	* 1.5412	* 1.2574	* .8043	*	*
	* 1.5225	* 1.3694	* 1.7367	* 1.4153	* 1.7248	* 2.6176	*	*

15	* 1.3013	* 1.1235	* .9243	* .8697	* F-SUB-Q			
	* 1.5991	* 1.8558	* 2.2680	* 2.4650	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.3527	* 1.6729	* 1.5615	* 1.7061	* 1.4437	* 1.4823	* 1.4662	* 1.3869
	* 1.8364	* 1.4985	* 1.5851	* 1.4085	* 1.6552	* 1.5689	* 1.5785	* 1.6470

9	* 1.6729	* 1.5604	* 1.4566	* 1.4973	* 1.6890	* 1.4748	* 1.6440	* 1.1931
	* 1.4985	* 1.6027	* 1.7314	* 1.6217	* 1.4320	* 1.5855	* 1.4181	* 1.9222

10	* 1.5615	* 1.4566	* 1.3259	* 1.6665	* 1.5380	* 1.6836	* 1.3366	* .9853
	* 1.5851	* 1.7314	* 1.8609	* 1.4893	* 1.5935	* 1.4621	* 1.8134	* 2.3588

11	* 1.7061	* 1.4962	* 1.6654	* 1.3430	* 1.6697	* 1.5990	* 1.6836	* .8393
	* 1.4085	* 1.6221	* 1.4905	* 1.8476	* 1.4663	* 1.5369	* 1.4539	* 2.5727

12	* 1.4437	* 1.6879	* 1.5347	* 1.6686	* 1.3130	* 1.6376	* 1.3923	*
	* 1.6552	* 1.4330	* 1.5953	* 1.4671	* 1.8449	* 1.4711	* 1.7430	*

13	* 1.4823	* 1.4758	* 1.6825	* 1.5979	* 1.6376	* 1.2884	* .8964	*
	* 1.5699	* 1.5846	* 1.4636	* 1.5377	* 1.4711	* 1.8537	* 2.6706	*

14	* 1.4662	* 1.6451	* 1.3366	* 1.6825	* 1.3912	* .8964	*	*
	* 1.5785	* 1.4178	* 1.8123	* 1.4547	* 1.7441	* 2.6718	*	*

15	* 1.3869	* 1.1942	* .9842	* .9382	* F-SUB-Q			
	* 1.6470	* 1.9202	* 2.3616	* 2.5750	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 31 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFDP, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3977	* 1.7222	* 1.5915	* 1.7447	* 1.4673	* 1.5069	* 1.4908	* 1.4148 *
	* 1.9753	* 1.6035	* 1.7369	* 1.5416	* 1.8185	* 1.7157	* 1.7198	* 1.7849 *
9	* 1.7222	* 1.6054	* 1.4865	* 1.5262	* 1.7339	* 1.5015	* 1.6815	* 1.2134 *
	* 1.6035	* 1.7207	* 1.8612	* 1.7817	* 1.5637	* 1.7316	* 1.5408	* 2.0917 *
10	* 1.5915	* 1.4865	* 1.3495	* 1.7147	* 1.5872	* 1.7382	* 1.3762	* 1.0025 *
	* 1.7369	* 1.8617	* 2.0436	* 1.5980	* 1.7163	* 1.5665	* 1.9674	* 2.5756 *
11	* 1.7447	* 1.5262	* 1.7136	* 1.3816	* 1.7393	* 1.6568	* 1.7457	* .9639 *
	* 1.5416	* 1.7828	* 1.5993	* 1.9757	* 1.5513	* 1.6321	* 1.5388	* 2.7753 *
12	* 1.4673	* 1.7329	* 1.5840	* 1.7382	* 1.3709	* 1.7200	* 1.4501	*
	* 1.8185	* 1.5645	* 1.7194	* 1.5522	* 1.9627	* 1.5537	* 1.8451	*
13	* 1.5069	* 1.5026	* 1.7361	* 1.6558	* 1.7200	* 1.3516	* .9350	*
	* 1.7157	* 1.7306	* 1.5674	* 1.6331	* 1.5537	* 1.9624	* 2.8318	*
14	* 1.4908	* 1.6825	* 1.3752	* 1.7457	* 1.4491	* .9350	*	*
	* 1.7198	* 1.5404	* 1.9674	* 1.5392	* 1.8463	* 2.8318	*	*
15	* 1.4148	* 1.2145	* 1.0014	* .9628	* F-SUB-Q			
	* 1.7849	* 2.0895	* 2.5779	* 2.7780	* M-SUB-Q			

AT 75% POWER, 4 EFDP, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3944	* 1.7254	* 1.5872	* 1.7468	* 1.4619	* 1.5005	* 1.4865	* 1.4148 *
	* 2.1685	* 1.7477	* 1.8937	* 1.7101	* 2.0325	* 1.9105	* 1.9106	* 1.9724 *
9	* 1.7254	* 1.6033	* 1.4812	* 1.5240	* 1.7414	* 1.4983	* 1.6847	* 1.2102 *
	* 1.7477	* 1.8846	* 2.0351	* 1.9580	* 1.7042	* 1.9271	* 1.7053	* 2.3200 *
10	* 1.5872	* 1.4801	* 1.3430	* 1.7243	* 1.5958	* 1.7511	* 1.3816	* .9992 *
	* 1.8937	* 2.0365	* 2.2282	* 1.7265	* 1.8588	* 1.6874	* 2.1286	* 2.8637 *
11	* 1.7468	* 1.5240	* 1.7222	* 1.3837	* 1.7597	* 1.6686	* 1.7629	* .9650 *
	* 1.7101	* 1.9593	* 1.7276	* 2.1544	* 1.6767	* 1.7698	* 1.6587	* 3.0021 *
12	* 1.4619	* 1.7404	* 1.5936	* 1.7586	* 1.3816	* 1.7447	* 1.4641	*
	* 2.0325	* 1.7052	* 1.8624	* 1.6777	* 2.1334	* 1.6785	* 1.9988	*
13	* 1.5005	* 1.4994	* 1.7500	* 1.6675	* 1.7447	* 1.3666	* .9425	*
	* 1.9105	* 1.9252	* 1.6894	* 1.7708	* 1.6785	* 2.1284	* 3.0751	*
14	* 1.4865	* 1.6858	* 1.3805	* 1.7629	* 1.4630	* .9425	*	*
	* 1.9106	* 1.7053	* 2.1286	* 1.6586	* 2.0002	* 3.0751	*	*
15	* 1.4148	* 1.2113	* .9982	* .9650	* F-SUB-Q			
	* 1.9724	* 2.3181	* 2.8666	* 3.0052	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 32 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 RFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4094	* 1.7511	* 1.6086	* 1.7746	* 1.4812	* 1.5208	* 1.5090	* 1.4394
	* 2.1798	* 1.7505	* 1.9077	* 1.7151	* 2.0616	* 2.0099	* 2.0254	* 2.1159
9	* 1.7511	* 1.6226	* 1.4973	* 1.5476	* 1.7736	* 1.5219	* 1.7157	* 1.2284
	* 1.7505	* 1.8927	* 2.0499	* 1.9688	* 1.7141	* 2.0071	* 1.7752	* 2.4856
10	* 1.6086	* 1.4973	* 1.3580	* 1.7564	* 1.6290	* 1.7875	* 1.4084	* 1.0132
	* 1.9077	* 2.0499	* 2.2494	* 1.7316	* 1.8743	* 1.7020	* 2.1700	* 3.0244
11	* 1.7746	* 1.5465	* 1.7543	* 1.4052	* 1.8004	* 1.7040	* 1.8057	* .9821
	* 1.7151	* 1.9702	* 1.7337	* 2.1716	* 1.6960	* 1.7951	* 1.6920	* 3.1258
12	* 1.4812	* 1.7725	* 1.6258	* 1.7982	* 1.4094	* 1.7875	* 1.4994	*
	* 2.0616	* 1.7151	* 1.8779	* 1.6970	* 2.1716	* 1.7121	* 2.0455	*
13	* 1.5208	* 1.5230	* 1.7864	* 1.7029	* 1.7875	* 1.3966	* .9618	*
	* 2.0099	* 2.0043	* 1.7040	* 1.7973	* 1.7121	* 2.2014	* 3.2021	*
14	* 1.5090	* 1.7168	* 1.4073	* 1.8046	* 1.4983	* .9618	*	*
	* 2.0254	* 1.7741	* 2.1716	* 1.6930	* 2.0470	* 3.2021	*	*
15	* 1.4394	* 1.2295	* 1.0121	* .9810	* F-SUB-Q			
	* 2.1159	* 2.4835	* 3.0275	* 3.1292	* M-SUB-Q			

AT 75% POWER, 4 RFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3591	* 1.6997	* 1.5562	* 1.7265	* 1.4341	* 1.4737	* 1.4641	* 1.4009
	* 2.2235	* 1.7719	* 1.9371	* 1.7316	* 2.0914	* 2.0369	* 2.0426	* 2.1113
9	* 1.6997	* 1.5669	* 1.4459	* 1.5005	* 1.7307	* 1.4758	* 1.6729	* 1.1910
	* 1.7719	* 1.9294	* 2.0854	* 1.9947	* 1.7264	* 2.0297	* 1.7873	* 2.4920
10	* 1.5562	* 1.4459	* 1.3120	* 1.7125	* 1.5862	* 1.7468	* 1.3687	* .9810
	* 1.9371	* 2.0869	* 2.2886	* 1.7452	* 1.8915	* 1.7121	* 2.1931	* 3.0726
11	* 1.7265	* 1.4994	* 1.7104	* 1.3623	* 1.7607	* 1.6611	* 1.7650	* .9532
	* 1.7316	* 1.9960	* 1.7473	* 2.2014	* 1.7050	* 1.8120	* 1.7010	* 3.1704
12	* 1.4341	* 1.7286	* 1.5829	* 1.7597	* 1.3698	* 1.7489	* 1.4619	*
	* 2.0914	* 1.7274	* 1.8952	* 1.7060	* 2.1964	* 1.7213	* 2.0630	*
13	* 1.4737	* 1.4769	* 1.7457	* 1.6600	* 1.7489	* 1.3602	* .9350	*
	* 2.0369	* 2.0283	* 1.7131	* 1.8131	* 1.7213	* 2.2252	* 3.2599	*
14	* 1.4641	* 1.6729	* 1.3687	* 1.7639	* 1.4608	* .9350	*	*
	* 2.0426	* 1.7873	* 2.1931	* 1.7020	* 2.0645	* 3.2599	*	*
15	* 1.4009	* 1.1920	* .9800	* .9521	* F-SUB-Q			
	* 2.1113	* 2.4899	* 3.0759	* 3.1739	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 33 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3570	* 1.7061	* 1.5604	* 1.7372	* 1.4394	* 1.4801	* 1.4737	* 1.4137
	* 2.1749	* 1.7111	* 1.8503	* 1.6448	* 1.9769	* 1.8927	* 1.8927	* 1.9450
9	* 1.7061	* 1.5690	* 1.4480	* 1.5080	* 1.7436	* 1.4855	* 1.6568	* 1.1984
	* 1.7111	* 1.8731	* 2.0016	* 1.8964	* 1.6401	* 1.8902	* 1.6628	* 2.2996
10	* 1.5604	* 1.4469	* 1.3130	* 1.7254	* 1.6001	* 1.7639	* 1.3805	* .9853
	* 1.8503	* 2.0016	* 2.1854	* 1.6686	* 1.8108	* 1.6318	* 2.0884	* 2.8456
11	* 1.7372	* 1.5069	* 1.7232	* 1.3677	* 1.7779	* 1.6772	* 1.7875	* .9596
	* 1.6448	* 1.8977	* 1.6705	* 2.3206	* 1.6504	* 1.7420	* 1.6208	* 2.9837
12	* 1.4394	* 1.7425	* 1.5969	* 1.7768	* 1.3794	* 1.7693	* 1.4780	*
	* 1.9769	* 1.6411	* 1.8142	* 1.6514	* 2.1379	* 1.6686	* 1.9837	*
13	* 1.4801	* 1.4865	* 1.7618	* 1.6750	* 1.7693	* 1.3720	* .9414	*
	* 1.8927	* 1.8890	* 1.6336	* 1.7431	* 1.6686	* 2.1619	* 3.1394	*
14	* 1.4737	* 1.6879	* 1.3794	* 1.7864	* 1.4769	* .9414	*	*
	* 1.8927	* 1.6628	* 2.0884	* 1.6217	* 1.9851	* 3.1394	*	*
15	* 1.4137	* 1.1995	* .9842	* .9585	* F-SUB-Q			
	* 1.9450	* 2.2977	* 2.8484	* 2.9868	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3152	* 1.6622	* 1.5176	* 1.6965	* 1.3998	* 1.4405	* 1.4362	* 1.3816
	* 2.0484	* 1.5966	* 1.7192	* 1.5161	* 1.8280	* 1.7579	* 1.7569	* 1.8052
9	* 1.6622	* 1.5240	* 1.4052	* 1.4683	* 1.7061	* 1.4480	* 1.6504	* 1.1685
	* 1.5966	* 1.7515	* 1.8731	* 1.7569	* 1.5146	* 1.7505	* 1.5347	* 2.1395
10	* 1.5176	* 1.4052	* 1.2734	* 1.6868	* 1.5637	* 1.7275	* 1.3462	* .9585
	* 1.7192	* 1.8743	* 2.0397	* 1.5503	* 1.6881	* 1.5146	* 1.9489	* 2.6401
11	* 1.6965	* 1.4673	* 1.6847	* 1.3302	* 1.7425	* 1.6386	* 1.7522	* .9350
	* 1.5161	* 1.7579	* 1.5520	* 1.9851	* 1.5322	* 1.6217	* 1.5067	* 2.7825
12	* 1.3998	* 1.7040	* 1.5604	* 1.7414	* 1.3452	* 1.7350	* 1.4459	*
	* 1.8280	* 1.5161	* 1.6910	* 1.5339	* 2.0016	* 1.5495	* 1.8444	*
13	* 1.4405	* 1.4491	* 1.7254	* 1.6376	* 1.7350	* 1.3398	* .9168	*
	* 1.7579	* 1.7494	* 1.5161	* 1.6226	* 1.5495	* 2.0155	* 2.9263	*
14	* 1.4362	* 1.6504	* 1.3462	* 1.7511	* 1.4448	* .9168	*	*
	* 1.7569	* 1.5347	* 1.9489	* 1.5074	* 1.8455	* 2.9263	*	*
15	* 1.3816	* 1.1695	* .9575	* .9339	* F-SUB-Q			
	* 1.8052	* 2.1379	* 2.6425	* 2.7852	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 34 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2413	* 1.5787	* 1.4373	* 1.6140	* 1.3259	* 1.3634	* 1.3612	* 1.3120 *
	* 1.9307	* 1.5035	* 1.6336	* 1.4420	* 1.7505	* 1.6910	* 1.6900	* 1.7357 *

9	* 1.5787	* 1.4405	* 1.3280	* 1.3923	* 1.6258	* 1.3720	* 1.5701	* 1.1053 *
	* 1.5035	* 1.6552	* 1.7730	* 1.6734	* 1.4355	* 1.6792	* 1.4669	* 2.0630 *

10	* 1.4373	* 1.3280	* 1.2038	* 1.6065	* 1.4855	* 1.6472	* 1.2766	* .9061 *
	* 1.6336	* 1.7741	* 1.9423	* 1.4609	* 1.5905	* 1.4263	* 1.8408	* 2.5380 *

11	* 1.6140	* 1.3912	* 1.6044	* 1.2595	* 1.6611	* 1.5572	* 1.6697	* .8846 *
	* 1.4420	* 1.6744	* 1.4632	* 1.8767	* 1.4405	* 1.5290	* 1.4158	* 2.6449 *

12	* 1.3259	* 1.6236	* 1.4823	* 1.6600	* 1.2745	* 1.6536	* 1.3730	* .8675 *
	* 1.7505	* 1.4369	* 1.5940	* 1.4412	* 1.8902	* 1.4587	* 1.7410	* .8675 *

13	* 1.3634	* 1.3730	* 1.6451	* 1.5562	* 1.6536	* 1.2702	* .8675 *	* .8675 *
	* 1.6910	* 1.6782	* 1.4277	* 1.5298	* 1.4587	* 1.9138	* 2.7852	* .8675 *

14	* 1.3612	* 1.5701	* 1.2766	* 1.6686	* 1.3720	* .8675 *		
	* 1.6900	* 1.4669	* 1.8420	* 1.4165	* 1.7420	* 2.7852		

15	* 1.3120	* 1.1063	* .9050	* .8836	* F-SUB-Q			
	* 1.7357	* 2.0616	* 2.5425	* 2.6474	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2070	* 1.5401	* 1.4030	* 1.5787	* 1.2938	* 1.3291	* 1.3270	* 1.2798 *
	* 1.7895	* 1.4000	* 1.5298	* 1.3516	* 1.6467	* 1.5984	* 1.5984	* 1.6420 *

9	* 1.5401	* 1.4041	* 1.2948	* 1.3612	* 1.5904	* 1.3388	* 1.5337	* 1.0764 *
	* 1.4000	* 1.5396	* 1.6580	* 1.5680	* 1.3434	* 1.5843	* 1.3819	* 1.9555 *

10	* 1.4030	* 1.2948	* 1.1727	* 1.5722	* 1.4544	* 1.6119	* 1.2466	* .8814 *
	* 1.5298	* 1.6590	* 1.8222	* 1.3630	* 1.6796	* 1.3310	* 1.7202	* 2.4029 *

11	* 1.5787	* 1.3602	* 1.5701	* 1.2284	* 1.6247	* 1.5230	* 1.6343	* .8611 *
	* 1.3516	* 1.5689	* 1.3650	* 1.7483	* 1.3322	* 1.4193	* 1.3158	* 2.4813 *

12	* 1.2938	* 1.5894	* 1.4512	* 1.6236	* 1.2434	* 1.6172	* 1.3420	* .8439 *
	* 1.6467	* 1.3446	* 1.4827	* 1.3335	* 1.7441	* 1.3440	* 1.6118	* .8439 *

13	* 1.3291	* 1.3398	* 1.6108	* 1.5219	* 1.6172	* 1.2391	* .8439 *	
	* 1.5984	* 1.5826	* 1.3322	* 1.4207	* 1.3434	* 1.7611	* 2.5811	

14	* 1.3270	* 1.5337	* 1.2456	* 1.6333	* 1.3409	* .8439 *		
	* 1.5984	* 1.3813	* 1.7202	* 1.3164	* 1.6136	* 2.5811		

15	* 1.2798	* 1.0774	* .8804	* .8600	* F-SUB-Q			
	* 1.6420	* 1.9542	* 2.4069	* 2.4856	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 35 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 BFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.1128	1.4298	1.2991	1.4673	1.1974	1.2242	1.2199	1.1770
	1.7984	1.4000	1.5371	1.3541	1.6590	1.6226	1.6244	1.6705
9	1.4298	1.2981	1.1974	1.2627	1.4791	1.2338	1.4159	.9675
	1.4000	1.5445	1.6666	1.5731	1.3440	1.6046	1.3960	1.9947
10	1.2991	1.1974	1.0849	1.4630	1.3484	1.4973	1.1481	.8086
	1.5371	1.6666	1.8315	1.3611	1.4804	1.3310	1.7337	2.4477
11	1.4673	1.2616	1.4608	1.1363	1.5080	1.4084	1.5101	.7893
	1.3541	1.5740	1.3624	1.7526	1.3285	1.4221	1.3200	2.5181
12	1.1974	1.4780	1.3462	1.5069	1.1460	1.4962	1.2359	
	1.6590	1.3453	1.4834	1.3298	1.7483	1.3415	1.6190	
13	1.2242	1.2349	1.4951	1.4073	1.4962	1.1385	.7743	
	1.6226	1.6028	1.3328	1.4235	1.3409	1.7665	2.6044	
14	1.2199	1.4169	1.1481	1.5090	1.2349	.7743		
	1.6244	1.3960	1.7337	1.3207	1.6199	2.6044		
15	1.1770	.9885	.8075	.7883	F-SUB-Q			
	1.6705	1.9919	2.4518	2.5203	M-SUB-Q			

AT 75% POWER, 4 BFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.0432	1.3366	1.2188	1.3784	1.1278	1.1374	1.1278	1.0774
	1.8131	1.4151	1.5503	1.3637	1.6676	1.6561	1.6686	1.7326
9	1.3366	1.2167	1.1245	1.1931	1.3902	1.1481	1.3109	.9082
	1.4151	1.5587	1.6802	1.5748	1.3522	1.6336	1.4291	2.0586
10	1.2188	1.1235	1.0228	1.3773	1.2702	1.4009	1.0678	.7454
	1.5503	1.6802	1.8385	1.3650	1.4834	1.3434	1.7633	2.5203
11	1.3784	1.1920	1.3762	1.0731	1.4084	1.3163	1.3934	.7240
	1.3637	1.5757	1.3669	1.7547	1.3415	1.4369	1.3497	2.5997
12	1.1278	1.3880	1.2681	1.4073	1.0689	1.3859	1.1417	
	1.6676	1.3535	1.4865	1.3421	1.7654	1.3637	1.6533	
13	1.1374	1.1492	1.3998	1.3152	1.3859	1.0517	.7122	
	1.6561	1.6327	1.3446	1.4377	1.3637	1.8007	2.6718	
14	1.1278	1.3109	1.0667	1.3934	1.1406	.7122		
	1.6686	1.4291	1.7633	1.3503	1.6552	2.6718		
15	1.0774	.9093	.7443	.7229	F-SUB-Q			
	1.7326	2.0572	2.5225	2.6020	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 36 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.9189	1.1556	1.0517	1.2059	.9960	.9757	.9478	.8761
	1.9810	1.5714	1.7305	1.4973	1.8154	1.8610	1.9153	2.0542
9	1.1556	1.0539	.9735	1.0560	1.2134	1.0025	1.0988	.7561
	1.5714	1.7305	1.8706	1.7111	1.4880	1.8029	1.6392	2.3850
10	1.0517	.9735	.9071	1.2070	1.1192	1.2145	.9168	.6276
	1.7305	1.8706	1.9960	1.4965	1.6190	1.4888	1.9742	2.8912
11	1.2059	1.0560	1.2059	.9585	1.2242	1.1320	1.1470	.5955
	1.4973	1.7121	1.4981	1.8853	1.4774	1.6037	1.5748	3.0435
12	.9960	1.2124	1.1171	1.2231	.9339	1.1652	.9478	
	1.8154	1.4896	1.6226	1.4796	1.9423	1.5553	1.9140	
13	.9757	1.0025	1.2124	1.1310	1.1652	.8921	.5955	
	1.8610	1.8029	1.4903	1.6055	1.5553	2.0383	3.0694	
14	.9478	1.0999	.9157	1.1470	.9468	.5955		
	1.9153	1.6392	1.9756	1.5757	1.9153	3.0694		
15	.8761	.7561	.6265	.5944	F-SUB-Q			
	2.0542	2.3831	2.8941	3.0467	M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.6094	.7690	.6608	.7958	.6587	.6126	.5762	.4980
	2.9174	2.3014	2.6918	2.2098	2.6768	2.8999	3.0759	3.5223
9	.7690	.6694	.6169	.6972	.8182	.6512	.6747	.4520
	2.3014	2.6595	2.8825	2.5247	2.1458	2.7069	2.6020	3.8978
10	.6608	.6169	.6040	.8129	.7315	.8107	.5794	.3834
	2.6918	2.8825	2.9263	2.1619	2.4149	2.1684	3.0435	4.6138
11	.7958	.6972	.8118	.6480	.8236	.7122	.6651	.3513
	2.2098	2.5247	2.1635	2.7196	2.1363	2.4835	2.6474	5.0406
12	.6587	.8182	.7304	.8225	.6190	.7261	.5580	
	2.6768	2.1474	2.4190	2.1379	2.8484	2.4271	3.1670	
13	.6126	.6512	.8097	.7122	.7261	.5526	.3609	
	2.8999	2.7069	2.1700	2.4856	2.4271	3.2056	4.9288	
14	.5762	.6747	.5794	.6640	.5580	.3609		
	3.0759	2.6020	3.0467	2.6474	3.1670	4.9372		
15	.4980	.4520	.3823	.3513	F-SUB-Q			
	3.5223	3.8978	4.6212	5.0494	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 37 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.5741	.7979	.7754	.9146	.7990	.7626	.7069	.6073
	* 2.3464	* 2.0293	* 2.1192	* 1.8022	* 2.0645	* 2.1549	* 2.3130	* 2.6818
9	.7979	.7186	.7551	.8247	.9168	.7808	.7915	.5601
	* 2.0293	* 2.2546	* 2.1788	* 1.9963	* 1.7942	* 2.0998	* 2.0661	* 2.9101
10	.7754	.7540	.7454	.8996	.8225	.8664	.6854	.4862
	* 2.1192	* 2.1806	* 2.1997	* 1.8240	* 1.9947	* 1.8840	* 2.3819	* 3.3297
11	.9146	.8247	.8996	.7326	.8129	.7219	.6887	.4230
	* 1.8022	* 1.9963	* 1.8240	* 2.2313	* 1.9937	* 2.2344	* 2.3354	* 3.8032
12	.7990	.9168	.8215	.8129	.5623	.6158	.5462	
	* 2.0645	* 1.7948	* 1.9947	* 1.9937	* 2.3791	* 2.2187	* 2.8441	
13	.7626	.7808	.8664	.7219	.6158	.4734	.3599	
	* 2.1549	* 2.0998	* 1.8847	* 2.2352	* 2.2187	* 2.7147	* 3.9914	
14	.7069	.7915	.6854	.6887	.5462	.3599		
	* 2.3130	* 2.0661	* 2.3809	* 2.3366	* 2.8466	* 3.9963		
15	.6073	.5601	.4862	.4230	F-SUB-Q			
	* 2.6818	* 2.9084	* 3.3316	* 3.8058	M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.7668	1.1031	1.1074	1.2520	1.0988	1.0913	1.0378	.9510
	* 1.7959	* 1.5529	* 1.5571	* 1.3817	* 1.5727	* 1.5783	* 1.6524	* 1.7955
9	1.1031	1.0271	1.0549	1.1331	1.2338	1.0828	1.1503	.8354
	* 1.5529	* 1.6524	* 1.6336	* 1.5220	* 1.3998	* 1.5876	* 1.4916	* 2.0447
10	1.1074	1.0539	1.0142	1.1995	1.1342	1.1760	.9532	.7144
	* 1.5571	* 1.6356	* 1.6963	* 1.4331	* 1.5155	* 1.4557	* 1.7972	* 2.3803
11	1.2520	1.1331	1.1984	.9907	1.1192	1.0399	1.0614	.6330
	* 1.3817	* 1.5225	* 1.4335	* 1.7308	* 1.5203	* 1.6251	* 1.5857	* 2.6648
12	1.0988	1.2338	1.1342	1.1181	.7497	.9286	.8279	
	* 1.5727	* 1.3998	* 1.5164	* 1.5212	* 1.8176	* 1.6102	* 1.9634	
13	1.0913	1.0828	1.1749	1.0389	.9286	.7015	.5376	
	* 1.5783	* 1.5876	* 1.4565	* 1.6257	* 1.6102	* 1.9587	* 2.8054	
14	1.0378	1.1503	.9532	1.0614	.8268	.5376		
	* 1.6524	* 1.4916	* 1.7960	* 1.5857	* 1.9649	* 2.8054		
15	.9510	.8354	.7144	.6319	F-SUB-Q			
	* 1.7955	* 2.0447	* 2.3803	* 2.6648	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 38 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8622	* 1.2788	* 1.2627	* 1.4416	* 1.2338	* 1.2445	* 1.2027	* 1.1353
	* 1.6872	* 1.4217	* 1.4502	* 1.2710	* 1.4819	* 1.4662	* 1.5102	* 1.5921
9	* 1.2788	* 1.1727	* 1.1867	* 1.2723	* 1.4191	* 1.2306	* 1.3473	* .9735
	* 1.4217	* 1.5249	* 1.5458	* 1.4375	* 1.2867	* 1.4790	* 1.3493	* 1.8577
10	* 1.2627	* 1.1856	* 1.1320	* 1.3816	* 1.2798	* 1.3656	* 1.0764	* .8257
	* 1.4502	* 1.5471	* 1.6185	* 1.3203	* 1.4232	* 1.3267	* 1.6846	* 2.1830
11	* 1.4416	* 1.2723	* 1.3805	* 1.1074	* 1.2991	* 1.2059	* 1.2659	* .7379
	* 1.2710	* 1.4382	* 1.3210	* 1.6484	* 1.3906	* 1.4871	* 1.4079	* 2.4162
12	* 1.2338	* 1.4191	* 1.2788	* 1.2991	* .8439	* 1.1074	* .9810	*
	* 1.4819	* 1.2870	* 1.4247	* 1.3913	* 1.7043	* 1.4408	* 1.7620	*
13	* 1.2445	* 1.2306	* 1.3655	* 1.2059	* 1.1074	* .8311	* .6351	*
	* 1.4662	* 1.4782	* 1.3274	* 1.4877	* 1.4408	* 1.7787	* 2.5409	*
14	* 1.2027	* 1.3473	* 1.0774	* 1.2649	* .9800	* .6351	*	*
	* 1.5102	* 1.3490	* 1.6842	* 1.4081	* 1.7632	* 2.5429	*	*
15	* 1.1353	* .9735	* .8257	* .7368	* F-SUB-Q			
	* 1.5921	* 1.8571	* 2.1840	* 2.4177	* M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9425	* 1.3977	* 1.3548	* 1.5562	* 1.3163	* 1.3280	* 1.2938	* 1.2349
	* 1.6947	* 1.4066	* 1.4604	* 1.2635	* 1.4893	* 1.4694	* 1.5011	* 1.5636
9	* 1.3977	* 1.2691	* 1.2616	* 1.3580	* 1.5380	* 1.3163	* 1.4608	* 1.0496
	* 1.4066	* 1.5214	* 1.5720	* 1.4469	* 1.2723	* 1.4795	* 1.3305	* 1.8412
10	* 1.3548	* 1.2595	* 1.2059	* 1.5026	* 1.3762	* 1.4940	* 1.1524	* .8889
	* 1.4604	* 1.5734	* 1.6452	* 1.3081	* 1.4227	* 1.3036	* 1.6810	* 2.1706
11	* 1.5562	* 1.3580	* 1.5015	* 1.1888	* 1.4309	* 1.3238	* 1.3944	* .8011
	* 1.2635	* 1.4475	* 1.3091	* 1.6646	* 1.3679	* 1.4680	* 1.3788	* 2.3852
12	* 1.3163	* 1.5369	* 1.3752	* 1.4298	* .9264	* 1.2445	* 1.0881	*
	* 1.4893	* 1.2729	* 1.4242	* 1.3686	* 1.7039	* 1.4112	* 1.7349	*
13	* 1.3280	* 1.3173	* 1.4940	* 1.3238	* 1.2434	* .9361	* .7101	*
	* 1.4694	* 1.4787	* 1.3042	* 1.4688	* 1.4112	* 1.7608	* 2.5149	*
14	* 1.2938	* 1.4608	* 1.1524	* 1.3934	* 1.0871	* .7101	*	*
	* 1.5011	* 1.3303	* 1.6817	* 1.3795	* 1.7351	* 2.5167	*	*
15	* 1.2349	* 1.0507	* .8879	* .8011	* F-SUB-Q			
	* 1.5636	* 1.8412	* 2.1723	* 2.3873	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 39 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 RFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0496	* 1.4619	* 1.3816	* 1.5862	* 1.3323	* 1.3409	* 1.3098	* 1.2541 *
	* 1.8041	* 1.4823	* 1.5713	* 1.3452	* 1.5984	* 1.5708	* 1.5956	* 1.6523 *
9	* 1.4619	* 1.3195	* 1.2788	* 1.3794	* 1.5776	* 1.3334	* 1.4887	* 1.0624 *
	* 1.4823	* 1.6141	* 1.6969	* 1.5540	* 1.3529	* 1.5772	* 1.4062	* 1.9551 *
10	* 1.3816	* 1.2766	* 1.2252	* 1.5508	* 1.4094	* 1.5476	* 1.1717	* .9007 *
	* 1.5713	* 1.6987	* 1.7728	* 1.3936	* 1.5243	* 1.3868	* 1.8011	* 2.3140 *
11	* 1.5862	* 1.3794	* 1.5497	* 1.2231	* 1.5060	* 1.3891	* 1.4512	* .8225 *
	* 1.3452	* 1.5540	* 1.3943	* 1.7806	* 1.4305	* 1.5490	* 1.4747	* 2.5668 *
12	* 1.3323	* 1.5776	* 1.4073	* 1.5058	* 1.0399	* 1.3495	* 1.1503	*
	* 1.5984	* 1.3535	* 1.5257	* 1.4318	* 1.8076	* 1.4804	* 1.8257	*
13	* 1.3409	* 1.3334	* 1.5465	* 1.3880	* 1.3495	* 1.0335	* .7604	*
	* 1.5708	* 1.5763	* 1.3875	* 1.5499	* 1.4804	* 1.8665	* 2.6653	*
14	* 1.3098	* 1.4887	* 1.1717	* 1.4501	* 1.1492	* .7604	*	*
	* 1.5956	* 1.4062	* 1.8011	* 1.4747	* 1.8269	* 2.6659	*	*
15	* 1.2541	* 1.0624	* .8996	* .8215	* F-SUB-Q			
	* 1.6523	* 1.9551	* 2.3154	* 2.5692	* M-SUB-Q			

AT 75% POWER, 100 RFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2499	* 1.5797	* 1.4544	* 1.6675	* 1.3923	* 1.3977	* 1.3655	* 1.3109 *
	* 1.8757	* 1.5246	* 1.6724	* 1.4201	* 1.6943	* 1.6625	* 1.6788	* 1.7273 *
9	* 1.5797	* 1.4384	* 1.3505	* 1.4491	* 1.6675	* 1.3998	* 1.5615	* 1.1074 *
	* 1.5246	* 1.6670	* 1.8100	* 1.6496	* 1.4270	* 1.6647	* 1.4768	* 2.0527 *
10	* 1.4544	* 1.3505	* 1.2884	* 1.6515	* 1.4908	* 1.6504	* 1.2316	* .9414 *
	* 1.6724	* 1.8119	* 1.8898	* 1.4737	* 1.6144	* 1.4636	* 1.9049	* 2.4415 *
11	* 1.6675	* 1.4491	* 1.6504	* 1.3141	* 1.6376	* 1.5058	* 1.5562	* .8707 *
	* 1.4201	* 1.6496	* 1.4752	* 1.8289	* 1.4585	* 1.5832	* 1.5340	* 2.7262 *
12	* 1.3923	* 1.6675	* 1.4898	* 1.6365	* 1.2263	* 1.5197	* 1.2563	*
	* 1.6943	* 1.4277	* 1.6162	* 1.4599	* 1.8722	* 1.5197	* 1.8704	*
13	* 1.3977	* 1.3998	* 1.6493	* 1.5048	* 1.5197	* 1.1824	* .8407	*
	* 1.6625	* 1.6637	* 1.4644	* 1.5832	* 1.5197	* 1.9292	* 2.7482	*
14	* 1.3655	* 1.5615	* 1.2306	* 1.5562	* 1.2552	* .8397	*	*
	* 1.6788	* 1.4766	* 1.9062	* 1.5349	* 1.8714	* 2.7509	*	*
15	* 1.3109	* 1.1074	* .9403	* .8707	* F-SUB-Q			
	* 1.7273	* 2.0516	* 2.4436	* 2.7262	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 40 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3173	* 1.6333	* 1.4737	* 1.6911	* 1.4013	* 1.4041	* 1.3720	* 1.3205 *
	* 2.0182	* 1.6317	* 1.8212	* 1.5627	* 1.8725	* 1.8319	* 1.8439	* 1.8873 *
9	* 1.6333	* 1.4876	* 1.3730	* 1.4673	* 1.6986	* 1.4148	* 1.5787	* 1.1128 *
	* 1.6317	* 1.7916	* 1.9530	* 1.8199	* 1.5645	* 1.8322	* 1.6183	* 2.2508 *
10	* 1.4737	* 1.3730	* 1.3045	* 1.6900	* 1.5219	* 1.6911	* 1.2520	* .9478 *
	* 1.8212	* 1.9532	* 2.0537	* 1.5756	* 1.7370	* 1.5659	* 2.1008	* 2.6874 *
11	* 1.6911	* 1.4662	* 1.6879	* 1.3495	* 1.6954	* 1.5540	* 1.5990	* .8857 *
	* 1.5627	* 1.8210	* 1.5764	* 1.9618	* 1.5532	* 1.6889	* 1.6352	* 2.9536 *
12	* 1.4019	* 1.6975	* 1.5197	* 1.6943	* 1.3013	* 1.6033	* 1.3034	*
	* 1.8725	* 1.5653	* 1.7400	* 1.5541	* 2.0016	* 1.6134	* 1.9916	*
13	* 1.4041	* 1.4148	* 1.6900	* 1.5530	* 1.6033	* 1.2509	* .8771	*
	* 1.8319	* 1.8311	* 1.5667	* 1.6899	* 1.6134	* 2.0522	* 2.9286	*
14	* 1.3720	* 1.5787	* 1.2520	* 1.5990	* 1.3023	* .8771	*	*
	* 1.8439	* 1.6174	* 2.1008	* 1.6352	* 1.9928	* 2.9286	*	*
15	* 1.3205	* 1.1128	* .9468	* .8846	* F-SUB-Q			
	* 1.8873	* 2.2504	* 2.6892	* 2.9566	* M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3216	* 1.6408	* 1.4673	* 1.6868	* 1.3923	* 1.3912	* 1.3602	* 1.3120 *
	* 2.2106	* 1.7767	* 1.9838	* 1.7157	* 2.0786	* 2.0452	* 2.0547	* 2.0931 *
9	* 1.6408	* 1.4898	* 1.3677	* 1.4608	* 1.6997	* 1.4084	* 1.5722	* 1.1031 *
	* 1.7767	* 1.9606	* 2.1336	* 1.9832	* 1.6951	* 2.0394	* 1.7970	* 2.5053 *
10	* 1.4673	* 1.3677	* 1.2981	* 1.6943	* 1.5272	* 1.6986	* 1.2531	* .9403 *
	* 1.9838	* 2.1347	* 2.2384	* 1.7047	* 1.8847	* 1.6902	* 2.2809	* 2.9977 *
11	* 1.6868	* 1.4598	* 1.6933	* 1.3516	* 1.7093	* 1.5615	* 1.6086	* .8836 *
	* 1.7157	* 1.9836	* 1.7057	* 2.1414	* 1.6836	* 1.8362	* 1.7673	* 3.2009 *
12	* 1.3923	* 1.6986	* 1.5251	* 1.7082	* 1.3130	* 1.6258	* 1.3141	*
	* 2.0786	* 1.6961	* 1.8872	* 1.6848	* 2.1824	* 1.7475	* 2.1624	*
13	* 1.3912	* 1.4084	* 1.6975	* 1.5604	* 1.6258	* 1.2670	* .8868	*
	* 2.0452	* 2.0394	* 1.6912	* 1.8368	* 1.7465	* 2.2309	* 3.1851	*
14	* 1.3602	* 1.5722	* 1.2531	* 1.6076	* 1.3141	* .8868	*	*
	* 2.0547	* 1.7970	* 2.2815	* 1.7673	* 2.1640	* 3.1851	*	*
15	* 1.3120	* 1.1031	* .9393	* .8836	* F-SUB-Q			
	* 2.0931	* 2.5037	* 2.9985	* 3.2020	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 41 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
B	* 1.3409	* 1.6718	* 1.4876	* 1.7157	* 1.4105	* 1.4073	* 1.3773	* 1.3323
	* 2.2923	* 1.8385	* 2.0630	* 1.7895	* 2.1749	* 2.1798	* 2.2269	* 2.2735
9	* 1.6718	* 1.5123	* 1.3859	* 1.4823	* 1.7318	* 1.4287	* 1.5979	* 1.1171
	* 1.8385	* 2.0311	* 2.2149	* 2.0704	* 1.7741	* 2.1474	* 1.9217	* 2.7294
10	* 1.4876	* 1.3859	* 1.3141	* 1.7275	* 1.5583	* 1.7339	* 1.2756	* .9521
	* 2.0630	* 2.2149	* 2.3349	* 1.7785	* 1.9742	* 1.7741	* 2.4109	* 3.2163
11	* 1.7157	* 1.4823	* 1.7265	* 1.3741	* 1.7479	* 1.5936	* 1.6440	* .8986
	* 1.7895	* 2.0719	* 1.7807	* 2.2355	* 1.7601	* 1.9294	* 1.8682	* 3.4100
12	* 1.4105	* 1.7307	* 1.5551	* 1.7468	* 1.3388	* 1.6675	* 1.3452	*
	* 2.1749	* 1.7752	* 1.9769	* 1.7611	* 2.2977	* 1.8467	* 2.2868	*
13	* 1.4073	* 1.4298	* 1.7329	* 1.5936	* 1.6675	* 1.2981	* .9061	*
	* 2.1798	* 2.1474	* 1.7752	* 1.9307	* 1.8467	* 2.3713	* 3.3900	*
14	* 1.3773	* 1.5919	* 1.2756	* 1.6440	* 1.3452	* .9061	*	*
	* 2.2269	* 1.9204	* 2.4109	* 1.8694	* 2.2886	* 3.3900	*	*
15	* 1.3323	* 1.1181	* .9510	* .8975	* F-SUB-Q			
	* 2.2735	* 2.7268	* 3.2199	* 3.4100	* M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3034	* 1.6343	* 1.4491	* 1.6783	* 1.3730	* 1.3687	* 1.3420	* 1.3023
	* 2.3274	* 1.8574	* 2.0884	* 1.8052	* 2.2031	* 2.2082	* 2.2512	* 2.3051
9	* 1.6343	* 1.4726	* 1.3473	* 1.4459	* 1.6965	* 1.3944	* 1.5637	* 1.0892
	* 1.8574	* 2.0586	* 2.2459	* 2.0945	* 1.7873	* 2.1716	* 1.9358	* 2.7639
10	* 1.4491	* 1.3473	* 1.2777	* 1.6933	* 1.5240	* 1.7007	* 1.2466	* .9264
	* 2.0884	* 2.2459	* 2.3694	* 1.7917	* 1.9919	* 1.7051	* 2.4353	* 3.2636
11	* 1.6783	* 1.4448	* 1.6922	* 1.3398	* 1.7157	* 1.5604	* 1.6140	* .8761
	* 1.8052	* 2.0960	* 1.7940	* 2.2635	* 1.7719	* 1.9476	* 1.8828	* 3.4631
12	* 1.3730	* 1.6954	* 1.5219	* 1.7136	* 1.3077	* 1.6386	* 1.3184	*
	* 2.2031	* 1.7884	* 1.9947	* 1.7730	* 2.3255	* 1.8586	* 2.3088	*
13	* 1.3687	* 1.3944	* 1.6997	* 1.5594	* 1.6397	* 1.2702	* .8857	*
	* 2.2082	* 2.1716	* 1.7862	* 1.9489	* 1.8586	* 2.4009	* 3.4425	*
14	* 1.3420	* 1.5637	* 1.2466	* 1.6140	* 1.3173	* .8857	*	*
	* 2.2512	* 1.9345	* 2.4353	* 1.8828	* 2.3088	* 3.4425	*	*
15	* 1.3023	* 1.0892	* .9264	* .8761	* F-SUB-Q			
	* 2.3051	* 2.7612	* 3.2636	* 3.4631	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 42 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3152	* 1.6568	* 1.4651	* 1.7040	* 1.3891	* 1.3837	* 1.3591	* 1.3238 *
	* 2.2618	* 1.7917	* 1.9851	* 1.7070	* 2.0779	* 2.0572	* 2.0704	* 2.1051 *
9	* 1.6568	* 1.4887	* 1.3612	* 1.4641	* 1.7243	* 1.4126	* 1.5883	* 1.1031 *
	* 1.7917	* 1.9878	* 2.1426	* 1.9851	* 1.6930	* 2.0441	* 1.7973	* 2.5269 *
10	* 1.4651	* 1.3612	* 1.2906	* 1.7211	* 1.5487	* 1.7307	* 1.2649	* .9382 *
	* 1.9851	* 2.1442	* 2.2547	* 1.7080	* 1.9014	* 1.6960	* 2.3069	* 3.0055 *
11	* 1.7040	* 1.4641	* 1.7190	* 1.3559	* 1.7457	* 1.5862	* 1.6451	* .8889 *
	* 1.7070	* 1.9864	* 1.7100	* 2.1733	* 1.7000	* 1.8658	* 1.7851	* 3.2307 *
12	* 1.3891	* 1.7232	* 1.5465	* 1.7436	* 1.3248	* 1.6708	* 1.3420	*
	* 2.0779	* 1.6940	* 1.9052	* 1.7020	* 2.2565	* 1.7917	* 2.2065	*
13	* 1.3837	* 1.4126	* 1.7286	* 1.5851	* 1.6708	* 1.2916	* .8986	*
	* 2.0572	* 2.0441	* 1.6970	* 1.8670	* 1.7917	* 2.3143	* 3.2784	*
14	* 1.3591	* 1.5894	* 1.2649	* 1.6440	* 1.3420	* .8986	*	*
	* 2.0704	* 1.7973	* 2.3069	* 1.7851	* 2.2065	* 3.2821	*	*
15	* 1.3238	* 1.1042	* .9371	* .8879	* F-SUB-Q			
	* 2.1051	* 2.5247	* 3.0086	* 3.2307	* M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2927	* 1.6376	* 1.4459	* 1.6868	* 1.3698	* 1.3645	* 1.3430	* 1.3109 *
	* 2.0749	* 1.6263	* 1.7973	* 1.5339	* 1.8694	* 1.8550	* 1.8682	* 1.8989 *
9	* 1.6376	* 1.4673	* 1.3409	* 1.4459	* 1.7093	* 1.3955	* 1.5744	* 1.0903 *
	* 1.6263	* 1.8097	* 1.9528	* 1.7917	* 1.5241	* 1.8420	* 1.6136	* 2.2832 *
10	* 1.4459	* 1.3398	* 1.2702	* 1.7050	* 1.5326	* 1.7168	* 1.2509	* .9253 *
	* 1.7973	* 1.9528	* 2.0484	* 1.5462	* 1.7254	* 1.5339	* 2.0809	* 2.7094 *
11	* 1.6868	* 1.4448	* 1.7029	* 1.3377	* 1.7318	* 1.5701	* 1.6333	* .8771 *
	* 1.5339	* 1.7928	* 1.5478	* 1.9810	* 1.5421	* 1.6940	* 1.6181	* 2.9322 *
12	* 1.3698	* 1.7082	* 1.5305	* 1.7297	* 1.3066	* 1.6579	* 1.3302	*
	* 1.8694	* 1.5250	* 1.7274	* 1.5437	* 2.0690	* 1.6235	* 2.0002	*
13	* 1.3645	* 1.3955	* 1.7157	* 1.5690	* 1.6590	* 1.2777	* .8879	*
	* 1.8550	* 1.8408	* 1.5355	* 1.6950	* 1.6235	* 2.0990	* 2.9837	*
14	* 1.3430	* 1.5744	* 1.2509	* 1.6322	* 1.3291	* .8879	*	*
	* 1.8682	* 1.6127	* 2.0824	* 1.6190	* 2.0002	* 2.9837	*	*
15	* 1.3109	* 1.0903	* .9243	* .8771	* F-SUB-Q			
	* 1.8989	* 2.2832	* 2.7120	* 2.9352	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 43 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2445	* 1.5851	* 1.3955	* 1.6343	* 1.3227	* 1.3163	* 1.2981	* 1.2702
	* 1.8902	* 1.4827	* 1.6523	* 1.4137	* 1.7326	* 1.7243	* 1.7389	* 1.7665
9	* 1.5851	* 1.4148	* 1.2927	* 1.3966	* 1.6579	* 1.3484	* 1.5262	* 1.0539
	* 1.4827	* 1.6533	* 1.7873	* 1.6533	* 1.4000	* 1.7030	* 1.4934	* 2.1300
10	* 1.3955	* 1.2916	* 1.2231	* 1.6536	* 1.4844	* 1.6665	* 1.2102	* .8921
	* 1.6523	* 1.7884	* 1.8878	* 1.4130	* 1.5774	* 1.4014	* 1.9191	* 2.5225
11	* 1.6343	* 1.3966	* 1.6515	* 1.2895	* 1.6804	* 1.5208	* 1.5862	* .8472
	* 1.4137	* 1.6533	* 1.4144	* 1.8131	* 1.4041	* 1.5462	* 1.4729	* 2.6993
12	* 1.3227	* 1.6568	* 1.4812	* 1.6783	* 1.2606	* 1.6108	* 1.2884	*
	* 1.7326	* 1.4007	* 1.5800	* 1.4055	* 1.8865	* 1.4804	* 1.8269	*
13	* 1.3163	* 1.3484	* 1.6654	* 1.5197	* 1.6108	* 1.2359	* .8568	*
	* 1.7243	* 1.7020	* 1.4021	* 1.5470	* 1.4804	* 1.9268	* 2.7481	*
14	* 1.2981	* 1.5272	* 1.2102	* 1.5851	* 1.2873	* .8557	*	*
	* 1.7389	* 1.4926	* 1.9191	* 1.4729	* 1.8280	* 2.7481	*	*
15	* 1.2702	* 1.0539	* .8911	* .8461	* F-SUB-Q			
	* 1.7665	* 2.1284	* 2.5247	* 2.7018	* M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2381	* 1.5808	* 1.3923	* 1.6333	* 1.3195	* 1.3120	* 1.2948	* 1.2691
	* 1.6950	* 1.3328	* 1.4973	* 1.2825	* 1.5783	* 1.5757	* 1.5896	* 1.6154
9	* 1.5808	* 1.4105	* 1.2873	* 1.3944	* 1.6579	* 1.3452	* 1.5262	* 1.0507
	* 1.3328	* 1.4880	* 1.6181	* 1.5004	* 1.2685	* 1.5495	* 1.3598	* 1.9502
10	* 1.3923	* 1.2873	* 1.2177	* 1.6526	* 1.4833	* 1.6675	* 1.2081	* .8889
	* 1.4973	* 1.6190	* 1.7151	* 1.2769	* 1.4221	* 1.2657	* 1.7347	* 2.3088
11	* 1.6333	* 1.3944	* 1.6515	* 1.2852	* 1.6804	* 1.5197	* 1.5883	* .8439
	* 1.2825	* 1.5004	* 1.2780	* 1.6383	* 1.2624	* 1.3906	* 1.3249	* 2.4498
12	* 1.3195	* 1.6568	* 1.4812	* 1.6793	* 1.2552	* 1.6119	* 1.2895	*
	* 1.5783	* 1.2696	* 1.4249	* 1.2635	* 1.6861	* 1.3200	* 1.6373	*
13	* 1.3120	* 1.3462	* 1.6654	* 1.5187	* 1.6119	* 1.2327	* .8536	*
	* 1.5757	* 1.5487	* 1.2668	* 1.3913	* 1.3200	* 1.7192	* 2.4644	*
14	* 1.2948	* 1.5262	* 1.2081	* 1.5883	* 1.2884	* .8525	*	*
	* 1.5896	* 1.3592	* 1.7347	* 1.3249	* 1.6383	* 2.4665	*	*
15	* 1.2691	* 1.0517	* .8879	* .8439	* F-SUB-Q			
	* 1.6154	* 1.9489	* 2.3106	* 2.4518	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 44 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 RFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1706	* 1.5026	* 1.3238	* 1.5572	* 1.2520	* 1.2445	* 1.2274	* 1.2027
	* 1.6457	* 1.2894	* 1.4536	* 1.2433	* 1.5371	* 1.5388	* 1.5553	* 1.5817
9	* 1.5026	* 1.3377	* 1.2231	* 1.3270	* 1.5797	* 1.2777	* 1.4501	* .9950
	* 1.2894	* 1.4420	* 1.5714	* 1.4558	* 1.2285	* 1.5090	* 1.3249	* 1.9128
10	* 1.3238	* 1.2220	* 1.1545	* 1.5754	* 1.4126	* 1.5883	* 1.1470	* .8397
	* 1.4536	* 1.5714	* 1.6686	* 1.2348	* 1.3760	* 1.2249	* 1.6851	* 2.2671
11	* 1.5572	* 1.3259	* 1.5744	* 1.2188	* 1.6011	* 1.4448	* 1.5123	* .7979
	* 1.2433	* 1.4565	* 1.2359	* 1.5896	* 1.2187	* 1.3459	* 1.2808	* 2.3949
12	* 1.2520	* 1.5787	* 1.4094	* 1.6001	* 1.1899	* 1.5337	* 1.2242	*
	* 1.5371	* 1.2296	* 1.3786	* 1.2197	* 1.6327	* 1.2718	* 1.5835	*
13	* 1.2445	* 1.2777	* 1.5872	* 1.4437	* 1.5337	* 1.1663	* .8054	*
	* 1.5388	* 1.5082	* 1.2259	* 1.3465	* 1.2718	* 1.6647	* 2.3969	*
14	* 1.2274	* 1.4512	* 1.1470	* 1.5123	* 1.2242	* .8054	*	*
	* 1.5553	* 1.3243	* 1.6851	* 1.2814	* 1.5843	* 2.3989	*	*
15	* 1.2027	* .9950	* .8386	* .7979	* F-SUB-Q			
	* 1.5817	* 1.9115	* 2.2689	* 2.3969	* M-SUB-Q			

AT 75% POWER, 100 RFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1235	* 1.4394	* 1.2734	* 1.4973	* 1.2081	* 1.1942	* 1.1706	* 1.1395
	* 1.6118	* 1.2646	* 1.4214	* 1.2161	* 1.5012	* 1.5122	* 1.5388	* 1.5766
9	* 1.4394	* 1.2841	* 1.1770	* 1.2820	* 1.5197	* 1.2274	* 1.3848	* .9468
	* 1.2646	* 1.4110	* 1.5355	* 1.4172	* 1.2014	* 1.4781	* 1.3081	* 1.8989
10	* 1.2734	* 1.1770	* 1.1128	* 1.5165	* 1.3623	* 1.5240	* 1.0999	* .7990
	* 1.4214	* 1.5363	* 1.6290	* 1.2049	* 1.3396	* 1.1994	* 1.6523	* 2.2494
11	* 1.4973	* 1.2820	* 1.5155	* 1.1760	* 1.5390	* 1.3869	* 1.4437	* .7583
	* 1.2161	* 1.4179	* 1.2065	* 1.5487	* 1.1901	* 1.3164	* 1.2613	* 2.3772
12	* 1.2081	* 1.5187	* 1.3602	* 1.5380	* 1.1438	* 1.4651	* 1.1695	*
	* 1.5012	* 1.2019	* 1.3421	* 1.1915	* 1.5940	* 1.2487	* 1.5579	*
13	* 1.1942	* 1.2274	* 1.5230	* 1.3859	* 1.4651	* 1.1096	* .7647	*
	* 1.5122	* 1.4781	* 1.2004	* 1.3170	* 1.2487	* 1.6420	* 2.3733	*
14	* 1.1706	* 1.3848	* 1.0999	* 1.4426	* 1.1685	* .7636	*	*
	* 1.5388	* 1.3081	* 1.6533	* 1.2613	* 1.5587	* 2.3752	*	*
15	* 1.1395	* .9468	* .7979	* .7572	* F-SUB-Q			
	* 1.5766	* 1.8989	* 2.2512	* 2.3791	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 45 of 143

TABLE 1. (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 100 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.0078	* 1.2766	* 1.1278	* 1.3313	* 1.0892	* 1.0549	* 1.0174	* .9618
	* 1.7223	* 1.3656	* 1.5404	* 1.3105	* 1.5966	* 1.6448	* 1.7010	* 1.7962

9	* 1.2766	* 1.1385	* 1.0464	* 1.1567	* 1.3473	* 1.0967	* 1.1984	* .8172
	* 1.3656	* 1.5266	* 1.6590	* 1.5067	* 1.2975	* 1.5887	* 1.4507	* 2.1144

10	* 1.1278	* 1.0464	* 1.0057	* 1.3484	* 1.2242	* 1.3452	* .9768	* .6940
	* 1.5404	* 1.6590	* 1.7305	* 1.2987	* 1.4291	* 1.3016	* 1.7862	* 2.4899

11	* 1.3313	* 1.1567	* 1.3462	* 1.0667	* 1.3634	* 1.2242	* 1.2359	* .6490
	* 1.3105	* 1.5074	* 1.2998	* 1.6373	* 1.2860	* 1.4284	* 1.4117	* 2.6694

12	* 1.0892	* 1.3473	* 1.2220	* 1.3612	* 1.0303	* 1.2691	* 1.0089	*
	* 1.5966	* 1.2987	* 1.4313	* 1.2871	* 1.6950	* 1.3800	* 1.7295	*

13	* 1.0549	* 1.0967	* 1.3441	* 1.2242	* 1.2691	* .9639	* .6608	*
	* 1.6448	* 1.5878	* 1.3022	* 1.4291	* 1.3800	* 1.8142	* 2.6353	*

14	* 1.0174	* 1.1984	* .9768	* 1.2349	* 1.0078	* .6608	*	*
	* 1.7010	* 1.4507	* 1.7862	* 1.4124	* 1.7305	* 2.6353	*	*

15	* .9618	* .8172	* .6940	* .6480	* F-SUB-Q			
	* 1.7962	* 2.1144	* 2.4920	* 2.6718	* M-SUB-Q			

AT 75% POWER, 100 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .6844	* .8622	* .7358	* .8954	* .7390	* .6876	* .6469	* .5708
	* 2.4686	* 1.9621	* 2.3014	* 1.8952	* 2.2941	* 2.4581	* 2.6091	* 2.9472

9	* .8622	* .7465	* .6876	* .7829	* .9243	* .7336	* .7636	* .5109
	* 1.9621	* 2.2635	* 2.4581	* 2.1667	* 1.8395	* 2.3125	* 2.2132	* 3.2933

10	* .7358	* .6876	* .6854	* .9200	* .8225	* .9136	* .6447	* .4402
	* 2.3014	* 2.4602	* 2.4728	* 1.8467	* 2.0675	* 1.8610	* 2.6305	* 3.8306

11	* .8954	* .7829	* .9189	* .7336	* .9307	* .7990	* .7508	* .4016
	* 1.8952	* 2.1684	* 1.8479	* 2.3162	* 1.8292	* 2.1284	* 2.2600	* 4.1981

12	* .7390	* .9232	* .8215	* .9296	* .7036	* .8204	* .6255	*
	* 2.2941	* 1.8397	* 2.0690	* 1.8303	* 2.4149	* 2.0719	* 2.7145	*

13	* .6876	* .7336	* .9136	* .7979	* .8204	* .6212	* .4155	*
	* 2.4581	* 2.3106	* 1.8622	* 2.1300	* 2.0719	* 2.7351	* 4.0795	*

14	* .6469	* .7636	* .6447	* .7508	* .6255	* .4155	*	*
	* 2.6091	* 2.2132	* 2.6305	* 2.2618	* 2.7145	* 4.0795	*	*

15	* .5708	* .5119	* .4402	* .4016	* F-SUB-Q			
	* 2.9472	* 3.2933	* 3.8306	* 4.2042	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 46 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .7004 *	* .9832 *	* .9660 *	* 1.1288 *	* 1.0046 *	* .9832 *	* .9350 *	* .8418 *
	* 2.1914 *	* 1.8433 *	* 1.8943 *	* 1.6279 *	* 1.8293 *	* 1.8694 *	* 1.9630 *	* 2.1758 *
9	* .9832 *	* .9007 *	* .9510 *	* 1.0314 *	* 1.1363 *	* .9992 *	* 1.0367 *	* .7615 *
	* 1.8433 *	* 2.0224 *	* 1.9239 *	* 1.7775 *	* 1.6125 *	* 1.8343 *	* 1.7696 *	* 2.4060 *
10	* .9660 *	* .9500 *	* .9436 *	* 1.1160 *	* 1.0357 *	* 1.0978 *	* .8954 *	* .6833 *
	* 1.8943 *	* 1.9253 *	* 1.9351 *	* 1.6377 *	* 1.7651 *	* 1.6619 *	* 2.0347 *	* 2.6652 *
11	* 1.1288 *	* 1.0314 *	* 1.1160 *	* .9318 *	* 1.0282 *	* .9318 *	* .9157 *	* .5987 *
	* 1.6279 *	* 1.7775 *	* 1.6387 *	* 1.9524 *	* 1.7593 *	* 1.9348 *	* 1.9666 *	* 3.0190 *
12	* 1.0046 *	* 1.1363 *	* 1.0357 *	* 1.0282 *	* .7144 *	* .8225 *	* .7304 *	
	* 1.8293 *	* 1.6125 *	* 1.7663 *	* 1.7604 *	* 2.1610 *	* 2.0458 *	* 2.4172 *	
13	* .9832 *	* .9992 *	* 1.0978 *	* .9318 *	* .8215 *	* .6544 *	* .5162 *	
	* 1.8694 *	* 1.8332 *	* 1.6619 *	* 1.9351 *	* 2.0458 *	* 2.4877 *	* 3.3334 *	
14	* .9350 *	* 1.0367 *	* .8954 *	* .9157 *	* .7304 *	* .5162 *		
	* 1.9630 *	* 1.7686 *	* 2.0347 *	* 1.9666 *	* 2.4172 *	* 3.3352 *		
15	* .8418 *	* .7615 *	* .6833 *	* .5987 *	* F-SUB-Q			
	* 2.1758 *	* 2.4060 *	* 2.6661 *	* 3.0190 *	* M-SUB-Q			

AT 75% POWER, 350 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8365 *	* 1.2370 *	* 1.2252 *	* 1.4373 *	* 1.2499 *	* 1.2531 *	* 1.2124 *	* 1.1556 *
	* 1.8600 *	* 1.5159 *	* 1.5423 *	* 1.3219 *	* 1.5198 *	* 1.5166 *	* 1.5655 *	* 1.6408 *
9	* 1.2370 *	* 1.1385 *	* 1.1877 *	* 1.2863 *	* 1.4341 *	* 1.2541 *	* 1.3441 *	* 1.0067 *
	* 1.5159 *	* 1.6513 *	* 1.5908 *	* 1.4726 *	* 1.3224 *	* 1.5109 *	* 1.4116 *	* 1.8839 *
10	* 1.2252 *	* 1.1867 *	* 1.1652 *	* 1.3944 *	* 1.2959 *	* 1.3784 *	* 1.1278 *	* .8964 *
	* 1.5423 *	* 1.5919 *	* 1.6191 *	* 1.3547 *	* 1.4569 *	* 1.3690 *	* 1.6712 *	* 2.1064 *
11	* 1.4373 *	* 1.2852 *	* 1.3944 *	* 1.1492 *	* 1.2981 *	* 1.1974 *	* 1.2295 *	* .7925 *
	* 1.3219 *	* 1.4734 *	* 1.3548 *	* 1.6360 *	* 1.4402 *	* 1.5525 *	* 1.5104 *	* 2.3571 *
12	* 1.2499 *	* 1.4341 *	* 1.2959 *	* 1.2981 *	* .8547 *	* 1.0849 *	* .9660 *	
	* 1.5198 *	* 1.3224 *	* 1.4577 *	* 1.4410 *	* 1.8321 *	* 1.6331 *	* 1.9821 *	
13	* 1.2531 *	* 1.2541 *	* 1.3784 *	* 1.1963 *	* 1.0839 *	* .8493 *	* .6812 *	
	* 1.5166 *	* 1.5101 *	* 1.3690 *	* 1.5527 *	* 1.6331 *	* 1.9617 *	* 2.6098 *	
14	* 1.2124 *	* 1.3441 *	* 1.1278 *	* 1.2284 *	* .9660 *	* .6812 *		
	* 1.5655 *	* 1.4108 *	* 1.6711 *	* 1.5104 *	* 1.8828 *	* 2.6110 *		
15	* 1.1556 *	* 1.0067 *	* .8964 *	* .7925 *	* F-SUB-Q			
	* 1.6408 *	* 1.8838 *	* 2.1066 *	* 2.3571 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 47 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 KFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .8739	* 1.3238	* 1.2959	* 1.5487	* 1.3173	* 1.3291	* 1.2970	* 1.2659
	* 1.8022	* 1.4728	* 1.5156	* 1.2723	* 1.4957	* 1.4841	* 1.5197	* 1.5562

9	* 1.3238	* 1.1963	* 1.2445	* 1.3537	* 1.5476	* 1.3270	* 1.4587	* 1.0849
	* 1.4728	* 1.6324	* 1.5789	* 1.4514	* 1.2690	* 1.4819	* 1.3506	* 1.8161

10	* 1.2959	* 1.2434	* 1.2209	* 1.5037	* 1.3698	* 1.4930	* 1.1899	* .9607
	* 1.5156	* 1.5807	* 1.6091	* 1.3023	* 1.4275	* 1.3064	* 1.6429	* 2.0447

11	* 1.5487	* 1.3537	* 1.5037	* 1.2049	* 1.3977	* 1.2766	* 1.3334	* .8493
	* 1.2723	* 1.4514	* 1.3030	* 1.6204	* 1.3819	* 1.5020	* 1.4356	* 2.2772

12	* 1.3173	* 1.5476	* 1.3687	* 1.3977	* .8932	* 1.1727	* 1.0389	*
	* 1.4957	* 1.2690	* 1.4282	* 1.3819	* 1.7742	* 1.5065	* 1.8066	*

13	* 1.3291	* 1.3270	* 1.4930	* 1.2766	* 1.1727	* .9050	* .7304	*
	* 1.4841	* 1.4812	* 1.3064	* 1.5020	* 1.5059	* 1.8448	* 2.4664	*

14	* 1.2970	* 1.4598	* 1.1899	* 1.3334	* 1.0389	* .7304	*	*
	* 1.5197	* 1.3499	* 1.6429	* 1.4356	* 1.8078	* 2.4686	*	*

15	* 1.2659	* 1.0860	* .9607	* .8493	* F-SUB-Q			
	* 1.5562	* 1.8160	* 2.0455	* 2.2772	* M-SUB-Q			

AT 75% POWER, 350 KFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .8729	* 1.3345	* 1.2991	* 1.5690	* 1.3238	* 1.3355	* 1.3098	* 1.2895
	* 1.7828	* 1.4637	* 1.5819	* 1.3093	* 1.5532	* 1.5437	* 1.5751	* 1.5996

9	* 1.3345	* 1.1963	* 1.2402	* 1.3580	* 1.5733	* 1.3334	* 1.4823	* 1.0988
	* 1.4637	* 1.6380	* 1.6615	* 1.5095	* 1.2999	* 1.5346	* 1.3876	* 1.8767

10	* 1.2991	* 1.2391	* 1.2188	* 1.5272	* 1.3784	* 1.5208	* 1.1942	* .9693
	* 1.5819	* 1.6626	* 1.6866	* 1.3363	* 1.4763	* 1.3325	* 1.7030	* 2.1113

11	* 1.5690	* 1.3580	* 1.5262	* 1.2070	* 1.4191	* 1.2884	* 1.3527	* .8568
	* 1.3093	* 1.5095	* 1.3369	* 1.6883	* 1.3959	* 1.5475	* 1.4719	* 2.3419

12	* 1.3238	* 1.5733	* 1.3773	* 1.4180	* .8954	* 1.1910	* 1.0528	*
	* 1.5532	* 1.3003	* 1.4774	* 1.3965	* 1.7497	* 1.4774	* 1.8348	*

13	* 1.3355	* 1.3334	* 1.5208	* 1.2884	* 1.1910	* .9136	* .7390	*
	* 1.5437	* 1.5338	* 1.3328	* 1.5478	* 1.4773	* 1.8234	* 2.4590	*

14	* 1.3098	* 1.4833	* 1.1942	* 1.3527	* 1.0517	* .7390	*	*
	* 1.5751	* 1.3870	* 1.7030	* 1.4722	* 1.8348	* 2.4611	*	*

15	* 1.2895	* 1.0999	* .9693	* .8568	* F-SUB-Q			
	* 1.5996	* 1.8756	* 2.1120	* 2.3419	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 48 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8429	* 1.2948	* 1.2531	* 1.5219	* 1.2756	* 1.2863	* 1.3649	* 1.2499 *
	* 1.9214	* 1.5676	* 1.7325	* 1.4204	* 1.6968	* 1.6806	* 1.7089	* 1.7271 *
9	* 1.2948	* 1.1524	* 1.1920	* 1.3109	* 1.5283	* 1.2863	* 1.4384	* 1.0624 *
	* 1.5676	* 1.7653	* 1.8224	* 1.6497	* 1.4090	* 1.6754	* 1.4977	* 2.0323 *
10	* 1.2531	* 1.1910	* 1.1738	* 1.4844	* 1.3345	* 1.4801	* 1.1524	* .9361 *
	* 1.7325	* 1.8241	* 1.8461	* 1.4507	* 1.6139	* 1.4474	* 1.8631	* 2.2957 *
11	* 1.5219	* 1.3109	* 1.4844	* 1.1642	* 1.3827	* 1.2520	* 1.3173	* .8290 *
	* 1.4204	* 1.6497	* 1.4510	* 1.8407	* 1.4903	* 1.6710	* 1.6151	* 2.5733 *
12	* 1.2756	* 1.5283	* 1.3334	* 1.3816	* .8686	* 1.1631	* 1.0239	*
	* 1.5968	* 1.4093	* 1.6148	* 1.4909	* 1.8811	* 1.5770	* 1.9702	*
13	* 1.2863	* 1.2863	* 1.4801	* 1.2520	* 1.1631	* .8911	* .7208	*
	* 1.6806	* 1.6754	* 1.4474	* 1.6710	* 1.5770	* 1.9544	* 2.6409	*
14	* 1.2649	* 1.4394	* 1.1524	* 1.3173	* 1.0239	* .7197	*	*
	* 1.7089	* 1.4973	* 1.8631	* 1.6156	* 1.9714	* 2.6433	*	*
15	* 1.2499	* 1.0624	* .9361	* .8279	* F-SUB-Q			
	* 1.7271	* 2.0323	* 2.2966	* 2.5744	* M-SUB-Q			

AT 75% POWER, 350 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8632	* 1.3227	* 1.2649	* 1.5390	* 1.2841	* 1.2906	* 1.2713	* 1.2606 *
	* 2.0109	* 1.6293	* 1.8649	* 1.5175	* 1.8190	* 1.8008	* 1.8196	* 1.8272 *
9	* 1.3227	* 1.1717	* 1.2017	* 1.3216	* 1.5497	* 1.2959	* 1.4533	* 1.0699 *
	* 1.6293	* 1.8426	* 1.9645	* 1.7718	* 1.5038	* 1.7953	* 1.5912	* 2.1568 *
10	* 1.2649	* 1.2006	* 1.1845	* 1.5101	* 1.3505	* 1.5058	* 1.1631	* .9446 *
	* 1.8649	* 1.9658	* 1.9896	* 1.5524	* 1.7331	* 1.5471	* 1.9967	* 2.4477 *
11	* 1.5390	* 1.3216	* 1.5090	* 1.1802	* 1.4159	* 1.2777	* 1.3441	* .8397 *
	* 1.5175	* 1.7722	* 1.5528	* 1.9150	* 1.5438	* 1.7351	* 1.7045	* 2.7632 *
12	* 1.2841	* 1.5497	* 1.3495	* 1.4148	* .8911	* 1.2006	* 1.0528	*
	* 1.8190	* 1.5038	* 1.7341	* 1.5443	* 1.9716	* 1.6460	* 2.0495	*
13	* 1.2906	* 1.2970	* 1.5058	* 1.2777	* 1.2006	* .9264	* .7465	*
	* 1.8008	* 1.7942	* 1.5475	* 1.7357	* 1.6456	* 2.0527	* 2.7627	*
14	* 1.2713	* 1.4544	* 1.1631	* 1.3430	* 1.0528	* .7465	*	*
	* 1.8196	* 1.5907	* 1.9967	* 1.7045	* 2.0501	* 2.7653	*	*
15	* 1.2606	* 1.0699	* .9436	* .8397	* F-SUB-Q			
	* 1.8272	* 2.1559	* 2.4498	* 2.7658	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 49 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .9307	* 1.3505	* 1.2606	* 1.5294	* 1.2691	* 1.2713	* 1.2520	* 1.2445 *
	* 2.1571	* 1.7406	* 2.0250	* 1.6720	* 2.0118	* 1.9891	* 2.0023	* 1.9997 *

9	* 1.3505	* 1.1899	* 1.1942	* 1.3120	* 1.5444	* 1.2841	* 1.4384	* 1.0549 *
	* 1.7406	* 1.9773	* 2.1412	* 1.9561	* 1.6564	* 1.9805	* 1.7461	* 2.3672 *

10	* 1.2606	* 1.1931	* 1.1792	* 1.5123	* 1.3473	* 1.5090	* 1.1535	* .9328 *
	* 2.0250	* 2.1428	* 2.1584	* 1.6733	* 1.8763	* 1.6704	* 2.2055	* 2.6956 *

11	* 1.5294	* 1.3120	* 1.5123	* 1.1835	* 1.4448	* 1.2981	* 1.3559	* .8365 *
	* 1.6720	* 1.9561	* 1.6739	* 2.0584	* 1.6477	* 1.8594	* 1.8240	* 3.0388 *

12	* 1.2691	* 1.5444	* 1.3462	* 1.4448	* .9607	* 1.2531	* 1.0796	*
	* 2.0118	* 1.6564	* 1.8780	* 1.3481	* 2.1093	* 1.7523	* 2.1885	*

13	* 1.2713	* 1.2841	* 1.5090	* 1.2981	* 1.2531	* .9842	* .7754	*
	* 1.9891	* 1.9791	* 1.6704	* 1.8594	* 1.7523	* 2.1855	* 2.9450	*

14	* 1.2520	* 1.4394	* 1.1535	* 1.3548	* 1.0796	* .7743	*	
	* 2.0023	* 1.7461	* 2.2055	* 1.8240	* 2.1885	* 2.9480	*	

15	* 1.2445	* 1.0549	* .9328	* .8365	* F-SUB-Q			
	* 1.9997	* 2.3661	* 2.6962	* 3.0388	* M-SUB-Q			

AT 75% POWER, 350 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.0849	* 1.4030	* 1.2574	* 1.5165	* 1.2509	* 1.2499	* 1.2306	* 1.2263 *
	* 2.3452	* 1.8848	* 2.1882	* 1.8242	* 2.2187	* 2.2117	* 2.2179	* 2.2064 *

9	* 1.4030	* 1.2338	* 1.1888	* 1.3013	* 1.5347	* 1.2713	* 1.4201	* 1.0378 *
	* 1.8848	* 2.1487	* 2.3157	* 2.1183	* 1.7940	* 2.1696	* 1.9301	* 2.6191 *

10	* 1.2574	* 1.1877	* 1.1749	* 1.5144	* 1.3430	* 1.5090	* 1.1438	* .9211 *
	* 2.1882	* 2.3175	* 2.3345	* 1.8029	* 2.0272	* 1.7956	* 2.4016	* 2.9892 *

11	* 1.5165	* 1.3013	* 1.5133	* 1.2006	* 1.4876	* 1.3259	* 1.3698	* .8322 *
	* 1.8242	* 2.1183	* 1.8029	* 2.2343	* 1.7811	* 2.0120	* 1.9622	* 3.2782 *

12	* 1.2509	* 1.5347	* 1.3420	* 1.4865	* 1.0946	* 1.3495	* 1.1138	*
	* 2.2187	* 1.7940	* 2.0299	* 1.7812	* 2.2916	* 1.8933	* 2.3688	*

13	* 1.2499	* 1.2713	* 1.5090	* 1.3259	* 1.3505	* 1.0699	* .8118	*
	* 2.2117	* 2.1695	* 1.7967	* 2.0120	* 1.8928	* 2.3648	* 3.1901	*

14	* 1.2306	* 1.4212	* 1.1438	* 1.3698	* 1.1138	* .8107	*	
	* 2.2179	* 1.9301	* 2.4016	* 1.9622	* 2.3691	* 3.1937	*	

15	* 1.2263	* 1.0378	* .9200	* .8322	* F-SUB-Q			
	* 2.2064	* 2.6180	* 2.9923	* 3.2816	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 50 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 BFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1824	* 1.4823	* 1.2841	* 1.5422	* 1.2670	* 1.2627	* 1.2434	* 1.2424 *
	* 2.4944	* 1.9952	* 2.3355	* 1.9461	* 2.3726	* 2.3830	* 2.4082	* 2.3848 *
9	* 1.4823	* 1.2981	* 1.2124	* 1.3238	* 1.5647	* 1.2906	* 1.4405	* 1.0507 *
	* 1.9952	* 2.2818	* 2.4714	* 2.2613	* 1.9104	* 2.3181	* 2.0745	* 2.8363 *
10	* 1.2841	* 1.2113	* 1.1995	* 1.5519	* 1.3720	* 1.5519	* 1.1642	* .9339 *
	* 2.3355	* 2.4753	* 2.4931	* 1.9142	* 2.1572	* 1.9048	* 2.5613	* 3.2066 *
11	* 1.5422	* 1.3238	* 1.5519	* 1.2445	* 1.5572	* 1.3762	* 1.4148	* .8514 *
	* 1.9461	* 2.2629	* 1.9154	* 2.3768	* 1.8847	* 2.1370	* 2.0793	* 3.4852 *
12	* 1.2670	* 1.5647	* 1.3709	* 1.5572	* 1.1952	* 1.4480	* 1.1674	*
	* 2.3726	* 1.9105	* 2.1588	* 1.8848	* 2.4374	* 2.0041	* 2.5018	*
13	* 1.2627	* 1.2916	* 1.5519	* 1.3762	* 1.4480	* 1.1513	* .8589	*
	* 2.3830	* 2.3181	* 1.9060	* 2.1370	* 2.0040	* 2.5065	* 3.3752	*
14	* 1.2434	* 1.4405	* 1.1642	* 1.4148	* 1.1674	* .8579	*	*
	* 2.4082	* 2.0745	* 2.5611	* 2.0793	* 2.5019	* 3.3792	*	*
15	* 1.2424	* 1.0507	* .9328	* .8504	* F-SUB-Q			
	* 2.3848	* 2.8350	* 3.2066	* 3.4894	* M-SUB-Q			

AT 75% POWER, 350 BFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1813	* 1.4812	* 1.2649	* 1.5176	* 1.2424	* 1.2349	* 1.2167	* 1.2188 *
	* 2.5696	* 2.0542	* 2.4089	* 2.0141	* 2.4602	* 2.4749	* 2.5159	* 2.5115 *
9	* 1.4812	* 1.2927	* 1.1942	* 1.3023	* 1.5422	* 1.2670	* 1.4169	* 1.0292 *
	* 2.0542	* 2.3520	* 2.5492	* 2.3444	* 1.9823	* 2.4109	* 2.1603	* 2.9745 *
10	* 1.2649	* 1.1931	* 1.1802	* 1.5358	* 1.3580	* 1.5380	* 1.1449	* .9146 *
	* 2.4089	* 2.5515	* 2.5811	* 1.9864	* 2.2442	* 1.9837	* 2.6694	* 3.3429 *
11	* 1.5176	* 1.3023	* 1.5347	* 1.2327	* 1.5530	* 1.3666	* 1.4052	* .8386 *
	* 2.0141	* 2.3444	* 1.9864	* 2.4707	* 1.9608	* 2.2286	* 2.1700	* 3.6468 *
12	* 1.2424	* 1.5412	* 1.3570	* 1.5519	* 1.1952	* 1.4544	* 1.1652	*
	* 2.4602	* 1.9823	* 2.2459	* 1.9608	* 2.5358	* 2.0869	* 2.6091	*
13	* 1.2349	* 1.2681	* 1.5380	* 1.3666	* 1.4544	* 1.1588	* .8611	*
	* 2.4749	* 2.4109	* 1.9851	* 2.2286	* 2.0854	* 2.6138	* 3.5223	*
14	* 1.2167	* 1.4169	* 1.1449	* 1.4052	* 1.1652	* .8600	*	*
	* 2.5159	* 2.1586	* 2.6694	* 2.1700	* 2.6091	* 3.5266	*	*
15	* 1.2188	* 1.0292	* .9146	* .8375	* F-SUB-Q			
	* 2.5115	* 2.9745	* 3.3468	* 3.6468	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 51 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2092	* 1.5197	* 1.2884	* 1.5465	* 1.2627	* 1.2531	* 1.2359	* 1.2413
	* 2.5269	* 2.0002	* 2.3088	* 1.9294	* 2.3463	* 2.3406	* 2.3536	* 2.3187
9	* 1.5197	* 1.3216	* 1.2167	* 1.3248	* 1.5733	* 1.2884	* 1.4448	* 1.0474
	* 2.0002	* 2.2850	* 2.4435	* 2.2494	* 1.9039	* 2.2977	* 2.0354	* 2.7557
10	* 1.2884	* 1.2167	* 1.2017	* 1.5701	* 1.3859	* 1.5733	* 1.1652	* .9318
	* 2.3088	* 2.4456	* 2.4813	* 1.9204	* 2.1716	* 1.9128	* 2.5247	* 3.1057
11	* 1.5465	* 1.3248	* 1.5701	* 1.2574	* 1.5915	* 1.3966	* 1.4394	* .8557
	* 1.9294	* 2.2494	* 1.9204	* 2.3949	* 1.9102	* 2.1586	* 2.0764	* 3.4060
12	* 1.2627	* 1.5733	* 1.3848	* 1.5904	* 1.2242	* 1.4951	* 1.1963	*
	* 2.3463	* 1.9039	* 2.1733	* 1.9102	* 2.4963	* 2.0397	* 2.5072	*
13	* 1.2531	* 1.2895	* 1.5733	* 1.3966	* 1.4951	* 1.1920	* .8857	*
	* 2.3406	* 2.2959	* 1.9128	* 2.1586	* 2.0383	* 2.5380	* 3.3624	*
14	* 1.2359	* 1.4459	* 1.1652	* 1.4394	* 1.1963	* .8846	*	*
	* 2.3536	* 2.0354	* 2.5247	* 2.0764	* 2.5072	* 3.3663	*	*
15	* 1.2413	* 1.0474	* .9307	* .8557	* F-SUB-Q			
	* 2.3187	* 2.7569	* 3.1090	* 3.4060	* M-SUB-Q			

AT 75% POWER, 350 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2059	* 1.5230	* 1.2863	* 1.5455	* 1.2574	* 1.2466	* 1.2316	* 1.2402
	* 2.2459	* 1.7698	* 2.0557	* 1.7161	* 2.0945	* 2.0894	* 2.0955	* 2.0641
9	* 1.5230	* 1.3195	* 1.2134	* 1.3216	* 1.5744	* 1.2841	* 1.4448	* 1.0453
	* 1.7698	* 2.0283	* 2.1765	* 2.0043	* 1.6930	* 2.0513	* 1.8104	* 2.4546
10	* 1.2863	* 1.2124	* 1.1963	* 1.5722	* 1.3848	* 1.5765	* 1.1620	* .9286
	* 2.0557	* 2.1782	* 2.2132	* 1.7060	* 1.9345	* 1.7010	* 2.2547	* 2.7742
11	* 1.5455	* 1.3216	* 1.5712	* 1.2541	* 1.5947	* 1.3955	* 1.4416	* .8536
	* 1.7161	* 2.0043	* 1.7070	* 2.1347	* 1.6960	* 1.9217	* 1.8479	* 3.0435
12	* 1.2574	* 1.5733	* 1.3827	* 1.5947	* 1.2220	* 1.4994	* 1.1984	*
	* 2.0945	* 1.6930	* 1.9358	* 1.6960	* 2.2303	* 1.8097	* 2.2286	*
13	* 1.2466	* 1.2852	* 1.5754	* 1.3955	* 1.5005	* 1.1942	* .8868	*
	* 2.0894	* 2.0499	* 1.7010	* 1.9217	* 1.8086	* 2.2565	* 2.9961	*
14	* 1.2316	* 1.4448	* 1.1620	* 1.4416	* 1.1984	* .8868	*	*
	* 2.0955	* 1.8104	* 2.2547	* 1.8479	* 2.2303	* 2.9992	*	*
15	* 1.2402	* 1.0453	* .9286	* .8536	* F-SUB-Q			
	* 2.0641	* 2.4546	* 2.7755	* 3.0435	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 52 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1845 *	* 1.5026 *	* 1.2649 *	* 1.5240 *	* 1.2338 *	* 1.2231 *	* 1.2102 *	* 1.2220 *
	* 2.0071 *	* 1.5870 *	* 1.8610 *	* 1.5523 *	* 1.9014 *	* 1.8970 *	* 1.9053 *	* 1.8762 *
9	* 1.5026 *	* 1.2981 *	* 1.1910 *	* 1.2981 *	* 1.5519 *	* 1.2616 *	* 1.4234 *	* 1.0271 *
	* 1.5870 *	* 1.8257 *	* 1.9715 *	* 1.8188 *	* 1.5306 *	* 1.8609 *	* 1.4386 *	* 2.2343 *
10	* 1.2649 *	* 1.1910 *	* 1.1738 *	* 1.5508 *	* 1.3623 *	* 1.5551 *	* 1.1417 *	* .9114 *
	* 1.8610 *	* 1.9715 *	* 2.0071 *	* 1.5396 *	* 1.7473 *	* 1.5339 *	* 2.0457 *	* 2.5212 *
11	* 1.5240 *	* 1.2981 *	* 1.5497 *	* 1.2306 *	* 1.5744 *	* 1.3730 *	* 1.4223 *	* .8375 *
	* 1.5523 *	* 1.8188 *	* 1.5404 *	* 1.9319 *	* 1.5258 *	* 1.7347 *	* 1.6666 *	* 2.7665 *
12	* 1.2338 *	* 1.5519 *	* 1.3612 *	* 1.5733 *	* 1.2006 *	* 1.4801 *	* 1.1813 *	
	* 1.9014 *	* 1.5309 *	* 1.7494 *	* 1.5258 *	* 1.9974 *	* 1.6226 *	* 2.0113 *	
13	* 1.2231 *	* 1.2627 *	* 1.5551 *	* 1.3730 *	* 1.4812 *	* 1.1760 *	* .8718 *	
	* 1.8970 *	* 1.8597 *	* 1.5347 *	* 1.7357 *	* 1.6226 *	* 2.0297 *	* 2.7094 *	
14	* 1.2102 *	* 1.4244 *	* 1.1417 *	* 1.4223 *	* 1.1802 *	* .8718 *		
	* 1.9053 *	* 1.6381 *	* 2.0457 *	* 1.6666 *	* 2.0127 *	* 2.7120 *		
15	* 1.2220 *	* 1.0271 *	* .9104 *	* .8375 *	F-SUB-Q			
	* 1.8762 *	* 2.2351 *	* 2.5223 *	* 2.7678 *	M-SUB-Q			

AT 75% POWER, 350 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2059 *	* 1.5347 *	* 1.2884 *	* 1.5540 *	* 1.2563 *	* 1.2445 *	* 1.2338 *	* 1.2477 *
	* 1.7658 *	* 1.3961 *	* 1.6444 *	* 1.3696 *	* 1.6624 *	* 1.6839 *	* 1.6919 *	* 1.6660 *
9	* 1.5347 *	* 1.3227 *	* 1.2124 *	* 1.3227 *	* 1.5840 *	* 1.2852 *	* 1.4533 *	* 1.0474 *
	* 1.3961 *	* 1.6107 *	* 1.7428 *	* 1.6065 *	* 1.3492 *	* 1.6460 *	* 1.4507 *	* 1.9833 *
10	* 1.2884 *	* 1.2124 *	* 1.1942 *	* 1.5829 *	* 1.3880 *	* 1.5883 *	* 1.1642 *	* .9296 *
	* 1.6444 *	* 1.7428 *	* 1.7772 *	* 1.3574 *	* 1.5425 *	* 1.3511 *	* 1.8085 *	* 2.2362 *
11	* 1.5540 *	* 1.3227 *	* 1.5819 *	* 1.2531 *	* 1.6076 *	* 1.3998 *	* 1.4512 *	* .8547 *
	* 1.3696 *	* 1.6065 *	* 1.3580 *	* 1.7078 *	* 1.3433 *	* 1.5311 *	* 1.4680 *	* 2.4446 *
12	* 1.2563 *	* 1.5840 *	* 1.3869 *	* 1.6076 *	* 1.2220 *	* 1.5123 *	* 1.2059 *	
	* 1.6824 *	* 1.3495 *	* 1.5442 *	* 1.3438 *	* 1.7572 *	* 1.4262 *	* 1.7718 *	
13	* 1.2445 *	* 1.2883 *	* 1.5883 *	* 1.3998 *	* 1.5123 *	* 1.1995 *	* .8900 *	
	* 1.6839 *	* 1.6450 *	* 1.3511 *	* 1.5311 *	* 1.4255 *	* 1.7867 *	* 2.3908 *	
14	* 1.2338 *	* 1.4544 *	* 1.1642 *	* 1.4512 *	* 1.2059 *	* .8889 *		
	* 1.6919 *	* 1.4507 *	* 1.8085 *	* 1.4680 *	* 1.7718 *	* 2.3928 *		
15	* 1.2477 *	* 1.0474 *	* .9286 *	* .8536 *	F-SUB-Q			
	* 1.6660 *	* 1.9847 *	* 2.2379 *	* 2.4446 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 53 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 KFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.1845	1.5144	1.2681	1.5337	1.2359	1.2242	1.2134	1.2306
	1.6413	1.2914	1.5282	1.2730	1.5703	1.5742	1.5833	1.5582
9	1.5144	1.3013	1.1931	1.3013	1.5637	1.2649	1.4341	1.0314
	1.2914	1.4941	1.6214	1.4962	1.2531	1.5352	1.3518	1.8503
10	1.2681	1.1920	1.1727	1.5615	1.3687	1.5690	1.1449	.9125
	1.5282	1.6214	1.6573	1.2585	1.4309	1.2520	1.6880	2.0983
11	1.5337	1.3013	1.5615	1.2306	1.5872	1.3794	1.4341	.8386
	1.2730	1.4962	1.2591	1.5885	1.2420	1.4189	1.3598	2.2871
12	1.2359	1.5637	1.3666	1.5862	1.2006	1.4919	1.1888	
	1.5703	1.2531	1.4327	1.2425	1.6307	1.3172	1.6414	
13	1.2242	1.2659	1.5679	1.3794	1.4930	1.1792	.8729	
	1.5742	1.5344	1.2523	1.4193	1.3166	1.6570	2.2236	
14	1.2134	1.4341	1.1449	1.4341	1.1877	.8718		
	1.5833	1.3515	1.6880	1.3598	1.6419	2.2253		
15	1.2306	1.0303	.9114	.8386	F-SUB-Q			
	1.5582	1.8589	2.0998	2.2889	M-SUB-Q			

AT 75% POWER, 350 KFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.1867	1.5187	1.2734	1.5401	1.2424	1.2295	1.2177	1.2316
	1.5304	1.2026	1.4235	1.1861	1.4637	1.4704	1.4814	1.4623
9	1.5187	1.3055	1.1984	1.3088	1.5690	1.2702	1.4384	1.0335
	1.2026	1.3912	1.5096	1.3926	1.1679	1.4321	1.2636	1.7414
10	1.2734	1.1984	1.1760	1.5658	1.3762	1.5733	1.1503	.9146
	1.4235	1.5100	1.5456	1.1726	1.3297	1.1665	1.5753	1.9670
11	1.5401	1.3088	1.5658	1.2349	1.5915	1.3848	1.4384	.8397
	1.1861	1.3926	1.1731	1.4794	1.1559	1.3203	1.2672	2.1432
12	1.2424	1.5690	1.3752	1.5915	1.2038	1.4962	1.1931	
	1.4637	1.1683	1.3313	1.1564	1.5176	1.2260	1.5286	
13	1.2295	1.2702	1.5733	1.3848	1.4962	1.1792	.8718	
	1.4704	1.4314	1.1670	1.3209	1.2260	1.5470	2.0813	
14	1.2177	1.4384	1.1503	1.4384	1.1920	.8707		
	1.4814	1.2636	1.5753	1.2672	1.5289	2.0843		
15	1.2316	1.0335	.9136	.8397	F-SUB-Q			
	1.4623	1.7419	1.9684	2.1448	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 54 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 75% POWER, 350 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	C	B	A
8	* 1.1181	* 1.4116	* 1.1974	* 1.4394	* 1.1781	* 1.1567	* 1.1385
	* 1.5513	* 1.2342	* 1.4481	* 1.2122	* 1.4751	* 1.4962	* 1.5164
9	* 1.4116	* 1.2263	* 1.1331	* 1.2413	* 1.4651	* 1.1974	* 1.3345
	* 1.2342	* 1.4154	* 1.5275	* 1.4030	* 1.1936	* 1.4522	* 1.3018
10	* 1.1974	* 1.1331	* 1.1128	* 1.4608	* 1.3023	* 1.4662	* 1.0871
	* 1.4481	* 1.5275	* 1.5618	* 1.1991	* 1.3417	* 1.1946	* 1.5957
11	* 1.4394	* 1.2413	* 1.4608	* 1.1695	* 1.4833	* 1.2991	* 1.3313
	* 1.2122	* 1.4030	* 1.1996	* 1.4920	* 1.1826	* 1.3439	* 1.3085
12	* 1.1781	* 1.4651	* 1.3013	* 1.4823	* 1.1395	* 1.3869	* 1.1074
	* 1.4751	* 1.1939	* 1.3432	* 1.1831	* 1.5312	* 1.2616	* 1.5722
13	* 1.1567	* 1.1984	* 1.4651	* 1.2991	* 1.3869	* 1.0946	* .8075
	* 1.4962	* 1.4514	* 1.1946	* 1.3442	* 1.2616	* 1.5917	* 2.1494
14	* 1.1385	* 1.3345	* 1.0871	* 1.3313	* 1.1074	* .8065	*
	* 1.5164	* 1.3018	* 1.5957	* 1.3085	* 1.5730	* 2.1518	*
15	* 1.1288	* .9607	* .8514	* .7797	* F-SUB-Q		
	* 1.5281	* 1.7954	* 2.0256	* 2.2138	* M-SUB-Q		

AT 75% POWER, 350 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8290	* 1.0196	* .8729	* 1.0399	* .8782	* .8429	* .8172	* .7636
	* 2.0296	* 1.6521	* 1.9285	* 1.6234	* 1.9201	* 1.9960	* 2.0514	* 2.1919
9	* 1.0196	* .8921	* .8311	* .9221	* 1.0710	* .8836	* .9510	* .6747
	* 1.6521	* 1.8861	* 2.0232	* 1.8317	* 1.5793	* 1.9088	* 1.7689	* 2.4825
10	* .8729	* .8311	* .8279	* 1.0678	* .9650	* 1.0699	* .7990	* .5998
	* 1.9285	* 2.0232	* 2.0375	* 1.5859	* 1.7553	* 1.5829	* 2.1061	* 2.7967
11	* 1.0399	* .9221	* 1.0678	* .8750	* 1.0806	* .9436	* .9243	* .5441
	* 1.6234	* 1.8317	* 1.5863	* 1.9343	* 1.5691	* 1.7930	* 1.8266	* 3.0822
12	* .8782	* 1.0710	* .9639	* 1.0796	* .8504	* .9907	* .7765	*
	* 1.9201	* 1.5793	* 1.7569	* 1.5695	* 1.9884	* 1.7091	* 2.1753	*
13	* .8429	* .8836	* 1.0699	* .9436	* .9907	* .7743	* .5623	*
	* 1.9960	* 1.9088	* 1.5833	* 1.7936	* 1.7086	* 2.1810	* 2.9957	*
14	* .8172	* .9510	* .7990	* .9243	* .7765	* .5623	*	*
	* 2.0514	* 1.7689	* 2.1061	* 1.8266	* 2.1753	* 2.9973	*	*
15	* .7636	* .6747	* .5987	* .5441	* F-SUB-Q			
	* 2.1919	* 2.4825	* 2.7967	* 3.0839	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 55 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 RFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.5890	.8172	.7936	.9350	.8086	.7668	.7069	.5923
	* 2.7024	* 2.2961	* 2.5216	* 2.1446	* 2.4791	* 2.6042	* 2.8105	* 3.3508
9	.6172	.7347	.7636	.8332	.9296	.7829	.7925	.5505
	* 2.2961	* 2.5523	* 2.6214	* 2.3998	* 2.1493	* 2.5442	* 2.5089	* 3.5964
10	.7936	.7626	.7422	.9093	.8354	.8707	.6876	.4680
	* 2.5216	* 2.6249	* 2.6852	* 2.1944	* 2.3940	* 2.2787	* 2.8881	* 4.2142
11	.9350	.8332	.9093	.7240	.8097	.7197	.6779	.4038
	* 2.1446	* 2.4012	* 2.1956	* 2.7134	* 2.3017	* 2.5971	* 2.8534	* 4.8464
12	.8086	.9296	.8343	.8097	.5558	.6008	.5344	
	* 2.4791	* 2.1504	* 2.3954	* 2.3030	* 2.7908	* 2.5602	* 3.2899	
13	.7668	.7829	.8707	.7186	.6008	.4509	.3363	
	* 2.6042	* 2.5442	* 2.2800	* 2.5974	* 2.5616	* 3.1520	* 4.7820	
14	.7069	.7936	.6876	.6779	.5334	.3363		
	* 2.8105	* 2.5073	* 2.8860	* 2.8537	* 3.2926	* 4.7828		
15	.5923	.5505	.4680	.4038	F-SUB-Q			
	* 3.3508	* 3.5964	* 4.2142	* 4.8464	M-SUB-Q			

AT 50% POWER, 4 RFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.8107	1.1535	1.1717	1.2981	1.1406	1.1385	1.0839	.9671
	* 2.0275	* 1.7523	* 1.7967	* 1.6285	* 1.8502	* 1.8485	* 1.9344	* 2.1623
9	1.1535	1.0860	1.1010	1.1727	1.2670	1.1235	1.1910	.8622
	* 1.7523	* 1.8354	* 1.9124	* 1.7959	* 1.6655	* 1.8690	* 1.7622	* 2.4276
10	1.1717	1.0999	1.0399	1.2274	1.1749	1.1963	.9885	.7133
	* 1.7967	* 1.9142	* 2.0206	* 1.7157	* 1.7927	* 1.7469	* 2.1159	* 2.9170
11	1.2981	1.1717	1.2263	.9982	1.1310	1.0678	1.0924	.6308
	* 1.6285	* 1.7959	* 1.7172	* 2.0621	* 1.7587	* 1.8425	* 1.8694	* 3.2716
12	1.1406	1.2659	1.1738	1.1299	.7593	.9403	.8482	
	* 1.8502	* 1.6655	* 1.7935	* 1.7602	* 2.0891	* 1.8137	* 2.1893	
13	1.1385	1.1245	1.1967	1.0678	.9403	.6951	.5205	
	* 1.8485	* 1.8673	* 1.7477	* 1.8441	* 1.8138	* 2.2026	* 3.2690	
14	1.0839	1.1910	.9896	1.0913	.8482	.5194		
	* 1.9344	* 1.7614	* 2.1159	* 1.8702	* 2.1905	* 3.2713		
15	.9671	.8622	.7122	.6297	F-SUB-Q			
	* 2.1623	* 2.4261	* 2.9191	* 3.2742	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 56 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9136 *	* 1.3388 *	* 1.3473 *	* 1.4973 *	* 1.2873 *	* 1.3141 *	* 1.2809 *	* 1.1835 *
	* 1.9250 *	* 1.6183 *	* 1.6701 *	* 1.5085 *	* 1.7522 *	* 1.7105 *	* 1.7492 *	* 1.8886 *
9	* 1.3388 *	* 1.2477 *	* 1.2434 *	* 1.3184 *	* 1.4576 *	* 1.3013 *	* 1.4180 *	* 1.0303 *
	* 1.6183 *	* 1.7100 *	* 1.8070 *	* 1.7077 *	* 1.5472 *	* 1.7249 *	* 1.5812 *	* 2.1706 *
10	* 1.3473 *	* 1.2424 *	* 1.1631 *	* 1.4073 *	* 1.3259 *	* 1.3934 *	* 1.1331 *	* .8407 *
	* 1.6701 *	* 1.8078 *	* 1.9322 *	* 1.5998 *	* 1.6985 *	* 1.6029 *	* 1.9760 *	* 2.6470 *
11	* 1.4973 *	* 1.3184 *	* 1.4062 *	* 1.1117 *	* 1.3109 *	* 1.2488 *	* 1.3280 *	* .7529 *
	* 1.5085 *	* 1.7077 *	* 1.6010 *	* 1.9723 *	* 1.6121 *	* 1.6891 *	* 1.6472 *	* 2.9141 *
12	* 1.2873 *	* 1.4576 *	* 1.3248 *	* 1.3098 *	* .8547 *	* 1.1342 *	* 1.0260 *	
	* 1.7522 *	* 1.5478 *	* 1.6989 *	* 1.6127 *	* 1.9661 *	* 1.6201 *	* 1.9439 *	
13	* 1.3141 *	* 1.3023 *	* 1.3923 *	* 1.2488 *	* 1.1342 *	* .8311 *	* .6223 *	
	* 1.7105 *	* 1.7235 *	* 1.6035 *	* 1.6905 *	* 1.6201 *	* 2.0059 *	* 2.9444 *	
14	* 1.2809 *	* 1.4180 *	* 1.1342 *	* 1.3270 *	* 1.0260 *	* .6223 *		
	* 1.7492 *	* 1.5812 *	* 1.9741 *	* 1.6478 *	* 1.9456 *	* 2.9447 *		
15	* 1.1835 *	* 1.0314 *	* .8407 *	* .7518 *	* F-SUB-Q			
	* 1.8886 *	* 2.1694 *	* 2.6487 *	* 2.9162 *	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9768 *	* 1.4469 *	* 1.4437 *	* 1.6183 *	* 1.3762 *	* 1.4180 *	* 1.3977 *	* 1.3109 *
	* 1.9769 *	* 1.6403 *	* 1.7015 *	* 1.5212 *	* 1.7862 *	* 1.7226 *	* 1.7457 *	* 1.8554 *
9	* 1.4469 *	* 1.3366 *	* 1.3205 *	* 1.4073 *	* 1.5754 *	* 1.4052 *	* 1.5551 *	* 1.1310 *
	* 1.6403 *	* 1.7454 *	* 1.8604 *	* 1.7450 *	* 1.5570 *	* 1.7377 *	* 1.5682 *	* 2.1528 *
10	* 1.4437 *	* 1.3205 *	* 1.2316 *	* 1.5165 *	* 1.4223 *	* 1.5219 *	* 1.2252 *	* .9178 *
	* 1.7015 *	* 1.8612 *	* 1.9940 *	* 1.6144 *	* 1.7262 *	* 1.5995 *	* 1.9902 *	* 2.6402 *
11	* 1.6183 *	* 1.4062 *	* 1.5155 *	* 1.1835 *	* 1.4298 *	* 1.3655 *	* 1.4716 *	* .8300 *
	* 1.5212 *	* 1.7457 *	* 1.6157 *	* 2.0206 *	* 1.6106 *	* 1.6958 *	* 1.6256 *	* 2.8873 *
12	* 1.3762 *	* 1.5744 *	* 1.4201 *	* 1.4276 *	* .9232 *	* 1.2606 *	* 1.1385 *	
	* 1.7862 *	* 1.5576 *	* 1.7283 *	* 1.6113 *	* 1.9913 *	* 1.6069 *	* 1.9292 *	
13	* 1.4180 *	* 1.4062 *	* 1.5208 *	* 1.3645 *	* 1.2595 *	* .9200 *	* .6887 *	
	* 1.7226 *	* 1.7363 *	* 1.6007 *	* 1.6965 *	* 1.6069 *	* 2.0104 *	* 2.9394 *	
14	* 1.3977 *	* 1.5551 *	* 1.2263 *	* 1.4716 *	* 1.1385 *	* .6887 *		
	* 1.7457 *	* 1.5676 *	* 1.9883 *	* 1.6262 *	* 1.9301 *	* 2.9415 *		
15	* 1.3109 *	* 1.1320 *	* .9168 *	* .8290 *	* F-SUB-Q			
	* 1.8554 *	* 2.1506 *	* 2.6418 *	* 2.8913 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 57 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9907	* 1.4758	* 1.4619	* 1.6472	* 1.3923	* 1.4416	* 1.4255	* 1.3473
	* 2.1811	* 1.7902	* 1.8923	* 1.6763	* 1.9799	* 1.8914	* 1.9076	* 2.0091
9	* 1.4758	* 1.3537	* 1.3302	* 1.4244	* 1.6097	* 1.4287	* 1.5947	* 1.1567
	* 1.7902	* 1.9165	* 2.0668	* 1.9364	* 1.7088	* 1.9102	* 1.7075	* 2.3454
10	* 1.4619	* 1.3302	* 1.2413	* 1.5508	* 1.4448	* 1.5658	* 1.2477	* .9371
	* 1.8923	* 2.0678	* 2.2281	* 1.7763	* 1.9050	* 1.7469	* 2.1877	* 2.8901
11	* 1.6472	* 1.4234	* 1.5497	* 1.1984	* 1.4748	* 1.4073	* 1.5251	* .8547
	* 1.6763	* 1.9373	* 1.7778	* 2.2120	* 1.7390	* 1.8338	* 1.7393	* 3.1458
12	* 1.3923	* 1.6086	* 1.4426	* 1.4737	* .9532	* 1.3130	* 1.1824	*
	* 1.9799	* 1.7095	* 1.9085	* 1.7397	* 2.1780	* 1.7372	* 2.0854	*
13	* 1.4416	* 1.4298	* 1.5647	* 1.4062	* 1.3120	* .9585	* .7176	*
	* 1.8914	* 1.9085	* 1.7484	* 1.8354	* 1.7372	* 2.1937	* 3.2031	*
14	* 1.4255	* 1.5947	* 1.2488	* 1.5240	* 1.1813	* .7176	*	*
	* 1.9076	* 1.7075	* 2.1866	* 1.7400	* 2.0865	* 3.2031	*	*
15	* 1.3473	* 1.1578	* .9371	* .8536	* F-SUB-Q			
	* 2.0091	* 2.3441	* 2.8921	* 3.1481	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0528	* 1.5637	* 1.5369	* 1.7307	* 1.4598	* 1.5144	* 1.5005	* 1.4234
	* 2.3653	* 1.9154	* 2.0716	* 1.8238	* 2.1569	* 2.0450	* 2.0558	* 2.1493
9	* 1.5637	* 1.4319	* 1.3977	* 1.4962	* 1.7007	* 1.5026	* 1.6836	* 1.2188
	* 1.9154	* 2.0555	* 2.2284	* 2.1113	* 1.8505	* 2.0627	* 1.8362	* 2.5197
10	* 1.5369	* 1.3977	* 1.3013	* 1.6429	* 1.5230	* 1.6654	* 1.3173	* .9885
	* 2.0716	* 2.2292	* 2.4452	* 1.9027	* 2.0434	* 1.8647	* 2.3493	* 3.1105
11	* 1.7307	* 1.4962	* 1.6418	* 1.2670	* 1.5787	* 1.5080	* 1.6365	* .9104
	* 1.8238	* 2.1124	* 1.9044	* 2.3592	* 1.8474	* 1.9411	* 1.8342	* 3.3557
12	* 1.4598	* 1.6997	* 1.5219	* 1.5765	* 1.0314	* 1.4287	* 1.2798	*
	* 2.1569	* 1.8513	* 2.0467	* 1.8490	* 2.3429	* 1.8532	* 2.2123	*
13	* 1.5144	* 1.5037	* 1.6643	* 1.5069	* 1.4276	* 1.0496	* .7808	*
	* 2.0450	* 2.0617	* 1.8656	* 1.9425	* 1.8532	* 2.3605	* 3.4263	*
14	* 1.5005	* 1.6836	* 1.3184	* 1.6354	* 1.2788	* .7808	*	*
	* 2.0558	* 1.8355	* 2.3493	* 1.8350	* 2.2142	* 3.4363	*	*
15	* 1.4234	* 1.2199	* .9875	* .9093	* F-SUB-Q			
	* 2.1493	* 2.5168	* 3.1127	* 3.3583	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 58 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 MFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1470	* 1.6247	* 1.5647	* 1.7586	* 1.4758	* 1.5294	* 1.5176	* 1.4426 *
	* 2.7016	* 2.1750	* 2.3318	* 2.0369	* 2.4136	* 2.2754	* 2.2802	* 2.3713 *
9	* 1.6247	* 1.4812	* 1.4298	* 1.5208	* 1.7382	* 1.5219	* 1.7115	* 1.2316 *
	* 2.1750	* 2.3436	* 2.5365	* 2.3623	* 2.0562	* 2.2923	* 2.0311	* 2.7879 *
10	* 1.5647	* 1.4287	* 1.3216	* 1.6890	* 1.5594	* 1.7179	* 1.3420	* 1.0025 *
	* 2.3318	* 2.5365	* 2.7525	* 2.1384	* 2.2971	* 2.0879	* 2.6241	* 3.4384 *
11	* 1.7586	* 1.5208	* 1.6879	* 1.3120	* 1.6493	* 1.5765	* 1.7007	* .9361 *
	* 2.0369	* 2.3636	* 2.1395	* 2.6738	* 2.0721	* 2.1849	* 2.0573	* 3.7252 *
12	* 1.4758	* 1.7372	* 1.5572	* 1.6472	* 1.1438	* 1.5358	* 1.3495	*
	* 2.4136	* 2.0581	* 2.3008	* 2.0731	* 2.6391	* 2.0731	* 2.4805	*
13	* 1.5294	* 1.5230	* 1.7157	* 1.5754	* 1.5358	* 1.1503	* .8332	*
	* 2.2754	* 2.2911	* 2.0899	* 2.1867	* 2.0731	* 2.6428	* 3.8473	*
14	* 1.5176	* 1.7115	* 1.3420	* 1.6997	* 1.3484	* .8332	*	*
	* 2.2802	* 2.0302	* 2.6209	* 2.0583	* 2.4828	* 3.8473	*	*
15	* 1.4426	* 1.2327	* 1.0014	* .9350	* F-SUB-Q			
	* 2.3713	* 2.7861	* 3.4439	* 3.7284	* M-SUB-Q			

AT 50% POWER, 4 MFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2766	* 1.6761	* 1.5722	* 1.7618	* 1.4705	* 1.5208	* 1.5090	* 1.4384 *
	* 3.1716	* 2.5247	* 2.6595	* 2.3045	* 2.7386	* 2.5773	* 2.5803	* 2.6727 *
9	* 1.6761	* 1.5272	* 1.4469	* 1.5240	* 1.7532	* 1.5165	* 1.7125	* 1.2252 *
	* 2.5247	* 2.7386	* 2.9313	* 2.6776	* 2.3143	* 2.5911	* 2.2850	* 3.1485 *
10	* 1.5722	* 1.4459	* 1.3248	* 1.7157	* 1.5754	* 1.7489	* 1.3645	* 1.0003 *
	* 2.6595	* 2.9352	* 3.1417	* 2.4203	* 2.5865	* 2.3431	* 2.9552	* 3.8648 *
11	* 1.7618	* 1.5230	* 1.7147	* 1.3452	* 1.7125	* 1.6311	* 1.7425	* .9468 *
	* 2.3045	* 2.6793	* 2.4230	* 3.1057	* 2.3962	* 2.5277	* 2.3368	* 4.1778 *
12	* 1.4705	* 1.7511	* 1.5733	* 1.7104	* 1.2841	* 1.6536	* 1.4094	*
	* 2.7386	* 2.3155	* 2.5911	* 2.3976	* 3.0794	* 2.4035	* 2.8768	*
13	* 1.5208	* 1.5176	* 1.7468	* 1.6301	* 1.6536	* 1.2649	* .8814	*
	* 2.5773	* 2.5880	* 2.3444	* 2.5291	* 2.4035	* 3.0714	* 4.4713	*
14	* 1.5090	* 1.7136	* 1.3645	* 1.7414	* 1.4084	* .8814	*	*
	* 2.5803	* 2.2838	* 2.9512	* 2.3393	* 2.8787	* 4.4713	*	*
15	* 1.4384	* 1.2263	* .9992	* .9457	* F-SUB-Q			
	* 2.6727	* 3.1463	* 3.8682	* 4.1818	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 59 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3784	* 1.7414	* 1.6086	* 1.7982	* 1.4951	* 1.5422	* 1.5326	* 1.4630
	* 3.2452	* 2.5865	* 2.8060	* 2.4339	* 2.9057	* 2.7683	* 2.7790	* 2.8979
9	* 1.7414	* 1.6011	* 1.4865	* 1.5572	* 1.7971	* 1.5422	* 1.7468	* 1.2445
	* 2.5865	* 2.8114	* 3.0488	* 2.8428	* 2.4616	* 2.7861	* 2.4630	* 3.4140
10	* 1.6086	* 1.4855	* 1.3537	* 1.7693	* 1.6343	* 1.8057	* 1.4105	* 1.0174
	* 2.6060	* 3.0488	* 3.3352	* 2.5380	* 2.7455	* 2.4870	* 3.1926	* 4.2391
11	* 1.7982	* 1.5562	* 1.7671	* 1.3966	* 1.7950	* 1.7050	* 1.8132	* .9757
	* 2.4339	* 2.8446	* 2.5410	* 3.2044	* 2.4742	* 2.6273	* 2.4742	* 4.6138
12	* 1.4951	* 1.7961	* 1.6311	* 1.7939	* 1.3869	* 1.7704	* 1.4844	*
	* 2.9057	* 2.4644	* 2.7507	* 2.4757	* 3.1903	* 2.4999	* 3.0086	*
13	* 1.5422	* 1.5433	* 1.8046	* 1.7029	* 1.7704	* 1.3645	* .9361	*
	* 2.7683	* 2.7825	* 2.4899	* 2.6289	* 2.4999	* 3.2428	* 4.7714	*
14	* 1.5326	* 1.7468	* 1.4094	* 1.8121	* 1.4833	* .9361	*	*
	* 2.7790	* 2.4630	* 3.1903	* 2.4757	* 3.0107	* 4.7714	*	*
15	* 1.4630	* 1.3456	* .0164	* .9746	* F-SUB-Q			
	* 2.8979	* 3.411	* .2433	* 4.6188	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3548	* 1.7104	* 1.5658	* 1.7532	* 1.4501	* 1.4940	* 1.4865	* 1.4223
	* 3.3532	* 2.6563	* 2.7718	* 2.3791	* 2.8597	* 2.7282	* 2.7299	* 2.8187
9	* 1.7104	* 1.5701	* 1.4480	* 1.5165	* 1.7607	* 1.4973	* 1.7040	* 1.2070
	* 2.6563	* 2.9018	* 3.0596	* 2.7897	* 2.4042	* 2.7316	* 2.3989	* 3.3377
10	* 1.5658	* 1.4480	* 1.3163	* 1.7372	* 1.6065	* 1.7768	* 1.3837	* .9885
	* 2.7718	* 3.0639	* 3.2871	* 2.5174	* 2.7111	* 2.4588	* 3.1303	* 4.1859
11	* 1.7532	* 1.5155	* 1.7350	* 1.3698	* 1.7821	* 1.6804	* 1.7886	* .9543
	* 2.3791	* 2.7897	* 2.5203	* 3.2946	* 2.5247	* 2.6909	* 2.5159	* 4.6089
12	* 1.4501	* 1.7586	* 1.6033	* 1.7811	* 1.3762	* 1.7650	* 1.4694	*
	* 2.8597	* 2.4069	* 2.7162	* 2.5277	* 3.2747	* 2.5515	* 3.0792	*
13	* 1.4940	* 1.4983	* 1.7757	* 1.6793	* 1.7650	* 1.3602	* .9296	*
	* 2.7282	* 2.7299	* 2.4616	* 2.6926	* 2.5515	* 3.3249	* 4.9120	*
14	* 1.4865	* 1.7040	* 1.3827	* 1.7875	* 1.4683	* .9296	*	*
	* 2.7299	* 2.3976	* 3.1281	* 2.5174	* 3.0814	* 4.9120	*	*
15	* 1.4223	* 1.2081	* .9875	* .9543	* F-SUB-Q			
	* 2.8187	* 3.3352	* 4.1899	* 4.6138	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 60 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3623	* 1.7222	* 1.5744	* 1.7650	* 1.4566	* 1.4994	* 1.4940	* 1.4330
	* 3.2921	* 2.5560	* 2.6465	* 2.2659	* 2.7179	* 2.5666	* 2.5575	* 2.6178
9	* 1.7222	* 1.5797	* 1.4555	* 1.5262	* 1.7757	* 1.5058	* 1.7168	* 1.2124
	* 2.5560	* 2.8078	* 2.9233	* 2.6579	* 2.2886	* 2.5712	* 2.2541	* 3.1101
10	* 1.5744	* 1.4544	* 1.3216	* 1.7543	* 1.6258	* 1.7971	* 1.3987	* .9928
	* 2.6465	* 2.9273	* 3.1440	* 2.3976	* 2.5803	* 2.3393	* 2.9573	* 3.9136
11	* 1.7650	* 1.5251	* 1.7522	* 1.3816	* 1.8100	* 1.7040	* 1.8175	* .9650
	* 2.6559	* 2.6595	* 2.4002	* 3.1600	* 2.4367	* 2.5773	* 2.3896	* 4.3542
12	* 1.4566	* 1.7746	* 1.6215	* 1.8089	* 1.3955	* 1.7982	* 1.4951	*
	* 2.7179	* 2.2911	* 2.5850	* 2.4380	* 3.1973	* 2.4743	* 2.9492	*
13	* 1.4994	* 1.5069	* 1.7961	* 1.7029	* 1.7982	* 1.3848	* .9446	*
	* 2.5666	* 2.5696	* 2.3418	* 2.5788	* 2.4742	* 3.2428	* 4.7194	*
14	* 1.4940	* 1.7168	* 1.3987	* 1.8164	* 1.4940	* .9446	*	*
	* 2.5575	* 2.2529	* 2.9552	* 2.3909	* 2.9512	* 4.7194	*	*
15	* 1.4330	* 1.2134	* .9917	* .9639	* F-SUB-Q			
	* 2.6178	* 3.1079	* 3.9207	* 4.3585	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3205	* 1.6772	* 1.5294	* 1.7200	* 1.4137	* 1.4555	* 1.4523	* 1.3955
	* 3.0968	* 2.3989	* 2.4518	* 2.0929	* 2.5203	* 2.3844	* 2.3739	* 2.4271
9	* 1.6772	* 1.5337	* 1.4116	* 1.4844	* 1.7339	* 1.4641	* 1.6740	* 1.1781
	* 2.3989	* 2.6401	* 2.7077	* 2.4602	* 2.1123	* 2.3857	* 2.0849	* 2.8902
10	* 1.5294	* 1.4116	* 1.2820	* 1.7136	* 1.5862	* 1.7575	* 1.3645	* .9650
	* 2.4518	* 2.7111	* 2.9155	* 2.2172	* 2.3844	* 2.1608	* 2.7438	* 3.6407
11	* 1.7200	* 1.4833	* 1.7115	* 1.3441	* 1.7725	* 1.6643	* 1.7800	* .9403
	* 2.0929	* 2.4616	* 2.2195	* 2.9735	* 2.2766	* 2.4149	* 2.2059	* 4.0339
12	* 1.4137	* 1.7329	* 1.5829	* 1.7714	* 1.3623	* 1.7629	* 1.4630	*
	* 2.5203	* 2.1144	* 2.3883	* 2.2778	* 2.9920	* 2.3045	* 2.7595	*
13	* 1.4555	* 1.4651	* 1.7564	* 1.6633	* 1.7629	* 1.3537	* .9221	*
	* 2.3844	* 2.3831	* 2.1630	* 2.4163	* 2.3045	* 3.0254	* 4.4208	*
14	* 1.4523	* 1.6750	* 1.3634	* 1.7789	* 1.4619	* .9221	*	*
	* 2.3739	* 2.0849	* 2.7403	* 2.2070	* 2.7612	* 4.4208	*	*
15	* 1.3955	* 1.1792	* .9639	* .9393	* F-SUB-Q			
	* 2.4271	* 2.8883	* 3.6468	* 4.0376	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report Appendix A

Page 61 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.2424	1.5883	1.4426	1.6301	1.3334	1.3720	1.3687	1.3195
	2.9253	2.2647	2.3418	1.9965	2.4176	2.2959	2.2850	2.3330
9	1.5883	1.4459	1.3302	1.4019	1.6451	1.3816	1.5851	1.1106
	2.2647	2.5028	2.5896	2.3507	2.0113	2.2923	1.9965	2.7879
10	1.4426	1.3302	1.2081	1.6258	1.5026	1.6697	1.2884	.9082
	2.3418	2.5927	2.7897	2.1072	2.2742	2.0523	2.6321	3.5109
11	1.6301	1.4009	1.6236	1.2691	1.6836	1.5754	1.6890	.8868
	1.9965	2.3520	2.1103	2.8187	2.1479	2.2850	2.0919	3.8613
12	1.3334	1.6440	1.4994	1.5825	1.2873	1.6740	1.3848	
	2.4176	2.0132	2.2790	2.1490	2.8353	2.1804	2.6162	
13	1.3720	1.3827	1.6675	1.5744	1.6750	1.2809	.8707	
	2.2959	2.2911	2.0542	2.2874	2.1793	2.8787	4.2226	
14	1.3687	1.5851	1.2884	1.6879	1.3848	.8707		
	2.2850	1.9965	2.6289	2.0940	2.6178	4.2267		
15	1.3195	1.1117	.9071	.8857	F-SUB-Q			
	2.3330	2.7861	3.5137	3.8648	M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.7038	1.5422	1.4019	1.5851	1.2948	1.3291	1.3270	1.2798
	2.6876	2.0650	2.1815	1.8658	2.2659	2.1662	2.1576	2.2048
9	1.5422	1.4019	1.2906	1.3634	1.6011	1.3398	1.5390	1.0753
	2.0650	2.2898	2.4149	2.1947	1.8763	2.1576	1.8779	2.6369
10	1.4019	1.2906	1.1717	1.5819	1.4630	1.6247	1.2509	.8793
	2.1815	2.4149	2.6052	1.9577	2.1175	1.9077	2.4714	3.3148
11	1.5851	1.3623	1.5808	1.2316	1.6386	1.5326	1.6440	.8589
	1.8658	2.1958	1.9604	2.5742	1.9621	2.0859	1.9272	3.6103
12	1.2948	1.6001	1.4598	1.6376	1.2488	1.6290	1.3473	
	2.2659	1.8779	2.1216	1.9648	2.6114	2.0011	2.3949	
13	1.3291	1.3420	1.6226	1.5315	1.6290	1.2424	.8439	
	2.1662	2.1554	1.9102	2.0879	2.0011	2.6595	3.9031	
14	1.3270	1.5401	1.2509	1.6429	1.3462	.8439		
	2.1576	1.8771	2.4686	1.9281	2.3962	3.9031		
15	1.2798	1.0764	.8782	.8579	F-SUB-Q			
	2.2048	2.6353	3.3198	3.6133	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 62 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1031 *	* 1.4223 *	* 1.2906 *	* 1.4641 *	* 1.1920 *	* 1.2167 *	* 1.2134 *	* 1.1695 *
	* 2.6385 *	* 2.0340 *	* 2.1630 *	* 1.8546 *	* 2.2671 *	* 2.1892 *	* 2.1859 *	* 2.2378 *
9	* 1.4223 *	* 1.2884 *	* 1.1877 *	* 1.2574 *	* 1.4791 *	* 1.2284 *	* 1.4126 *	* .9810 *
	* 2.0340 *	* 2.2576 *	* 2.3923 *	* 2.1804 *	* 1.8602 *	* 2.1749 *	* 1.8894 *	* 2.6809 *
10	* 1.2906 *	* 1.1867 *	* 1.0774 *	* 1.4630 *	* 1.3484 *	* 1.4983 *	* 1.1460 *	* .8022 *
	* 2.1630 *	* 2.3936 *	* 2.5865 *	* 1.9255 *	* 2.0980 *	* 1.8820 *	* 2.4799 *	* 3.3558 *
11	* 1.4641 *	* 1.2563 *	* 1.4608 *	* 1.1331 *	* 1.5101 *	* 1.4084 *	* 1.5080 *	* .7829 *
	* 1.8546 *	* 2.1815 *	* 1.9281 *	* 2.5365 *	* 1.9281 *	* 2.0650 *	* 1.8968 *	* 3.6133 *
12	* 1.1920 *	* 1.4780 *	* 1.3452 *	* 1.5090 *	* 1.1438 *	* 1.4962 *	* 1.2338 *	
	* 2.2671 *	* 1.8618 *	* 2.1021 *	* 1.9298 *	* 2.5575 *	* 1.9568 *	* 2.3674 *	
13	* 1.2167 *	* 1.2295 *	* 1.4973 *	* 1.4073 *	* 1.4973 *	* 1.1353 *	* .7690 *	
	* 2.1892 *	* 2.1727 *	* 1.8936 *	* 2.0660 *	* 1.9568 *	* 2.5989 *	* 3.8510 *	
14	* 1.2134 *	* 1.4126 *	* 1.1460 *	* 1.5080 *	* 1.2327 *	* .7690 *		
	* 2.1859 *	* 1.8886 *	* 2.4799 *	* 1.8977 *	* 2.3700 *	* 3.8510 *		
15	* 1.1695 *	* .9821 *	* .8011 *	* .7829 *	* F-SUB-Q			
	* 2.2378 *	* 2.6793 *	* 3.3611 *	* 3.6194 *	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0282 *	* 1.3227 *	* 1.2038 *	* 1.3666 *	* 1.1160 *	* 1.1235 *	* 1.1138 *	* 1.0635 *
	* 2.5927 *	* 1.9892 *	* 2.1469 *	* 1.8522 *	* 2.2623 *	* 2.2275 *	* 2.2367 *	* 2.3155 *
9	* 1.3227 *	* 1.2006 *	* 1.1085 *	* 1.1813 *	* 1.3805 *	* 1.1374 *	* 1.2981 *	* .8964 *
	* 1.9892 *	* 2.2093 *	* 2.3558 *	* 2.1586 *	* 1.8499 *	* 2.2048 *	* 1.9247 *	* 2.7595 *
10	* 1.2038 *	* 1.1085 *	* 1.0100 *	* 1.3687 *	* 1.2616 *	* 1.3934 *	* 1.0581 *	* .7358 *
	* 2.1469 *	* 2.3571 *	* 2.5575 *	* 1.8960 *	* 2.0719 *	* 1.8658 *	* 2.4728 *	* 3.4330 *
11	* 1.3666 *	* 1.1802 *	* 1.3666 *	* 1.0624 *	* 1.4009 *	* 1.3066 *	* 1.3827 *	* .7144 *
	* 1.8522 *	* 2.1597 *	* 1.8985 *	* 2.4672 *	* 1.8853 *	* 2.0264 *	* 1.8985 *	* 3.6653 *
12	* 1.1160 *	* 1.3794 *	* 1.2595 *	* 1.3998 *	* 1.0614 *	* 1.3773 *	* 1.1320 *	
	* 2.2623 *	* 1.8515 *	* 2.0759 *	* 1.8878 *	* 2.5425 *	* 1.9595 *	* 2.3648 *	
13	* 1.1235 *	* 1.1374 *	* 1.3912 *	* 1.3055 *	* 1.3773 *	* 1.0432 *	* .7036 *	
	* 2.2275 *	* 2.2025 *	* 1.8674 *	* 2.0273 *	* 1.9595 *	* 2.6257 *	* 3.8960 *	
14	* 1.1138 *	* 1.2981 *	* 1.0581 *	* 1.3816 *	* 1.1310 *	* .7036 *		
	* 2.2367 *	* 1.9247 *	* 2.4728 *	* 1.8993 *	* 2.3674 *	* 3.8995 *		
15	* 1.0635 *	* .8975 *	* .7347 *	* .7133 *	* F-SUB-Q			
	* 2.3155 *	* 2.7577 *	* 3.4357 *	* 3.6715 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 63 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.9007	1.1363	1.0335	1.1888	.9810	.9585	.9307	.8589
	2.7648	2.1815	2.3661	2.0216	2.4518	2.5014	2.5635	2.7438
9	1.1363	1.0346	.9553	1.0399	1.1974	.9875	1.0817	.7422
	2.1815	2.4069	2.5819	2.3255	2.0188	2.4422	2.2014	3.1926
10	1.0335	.9543	.8911	1.1920	1.1042	1.1995	.9029	.6148
	2.3661	2.5819	2.7403	2.0494	2.2252	2.0397	2.7351	3.9136
11	1.1888	1.0399	1.1899	.9457	1.2102	1.1171	1.1299	.5837
	2.0216	2.3267	2.0513	2.6114	2.0455	2.2286	2.1892	4.2350
12	.9810	1.1963	1.1021	1.2081	.9211	1.1492	.9328	
	2.4518	2.0207	2.2286	2.0484	2.7265	2.1837	2.6876	
13	.9585	.9875	1.1984	1.1160	1.1492	.8793	.5848	
	2.5014	2.4422	2.0417	2.2297	2.1837	2.8863	4.3629	
14	.9307	1.0817	.9029	1.1299	.9328	.5848		
	2.5635	2.2014	2.7351	2.1903	2.6893	4.3673		
15	.8589	.7422	.6137	.5837	F-SUB-Q			
	2.7438	3.1903	3.9207	4.2391	M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.5933	.7497	.6447	.7786	.6447	.5976	.5612	.4852
	4.0414	3.1762	3.6653	2.9817	3.6103	3.8960	4.1222	4.7142
9	.7497	.6522	.6019	.6833	.8022	.6372	.6587	.4402
	3.1762	3.6684	3.9421	3.4248	2.9037	3.6632	3.4995	5.2260
10	.6447	.6019	.5901	.7958	.7165	.7947	.5666	.3727
	3.6653	3.9457	3.9967	2.9392	3.2871	2.9694	4.1698	6.2517
11	.7786	.6833	.7958	.6351	.8075	.6972	.6501	.3416
	2.9817	3.4275	2.9432	3.7380	2.9472	3.4357	3.6591	6.9429
12	.6447	.8011	.7154	.8065	.6062	.7111	.5462	
	3.6103	2.9057	3.2921	2.9492	3.9565	3.3900	4.4253	
13	.5976	.6372	.7936	.6972	.7111	.5398	.3524	
	3.8960	3.6622	2.9715	3.4384	3.3900	4.5035	6.9541	
14	.5612	.6587	.5666	.6501	.5451	.3524		
	4.1222	3.4995	4.1698	3.6622	4.4253	6.9541		
15	.4852	.4402	.3727	.3416	F-SUB-Q			
	4.7142	5.2260	6.2517	6.9429	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 64 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .6287 *	* .8814 *	* .8536 *	* 1.0292 *	* .8921 *	* .8311 *	* .6908 *	* .5869 *
	* 2.6064 *	* 2.2303 *	* 2.3807 *	* 1.9946 *	* 2.3050 *	* 2.4166 *	* 2.6015 *	* 3.0382 *
9	* .8814 *	* .7618 *	* .8086 *	* .9125 *	* 1.0324 *	* .8686 *	* .8525 *	* .5676 *
	* 2.2303 *	* 2.4955 *	* 2.4571 *	* 2.2239 *	* 1.9807 *	* 2.3441 *	* 2.3043 *	* 3.3107 *
10	* .8536 *	* .8086 *	* .7315 *	* .9960 *	* .9221 *	* .9821 *	* .7540 *	* .5205 *
	* 2.3807 *	* 2.4602 *	* 2.4773 *	* 2.0163 *	* 2.2114 *	* 2.0820 *	* 2.6745 *	* 3.8179 *
11	* 1.0292 *	* .9114 *	* .9960 *	* .7893 *	* .9200 *	* .8204 *	* .7797 *	* .4627 *
	* 1.9946 *	* 2.2250 *	* 2.0173 *	* 2.5044 *	* 2.1674 *	* 2.4648 *	* 2.5622 *	* 4.3733 *
12	* .8921 *	* 1.0314 *	* .9211 *	* .9189 *	* .6287 *	* .6994 *	* .6137 *	
	* 2.3050 *	* 1.9816 *	* 2.2128 *	* 2.1686 *	* 2.5999 *	* 2.3998 *	* 3.1071 *	
13	* .8311 *	* .8686 *	* .9810 *	* .8193 *	* .6983 *	* .5291 *	* .3973 *	
	* 2.4166 *	* 2.3441 *	* 2.0822 *	* 2.4648 *	* 2.3998 *	* 2.9743 *	* 4.4514 *	
14	* .6908 *	* .8525 *	* .7540 *	* .7797 *	* .6137 *	* .3963 *		
	* 2.6015 *	* 2.3030 *	* 2.6745 *	* 2.5622 *	* 3.1096 *	* 4.4564 *		
15	* .5869 *	* .5666 *	* .5205 *	* .4627 *	* F-SUB-Q			
	* 3.0382 *	* 3.3107 *	* 3.8179 *	* 4.3775 *	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8472 *	* 1.2306 *	* 1.2316 *	* 1.4191 *	* 1.2359 *	* 1.2124 *	* 1.1128 *	* 1.0100 *
	* 2.0063 *	* 1.7266 *	* 1.7534 *	* 1.5334 *	* 1.7612 *	* 1.7757 *	* 1.8642 *	* 2.0407 *
9	* 1.2306 *	* 1.1310 *	* 1.1524 *	* 1.2702 *	* 1.3977 *	* 1.2156 *	* 1.2734 *	* .8900 *
	* 1.7266 *	* 1.8395 *	* 1.8489 *	* 1.7016 *	* 1.5510 *	* 1.7781 *	* 1.6672 *	* 2.3330 *
10	* 1.2316 *	* 1.1524 *	* 1.0681 *	* 1.3537 *	* 1.2831 *	* 1.3409 *	* 1.0614 *	* .7775 *
	* 1.7534 *	* 1.8507 *	* 1.9176 *	* 1.5894 *	* 1.6852 *	* 1.6128 *	* 2.0238 *	* 2.7359 *
11	* 1.4191 *	* 1.2691 *	* 1.3527 *	* 1.0924 *	* 1.2756 *	* 1.1824 *	* 1.2038 *	* .6951 *
	* 1.5334 *	* 1.7017 *	* 1.5900 *	* 1.9489 *	* 1.6690 *	* 1.7932 *	* 1.7424 *	* 3.0607 *
12	* 1.2359 *	* 1.3977 *	* 1.2820 *	* 1.2745 *	* .8418 *	* 1.0528 *	* .9286 *	
	* 1.7612 *	* 1.5516 *	* 1.6866 *	* 1.6704 *	* 1.9986 *	* 1.7522 *	* 2.1577 *	
13	* 1.2124 *	* 1.2167 *	* 1.3409 *	* 1.1813 *	* 1.0528 *	* .7797 *	* .5901 *	
	* 1.7757 *	* 1.7781 *	* 1.6134 *	* 1.7940 *	* 1.7522 *	* 2.1572 *	* 3.1406 *	
14	* 1.1128 *	* 1.2745 *	* 1.0624 *	* 1.2027 *	* .9275 *	* .5901 *		
	* 1.8642 *	* 1.6665 *	* 2.0228 *	* 1.7431 *	* 2.1600 *	* 3.1430 *		
15	* 1.0100 *	* .8911 *	* .7775 *	* .6951 *	* F-SUB-Q			
	* 2.0407 *	* 2.3328 *	* 2.7361 *	* 3.0631 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 65 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9361	* 1.4062	* 1.3912	* 1.6161	* 1.3730	* 1.3762	* 1.3238	* 1.2402
	* 1.9320	* 1.6148	* 1.6704	* 1.4443	* 1.7007	* 1.6861	* 1.7394	* 1.8447
9	* 1.4062	* 1.2788	* 1.2959	* 1.4126	* 1.5926	* 1.3623	* 1.4983	* 1.0624
	* 1.6148	* 1.7413	* 1.7881	* 1.6460	* 1.4598	* 1.6982	* 1.5403	* 2.1594
10	* 1.3912	* 1.2948	* 1.2359	* 1.5444	* 1.4298	* 1.5337	* 1.1910	* .8975
	* 1.6704	* 1.7898	* 1.8694	* 1.5009	* 1.6227	* 1.5059	* 1.9427	* 2.5576
11	* 1.6161	* 1.4126	* 1.5433	* 1.2145	* 1.4544	* 1.3430	* 1.4073	* .8000
	* 1.4443	* 1.6465	* 1.5015	* 1.9011	* 1.5568	* 1.6735	* 1.5734	* 2.7911
12	* 1.3730	* 1.5926	* 1.4276	* 1.4533	* .9264	* 1.2231	* 1.0742	*
	* 1.7007	* 1.4604	* 1.6246	* 1.5580	* 1.9195	* 1.6056	* 1.9703	*
13	* 1.3762	* 1.3634	* 1.5326	* 1.3420	* 1.2220	* .8943	* .6779	*
	* 1.6861	* 1.5969	* 1.5064	* 1.6742	* 1.6056	* 2.0087	* 2.9053	*
14	* 1.3238	* 1.4994	* 1.1920	* 1.4062	* 1.0731	* .6769	*	*
	* 1.7394	* 1.5397	* 1.9416	* 1.5740	* 1.9712	* 2.9073	*	*
15	* 1.2402	* 1.0624	* .8975	* .7990	* F-SUB-Q			
	* 1.8447	* 2.1594	* 2.5592	* 2.7930	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9746	* 1.4844	* 1.4544	* 1.7072	* 1.4341	* 1.4459	* 1.4094	* 1.3409
	* 2.0083	* 1.6548	* 1.7373	* 1.4807	* 1.7617	* 1.7447	* 1.7847	* 1.8674
9	* 1.4844	* 1.3366	* 1.3462	* 1.4748	* 1.6868	* 1.4351	* 1.6011	* 1.1374
	* 1.6548	* 1.8011	* 1.8774	* 1.7092	* 1.4878	* 1.7541	* 1.5686	* 2.2054
10	* 1.4544	* 1.3452	* 1.2863	* 1.6343	* 1.4983	* 1.6290	* 1.2488	* .9521
	* 1.7373	* 1.8793	* 1.9612	* 1.5334	* 1.6723	* 1.5244	* 2.0004	* 2.6172
11	* 1.7072	* 1.4737	* 1.6333	* 1.2659	* 1.5412	* 1.4180	* 1.4983	* .8461
	* 1.4807	* 1.7095	* 1.5342	* 1.9734	* 1.5834	* 1.6966	* 1.5813	* 2.8208
12	* 1.4341	* 1.6858	* 1.4962	* 1.5401	* .9660	* 1.3023	* 1.1395	*
	* 1.7617	* 1.4884	* 1.6743	* 1.5846	* 1.9857	* 1.6280	* 1.9912	*
13	* 1.4459	* 1.4362	* 1.6290	* 1.4169	* 1.3023	* .9468	* .7176	*
	* 1.7447	* 1.7533	* 1.5255	* 1.6980	* 1.6280	* 2.0532	* 2.9680	*
14	* 1.4094	* 1.6011	* 1.2499	* 1.4973	* 1.1385	* .7165	*	*
	* 1.7847	* 1.5680	* 2.0001	* 1.5819	* 1.9921	* 2.9681	*	*
15	* 1.3409	* 1.1374	* .9510	* .8450	* F-SUB-Q			
	* 1.8674	* 2.2052	* 2.6194	* 2.8227	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 66 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 KFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

6	* .9575	* 1.4651	* 1.4298	* 1.6900	* 1.4116	* 1.4255	* 1.3966	* 1.3388 *
	* 2.2307	* 1.8202	* 1.9309	* 1.6173	* 1.9328	* 1.9204	* 1.9643	* 2.0419 *

9	* 1.4651	* 1.3109	* 1.3184	* 1.4501	* 1.6740	* 1.4169	* 1.5926	* 1.1299 *
	* 1.8202	* 1.9920	* 2.0965	* 1.8784	* 1.6131	* 1.9172	* 1.7181	* 2.4240 *

10	* 1.4298	* 1.3173	* 1.2616	* 1.6204	* 1.4780	* 1.6204	* 1.2327	* .9425 *
	* 1.9209	* 2.0986	* 2.1867	* 1.6678	* 1.8200	* 1.6400	* 2.1753	* 2.8610 *

11	* 1.6900	* 1.4501	* 1.6194	* 1.2434	* 1.5315	* 1.4041	* 1.4887	* .8365 *
	* 1.6173	* 1.8792	* 1.6691	* 2.1771	* 1.7256	* 1.8545	* 1.7319	* 3.0861 *

12	* 1.4116	* 1.6729	* 1.4769	* 1.5294	* .9521	* 1.2948	* 1.1288	*
	* 1.9328	* 1.6142	* 1.8222	* 1.7271	* 2.1984	* 1.7853	* 2.2003	*

13	* 1.4255	* 1.4180	* 1.6194	* 1.4030	* 1.2948	* .9371	* .7101	*
	* 1.9204	* 1.9172	* 1.6412	* 1.8553	* 1.7853	* 2.2706	* 3.2785	*

14	* 1.3966	* 1.5926	* 1.2338	* 1.4876	* 1.1278	* .7101	*	
	* 1.9643	* 1.7181	* 2.1764	* 1.7326	* 2.2014	* 3.2793	*	

15	* 1.3388	* 1.1299	* .9414	* .8354	* F-SUB-Q			
	* 2.0419	* 2.4231	* 2.8629	* 3.0883	* M-SUB-Q			

AT 50% POWER, 10 KFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9660	* 1.4887	* 1.4501	* 1.7232	* 1.4341	* 1.4480	* 1.4244	* 1.3709 *
	* 2.4459	* 1.9715	* 2.0737	* 1.7382	* 2.0846	* 2.0539	* 2.0840	* 2.1575 *
9	* 1.4887	* 1.3280	* 1.3355	* 1.4737	* 1.7093	* 1.4426	* 1.6279	* 1.1535 *
	* 1.9715	* 2.1659	* 2.2527	* 2.0250	* 1.7343	* 2.0531	* 1.8148	* 2.5675 *
10	* 1.4501	* 1.3334	* 1.2777	* 1.6536	* 1.5058	* 1.6568	* 1.2541	* .9607 *
	* 2.0737	* 2.2551	* 2.3444	* 1.7934	* 1.9644	* 1.7694	* 2.3380	* 3.0420 *
11	* 1.7232	* 1.4737	* 1.6526	* 1.2616	* 1.5658	* 1.4330	* 1.5219	* .8536 *
	* 1.7382	* 2.0250	* 1.7947	* 2.3536	* 1.8578	* 2.0087	* 1.8641	* 3.3271 *
12	* 1.4341	* 1.7082	* 1.5048	* 1.5637	* .9660	* 1.3248	* 1.1545	*
	* 2.0846	* 1.7356	* 1.9679	* 1.8594	* 2.4041	* 1.9341	* 2.3999	*
13	* 1.4480	* 1.4437	* 1.6558	* 1.4330	* 1.3248	* .9575	* .7261	*
	* 2.0539	* 2.0519	* 1.7709	* 2.0106	* 1.9341	* 2.4794	* 3.5658	*
14	* 1.4244	* 1.6279	* 1.2552	* 1.5219	* 1.1535	* .7251	*	
	* 2.0840	* 1.8141	* 2.3393	* 1.8649	* 2.4012	* 3.5666	*	
15	* 1.3709	* 1.1535	* .9607	* .8525	* F-SUB-Q			
	* 2.1575	* 2.5672	* 3.0442	* 3.3297	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 67 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9478	* 1.4683	* 1.4266	* 1.7018	* 1.4105	* 1.4234	* 1.4030	* 1.3559 *
	* 2.7988	* 2.2446	* 2.3817	* 1.9848	* 2.3893	* 2.3407	* 2.3560	* 2.4181 *
9	* 1.4683	* 1.3045	* 1.3120	* 1.4512	* 1.6911	* 1.4201	* 1.6086	* 1.1374 *
	* 2.2446	* 2.4763	* 2.5878	* 2.3214	* 1.9720	* 2.3347	* 2.0525	* 2.8908 *
10	* 1.4266	* 1.3098	* 1.2563	* 1.6365	* 1.4865	* 1.6418	* 1.2359	* .9468 *
	* 2.3817	* 2.5906	* 2.6940	* 2.0465	* 2.2343	* 1.9993	* 2.6579	* 3.4521 *
11	* 1.7018	* 1.4512	* 1.6354	* 1.2413	* 1.5519	* 1.4180	* 1.5090	* .8418 *
	* 1.9848	* 2.3226	* 2.0484	* 2.6859	* 2.1035	* 2.2778	* 2.1062	* 3.7542 *
12	* 1.4105	* 1.6900	* 1.4855	* 1.5497	* .9521	* 1.3152	* 1.1438	*
	* 2.3893	* 1.9738	* 2.2378	* 2.1055	* 2.7312	* 2.1811	* 2.7130	*
13	* 1.4234	* 1.4212	* 1.6408	* 1.4169	* 1.3152	* .9489	* .7197	*
	* 2.3407	* 2.3334	* 2.0011	* 2.2790	* 2.1811	* 2.7971	* 4.0243	*
14	* 1.4030	* 1.6086	* 1.2370	* 1.5080	* 1.1428	* .7186	*	*
	* 2.3560	* 2.0525	* 2.6579	* 2.1072	* 2.7134	* 4.0243	*	*
15	* 1.3559	* 1.1374	* .9468	* .8418	* F-SUB-Q			
	* 2.4181	* 2.8904	* 3.4549	* 3.7575	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9296	* 1.4437	* 1.3966	* 1.6697	* 1.3784	* 1.3891	* 1.3709	* 1.3280 *
	* 3.2796	* 2.6193	* 2.7648	* 2.2874	* 2.7595	* 2.6993	* 2.7145	* 2.7754 *
9	* 1.4437	* 1.2777	* 1.2831	* 1.4212	* 1.6633	* 1.3880	* 1.5776	* 1.1117 *
	* 2.6193	* 2.8999	* 3.0065	* 2.6809	* 2.2706	* 2.6859	* 2.3533	* 3.3249 *
10	* 1.3966	* 1.2809	* 1.2284	* 1.6119	* 1.4598	* 1.6183	* 1.2102	* .9264 *
	* 2.7648	* 3.0107	* 3.1258	* 2.3584	* 2.5834	* 2.3118	* 3.0553	* 3.9493 *
11	* 1.6697	* 1.4212	* 1.6097	* 1.2167	* 1.5326	* 1.3977	* 1.4898	* .8268 *
	* 2.2874	* 2.6809	* 2.3597	* 3.1394	* 2.4479	* 2.6628	* 2.4518	* 4.3629 *
12	* 1.3784	* 1.6622	* 1.4576	* 1.5305	* .9382	* 1.3055	* 1.1320	*
	* 2.7595	* 2.2718	* 2.5880	* 2.4499	* 3.1958	* 2.5353	* 3.1576	*
13	* 1.3891	* 1.3891	* 1.6172	* 1.3966	* 1.3045	* .9414	* .7133	*
	* 2.6993	* 2.6843	* 2.3143	* 2.6644	* 2.5342	* 3.2579	* 4.6870	*
14	* 1.3709	* 1.5787	* 1.2113	* 1.4887	* 1.1310	* .7122	*	*
	* 2.7145	* 2.3520	* 3.0574	* 2.4532	* 3.1599	* 4.6870	*	*
15	* 1.3280	* 1.1117	* .9253	* .8268	* F-SUB-Q			
	* 2.7754	* 3.3224	* 3.9529	* 4.3673	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 68 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9543	* 1.4758	* 1.4126	* 1.6890	* 1.3880	* 1.3966	* 1.3784	* 1.3398
	* 3.4033	* 2.7111	* 3.0531	* 2.5605	* 3.0968	* 3.0553	* 3.0704	* 3.1258
9	* 1.4758	* 1.3023	* 1.2970	* 1.4373	* 1.6879	* 1.3987	* 1.5936	* 1.1192
	* 2.7111	* 3.0065	* 3.2921	* 3.0128	* 2.5696	* 3.0467	* 2.6677	* 3.7575
10	* 1.4126	* 1.2948	* 1.2434	* 1.6408	* 1.4812	* 1.6493	* 1.2231	* .9339
	* 3.0531	* 3.2921	* 3.4604	* 2.6020	* 2.8902	* 2.5911	* 3.4854	* 4.4989
11	* 1.6890	* 1.4362	* 1.6397	* 1.2359	* 1.5722	* 1.4319	* 1.5251	* .8418
	* 2.5605	* 3.0149	* 2.6052	* 3.2921	* 2.5696	* 2.8261	* 2.7455	* 5.0143
12	* 1.3880	* 1.6868	* 1.4801	* 1.5712	* .9671	* 1.3559	* 1.1685	*
	* 3.0968	* 2.5712	* 2.8941	* 2.5712	* 3.3847	* 2.7027	* 3.3741	*
13	* 1.3966	* 1.3998	* 1.6483	* 1.4309	* 1.3548	* .9853	* .7411	*
	* 3.0553	* 3.0445	* 2.5927	* 2.8261	* 2.7027	* 3.5109	* 5.0671	*
14	* 1.3784	* 1.5947	* 1.2242	* 1.5240	* 1.1674	* .7411	*	*
	* 3.0704	* 2.6677	* 3.4854	* 2.7455	* 3.3741	* 5.0671	*	*
15	* 1.3398	* 1.1192	* .9328	* .8407	* F-SUB-Q			
	* 3.1258	* 3.7542	* 4.5035	* 5.0202	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0153	* 1.4865	* 1.3923	* 1.6579	* 1.3559	* 1.3602	* 1.3430	* 1.3077
	* 3.5338	* 2.8005	* 3.0254	* 2.5086	* 3.0445	* 3.0044	* 3.0275	* 3.0968
9	* 1.4865	* 1.3066	* 1.2756	* 1.4116	* 1.6654	* 1.3698	* 1.5615	* 1.0903
	* 2.8005	* 3.1191	* 3.2971	* 2.9593	* 2.5174	* 3.0003	* 2.6289	* 3.7220
10	* 1.3923	* 1.2734	* 1.2242	* 1.6301	* 1.4630	* 1.6408	* 1.1995	* .9125
	* 3.0254	* 3.3021	* 3.4549	* 2.6130	* 2.8806	* 2.5942	* 3.4604	* 4.4942
11	* 1.6579	* 1.4105	* 1.6279	* 1.2359	* 1.5883	* 1.4426	* 1.5251	* .8322
	* 2.5086	* 2.9613	* 2.6162	* 3.4113	* 2.6465	* 2.9174	* 2.8261	* 5.0850
12	* 1.3559	* 1.6643	* 1.4608	* 1.5842	* 1.0335	* 1.4073	* 1.1877	*
	* 3.0445	* 2.5203	* 2.8844	* 2.6498	* 3.5023	* 2.7843	* 3.4798	*
13	* 1.3602	* 1.3709	* 1.6386	* 1.4416	* 1.4062	* 1.0421	* .7626	*
	* 3.0044	* 2.9982	* 2.5974	* 2.9194	* 2.7843	* 3.6254	* 5.2450	*
14	* 1.3430	* 1.5615	* 1.2006	* 1.5251	* 1.1867	* .7626	*	*
	* 3.0275	* 2.6289	* 3.4576	* 2.8261	* 3.4826	* 5.2450	*	*
15	* 1.3077	* 1.0903	* .9114	* .8311	* F-SUB-Q			
	* 3.0968	* 3.7220	* 4.4989	* 5.0909	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 69 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 RFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1899	* 1.5744	* 1.4351	* 1.7007	* 1.3848	* 1.3848	* 1.3677	* 1.3345
	* 3.4411	* 2.6859	* 2.8653	* 2.3687	* 2.8825	* 2.8206	* 2.8242	* 2.8634
9	* 1.5744	* 1.3987	* 1.3141	* 1.4491	* 1.7168	* 1.4052	* 1.5979	* 1.1106
	* 2.6859	* 2.9920	* 3.1281	* 2.8023	* 2.3791	* 2.8151	* 2.4616	* 3.4494
10	* 1.4351	* 1.3130	* 1.2606	* 1.6922	* 1.5123	* 1.7050	* 1.2338	* .9328
	* 2.8653	* 3.1303	* 3.2796	* 2.4700	* 2.7248	* 2.4504	* 3.2574	* 4.1818
11	* 1.7007	* 1.4491	* 1.6911	* 1.3013	* 1.6858	* 1.5262	* 1.5979	* .8622
	* 2.3687	* 2.8041	* 2.4728	* 3.2501	* 2.5218	* 2.7754	* 2.6612	* 4.7609
12	* 1.3848	* 1.7147	* 1.5101	* 1.6836	* 1.1974	* 1.5530	* 1.2702	*
	* 2.8825	* 2.3804	* 2.7282	* 2.5232	* 3.4086	* 2.6743	* 3.3021	*
13	* 1.3848	* 1.4052	* 1.7040	* 1.5262	* 1.5530	* 1.1738	* .8268	*
	* 2.8206	* 2.8132	* 2.4532	* 2.7111	* 2.6743	* 3.4798	* 4.9683	*
14	* 1.3677	* 1.5979	* 1.2327	* 1.5979	* 1.2691	* .8268	*	*
	* 2.8242	* 2.4602	* 3.2550	* 2.6612	* 3.3046	* 4.9740	*	*
15	* 1.3345	* 1.1106	* .9318	* .8622	* F-SUB-Q			
	* 2.8634	* 3.4494	* 4.1859	* 4.7661	* M-SUB-Q			

AT 50% POWER, 100 RFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2616	* 1.6161	* 1.4416	* 1.7029	* 1.3805	* 1.3762	* 1.3602	* 1.3291
	* 3.1577	* 2.4588	* 2.5911	* 2.1384	* 2.6020	* 2.5500	* 2.5530	* 2.5834
9	* 1.6161	* 1.4416	* 1.3259	* 1.4512	* 1.7243	* 1.4052	* 1.5958	* 1.1031
	* 2.4588	* 2.7455	* 2.8261	* 2.5336	* 2.1469	* 2.5425	* 2.2161	* 3.1213
10	* 1.4416	* 1.3259	* 1.2638	* 1.7104	* 1.5305	* 1.7243	* 1.2466	* .9286
	* 2.5911	* 2.8298	* 2.9715	* 2.2332	* 2.4644	* 2.2138	* 2.9392	* 3.7838
11	* 1.7029	* 1.4501	* 1.7082	* 1.3248	* 1.7254	* 1.5604	* 1.6258	* .8697
	* 2.1384	* 2.5350	* 2.2343	* 2.9899	* 2.3081	* 2.5440	* 2.4015	* 4.2980
12	* 1.3805	* 1.7232	* 1.5272	* 1.7232	* 1.2756	* 1.6279	* 1.3077	*
	* 2.6020	* 2.1490	* 2.4686	* 2.3106	* 3.1258	* 2.4394	* 3.0233	*
13	* 1.3762	* 1.4052	* 1.7232	* 1.5594	* 1.6279	* 1.2391	* .8589	*
	* 2.5500	* 2.5395	* 2.2149	* 2.5455	* 2.4394	* 3.1809	* 4.5604	*
14	* 1.3602	* 1.5958	* 1.2466	* 1.6258	* 1.3077	* .8589	*	*
	* 2.5530	* 2.2161	* 2.9372	* 2.4029	* 3.0254	* 4.5604	*	*
15	* 1.3291	* 1.1042	* .9275	* .8686	* F-SUB-Q			
	* 2.5834	* 3.1191	* 3.7871	* 4.3023	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 70 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2456	* 1.5969	* 1.4094	* 1.6643	* 1.3430	* 1.3377	* 1.3205	* 1.2927
	* 2.8863	* 2.2494	* 2.3949	* 1.9765	* 2.4176	* 2.3752	* 2.3778	* 2.4042
9	* 1.5969	* 1.4212	* 1.2991	* 1.4169	* 1.6900	* 1.3709	* 1.5572	* 1.0721
	* 2.2494	* 2.5174	* 2.6162	* 2.3456	* 1.9819	* 2.3648	* 2.0562	* 2.9116
10	* 1.4094	* 1.2991	* 1.2338	* 1.6804	* 1.5048	* 1.5965	* 1.2242	* .9029
	* 2.3949	* 2.6193	* 2.7507	* 2.0591	* 2.2778	* 2.0388	* 2.7282	* 3.5280
11	* 1.6643	* 1.4159	* 1.6783	* 1.3013	* 1.7050	* 1.5390	* 1.6054	* .8514
	* 1.9765	* 2.3469	* 2.0611	* 2.7490	* 2.1113	* 2.3330	* 2.2059	* 3.9856
12	* 1.3430	* 1.6890	* 1.5026	* 1.7029	* 1.2659	* 1.6226	* 1.2959	
	* 2.4176	* 1.9837	* 2.2814	* 2.1144	* 2.8616	* 2.2355	* 2.7736	
13	* 1.3377	* 1.3709	* 1.6954	* 1.5380	* 1.6226	* 1.2349	* .8536	
	* 2.3752	* 2.3636	* 2.0397	* 2.3343	* 2.2343	* 2.9332	* 4.2144	
14	* 1.3205	* 1.5572	* 1.2242	* 1.6044	* 1.2948	* .8525		
	* 2.3778	* 2.0552	* 2.7265	* 2.2070	* 2.7754	* 4.2144		
15	* 1.2927	* 1.0721	* .9018	* .8504	* F-SUB-Q			
	* 2.4042	* 2.9096	* 3.5309	* 3.9893	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2531	* 1.6097	* 1.4159	* 1.6718	* 1.3462	* 1.3377	* 1.3227	* 1.2959
	* 2.5590	* 1.9864	* 2.1576	* 1.7873	* 2.1936	* 2.1662	* 2.1695	* 2.1947
9	* 1.6097	* 1.4309	* 1.3055	* 1.4234	* 1.6997	* 1.3741	* 1.5626	* 1.0721
	* 1.9864	* 2.2252	* 2.3610	* 2.1206	* 1.7695	* 2.1522	* 1.8690	* 2.6595
10	* 1.4159	* 1.3055	* 1.2381	* 1.6922	* 1.5165	* 1.7082	* 1.2327	* .9039
	* 2.1576	* 2.3636	* 2.4842	* 1.8515	* 2.0533	* 1.8334	* 2.4771	* 3.2187
11	* 1.6718	* 1.4223	* 1.6900	* 1.3088	* 1.7211	* 1.5519	* 1.6215	* .8568
	* 1.7873	* 2.1216	* 1.8530	* 2.4285	* 1.8618	* 2.0561	* 1.9568	* 3.5983
12	* 1.3462	* 1.6975	* 1.5144	* 1.7190	* 1.2766	* 1.6440	* 1.3120	
	* 2.1936	* 1.7910	* 2.0562	* 1.8642	* 2.5440	* 1.9801	* 2.4504	
13	* 1.3377	* 1.3752	* 1.7072	* 1.5508	* 1.6440	* 1.2509	* .8622	
	* 2.1662	* 2.1501	* 1.8350	* 2.0591	* 1.9801	* 2.6146	* 3.7542	
14	* 1.3227	* 1.5626	* 1.2327	* 1.6204	* 1.3109	* .8622		
	* 2.1695	* 1.8682	* 2.4742	* 1.9577	* 2.4518	* 3.7542		
15	* 1.2959	* 1.0731	* .9029	* .8557	* F-SUB-Q			
	* 2.1947	* 2.6595	* 3.2235	* 3.6013	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 71 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1910	* 1.5358	* 1.3505	* 1.5958	* 2.809	* 1.2713	* 1.2541	* 1.2295
	* 2.4312	* 1.8919	* 2.0650	* 1.7192	* 2.1206	* 2.1062	* 2.1144	* 2.1426
9	* 1.5358	* 1.3634	* 1.2445	* 1.3570	* 1.6226	* 1.3077	* 1.4865	* 1.0164
	* 1.8919	* 2.1216	* 2.2623	* 2.0378	* 1.7165	* 2.0909	* 1.8120	* 2.5989
10	* 1.3505	* 1.2434	* 1.1781	* 1.6161	* 1.4480	* 1.6311	* 1.1738	* .8557
	* 2.0650	* 2.2647	* 2.3817	* 1.7590	* 1.9639	* 1.7441	* 2.3949	* 3.1394
11	* 1.5958	* 1.3570	* 1.6151	* 1.2466	* 1.6440	* 1.4801	* 1.5487	* .8129
	* 1.7192	* 2.0378	* 1.7604	* 2.3267	* 1.7770	* 1.9684	* 1.8546	* 3.4604
12	* 1.2809	* 1.6215	* 1.4448	* 1.6418	* 1.2145	* 1.5712	* 1.2509	*
	* 2.1206	* 1.7178	* 1.9666	* 1.7792	* 2.4082	* 1.8723	* 2.3368	*
13	* 1.2713	* 1.3077	* 1.6301	* 1.4791	* 1.5712	* 1.1899	* .8193	*
	* 2.1062	* 2.0889	* 1.7455	* 1.9702	* 1.8714	* 2.4728	* 3.5775	*
14	* 1.2541	* 1.4865	* 1.1738	* 1.5476	* 1.2509	* .8193	*	*
	* 2.1144	* 1.6112	* 2.3936	* 1.6554	* 2.3380	* 3.5775	*	*
15	* 1.2295	* 1.0164	* .8547	* .8118	* F-SUB-Q			
	* 2.1426	* 2.5989	* 3.1417	* 3.4631	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1438	* 1.4705	* 1.2991	* 1.5337	* 1.2349	* 1.2188	* 1.1952	* 1.1631
	* 2.3205	* 1.7977	* 1.9855	* 1.6676	* 2.0552	* 2.0591	* 2.0849	* 2.1310
9	* 1.4705	* 1.3098	* 1.1984	* 1.3120	* 1.5594	* 1.2562	* 1.4169	* .9660
	* 1.7977	* 2.0141	* 2.1695	* 1.9604	* 1.6587	* 2.0359	* 1.7807	* 2.5727
10	* 1.2991	* 1.1984	* 1.1353	* 1.5562	* 1.3966	* 1.5637	* 1.1256	* .8140
	* 1.9855	* 2.1695	* 2.2850	* 1.6871	* 1.8812	* 1.6799	* 2.3305	* 3.0924
11	* 1.5337	* 1.3109	* 1.5540	* 1.2027	* 1.5797	* 1.4201	* 1.4769	* .7722
	* 1.6676	* 1.9612	* 1.6890	* 2.1970	* 1.6838	* 1.8690	* 1.7880	* 3.3768
12	* 1.2349	* 1.5583	* 1.3934	* 1.5776	* 1.1685	* 1.5005	* 1.1952	*
	* 2.0552	* 1.6599	* 1.8836	* 1.6038	* 2.3081	* 1.8067	* 2.2436	*
13	* 1.2188	* 1.2563	* 1.5626	* 1.4191	* 1.5005	* 1.1331	* .7786	*
	* 2.0591	* 2.0359	* 1.6812	* 1.8706	* 1.8067	* 2.4122	* 3.4854	*
14	* 1.1952	* 1.4169	* 1.1256	* 1.4769	* 1.1942	* .7786	*	*
	* 2.0849	* 1.7807	* 2.3292	* 1.7880	* 2.2448	* 3.4854	*	*
15	* 1.1631	* .9660	* .8129	* .7711	* F-SUB-Q			
	* 2.1310	* 2.5727	* 3.0968	* 3.3794	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 72 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 100 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0249	* 1.3013	* 1.1492	* 1.3602	* 1.1117	* 1.0742	* 1.0367	* .9789 *
	* 2.4217	* 1.9111	* 2.1258	* 1.7873	* 2.1760	* 2.2320	* 2.3008	* 2.4258 *
9	* 1.3013	* 1.1588	* 1.0646	* 1.1813	* 1.3784	* 1.1192	* 1.2231	* .8322 *
	* 1.9111	* 2.1395	* 2.3094	* 2.0670	* 1.7785	* 2.1738	* 1.9702	* 2.8616 *
10	* 1.1492	* 1.0646	* 1.0249	* 1.3784	* 1.2520	* 1.3762	* .9971	* .7058 *
	* 2.1258	* 2.3118	* 2.3976	* 1.7962	* 1.9783	* 1.8007	* 2.4899	* 3.4060 *
11	* 1.3602	* 1.1802	* 1.3773	* 1.0881	* 1.3955	* 1.2509	* 1.2616	* .6597 *
	* 1.7873	* 2.0680	* 1.7977	* 2.2886	* 1.7954	* 2.0002	* 1.9801	* 3.7445 *
12	* 1.1117	* 1.3784	* 1.2499	* 1.3934	* 1.0517	* 1.2959	* 1.0292	*
	* 2.1760	* 1.7792	* 1.9810	* 1.7977	* 2.3949	* 1.9533	* 2.4491	*
13	* 1.0742	* 1.1192	* 1.3752	* 1.2509	* 1.2959	* .9832	* .6726	*
	* 2.2320	* 2.1727	* 1.8022	* 2.0020	* 1.9533	* 2.5880	* 3.7739	*
14	* 1.0367	* 1.2231	* .9971	* 1.2606	* 1.0282	* .6726	*	*
	* 2.3008	* 1.9702	* 2.4899	* 1.9810	* 2.4504	* 3.7772	*	*
15	* .9789	* .8322	* .7058	* .6597	* F-SUB-Q			
	* 2.4258	* 2.8616	* 3.4113	* 3.7477	* M-SUB-Q			

AT 50% POWER, 100 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .6940	* .8750	* .7454	* .9093	* .7497	* .6972	* .6555	* .5783 *
	* 3.4521	* 2.7368	* 3.1646	* 2.5834	* 3.1236	* 3.3377	* 3.5338	* 3.9893 *
9	* .8750	* .7572	* .6983	* .7958	* .9403	* .7454	* .7754	* .5184 *
	* 2.7368	* 3.1554	* 3.3873	* 2.9674	* 2.5130	* 3.1577	* 3.0149	* 4.4618 *
10	* .7454	* .6972	* .6961	* .9361	* .8375	* .9296	* .6555	* .4455 *
	* 3.1646	* 3.3926	* 3.4113	* 2.5380	* 2.8409	* 2.5742	* 3.6254	* 5.2387 *
11	* .9093	* .7958	* .9350	* .7454	* .9468	* .8118	* .7626	* .4070 *
	* 2.5834	* 2.9694	* 2.5395	* 3.2211	* 2.5500	* 2.9735	* 3.1554	* 5.8388 *
12	* .7497	* .9393	* .8365	* .9468	* .7154	* .8343	* .6351	*
	* 3.1236	* 2.5144	* 2.8446	* 2.5515	* 3.3926	* 2.9214	* 3.8272	*
13	* .6972	* .7454	* .9296	* .8118	* .8343	* .6308	* .4209	*
	* 3.3377	* 3.1577	* 2.5757	* 2.9755	* 2.9214	* 3.8751	* 5.7997	*
14	* .6555	* .7754	* .6555	* .7626	* .6351	* .4209	*	*
	* 3.5338	* 3.0128	* 3.6254	* 3.1577	* 3.8272	* 5.8075	*	*
15	* .5783	* .5184	* .4455	* .4059	* F-SUB-Q			
	* 3.9893	* 4.4618	* 5.2450	* 5.8467	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 73 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .6587 *	* .9264 *	* .9082 *	* 1.1149 *	* .9885 *	* .9039 *	* .6662 *	* .5655 *
	* 2.2633 *	* 2.0034 *	* 2.1351 *	* 1.8017 *	* 2.0429 *	* 2.0979 *	* 2.2107 *	* 2.4700 *
9	* .9264 *	* .8161 *	* .8461 *	* .9960 *	* 1.1406 *	* .9842 *	* .9382 *	* .6340 *
	* 2.0034 *	* 2.2367 *	* 2.1752 *	* 1.9801 *	* 1.7765 *	* 2.0460 *	* 1.9732 *	* 2.7415 *
10	* .9082 *	* .8461 *	* .7090 *	* 1.0731 *	* 1.0517 *	* 1.1363 *	* .8921 *	* .6190 *
	* 2.1351 *	* 2.1776 *	* 2.1784 *	* 1.8072 *	* 1.9471 *	* 1.7843 *	* 2.2646 *	* 3.0619 *
11	* 1.1149 *	* .9960 *	* 1.0731 *	* .9018 *	* 1.0967 *	* 1.0089 *	* .9939 *	* .6126 *
	* 1.8017 *	* 1.9807 *	* 1.8080 *	* 2.1876 *	* 1.8362 *	* 1.9913 *	* 2.0155 *	* 3.2724 *
12	* .9885 *	* 1.1406 *	* 1.0517 *	* 1.0967 *	* .7551 *	* .9307 *	* .8161 *	
	* 2.0429 *	* 1.7765 *	* 1.9477 *	* 1.8368 *	* 2.1748 *	* 2.0398 *	* 2.4190 *	
13	* .9039 *	* .9842 *	* 1.1363 *	* 1.0089 *	* .9307 *	* .7476 *	* .5848 *	
	* 2.0979 *	* 2.0457 *	* 1.7851 *	* 1.9913 *	* 2.0398 *	* 2.5024 *	* 3.3152 *	
14	* .6662 *	* .9382 *	* .8921 *	* .9928 *	* .8150 *	* .5848 *		
	* 2.2107 *	* 1.9722 *	* 2.2646 *	* 2.0155 *	* 2.4190 *	* 3.3179 *		
15	* .5655 *	* .6340 *	* .6180 *	* .6126 *	F-SUB-Q			
	* 2.4700 *	* 2.7415 *	* 3.0619 *	* 3.2742 *	M-SUB-Q			

AT 50% POWER, 350 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8000 *	* 1.1802 *	* 1.1663 *	* 1.4384 *	* 1.2434 *	* 1.1610 *	* .8579 *	* .7754 *
	* 1.9326 *	* 1.6444 *	* 1.7406 *	* 1.4632 *	* 1.6981 *	* 1.7053 *	* 1.7667 *	* 1.8661 *
9	* 1.1802 *	* 1.0453 *	* 1.0667 *	* 1.2520 *	* 1.4566 *	* 1.2477 *	* 1.2466 *	* .8482 *
	* 1.6444 *	* 1.8119 *	* 1.8025 *	* 1.6422 *	* 1.4556 *	* 1.6875 *	* 1.5751 *	* 2.1478 *
10	* 1.1663 *	* 1.0667 *	* .8664 *	* 1.3634 *	* 1.3323 *	* 1.4512 *	* 1.1353 *	* .8257 *
	* 1.7406 *	* 1.8041 *	* 1.8251 *	* 1.4948 *	* 1.6150 *	* 1.4759 *	* 1.8743 *	* 2.4204 *
11	* 1.4384 *	* 1.2520 *	* 1.3634 *	* 1.1224 *	* 1.3891 *	* 1.3077 *	* 1.3441 *	* .8193 *
	* 1.4632 *	* 1.6424 *	* 1.4955 *	* 1.8356 *	* 1.5309 *	* 1.6156 *	* 1.5661 *	* 2.5770 *
12	* 1.2434 *	* 1.4566 *	* 1.3323 *	* 1.3891 *	* .9114 *	* 1.2327 *	* 1.0871 *	
	* 1.6981 *	* 1.4558 *	* 1.6163 *	* 1.5309 *	* 1.8579 *	* 1.6389 *	* 1.9079 *	
13	* 1.1610 *	* 1.2477 *	* 1.4512 *	* 1.3066 *	* 1.2327 *	* .9768 *	* .7765 *	
	* 1.7053 *	* 1.5872 *	* 1.4763 *	* 1.6158 *	* 1.6389 *	* 1.9934 *	* 2.6233 *	
14	* .8579 *	* 1.2466 *	* 1.1353 *	* 1.3441 *	* 1.0860 *	* .7754 *		
	* 1.7667 *	* 1.5749 *	* 1.8743 *	* 1.5661 *	* 1.9088 *	* 2.6256 *		
15	* .7754 *	* .8482 *	* .8247 *	* .8182 *	F-SUB-Q			
	* 1.8661 *	* 2.1470 *	* 2.4209 *	* 2.5770 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 74 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 HFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8439	* 1.2734	* 1.2424	* 1.5583	* 1.3173	* 1.2391	* .9264	* .8675
	* 1.9606	* 1.6197	* 1.7529	* 1.4438	* 1.7148	* 1.7105	* 1.7567	* 1.8097
9	* 1.2734	* 1.1117	* 1.1245	* 1.3227	* 1.5797	* 1.3238	* 1.3591	* .9232
	* 1.6197	* 1.8121	* 1.8323	* 1.6597	* 1.4334	* 1.6993	* 1.5435	* 2.1161
10	* 1.2424	* 1.1245	* .9157	* 1.4780	* 1.4126	* 1.5722	* 1.1995	* .8889
	* 1.7529	* 1.8342	* 1.8561	* 1.4739	* 1.6259	* 1.4476	* 1.8875	* 2.3993
11	* 1.5583	* 1.3227	* 1.4780	* 1.1792	* 1.5005	* 1.3923	* 1.4555	* .8804
	* 1.4438	* 1.6602	* 1.4746	* 1.8643	* 1.5063	* 1.6118	* 1.5350	* 2.5405
12	* 1.3173	* 1.5797	* 1.4116	* 1.5005	* .9543	* 1.3280	* 1.1652	*
	* 1.7148	* 1.4339	* 1.6270	* 1.5066	* 1.8882	* 1.6057	* 1.8866	*
13	* 1.2391	* 1.3238	* 1.5722	* 1.3912	* 1.3270	* 1.0367	* .8290	*
	* 1.7105	* 1.6989	* 1.4481	* 1.6118	* 1.6051	* 1.9811	* 2.6045	*
14	* .9264	* 1.3591	* 1.2006	* 1.4555	* 1.1652	* .8279	*	*
	* 1.7567	* 1.5433	* 1.8875	* 1.5354	* 1.8869	* 2.6062	*	*
15	* .8675	* .9232	* .8879	* .8804	* F-SUB-Q			
	* 1.8097	* 2.1157	* 2.4007	* 2.5421	* M-SUB-Q			

AT 50% POWER, 350 HFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8600	* 1.3130	* 1.2734	* 1.6044	* 1.3441	* 1.2766	* .9789	* .9468
	* 2.1175	* 1.7265	* 1.8950	* 1.5388	* 1.8418	* 1.8412	* 1.8836	* 1.9209
9	* 1.3130	* 1.1406	* 1.1535	* 1.3527	* 1.6290	* 1.3527	* 1.4105	* .9639
	* 1.7265	* 1.9499	* 1.9950	* 1.7868	* 1.5194	* 1.8178	* 1.6430	* 2.2584
10	* 1.2734	* 1.1535	* .9521	* 1.5262	* 1.4384	* 1.6129	* 1.2156	* .9200
	* 1.8950	* 1.9969	* 2.0143	* 1.5660	* 1.7386	* 1.5404	* 2.0339	* 2.5572
11	* 1.6044	* 1.3527	* 1.5251	* 1.2006	* 1.5305	* 1.4073	* 1.4791	* .8975
	* 1.5388	* 1.7868	* 1.5665	* 2.0061	* 1.6095	* 1.7341	* 1.6421	* 2.7224
12	* 1.3441	* 1.6290	* 1.4373	* 1.5305	* .9618	* 1.3409	* 1.1749	*
	* 1.8418	* 1.5194	* 1.7401	* 1.6101	* 2.0386	* 1.7101	* 2.0276	*
13	* 1.2766	* 1.3527	* 1.6119	* 1.4073	* 1.3409	* 1.0367	* .8322	*
	* 1.8412	* 1.8173	* 1.5410	* 1.7346	* 1.7100	* 2.1273	* 2.8094	*
14	* .9789	* 1.4105	* 1.2156	* 1.4791	* 1.1749	* .8311	*	*
	* 1.8836	* 1.6424	* 2.0339	* 1.6421	* 2.0286	* 2.8119	*	*
15	* .9468	* .9639	* .9200	* .8964	* F-SUB-Q			
	* 1.9209	* 2.2571	* 2.5588	* 2.7236	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 75 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8536	* 1.3130	* 1.2713	* 1.5958	* 1.3302	* 1.2927	* 1.0967	* 1.0913
	* 2.3899	* 1.9341	* 2.1486	* 1.7247	* 2.0720	* 2.0784	* 2.1229	* 2.1530
9	* 1.3130	* 1.1460	* 1.1663	* 1.3505	* 1.6204	* 1.3420	* 1.4384	* .9960
	* 1.9341	* 2.1946	* 2.2761	* 2.0147	* 1.6957	* 2.0373	* 1.8443	* 2.5391
10	* 1.2713	* 1.1652	* 1.0410	* 1.5358	* 1.4169	* 1.5926	* 1.1974	* .9328
	* 2.1486	* 2.2778	* 2.2926	* 1.7561	* 1.9421	* 1.7282	* 2.2719	* 2.8661
11	* 1.5958	* 1.3505	* 1.5358	* 1.1942	* 1.5005	* 1.3687	* 1.4416	* .8782
	* 1.7247	* 2.0147	* 1.7568	* 2.2609	* 1.8067	* 1.9919	* 1.8784	* 3.1153
12	* 1.3302	* 1.6204	* 1.4159	* 1.4994	* .9382	* 1.2959	* 1.1342	*
	* 2.0720	* 1.6964	* 1.9439	* 1.8075	* 2.3070	* 1.9247	* 2.3389	*
13	* 1.2927	* 1.3430	* 1.5926	* 1.3687	* 1.2959	* .9928	* .7979	*
	* 2.0784	* 2.0363	* 1.7284	* 1.9925	* 1.9238	* 2.4123	* 3.2584	*
14	* 1.0967	* 1.4384	* 1.1974	* 1.4416	* 1.1331	* .7968	*	*
	* 2.1229	* 1.8443	* 2.2719	* 1.8787	* 2.3394	* 3.2610	*	*
15	* 1.0913	* .9950	* .9328	* .8771	* F-SUB-Q			
	* 2.1530	* 2.5391	* 2.8664	* 3.1161	* M-SUB-Q			

AT 50% POWER, 350 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8782 *	* 1.3655 *	* 1.3195 *	* 1.6493 *	* 1.3698 *	* 1.3580 *	* 1.2959 *	* 1.2713 *
	* 2.6336 *	* 2.1138 *	* 2.3507 *	* 1.8813 *	* 2.2680 *	* 2.2561 *	* 2.2948 *	* 2.3163 *
9	* 1.3655 *	* 1.1963 *	* 1.2327 *	* 1.4030 *	* 1.6740 *	* 1.3859 *	* 1.5272 *	* 1.0946 *
	* 2.1138 *	* 2.4064 *	* 2.4835 *	* 2.2043 *	* 1.8507 *	* 2.2285 *	* 1.9846 *	* 2.7304 *
10	* 1.3195 *	* 1.2316 *	* 1.2145 *	* 1.6097 *	* 1.4523 *	* 1.6354 *	* 1.2391 *	* .9853 *
	* 2.3507 *	* 2.4851 *	* 2.4979 *	* 1.9137 *	* 2.1354 *	* 1.8939 *	* 2.4826 *	* 3.0883 *
11	* 1.6493 *	* 1.4030 *	* 1.6086 *	* 1.2359 *	* 1.5305 *	* 1.3837 *	* 1.4608 *	* .8964 *
	* 1.8813 *	* 2.2043 *	* 1.9145 *	* 2.4716 *	* 1.9701 *	* 2.2217 *	* 2.0908 *	* 3.4317 *
12	* 1.3698 *	* 1.6740 *	* 1.4512 *	* 1.5294 *	* .9489 *	* 1.3013 *	* 1.1395 *	
	* 2.2680 *	* 1.8507 *	* 2.1375 *	* 1.9710 *	* 2.5463 *	* 2.1140 *	* 2.6407 *	
13	* 1.3580 *	* 1.3859 *	* 1.6354 *	* 1.3837 *	* 1.3013 *	* .9896 *	* .7968 *	
	* 2.2561 *	* 2.2273 *	* 1.8939 *	* 2.2222 *	* 2.1140 *	* 2.6663 *	* 3.6266 *	
14	* 1.2959 *	* 1.5272 *	* 1.2391 *	* 1.4598 *	* 1.1385 *	* .7958 *		
	* 2.2948 *	* 1.9844 *	* 2.4826 *	* 2.0908 *	* 2.6412 *	* 3.6295 *		
15	* 1.2713 *	* 1.0935 *	* .9853 *	* .8954 *	* F-SUB-Q			
	* 2.3163 *	* 2.7319 *	* 3.0905 *	* 3.4317 *	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 76 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8761	* 1.3698	* 1.3205	* 1.6493	* 1.3645	* 1.3666	* 1.3398	* 1.3302
	* 2.9871	* 2.3911	* 2.6992	* 2.1507	* 2.6010	* 2.5778	* 2.5961	* 2.5989
9	* 1.3698	* 1.1995	* 1.2466	* 1.4019	* 1.6718	* 1.3816	* 1.5530	* 1.1278
	* 2.3911	* 2.7336	* 2.8527	* 2.5306	* 2.1173	* 2.5555	* 2.2466	* 3.0801
10	* 1.3205	* 1.2456	* 1.2349	* 1.6161	* 1.4426	* 1.6279	* 1.2370	* .9960
	* 2.6992	* 2.8545	* 2.8713	* 2.1928	* 2.4436	* 2.1550	* 2.8338	* 3.5110
11	* 1.6493	* 1.4019	* 1.6161	* 1.2981	* 1.5165	* 1.3623	* 1.4405	* .8868
	* 2.1507	* 2.5306	* 2.1939	* 2.8121	* 2.2257	* 2.5285	* 2.3929	* 3.8953
12	* 1.3645	* 1.6718	* 1.4416	* 1.5155	* .9328	* 1.2745	* 1.1149	*
	* 2.6010	* 2.1175	* 2.4458	* 2.2268	* 2.8817	* 2.3808	* 2.9976	*
13	* 1.3666	* 1.3827	* 1.6268	* 1.3612	* 1.2734	* .9628	* .7754	*
	* 2.5778	* 2.5543	* 2.1557	* 2.5298	* 2.3796	* 3.0000	* 4.0798	*
14	* 1.3398	* 1.5530	* 1.2370	* 1.4384	* 1.1149	* .7743	*	*
	* 2.5961	* 2.2464	* 2.8345	* 2.3937	* 2.9996	* 4.0837	*	*
15	* 1.3302	* 1.1267	* .9950	* .8868	* F-SUB-Q			
	* 2.5989	* 3.0801	* 3.5139	* 3.8953	* M-SUB-Q			

AT 50% POWER, 350 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8600	* 1.3495	* 1.2981	* 1.6236	* 1.3388	* 1.3452	* 1.3313	* 1.3302
	* 3.4652	* 2.7614	* 3.1370	* 2.4831	* 3.0088	* 2.9765	* 2.9945	* 2.9858
9	* 1.3495	* 1.1792	* 1.2274	* 1.3752	* 1.6440	* 1.3559	* 1.5401	* 1.1213
	* 2.7614	* 3.1688	* 3.3155	* 2.9302	* 2.4385	* 2.9404	* 2.5815	* 3.5402
10	* 1.2981	* 1.2263	* 1.2145	* 1.5904	* 1.4137	* 1.5979	* 1.2145	* .9832
	* 3.1370	* 3.3196	* 3.3379	* 2.5315	* 2.8298	* 2.4892	* 3.2599	* 4.0197
11	* 1.6236	* 1.3752	* 1.5894	* 1.2113	* 1.4833	* 1.3259	* 1.4062	* .8675
	* 2.4831	* 2.9302	* 2.5321	* 3.2629	* 2.5696	* 2.9270	* 2.7909	* 4.5158
12	* 1.3388	* 1.6440	* 1.4126	* 1.4823	* .9071	* 1.2381	* 1.0839	*
	* 3.0088	* 2.4385	* 2.8327	* 2.5696	* 3.3390	* 2.7426	* 3.4574	*
13	* 1.3452	* 1.3570	* 1.5969	* 1.3259	* 1.2381	* .9307	* .7497	*
	* 2.9765	* 2.9392	* 2.4897	* 2.9270	* 2.7424	* 3.4577	* 4.7069	*
14	* 1.3313	* 1.5401	* 1.2145	* 1.4062	* 1.0828	* .7497	*	*
	* 2.9945	* 2.5806	* 3.2599	* 2.7916	* 3.4601	* 4.7072	*	*
15	* 1.3302	* 1.1213	* .9821	* .8664	* F-SUB-Q			
	* 2.9858	* 3.5413	* 4.0235	* 4.5176	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 77 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
B	.8568	1.3527	1.2981	1.6258	1.3377	1.3452	1.3366	1.3430
	3.7124	2.9532	3.4743	2.7683	3.3611	3.3198	3.3249	3.2996
9	1.3527	1.1781	1.2263	1.3741	1.6461	1.3548	1.5476	1.1299
	2.9532	3.3926	3.6871	3.2772	2.7299	3.2921	2.8748	3.9278
10	1.2981	1.2252	1.2124	1.5915	1.4105	1.5979	1.2145	.9864
	3.4743	3.6903	3.7029	2.8206	3.1832	2.8005	3.6684	4.4989
11	1.6258	1.3741	1.5915	1.2070	1.4801	1.3195	1.4030	.8664
	2.7683	3.2796	2.8224	3.5223	2.7807	3.1739	3.1124	5.1090
12	1.3377	1.6461	1.4094	1.4791	.8996	1.2327	1.0796	
	3.3611	2.7299	3.1856	2.7825	3.6254	2.9858	3.7575	
13	1.3452	1.3548	1.5979	1.3184	1.2327	.9243	.7454	
	3.3198	3.2896	2.8023	3.1739	2.9837	3.7772	5.1332	
14	1.3366	1.5487	1.2145	1.4030	1.0765	.7454		
	3.3249	2.8729	3.6684	3.1124	3.7608	5.1393		
15	1.3430	1.1299	.9864	.8664	F-SUB-Q			
	3.2996	3.9278	4.5035	5.1090	M-SUB-Q			

AT 50% POWER, 350 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.8279	1.3120	1.2552	1.5754	1.2916	1.2991	1.2948	1.3055
	4.0078	3.1762	3.5570	2.8316	3.4411	3.4086	3.4194	3.3980
9	1.3120	1.1385	1.1845	1.3280	1.5947	1.3098	1.5026	1.0956
	3.1762	3.6591	3.7673	3.3584	2.8023	3.3900	2.9593	4.0490
10	1.2552	1.1835	1.1706	1.5412	1.3634	1.5487	1.1738	.9543
	3.5570	3.7706	3.8205	2.9076	3.2772	2.8921	3.7937	4.6535
11	1.5754	1.3270	1.5412	1.1631	1.4319	1.2734	1.3591	.8375
	2.8316	3.3584	2.9096	3.8070	2.9961	3.4248	3.3046	5.3355
12	1.2916	1.5947	1.3623	1.4309	.8575	1.1931	1.0432	
	3.4411	2.8023	3.2796	2.9961	3.9207	3.2116	4.0490	
13	1.2991	1.3098	1.5476	1.2734	1.1920	.8921	.7197	
	3.4086	3.3873	2.8921	3.4248	3.2092	4.0642	5.5331	
14	1.2948	1.5026	1.1738	1.3591	1.0421	.7186		
	3.4194	2.9593	3.7937	3.3046	4.0490	5.5331		
15	1.3055	1.0967	.9543	.8365	F-SUB-Q			
	3.3980	4.0490	4.6585	5.3355	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 78 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8343	* 1.3270	* 1.2649	* 1.5894	* 1.3002	* 1.3066	* 1.3045	* 1.3205
	* 3.8682	* 3.0296	* 3.4006	* 2.7094	* 3.2846	* 3.2259	* 3.2116	* 3.1554
9	* 1.3270	* 1.1481	* 1.1942	* 1.3366	* 1.6097	* 1.3195	* 1.5176	* 1.1074
	* 3.0296	* 3.4826	* 3.5983	* 3.2187	* 2.6843	* 3.2021	* 2.7897	* 3.7673
10	* 1.2649	* 1.1920	* 1.1781	* 1.5572	* 1.3741	* 1.5637	* 1.1835	* .9639
	* 3.4006	* 3.6013	* 3.6653	* 2.7987	* 3.1463	* 2.7718	* 3.5924	* 4.3411
11	* 1.5894	* 1.3366	* 1.5562	* 1.1717	* 1.4459	* 1.2841	* 1.3741	* .8461
	* 2.7094	* 3.2211	* 2.7987	* 3.6164	* 2.8540	* 3.2452	* 3.1349	* 5.0028
12	* 1.3002	* 1.6097	* 1.3730	* 1.4448	* .8718	* 1.2070	* 1.0560	*
	* 3.2846	* 2.6859	* 3.1508	* 2.8559	* 3.7904	* 3.0661	* 3.8003	*
13	* 1.3066	* 1.3205	* 1.5637	* 1.2831	* 1.2070	* .9039	* .7304	*
	* 3.2259	* 3.1997	* 2.7736	* 3.2452	* 3.0661	* 3.8579	* 5.1638	*
14	* 1.3045	* 1.5176	* 1.1835	* 1.3741	* 1.0560	* .7294	*	*
	* 3.2116	* 2.7879	* 3.5924	* 3.1349	* 3.8037	* 5.1699	*	*
15	* 1.3205	* 1.1074	* .9628	* .8461	* F-SUB-Q			
	* 3.1554	* 3.7673	* 4.3411	* 5.0028	* M-SUB-Q			

AT 50% POWER, 350 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8386	* 1.3313	* 1.2606	* 1.5840	* 1.2916	* 1.2948	* 1.2948	* 1.3141
	* 3.5194	* 2.7507	* 2.9961	* 2.3883	* 2.9076	* 2.8616	* 2.8484	* 2.7951
9	* 1.3313	* 1.1503	* 1.1888	* 1.3302	* 1.6054	* 1.3120	* 1.5101	* 1.0999
	* 2.7507	* 3.1670	* 3.1739	* 2.8446	* 2.3674	* 2.8391	* 2.4672	* 3.3429
10	* 1.2606	* 1.1877	* 1.1727	* 1.5562	* 1.3687	* 1.5626	* 1.1770	* .9585
	* 2.9961	* 3.1762	* 3.2355	* 2.4630	* 2.7790	* 1.4435	* 3.1809	* 3.8510
11	* 1.5840	* 1.3302	* 1.5551	* 1.1674	* 1.4491	* 1.2841	* 1.3773	* .8439
	* 2.3883	* 2.8446	* 2.4630	* 3.2772	* 2.5974	* 1.9472	* 2.7843	* 4.4253
12	* 1.2916	* 1.6054	* 1.3677	* 1.4491	* .8739	* 1.2177	* 1.0635	*
	* 2.9076	* 2.3674	* 2.7825	* 2.5989	* 3.4631	* 2.7951	* 3.4715	*
13	* 1.2948	* 1.3120	* 1.5615	* 1.2841	* 1.2167	* .9146	* .7379	*
	* 2.8616	* 2.8372	* 2.4449	* 2.9472	* 2.7951	* 3.5223	* 4.7245	*
14	* 1.2948	* 1.5101	* 1.1770	* 1.3762	* 1.0624	* .7379	*	*
	* 2.8484	* 2.4658	* 3.1809	* 2.7843	* 3.4743	* 4.7297	*	*
15	* 1.3141	* 1.0999	* .9575	* .8439	* F-SUB-Q			
	* 2.7951	* 3.3429	* 3.8544	* 4.4299	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 79 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 RPPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8611	* 1.3473	* 1.2541	* 1.5690	* 1.2734	* 1.2745	* 1.2745	* 1.2948
	* 3.1012	* 2.4312	* 2.6893	* 2.1469	* 2.6241	* 2.5927	* 2.5819	* 2.5321
9	* 1.3473	* 1.1599	* 1.1813	* 1.3173	* 1.5915	* 1.2948	* 1.4908	* 1.0806
	* 2.4312	* 2.8078	* 2.8521	* 2.5605	* 2.1279	* 2.5696	* 2.2275	* 3.0360
10	* 1.2541	* 1.1802	* 1.1642	* 1.5497	* 1.3591	* 1.5551	* 1.1652	* .9446
	* 2.6893	* 2.8540	* 2.9096	* 2.2070	* 2.4999	* 2.1936	* 2.8729	* 3.4911
11	* 1.5690	* 1.3173	* 1.5497	* 1.1652	* 1.4619	* 1.2927	* 1.3816	* .8375
	* 2.1469	* 2.5605	* 2.2070	* 2.9135	* 2.3094	* 2.6130	* 2.4842	* 4.0004
12	* 1.2734	* 1.5915	* 1.3580	* 1.4608	* .8964	* 1.2445	* 1.0774	*
	* 2.6241	* 2.1289	* 2.5028	* 2.3106	* 3.0704	* 2.4856	* 3.0924	*
13	* 1.2745	* 1.2959	* 1.5551	* 1.2916	* 1.2445	* .9478	* .7551	*
	* 2.5927	* 2.5681	* 2.1936	* 2.6146	* 2.4856	* 3.1485	* 4.2309	*
14	* 1.2745	* 1.4919	* 1.1642	* 1.3805	* 1.0774	* .7551	*	*
	* 2.5819	* 2.2275	* 2.8729	* 2.4842	* 3.0946	* 4.2350	*	*
15	* 1.2948	* 1.0817	* .9436	* .8365	* F-SUB-Q			
	* 2.5321	* 3.0329	* 3.4939	* 4.0004	* M-SUB-Q			

AT 50% POWER, 350 RPPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0100	* 1.4491	* 1.3034	* 1.6182	* 1.3098	* 1.3066	* 1.3055	* 1.3280
	* 2.6369	* 2.0591	* 2.3482	* 1.8820	* 2.3081	* 2.2898	* 2.2826	* 2.2378
9	* 1.4491	* 1.2381	* 1.2263	* 1.3612	* 1.6461	* 1.3345	* 1.5326	* 1.1096
	* 2.0591	* 2.3817	* 2.4913	* 2.2424	* 1.8642	* 2.2671	* 1.9639	* 2.6843
10	* 1.3034	* 1.2252	* 1.2102	* 1.6140	* 1.4105	* 1.6183	* 1.2038	* .9714
	* 2.3482	* 2.4927	* 2.5410	* 1.9229	* 2.1859	* 1.9153	* 2.5232	* 3.0792
11	* 1.6183	* 1.3612	* 1.6129	* 1.2274	* 1.5604	* 1.3720	* 1.4512	* .8697
	* 1.8820	* 2.2424	* 1.9238	* 2.4999	* 1.9604	* 2.2401	* 2.1479	* 3.5023
12	* 1.3098	* 1.6461	* 1.4094	* 1.5594	* 1.0474	* 1.3698	* 1.1578	*
	* 2.3081	* 1.8642	* 2.1881	* 1.9612	* 2.6193	* 2.1185	* 2.6257	*
13	* 1.3066	* 1.3355	* 1.6183	* 1.3720	* 1.3698	* 1.0678	* .8236	*
	* 2.2898	* 2.2659	* 1.9153	* 2.2401	* 2.1175	* 2.6909	* 3.6073	*
14	* 1.3055	* 1.5326	* 1.2038	* 1.4512	* 1.1567	* .8225	*	*
	* 2.2826	* 1.9630	* 2.5232	* 2.1479	* 2.6257	* 3.6103	*	*
15	* 1.3280	* 1.1085	* .9714	* .8697	* F-SUB-Q			
	* 2.2378	* 2.6843	* 3.0814	* 3.5052	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 80 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 RFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1642	* 1.5219	* 1.3120	* 1.6172	* 1.3023	* 1.2970	* 1.2927	* 1.3163
	* 2.3989	* 1.8755	* 2.1479	* 1.7337	* 2.1363	* 2.1269	* 2.1248	* 2.0849
9	* 1.5219	* 1.3066	* 1.2327	* 1.3623	* 1.6472	* 1.3313	* 1.5240	* 1.0988
	* 1.8755	* 2.1771	* 2.2826	* 2.0640	* 1.7144	* 2.0990	* 1.8196	* 2.5028
10	* 1.3120	* 1.2306	* 1.2145	* 1.6268	* 1.4180	* 1.6311	* 1.2027	* .9650
	* 2.1479	* 2.2850	* 2.3292	* 1.7561	* 2.0020	* 1.7526	* 2.3305	* 2.8672
11	* 1.6172	* 1.3623	* 1.6258	* 1.2563	* 1.6183	* 1.4105	* 1.4780	* .8718
	* 1.7337	* 2.0640	* 1.7569	* 2.2826	* 1.7940	* 2.0407	* 1.9376	* 3.2307
12	* 1.3023	* 1.6472	* 1.4169	* 1.6172	* 1.1802	* 1.4812	* 1.1984	*
	* 2.1363	* 1.7144	* 2.0039	* 1.7947	* 2.3804	* 1.9204	* 2.4029	*
13	* 1.2970	* 1.3323	* 1.6311	* 1.4105	* 1.4823	* 1.1545	* .8622	*
	* 2.1269	* 2.0980	* 1.7526	* 2.0417	* 1.9195	* 2.4408	* 3.2946	*
14	* 1.2927	* 1.5251	* 1.2027	* 1.4780	* 1.1984	* .8611	*	*
	* 2.1248	* 1.8196	* 2.3305	* 1.9376	* 2.4042	* 3.2996	*	*
15	* 1.3163	* 1.0988	* .9639	* .8707	* F-SUB-Q			
	* 2.0849	* 2.5043	* 2.8691	* 3.2331	* M-SUB-Q			

AT 50% POWER, 350 RFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2295	* 1.5851	* 1.3409	* 1.6408	* 1.3216	* 1.3120	* 1.3045	* 1.3238
	* 2.1695	* 1.6897	* 1.9657	* 1.6022	* 1.9756	* 1.9765	* 1.9819	* 1.9533
9	* 1.5851	* 1.3602	* 1.2595	* 1.3869	* 1.6718	* 1.3516	* 1.5390	* 1.1085
	* 1.6897	* 1.9568	* 2.0899	* 1.8993	* 1.5829	* 1.9436	* 1.6943	* 2.3368
10	* 1.3409	* 1.2584	* 1.2402	* 1.6568	* 1.4523	* 1.6665	* 1.2220	* .9757
	* 1.9657	* 2.0919	* 2.1363	* 1.6106	* 1.8327	* 1.6094	* 2.1511	* 2.6694
11	* 1.6408	* 1.3869	* 1.6568	* 1.2959	* 1.6729	* 1.4544	* 1.5155	* .8868
	* 1.6022	* 1.8993	* 1.6112	* 2.0640	* 1.6136	* 1.8451	* 1.7690	* 2.9817
12	* 1.3216	* 1.6718	* 1.4501	* 1.6718	* 1.2488	* 1.5551	* 1.2434	*
	* 1.9756	* 1.5829	* 1.8342	* 1.6142	* 2.1597	* 1.7441	* 2.1673	*
13	* 1.3120	* 1.3527	* 1.3665	* 1.4544	* 1.5551	* 1.2145	* .8986	*
	* 1.9765	* 1.9428	* 1.6100	* 1.8451	* 1.7441	* 2.2332	* 3.0086	*
14	* 1.3045	* 1.5390	* 1.2220	* 1.5155	* 1.2424	* .8975	*	*
	* 1.9819	* 1.6937	* 2.1511	* 1.7690	* 2.1673	* 3.0107	*	*
15	* 1.3238	* 1.1085	* .9746	* .8857	* F-SUB-Q			
	* 1.9533	* 2.3380	* 2.6710	* 2.9837	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 81 of 143

TABLE 1 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - NORMAL OPERATION

AT 50% POWER, 350 BFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1802	* 1.4962	* 1.2734	* 1.5412	* 1.2606	* 1.2402	* 1.2242	* 1.2156
	* 2.1533	* 1.7057	* 1.9756	* 1.6312	* 1.9846	* 2.0067	* 2.0283	* 2.0436
9	* 1.4962	* 1.2970	* 1.2027	* 1.3259	* 1.5701	* 1.2820	* 1.4341	* 1.0335
	* 1.7057	* 1.9586	* 2.0919	* 1.9010	* 1.6100	* 1.9604	* 1.7448	* 2.4069
10	* 1.2734	* 1.2017	* 1.1845	* 1.5594	* 1.3880	* 1.5669	* 1.1620	* .9136
	* 1.9756	* 2.0940	* 2.1352	* 1.6306	* 1.8311	* 1.6330	* 2.1662	* 2.7386
11	* 1.5412	* 1.3248	* 1.5583	* 1.2424	* 1.5787	* 1.3816	* 1.4169	* .8300
	* 1.6312	* 1.9010	* 1.6312	* 2.0581	* 1.6312	* 1.8570	* 1.8112	* 3.0510
12	* 1.2606	* 1.5701	* 1.3869	* 1.5787	* 1.2049	* 1.4673	* 1.1727	*
	* 1.9846	* 1.6100	* 1.8319	* 1.6318	* 2.1331	* 1.7604	* 2.1970	*
13	* 1.2402	* 1.2831	* 1.5658	* 1.3816	* 1.4673	* 1.1513	* .8482	*
	* 2.0067	* 1.9595	* 1.6330	* 1.8578	* 1.7597	* 2.2448	* 3.0424	*
14	* 1.2242	* 1.4341	* 1.1620	* 1.4169	* 1.1727	* .8482	*	*
	* 2.0283	* 1.7448	* 2.1662	* 1.8112	* 2.1970	* 3.0445	*	*
15	* 1.2156	* 1.0335	* .9125	* .8300	* F-SUB-Q			
	* 2.0436	* 2.4082	* 2.7403	* 3.0531	* M-SUB-Q			

AT 50% POWER, 350 BFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8782	* 1.0828	* .9296	* 1.1128	* .9393	* .9029	* .8771	* .6215
	* 2.8132	* 2.2814	* 2.6273	* 2.1914	* 2.5896	* 2.6843	* 2.7560	* 2.9452
9	* 1.0828	* .9468	* .8857	* .9853	* 1.1470	* .9468	* 1.0207	* .7251
	* 2.2814	* 2.6020	* 2.7612	* 2.4827	* 2.1363	* 2.5819	* 2.3844	* 3.3429
10	* .9296	* .8846	* .8825	* 1.1406	* 1.0303	* 1.1428	* .8547	* .6426
	* 2.6273	* 2.7630	* 2.7807	* 2.1554	* 2.3909	* 2.1640	* 2.8634	* 3.7937
11	* 1.1128	* .9853	* 1.1406	* .9318	* 1.1524	* 1.0057	* .9853	* .5805
	* 2.1914	* 2.4827	* 2.1565	* 2.6579	* 2.1597	* 2.4728	* 2.5203	* 4.2433
12	* .9393	* 1.1470	* 1.0292	* 1.1524	* .9039	* 1.0517	* .8247	*
	* 2.5896	* 2.1363	* 2.3923	* 2.1608	* 2.7648	* 2.3844	* 3.0381	*
13	* .9029	* .9468	* 1.1428	* 1.0046	* 1.0517	* .8193	* .5944	*
	* 2.6843	* 2.5819	* 2.1640	* 2.4728	* 2.3844	* 3.0661	* 4.2267	*
14	* .8771	* 1.0207	* .8547	* .9853	* .8247	* .5933	*	*
	* 2.7560	* 2.3844	* 2.8634	* 2.5218	* 3.0381	* 4.2309	*	*
15	* .6215	* .7251	* .6415	* .5805	* F-SUB-Q			
	* 2.9452	* 3.3455	* 3.7937	* 4.2474	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 82 of 143

TABLE 2

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.6190	.8011	.7454	.8450	.7401	.6951	.6372	.5366
	2.1738	1.8753	2.0636	1.7852	2.0361	2.1323	2.2977	2.7046
9	.8011	.7240	.7208	.7679	.8439	.7165	.7090	.5044
	1.8753	2.0666	2.1300	1.9792	1.7933	2.0941	2.0744	2.8813
10	.7454	.7197	.7069	.8397	.7722	.8000	.6351	.4423
	2.0636	2.1323	2.1767	1.8263	1.9772	1.9015	2.3549	3.3253
11	.8450	.7679	.8397	.6983	.7861	.6994	.6490	.3973
	1.7852	1.9792	1.8263	2.2182	1.9188	2.1640	2.3749	3.7958
12	.7401	.8439	.7711	.7850	.5848	.6319	.5473	
	2.0361	1.7949	1.9792	1.9206	2.3003	2.1510	2.7076	
13	.6951	.7165	.8000	.6994	.6319	.5066	.3759	
	2.1323	2.0941	1.9033	2.1640	2.1510	2.5965	3.8129	
14	.6372	.7090	.6351	.6490	.5473	.3759		
	2.2977	2.0744	2.3549	2.3749	2.7076	3.8182		
15	.5366	.5044	.4423	.3973	F-SUB-Q			
	2.7046	2.8813	3.3253	3.7958	M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.9253	1.1331	1.0935	1.1652	1.0303	1.0217	.9650	.8664
	1.6242	1.4235	1.4731	1.3580	1.5231	1.5152	1.5854	1.7506
9	1.1331	1.0764	1.0474	1.0731	1.1406	1.0121	1.0571	.7808
	1.4235	1.4814	1.5537	1.4807	1.3870	1.5371	1.4603	1.9466
10	1.0935	1.0474	.9832	1.1320	1.0785	1.1063	.9061	.6683
	1.4731	1.5549	1.6356	1.4222	1.4817	1.4603	1.7266	2.2995
11	1.1652	1.0731	1.1310	.9639	1.0988	1.0442	1.0421	.6169
	1.3580	1.4817	1.4232	1.6756	1.4627	1.5308	1.5512	2.5593
12	1.0303	1.1395	1.0785	1.0978	.8707	1.0046	.8750	
	1.5231	1.3879	1.4828	1.4630	1.7147	1.5189	1.7962	
13	1.0217	1.0121	1.1063	1.0442	1.0035	.8182	.5901	
	1.5152	1.5359	1.4603	1.5317	1.5189	1.8074	2.5965	
14	.9650	1.0571	.9061	1.0421	.8739	.5890		
	1.5854	1.4603	1.7266	1.5512	1.7966	2.5965		
15	.8664	.7808	.6672	.6158	F-SUB-Q			
	1.7506	1.9447	2.2996	2.5625	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 83 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFDP, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1363	* 1.3537	* 1.2809	* 1.3709	* 1.1802	* 1.1942	* 1.1535	* 1.0689 *
	* 1.4857	* 1.2669	* 1.3257	* 1.2184	* 1.3962	* 1.3591	* 1.3914	* 1.4874 *
9	* 1.3537	* 1.2863	* 1.2199	* 1.2284	* 1.3334	* 1.1781	* 1.2723	* .9414 *
	* 1.2669	* 1.3290	* 1.4174	* 1.3618	* 1.2481	* 1.3755	* 1.2730	* 1.6927 *
10	* 1.2809	* 1.2199	* 1.1256	* 1.3259	* 1.2391	* 1.3130	* 1.0635	* .7958 *
	* 1.3257	* 1.4174	* 1.5116	* 1.2825	* 1.3582	* 1.2988	* 1.5623	* 2.0259 *
11	* 1.3709	* 1.2284	* 1.3259	* 1.1074	* 1.3109	* 1.2552	* 1.2895	* .7518 *
	* 1.2184	* 1.3627	* 1.2833	* 1.5423	* 1.2999	* 1.3540	* 1.3213	* 2.2288 *
12	* 1.1802	* 1.3334	* 1.2381	* 1.3098	* 1.0592	* 1.2627	* 1.0849	*
	* 1.3962	* 1.2481	* 1.3591	* 1.3008	* 1.5618	* 1.3125	* 1.5424	*
13	* 1.1942	* 1.1792	* 1.3120	* 1.2541	* 1.2627	* 1.0260	* .7251	*
	* 1.3591	* 1.3746	* 1.2996	* 1.3546	* 1.3125	* 1.5909	* 2.2661	*
14	* 1.1535	* 1.2734	* 1.0635	* 1.2895	* 1.0849	* .7251	*	
	* 1.3914	* 1.2722	* 1.5611	* 1.3213	* 1.5427	* 2.2661	*	
15	* 1.0689	* .9414	* .7947	* .7508	* F-SUB-Q			
	* 1.4874	* 1.6913	* 2.0279	* 2.2288	* M-SUB-Q			

AT 100% POWER, 4 EFDP, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2531	* 1.4994	* 1.4009	* 1.5058	* 1.2831	* 1.3055	* 1.2756	* 1.1984 *
	* 1.4436	* 1.2157	* 1.2870	* 1.1737	* 1.3585	* 1.3114	* 1.3290	* 1.4006 *
9	* 1.4994	* 1.4180	* 1.3259	* 1.3334	* 1.4705	* 1.2916	* 1.4159	* 1.0464 *
	* 1.2157	* 1.2839	* 1.3793	* 1.3282	* 1.2016	* 1.3256	* 1.2085	* 1.6086 *
10	* 1.4009	* 1.3259	* 1.2156	* 1.4619	* 1.3527	* 1.4587	* 1.1781	* .8702 *
	* 1.2870	* 1.3800	* 1.4846	* 1.2380	* 1.3181	* 1.2380	* 1.5072	* 1.9403 *
11	* 1.5058	* 1.3334	* 1.4619	* 1.2113	* 1.4608	* 1.3998	* 1.4533	* .8397 *
	* 1.1737	* 1.3282	* 1.2388	* 1.4969	* 1.2325	* 1.2878	* 1.2363	* 2.1116 *
12	* 1.2831	* 1.4705	* 1.3516	* 1.4598	* 1.1792	* 1.4341	* 1.2263	*
	* 1.3585	* 1.2022	* 1.3197	* 1.2330	* 1.5021	* 1.2366	* 1.4532	*
13	* 1.3055	* 1.2927	* 1.4587	* 1.3987	* 1.4341	* 1.1599	* .8161	*
	* 1.3114	* 1.3248	* 1.2388	* 1.2884	* 1.2366	* 1.5135	* 2.1538	*
14	* 1.2756	* 1.4159	* 1.1781	* 1.4523	* 1.2252	* .8161	*	
	* 1.3290	* 1.2085	* 1.5061	* 1.2363	* 1.4540	* 2.1544	*	
15	* 1.1984	* 1.0464	* .8771	* .8386	* F-SUB-Q			
	* 1.4006	* 1.6074	* 1.9421	* 2.1138	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 84 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (X-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD. THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2863	* 1.5487	* 1.4394	* 1.5519	* 1.3163	* 1.3430	* 1.3205	* 1.2477
	* 1.4880	* 1.2408	* 1.3319	* 1.2100	* 1.4092	* 1.3533	* 1.3664	* 1.4302
9	* 1.5487	* 1.4587	* 1.3559	* 1.3677	* 1.5240	* 1.3323	* 1.4716	* 1.0828
	* 1.2408	* 1.3176	* 1.4158	* 1.3771	* 1.2340	* 1.3673	* 1.2351	* 1.6527
10	* 1.4394	* 1.3559	* 1.2381	* 1.5144	* 1.3998	* 1.5197	* 1.2209	* .9061
	* 1.3319	* 1.4158	* 1.5429	* 1.2579	* 1.3596	* 1.2485	* 1.5470	* 1.9980
11	* 1.5519	* 1.3677	* 1.5133	* 1.2466	* 1.5230	* 1.4566	* 1.5208	* .8707
	* 1.2100	* 1.3771	* 1.2587	* 1.5323	* 1.2429	* 1.3029	* 1.2393	* 2.1458
12	* 1.3163	* 1.5230	* 1.3987	* 1.5219	* 1.2252	* 1.5058	* 1.2820	*
	* 1.4092	* 1.2347	* 1.3616	* 1.2437	* 1.5324	* 1.2466	* 1.4673	*
13	* 1.3430	* 1.3334	* 1.5187	* 1.4555	* 1.5058	* 1.2113	* .8504	*
	* 1.3533	* 1.3664	* 1.2487	* 1.3037	* 1.2467	* 1.5383	* 2.1932	*
14	* 1.3205	* 1.4716	* 1.2209	* 1.5197	* 1.2809	* .8504	*	*
	* 1.3664	* 1.2354	* 1.5470	* 1.2399	* 1.4683	* 2.1937	*	*
15	* 1.2477	* 1.0839	* .9050	* .8697	* F-SUB-Q			
	* 1.4302	* 1.6514	* 1.9999	* 2.1480	* M-SUB-Q			

AT 100% POWER, 4 EFPD. THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3537	* 1.6376	* 1.5197	* 1.6418	* 1.3902	* 1.4212	* 1.4030	* 1.3302
	* 1.4982	* 1.2356	* 1.3297	* 1.2183	* 1.4243	* 1.3628	* 1.3733	* 1.4309
9	* 1.6376	* 1.5390	* 1.4276	* 1.4459	* 1.6183	* 1.4137	* 1.5679	* 1.1503
	* 1.2356	* 1.3153	* 1.4137	* 1.3836	* 1.2321	* 1.3750	* 1.2372	* 1.6624
10	* 1.5197	* 1.4276	* 1.3013	* 1.6076	* 1.4898	* 1.6183	* 1.3002	* .9596
	* 1.3297	* 1.4140	* 1.5486	* 1.2471	* 1.3418	* 1.2323	* 1.5280	* 2.0111
11	* 1.6418	* 1.4448	* 1.6065	* 1.3184	* 1.6258	* 1.5540	* 1.6700	* .9253
	* 1.2183	* 1.3836	* 1.2480	* 1.5204	* 1.2259	* 1.2815	* 1.2146	* 2.1237
12	* 1.3902	* 1.6172	* 1.4876	* 1.6247	* 1.3034	* 1.6119	* 1.3720	*
	* 1.4243	* 1.2328	* 1.3435	* 1.2266	* 1.5290	* 1.2308	* 1.4434	*
13	* 1.4212	* 1.4148	* 1.6183	* 1.5530	* 1.6119	* 1.2938	* .9050	*
	* 1.3628	* 1.3742	* 1.2330	* 1.2823	* 1.2308	* 1.5286	* 2.1797	*
14	* 1.4030	* 1.5679	* 1.2991	* 1.6279	* 1.3720	* .9050	*	*
	* 1.3733	* 1.2372	* 1.5280	* 1.2148	* 1.4444	* 2.1797	*	*
15	* 1.3302	* 1.1513	* .9585	* .9253	* F-SUB-Q			
	* 1.4309	* 1.6599	* 2.0130	* 2.1258	* M-SUB-Q			

Page 85 of 143

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

	H	G	F	E	D	C	B	A
8	1.3591	1.6665	1.5380	1.6772	1.4105	1.4469	1.4341	1.3655
	1.6588	1.3477	1.4555	1.3261	1.5719	1.5080	1.5143	1.5703
9	1.6665	1.5540	1.4405	1.4705	1.6665	1.4437	1.6151	1.1706
	1.3477	1.4475	1.5584	1.5108	1.3253	1.5141	1.3465	1.8367
10	1.5380	1.4394	1.3066	1.6526	1.5315	1.6729	1.3302	.9714
	1.4555	1.5584	1.7081	1.3414	1.4448	1.3162	1.6499	2.2176
11	1.6772	1.4705	1.6515	1.3398	1.6836	1.6001	1.6879	.9414
	1.3261	1.5118	1.3422	1.6622	1.3115	1.3787	1.2937	2.2980
12	1.4105	1.6654	1.5283	1.6825	1.3334	1.6718	1.4137	
	1.5719	1.3261	1.4469	1.3118	1.6570	1.3128	1.5525	
13	1.4469	1.4448	1.6718	1.5990	1.6718	1.3259	.9211	
	1.5080	1.5122	1.3177	1.3796	1.3128	1.6494	2.3625	
14	1.4341	1.6151	1.3302	1.6868	1.4126	.9211		
	1.5143	1.3465	1.6499	1.2945	1.5532	2.3625		
15	1.3655	1.1717	.9714	.9403	F-SUB-Q			
	1.5703	1.8352	2.2188	2.3005	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 86 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3762	* 1.6906	* 1.5647	* 1.7136	* 1.4373	* 1.4758	* 1.4630	* 1.3966 *
	* 1.6523	* 1.3405	* 1.4519	* 1.3225	* 1.5766	* 1.5330	* 1.5440	* 1.6142 *
9	* 1.6986	* 1.5797	* 1.4608	* 1.5005	* 1.7072	* 1.4737	* 1.6558	* 1.1952 *
	* 1.3405	* 1.4403	* 1.5539	* 1.5095	* 1.3249	* 1.5352	* 1.3658	* 1.8869 *
10	* 1.5647	* 1.4608	* 1.3248	* 1.6933	* 1.5701	* 1.7179	* 1.3612	* .9896 *
	* 1.4519	* 1.5539	* 1.7111	* 1.3380	* 1.4470	* 1.3192	* 1.6676	* 2.2826 *
11	* 1.7136	* 1.4994	* 1.6911	* 1.3645	* 1.7297	* 1.6418	* 1.7372	* .9596 *
	* 1.3225	* 1.5095	* 1.3388	* 1.6625	* 1.3160	* 1.3886	* 1.3097	* 2.3623 *
12	* 1.4373	* 1.7061	* 1.5679	* 1.7286	* 1.3634	* 1.7190	* 1.4501	*
	* 1.5766	* 1.3257	* 1.4499	* 1.3168	* 1.6714	* 1.3273	* 1.5708	*
13	* 1.4758	* 1.4748	* 1.7168	* 1.6408	* 1.7200	* 1.3559	* .9393	*
	* 1.5350	* 1.5341	* 1.3200	* 1.3895	* 1.3273	* 1.6831	* 2.4230	*
14	* 1.4630	* 1.6558	* 1.3612	* 1.7361	* 1.4401	* .9393	*	
	* 1.5440	* 1.3658	* 1.6676	* 1.3105	* 1.5720	* 2.4230	*	
15	* 1.3966	* 1.1963	* .9885	* .9585	* F-SUB-Q			
	* 1.6142	* 1.8853	* 2.2850	* 2.3648	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3345	* 1.6600	* 1.5230	* 1.6793	* 1.4009	* 1.4394	* 1.4298	* 1.3687 *
	* 1.6612	* 1.3347	* 1.4538	* 1.3113	* 1.5731	* 1.5341	* 1.5440	* 1.6022 *
9	* 1.6600	* 1.5347	* 1.4201	* 1.4641	* 1.6793	* 1.4394	* 1.6258	* 1.1863 *
	* 1.3347	* 1.4461	* 1.5595	* 1.5033	* 1.3105	* 1.5287	* 1.3513	* 1.8820 *
10	* 1.5230	* 1.4191	* 1.2863	* 1.6633	* 1.5401	* 1.6922	* 1.3323	* .9639 *
	* 1.4538	* 1.5595	* 1.7138	* 1.3241	* 1.4346	* 1.3026	* 1.6561	* 2.2898 *
11	* 1.6793	* 1.4641	* 1.6611	* 1.3302	* 1.7040	* 1.6108	* 1.7115	* .9361 *
	* 1.3113	* 1.5043	* 1.3257	* 1.6587	* 1.2995	* 1.3762	* 1.2925	* 2.3648 *
12	* 1.4009	* 1.6772	* 1.5369	* 1.7029	* 1.3334	* 1.6943	* 1.4223	*
	* 1.5731	* 1.3113	* 1.4374	* 1.3002	* 1.6612	* 1.3097	* 1.5595	*
13	* 1.4394	* 1.4405	* 1.6911	* 1.6097	* 1.6943	* 1.3259	* .9168	*
	* 1.5341	* 1.5276	* 1.3042	* 1.3771	* 1.3097	* 1.6779	* 2.4339	*
14	* 1.4298	* 1.6268	* 1.3323	* 1.7104	* 1.4212	* .9168	*	
	* 1.5440	* 1.3513	* 1.6574	* 1.2933	* 1.5595	* 2.4367	*	
15	* 1.3687	* 1.1674	* .9628	* .9350	* F-SUB-Q			
	* 1.6022	* 1.8804	* 2.2898	* 2.3674	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 87 of 143

TABLE 2 (CONTINUED)


F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3430	* 1.6783	* 1.5401	* 1.7040	* 1.4169	* 1.4575	* 1.4501	* 1.3923 *
	* 1.6058	* 1.2841	* 1.4012	* 1.2587	* 1.5159	* 1.4703	* 1.4739	* 1.5192 *
9	* 1.6783	* 1.5487	* 1.4319	* 1.4833	* 1.7061	* 1.4608	* 1.6536	* 1.1835 *
	* 1.2841	* 1.3957	* 1.5053	* 1.4461	* 1.2558	* 1.4643	* 1.2914	* 1.7895 *
10	* 1.5401	* 1.4319	* 1.2970	* 1.6890	* 1.5658	* 1.7222	* 1.3537	* .9746 *
	* 1.4012	* 1.5064	* 1.6561	* 1.2690	* 1.3727	* 1.2457	* 1.5858	* 2.1820 *
11	* 1.7040	* 1.4823	* 1.6868	* 1.3452	* 1.7350	* 1.6397	* 1.7468	* .9489 *
	* 1.2587	* 1.4470	* 1.2705	* 1.5963	* 1.2392	* 1.3144	* 1.2308	* 2.2631 *
12	* 1.4169	* 1.7050	* 1.5626	* 1.7339	* 1.3527	* 1.7275	* 1.4491	*
	* 1.5159	* 1.2565	* 1.3754	* 1.2400	* 1.5905	* 1.2471	* 1.4868	*
13	* 1.4576	* 1.4619	* 1.7211	* 1.6386	* 1.7275	* 1.3473	* .9296 *	
	* 1.4703	* 1.4633	* 1.2464	* 1.3152	* 1.2464	* 1.6034	* 2.3318 *	
14	* 1.4501	* 1.6547	* 1.3537	* 1.7457	* 1.4480	* .9286 *		
	* 1.4739	* 1.2910	* 1.5870	* 1.2315	* 1.4878	* 2.3343 *		
15	* 1.3923	* 1.1845	* .9746	* .9478	* F-SUB-Q			
	* 1.5192	* 1.7880	* 2.1842	* 2.2655	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3120	* 1.6504	* 1.5112	* 1.6783	* 1.3912	* 1.4319	* 1.4266	* 1.3730 *
	* 1.5895	* 1.2531	* 1.3628	* 1.2176	* 1.4681	* 1.4204	* 1.4228	* 1.4628 *
9	* 1.6504	* 1.5176	* 1.4019	* 1.4576	* 1.6847	* 1.4373	* 1.6333	* 1.1631 *
	* 1.2531	* 1.3688	* 1.4693	* 1.4029	* 1.2134	* 1.4124	* 1.2412	* 1.7295 *
10	* 1.5112	* 1.4019	* 1.2691	* 1.6665	* 1.5444	* 1.7029	* 1.3334	* .9564 *
	* 1.3628	* 1.4693	* 1.6118	* 1.2304	* 1.3328	* 1.2038	* 1.5357	* 2.1130 *
11	* 1.6783	* 1.4566	* 1.6643	* 1.3205	* 1.7157	* 1.6172	* 1.7286	* .9318 *
	* 1.2176	* 1.4038	* 1.2318	* 1.5576	* 1.2064	* 1.2780	* 1.1879	* 2.1837 *
12	* 1.3912	* 1.6825	* 1.5412	* 1.7147	* 1.3302	* 1.7093	* 1.4298	*
	* 1.4681	* 1.2145	* 1.3356	* 1.2071	* 1.5624	* 1.2153	* 1.4434	*
13	* 1.4319	* 1.4384	* 1.7007	* 1.6161	* 1.7093	* 1.3270	* .9125 *	
	* 1.4204	* 1.4115	* 1.2049	* 1.2788	* 1.2153	* 1.5688	* 2.2667 *	
14	* 1.4266	* 1.6333	* 1.3323	* 1.7286	* 1.4298	* .9125 *		
	* 1.4228	* 1.2409	* 1.5368	* 1.1886	* 1.4444	* 2.2667 *		
15	* 1.3730	* 1.1642	* .9553	* .9307	* F-SUB-Q			
	* 1.4628	* 1.7281	* 2.1151	* 2.1859	* M-SUB-Q			

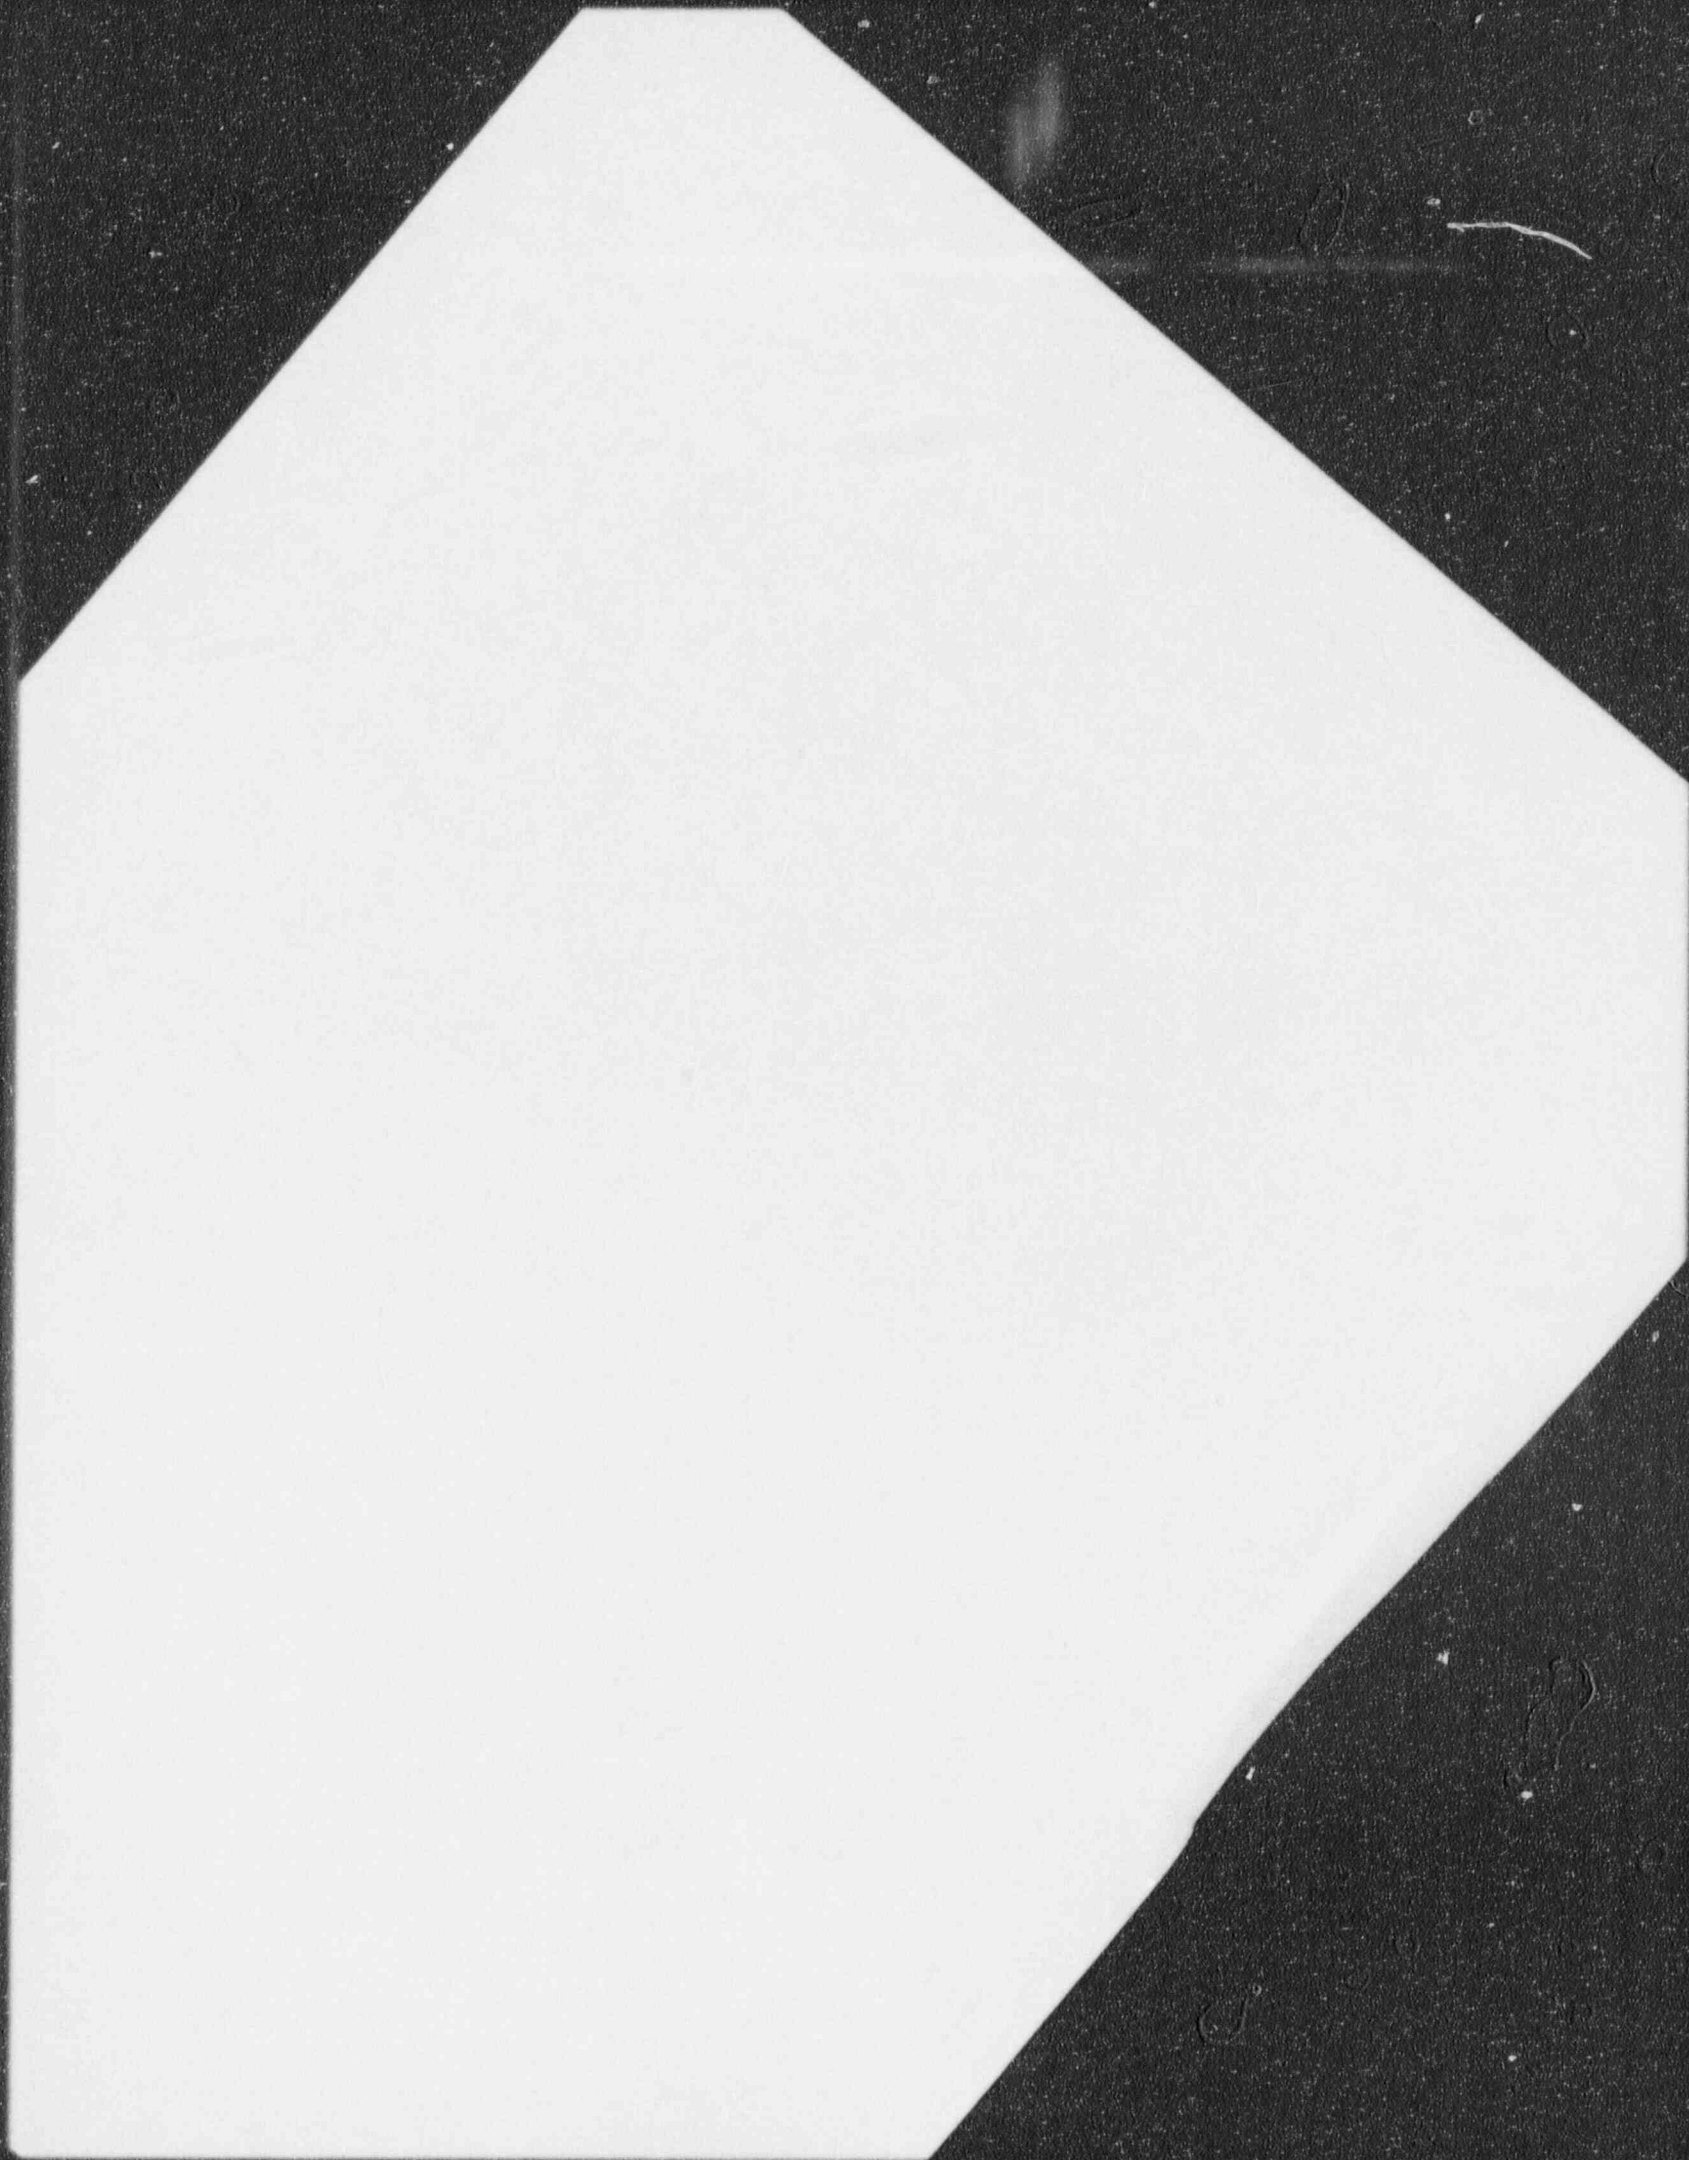

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 88 of 145

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.2488	1.5819	1.4437	1.6129	1.3291	1.3687	1.3645	1.3163
9	1.5743	1.2387	1.3542	1.2039	1.4602	1.4145	1.4154	1.4525
10	1.5819	1.4480	1.3366	1.3944	1.6204	1.3741	1.5690	1.1106
11	1.2387	1.3586	1.4616	1.3920	1.1975	1.4044	1.2283	1.7240
12	1.4437	1.3366	1.2092	1.6022	1.4823	1.6397	1.2756	.9114
13	1.3542	1.4616	1.6057	1.2134	1.3167	1.1859	1.5217	2.1080
14	1.6129	1.3934	1.6001	1.2606	1.6526	1.5530	1.6633	.8889
15	1.2039	1.3928	1.2148	1.5454	1.1854	1.2612	1.1701	2.1740
16	1.3291	1.6194	1.4791	1.6515	1.2723	1.6451	1.3709	
17	1.4602	1.1985	1.3194	1.1860	1.5412	1.1924	1.4243	
18	1.3687	1.3752	1.6386	1.5519	1.6451	1.2702	.8707	
19	1.4145	1.4030	1.1870	1.2619	1.1924	1.5478	2.2484	
20	1.3645	1.5690	1.2756	1.6633	1.3698	.8707		
21	1.4154	1.2279	1.5217	1.1703	1.4252	2.2484		
22	1.3163	1.1117	.9114	.8879	F-SUB-Q			
23	1.4525	1.7226	2.1101	2.1762	M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.2252	1.5583	1.4212	1.5915	1.3088	1.3452	1.3430	1.2959
9	1.5135	1.1909	1.3026	1.1558	1.4056	1.3661	1.3662	1.4031
10	1.5583	1.4234	1.3141	1.3752	1.6001	1.3537	1.5465	1.0913
11	1.1909	1.3065	1.4079	1.3373	1.1488	1.3533	1.1822	1.6694
12	1.4212	1.3141	1.1888	1.5819	1.4541	1.6204	1.2574	.8943
13	1.3026	1.4079	1.5482	1.1640	1.2616	1.1374	1.4640	2.0439
14	1.5915	1.3741	1.5808	1.2413	1.6322	1.5326	1.6451	.8729
15	1.1558	1.3382	1.1653	1.4865	1.1347	1.2090	1.1206	2.1014
16	1.3088	1.5990	1.4608	1.6311	1.2520	1.6258	1.3527	
17	1.4056	1.1501	1.2642	1.1353	1.4784	1.1407	1.3666	
18	1.3452	1.3548	1.6183	1.5315	1.6258	1.2499	.8547	
19	1.3661	1.3525	1.1383	1.2097	1.1407	1.4866	2.1724	
20	1.3430	1.5465	1.2563	1.6440	1.3516	.8547		
21	1.3662	1.1822	1.4640	1.1209	1.3675	2.1724		
22	1.2959	1.0913	.8932	.8718	F-SUB-Q			
23	1.4031	1.6668	2.0467	2.1035	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 88 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2488	* 1.5819	* 1.4437	* 1.6129	* 1.3291	* 1.3657	* 1.3645	* 1.3163 *
	* 1.5743	* 1.2387	* 1.3542	* 1.2039	* 1.4602	* 1.4145	* 1.4154	* 1.4525 *
9	* 1.5819	* 1.4480	* 1.3366	* 1.3944	* 1.6204	* 1.3741	* 1.5690	* 1.1106 *
	* 1.2387	* 1.3586	* 1.4616	* 1.3920	* 1.1975	* 1.4044	* 1.3283	* 1.7240 *
10	* 1.4437	* 1.3366	* 1.2092	* 1.6022	* 1.4823	* 1.6397	* 1.2756	* .9114 *
	* 1.3542	* 1.4616	* 1.6057	* 1.2134	* 1.3167	* 1.1859	* 1.5217	* 2.1080 *
11	* 1.6129	* 1.3934	* 1.6001	* 1.2606	* 1.6526	* 1.5530	* 1.6633	* .8889 *
	* 1.2039	* 1.3928	* 1.2148	* 1.5454	* 1.1854	* 1.2612	* 1.1701	* 2.1740 *
12	* 1.3291	* 1.6194	* 1.4791	* 1.6515	* 1.2723	* 1.6451	* 1.3709	* .8707 *
	* 1.4602	* 1.1985	* 1.3194	* 1.1860	* 1.5412	* 1.1924	* 1.4243	* .8707 *
13	* 1.3687	* 1.3752	* 1.6386	* 1.5519	* 1.6451	* 1.2702	* .8707	* 2.2484 *
	* 1.4145	* 1.4030	* 1.1870	* 1.2619	* 1.1924	* 1.5478	* 2.2484	* .8707 *
14	* 1.3645	* 1.5690	* 1.2750	* 1.6633	* 1.3698	* .8707	* 2.2484	* .8707 *
	* 1.4154	* 1.2279	* 1.5217	* 1.1703	* 1.4252	* 2.2484	* .8707	* .8707 *
15	* 1.3163	* 1.1117	* .9114	* .8879	* F-SUB-Q			
	* 1.4525	* 1.7226	* 2.1101	* 2.1762	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2252	* 1.5583	* 1.4212	* 1.5915	* 1.3088	* 1.3452	* 1.3430	* 1.2959 *
	* 1.5156	* 1.1909	* 1.3026	* 1.1558	* 1.4056	* 1.3661	* 1.3662	* 1.4031 *
9	* 1.5583	* 1.4234	* 1.3141	* 1.3752	* 1.6001	* 1.3537	* 1.5465	* 1.0913 *
	* 1.1909	* 1.3065	* 1.4079	* 1.3373	* 1.1488	* 1.3533	* 1.1822	* 1.6694 *
10	* 1.4212	* 1.3141	* 1.1888	* 1.5819	* 1.4641	* 1.6204	* 1.2574	* .8943 *
	* 1.3026	* 1.4079	* 1.5482	* 1.1640	* 1.2616	* 1.1374	* 1.4640	* 2.0439 *
11	* 1.5915	* 1.3741	* 1.5808	* 1.2413	* 1.6322	* 1.5326	* 1.6451	* .8729 *
	* 1.1558	* 1.3382	* 1.1653	* 1.4865	* 1.1347	* 1.2090	* 1.1206	* 2.1014 *
12	* 1.3088	* 1.5990	* 1.4608	* 1.6311	* 1.2520	* 1.6258	* 1.3527	* .8547 *
	* 1.4056	* 1.1501	* 1.2642	* 1.1353	* 1.4784	* 1.1407	* 1.3666	* .8547 *
13	* 1.3452	* 1.3548	* 1.6183	* 1.5315	* 1.6258	* 1.2499	* .8547	* 2.1724 *
	* 1.3661	* 1.3525	* 1.1383	* 1.2097	* 1.1407	* 1.4866	* 2.1724	* .8547 *
14	* 1.3430	* 1.5465	* 1.2563	* 1.6440	* 1.3516	* .8547	* 2.1724	* .8547 *
	* 1.3662	* 1.1822	* 1.4640	* 1.1309	* 1.3675	* 2.1724	* .8547	* .8547 *
15	* 1.2959	* 1.0913	* .8932	* .8718	* F-SUB-Q			
	* 1.4031	* 1.6668	* 2.0467	* 2.1035	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 89 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1395	* 1.4576	* 1.3270	* 1.4930	* 1.2220	* 1.2499	* 1.2456	* 1.2017
	* 1.5491	* 1.2096	* 1.3280	* 1.1732	* 1.4354	* 1.4028	* 1.4052	* 1.4438
9	* 1.4576	* 1.3270	* 1.2263	* 1.2863	* 1.5015	* 1.2584	* 1.4416	* 1.0089
	* 1.2096	* 1.3325	* 1.4367	* 1.3607	* 1.1654	* 1.3875	* 1.2088	* 1.7219
10	* 1.3270	* 1.2263	* 1.1085	* 1.4855	* 1.3698	* 1.5187	* 1.1685	* .8268
	* 1.3280	* 1.4377	* 1.5816	* 1.1791	* 1.2816	* 1.1539	* 1.4973	* 2.1088
11	* 1.4930	* 1.2863	* 1.4833	* 1.1578	* 1.5283	* 1.4309	* 1.5337	* .8065
	* 1.1732	* 1.3615	* 1.1804	* 1.5145	* 1.1502	* 1.2301	* 1.1414	* 2.1660
12	* 1.2220	* 1.5005	* 1.3677	* 1.5272	* 1.1642	* 1.5176	* 1.2574	*
	* 1.4354	* 1.1663	* 1.2843	* 1.1508	* 1.5087	* 1.1589	* 1.3961	*
13	* 1.2499	* 1.2595	* 1.5165	* 1.4298	* 1.5176	* 1.1588	* .7904	*
	* 1.4028	* 1.3862	* 1.1548	* 1.2312	* 1.1585	* 1.5210	* 2.2333	*
14	* 1.2456	* 1.4416	* 1.1685	* 1.5337	* 1.2563	* .7893	*	*
	* 1.4052	* 1.2088	* 1.4583	* 1.1420	* 1.3970	* 2.2333	*	*
15	* 1.2017	* 1.0100	* .8257	* .8054	* F-SUB-Q			
	* 1.4438	* 1.7206	* 2.1120	* 2.1682	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0753	* 1.3741	* 1.2552	* 1.4126	* 1.1599	* 1.1706	* 1.1610	* 1.1085
	* 1.5764	* 1.2325	* 1.3504	* 1.1907	* 1.4538	* 1.4418	* 1.4520	* 1.5058
9	* 1.3741	* 1.2531	* 1.1599	* 1.2252	* 1.4223	* 1.1802	* 1.3452	* .9350
	* 1.2325	* 1.3563	* 1.4611	* 1.3733	* 1.1809	* 1.4227	* 1.2458	* 1.7892
10	* 1.2552	* 1.1588	* 1.0528	* 1.4105	* 1.3023	* 1.4330	* 1.0946	* .7679
	* 1.3504	* 1.4611	* 1.6005	* 1.1924	* 1.2951	* 1.1733	* 1.5352	* 2.1873
11	* 1.4126	* 1.2242	* 1.4084	* 1.1021	* 1.4394	* 1.3484	* 1.4287	* .7454
	* 1.1907	* 1.3738	* 1.1937	* 1.5285	* 1.1707	* 1.2526	* 1.1759	* 2.2536
12	* 1.1599	* 1.4212	* 1.2991	* 1.4384	* 1.0956	* 1.4180	* 1.1706	*
	* 1.4538	* 1.1819	* 1.2974	* 1.1717	* 1.5378	* 1.1881	* 1.4380	*
13	* 1.1706	* 1.1813	* 1.4319	* 1.3473	* 1.4180	* 1.0785	* .7326	*
	* 1.4418	* 1.4218	* 1.1743	* 1.2537	* 1.1879	* 1.5653	* 2.3141	*
14	* 1.1610	* 1.3452	* 1.0946	* 1.4276	* 1.1695	* .7315	*	*
	* 1.4520	* 1.2451	* 1.5352	* 1.1765	* 1.4395	* 2.3152	*	*
15	* 1.1085	* .9361	* .7679	* .7443	* F-SUB-Q			
	* 1.5058	* 1.7877	* 2.1895	* 2.2560	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 90 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 100% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .9532	* 1.1963	* 1.0903	* 1.2466	* 1.0303	* 1.0110	* .9821	* .9071
	* 1.7283	* 1.3731	* 1.5111	* 1.3105	* 1.5873	* 1.6250	* 1.6697	* 1.7897

9	* 1.1963	* 1.0924	* 1.0100	* 1.0913	* 1.2509	* 1.0357	* 1.1363	* .7840
	* 1.3731	* 1.5105	* 1.6317	* 1.4964	* 1.3031	* 1.5752	* 1.4316	* 2.0766

10	* 1.0903	* 1.0100	* .9393	* 1.2445	* 1.1545	* 1.2509	* .9468	* .6501
	* 1.5111	* 1.6322	* 1.7438	* 1.3102	* 1.4164	* 1.3028	* 1.7238	* 2.5131

11	* 1.2466	* 1.0913	* 1.2434	* .9896	* 1.2616	* 1.1685	* 1.1845	* .6169
	* 1.3105	* 1.4975	* 1.3118	* 1.6492	* 1.2933	* 1.4022	* 1.3750	* 2.6473

12	* 1.0303	* 1.2499	* 1.1524	* 1.2606	* .9639	* 1.2017	* .9789	*
	* 1.5873	* 1.3039	* 1.4188	* 1.2949	* 1.6966	* 1.3590	* 1.6692	*

13	* 1.0110	* 1.0357	* 1.2499	* 1.1674	* 1.2017	* .9211	* .6169	*
	* 1.6250	* 1.5752	* 1.3039	* 1.4031	* 1.3590	* 1.7771	* 2.6683	*

14	* .9821	* 1.1363	* .9457	* 1.1835	* .9778	* .6158	*	*
	* 1.6697	* 1.4307	* 1.7238	* 1.3750	* 1.6704	* 2.6702	*	*

15	* .9071	* .7840	* .6501	* .6169	* F-SUB-Q			
	* 1.7897	* 2.0754	* 2.5160	* 2.6487	* M-SUB-Q			

AT 100% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* .6362	* .8011	* .6887	* .8279	* .6854	* .6383	* .6008	* .5194
	* 2.5435	* 2.0074	* 2.3471	* 1.9302	* 2.3370	* 2.5274	* 2.6796	* 3.0645

9	* .8011	* .6983	* .6447	* .7251	* .8504	* .6779	* .7015	* .4712
	* 2.0074	* 2.3192	* 2.5124	* 2.2055	* 1.8758	* 2.3640	* 2.2685	* 3.3921

10	* .6887	* .6437	* .6287	* .8439	* .7604	* .8418	* .6019	* .3995
	* 2.3471	* 2.5140	* 2.5542	* 1.8889	* 2.1107	* 1.8948	* 2.6552	* 4.0141

11	* .8279	* .7251	* .8439	* .6726	* .8547	* .7401	* .6908	* .3663
	* 1.9302	* 2.2068	* 1.8905	* 2.3769	* 1.8661	* 2.1680	* 2.3085	* 4.3804

12	* .6854	* .8493	* .7593	* .8536	* .6437	* .7540	* .5805	*
	* 2.3370	* 1.8765	* 2.1127	* 1.8677	* 2.4880	* 2.1180	* 2.7571	*

13	* .6383	* .6779	* .8407	* .7401	* .7540	* .5741	* .5759	*
	* 2.5274	* 2.3640	* 1.8964	* 2.1702	* 2.1180	* 2.7926	* 4.2851	*

14	* .6008	* .7015	* .6019	* .6908	* .5805	* .3759	*	*
	* 2.6796	* 2.2685	* 2.6552	* 2.3085	* 2.7606	* 4.2888	*	*

15	* .5194	* .4712	* .3995	* .3663	* F-SUB-Q			
	* 3.0645	* 3.3921	* 4.0173	* 4.3854	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 91 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPL, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .6126 *	* .8290 *	* .7893 *	* .9093 *	* .7925 *	* .7465 *	* .6865 *	* .5762 *
	* 2.4482 *	* 2.1011 *	* 2.1889 *	* 1.8845 *	* 2.1599 *	* 2.2622 *	* 2.4387 *	* 2.8816 *
9	* .8290 *	* .7486 *	* .7636 *	* .8204 *	* .9071 *	* .7679 *	* .7658 *	* .5387 *
	* 2.1011 *	* 2.3222 *	* 2.2632 *	* 2.0938 *	* 1.8902 *	* 2.2150 *	* 2.1930 *	* 3.0801 *
10	* .7893 *	* .7626 *	* .7465 *	* .8964 *	* .8236 *	* .8557 *	* .6779 *	* .4670 *
	* 2.1889 *	* 2.2656 *	* 2.3151 *	* 1.9242 *	* 2.0905 *	* 2.0009 *	* 2.4985 *	* 3.5782 *
11	* .9093 *	* .8204 *	* .8954 *	* .7315 *	* .8182 *	* .7294 *	* .6844 *	* .4134 *
	* 1.8845 *	* 2.0938 *	* 1.9256 *	* 2.3711 *	* 2.1291 *	* 2.3790 *	* 2.5153 *	* 4.0969 *
12	* .7925 *	* .9071 *	* .8225 *	* .8182 *	* .5805 *	* .6330 *	* .5612 *	
	* 2.1599 *	* 1.8913 *	* 2.0921 *	* 2.1295 *	* 2.5658 *	* 2.3831 *	* 3.0207 *	
13	* .7465 *	* .7679 *	* .8557 *	* .7294 *	* .6330 *	* .4969 *	* .3727 *	
	* 2.2622 *	* 2.2150 *	* 2.0020 *	* 2.3806 *	* 2.3831 *	* 2.8982 *	* 4.3254 *	
14	* .6865 *	* .7658 *	* .6779 *	* .6844 *	* .5612 *	* .3716 *		
	* 2.4387 *	* 2.1925 *	* 2.4985 *	* 2.5153 *	* 3.0242 *	* 4.3281 *		
15	* .5762 *	* .5387 *	* .4670 *	* .4134 *	F-SUB-Q			
	* 2.8816 *	* 3.0801 *	* 3.5782 *	* 4.0969 *	M-SUB-Q			

AT 75% POWER, 4 EFPL, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8975 *	* 1.1867 *	* 1.1706 *	* 1.2627 *	* 1.1149 *	* 1.1063 *	* 1.0485 *	* .9371 *
	* 1.8266 *	* 1.5813 *	* 1.5613 *	* 1.4327 *	* 1.6135 *	* 1.6080 *	* 1.6807 *	* 1.8634 *
9	* 1.1867 *	* 1.1245 *	* 1.1106 *	* 1.1578 *	* 1.2359 *	* 1.0935 *	* 1.1503 *	* .8397 *
	* 1.5813 *	* 1.6602 *	* 1.6524 *	* 1.5672 *	* 1.4637 *	* 1.6276 *	* 1.5423 *	* 2.0822 *
10	* 1.1706 *	* 1.1106 *	* 1.0485 *	* 1.2156 *	* 1.1610 *	* 1.1899 *	* .9757 *	* .7101 *
	* 1.5613 *	* 1.6544 *	* 1.7419 *	* 1.5017 *	* 1.5665 *	* 1.5346 *	* 1.8333 *	* 2.4803 *
11	* 1.2627 *	* 1.1567 *	* 1.2145 *	* 1.0207 *	* 1.1588 *	* 1.1021 *	* 1.1128 *	* .6480 *
	* 1.4327 *	* 1.5675 *	* 1.5027 *	* 1.8108 *	* 1.6108 *	* 1.6853 *	* 1.6417 *	* 2.7646 *
12	* 1.1149 *	* 1.2359 *	* 1.1610 *	* 1.1588 *	* .8461 *	* 1.0228 *	* .9093 *	
	* 1.6135 *	* 1.4637 *	* 1.5684 *	* 1.6118 *	* 1.9096 *	* 1.6796 *	* 2.0009 *	
13	* 1.1063 *	* 1.0946 *	* 1.1899 *	* 1.1021 *	* 1.0228 *	* .8054 *	* .5923 *	
	* 1.6080 *	* 1.6267 *	* 1.5355 *	* 1.6864 *	* 1.6796 *	* 2.0149 *	* 2.9437 *	
14	* 1.0485 *	* 1.1503 *	* .9757 *	* 1.1117 *	* .9093 *	* .5923 *		
	* 1.6807 *	* 1.5421 *	* 1.8333 *	* 1.6417 *	* 2.0018 *	* 2.9457 *		
15	* .9371 *	* .8397 *	* .7101 *	* .6469 *	F-SUB-Q			
	* 1.8634 *	* 2.0805 *	* 2.4825 *	* 2.7654 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 92 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.1299	* 1.4330	* 1.3709	* 1.4769	* 1.2734	* 1.2906	* 1.2488	* 1.1524 *
	* 1.6918	* 1.4337	* 1.4290	* 1.3047	* 1.5013	* 1.4640	* 1.4975	* 1.6067 *

9	* 1.4330	* 1.3452	* 1.2938	* 1.3216	* 1.4437	* 1.2745	* 1.3816	* 1.0089 *
	* 1.4337	* 1.5084	* 1.5350	* 1.4641	* 1.3359	* 1.4789	* 1.3638	* 1.8384 *

10	* 1.3709	* 1.2938	* 1.1963	* 1.4266	* 1.3334	* 1.4159	* 1.1363	* .8429 *
	* 1.4290	* 1.5358	* 1.6402	* 1.3774	* 1.4584	* 1.3824	* 1.6829	* 2.2203 *

11	* 1.4769	* 1.3216	* 1.4255	* 1.1717	* 1.3977	* 1.3366	* 1.3827	* .7893 *
	* 1.3047	* 1.4649	* 1.3781	* 1.7112	* 1.4541	* 1.5139	* 1.4165	* 2.4296 *

12	* 1.2734	* 1.4426	* 1.3323	* 1.3966	* 1.0753	* 1.3184	* 1.1428	*
	* 1.5013	* 1.3364	* 1.4599	* 1.4549	* 1.7595	* 1.4662	* 1.7376	*

13	* 1.2906	* 1.2756	* 1.4148	* 1.3355	* 1.3173	* 1.0485	* .7422	*
	* 1.4640	* 1.4781	* 1.3831	* 1.5148	* 1.4662	* 1.7944	* 2.5968	*

14	* 1.2488	* 1.3827	* 1.1353	* 1.3827	* 1.1417	* .7422	*	*
	* 1.4975	* 1.3633	* 1.6819	* 1.4173	* 1.7387	* 2.5793	*	*

15	* 1.1524	* 1.0100	* .8429	* .7893	* F-SUB-Q			
	* 1.6067	* 1.8372	* 2.2208	* 2.4317	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.3173	* 1.5969	* 1.4951	* 1.6183	* 1.3773	* 1.4019	* 1.3730	* 1.2852 *
	* 1.6778	* 1.4013	* 1.4168	* 1.2799	* 1.4884	* 1.4366	* 1.4565	* 1.5407 *

9	* 1.5969	* 1.5037	* 1.4084	* 1.4309	* 1.5883	* 1.3912	* 1.5305	* 1.1149 *
	* 1.4013	* 1.4846	* 1.5393	* 1.4547	* 1.3077	* 1.4515	* 1.3180	* 1.7794 *

10	* 1.4951	* 1.4084	* 1.2884	* 1.5733	* 1.4533	* 1.5744	* 1.2595	* .9275 *
	* 1.4168	* 1.5402	* 1.6501	* 1.3516	* 1.4415	* 1.3383	* 1.6508	* 2.1620 *

11	* 1.6183	* 1.4298	* 1.5722	* 1.2884	* 1.5690	* 1.5015	* 1.5637	* .8825 *
	* 1.2799	* 1.4554	* 1.3529	* 1.7089	* 1.4025	* 1.4630	* 1.3509	* 2.3347 *

12	* 1.3773	* 1.5872	* 1.4523	* 1.5669	* 1.2488	* 1.5305	* 1.3034	*
	* 1.4884	* 1.3083	* 1.4430	* 1.4033	* 1.7233	* 1.4046	* 1.6675	*

13	* 1.4019	* 1.3923	* 1.5733	* 1.5005	* 1.5305	* 1.2209	* .8482	*
	* 1.4366	* 1.4505	* 1.3393	* 1.4638	* 1.4046	* 1.7394	* 2.5135	*

14	* 1.3730	* 1.5305	* 1.2595	* 1.5626	* 1.3023	* .8482	*	*
	* 1.4565	* 1.3174	* 1.6494	* 1.3512	* 1.6681	* 2.5135	*	*

15	* 1.2852	* 1.1160	* .9264	* .8814	* F-SUB-Q			
	* 1.5407	* 1.7783	* 2.1637	* 2.3256	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 93 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3548	* 1.6493	* 1.5272	* 1.6600	* 1.4030	* 1.4298	* 1.4084	* 1.3259 *
	* 1.7735	* 1.4634	* 1.5054	* 1.3468	* 1.5776	* 1.5080	* 1.5225	* 1.5991 *
9	* 1.6493	* 1.5465	* 1.4351	* 1.4587	* 1.6365	* 1.4234	* 1.5787	* 1.1449 *
	* 1.4634	* 1.5613	* 1.6467	* 1.5442	* 1.3715	* 1.5233	* 1.3694	* 1.8576 *
10	* 1.5272	* 1.4341	* 1.3045	* 1.6236	* 1.5005	* 1.6333	* 1.3013	* .9500 *
	* 1.5054	* 1.6477	* 1.7622	* 1.4220	* 1.5231	* 1.4020	* 1.7384	* 2.2662 *
11	* 1.6600	* 1.4587	* 1.6226	* 1.3238	* 1.6354	* 1.5615	* 1.5322	* .9114 *
	* 1.3468	* 1.5446	* 1.4230	* 1.8125	* 1.4469	* 1.5201	* 1.4146	* 2.4628 *
12	* 1.4030	* 1.6365	* 1.4983	* 1.6343	* 1.3034	* 1.6129	* 1.3634	*
	* 1.5776	* 1.3722	* 1.5251	* 1.4477	* 1.8023	* 1.4490	* 1.7237	*
13	* 1.4298	* 1.4244	* 1.6322	* 1.5615	* 1.6129	* 1.2820	* .8879	*
	* 1.5080	* 1.5221	* 1.4030	* 1.5209	* 1.4490	* 1.8127	* 2.6176	*
14	* 1.4084	* 1.5797	* 1.3013	* 1.6311	* 1.3623	* .8879	*	*
	* 1.5225	* 1.3694	* 1.7367	* 1.4153	* 1.7248	* 2.6176	*	*
15	* 1.3259	* 1.1460	* .9500	* .9114	* F-SUB-Q			
	* 1.5991	* 1.8558	* 2.2680	* 2.4650	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4159	* 1.7307	* 1.5990	* 1.7414	* 1.4673	* 1.4994	* 1.4801	* 1.3977 *
	* 1.8364	* 1.4985	* 1.5851	* 1.4085	* 1.6552	* 1.5699	* 1.5785	* 1.6470 *
9	* 1.7307	* 1.6204	* 1.4973	* 1.5272	* 1.7243	* 1.4940	* 1.6654	* 1.2038 *
	* 1.4985	* 1.6027	* 1.7314	* 1.6217	* 1.4320	* 1.5855	* 1.4181	* 1.9222 *
10	* 1.5990	* 1.4973	* 1.3580	* 1.7104	* 1.5851	* 1.7275	* 1.3741	* .9982 *
	* 1.5851	* 1.7314	* 1.8609	* 1.4893	* 1.5935	* 1.4621	* 1.8134	* 2.3588 *
11	* 1.7414	* 1.5272	* 1.7093	* 1.3891	* 1.7361	* 1.6558	* 1.7361	* .9628 *
	* 1.4085	* 1.6221	* 1.4905	* 1.8476	* 1.4663	* 1.5369	* 1.4539	* 2.5727 *
12	* 1.4673	* 1.7232	* 1.5819	* 1.7350	* 1.3794	* 1.7200	* 1.4501	*
	* 1.6552	* 1.4330	* 1.5953	* 1.4671	* 1.8449	* 1.4711	* 1.7430	*
13	* 1.4994	* 1.4951	* 1.7265	* 1.6547	* 1.7200	* 1.3612	* .9414	*
	* 1.5699	* 1.5846	* 1.4636	* 1.5377	* 1.4711	* 1.8537	* 2.6706	*
14	* 1.4801	* 1.6665	* 1.3741	* 1.7361	* 1.4491	* .9414	*	*
	* 1.5785	* 1.4178	* 1.8123	* 1.4547	* 1.7441	* 2.6718	*	*
15	* 1.3977	* 1.2049	* .9971	* .9618	* F-SUB-Q			
	* 1.6470	* 1.9202	* 2.3616	* 2.5750	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 94 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4148	* 1.7393	* 1.6022	* 1.7522	* 1.4705	* 1.5058	* 1.4887	* 1.4105 *
	* 1.9753	* 1.6035	* 1.7369	* 1.5416	* 1.8185	* 1.7157	* 1.7198	* 1.7849 *
9	* 1.7393	* 1.6215	* 1.4973	* 1.5337	* 1.7414	* 1.5015	* 1.6825	* 1.2102 *
	* 1.6035	* 1.7207	* 1.8612	* 1.7817	* 1.5637	* 1.7316	* 1.5408	* 2.0917 *
10	* 1.6022	* 1.4962	* 1.3570	* 1.7265	* 1.6001	* 1.7500	* 1.3869	* 1.0025 *
	* 1.7369	* 1.8617	* 2.0436	* 1.5980	* 1.7163	* 1.5665	* 1.9674	* 2.5756 *
11	* 1.7522	* 1.5326	* 1.7254	* 1.3944	* 1.7618	* 1.6750	* 1.7629	* .9703 *
	* 1.5416	* 1.7828	* 1.5993	* 1.9757	* 1.5513	* 1.6321	* 1.5388	* 2.7753 *
12	* 1.4705	* 1.7404	* 1.5979	* 1.7607	* 1.3923	* 1.7468	* 1.4694	*
	* 1.8185	* 1.5645	* 1.7194	* 1.5522	* 1.9627	* 1.5537	* 1.8451	*
13	* 1.5058	* 1.5026	* 1.7489	* 1.6740	* 1.7468	* 1.3762	* .9510	*
	* 1.7157	* 1.7306	* 1.5674	* 1.6331	* 1.5537	* 1.9624	* 2.8318	*
14	* 1.4887	* 1.6825	* 1.3859	* 1.7618	* 1.4683	* .9500	*	*
	* 1.7198	* 1.5404	* 1.9674	* 1.5392	* 1.8463	* 2.8318	*	*
15	* 1.4105	* 1.2113	* 1.0014	* .9693	* F-SUB-Q			
	* 1.7849	* 2.0895	* 2.5779	* 2.7780	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3859	* 1.7147	* 1.5744	* 1.7307	* 1.4480	* 1.4833	* 1.4694	* 1.3966 *
	* 2.1685	* 1.7477	* 1.8937	* 1.7101	* 2.0325	* 1.9405	* 1.9106	* 1.9724 *
9	* 1.7147	* 1.5926	* 1.4694	* 1.5112	* 1.7265	* 1.4823	* 1.6675	* 1.1952 *
	* 1.7477	* 1.8846	* 2.0351	* 1.9580	* 1.7042	* 1.9271	* 1.7053	* 2.3200 *
10	* 1.5744	* 1.4683	* 1.3313	* 1.7115	* 1.5851	* 1.7382	* 1.3720	* .9875 *
	* 1.8937	* 2.0365	* 2.2282	* 1.7265	* 1.8588	* 1.6874	* 2.1286	* 2.8637 *
11	* 1.7307	* 1.5101	* 1.7104	* 1.3741	* 1.7511	* 1.6600	* 1.7522	* .9575 *
	* 1.7101	* 1.9593	* 1.7276	* 2.1544	* 1.6767	* 1.7698	* 1.6586	* 3.0021 *
12	* 1.4480	* 1.7254	* 1.5829	* 1.7500	* 1.3762	* 1.7382	* 1.4576	*
	* 2.0325	* 1.7052	* 1.8624	* 1.6777	* 2.1334	* 1.6785	* 1.9988	*
13	* 1.4833	* 1.4833	* 1.7372	* 1.6590	* 1.7382	* 1.3623	* .9393	*
	* 1.9105	* 1.9252	* 1.6894	* 1.7708	* 1.6785	* 2.1284	* 3.0751	*
14	* 1.4694	* 1.6675	* 1.3709	* 1.7511	* 1.4566	* .9393	*	*
	* 1.9106	* 1.7053	* 2.1286	* 1.6586	* 2.0002	* 3.0751	*	*
15	* 1.3966	* 1.1952	* .9864	* .9564	* F-SUB-Q			
	* 1.9724	* 2.3181	* 2.8666	* 3.0052	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 95 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3837	* 1.7200	* 1.5776	* 1.7425	* 1.4523	* 1.4898	* 1.4780	* 1.4094 *
	* 2.1798	* 1.7505	* 1.9077	* 1.7151	* 2.0616	* 2.0099	* 2.0254	* 2.1159 *
9	* 1.7200	* 1.5936	* 1.4694	* 1.5187	* 1.7414	* 1.4908	* 1.6825	* 1.2027 *
	* 1.7505	* 1.8927	* 2.0499	* 1.9688	* 1.7141	* 2.0071	* 1.7752	* 2.4856 *
10	* 1.5776	* 1.4694	* 1.3323	* 1.7254	* 1.6001	* 1.7564	* 1.3827	* .9917 *
	* 1.9077	* 2.0499	* 2.2494	* 1.7316	* 1.8743	* 1.7020	* 2.1700	* 3.0244 *
11	* 1.7425	* 1.5176	* 1.7232	* 1.3805	* 1.7704	* 1.6750	* 1.7746	* .9639 *
	* 1.7151	* 1.9702	* 1.7337	* 2.1716	* 1.6960	* 1.7951	* 1.6920	* 3.1258 *
12	* 1.4523	* 1.7404	* 1.5969	* 1.7693	* 1.3859	* 1.7586	* 1.4737	*
	* 2.0616	* 1.7151	* 1.8779	* 1.6970	* 2.1716	* 1.7121	* 2.0455	*
13	* 1.4898	* 1.4930	* 1.7543	* 1.6740	* 1.7586	* 1.3741	* .9457	*
	* 2.0099	* 2.0043	* 1.7040	* 1.7973	* 1.7121	* 2.2014	* 3.2021	*
14	* 1.4780	* 1.6825	* 1.3827	* 1.7736	* 1.4726	* .9457	*	*
	* 2.0254	* 1.7741	* 2.1716	* 1.6930	* 2.0470	* 3.2021	*	*
15	* 1.4094	* 1.2038	* .9907	* .9628	F-SUB-Q			
	* 2.1159	* 2.4835	* 3.0275	* 3.1292	M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3227	* 1.6558	* 1.5144	* 1.6815	* 1.3955	* 1.4330	* 1.4234	* 1.3623 *
	* 2.2235	* 1.7719	* 1.9371	* 1.7316	* 2.0914	* 2.0369	* 2.0426	* 2.1113 *
9	* 1.6558	* 1.5262	* 1.4073	* 1.4608	* 1.6858	* 1.4362	* 1.6279	* 1.1578 *
	* 1.7719	* 1.9294	* 2.0854	* 1.9947	* 1.7264	* 2.0297	* 1.7873	* 2.4920 *
10	* 1.5144	* 1.4073	* 1.2766	* 1.6686	* 1.5455	* 1.7029	* 1.3334	* .9543 *
	* 1.9371	* 2.0869	* 2.2886	* 1.7452	* 1.8915	* 1.7121	* 2.1931	* 3.0726 *
11	* 1.6815	* 1.4598	* 1.6665	* 1.3270	* 1.7168	* 1.6194	* 1.7200	* .9275 *
	* 1.7316	* 1.9960	* 1.7473	* 2.2014	* 1.7050	* 1.8120	* 1.7010	* 3.1704 *
12	* 1.3955	* 1.6847	* 1.5422	* 1.7157	* 1.3355	* 1.7061	* 1.4244	*
	* 2.0914	* 1.7274	* 1.8952	* 1.7060	* 2.1964	* 1.7213	* 2.0630	*
13	* 1.4330	* 1.4373	* 1.7007	* 1.6183	* 1.7061	* 1.3259	* .9104	*
	* 2.0369	* 2.0283	* 1.7131	* 1.8131	* 1.7213	* 2.2252	* 3.2599	*
14	* 1.4234	* 1.6279	* 1.3334	* 1.7190	* 1.4234	* .9104	*	*
	* 2.0426	* 1.7873	* 2.1931	* 1.7020	* 2.0645	* 3.2599	*	*
15	* 1.3623	* 1.1588	* .9532	* .9264	F-SUB-Q			
	* 2.1113	* 2.4899	* 3.0759	* 3.1739	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 96 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3130	* 1.6504	* 1.5101	* 1.6815	* 1.2923	* 1.4309	* 1.4244	* 1.3666 *
	* 2.1749	* 1.7111	* 1.8503	* 1.6448	* 1.9769	* 1.8927	* 1.8927	* 1.9450 *
9	* 1.6504	* 1.5187	* 1.3998	* 1.4587	* 1.6879	* 1.4362	* 1.6322	* 1.1588 *
	* 1.7111	* 1.8731	* 2.0016	* 1.8964	* 1.6401	* 1.8902	* 1.6628	* 2.2996 *
10	* 1.5101	* 1.3998	* 1.2691	* 1.6708	* 1.5487	* 1.7082	* 1.3355	* .9521 *
	* 1.8503	* 2.0016	* 2.1864	* 1.6686	* 1.8108	* 1.6318	* 2.0884	* 2.8456 *
11	* 1.6815	* 1.4576	* 1.6686	* 1.3238	* 1.7222	* 1.6236	* 1.7307	* .9275 *
	* 1.6448	* 1.8977	* 1.6705	* 2.1206	* 1.6504	* 1.7420	* 1.6208	* 2.9837 *
12	* 1.3923	* 1.6868	* 1.5455	* 1.7211	* 1.3355	* 1.7136	* 1.4309	*
	* 1.9769	* 1.6411	* 1.8142	* 1.6514	* 2.1379	* 1.6686	* 1.9837	*
13	* 1.4309	* 1.4373	* 1.7061	* 1.6226	* 1.7147	* 1.3280	* .9104	*
	* 1.8927	* 1.8890	* 1.6336	* 1.7431	* 1.6686	* 2.1619	* 3.1394	*
14	* 1.4244	* 1.6322	* 1.3355	* 1.7297	* 1.4298	* .9104	*	*
	* 1.8927	* 1.6628	* 2.0884	* 1.6217	* 1.9851	* 3.1394	*	*
15	* 1.3666	* 1.1599	* .9510	* .9264	* F-SUB-Q			
	* 1.9450	* 2.2977	* 2.8484	* 2.9868	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2659	* 1.6001	* 1.4608	* 1.6343	* 1.3473	* 1.3869	* 1.3827	* 1.3291 *
	* 2.0484	* 1.5966	* 1.7192	* 1.5161	* 1.8280	* 1.7579	* 1.7569	* 1.8052 *
9	* 1.6001	* 1.4673	* 1.3527	* 1.4137	* 1.6440	* 1.3934	* 1.5894	* 1.1235 *
	* 1.5966	* 1.7515	* 1.8731	* 1.7569	* 1.5146	* 1.7505	* 1.5347	* 2.1395 *
10	* 1.4608	* 1.3516	* 1.2263	* 1.6258	* 1.5058	* 1.6643	* 1.2970	* .9221 *
	* 1.7192	* 1.8743	* 2.0397	* 1.5503	* 1.6881	* 1.5146	* 1.9489	* 2.6401 *
11	* 1.6343	* 1.4126	* 1.6236	* 1.2809	* 1.6793	* 1.5787	* 1.6879	* .8996 *
	* 1.5161	* 1.7579	* 1.5520	* 1.9851	* 1.5322	* 1.6217	* 1.5067	* 2.7825 *
12	* 1.3473	* 1.6418	* 1.5026	* 1.6783	* 1.2959	* 1.6718	* 1.3923	*
	* 1.8280	* 1.5161	* 1.6910	* 1.5339	* 2.0016	* 1.5495	* 1.8444	*
13	* 1.3869	* 1.3944	* 1.6633	* 1.5776	* 1.6718	* 1.2906	* .8825	*
	* 1.7579	* 1.7494	* 1.5161	* 1.6226	* 1.5495	* 2.0155	* 2.9263	*
14	* 1.3827	* 1.5894	* 1.2970	* 1.6879	* 1.3912	* .8825	*	*
	* 1.7569	* 1.5347	* 1.9489	* 1.5074	* 1.8455	* 2.9263	*	*
15	* 1.3291	* 1.1245	* .9211	* .8986	* F-SUB-Q			
	* 1.8052	* 2.1379	* 2.6425	* 2.7852	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 97 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.1899	* 1.5133	* 1.3773	* 1.5487	* 1.2713	* 1.3077	* 1.3045	* 1.2574 *
	* 1.9307	* 1.5035	* 1.6336	* 1.4420	* 1.7505	* 1.6910	* 1.6900	* 1.7357 *

9	* 1.5133	* 1.3816	* 1.2734	* 1.3355	* 1.5594	* 1.3152	* 1.5058	* 1.0592 *
	* 1.5035	* 1.6552	* 1.7730	* 1.5734	* 1.4355	* 1.6792	* 1.4669	* 2.0630 *

10	* 1.3773	* 1.2723	* 1.1545	* 1.5422	* 1.4255	* 1.5808	* 1.2252	* .8686 *
	* 1.6336	* 1.7741	* 1.9423	* 1.4609	* 1.5905	* 1.4263	* 1.8408	* 2.5380 *

11	* 1.5487	* 1.3345	* 1.5401	* 1.2081	* 1.5947	* 1.4951	* 1.6022	* .8472 *
	* 1.4420	* 1.6744	* 1.4632	* 1.8767	* 1.4405	* 1.5290	* 1.4158	* 2.6449 *

12	* 1.2713	* 1.5583	* 1.4223	* 1.5936	* 1.2231	* 1.5862	* 1.3173	*
	* 1.7505	* 1.4369	* 1.5940	* 1.4412	* 1.8902	* 1.4587	* 1.7410	*

13	* 1.3077	* 1.3163	* 1.5797	* 1.4940	* 1.5872	* 1.2188	* .8322	*
	* 1.6910	* 1.6782	* 1.4277	* 1.5298	* 1.4587	* 1.9128	* 2.7852	*

14	* 1.3045	* 1.5058	* 1.2242	* 1.6011	* 1.3163	* .8322	*	
	* 1.6900	* 1.4669	* 1.8420	* 1.4165	* 1.7420	* 2.7852	*	

15	* 1.2574	* 1.0603	* .8675	* .8461	* F-SUB-Q			
	* 1.7357	* 2.0616	* 2.5425	* 2.6474	* M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.1535	* 1.4726	* 1.3409	* 1.5090	* 1.2370	* 1.2702	* 1.2681	* 1.2231 *
	* 1.7895	* 1.4000	* 1.5298	* 1.3516	* 1.6467	* 1.5984	* 1.5984	* 1.6420 *

9	* 1.4726	* 1.3420	* 1.2370	* 1.3013	* 1.5219	* 1.2798	* 1.4662	* 1.0282 *
	* 1.4000	* 1.5396	* 1.6580	* 1.5680	* 1.3434	* 1.5843	* 1.3819	* 1.9555 *

10	* 1.3409	* 1.2370	* 1.1203	* 1.5037	* 1.3912	* 1.5422	* 1.1920	* .8418 *
	* 1.5298	* 1.6590	* 1.8222	* 1.3630	* 1.4796	* 1.3310	* 1.7202	* 2.4029 *

11	* 1.5090	* 1.3002	* 1.5026	* 1.1749	* 1.5551	* 1.4566	* 1.5626	* .8225 *
	* 1.3516	* 1.5689	* 1.3650	* 1.7483	* 1.3322	* 1.4193	* 1.3158	* 2.4813 *

12	* 1.2370	* 1.5197	* 1.3880	* 1.5540	* 1.1888	* 1.5476	* 1.2831	*
	* 1.6467	* 1.3446	* 1.4827	* 1.3335	* 1.7441	* 1.3440	* 1.6118	*

13	* 1.2702	* 1.2809	* 1.5401	* 1.4555	* 1.5476	* 1.1845	* .8065	*
	* 1.5984	* 1.5826	* 1.3322	* 1.4207	* 1.3434	* 1.7611	* 2.5811	*

14	* 1.2681	* 1.4662	* 1.1910	* 1.5626	* 1.2820	* .8065	*	
	* 1.5984	* 1.3813	* 1.7202	* 1.3164	* 1.6136	* 2.5811	*	

15	* 1.2231	* 1.0292	* .8407	* .8215	* F-SUB-Q			
	* 1.6420	* 1.9542	* 2.4069	* 2.4856	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 98 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPP, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0603	* 1.3634	* 1.2381	* 1.3998	* 1.1417	* 1.1663	* 1.1631	* 1.1213 *
	* 1.7984	* 1.4000	* 1.5371	* 1.3541	* 1.6590	* 1.6226	* 1.6244	* 1.6705 *
9	* 1.3634	* 1.2370	* 1.1417	* 1.2038	* 1.4105	* 1.1760	* 1.3505	* .9414 *
	* 1.4000	* 1.5445	* 1.6666	* 1.5731	* 1.3440	* 1.6046	* 1.3960	* 1.9947 *
10	* 1.2381	* 1.1406	* 1.0335	* 1.3955	* 1.2863	* 1.4287	* 1.0956	* .7700 *
	* 1.5371	* 1.6666	* 1.8315	* 1.3611	* 1.4804	* 1.3310	* 1.7337	* 2.4477 *
11	* 1.3998	* 1.2027	* 1.3944	* 1.0839	* 1.4384	* 1.3441	* 1.4405	* .7518 *
	* 1.3541	* 1.5740	* 1.3624	* 1.7526	* 1.3285	* 1.4221	* 1.3200	* 2.5181 *
12	* 1.1417	* 1.4094	* 1.2841	* 1.4384	* 1.0924	* 1.4276	* 1.1792	*
	* 1.6590	* 1.3453	* 1.4834	* 1.3298	* 1.7483	* 1.3415	* 1.6190	*
13	* 1.1663	* 1.1770	* 1.4266	* 1.3430	* 1.4276	* 1.0849	* .7379	*
	* 1.6226	* 1.6028	* 1.3328	* 1.4235	* 1.3409	* 1.7665	* 2.6044	*
14	* 1.1631	* 1.3505	* 1.0946	* 1.4394	* 1.1781	* .7379	*	*
	* 1.6244	* 1.3960	* 1.7337	* 1.3207	* 1.6199	* 2.6044	*	*
15	* 1.1213	* .9425	* .7700	* .7508	* F-SUB-Q			
	* 1.6705	* 1.9919	* 2.4518	* 2.5203	* M-SUB-Q			

AT 75% POWER, 4 EFPP, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9917	* 1.2723	* 1.1599	* 1.3120	* 1.0731	* 1.0817	* 1.0731	* 1.0249 *
	* 1.8131	* 1.4151	* 1.5503	* 1.3637	* 1.6676	* 1.6561	* 1.6686	* 1.7326 *
9	* 1.2723	* 1.1567	* 1.0699	* 1.1353	* 1.3227	* 1.0924	* 1.2466	* .8643 *
	* 1.4151	* 1.5587	* 1.6802	* 1.5748	* 1.3522	* 1.6336	* 1.4291	* 2.0586 *
10	* 1.1599	* 1.0689	* .9725	* 1.3120	* 1.2092	* 1.3334	* 1.0164	* .7090 *
	* 1.5503	* 1.6802	* 1.8385	* 1.3650	* 1.4834	* 1.3434	* 1.7633	* 2.5203 *
11	* 1.3120	* 1.1342	* 1.3098	* 1.0207	* 1.3409	* 1.2531	* 1.3270	* .6887 *
	* 1.3637	* 1.5757	* 1.3669	* 1.7547	* 1.3415	* 1.4369	* 1.3497	* 2.5997 *
12	* 1.0731	* 1.3216	* 1.2070	* 1.3398	* 1.0174	* 1.3195	* 1.0860	*
	* 1.6676	* 1.3535	* 1.4865	* 1.3421	* 1.7654	* 1.3637	* 1.6533	*
13	* 1.0817	* 1.0935	* 1.3323	* 1.2520	* 1.3195	* 1.0014	* .6769	*
	* 1.6561	* 1.6327	* 1.3446	* 1.4377	* 1.3627	* 1.8007	* 2.6718	*
14	* 1.0731	* 1.2477	* 1.0153	* 1.3259	* 1.0860	* .6769	*	*
	* 1.6686	* 1.4291	* 1.7633	* 1.3503	* 1.6552	* 2.6718	*	*
15	* 1.0249	* .8643	* .7079	* .6876	* F-SUB-Q			
	* 1.7326	* 2.0572	* 2.5225	* 2.6020	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 99 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 75% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.8729	1.0978	.9992	1.1470	.9468	.9275	.9007	.8311
	1.9810	1.5714	1.7305	1.4973	1.8154	1.8610	1.9153	2.0542
9	1.0978	1.0014	.9243	1.0035	1.1535	.9521	1.0442	.7176
	1.5714	1.7305	1.8706	1.7111	1.4880	1.8029	1.6392	2.3850
10	.9992	.9243	.8611	1.1470	1.0635	1.1545	.8707	.5955
	1.7305	1.8706	1.9960	1.4965	1.6190	1.4888	1.9742	2.8912
11	1.1470	1.0035	1.1460	.9114	1.1642	1.0764	1.0903	.5655
	1.4973	1.7121	1.4981	1.8853	1.4774	1.6037	1.5748	3.0435
12	.9468	1.1524	1.0614	1.1620	.8879	1.1074	.9007	
	1.8154	1.4896	1.6226	1.4796	1.9423	1.5553	1.9140	
13	.9275	.9532	1.1524	1.0753	1.1074	.8472	.5655	
	1.8610	1.8029	1.4903	1.6055	1.5553	2.0383	3.0694	
14	.9007	1.0442	.8707	1.0892	.8996	.5655		
	1.9153	1.6392	1.9756	1.5757	1.9153	3.0694		
15	.8311	.7186	.5955	.5644	F-SUB-Q			
	2.0542	2.3831	2.8941	3.0467	M-SUB-Q			

AT 75% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.5783	.7294	.6265	.7551	.6255	.5805	.5462	.4723
	2.9174	2.3014	2.6918	2.2098	2.6768	2.8999	3.0759	3.5223
9	.7294	.6351	.5858	.6619	.7765	.6180	.6394	.4284
	2.3014	2.6595	2.8825	2.5247	2.1458	2.7069	2.6020	3.8978
10	.6265	.5858	.5730	.7711	.6940	.7690	.5494	.3631
	2.6918	2.8825	2.9263	2.1619	2.4149	2.1684	3.0435	4.6138
11	.7551	.6619	.7711	.6148	.7818	.6758	.6308	.3331
	2.2098	2.5247	2.1635	2.7196	2.1363	2.4835	2.6474	5.0406
12	.6255	.7765	.6929	.7808	.5880	.6887	.5301	
	2.6768	2.1474	2.4190	2.1378	2.8484	2.4271	3.1670	
13	.5805	.6180	.7690	.6758	.6887	.5237	.3427	
	2.8999	2.7069	2.1700	2.4856	2.4271	3.2056	4.9288	
14	.5462	.6405	.5494	.6308	.5291	.3427		
	3.0759	2.6020	3.0467	2.6474	3.1670	4.9372		
15	.4723	.4284	.3631	.3331	F-SUB-Q			
	3.5223	3.8978	4.6212	5.0494	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 100 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .6576 *	* .9007 *	* .8557 *	* .9960 *	* .8600 *	* .8086 *	* .7411 *	* .6169 *
	* 2.7024 *	* 2.2961 *	* 2.5216 *	* 2.1446 *	* 2.4791 *	* 2.6042 *	* 2.8105 *	* 3.3508 *
9	* .9007 *	* .8075 *	* .8236 *	* .8932 *	* .9950 *	* .8343 *	* .8343 *	* .5751 *
	* 2.2961 *	* 2.5523 *	* 2.6214 *	* 2.3998 *	* 2.1493 *	* 2.5442 *	* 2.5089 *	* 3.5964 *
10	* .8557 *	* .8225 *	* .8043 *	* .9821 *	* .8975 *	* .9393 *	* .7326 *	* .4959 *
	* 2.5216 *	* 2.6249 *	* 2.6852 *	* 2.1944 *	* 2.3940 *	* 2.2787 *	* 2.8881 *	* 4.2142 *
11	* .9960 *	* .8932 *	* .9810 *	* .7915 *	* .8964 *	* .7979 *	* .7486 *	* .4391 *
	* 2.1446 *	* 2.4012 *	* 2.1956 *	* 2.7134 *	* 2.3017 *	* 2.5971 *	* 2.8534 *	* 4.8464 *
12	* .8600 *	* .9939 *	* .8975 *	* .8964 *	* .6265 *	* .6897 *	* .6062 *	
	* 2.4791 *	* 2.1504 *	* 2.3954 *	* 2.3030 *	* 2.7908 *	* 2.5602 *	* 3.2899 *	
13	* .8086 *	* .8343 *	* .9382 *	* .7979 *	* .6897 *	* .5334 *	* .3941 *	
	* 2.6042 *	* 2.5442 *	* 2.2800 *	* 2.5974 *	* 2.5616 *	* 3.1520 *	* 4.7820 *	
14	* .7411 *	* .8343 *	* .7326 *	* .7486 *	* .6062 *	* .3941 *		
	* 2.8105 *	* 2.5073 *	* 2.8860 *	* 2.8537 *	* 3.2926 *	* 4.7828 *		
15	* .6169 *	* .5762 *	* .4959 *	* .4380 *	F-SUB-Q			
	* 3.3508 *	* 3.5964 *	* 4.2142 *	* 4.8464 *	M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9703 *	* 1.2970 *	* 1.2756 *	* 1.3891 *	* 1.2156 *	* 1.2027 *	* 1.1385 *	* 1.0110 *
	* 2.0275 *	* 1.7523 *	* 1.7967 *	* 1.6285 *	* 1.8502 *	* 1.8485 *	* 1.9344 *	* 2.1623 *
9	* 1.2970 *	* 1.2209 *	* 1.2027 *	* 1.2649 *	* 1.3591 *	* 1.1931 *	* 1.2595 *	* .9018 *
	* 1.7523 *	* 1.8354 *	* 1.9124 *	* 1.7959 *	* 1.6655 *	* 1.8690 *	* 1.7622 *	* 2.4276 *
10	* 1.2756 *	* 1.2027 *	* 1.1331 *	* 1.3377 *	* 1.2723 *	* 1.3130 *	* 1.0603 *	* .7572 *
	* 1.7967 *	* 1.9142 *	* 2.0206 *	* 1.7157 *	* 1.7927 *	* 1.7469 *	* 2.1159 *	* 2.9170 *
11	* 1.3891 *	* 1.2638 *	* 1.3377 *	* 1.1085 *	* 1.2788 *	* 1.2124 *	* 1.2220 *	* .6908 *
	* 1.6285 *	* 1.7959 *	* 1.7172 *	* 2.0621 *	* 1.7587 *	* 1.8425 *	* 1.8694 *	* 3.2716 *
12	* 1.2156 *	* 1.3591 *	* 1.2713 *	* 1.2777 *	* .9189 *	* 1.1235 *	* .9885 *	
	* 1.8502 *	* 1.6655 *	* 1.7935 *	* 1.7602 *	* 2.0891 *	* 1.8137 *	* 2.1893 *	
13	* 1.2027 *	* 1.1942 *	* 1.3130 *	* 1.2113 *	* 1.1224 *	* .8697 *	* .6319 *	
	* 1.8485 *	* 1.8673 *	* 1.7477 *	* 1.8441 *	* 1.8138 *	* 2.2026 *	* 3.2690 *	
14	* 1.1385 *	* 1.2595 *	* 1.0603 *	* 1.2220 *	* .9885 *	* .6308 *		
	* 1.9344 *	* 1.7614 *	* 2.1159 *	* 1.8702 *	* 2.1905 *	* 3.2713 *		
15	* 1.0110 *	* .9018 *	* .7572 *	* .6897 *	F-SUB-Q			
	* 2.1623 *	* 2.4261 *	* 2.9191 *	* 3.2742 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 101 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.2102	* 1.5540	* 1.4801	* 1.6097	* 1.3762	* 1.3902	* 1.3452	* 1.2349 *
	* 1.9250	* 1.6183	* 1.6701	* 1.5085	* 1.7522	* 1.7105	* 1.7492	* 1.8886 *

9	* 1.5540	* 1.4491	* 1.3891	* 1.4309	* 1.5776	* 1.3773	* 1.5015	* 1.0774 *
	* 1.6183	* 1.7100	* 1.8070	* 1.7077	* 1.5472	* 1.7249	* 1.5812	* 2.1706 *

10	* 1.4801	* 1.3891	* 1.2788	* 1.5572	* 1.4491	* 1.5497	* 1.2284	* .8954 *
	* 1.6701	* 1.8078	* 1.9322	* 1.5998	* 1.6985	* 1.6029	* 1.9760	* 2.6470 *

11	* 1.6097	* 1.4298	* 1.5562	* 1.2638	* 1.5294	* 1.4587	* 1.5101	* .8386 *
	* 1.5085	* 1.7077	* 1.6010	* 1.9723	* 1.6121	* 1.6891	* 1.6472	* 2.9141 *

12	* 1.3762	* 1.5765	* 1.4480	* 1.5283	* 1.1642	* 1.4394	* 1.2349	*
	* 1.7522	* 1.5478	* 1.6999	* 1.6127	* 1.9661	* 1.6201	* 1.9439	*

13	* 1.3902	* 1.3784	* 1.5487	* 1.4576	* 1.4394	* 1.1278	* .7883	*
	* 1.7105	* 1.7235	* 1.6035	* 1.6905	* 1.6201	* 2.0059	* 2.9444	*

14	* 1.3452	* 1.5015	* 1.2284	* 1.5090	* 1.2338	* .7883	*	*
	* 1.7492	* 1.5812	* 1.9741	* 1.6478	* 1.9456	* 2.9447	*	*

15	* 1.2349	* 1.0785	* .8943	* .8375	* F-SUB-Q			
	* 1.8886	* 2.1694	* 2.6487	* 2.9163	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A

8	* 1.3955	* 1.7125	* 1.5958	* 1.7425	* 1.4716	* 1.4940	* 1.4630	* 1.3645 *
	* 1.9769	* 1.6403	* 1.7015	* 1.5212	* 1.7862	* 1.7226	* 1.7457	* 1.8554 *

9	* 1.7125	* 1.6033	* 1.4951	* 1.5305	* 1.7157	* 1.4855	* 1.6451	* 1.1802 *
	* 1.6403	* 1.7454	* 1.8604	* 1.7450	* 1.5570	* 1.7377	* 1.5682	* 2.1528 *

10	* 1.5958	* 1.4951	* 1.3612	* 1.6975	* 1.5658	* 1.7040	* 1.3495	* .9757 *
	* 1.7015	* 1.8612	* 1.9940	* 1.6144	* 1.7262	* 1.5995	* 1.9902	* 2.6402 *

11	* 1.7425	* 1.5305	* 1.6965	* 1.3752	* 1.6986	* 1.6226	* 1.6900	* .9296 *
	* 1.5212	* 1.7457	* 1.6157	* 2.0206	* 1.6106	* 1.6958	* 1.6256	* 2.8873 *

12	* 1.4716	* 1.7147	* 1.5637	* 1.6965	* 1.3409	* 1.6568	* 1.3966	*
	* 1.7862	* 1.5576	* 1.7283	* 1.6113	* 1.9913	* 1.6069	* 1.9292	*

13	* 1.4940	* 1.4865	* 1.7029	* 1.6215	* 1.6568	* 1.3045	* .8954	*
	* 1.7226	* 1.7363	* 1.6007	* 1.6965	* 1.6069	* 2.0104	* 2.9394	*

14	* 1.4630	* 1.6451	* 1.3495	* 1.6890	* 1.3955	* .8954	*	*
	* 1.7457	* 1.5676	* 1.9883	* 1.6262	* 1.9301	* 2.9415	*	*

15	* 1.3645	* 1.1813	* .9757	* .9286	* F-SUB-Q			
	* 1.8554	* 2.1506	* 2.6418	* 2.8913	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 102 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4191	* 1.7447	* 1.6076	* 1.7618	* 1.4791	* 1.5058	* 1.4833	* 1.3923 *
	* 2.1811	* 1.7902	* 1.8923	* 1.6763	* 1.9799	* 1.8914	* 1.9076	* 2.0091 *
9	* 1.7447	* 1.6290	* 1.5037	* 1.5401	* 1.7447	* 1.5005	* 1.6750	* 1.1984 *
	* 1.7902	* 1.9165	* 2.0792	* 1.9364	* 1.7088	* 1.9102	* 1.7075	* 2.3454 *
10	* 1.6076	* 1.5037	* 1.3634	* 1.7286	* 1.5969	* 1.7457	* 1.3784	* .9907 *
	* 1.8923	* 2.0812	* 2.2281	* 1.7763	* 1.9050	* 1.7469	* 2.1877	* 2.8901 *
11	* 1.7618	* 1.5401	* 1.7275	* 1.3955	* 1.7500	* 1.6665	* 1.7425	* .9510 *
	* 1.6763	* 1.9373	* 1.7778	* 2.2120	* 1.7390	* 1.8338	* 1.7463	* 3.1458 *
12	* 1.4791	* 1.7436	* 1.5947	* 1.7489	* 1.3816	* 1.7254	* 1.4437	*
	* 1.9799	* 1.7095	* 1.9085	* 1.7397	* 2.1780	* 1.7372	* 2.0854	*
13	* 1.5058	* 1.5026	* 1.7447	* 1.6654	* 1.7254	* 1.3548	* .9286	*
	* 1.8914	* 1.9085	* 1.7484	* 1.8354	* 1.7372	* 2.1937	* 3.2031	*
14	* 1.4833	* 1.6761	* 1.3773	* 1.7414	* 1.4437	* .9275	*	*
	* 1.9076	* 1.7075	* 2.1866	* 1.7470	* 2.0865	* 3.2031	*	*
15	* 1.3923	* 1.1995	* .9896	* .9500	* F-SUB-Q			
	* 2.0091	* 2.3441	* 2.8921	* 3.1481	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4651	* 1.8057	* 1.6600	* 1.8228	* 1.5272	* 1.5594	* 1.5401	* 1.4523 *
	* 2.4086	* 1.9579	* 2.0716	* 1.8238	* 2.1569	* 2.0450	* 2.0558	* 2.1493 *
9	* 1.8057	* 1.6836	* 1.5497	* 1.5926	* 1.8121	* 1.5562	* 1.7436	* 1.2456 *
	* 1.9579	* 2.1015	* 2.2506	* 2.1113	* 1.8505	* 2.0627	* 1.8362	* 2.5197 *
10	* 1.6600	* 1.5497	* 1.4041	* 1.7961	* 1.6643	* 1.8207	* 1.4373	* 1.0282 *
	* 2.0716	* 2.2518	* 2.4452	* 1.9114	* 2.0617	* 1.8739	* 2.3645	* 3.1105 *
11	* 1.8228	* 1.5915	* 1.7950	* 1.4469	* 1.8325	* 1.7425	* 1.8282	* .9939 *
	* 1.8238	* 2.1124	* 1.9131	* 2.4107	* 1.8786	* 1.9820	* 1.8633	* 3.3557 *
12	* 1.5272	* 1.8111	* 1.6611	* 1.8314	* 1.4448	* 1.8143	* 1.5176	*
	* 2.1569	* 1.8513	* 2.0657	* 1.8795	* 2.3690	* 1.8731	* 2.2452	*
13	* 1.5594	* 1.5572	* 1.8196	* 1.7404	* 1.8143	* 1.4223	* .9746	*
	* 2.0450	* 2.0617	* 1.8755	* 1.9831	* 1.8731	* 2.3710	* 3.4572	*
14	* 1.5401	* 1.7447	* 1.4373	* 1.8271	* 1.5165	* .9735	*	*
	* 2.0558	* 1.8355	* 2.3619	* 1.8641	* 2.2463	* 3.4572	*	*
15	* 1.4523	* 1.2456	* 1.0271	* .9928	* F-SUB-Q			
	* 2.1493	* 2.5168	* 3.1127	* 3.3583	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 103 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4448	* 1.7907	* 1.6418	* 1.8100	* 1.5112	* 1.5465	* 1.5294	* 1.4469 *
	* 2.7525	* 2.1837	* 2.3318	* 2.0369	* 2.4136	* 2.2754	* 2.2802	* 2.3713 *
9	* 1.7907	* 1.6633	* 1.5305	* 1.5776	* 1.8057	* 1.5455	* 1.7382	* 1.2381 *
	* 2.1837	* 2.3661	* 2.5365	* 2.3623	* 2.0562	* 2.2923	* 2.0311	* 2.7879 *
10	* 1.6418	* 1.5294	* 1.3869	* 1.7896	* 1.6590	* 1.8186	* 1.4319	* 1.0207 *
	* 2.3318	* 2.5365	* 2.7525	* 2.1384	* 2.2971	* 2.0879	* 2.6241	* 3.4384 *
11	* 1.8100	* 1.5776	* 1.7875	* 1.4351	* 1.8336	* 1.7382	* 1.8303	* .9896 *
	* 2.0369	* 2.3636	* 2.1395	* 2.6909	* 2.1041	* 2.2014	* 2.0611	* 3.7252 *
12	* 1.5112	* 1.8046	* 1.6558	* 1.8325	* 1.4394	* 1.8186	* 1.5187	*
	* 2.4136	* 2.0581	* 2.3008	* 2.1062	* 2.7111	* 2.1269	* 2.5218	*
13	* 1.5465	* 1.5465	* 1.8175	* 1.7372	* 1.8186	* 1.4212	* .9725	*
	* 2.2754	* 2.2911	* 2.0899	* 2.2025	* 2.1269	* 2.7091	* 3.9462	*
14	* 1.5294	* 1.7393	* 1.4309	* 1.8303	* 1.5176	* .9725	*	*
	* 2.2802	* 2.0302	* 2.6209	* 2.0621	* 2.5232	* 3.9462	*	*
15	* 1.4469	* 1.2391	* 1.0207	* .9885	* F-SUB-Q			
	* 2.3713	* 2.7861	* 3.4439	* 3.7284	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3977	* 1.7414	* 1.5936	* 1.7661	* 1.4683	* 1.5037	* 1.4898	* 1.4148 *
	* 3.1716	* 2.5247	* 2.8595	* 2.3045	* 2.7386	* 2.5773	* 2.5803	* 2.6727 *
9	* 1.7414	* 1.6119	* 1.4823	* 1.5347	* 1.7671	* 1.5048	* 1.7007	* 1.2070 *
	* 2.5247	* 2.7386	* 2.9313	* 2.6776	* 2.3143	* 2.5911	* 2.2850	* 3.1485 *
10	* 1.5936	* 1.4812	* 1.3452	* 1.7500	* 1.6215	* 1.7832	* 1.3977	* .9939 *
	* 2.6595	* 2.9352	* 3.1417	* 2.4203	* 2.5865	* 2.3431	* 2.9552	* 3.8648 *
11	* 1.7661	* 1.5347	* 1.7479	* 1.3966	* 1.7982	* 1.6997	* 1.7961	* .9650 *
	* 2.3045	* 2.6793	* 2.4230	* 3.1057	* 2.3962	* 2.5277	* 2.3368	* 4.1778 *
12	* 1.4683	* 1.7661	* 1.6183	* 1.7971	* 1.4041	* 1.7843	* 1.4865	*
	* 2.7386	* 2.3155	* 2.5911	* 2.3976	* 3.0836	* 2.4069	* 2.8768	*
13	* 1.5037	* 1.5058	* 1.7811	* 1.6986	* 1.7843	* 1.3880	* .9489	*
	* 2.5773	* 2.5880	* 2.3444	* 2.5291	* 2.4069	* 3.0924	* 4.4942	*
14	* 1.4898	* 1.7007	* 1.3977	* 1.7950	* 1.4855	* .9489	*	*
	* 2.5803	* 2.2838	* 2.9512	* 2.3393	* 2.8787	* 4.4942	*	*
15	* 1.4148	* 1.2081	* .9928	* .9639	* F-SUB-Q			
	* 2.6727	* 3.1463	* 3.8682	* 4.1818	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 104 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 HFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3773	* 1.7232	* 1.5765	* 1.7532	* 1.4544	* 1.4908	* 1.4791	* 1.4094 *
	* 3.2452	* 2.5865	* 2.8060	* 2.4339	* 2.9057	* 2.7683	* 2.7790	* 2.8979 *
9	* 1.7232	* 1.5904	* 1.4630	* 1.5219	* 1.7586	* 1.4940	* 1.6933	* 1.1995 *
	* 2.5865	* 2.8114	* 3.0488	* 2.8428	* 2.4616	* 2.7861	* 2.4630	* 3.4140 *
10	* 1.5765	* 1.4630	* 1.3280	* 1.7404	* 1.6140	* 1.7768	* 1.3902	* .9864 *
	* 2.8060	* 3.0488	* 3.3352	* 2.5380	* 2.7455	* 2.4870	* 3.1926	* 4.2391 *
11	* 1.7532	* 1.5208	* 1.7382	* 1.3837	* 1.7929	* 1.6922	* 1.7939	* .9596 *
	* 2.4339	* 2.8446	* 2.5410	* 3.2044	* 2.4742	* 2.6273	* 2.4742	* 4.6138 *
12	* 1.4544	* 1.7564	* 1.6108	* 1.7918	* 1.3955	* 1.7811	* 1.4833	*
	* 2.9057	* 2.4644	* 2.7507	* 2.4757	* 3.1903	* 2.4999	* 3.0086	*
13	* 1.4908	* 1.4951	* 1.7757	* 1.6911	* 1.7811	* 1.3816	* .9436	*
	* 2.7683	* 2.7625	* 2.4899	* 2.6289	* 2.4999	* 3.2428	* 4.7714	*
14	* 1.4791	* 1.6933	* 1.3902	* 1.7929	* 1.4823	* .9436	*	*
	* 2.7790	* 2.4630	* 3.1903	* 2.4757	* 3.0107	* 4.7714	*	*
15	* 1.4094	* 1.2006	* .9853	* .9585	* F-SUB-Q			
	* 2.8979	* 3.4113	* 4.2433	* 4.6188	* M-SUB-Q			

AT 50% POWER, 4 HFPD, THIS IS LEVEL 9 OF 16
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3002	* 1.6365	* 1.4930	* 1.6697	* 1.3784	* 1.4137	* 1.4062	* 1.3441 *
	* 3.3532	* 2.6563	* 2.7718	* 2.3791	* 2.8597	* 2.7282	* 2.7299	* 2.8187 *
9	* 1.6365	* 1.5037	* 1.3827	* 1.4448	* 1.6783	* 1.4201	* 1.6161	* 1.1406 *
	* 2.6563	* 2.9018	* 3.0596	* 2.7897	* 2.4042	* 2.7316	* 2.3989	* 3.3377 *
10	* 1.4930	* 1.3827	* 1.2574	* 1.6611	* 1.5380	* 1.6986	* 1.3230	* .9371 *
	* 2.7718	* 3.0639	* 3.2871	* 2.5174	* 2.7111	* 2.4588	* 3.1303	* 4.1859 *
11	* 1.6697	* 1.4437	* 1.6590	* 1.3130	* 1.7147	* 1.6129	* 1.7147	* .9114 *
	* 2.3791	* 2.7897	* 2.5203	* 3.2946	* 2.5247	* 2.6909	* 2.5159	* 4.6089 *
12	* 1.3784	* 1.6772	* 1.5347	* 1.7136	* 1.3270	* 1.7029	* 1.4148	*
	* 2.8597	* 2.4069	* 2.7162	* 2.5277	* 3.2747	* 2.5515	* 3.0792	*
13	* 1.4137	* 1.4212	* 1.6975	* 1.6119	* 1.7029	* 1.3152	* .8975	*
	* 2.7282	* 2.7299	* 2.4616	* 2.6926	* 2.5515	* 3.3249	* 4.9120	*
14	* 1.4062	* 1.6161	* 1.3227	* 1.7136	* 1.4137	* .8975	*	*
	* 2.7299	* 2.3976	* 3.1281	* 2.5174	* 3.0814	* 4.9120	*	*
15	* 1.3441	* 1.1406	* .9361	* .9104	* F-SUB-Q			
	* 2.8187	* 3.3352	* 4.1899	* 4.6138	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 105 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2734	* 1.6108	* 1.4694	* 1.6472	* 1.3570	* 1.3944	* 1.3880	* 1.3502
	* 3.2921	* 2.5560	* 2.6465	* 2.2659	* 2.7179	* 2.5666	* 2.5575	* 2.6178
9	* 1.6108	* 1.4769	* 1.3580	* 1.4244	* 1.6590	* 1.4019	* 1.5990	* 1.1267
	* 2.5560	* 2.8078	* 2.9233	* 2.6579	* 2.2886	* 2.5712	* 2.2541	* 3.1101
10	* 1.4694	* 1.3580	* 1.2338	* 1.6408	* 1.5208	* 1.6815	* 1.3077	* .9232
	* 2.6465	* 2.9273	* 3.1440	* 2.3976	* 2.5803	* 2.3393	* 2.9573	* 3.9136
11	* 1.6472	* 1.4234	* 1.6386	* 1.2927	* 1.6975	* 1.5958	* 1.7007	* .9007
	* 2.2659	* 2.6595	* 2.4002	* 3.1600	* 2.4367	* 2.5773	* 2.3896	* 4.3542
12	* 1.3570	* 1.6579	* 1.5176	* 1.6965	* 1.3098	* 1.6879	* 1.4019	
	* 2.7179	* 2.2911	* 2.5850	* 2.4380	* 3.1973	* 2.4742	* 2.9492	
13	* 1.3944	* 1.4030	* 1.6793	* 1.5947	* 1.6879	* 1.3002	* .8868	
	* 2.5666	* 2.5696	* 2.3418	* 2.5788	* 2.4742	* 3.2428	* 4.7194	
14	* 1.3880	* 1.5990	* 1.3077	* 1.7007	* 1.4009	* .8857		
	* 2.5575	* 2.2529	* 2.9552	* 2.3909	* 2.9512	* 4.7194		
15	* 1.3202	* 1.1278	* .9221	* .8996	* F-SUB-Q			
	* 2.6178	* 3.1079	* 3.9207	* 4.3585	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2124	* 1.5412	* 1.4041	* 1.5797	* 1.2981	* 1.3334	* 1.3302	* 1.2777
	* 3.0968	* 2.3989	* 2.4518	* 2.0929	* 2.5203	* 2.3844	* 2.3739	* 2.4271
9	* 1.5412	* 1.4084	* 1.2959	* 1.3634	* 1.5936	* 1.3420	* 1.5358	* 1.0785
	* 2.3989	* 2.6401	* 2.7077	* 2.4602	* 2.1123	* 2.3857	* 2.0849	* 2.8902
10	* 1.4041	* 1.2959	* 1.1770	* 1.5754	* 1.4598	* 1.6172	* 1.2541	* .8836
	* 2.4518	* 2.7111	* 2.9155	* 2.2172	* 2.3844	* 2.1608	* 2.7438	* 3.6407
11	* 1.5797	* 1.3623	* 1.5733	* 1.2359	* 1.6322	* 1.5315	* 1.6376	* .8622
	* 2.0929	* 2.4616	* 2.2195	* 2.9735	* 2.2766	* 2.4149	* 2.2059	* 4.0339
12	* 1.2981	* 1.5926	* 1.4566	* 1.6311	* 1.2541	* 1.6247	* 1.3462	
	* 2.5203	* 2.1145	* 2.3883	* 2.2778	* 2.9920	* 2.3045	* 2.7595	
13	* 1.3334	* 1.3430	* 1.6161	* 1.5305	* 1.6247	* 1.2466	* .8482	
	* 2.3844	* 2.3831	* 2.1630	* 2.4163	* 2.3045	* 3.0254	* 4.4208	
14	* 1.3302	* 1.5358	* 1.2531	* 1.6365	* 1.3452	* .8482		
	* 2.3739	* 2.0849	* 2.7403	* 2.2070	* 2.7612	* 4.4208		
15	* 1.2777	* 1.0796	* .8825	* .8622	* F-SUB-Q			
	* 2.4271	* 2.8883	* 3.6468	* 4.0376	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 106 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1267	* 1.4405	* 1.3077	* 1.4780	* 1.2092	* 1.2413	* 1.2391	* 1.1942
	* 2.9253	* 2.2647	* 2.3418	* 1.9965	* 2.4176	* 2.2959	* 2.2850	* 2.3330
9	* 1.4405	* 1.3109	* 1.2049	* 1.2713	* 1.4930	* 1.2509	* 1.4362	* 1.0046
	* 2.2647	* 2.5028	* 2.5896	* 2.3507	* 2.0113	* 2.2923	* 1.9965	* 2.7879
10	* 1.3077	* 1.2049	* 1.0946	* 1.4758	* 1.3634	* 1.5155	* 1.1695	* .8225
	* 2.3418	* 2.5927	* 2.7897	* 2.1072	* 2.2742	* 2.0523	* 2.6321	* 3.5109
11	* 1.4780	* 1.2702	* 1.4737	* 1.1513	* 1.5305	* 1.4309	* 1.5326	* .8032
	* 1.9965	* 2.3520	* 2.1103	* 2.8187	* 2.1479	* 2.2850	* 2.0919	* 3.8613
12	* 1.2092	* 1.4919	* 1.3612	* 1.5294	* 1.1685	* 1.5208	* 1.2574	*
	* 2.4176	* 2.0132	* 2.2790	* 2.1490	* 2.8353	* 2.1804	* 2.6162	*
13	* 1.2413	* 1.2520	* 1.5144	* 1.4298	* 1.5219	* 1.1631	* .7904	*
	* 2.2959	* 2.2911	* 2.0542	* 2.2874	* 2.1793	* 2.8787	* 4.2226	*
14	* 1.2391	* 1.4373	* 1.1685	* 1.5315	* 1.2563	* .7904	*	*
	* 2.2850	* 1.9965	* 2.6289	* 2.0940	* 2.6178	* 4.2267	*	*
15	* 1.1942	* 1.0057	* .8215	* .8022	* F-SUB-Q			
	* 2.3330	* 2.7361	* 3.5137	* 3.8648	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0796	* 1.3848	* 1.2574	* 1.4244	* 1.1620	* 1.1920	* 1.1899	* 1.1470
	* 2.6876	* 2.0650	* 2.1815	* 1.8658	* 2.2659	* 2.1662	* 2.1576	* 2.2048
9	* 1.3848	* 1.2584	* 1.1578	* 1.2242	* 1.4384	* 1.2027	* 1.3816	* .9639
	* 2.0650	* 2.2898	* 2.4149	* 2.1947	* 1.8763	* 2.1576	* 1.8779	* 2.6369
10	* 1.2574	* 1.1578	* 1.0507	* 1.4223	* 1.3141	* 1.4598	* 1.1235	* .7883
	* 2.1815	* 2.4190	* 2.6052	* 1.9577	* 2.1175	* 1.9077	* 2.4714	* 3.3148
11	* 1.4244	* 1.2231	* 1.4201	* 1.1063	* 1.4737	* 1.3773	* 1.4769	* .7700
	* 1.8658	* 2.1958	* 1.9604	* 2.5742	* 1.9621	* 2.0850	* 1.9272	* 3.6103
12	* 1.1620	* 1.4373	* 1.3109	* 1.4726	* 1.1224	* 1.4641	* 1.2102	*
	* 2.2659	* 1.8779	* 2.1216	* 1.9648	* 2.6114	* 2.0011	* 2.3949	*
13	* 1.1920	* 1.2038	* 1.4587	* 1.3762	* 1.4641	* 1.1160	* .7572	*
	* 2.1662	* 2.1554	* 1.9102	* 2.0879	* 2.0011	* 2.6595	* 3.9031	*
14	* 1.1899	* 1.3816	* 1.1235	* 1.4758	* 1.2092	* .7572	*	*
	* 2.1576	* 1.8771	* 2.4686	* 1.9281	* 2.3962	* 3.9031	*	*
15	* 1.1470	* .9650	* .7872	* .7700	* F-SUB-Q			
	* 2.2048	* 2.6353	* 3.3198	* 3.6133	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 107 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9821	* 1.2670	* 1.1492	* 1.3055	* 1.0614	* 1.0828	* 1.0796	* 1.0399
	* 2.6385	* 2.0340	* 2.1630	* 1.8546	* 2.2671	* 2.1892	* 2.1859	* 2.2378
9	* 1.2670	* 1.1481	* 1.0571	* 1.1203	* 1.3195	* 1.0935	* 1.2584	* .8729
	* 2.0340	* 2.2576	* 2.3923	* 2.1804	* 1.8602	* 2.1749	* 1.8894	* 2.6809
10	* 1.1492	* 1.0571	* .9596	* 1.3045	* 1.2017	* 1.3366	* 1.0207	* .7133
	* 2.1630	* 2.3936	* 2.5865	* 1.9255	* 2.0980	* 1.8820	* 2.4799	* 3.3558
11	* 1.3055	* 1.1192	* 1.3034	* 1.0100	* 1.3473	* 1.2552	* 1.3441	* .6972
	* 1.8546	* 2.1815	* 1.9281	* 2.5365	* 1.9281	* 2.0650	* 1.8968	* 3.6133
12	* 1.0614	* 1.3173	* 1.1995	* 1.3462	* 1.0196	* 1.3345	* 1.0988	*
	* 2.2671	* 1.8618	* 2.1021	* 1.9298	* 2.5575	* 1.9568	* 2.3674	*
13	* 1.0828	* 1.0946	* 1.3355	* 1.2541	* 1.3345	* 1.0121	* .6854	*
	* 2.1892	* 2.1727	* 1.8836	* 2.0660	* 1.9568	* 2.5989	* 3.8510	*
14	* 1.0796	* 1.2584	* 1.0207	* 1.3430	* 1.0978	* .6854	*	*
	* 2.1859	* 1.8886	* 2.4799	* 1.8977	* 2.3700	* 3.8510	*	*
15	* 1.0399	* .8739	* .7122	* .6961	* F-SUB-Q			
	* 2.2378	* 2.6793	* 3.3611	* 3.6194	* M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9104	* 1.1717	* 1.0656	* 1.2113	* .9885	* .9939	* .9853	* .9414
	* 2.5927	* 1.9892	* 2.1469	* 1.8522	* 2.2623	* 2.2275	* 2.2367	* 2.3155
9	* 1.1717	* 1.0624	* .9810	* 1.0464	* 1.2242	* 1.0067	* 1.1492	* .7936
	* 1.9892	* 2.2093	* 2.3558	* 2.1586	* 1.8499	* 2.2048	* 1.9247	* 2.7595
10	* 1.0656	* .9810	* .8943	* 1.2134	* 1.1181	* 1.2349	* .9371	* .6501
	* 2.1469	* 2.3571	* 2.5575	* 1.8960	* 2.0719	* 1.8658	* 2.4728	* 3.4330
11	* 1.2113	* 1.0453	* 1.2113	* .9414	* 1.2424	* 1.1578	* 1.2252	* .6319
	* 1.8522	* 2.1597	* 1.8985	* 2.4672	* 1.8853	* 2.0264	* 1.8985	* 3.6653
12	* .9885	* 1.2231	* 1.1160	* 1.2413	* .9403	* 1.2199	* 1.0025	*
	* 2.2623	* 1.8515	* 2.0759	* 1.8878	* 2.5425	* 1.9595	* 2.3648	*
13	* .9939	* 1.0067	* 1.2338	* 1.1567	* 1.2209	* .9243	* .6233	*
	* 2.2275	* 2.2025	* 1.8674	* 2.0273	* 1.9595	* 2.6257	* 3.8960	*
14	* .9853	* 1.1503	* .9371	* 1.2242	* 1.0014	* .6223	*	*
	* 2.2367	* 1.9247	* 2.4728	* 1.8993	* 2.3674	* 3.8995	*	*
15	* .9414	* .7936	* .6501	* .6308	* F-SUB-Q			
	* 2.3155	* 2.7577	* 3.4357	* 3.6715	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 108 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 50% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .7947 *	* 1.0025 *	* .9114 *	* 1.0496 *	* .8654 *	* .8450 *	* .8204 *	* .7572 *
	* 2.7648 *	* 2.1815 *	* 2.3661 *	* 2.0216 *	* 2.4518 *	* 2.5014 *	* 2.5635 *	* 2.7438 *
9	* 1.0025 *	* .9125 *	* .8418 *	* .9178 *	* 1.0571 *	* .8707 *	* .9543 *	* .6533 *
	* 2.1815 *	* 2.4069 *	* 2.5819 *	* 2.3255 *	* 2.0188 *	* 2.4422 *	* 2.2014 *	* 3.1926 *
10	* .9114 *	* .8418 *	* .7861 *	* 1.0517 *	* .9746 *	* 1.0581 *	* .7958 *	* .5419 *
	* 2.3661 *	* 2.5819 *	* 2.7403 *	* 2.0494 *	* 2.2252 *	* 2.0397 *	* 2.7351 *	* 3.9136 *
11	* 1.0496 *	* .7168 *	* 1.0507 *	* .8343 *	* 1.0678 *	* .9853 *	* .9971 *	* .5141 *
	* 2.0216 *	* 2.3267 *	* 2.0513 *	* 2.6114 *	* 2.0455 *	* 2.2286 *	* 2.1892 *	* 4.2350 *
12	* .8654 *	* 1.0560 *	* .9725 *	* 1.0667 *	* .8129 *	* 1.0142 *	* .8225 *	
	* 2.4518 *	* 2.0207 *	* 2.2286 *	* 2.0484 *	* 2.7265 *	* 2.1837 *	* 2.6876 *	
13	* .8450 *	* .8707 *	* 1.0571 *	* .9842 *	* 1.0142 *	* .7754 *	* .5162 *	
	* 2.5014 *	* 2.4422 *	* 2.0417 *	* 2.2297 *	* 2.1837 *	* 2.8863 *	* 4.3629 *	
14	* .8204 *	* .9543 *	* .7958 *	* .9960 *	* .8225 *	* .5152 *		
	* 2.5635 *	* 2.2014 *	* 2.7351 *	* 2.1903 *	* 2.6893 *	* 4.3673 *		
15	* .7572 *	* .6533 *	* .5409 *	* .5141 *	F-SUB-Q			
	* 2.7438 *	* 3.1903 *	* 3.9207 *	* 4.2391 *	M-SUB-Q			

AT 50% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .5216 *	* .6597 *	* .5666 *	* .6844 *	* .5666 *	* .5248 *	* .4937 *	* .4263 *
	* 4.0414 *	* 3.1762 *	* 3.6653 *	* 2.9817 *	* 3.6103 *	* 3.8960 *	* 4.1222 *	* 4.7142 *
9	* .6597 *	* .5730 *	* .5291 *	* .6008 *	* .7047 *	* .5601 *	* .5783 *	* .3856 *
	* 3.1762 *	* 3.6684 *	* 3.9421 *	* 3.4248 *	* 2.9037 *	* 3.6622 *	* 3.4995 *	* 5.2260 *
10	* .5666 *	* .5291 *	* .5184 *	* .7004 *	* .6297 *	* .6983 *	* .4980 *	* .3277 *
	* 3.6653 *	* 3.9457 *	* 3.9967 *	* 2.9392 *	* 3.2871 *	* 2.9694 *	* 4.1698 *	* 6.2517 *
11	* .6844 *	* .6008 *	* .6994 *	* .5580 *	* .7101 *	* .6137 *	* .5719 *	* .2999 *
	* 2.9817 *	* 3.4275 *	* 2.9432 *	* 3.7380 *	* 2.9472 *	* 3.4357 *	* 3.6591 *	* 6.9429 *
12	* .5666 *	* .7047 *	* .6297 *	* .7101 *	* .5334 *	* .6244 *	* .4798 *	
	* 3.6103 *	* 2.9057 *	* 3.2921 *	* 2.9492 *	* 3.9565 *	* 3.3900 *	* 4.4253 *	
13	* .5248 *	* .5601 *	* .6983 *	* .6126 *	* .6244 *	* .4745 *	* .3095 *	
	* 3.8960 *	* 3.6622 *	* 2.9715 *	* 3.4384 *	* 3.3900 *	* 4.5035 *	* 6.9541 *	
14	* .4937 *	* .5794 *	* .4980 *	* .5708 *	* .4798 *	* .3095 *		
	* 4.1222 *	* 3.4995 *	* 4.1698 *	* 3.6622 *	* 4.4253 *	* 6.9541 *		
15	* .4263 *	* .3856 *	* .3267 *	* .2999 *	F-SUB-Q			
	* 4.7142 *	* 5.2260 *	* 6.2517 *	* 6.9429 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 109 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 RFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .6833 *	* .9436 *	* .8954 *	* 1.0496 *	* .9029 *	* .8461 *	* .7743 *	* .6415 *
	* 2.7024 *	* 2.2961 *	* 2.5216 *	* 2.1446 *	* 2.4791 *	* 2.6042 *	* 2.8105 *	* 3.3508 *
9	* .9436 *	* .8439 *	* .8600 *	* .9382 *	* 1.0507 *	* .8750 *	* .8761 *	* .5965 *
	* 2.2961 *	* 2.5523 *	* 2.6214 *	* 2.3998 *	* 2.1493 *	* 2.5442 *	* 2.5089 *	* 3.5564 *
10	* .8954 *	* .8589 *	* .8397 *	* 1.0357 *	* .9446 *	* .9917 *	* .7668 *	* .5119 *
	* 2.5216 *	* 2.6249 *	* 2.6852 *	* 2.1944 *	* 2.3940 *	* 2.2787 *	* 2.8881 *	* 4.2142 *
11	* 1.0496 *	* .9382 *	* 1.0346 *	* .8279 *	* .9457 *	* .8407 *	* .7872 *	* .4520 *
	* 2.1446 *	* 2.4012 *	* 2.1956 *	* 2.7134 *	* 2.3017 *	* 2.5971 *	* 2.8534 *	* 4.8464 *
12	* .9029 *	* 1.0496 *	* .9436 *	* .9457 *	* .6555 *	* .7251 *	* .6340 *	
	* 2.4791 *	* 2.1504 *	* 2.3954 *	* 2.3030 *	* 2.7908 *	* 2.5602 *	* 3.2899 *	
13	* .8461 *	* .8761 *	* .9907 *	* .8397 *	* .7240 *	* .5548 *	* .4070 *	
	* 2.6042 *	* 2.5442 *	* 2.2800 *	* 2.5974 *	* 2.5616 *	* 3.1520 *	* 4.7820 *	
14	* .7743 *	* .8761 *	* .7668 *	* .7872 *	* .6330 *	* .4059 *		
	* 2.8105 *	* 2.5073 *	* 2.8860 *	* 2.8537 *	* 3.2926 *	* 4.7828 *		
15	* .6415 *	* .5965 *	* .5119 *	* .4520 *	F-SUB-Q			
	* 3.3508 *	* 3.5964 *	* 4.2142 *	* 4.8464 *	M-SUB-Q			

AT 30% POWER, 4 RFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0174 *	* 1.3698 *	* 1.3441 *	* 1.4748 *	* 1.2831 *	* 1.2670 *	* 1.1974 *	* 1.0592 *
	* 2.0275 *	* 1.7523 *	* 1.7967 *	* 1.6285 *	* 1.8502 *	* 1.8485 *	* 1.9344 *	* 2.1623 *
9	* 1.3698 *	* 1.2841 *	* 1.2627 *	* 1.3366 *	* 1.4448 *	* 1.2606 *	* 1.3323 *	* .9425 *
	* 1.7523 *	* 1.8354 *	* 1.9124 *	* 1.7959 *	* 1.6655 *	* 1.8690 *	* 1.7622 *	* 2.4276 *
10	* 1.3441 *	* 1.2627 *	* 1.1899 *	* 1.4212 *	* 1.3484 *	* 1.3977 *	* 1.1171 *	* .7883 *
	* 1.7967 *	* 1.9142 *	* 2.0206 *	* 1.7157 *	* 1.7927 *	* 1.7469 *	* 2.1159 *	* 2.9170 *
11	* 1.4748 *	* 1.3366 *	* 1.4212 *	* 1.1674 *	* 1.3602 *	* 1.2863 *	* 1.2959 *	* .7176 *
	* 1.6285 *	* 1.7959 *	* 1.7172 *	* 2.0621 *	* 1.7587 *	* 1.8425 *	* 1.8694 *	* 3.2716 *
12	* 1.2831 *	* 1.4437 *	* 1.3473 *	* 1.3591 *	* .9693 *	* 1.1899 *	* 1.0421 *	
	* 1.8502 *	* 1.6655 *	* 1.7935 *	* 1.7602 *	* 2.0891 *	* 1.8137 *	* 2.1893 *	
13	* 1.2670 *	* 1.2606 *	* 1.3966 *	* 1.2863 *	* 1.1899 *	* .9125 *	* .6565 *	
	* 1.8485 *	* 1.8673 *	* 1.7477 *	* 1.8441 *	* 1.8138 *	* 2.2026 *	* 3.2690 *	
14	* 1.1974 *	* 1.3323 *	* 1.1171 *	* 1.2959 *	* 1.0410 *	* .6565 *		
	* 1.9344 *	* 1.7614 *	* 2.1159 *	* 1.8702 *	* 2.1905 *	* 3.2713 *		
15	* 1.0592 *	* .9425 *	* .7883 *	* .7176 *	F-SUB-Q			
	* 2.1623 *	* 2.4261 *	* 2.9191 *	* 3.2742 *	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 110 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 EPPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2659	* 1.6376	* 1.5551	* 1.7040	* 1.4480	* 1.4598	* 1.4126	* 1.2938
	* 1.9250	* 1.6183	* 1.6701	* 1.5085	* 1.7522	* 1.7105	* 1.7492	* 1.8886
9	* 1.6376	* 1.5197	* 1.4544	* 1.5069	* 1.6729	* 1.4491	* 1.5851	* 1.1245
	* 1.6183	* 1.7100	* 1.8070	* 1.7077	* 1.5472	* 1.7249	* 1.5812	* 2.1706
10	* 1.5551	* 1.4544	* 1.3377	* 1.6493	* 1.5326	* 1.6451	* 1.2948	* .9307
	* 1.6701	* 1.8078	* 1.9322	* 1.5998	* 1.6985	* 1.6029	* 1.9760	* 2.6470
11	* 1.7040	* 1.5069	* 1.6483	* 1.3291	* 1.6236	* 1.5455	* 1.5990	* .8718
	* 1.5085	* 1.7077	* 1.6010	* 1.9723	* 1.6121	* 1.6891	* 1.6472	* 2.9141
12	* 1.4480	* 1.6718	* 1.5305	* 1.6215	* 1.2274	* 1.5262	* 1.3002	*
	* 1.7522	* 1.5478	* 1.6999	* 1.6127	* 1.9661	* 1.6201	* 1.9439	*
13	* 1.4598	* 1.4501	* 1.6429	* 1.5444	* 1.5262	* 1.1835	* .8204	*
	* 1.7105	* 1.7235	* 1.6035	* 1.6905	* 1.6201	* 2.0059	* 2.9444	*
14	* 1.4126	* 1.5862	* 1.2938	* 1.5990	* 1.2991	* .8204	*	*
	* 1.7492	* 1.5812	* 1.9741	* 1.6478	* 1.9456	* 2.9447	*	*
15	* 1.2938	* 1.1256	* .9296	* .8707	* F-SUB-Q			
	* 1.8886	* 2.1694	* 2.6487	* 2.9162	* M-SUB-Q			

AT 30% POWER, 4 EPPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4523	* 1.7950	* 1.6675	* 1.8325	* 1.5390	* 1.5615	* 1.5294	* 1.4223
	* 1.9769	* 1.6403	* 1.7015	* 1.5212	* 1.7862	* 1.7226	* 1.7457	* 1.8554
9	* 1.7950	* 1.6750	* 1.5572	* 1.6033	* 1.8089	* 1.5551	* 1.7286	* 1.2274
	* 1.6403	* 1.7454	* 1.8604	* 1.7450	* 1.5570	* 1.7377	* 1.5682	* 2.1528
10	* 1.6675	* 1.5562	* 1.4159	* 1.7896	* 1.6493	* 1.8004	* 1.4159	* 1.0110
	* 1.7015	* 1.8612	* 1.9940	* 1.6144	* 1.7262	* 1.5995	* 1.9902	* 2.6402
11	* 1.8325	* 1.6033	* 1.7886	* 1.4394	* 1.7950	* 1.7115	* 1.7821	* .9639
	* 1.5212	* 1.7457	* 1.6157	* 2.0206	* 1.6106	* 1.6958	* 1.6256	* 2.8873
12	* 1.5390	* 1.8078	* 1.6472	* 1.7929	* 1.4084	* 1.7500	* 1.4651	*
	* 1.7862	* 1.5576	* 1.7283	* 1.6113	* 1.9913	* 1.6069	* 1.9292	*
13	* 1.5615	* 1.5562	* 1.7993	* 1.7104	* 1.7500	* 1.3666	* .9296	*
	* 1.7226	* 1.7363	* 1.6007	* 1.6965	* 1.6069	* 2.0104	* 2.9394	*
14	* 1.5294	* 1.7286	* 1.4159	* 1.7811	* 1.4641	* .9296	*	*
	* 1.7457	* 1.5676	* 1.9883	* 1.6262	* 1.9301	* 2.9415	*	*
15	* 1.4223	* 1.2284	* 1.0100	* .9628	* F-SUB-Q			
	* 1.8554	* 2.1506	* 2.6418	* 2.8913	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 111 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 BFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4683	* 1.8164	* 1.6675	* 1.8400	* 1.5369	* 1.5637	* 1.5401	* 1.4437 *
	* 2.1811	* 1.7902	* 1.8923	* 1.6763	* 1.9799	* 1.8914	* 1.9076	* 2.0091 *
9	* 1.8164	* 1.6900	* 1.5551	* 1.6033	* 1.8282	* 1.5615	* 1.7489	* 1.2301 *
	* 1.7902	* 1.9165	* 2.0792	* 1.9364	* 1.7088	* 1.9102	* 1.7075	* 2.3454 *
10	* 1.6675	* 1.5551	* 1.4105	* 1.8100	* 1.6718	* 1.8325	* 1.4373	* 1.0207 *
	* 1.8923	* 2.0812	* 2.2281	* 1.7763	* 1.9050	* 1.7469	* 2.1877	* 2.8901 *
11	* 1.8400	* 1.6022	* 1.8089	* 1.4523	* 1.8389	* 1.7468	* 1.8271	* .9810 *
	* 1.6763	* 1.9373	* 1.7778	* 2.2120	* 1.7390	* 1.8338	* 1.7463	* 3.1458 *
12	* 1.5369	* 1.8271	* 1.6686	* 1.8378	* 1.4437	* 1.8121	* 1.5069	*
	* 1.9799	* 1.7095	* 1.9085	* 1.7397	* 2.1780	* 1.7372	* 2.0854	*
13	* 1.5637	* 1.5626	* 1.8314	* 1.7457	* 1.8111	* 1.4126	* .9596 *	
	* 1.8914	* 1.9085	* 1.7484	* 1.8354	* 1.7372	* 2.1937	* 3.2031 *	
14	* 1.5401	* 1.7500	* 1.4373	* 1.8261	* 1.5058	* .9596 *		
	* 1.9076	* 1.7075	* 2.1866	* 1.7470	* 2.0865	* 3.2031 *		
15	* 1.4437	* 1.2402	* 1.0196	* .9800	* F-SUB-Q			
	* 2.0091	* 2.3441	* 2.8921	* 3.1481	* M-SUB-Q			

AT 30% POWER, 4 BFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.5048	* 1.8668	* 1.7093	* 1.8903	* 1.5754	* 1.6076	* 1.5883	* 1.4951 *
	* 2.4086	* 1.9579	* 2.0716	* 1.8233	* 2.1569	* 2.0450	* 2.0558	* 2.1493 *
9	* 1.8668	* 1.7339	* 1.5915	* 1.6451	* 1.8850	* 1.6076	* 1.8078	* 1.2798 *
	* 1.9579	* 2.1015	* 2.2506	* 2.1113	* 1.8505	* 2.0627	* 1.8362	* 2.5197 *
10	* 1.7093	* 1.5904	* 1.4426	* 1.8668	* 1.7286	* 1.8967	* 1.4887	* 1.0528 *
	* 2.0716	* 2.2518	* 2.4452	* 1.9114	* 2.0617	* 1.8739	* 2.3645	* 3.1105 *
11	* 1.8903	* 1.6440	* 1.8657	* 1.4951	* 1.9117	* 1.8121	* 1.9032	* 1.0185 *
	* 1.8238	* 2.1124	* 1.9131	* 2.4107	* 1.8786	* 1.9820	* 1.8633	* 3.3557 *
12	* 1.5754	* 1.8839	* 1.7265	* 1.9107	* 1.4983	* 1.8914	* 1.5733	*
	* 2.1569	* 1.8513	* 2.0657	* 1.8795	* 2.3690	* 1.8731	* 2.2452	*
13	* 1.6076	* 1.6086	* 1.8957	* 1.8111	* 1.8914	* 1.4737	* 1.0003	*
	* 2.0450	* 2.0617	* 1.8755	* 1.9831	* 1.8731	* 2.3710	* 3.4572	*
14	* 1.5883	* 1.8078	* 1.4887	* 1.9021	* 1.5722	* 1.0003	*	
	* 2.0558	* 1.8355	* 2.3619	* 1.8641	* 2.2463	* 3.4572	*	
15	* 1.4951	* 1.2809	* 1.0517	* 1.0174	* F-SUB-Q			
	* 2.1493	* 2.5168	* 3.1127	* 3.3583	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 112 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OP MARGIN) - POWER ESCALATION

AT 30% POWER, 4 KFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4716	* 1.8346	* 1.6772	* 1.8614	* 1.5465	* 1.5808	* 1.5647	* 1.4780
	* 2.7525	* 2.1837	* 2.3318	* 2.0369	* 2.4136	* 2.2754	* 2.2802	* 2.3713
9	* 1.8346	* 1.6986	* 1.5583	* 1.6172	* 1.8625	* 1.5829	* 1.7875	* 1.2616
	* 2.1837	* 2.3661	* 2.5365	* 2.3623	* 2.0562	* 2.2923	* 2.0311	* 2.7879
10	* 1.6772	* 1.5583	* 1.4137	* 1.8443	* 1.7093	* 1.8785	* 1.4716	* 1.0378
	* 2.3318	* 2.5365	* 2.7525	* 2.1384	* 2.2971	* 2.0879	* 2.6241	* 3.4384
11	* 1.8614	* 1.6161	* 1.8432	* 1.4705	* 1.8967	* 1.7939	* 1.8892	* 1.0067
	* 2.0369	* 2.3636	* 2.1395	* 2.6909	* 2.1041	* 2.2014	* 2.0611	* 3.7252
12	* 1.5465	* 1.8614	* 1.7061	* 1.8957	* 1.4812	* 1.8796	* 1.5615	*
	* 2.4136	* 2.0581	* 2.3008	* 2.1062	* 2.7111	* 2.1269	* 2.5218	*
13	* 1.5808	* 1.5840	* 1.8775	* 1.7929	* 1.8796	* 1.4598	* .9917	*
	* 2.2754	* 2.2911	* 2.0899	* 2.2025	* 2.1269	* 2.7091	* 3.9462	*
14	* 1.5647	* 1.7875	* 1.4705	* 1.8882	* 1.5604	* .9917	*	*
	* 2.2802	* 2.0302	* 2.6209	* 2.0621	* 2.5232	* 3.9462	*	*
15	* 1.4780	* 1.2627	* 1.0367	* 1.0057	* F-SUB-Q			
	* 2.3713	* 2.7861	* 3.4439	* 3.7284	* M-SUB-Q			

AT 30% POWER, 4 KFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.4105	* 1.7682	* 1.6129	* 1.7993	* 1.4887	* 1.5230	* 1.5101	* 1.4319
	* 3.1716	* 2.5247	* 2.6595	* 2.3045	* 2.7386	* 2.5773	* 2.5803	* 2.6727
9	* 1.7682	* 1.6311	* 1.4962	* 1.5594	* 1.8057	* 1.5272	* 1.7318	* 1.2188
	* 2.5247	* 2.7386	* 2.9313	* 2.6776	* 2.3143	* 2.5911	* 2.2850	* 3.1485
10	* 1.6129	* 1.4951	* 1.3591	* 1.7875	* 1.6558	* 1.8250	* 1.4234	* 1.0014
	* 2.6595	* 2.9352	* 3.1417	* 2.4203	* 2.5865	* 2.3431	* 2.9552	* 3.8648
11	* 1.7993	* 1.5583	* 1.7854	* 1.4180	* 1.8432	* 1.7372	* 1.8357	* .9735
	* 2.3045	* 2.6793	* 2.4230	* 3.1057	* 2.3962	* 2.5277	* 2.3368	* 4.1778
12	* 1.4887	* 1.8036	* 1.6526	* 1.8421	* 1.4319	* 1.8271	* 1.5144	*
	* 2.7386	* 2.3155	* 2.5911	* 2.3976	* 3.0836	* 2.4069	* 2.8768	*
13	* 1.5230	* 1.5283	* 1.8228	* 1.7361	* 1.8271	* 1.4137	* .9596	*
	* 2.5773	* 2.5880	* 2.3444	* 2.5291	* 2.4069	* 3.0924	* 4.4942	*
14	* 1.5101	* 1.7318	* 1.4223	* 1.8346	* 1.5133	* .9596	*	*
	* 2.5803	* 2.2838	* 2.9512	* 2.3393	* 2.8787	* 4.4942	*	*
15	* 1.4319	* 1.2199	* 1.0003	* .9725	* F-SUB-Q			
	* 2.6727	* 3.1463	* 3.8682	* 4.1818	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 113 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.3773	* 1.7329	* 1.5808	* 1.7693	* 1.4608	* 1.4951	* 1.4844	* 1.4126
	* 3.2452	* 2.5865	* 2.8060	* 2.4339	* 2.9057	* 2.7683	* 2.7790	* 2.8979
9	* 1.7329	* 1.5947	* 1.4630	* 1.5315	* 1.7789	* 1.5015	* 1.7072	* 1.2006
	* 2.5865	* 2.8114	* 3.0488	* 2.8428	* 2.4616	* 2.7861	* 2.4630	* 3.4140
10	* 1.5808	* 1.4630	* 1.3302	* 1.7607	* 1.6322	* 1.8004	* 1.4019	* .9842
	* 2.8060	* 3.0488	* 3.3352	* 2.5380	* 2.7455	* 2.4870	* 3.1926	* 4.2391
11	* 1.7693	* 1.5305	* 1.7586	* 1.3923	* 1.8196	* 1.7125	* 1.8153	* .9585
	* 2.4339	* 2.8446	* 2.5410	* 3.2044	* 2.4742	* 2.6273	* 2.4742	* 4.6136
12	* 1.6608	* 1.7768	* 1.6290	* 1.8186	* 1.4094	* 1.8057	* 1.4962	*
	* 2.9057	* 2.4644	* 2.7507	* 2.4757	* 3.1903	* 2.4999	* 3.0086	*
13	* 1.4951	* 1.5026	* 1.7993	* 1.7115	* 1.8057	* 1.3934	* .9457	*
	* 2.7683	* 2.7825	* 2.4899	* 2.6289	* 2.4999	* 3.2428	* 4.7714	*
14	* 1.4844	* 1.7072	* 1.4019	* 1.8143	* 1.4951	* .9457	*	*
	* 2.7790	* 2.4630	* 3.1903	* 2.4757	* 3.0107	* 4.7714	*	*
15	* 1.4126	* 1.2017	* .9842	* .9575	* F-SUB-Q			
	* 2.8979	* 3.4113	* 4.2433	* 4.6188	* M-SUB-Q			

AT 30% POWER, 4 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2863	* 1.6290	* 1.4812	* 1.6675	* 1.3709	* 1.4041	* 1.3966	* 1.3334
	* 3.3532	* 2.6563	* 2.7718	* 2.3791	* 2.8597	* 2.7282	* 2.7299	* 2.8187
9	* 1.6290	* 1.4919	* 1.3698	* 1.4384	* 1.6804	* 1.4126	* 1.6119	* 1.1299
	* 2.6563	* 2.9018	* 3.0596	* 2.7897	* 2.4042	* 3.7316	* 2.3989	* 3.3377
10	* 1.4812	* 1.3687	* 1.2466	* 1.6622	* 1.5390	* 1.7029	* 1.3205	* .9253
	* 2.7718	* 3.0639	* 3.2871	* 2.5174	* 2.7111	* 2.4588	* 3.1303	* 4.1859
11	* 1.6675	* 1.4384	* 1.6600	* 1.3077	* 1.7211	* 1.6151	* 1.7157	* .9018
	* 2.3791	* 2.7897	* 2.5203	* 3.2946	* 2.5247	* 2.6909	* 2.5159	* 4.6089
12	* 1.3709	* 1.6793	* 1.5358	* 1.7200	* 1.3259	* 1.7082	* 1.4126	*
	* 2.8597	* 2.4069	* 2.7162	* 2.5277	* 3.2747	* 2.5515	* 3.0792	*
13	* 1.4041	* 1.4137	* 1.7018	* 1.6140	* 1.7082	* 1.3130	* .8900	*
	* 2.7282	* 2.7299	* 2.4616	* 2.6926	* 2.5515	* 3.3249	* 4.9120	*
14	* 1.3966	* 1.6119	* 1.3205	* 1.7157	* 1.4116	* .8900	*	*
	* 2.7299	* 2.3976	* 3.1281	* 2.5174	* 3.0814	* 4.9120	*	*
15	* 1.3334	* 1.1310	* .9253	* .9018	* F-SUB-Q			
	* 2.8187	* 3.3352	* 4.1899	* 4.6138	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 114 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.2477	* 1.5862	* 1.4426	* 1.6268	* 1.5555	* 1.3698	* 1.3645	* 1.3066
	* 3.2921	* 2.5560	* 2.6465	* 2.2659	* 2.7179	* 2.5666	* 2.5575	* 2.6178
9	* 1.5862	* 1.4501	* 1.3313	* 1.4030	* 1.6429	* 1.3794	* 1.5776	* 1.1042
	* 2.5560	* 2.8078	* 2.9233	* 2.6579	* 2.2886	* 2.5712	* 2.2541	* 3.1101
10	* 1.4426	* 1.3302	* 1.2113	* 1.6247	* 1.5048	* 1.6675	* 1.2916	* .9039
	* 2.6465	* 2.9273	* 3.1440	* 2.3976	* 2.5803	* 2.3393	* 2.9573	* 3.9136
11	* 1.6268	* 1.4019	* 1.6226	* 1.2745	* 1.6847	* 1.5797	* 1.6836	* .8825
	* 2.2659	* 2.6595	* 2.4002	* 3.1600	* 2.4367	* 2.5773	* 2.3896	* 4.3542
12	* 1.3355	* 1.6408	* 1.5018	* 1.6836	* 1.2948	* 1.6740	* 1.3848	*
	* 2.7179	* 2.2911	* 2.5850	* 2.4380	* 3.1973	* 2.4742	* 2.9492	*
13	* 1.3698	* 1.3805	* 1.6654	* 1.5787	* 1.6740	* 1.2841	* .8697	*
	* 2.5666	* 2.5696	* 2.3418	* 2.5788	* 2.4742	* 3.2428	* 4.7194	*
14	* 1.3645	* 1.5776	* 1.2906	* 1.6825	* 1.3837	* .8697	*	*
	* 2.5575	* 2.2529	* 2.9552	* 2.3909	* 2.9512	* 4.7194	*	*
15	* 1.3066	* 1.1053	* .9029	* .8814	* F-SUB-Q			
	* 2.6178	* 3.1079	* 3.9207	* 4.3585	* M-SUB-Q			

AT 30% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.1760	* 1.5015	* 1.3634	* 1.5433	* 1.2638	* 1.2959	* 1.2927	* 1.2413
	* 3.0968	* 2.3989	* 2.4518	* 2.0929	* 2.5203	* 2.3844	* 2.3739	* 2.4271
9	* 1.5015	* 1.3687	* 1.2563	* 1.3291	* 1.5604	* 1.3066	* 1.4983	* 1.0464
	* 2.3989	* 2.6401	* 2.7077	* 2.4602	* 2.1123	* 2.3857	* 2.0849	* 2.8902
10	* 1.3634	* 1.2563	* 1.1438	* 1.5433	* 1.4287	* 1.5851	* 1.2242	* .8557
	* 2.4518	* 2.7111	* 2.9355	* 2.2172	* 2.3844	* 2.1608	* 2.7438	* 3.6407
11	* 1.5433	* 1.3280	* 1.5412	* 1.2059	* 1.6022	* 1.4994	* 1.6022	* .8365
	* 2.0929	* 2.4615	* 2.2195	* 2.9735	* 2.2766	* 2.4149	* 2.2059	* 4.0339
12	* 1.2638	* 1.5594	* 1.4255	* 1.6011	* 1.3263	* 1.5926	* 1.3152	*
	* 2.5203	* 2.1144	* 2.3883	* 2.2778	* 2.9920	* 2.3045	* 2.7595	*
13	* 1.2959	* 1.3077	* 1.5840	* 1.4983	* 1.5926	* 1.2177	* .8247	*
	* 2.3844	* 2.3831	* 2.1630	* 2.4163	* 2.3045	* 3.0254	* 4.4208	*
14	* 1.2927	* 1.4983	* 1.2242	* 1.6011	* 1.3141	* .8247	*	*
	* 2.3739	* 2.0849	* 2.7403	* 2.2070	* 2.7612	* 4.4208	*	*
15	* 1.2413	* 1.0474	* .8547	* .8354	* F-SUB-Q			
	* 2.4271	* 2.8883	* 3.6468	* 4.0376	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 115 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0806	* 1.3869	* 1.2574	* 1.4287	* 1.1642	* 1.1931	* 1.1910	* 1.1460
	* 2.9253	* 2.2647	* 2.3418	* 1.9965	* 2.4176	* 2.2959	* 2.2850	* 2.3330
9	* 1.3869	* 1.2595	* 1.1567	* 1.2263	* 1.4459	* 1.2049	* 1.3859	* .9639
	* 2.2647	* 2.5028	* 2.5896	* 2.3507	* 2.0113	* 2.2923	* 1.9965	* 2.7879
10	* 1.2574	* 1.1556	* 1.0528	* 1.4287	* 1.3195	* 1.4694	* 1.1288	* .7872
	* 2.3418	* 2.5927	* 2.7897	* 2.1072	* 2.2742	* 2.0523	* 2.6321	* 3.5109
11	* 1.4287	* 1.2252	* 1.4276	* 1.1117	* 1.4844	* 1.3848	* 1.4823	* .7700
	* 1.9965	* 2.3520	* 3.1103	* 2.8187	* 2.1479	* 2.2850	* 2.0919	* 3.8613
12	* 1.1642	* 1.4448	* 1.3173	* 1.4833	* 1.1299	* 1.4737	* 1.2145	*
	* 2.4176	* 2.0132	* 2.2790	* 2.1490	* 2.8353	* 2.1804	* 2.6162	*
13	* 1.1931	* 1.2059	* 1.4603	* 1.3837	* 1.4737	* 1.1224	* .7593	*
	* 2.2959	* 2.2911	* 2.0542	* 2.2874	* 2.1793	* 2.8787	* 4.2226	*
14	* 1.1910	* 1.3859	* 1.1288	* 1.4812	* 1.2134	* .7593	*	*
	* 2.2850	* 1.9965	* 2.6289	* 2.0940	* 2.6178	* 4.2267	*	*
15	* 2.1460	* .9650	* .7861	* .7690	F-SUB-Q			
	* 2.3330	* 2.7861	* 3.5137	* 3.8648	M-SUB-Q			

AT 30% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.0249	* 1.3195	* 1.1963	* 1.3612	* 1.1074	* 1.1331	* 1.1310	* 1.0892
	* 2.6876	* 2.0650	* 2.1815	* 1.8658	* 2.2659	* 2.1662	* 2.1576	* 2.2048
9	* 1.3195	* 1.1963	* 1.0988	* 1.1674	* 1.3773	* 1.1449	* 1.3173	* .9146
	* 2.0650	* 2.2898	* 2.4149	* 2.1947	* 1.8763	* 2.1576	* 1.8779	* 2.6369
10	* 1.1963	* 1.0988	* .9992	* 1.3612	* 1.2574	* 1.3998	* 1.0731	* .7465
	* 2.1815	* 2.4190	* 2.6052	* 1.9577	* 2.1175	* 1.9077	* 2.4714	* 3.3148
11	* 1.3612	* 1.1663	* 1.3602	* 1.0571	* 1.4126	* 1.3173	* 1.4116	* .7304
	* 1.8658	* 2.1958	* 1.9604	* 2.5742	* 1.9621	* 2.0859	* 1.9272	* 3.6103
12	* 1.1074	* 1.3762	* 1.2541	* 1.4116	* 1.0731	* 1.4019	* 1.1556	*
	* 2.2659	* 1.8779	* 2.1216	* 1.9648	* 2.6114	* 2.0011	* 2.3949	*
13	* 1.1331	* 1.1460	* 1.3977	* 1.3163	* 1.4019	* 1.0656	* .7197	*
	* 2.1662	* 2.1554	* 1.9102	* 2.0879	* 2.0011	* 2.6595	* 3.9031	*
14	* 1.1310	* 1.3173	* 1.0721	* 1.4105	* 1.1545	* .7197	*	*
	* 2.1576	* 1.8771	* 2.4686	* 1.9281	* 2.3962	* 3.9031	*	*
15	* 1.0892	* .9157	* .7454	* .7294	F-SUB-Q			
	* 2.2048	* 2.6353	* 3.3198	* 3.6133	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 116 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 RFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .9232	* 1.1942	* 1.0806	* 1.2338	* 1.0003	* 1.0185	* 1.0142	* .9768
	* 2.6367	* 2.0340	* 2.1630	* 1.8546	* 2.2671	* 2.1892	* 2.1859	* 2.2378
9	* 1.1942	* 1.0796	* .9928	* 1.0571	* 1.2488	* 1.0303	* 1.1856	* .8193
	* 2.0340	* 2.2576	* 2.3923	* 2.1804	* 1.8602	* 2.1749	* 1.8894	* 2.6809
10	* 1.0806	* .9928	* .9029	* 1.2359	* 1.1374	* 1.2659	* .9639	* .6683
	* 2.1630	* 2.3936	* 2.5865	* 1.9255	* 2.0980	* 1.8820	* 2.4799	* 3.3558
11	* 1.2338	* 1.0560	* 1.2338	* .9543	* 1.2766	* 1.1877	* 1.2702	* .6533
	* 1.8546	* 2.1815	* 1.9281	* 2.5365	* 1.9281	* 2.0650	* 1.8968	* 3.6133
12	* 1.0003	* 1.2477	* 1.1342	* 1.2756	* .9639	* 1.2627	* 1.0378	*
	* 2.2671	* 1.8618	* 2.1021	* 1.9298	* 2.5575	* 1.9568	* 2.3674	*
13	* 1.0185	* 1.0314	* 1.2649	* 1.1867	* 1.2627	* .9553	* .6437	*
	* 2.1892	* 2.1727	* 1.8836	* 2.0660	* 1.9568	* 2.5989	* 3.8510	*
14	* 1.0142	* 1.1867	* .9639	* 1.2691	* 1.0367	* .6437	*	*
	* 2.1859	* 1.8886	* 2.4799	* 1.8977	* 2.3700	* 3.8510	*	*
15	* .9768	* .8193	* .6683	* .6533	* F-SUB-Q			
	* 2.2378	* 2.6793	* 3.3611	* 3.6194	* M-SUB-Q			

AT 30% POWER, 4 RFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* .8472	* 1.0935	* .9928	* 1.1331	* .9221	* .9253	* .9168	* .8739
	* 2.5927	* 1.9892	* 2.1469	* 1.8522	* 2.2623	* 2.2275	* 2.2367	* 2.3155
9	* 1.0935	* .9896	* .9125	* .9768	* 1.1470	* .9403	* 1.0721	* .7368
	* 1.9892	* 2.2093	* 2.3558	* 2.1586	* 1.8499	* 2.2048	* 1.5347	* 2.7595
10	* .9928	* .9125	* .8332	* 1.1363	* 1.0464	* 1.1578	* .8750	* .6030
	* 2.1469	* 2.3571	* 2.5575	* 1.8960	* 2.0719	* 1.8658	* 2.4728	* 3.4330
11	* 1.1331	* .9768	* 1.1353	* .8814	* 1.1642	* 1.0839	* 1.1438	* .5858
	* 1.8522	* 2.1597	* 1.8985	* 2.4672	* 1.8853	* 2.0264	* 1.8985	* 3.6653
12	* .9221	* 1.1460	* 1.0442	* 1.1631	* .8793	* 1.1417	* .9361	*
	* 2.2623	* 1.8515	* 2.0759	* 1.8878	* 2.5425	* 1.9595	* 2.3648	*
13	* .9253	* .9403	* 1.1567	* 1.0828	* 1.1417	* .8632	* .5794	*
	* 2.2275	* 2.2025	* 1.8674	* 2.0273	* 1.9595	* 2.6257	* 3.8960	*
14	* .9168	* 1.0721	* .8750	* 1.1428	* .9350	* .5783	*	*
	* 2.2367	* 1.9247	* 2.4728	* 1.8993	* 2.3674	* 3.8995	*	*
15	* .8739	* .7368	* .6019	* .5858	* F-SUB-Q			
	* 2.3155	* 2.7577	* 3.4357	* 3.6715	* M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 117 of 143

TABLE 2 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q OF MARGIN) - POWER ESCALATION

AT 30% POWER, 4 EFPD, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.7326	.9264	.8407	.9725	.8011	.7797	.7551	.6951
	* 2.7548	* 2.1815	* 2.3661	* 2.0216	* 2.4518	* 2.5014	* 2.5635	* 2.7438
9	.9264	.8418	.7765	.8493	.9800	.8054	.8804	.6008
	* 2.1815	* 2.4069	* 2.5819	* 2.3255	* 2.0188	* 2.4422	* 2.2014	* 3.1926
10	.8407	.7765	.7261	.9757	.9039	.9821	.7358	.4959
	* 2.3661	* 2.5819	* 2.7403	* 2.0494	* 2.2252	* 2.0397	* 2.7351	* 3.9136
11	.9725	.8482	.9746	.7743	.9917	.9125	.9211	.4723
	* 2.0216	* 2.3267	* 2.0513	* 2.6114	* 2.0455	* 2.2286	* 2.1892	* 4.2350
12	.8011	.9800	.9018	.9907	.7529	.9393	.7604	
	* 2.4518	* 2.0207	* 2.2286	* 2.0484	* 2.7265	* 2.1837	* 2.6876	
13	.7797	.8054	.9810	.9125	.9393	.7165	.4745	
	* 2.5014	* 2.4422	* 2.0417	* 2.2297	* 2.1837	* 2.8863	* 4.3629	
14	.7551	.8804	.7358	.9211	.7593	.4745		
	* 2.5635	* 2.2014	* 2.7351	* 2.1903	* 2.6893	* 4.3673		
15	.6951	.6008	.4969	.4723	F-SUB-Q			
	* 2.7438	* 3.1903	* 3.9207	* 4.2391	M-SUB-Q			

AT 30% POWER, 4 EFPD, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	.4766	.6030	.5184	.6276	.5194	.4798	.4498	.3866
	* 3.1762	* 3.6684	* 3.9421	* 3.4248	* 2.9037	* 3.6622	* 3.4995	* 5.2260
9	.6030	.5237	.4830	.5516	.6469	.5130	.5280	.3513
	* 4.0414	* 3.1762	* 3.6653	* 2.9817	* 3.6103	* 3.8960	* 4.1222	* 4.7142
10	.5184	.4830	.4745	.6426	.5783	.6405	.4562	.2977
	* 3.6653	* 3.9457	* 3.9967	* 2.9392	* 3.2871	* 2.9694	* 4.1698	* 6.2517
11	.6276	.5516	.6415	.5130	.6522	.5623	.5226	.2731
	* 2.9817	* 3.4275	* 2.9432	* 3.7380	* 2.9472	* 3.4357	* 3.6591	* 6.9429
12	.5194	.6469	.5773	.6512	.4894	.5719	.4380	
	* 3.6103	* 2.9057	* 3.2921	* 2.9492	* 3.9565	* 3.3900	* 4.4253	
13	.4798	.5130	.6405	.5623	.5719	.4338	.2817	
	* 3.8960	* 3.6622	* 2.9715	* 3.4384	* 3.3900	* 4.5035	* 6.9541	
14	.4498	.5280	.4552	.5216	.4380	.2817		
	* 4.1222	* 3.4995	* 4.1698	* 3.6622	* 4.4253	* 6.9541		
15	.3866	.3513	.2967	.2720	F-SUB-Q			
	* 4.7142	* 5.2260	* 6.2517	* 6.9429	M-SUB-Q			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 118 of 143

TABLE 3

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	2.5226	2.1527	2.4788	2.1978	2.5330	2.6412	2.8336	3.2712
	2.4458	2.1367	2.3158	1.9956	2.2660	2.3572	2.5166	2.8866
	2.1563	1.9447	2.1552	1.8817	2.1049	2.1500	2.2558	2.4836
9	2.1527	2.4039	2.5370	2.4231	2.1733	2.5784	2.5307	3.5365
	2.1367	2.3631	2.3714	2.1936	1.9868	2.2989	2.2659	3.1204
	1.9447	2.1475	2.1820	2.0457	1.8701	2.1147	2.0462	2.7280
10	2.4788	2.5385	2.6031	2.1647	2.4015	2.2322	2.8909	4.0763
	2.3158	2.3732	2.3912	2.0134	2.1952	2.0769	2.5909	3.5357
	2.1552	2.1842	2.2010	1.8931	2.0378	1.9266	2.3256	2.9871
11	2.1978	2.4237	2.1662	2.5483	2.1776	2.4745	2.6657	4.4815
	1.9956	2.1936	2.0147	2.4279	2.1127	2.3725	2.5390	4.0063
	1.8817	2.0457	1.8937	2.1846	1.9224	2.1366	2.2480	3.3321
12	2.5330	2.1737	2.4028	2.1776	2.6213	2.4137	3.0612	
	2.2660	1.8668	2.1567	2.1127	2.4668	2.3120	2.9205	
	2.1049	1.8701	2.0384	1.9224	2.1317	2.0221	2.5512	
13	2.6412	2.5784	2.2338	2.4759	2.4137	2.9368	4.2941	
	2.3572	2.2989	2.0769	2.3725	2.3120	2.7859	4.0022	
	2.1500	2.1140	1.9266	2.1366	2.0221	2.4068	3.2483	
14	2.8336	2.5307	2.8909	2.6657	3.0641	4.2941		
	2.5166	2.2643	2.5889	2.5390	2.9205	4.0038		
	2.2558	2.0456	2.3256	2.2480	2.5533	3.2494		
15	3.2712	3.5365	4.0763	4.4835	4	EFPD 118 % POWER		
	2.8866	3.1203	3.5396	4.0063	100	EFPD 118 % POWER		
	2.4836	2.7280	2.9871	3.3321	350	EFPD 118 % POWER		

THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	1.8652	1.6160	1.7383	1.6353	1.8579	1.8427	1.9178	2.0787
	1.8519	1.6265	1.6717	1.5046	1.6968	1.6958	1.7669	1.8996
	1.8321	1.6048	1.7291	1.5105	1.7243	1.7191	1.7746	1.8467
9	1.6160	1.7011	1.8047	1.7803	1.6526	1.8634	1.7488	2.3497
	1.6265	1.7149	1.7465	1.6422	1.5220	1.7069	1.6070	2.1591
	1.6048	1.7371	1.7767	1.6715	1.5174	1.7173	1.6113	2.1063
10	1.7383	1.8047	1.9401	1.6438	1.7565	1.6669	2.0466	2.7787
	1.6717	1.7484	1.8126	1.5534	1.6388	1.5767	1.9181	2.4870
	1.7291	1.7777	1.8155	1.5475	1.6601	1.5682	1.8808	2.3205
11	1.6353	1.7810	1.6447	1.9064	1.6403	1.7289	1.7179	2.9658
	1.5046	1.6430	1.5542	1.8479	1.6024	1.6997	1.6959	2.7679
	1.5105	1.6715	1.5475	1.8111	1.5703	1.7020	1.7076	2.5654
12	1.8579	1.6532	1.7578	1.6411	1.9309	1.6822	2.0079	
	1.6968	1.5220	1.6396	1.6033	1.8636	1.6594	1.9969	
	1.7243	1.5174	1.6605	1.5711	1.8083	1.6191	1.9735	
13	1.8427	1.8623	1.6678	1.7295	1.6822	2.0218	2.8947	
	1.6958	1.7069	1.5767	1.6997	1.6594	1.9793	2.7835	
	1.7191	1.7168	1.5682	1.7020	1.6191	1.8928	2.5165	
14	1.9178	1.7488	2.0466	1.7188	2.0091	2.8965		
	1.7669	1.6070	1.9181	1.6959	1.9978	2.7860		
	1.7746	1.6113	1.8808	1.7076	1.9743	2.5185		
15	2.0787	2.3497	2.7811	2.9666	4	EFPD 118 % POWER		
	1.8996	2.1576	2.4889	2.7680	100	EFPD 118 % POWER		
	1.8467	2.1070	2.3214	2.5654	350	EFPD 118 % POWER		

Page 119 of 143

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM) THIS IS LEVEL 16 OF 18

	H	G	F	E	D	C	B	A
8	1.7183	1.4442	1.5673	1.4587	1.6996	1.6454	1.6752	1.7597
	1.7225	1.4554	1.5242	1.3527	1.5650	1.5390	1.5774	1.6489
	1.7680	1.3059	1.6421	1.4077	1.6425	1.6256	1.6636	1.6930
9	1.4442	1.5355	1.6466	1.6415	1.4820	1.6593	1.5144	2.0382
	1.4654	1.5651	1.6195	1.5169	1.3691	1.5488	1.4194	1.9215
	1.5059	1.6543	1.7027	1.5929	1.4115	1.6289	1.4913	1.9613
10	1.5673	1.6475	1.7938	1.4794	1.5940	1.4803	1.8265	2.4483
	1.5242	1.6211	1.6959	1.4007	1.5068	1.4073	1.7562	2.2418
	1.6421	1.7036	1.7421	1.4411	1.5762	1.4533	1.7894	2.1798
11	1.4587	1.6421	1.4801	1.7683	1.4513	1.5304	1.4636	2.5635
	1.3527	1.5177	1.4013	1.7172	1.4357	1.5275	1.4759	2.4714
	1.4077	1.5929	1.4411	1.7380	1.4643	1.6045	1.5829	2.4137
12	1.6996	1.4825	1.5956	1.4519	1.7598	1.4514	1.7288	
	1.5650	1.3697	1.5082	1.4364	1.7234	1.4622	1.7690	
	1.6425	1.4115	1.5770	1.4643	1.7435	1.5078	1.8465	
13	1.6454	1.6584	1.4810	1.5312	1.4516	1.7789	2.5391	
	1.5390	1.5481	1.4080	1.5275	1.4622	1.7716	2.4964	
	1.6256	1.6285	1.4533	1.6050	1.5074	1.7884	2.3729	
14	1.6752	1.5137	1.8268	1.4643	1.7294	2.5391		
	1.5774	1.4188	1.7562	1.4759	1.7693	2.4978		
	1.6636	1.4910	1.7894	1.5829	1.8469	2.3735		
15	1.7597	2.0368	2.4502	2.5649	4	EFPD 118 % POWER		
	1.6489	1.9204	2.2434	2.4733	100	EFPD 118 % POWER		
	1.6930	1.9620	2.1806	2.4156	350	EFPD 118 % POWER		

THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 1.7031	* 1.4106	* 1.5390	* 1.4032	* 1.6563	* 1.5922	* 1.6093	* 1.6645 *
	* 1.7151	* 1.4406	* 1.5113	* 1.3190	* 1.5476	* 1.5178	* 1.5408	* 1.5930 *
	* 1.7970	* 1.5108	* 1.6642	* 1.4081	* 1.6572	* 1.6386	* 1.6671	* 1.6812 *
9	* 1.4106	* 1.5114	* 1.6306	* 1.6009	* 1.4205	* 1.6074	* 1.4382	* 1.9499 *
	* 1.4406	* 1.5545	* 1.6217	* 1.5026	* 1.3290	* 1.5237	* 1.3724	* 1.8734 *
	* 1.5108	* 1.6758	* 1.7364	* 1.6108	* 1.4075	* 1.6408	* 1.4844	* 1.9638 *
10	* 1.5390	* 1.6311	* 1.7843	* 1.4353	* 1.5533	* 1.4205	* 1.7664	* 2.3552 *
	* 1.5113	* 1.6234	* 1.6959	* 1.3635	* 1.4814	* 1.3605	* 1.7266	* 2.1974 *
	* 1.6642	* 1.7378	* 1.7724	* 1.4398	* 1.5885	* 1.4464	* 1.8062	* 2.1956 *
11	* 1.4032	* 1.6017	* 1.4363	* 1.7456	* 1.3922	* 1.4763	* 1.3904	* 2.4565 *
	* 1.3190	* 1.5033	* 1.3641	* 1.7072	* 1.3908	* 1.4917	* 1.4252	* 2.4220 *
	* 1.4081	* 1.6108	* 1.4405	* 1.7611	* 1.4614	* 1.6128	* 1.5841	* 2.4407 *
12	* 1.6563	* 1.4211	* 1.5553	* 1.3928	* 1.7149	* 1.3819	* 1.6514	* 2.4552 *
	* 1.5476	* 1.3295	* 1.4828	* 1.3914	* 1.7080	* 1.4147	* 1.7252	* 2.4552 *
	* 1.6572	* 1.4075	* 1.5889	* 1.4614	* 1.7683	* 1.5079	* 1.8549	* 2.4552 *
13	* 1.5922	* 1.6058	* 1.4212	* 1.4770	* 1.3819	* 1.7123	* 2.4505	* 2.4505 *
	* 1.5178	* 1.5222	* 1.3611	* 1.4925	* 1.4147	* 1.7369	* 2.4552	* 2.4552 *
	* 1.6386	* 1.6403	* 1.4464	* 1.6131	* 1.5079	* 1.8052	* 2.4008	* 2.4008 *
14	* 1.6093	* 1.4381	* 1.7668	* 1.3906	* 1.6523	* 2.4505	* 2.4505	* 2.4505 *
	* 1.5408	* 1.3724	* 1.7266	* 1.4258	* 1.7262	* 2.4558	* 2.4558	* 2.4558 *
	* 1.6671	* 1.4844	* 1.8062	* 1.5845	* 1.8549	* 2.4026	* 2.4026	* 2.4026 *
15	* 1.6645	* 1.9475	* 2.3569	* 2.4584	* 4 EFPD	118 % POWER		
	* 1.5930	* 1.8723	* 2.1989	* 2.4239	* 100 EFPD	118 % POWER		
	* 1.6812	* 1.9650	* 2.1964	* 2.4407	* 350 EFPD	118 % POWER		

Page 120 of 143

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

	H	G	F	E	D	C	B	A
8	1.8825	1.5174	1.6564	1.4977	1.7907	1.7093	1.7177	1.7518
	1.8792	1.5541	1.7219	1.4738	1.7525	1.7060	1.7144	1.7486
	1.9749	1.6234	1.8612	1.5719	1.8691	1.8479	1.6692	1.8677
9	1.5174	1.6417	1.7706	1.7205	1.4941	1.7158	1.5107	2.0758
	1.5541	1.6873	1.8288	1.7051	1.4766	1.7060	1.5135	2.0799
	1.6234	1.8187	1.9524	1.8125	1.5661	1.8468	1.6464	2.1965
10	1.6564	1.7706	1.9427	1.5107	1.6350	1.4715	1.8527	2.5054
	1.7219	1.8299	1.9296	1.5078	1.6507	1.4924	1.9403	2.4656
	1.8612	1.9529	1.9828	1.5819	1.7577	1.5762	2.0353	2.4688
11	1.4977	1.7205	1.5122	1.8769	1.4611	1.5476	1.4329	2.5749
	1.4738	1.7051	1.5090	1.8580	1.4841	1.5965	1.5326	2.7129
	1.5719	1.8125	1.5823	1.9106	1.5596	1.7346	1.6886	2.7246
12	1.7907	1.4948	1.6375	1.4625	1.8581	1.4543	1.7356	
	1.7525	1.4773	1.6524	1.4848	1.8823	1.5224	1.8598	
	1.8691	1.5661	1.7587	1.5604	1.9530	1.6366	2.0128	
13	1.7093	1.7139	1.4715	1.5491	1.4543	1.8387	2.6329	
	1.7060	1.7051	1.4931	1.5968	1.5224	1.9075	2.6894	
	1.8479	1.8457	1.5768	1.7348	1.6359	1.9995	2.6493	
14	1.7177	1.5107	1.8538	1.4336	1.7365	2.6329		
	1.7144	1.5127	1.9403	1.5334	1.8609	2.6917		
	1.8692	1.6456	2.0353	1.6886	2.0128	2.6516		
15	1.7518	2.0744	2.5074	2.5770	4	EFPD 118 % POWER		
	1.7486	2.0785	2.4675	2.7153	100	EFPD 118 % POWER		
	1.8677	2.1965	2.4688	2.7270	350	EFPD 118 % POWER		

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 121 of 143

TABLE 3 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 2.0732	* 1.6581	* 1.6777	* 1.6329	* 1.9624	* 1.8579	* 1.8546	* 1.8789
	* 2.0474	* 1.6743	* 1.8590	* 1.6350	* 1.9596	* 1.8993	* 1.9016	* 1.9296
	* 2.1363	* 1.7427	* 2.0015	* 1.6930	* 2.0322	* 2.0198	* 2.0403	* 2.0293
9	* 1.6581	* 1.8022	* 1.9467	* 1.8817	* 1.6201	* 1.8683	* 1.6355	* 2.2379
	* 1.6743	* 1.8256	* 1.9793	* 1.8745	* 1.6125	* 1.8971	* 1.6725	* 2.3051
	* 1.7427	* 1.9642	* 2.1071	* 1.8498	* 1.6738	* 1.9917	* 1.7850	* 2.3917
10	* 1.8177	* 1.9478	* 2.1335	* 1.6380	* 1.7709	* 1.5839	* 2.0074	* 2.7273
	* 1.8590	* 1.9793	* 2.0881	* 1.6294	* 1.7917	* 1.6063	* 2.1331	* 2.7400
	* 2.0015	* 2.1085	* 2.1371	* 1.6880	* 1.8891	* 1.6840	* 2.1839	* 2.6791
11	* 1.6329	* 1.8817	* 1.6398	* 2.0477	* 1.5719	* 1.6715	* 1.5400	* 2.7900
	* 1.6350	* 1.8745	* 1.6303	* 2.0057	* 1.6045	* 1.7322	* 1.6570	* 2.9366
	* 1.6530	* 1.7428	* 1.6880	* 2.0607	* 1.6689	* 1.8643	* 1.8124	* 2.9170
12	* 1.9624	* 1.6210	* 1.7729	* 1.5735	* 2.0112	* 1.5601	* 1.8684	*
	* 1.9596	* 1.6133	* 1.7937	* 1.6053	* 2.0408	* 1.6428	* 2.0138	*
	* 2.0322	* 1.6738	* 1.8906	* 1.5698	* 2.0994	* 1.7501	* 2.1554	*
13	* 1.8579	* 1.8672	* 1.5847	* 1.6724	* 1.5601	* 1.9785	* 2.8377	*
	* 1.8993	* 1.8959	* 1.6077	* 1.7331	* 1.6428	* 2.0634	* 2.9122	*
	* 2.0198	* 1.9909	* 1.6849	* 1.8649	* 1.7501	* 2.1387	* 2.8337	*
14	* 1.8546	* 1.6355	* 2.0074	* 1.5400	* 1.8695	* 2.8403	*	*
	* 1.9016	* 1.6725	* 2.1342	* 1.6570	* 2.0138	* 2.9122	*	*
	* 2.0403	* 1.7847	* 2.1839	* 1.8124	* 2.1554	* 2.8363	*	*
15	* 1.8789	* 2.2363	* 2.7296	* 2.7925	* 4 EFPD 118 % POWER			
	* 1.9296	* 2.3034	* 2.7424	* 2.9375	* 100 EFPD 118 % POWER			
	* 2.0293	* 2.3918	* 2.6792	* 2.9170	* 350 EFPD 118 % POWER			

THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 2.1034	* 1.8498	* 2.0303	* 1.8323	* 2.2035	* 2.0730	* 2.0622	* 2.0773
	* 2.1000	* 1.8645	* 2.0799	* 1.8214	* 2.1943	* 2.1671	* 2.1716	* 2.1897
	* 2.3845	* 1.9253	* 2.2212	* 1.8736	* 2.2630	* 2.2505	* 2.2667	* 2.2484
9	* 1.8498	* 2.0121	* 2.1871	* 2.1119	* 1.8142	* 2.0881	* 1.8173	* 2.4870
	* 1.8645	* 2.0461	* 2.2221	* 2.0909	* 1.7995	* 2.1494	* 1.8886	* 2.6258
	* 1.9253	* 2.1819	* 2.3430	* 2.1640	* 1.8469	* 2.2079	* 1.9717	* 2.6516
10	* 2.0303	* 2.1671	* 2.3781	* 1.8404	* 1.9897	* 1.7693	* 2.2559	* 3.0445
	* 2.0799	* 2.2221	* 2.3375	* 1.8037	* 1.9855	* 1.7870	* 2.3799	* 3.0953
	* 2.2212	* 2.3441	* 2.3727	* 1.8563	* 2.0757	* 1.8431	* 2.4135	* 2.9655
11	* 1.8323	* 2.1134	* 1.8426	* 2.3084	* 1.7573	* 1.8762	* 1.7176	* 3.1379
	* 1.8214	* 2.0909	* 1.8047	* 2.2395	* 1.7772	* 1.9260	* 1.8341	* 3.2653
	* 1.8736	* 2.1640	* 1.8569	* 2.2798	* 1.8317	* 2.0517	* 1.9806	* 3.2146
12	* 2.2035	* 1.8152	* 1.9935	* 1.7583	* 2.2640	* 1.7406	* 2.0914	*
	* 2.1943	* 1.8006	* 1.9893	* 1.7792	* 2.2735	* 1.8277	* 2.2395	*
	* 2.2630	* 1.8469	* 2.0779	* 1.8328	* 2.3366	* 1.9306	* 2.3746	*
13	* 2.0730	* 2.0868	* 1.7703	* 1.8772	* 1.7406	* 2.2178	* 3.1856	*
	* 2.1671	* 2.1479	* 1.7883	* 1.9272	* 1.8277	* 2.2983	* 3.2351	*
	* 2.2505	* 2.2070	* 1.8437	* 2.0517	* 1.9301	* 2.3666	* 3.1400	*
14	* 2.0622	* 1.8163	* 2.2559	* 1.7185	* 2.0928	* 3.1887	*	*
	* 2.1716	* 1.8886	* 2.3799	* 1.8351	* 2.2411	* 3.2351	*	*
	* 2.2667	* 1.9717	* 2.4135	* 1.9806	* 2.3753	* 3.1413	*	*
15	* 2.0773	* 2.4850	* 3.0474	* 3.1410	* 4 EFPD 118 % POWER			
	* 2.1897	* 2.6258	* 3.0983	* 3.2687	* 100 EFPD 118 % POWER			
	* 2.2484	* 2.6516	* 2.9671	* 3.2159	* 350 EFPD 118 % POWER			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 122 of 143

TABLE 3 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 2.4407	* 1.9631	* 2.1553	* 1.9183	* 2.3255	* 2.2332	* 2.2395	* 2.2618
	* 2.5432	* 2.0488	* 2.2850	* 1.9880	* 2.4017	* 2.3692	* 2.3817	* 2.4146
	* 2.6384	* 2.1219	* 2.4701	* 2.0747	* 2.5163	* 2.5016	* 2.5070	* 2.4730
9	* 1.9631	* 2.1377	* 2.2983	* 2.2237	* 1.9065	* 2.2316	* 1.9459	* 2.7160
	* 2.0488	* 2.2572	* 2.4464	* 2.2900	* 1.9620	* 2.3445	* 2.0689	* 2.8829
	* 2.1219	* 2.4171	* 2.6044	* 2.4035	* 2.0396	* 2.4457	* 2.1720	* 2.9196
10	* 2.1553	* 2.2983	* 2.5248	* 1.9302	* 2.1035	* 1.8846	* 2.4109	* 3.2857
	* 2.2850	* 2.4464	* 2.5723	* 1.9718	* 2.1731	* 1.9499	* 2.5998	* 3.3629
	* 2.4701	* 2.6066	* 2.6372	* 2.0457	* 2.2917	* 2.0250	* 2.6641	* 3.2653
11	* 1.9183	* 2.2253	* 1.9314	* 2.4626	* 1.8743	* 2.0057	* 1.8487	* 3.3918
	* 1.9880	* 2.2916	* 1.9731	* 2.4617	* 1.9427	* 2.1091	* 2.0096	* 3.5564
	* 2.0747	* 2.4035	* 2.0470	* 2.5228	* 2.0095	* 2.2599	* 2.1712	* 3.5324
12	* 2.3255	* 1.9077	* 2.1077	* 1.8755	* 2.4239	* 1.8777	* 2.2588	*
	* 2.4017	* 1.9632	* 2.1761	* 1.9439	* 2.5048	* 1.9994	* 2.4483	*
	* 2.5163	* 2.0396	* 2.2951	* 2.0100	* 2.5694	* 2.1076	* 2.5948	*
13	* 2.2332	* 2.2300	* 1.8857	* 2.0070	* 1.8777	* 2.4201	* 3.4818	*
	* 2.3692	* 2.3445	* 1.9511	* 2.1105	* 1.9994	* 2.5228	* 3.5444	*
	* 2.5016	* 2.4457	* 2.0250	* 2.2599	* 2.1070	* 2.5884	* 3.4257	*
14	* 2.2395	* 1.9447	* 2.4109	* 1.8498	* 2.2588	* 3.4818	*	*
	* 2.3817	* 2.0689	* 2.5998	* 2.0096	* 2.4502	* 3.5484	*	*
	* 2.5070	* 2.1710	* 2.6641	* 2.1712	* 2.5970	* 3.4294	*	*
15	* 2.2618	* 2.7117	* 3.2892	* 3.3918	* 4 HFPD 118 % POWER			
	* 2.4146	* 2.8829	* 3.3665	* 3.5564	* 100 HFPD 118 % POWER			
	* 2.4730	* 2.9205	* 3.2653	* 3.5340	* 350 HFPD 118 % POWER			

THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	* 2.4276	* 1.9386	* 2.1363	* 1.9112	* 2.3135	* 2.2491	* 2.2443	* 2.2634
	* 2.5660	* 2.0826	* 2.3220	* 2.0251	* 2.4560	* 2.4407	* 2.4656	* 2.5148
	* 2.8776	* 2.3272	* 2.7024	* 2.2916	* 2.7787	* 2.7640	* 2.7811	* 2.7472
9	* 1.9386	* 2.1233	* 2.2817	* 2.2128	* 1.9054	* 2.2427	* 1.9435	* 2.7187
	* 2.0826	* 2.2883	* 2.4753	* 2.3375	* 1.9968	* 2.4035	* 2.1291	* 3.0096
	* 2.3272	* 2.6412	* 2.8439	* 2.6546	* 2.2588	* 2.7071	* 2.4090	* 3.2485
10	* 2.1363	* 2.2817	* 2.5048	* 1.9302	* 2.1063	* 1.8789	* 2.4164	* 3.3344
	* 2.3220	* 2.4753	* 2.6215	* 2.0057	* 2.2143	* 1.9868	* 2.6772	* 3.5325
	* 2.7024	* 2.8439	* 2.9042	* 2.2637	* 2.5370	* 2.2475	* 2.9559	* 3.6260
11	* 1.9112	* 2.2143	* 1.9326	* 2.4389	* 1.8687	* 2.0070	* 1.8421	* 3.4400
	* 2.0251	* 2.3393	* 2.0070	* 2.5188	* 1.9768	* 2.1553	* 2.0662	* 3.7378
	* 2.2916	* 2.6546	* 2.2653	* 2.7885	* 2.2269	* 2.5028	* 2.4090	* 3.9289
12	* 2.3135	* 1.9065	* 2.1105	* 1.8698	* 2.4332	* 1.8709	* 2.2588	*
	* 2.4560	* 1.9981	* 2.2175	* 1.9780	* 2.5702	* 2.0488	* 2.5228	*
	* 2.7787	* 2.2588	* 2.5411	* 2.2269	* 2.8439	* 2.3358	* 2.8776	*
13	* 2.2491	* 2.2411	* 1.8800	* 2.0083	* 1.8709	* 2.4351	* 3.5365	*
	* 2.4407	* 2.4035	* 1.9880	* 2.1553	* 2.0474	* 2.6106	* 3.7158	*
	* 2.7640	* 2.7071	* 2.2475	* 2.5048	* 2.3341	* 2.8698	* 3.8056	*
14	* 2.2443	* 1.9435	* 2.4183	* 1.8432	* 2.2604	* 3.5365	*	*
	* 2.4656	* 2.1291	* 2.6772	* 2.0662	* 2.5228	* 3.7158	*	*
	* 2.7811	* 2.4090	* 2.9559	* 2.4090	* 2.8776	* 3.8102	*	*
15	* 2.2634	* 2.7164	* 3.3344	* 3.4400	* 4 HFPD 118 % POWER			
	* 2.5148	* 3.0096	* 3.5365	* 3.7378	* 100 HFPD 118 % POWER			
	* 2.7472	* 3.2485	* 3.6302	* 3.9338	* 350 HFPD 118 % POWER			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 123 of 143

TABLE 3 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	2.3135	1.8345	2.0173	1.7994	2.1806	2.0993	2.0895	2.0927
	2.3980	1.9355	2.1582	1.8902	2.2833	2.2718	2.3019	2.3222
	2.6636	2.1465	2.5008	2.1233	2.5744	2.5681	2.5870	2.5556
9	1.8345	2.0147	2.1627	2.0868	1.8005	2.0979	1.8184	2.5168
	1.9355	2.1319	2.3067	2.1791	1.8801	2.2523	1.9970	2.7863
	2.1465	2.4445	2.6368	2.4579	2.0979	2.5188	2.2459	3.0211
10	2.0173	2.1627	2.3763	1.8205	1.9981	1.7911	2.2983	3.1044
	2.1582	2.3084	2.4445	1.8868	2.0923	1.8812	2.5269	3.2792
	2.5008	2.6368	2.6909	2.1021	2.3638	2.0951	2.7568	3.3809
11	1.7994	2.0881	1.8227	2.3084	1.7901	1.9190	1.7617	3.2451
	1.8902	2.1806	1.8891	2.3585	1.8711	2.0448	1.9547	3.4972
	2.1233	2.4598	2.1035	2.5913	2.0771	2.3375	2.2507	3.6725
12	2.1806	1.8015	2.0019	1.7911	2.3152	1.7943	2.1612	
	2.2833	1.8812	2.0965	1.8723	2.4183	1.9379	2.3853	
	2.5744	2.0979	2.3656	2.0785	2.6479	2.1806	2.6863	
13	2.0993	2.0965	1.7922	1.9202	1.7943	2.3272	3.3629	
	2.2718	2.2507	1.8823	2.0448	1.9379	2.4694	3.4895	
	2.5681	2.5188	2.0965	2.3375	2.1806	2.6840	3.5564	
14	2.0895	1.8184	2.2983	1.7627	2.1627	3.3629		
	2.3019	1.9970	2.5269	1.9559	2.3871	3.4895		
	2.5870	2.2459	2.7544	2.2507	2.6863	3.5564		
15	2.0927	2.5148	3.1075	3.2485	4 BFPD 118 % POWER			
	2.3222	2.7863	3.2826	3.5011	100 BFPD 118 % POWER			
	2.5556	3.0240	3.3845	3.6725	350 BFPD 118 % POWER			

THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8	2.1943	1.7131	1.8723	1.6610	2.0096	1.9278	1.9278	1.9362
	2.2715	1.8138	2.0092	1.7434	2.1183	2.0899	2.0908	2.1042
	2.4579	1.9843	2.3034	1.9537	2.3807	2.3616	2.3638	2.3189
9	1.7131	1.8902	2.0134	1.9319	1.6627	1.9254	1.6717	2.3265
	1.8138	2.0003	2.1505	2.0218	1.7186	2.0642	1.8084	2.5334
	1.9843	2.2556	2.4257	2.2784	1.9418	2.3214	2.0513	2.7471
10	1.8723	2.0134	2.2035	1.6908	1.8590	1.6592	2.1291	2.8467
	2.0092	2.1520	2.2780	1.7338	1.9184	1.7102	2.3041	2.9905
	2.3034	2.4257	2.4909	1.9511	2.2004	1.9427	2.5283	3.0739
11	1.6610	1.9319	1.6926	2.1553	1.6726	1.7873	1.6305	2.9811
	1.7434	2.0231	1.7357	2.1981	1.7139	1.8684	1.7697	3.1774
	1.9637	2.2784	1.9523	2.4072	1.9272	2.1761	2.0791	3.3475
12	2.0096	1.6645	1.8623	1.6726	2.1837	1.6807	2.0096	
	2.1183	1.7196	1.9208	1.7158	2.2774	1.7807	2.1753	
	2.3807	1.9418	2.2020	1.9284	2.4675	2.0277	2.4933	
13	1.9278	1.9242	1.6601	1.7883	1.6807	2.1837	3.1229	
	2.0899	2.0628	1.7112	1.8695	1.7807	2.2741	3.2065	
	2.3616	2.3214	1.9427	2.1761	2.0264	2.5008	3.2968	
14	1.9278	1.6717	2.1291	1.6305	2.0096	3.1229		
	2.0908	1.8083	2.3041	1.7697	2.1767	3.2098		
	2.3638	2.0513	2.5283	2.0791	2.4933	3.2970		
15	1.9362	2.3237	2.8493	2.9839	4 BFPD 118 % POWER			
	2.1042	2.5322	2.9934	3.1806	100 BFPD 118 % POWER			
	2.3189	2.7471	3.0769	3.3510	350 BFPD 118 % POWER			

Page 124 of 143

	H	G	F	E	D	C	B	A
8	1.8829	1.4671	1.6188	1.4269	1.7489	1.6907	1.6904	1.7064
	1.9010	1.5085	1.6901	1.4626	1.7884	1.7770	1.7766	1.7870
	2.0081	1.6001	1.8741	1.5848	1.9348	1.9322	1.9411	1.8993
9	1.4671	1.6267	1.7454	1.6685	1.4238	1.6799	1.4531	2.0534
	1.5045	1.6757	1.8163	1.7021	1.4418	1.7463	1.5231	2.1620
	1.6001	1.8354	1.9793	1.8488	1.5658	1.8946	1.6709	2.2590
10	1.6188	1.7458	1.9211	1.4441	1.5868	1.4128	1.8303	2.5129
	1.6901	1.8173	1.9313	1.4531	1.6063	1.4294	1.9376	2.5576
	1.8741	1.9796	2.0314	1.5721	1.7783	1.5619	2.0696	2.5346
11	1.4269	1.6693	1.4457	1.8599	1.4154	1.5224	1.3897	2.5949
	1.4626	1.7030	1.4545	1.8540	1.4277	1.5600	1.4715	2.6974
	1.5848	1.8450	1.5729	1.9611	1.5512	1.7585	1.6790	2.7530
12	1.7489	1.4251	1.5892	1.4167	1.8606	1.4229	1.7143	
	1.7884	1.4432	1.6093	1.4290	1.8890	1.4697	1.8127	
	1.9348	1.5658	1.7803	1.5520	2.0105	1.6322	2.0129	
13	1.6907	1.6781	1.4141	1.5236	1.4229	1.8686	2.7046	
	1.7770	1.7453	1.4307	1.5608	1.4697	1.8949	2.7020	
	1.9322	1.6941	1.5619	1.7585	1.6322	2.0220	2.6778	
14	1.6904	1.4528	1.8314	1.3903	1.7162	2.7046		
	1.7766	1.5231	1.9383	1.4715	1.8137	2.7043		
	1.9411	1.6709	2.0696	1.6790	2.0142	2.6822		
15	1.7064	2.0520	2.5149	2.5984	4 EFPD	118 % POWER		
	1.7870	2.1620	2.5596	2.6997	100 EFPD	118 % POWER		
	1.8993	2.2591	2.5366	2.7553	350 EFPD	118 % POWER		

Page 125 of 143

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

	H	G	F	E	D	C	B	A
8	1.8607	1.4405	1.5971	1.4018	1.7295	1.6833	1.6847	1.7021
	1.8408	1.4529	1.6320	1.4078	1.7301	1.7234	1.7276	1.7379
	1.8381	1.4554	1.7133	1.4434	1.7720	1.7716	1.7818	1.7485
9	1.4405	1.6036	1.7236	1.6433	1.3969	1.6681	1.4383	2.0555
	1.4529	1.6178	1.7572	1.6422	1.3883	1.6928	1.4736	2.1072
	1.4554	1.6760	1.8131	1.6898	1.4247	1.7341	1.5286	2.0835
10	1.5971	1.7236	1.8995	1.4138	1.5566	1.3853	1.8101	2.5147
	1.6320	1.7572	1.8705	1.3973	1.5463	1.3750	1.8723	2.4967
	1.7133	1.8131	1.8629	1.4298	1.6226	1.4232	1.9000	2.3422
11	1.4018	1.6442	1.4153	1.8315	1.3838	1.4953	1.3658	2.5891
	1.4078	1.6431	1.3988	1.7904	1.3708	1.5014	1.4143	2.6245
	1.4434	1.6900	1.4305	1.7937	1.4124	1.6055	1.5315	2.5450
12	1.7295	1.3981	1.5596	1.3847	1.8300	1.3923	1.6893	
	1.7301	1.3889	1.5488	1.3722	1.8220	1.4094	1.7454	
	1.7720	1.4247	1.6243	1.4131	1.8388	1.4869	1.8423	
13	1.6833	1.6667	1.3865	1.4961	1.3916	1.8410	2.6822	
	1.7234	1.6919	1.3759	1.5021	1.4092	1.8296	2.6232	
	1.7716	1.7339	1.4232	1.6055	1.4862	1.8532	2.4723	
14	1.6847	1.4379	1.8107	1.3662	1.6902	2.6822		
	1.7276	1.4729	1.8723	1.4147	1.7464	2.6254		
	1.7818	1.5286	1.9000	1.5315	1.8424	2.4743		
15	1.7021	2.0534	2.5174	2.5912	4 EFPD	118 % POWER		
	1.7379	2.1058	2.4994	2.6267	100 EFPD	118 % POWER		
	1.7485	2.0841	2.3439	2.5466	350 EFPD	118 % POWER		

	H	G	F	E	D	C	B	A
8	1.8440	1.4290	1.5824	1.3849	1.7076	1.6853	1.6964	1.7304
	1.7887	1.4117	1.5811	1.3619	1.6732	1.6760	1.6912	1.7137
	1.6843	1.3305	1.5677	1.3179	1.6197	1.6234	1.6351	1.6100
9	1.4290	1.5887	1.7073	1.6152	1.3779	1.6669	1.4428	2.0820
	1.4117	1.5693	1.7023	1.5828	1.3427	1.6424	1.4392	2.0706
	1.3305	1.5333	1.6590	1.5422	1.3005	1.5865	1.4007	1.9161
10	1.5824	1.7079	1.8757	1.3908	1.5294	1.3700	1.8054	2.5420
	1.5811	1.7032	1.8105	1.3496	1.4897	1.3314	1.8180	2.4548
	1.5677	1.6598	1.7068	1.3059	1.4785	1.3001	1.7394	2.1582
11	1.3849	1.6160	1.3925	1.8004	1.3688	1.4803	1.3671	2.6238
	1.3619	1.5836	1.3508	1.7278	1.3245	1.4538	1.3771	2.5825
	1.3179	1.5428	1.3060	1.6402	1.2888	1.4667	1.4016	2.3456
12	1.7076	1.3785	1.5323	1.3698	1.8141	1.3860	1.6919	
	1.6732	1.3433	1.4925	1.3260	1.7655	1.3692	1.6999	
	1.6197	1.3006	1.4799	1.2893	1.6811	1.3594	1.6865	
13	1.6853	1.6657	1.3712	1.4810	1.3860	1.8419	2.7032	
	1.6760	1.6421	1.3325	1.4545	1.3692	1.7880	2.5761	
	1.6234	1.5857	1.3002	1.4669	1.3588	1.7029	2.2794	
14	1.6964	1.4421	1.8058	1.3677	1.6928	2.7032		
	1.6912	1.4389	1.8180	1.3773	1.7009	2.5769		
	1.6351	1.4003	1.7394	1.4016	1.6866	2.2820		
15	1.7304	2.0806	2.5462	2.6260	4 EFPD	118 % POWER		
	1.7137	2.0701	2.4567	2.5846	100 EFPD	118 % POWER		
	1.6100	1.9164	2.1597	2.3473	350 EFPD	118 % POWER		

Page 126 of 143

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

	H	G	F	E	D	C	B	A
8	* 1.9806	* 1.5580	* 1.7340	* 1.4909	* 1.8272	* 1.8628	* 1.9100	* 2.0149
	* 1.8881	* 1.5036	* 1.6920	* 1.4467	* 1.7576	* 1.8001	* 1.8476	* 1.9282
	* 1.6796	* 1.3402	* 1.5684	* 1.3214	* 1.6044	* 1.6232	* 1.6441	* 1.6533
9	* 1.5580	* 1.7330	* 1.8684	* 1.7238	* 1.4863	* 1.8132	* 1.6214	* 2.3680
	* 1.5036	* 1.6766	* 1.8178	* 1.6608	* 1.4311	* 1.7425	* 1.5749	* 2.2799
	* 1.3402	* 1.5334	* 1.6520	* 1.5269	* 1.3036	* 1.5794	* 1.4157	* 1.9399
10	* 1.7340	* 1.8691	* 2.0023	* 1.4949	* 1.6365	* 1.4870	* 1.9837	* 2.8661
	* 1.6920	* 1.8178	* 1.9008	* 1.4352	* 1.5683	* 1.4252	* 1.9402	* 2.6859
	* 1.5684	* 1.6527	* 1.6950	* 1.3096	* 1.4640	* 1.3053	* 1.7316	* 2.1845
11	* 1.4909	* 1.7247	* 1.4963	* 1.9044	* 1.4781	* 1.6197	* 1.5620	* 3.0206
	* 1.4467	* 1.6615	* 1.4365	* 1.8034	* 1.4123	* 1.5567	* 1.5228	* 2.8670
	* 1.3214	* 1.5269	* 1.3101	* 1.6252	* 1.2934	* 1.4657	* 1.4214	* 2.3850
12	* 1.8272	* 1.4877	* 1.6399	* 1.4799	* 1.9583	* 1.5486	* 1.9201	
	* 1.7576	* 1.4320	* 1.5706	* 1.4136	* 1.8560	* 1.4936	* 1.8646	
	* 1.6044	* 1.3041	* 1.4654	* 1.2934	* 1.6661	* 1.3739	* 1.7060	
13	* 1.8628	* 1.8125	* 1.4884	* 1.6205	* 1.5486	* 2.0453	* 3.0528	
	* 1.8001	* 1.7422	* 1.4265	* 1.5574	* 1.4932	* 1.9557	* 2.8268	
	* 1.6232	* 1.5794	* 1.3058	* 1.4657	* 1.3739	* 1.7236	* 2.3186	
14	* 1.9100	* 1.6214	* 1.9845	* 1.5623	* 1.9213	* 3.0546		
	* 1.8476	* 1.5746	* 1.9420	* 1.5231	* 1.8657	* 2.8293		
	* 1.6441	* 1.4156	* 1.7308	* 1.4214	* 1.7060	* 2.3217		
15	* 2.0149	* 2.3668	* 2.8687	* 3.0235	* 4 EFPD	118 % POWER		
	* 1.9282	* 2.2783	* 2.6882	* 2.8696	* 100 EFPD	118 % POWER		
	* 1.6533	* 1.9409	* 2.1860	* 2.3853	* 350 EFPD	118 % POWER		

	H	G	F	E	D	C	B	A
8	2.8673	2.2362	2.6492	2.1576	2.6461	2.8524	3.0159	3.3911
	2.6653	2.1230	2.4875	2.0549	2.4836	2.6496	2.7941	3.1419
	2.1646	1.7645	2.0591	1.7390	2.0558	2.1327	2.1896	2.3347
9	2.2362	2.6148	2.8322	2.5002	2.0989	2.6745	2.5249	3.8031
	2.1230	2.4466	2.6541	2.3511	1.9969	2.4977	2.3783	3.5087
	1.7645	2.0130	2.1569	1.9631	1.6948	2.0446	1.8914	2.6431
10	2.6492	2.8322	2.8874	2.1141	2.3952	2.1217	3.0015	4.5028
	2.4875	2.6541	2.6747	2.0063	2.2434	2.0176	2.8322	4.0796
	2.0591	2.1569	2.1796	1.7012	1.8846	1.6988	2.2506	2.9751
11	2.1576	2.5022	2.1161	2.6974	2.0914	2.4592	2.5743	4.9194
	2.0549	2.3511	2.0075	2.5116	1.9869	2.3047	2.4253	4.4714
	1.7390	1.9631	1.7021	2.0740	1.6856	1.9238	1.9543	3.2744
12	2.6461	2.1004	2.3988	2.0928	2.8227	2.3681	3.1162	
	2.4836	1.9972	2.2450	1.9881	2.6123	2.2304	2.9130	
	2.0558	1.6948	1.8858	1.6856	2.1312	1.8305	2.3251	
13	2.8524	2.6745	2.1232	2.4604	2.3681	3.1588	4.8243	
	2.6496	2.4977	2.0178	2.3061	2.2304	2.9413	4.3530	
	2.1327	2.0446	1.6996	1.9238	1.8303	2.3285	3.1870	
14	3.0159	2.5249	3.0026	2.5764	3.1181	4.8289		
	2.7941	2.3783	2.8322	2.4265	2.9130	4.3530		
	2.1896	1.8905	2.2506	1.9543	2.3251	3.1902		
15	3.3911	3.8031	4.5052	4.9242	4 EFPD	118 % POWER		
	3.1419	3.5087	4.0805	4.4767	100 EFPD	118 % POWER		
	2.3347	2.6453	2.9773	3.2772	350 EFPD	118 % POWER		

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 127 of 143

TABLE 4

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RFS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 18 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.5226	2.1527	2.4788	2.1978	2.5330	2.6412	2.8336	3.2712
9*	2.1527	2.4039	2.5370	2.4231	2.1733	2.5784	2.5307	3.5365
10*	2.4788	2.5385	2.6031	2.1647	2.4015	2.2322	2.8909	4.0763
11*	2.1978	2.4237	2.1662	2.5483	2.1776	2.4745	2.6657	4.4815
12*	2.5330	2.1737	2.4028	2.1776	2.6213	2.4137	3.0612	
13*	2.6412	2.5784	2.2338	2.4759	2.4137	2.9368	4.2941	
14*	2.8336	2.5307	2.8909	2.6657	3.0641	4.2941		
15 *	3.2712	3.5365	4.0763	4.4835				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 17 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.8652	1.6160	1.7383	1.6353	1.8579	1.8427	1.9178	2.0787
9*	1.6160	1.7011	1.8047	1.7803	1.6526	1.8634	1.7488	2.3497
10*	1.7383	1.8047	1.9401	1.6438	1.7565	1.6669	2.0466	2.7787
11*	1.6353	1.7810	1.6447	1.9064	1.6403	1.7289	1.7179	2.9658
12*	1.8579	1.6532	1.7578	1.6411	1.9309	1.6822	2.0079	
13*	1.8427	1.8623	1.6678	1.7295	1.6822	2.0218	2.8947	
14*	1.9178	1.7488	2.0466	1.7188	2.0091	2.8965		
15 *	2.0787	2.3497	2.7811	2.9666				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 128 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 16 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.7183	1.4442	1.5673	1.4587	1.6996	1.6454	1.6752	1.7597
9*	1.4442	1.5355	1.6466	1.6415	1.4820	1.6593	1.5144	2.0382
10*	1.5673	1.6473	1.7938	1.4794	1.5940	1.4803	1.8265	2.4483
11*	1.4587	1.6421	1.4801	1.7683	1.4513	1.5304	1.4636	2.5635
12*	1.6996	1.4825	1.5956	1.4519	1.7598	1.4514	1.7288	
13*	1.6454	1.6584	1.4810	1.5312	1.4516	1.7789	2.5391	
14*	1.6752	1.5137	1.8268	1.4643	1.7294	2.5391		
15 *	1.7597	2.0368	2.4502	2.5649				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 15 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.7031	1.4106	1.5390	1.4134	1.6672	1.5922	1.6093	1.6645
9*	1.4106	1.5114	1.6306	1.6105	1.4279	1.6093	1.4427	1.9499
10*	1.5390	1.6311	1.7843	1.4353	1.5533	1.4205	1.7664	2.3603
11*	1.4134	1.6113	1.4363	1.7456	1.3922	1.4763	1.3904	2.4565
12*	1.6672	1.4286	1.5553	1.3928	1.7149	1.3819	1.6514	
13*	1.5922	1.6085	1.4212	1.4770	1.3819	1.7123	2.4505	
14*	1.6093	1.4421	1.7668	1.3906	1.6523	2.4505		
15 *	1.6645	1.9475	2.3621	2.4584				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 129 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 14 OF 18
(LEVEL 18 = TOP OF CORR, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.8068	1.4787	1.6231	1.4818	1.7594	1.6646	1.6743	1.7179
9*	1.4787	1.5949	1.7280	1.6985	1.4862	1.6832	1.4933	2.0264
10*	1.6231	1.7286	1.8111	1.4946	1.6164	1.4626	1.8353	2.4675
11*	1.4818	1.6989	1.4956	1.8358	1.4402	1.5302	1.4284	2.5551
12*	1.7594	1.4869	1.6189	1.4412	1.8000	1.4302	1.7131	
13*	1.6646	1.6823	1.4630	1.5310	1.4302	1.7914	2.5670	
14*	1.6743	1.4933	1.8368	1.4291	1.7137	2.5670		
15 *	1.7179	2.0238	2.4694	2.5563				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 13 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.8880	1.5453	1.6914	1.5271	1.8203	1.7153	1.7181	1.7518
9*	1.5453	1.6654	1.7985	1.7633	1.5331	1.7332	1.5294	2.0758
10*	1.6914	1.7985	1.9718	1.5478	1.6711	1.5032	1.8953	2.5370
11*	1.5271	1.7633	1.5493	1.9134	1.4838	1.5768	1.4626	2.6352
12*	1.8203	1.5339	1.6738	1.4845	1.8733	1.4692	1.7595	
13*	1.7153	1.7313	1.5036	1.5776	1.4692	1.8485	2.6519	
14*	1.7181	1.5286	1.8953	1.4626	1.7605	2.6519		
15 *	1.7518	2.0744	2.5391	2.6374				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 130 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 12 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.0744	1.6798	1.8395	1.6469	1.9743	1.8579	1.8546	1.8789
9*	1.6798	1.8172	1.9596	1.9039	1.6408	1.8745	1.6425	2.2379
10*	1.8395	1.9596	2.1509	1.6699	1.8130	1.6228	2.0514	2.7376
11*	1.6469	1.9039	1.6708	2.0937	1.6173	1.7223	1.5791	2.8439
12*	1.9743	1.6417	1.8161	1.6182	2.0639	1.6009	1.9208	
13*	1.8579	1.8734	1.6236	1.7233	1.6009	2.0265	2.9109	
14*	1.8546	1.6417	2.0514	1.5799	1.9220	2.9109		
15 *	1.8789	2.2363	2.7400	2.8464				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 11 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.3034	1.8498	2.0303	1.8323	2.2035	2.0730	2.0622	2.0773
9*	1.8498	2.0121	2.1671	2.1119	1.8142	2.0881	1.8173	2.4870
10*	2.0303	2.1671	2.3781	1.8421	1.9956	1.7758	2.2604	3.0445
11*	1.8323	2.1134	1.8432	2.3084	1.7738	1.8868	1.7265	3.1385
12*	2.2035	1.8152	1.9994	1.7748	2.2933	1.7637	2.1134	
13*	2.0730	2.0868	1.7768	1.8880	1.7637	2.2539	3.2318	
14*	2.0622	1.8163	2.2620	1.7265	2.1134	3.2351		
15 *	2.0773	2.4850	3.0474	3.1416				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 131 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 10 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.4407	1.9631	2.1553	1.9183	2.3255	2.2332	2.2395	2.2618
9*	1.9631	2.1377	2.2983	2.2237	1.9065	2.2316	1.9459	2.7140
10*	2.1553	2.2983	2.5248	1.9302	2.1035	1.8846	2.4109	3.2857
11*	1.9183	2.2253	1.9314	2.4426	1.8743	2.0057	1.8487	3.3918
12*	2.3255	1.9077	2.1077	1.8755	2.4239	1.8777	2.2588	
13*	2.2332	2.2300	1.8857	2.0070	1.8777	2.4201	3.4818	
14*	2.2395	1.9447	2.4109	1.8498	2.2586	3.4818		
15 *	2.2618	2.7117	3.2892	3.3918				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 9 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.4276	1.9386	2.1363	1.9112	2.3135	2.2491	2.2443	2.2634
9*	1.9386	2.1233	2.2817	2.2128	1.9054	2.2427	1.9435	2.7187
10*	2.1363	2.2817	2.5048	1.9302	2.1063	1.8789	2.4164	3.3344
11*	1.9112	2.2143	1.9326	2.4389	1.8687	2.0070	1.8421	3.4400
12*	2.3135	1.9065	2.1105	1.8698	2.4332	1.8709	2.2588	
13*	2.2491	2.2411	1.8800	2.0083	1.8709	2.4351	3.5365	
14*	2.2443	1.9435	2.4183	1.8432	2.2604	3.5365		
15 *	2.2634	2.7164	3.3344	3.4400				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 132 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 8 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.3135	1.8345	2.0173	1.7994	2.1806	2.0993	2.0895	2.0927
9*	1.8345	2.0147	2.1627	2.0868	1.8005	2.0979	1.8184	2.5168
10*	2.0173	2.1627	2.3763	1.8205	1.9981	1.7911	2.2983	3.1044
11*	1.7994	2.0881	1.8227	2.3084	1.7901	1.9190	1.7617	3.2451
12*	2.1806	1.8015	2.0019	1.7911	2.3152	1.7943	2.1612	
13*	2.0993	2.0965	1.7922	1.9202	1.7943	2.3272	3.3629	
14*	2.0895	1.8184	2.2983	1.7627	2.1627	3.3629		
15 *	2.0927	2.5148	3.1075	3.2485				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 7 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.1943	1.7131	1.8723	1.6610	2.0096	1.9278	1.9278	1.9362
9*	1.7131	1.8902	2.0134	1.9319	1.6627	1.9254	1.6717	2.3265
10*	1.8723	2.0134	2.2035	1.6908	1.8590	1.3592	2.1291	2.8467
11*	1.6610	1.9319	1.6926	2.1553	1.6726	1.7873	1.6305	2.9811
12*	2.0096	1.6645	1.8623	1.6726	2.1837	1.6807	2.0096	
13*	1.9278	1.9242	1.6601	1.7883	1.6807	2.1837	3.1229	
14*	1.9278	1.6717	2.1291	1.6305	2.0096	3.1229		
15 *	1.9362	2.3237	2.8493	2.9839				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 133 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 6 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.0488	1.5978	1.7588	1.5519	1.8920	1.8213	1.8209	1.8372
9*	1.5978	1.7702	1.8936	1.8123	1.5509	1.8140	1.5723	2.2054
10*	1.7588	1.8948	2.0796	1.5751	1.7332	1.5430	1.9930	2.6968
11*	1.5519	1.8133	1.5767	2.0225	1.5507	1.6646	1.5219	2.8099
12*	1.8920	1.5521	1.7361	1.5515	2.0329	1.5616	1.8745	
13*	1.8213	1.8126	1.5446	1.6654	1.5616	2.0395	2.9366	
14*	1.8209	1.5723	1.9943	1.5219	1.8756	2.9366		
15 *	1.8372	2.2038	2.7000	2.8124				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 5 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.8829	1.4671	1.6188	1.4269	1.7489	1.6907	1.6904	1.7064
9*	1.4671	1.6267	1.7454	1.6685	1.4238	1.6799	1.4531	2.0534
10*	1.6188	1.7458	1.9211	1.4441	1.5868	1.4128	1.8303	2.5129
11*	1.4269	1.6693	1.4457	1.8599	1.4154	1.5224	1.3897	2.5949
12*	1.7489	1.4251	1.5892	1.4167	1.8606	1.4229	1.7143	
13*	1.6907	1.6781	1.4141	1.5236	1.4229	1.8686	2.7046	
14*	1.6904	1.4528	1.8314	1.3903	1.7162	2.7046		
15 *	1.7064	2.0520	2.5149	2.5984				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 134 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFPD, THIS IS LEVEL 4 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.8607	1.4405	1.5971	1.4018	1.7295	1.6833	1.6847	1.7021
9*	1.4405	1.6036	1.7236	1.6433	1.3969	1.6681	1.4383	2.0555
10*	1.5971	1.7236	1.8995	1.4138	1.5566	1.3853	1.8101	2.5147
11*	1.4018	1.6442	1.4153	1.8315	1.3838	1.4953	1.3658	2.5891
12*	1.7295	1.3981	1.5596	1.3847	1.8300	1.3923	1.6893	
13*	1.6833	1.6667	1.3865	1.4961	1.3916	1.8410	2.6822	
14*	1.6847	1.4379	1.8107	1.3662	1.6902	2.6822		
15 *	1.7021	2.0534	2.5174	2.5912				

AT 118% POWER, 4 EFPD, THIS IS LEVEL 3 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.8440	1.4290	1.5824	1.3849	1.7076	1.6853	1.6964	1.7304
9*	1.4290	1.5887	1.7073	1.6152	1.3779	1.6669	1.4428	2.0820
10*	1.5824	1.7079	1.8757	1.3908	1.5294	1.3700	1.8054	2.5420
11*	1.3849	1.6160	1.3925	1.8004	1.3688	1.4803	1.3671	2.6238
12*	1.7076	1.3785	1.5323	1.3698	1.8141	1.3860	1.6919	
13*	1.6853	1.6657	1.3712	1.4610	1.3860	1.8419	2.7032	
14*	1.6964	1.4421	1.8058	1.3677	1.6928	2.7032		
15 *	1.7304	2.0806	2.5462	2.6260				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 135 of 143

TABLE 4 (CONTINUED)

F-SUB-Q & M-SUB-Q VALUES (F-SUB-Q RPS MARGIN)

AT 118% POWER, 4 EFDP, THIS IS LEVEL 2 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	1.9806	1.5580	1.7340	1.4909	1.8272	1.8628	1.9100	2.0149
9*	1.5580	1.7330	1.8684	1.7238	1.4863	1.8132	1.6214	2.3680
10*	1.7340	1.8691	2.0023	1.4949	1.6365	1.4870	1.9837	2.8661
11*	1.4909	1.7247	1.4963	1.9044	1.4781	1.6197	1.5620	3.0206
12*	1.8272	1.4877	1.6399	1.4799	1.9583	1.5486	1.9201	
13*	1.8628	1.8125	1.4884	1.6205	1.5486	2.0453	3.7528	
14*	1.9100	1.6214	1.9845	1.5623	1.9213	3.0546		
15 *	2.0149	2.3668	2.8687	3.0235				

AT 118% POWER, 4 EFDP, THIS IS LEVEL 1 OF 18
(LEVEL 18 = TOP OF CORE, LEVEL 1 = BOTTOM)

	H	G	F	E	D	C	B	A
8*	2.8673	2.2362	2.6492	2.1576	2.6461	2.8524	3.0159	3.3911
9*	2.2362	2.6148	2.8322	2.5002	3.0989	2.6745	2.5249	3.8031
10*	2.6492	2.8322	2.8874	2.1141	2.3952	2.1217	3.0015	4.5028
11*	2.1576	2.5022	2.1161	2.6974	2.0914	2.4592	2.5743	4.9194
12*	2.6461	2.1004	2.3508	2.0928	2.8227	2.3681	3.1162	
13*	2.8524	2.6745	2.1232	2.4604	2.3681	3.1588	4.8243	
14*	3.0159	2.5249	3.0026	2.5764	3.1181	4.8289		
15 *	3.3911	3.8031	4.5052	4.9242				

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 136 of 143

TABLE 5

F-DEL-H & M-DEL-H VALUES - NORMAL OPERATION

AT 100% POWER, 4 EFPD

	H	G	F	E	D	C	B	A
8	* 1.0790	* 1.3430	* 1.2390	* 1.3650	* 1.1470	* 1.1600	* 1.1440	* 1.0800 *
	* 1.3790	* 1.1424	* 1.2253	* 1.1042	* 1.2932	* 1.2550	* 1.3195	* 1.3787 *
9	* 1.3430	* 1.2480	* 1.1610	* 1.2000	* 1.3580	* 1.1610	* 1.2950	* .9300 *
	* 1.1424	* 1.2170	* 1.3130	* 1.2507	* 1.1159	* 1.2621	* 1.1796	* 1.5376 *
10	* 1.2390	* 1.1610	* 1.0600	* 1.3470	* 1.2480	* 1.3590	* 1.0710	* .7730 *
	* 1.2253	* 1.3132	* 1.4157	* 1.1799	* 1.2747	* 1.1648	* 1.4635	* 1.8522 *
11	* 1.3650	* 1.2000	* 1.3460	* 1.0900	* 1.3610	* 1.2910	* 1.3490	* .7440 *
	* 1.1042	* 1.2506	* 1.1808	* 1.3994	* 1.1642	* 1.2267	* 1.1618	* 2.0518 *
12	* 1.1470	* 1.3570	* 1.2460	* 1.3600	* 1.0720	* 1.3390	* 1.1250	*
	* 1.2932	* 1.1167	* 1.2768	* 1.1651	* 1.4058	* 1.1745	* 1.3930	*
13	* 1.1600	* 1.1620	* 1.3580	* 1.2900	* 1.3390	* 1.0540	* .7300	*
	* 1.2550	* 1.2610	* 1.1652	* 1.2273	* 1.1747	* 1.4170	* 2.0288	*
14	* 1.1440	* 1.2950	* 1.0710	* 1.3480	* 1.1240	* .7300	*	*
	* 1.3195	* 1.1796	* 1.4640	* 1.1623	* 1.3942	* 2.0306	*	*
15	* 1.0800	* .9310	* .7730	* .7430	* F-DEL-H			
	* 1.3787	* 1.5359	* 1.8543	* 2.0544	* M-DEL-H			

AT 100% POWER, 100 EFPD

	H	G	F	E	D	C	B	A
8	* 1.0720	* 1.3420	* 1.2030	* 1.3780	* 1.1430	* 1.1340	* 1.1030	* 1.0570 *
	* 1.3860	* 1.1406	* 1.2616	* 1.0916	* 1.2958	* 1.2857	* 1.3090	* 1.3496 *
9	* 1.3420	* 1.2200	* 1.1280	* 1.2020	* 1.3830	* 1.1530	* 1.2720	* .8950 *
	* 1.1406	* 1.2431	* 1.3492	* 1.2479	* 1.0930	* 1.2851	* 1.1524	* 1.5901 *
10	* 1.2030	* 1.1280	* 1.0720	* 1.3820	* 1.2510	* 1.3800	* 1.0270	* .7680 *
	* 1.2616	* 1.3502	* 1.4037	* 1.1126	* 1.2273	* 1.1209	* 1.4487	* 1.8639 *
11	* 1.3780	* 1.2020	* 1.3810	* 1.1130	* 1.3910	* 1.2710	* 1.3030	* .7220 *
	* 1.0916	* 1.2479	* 1.1133	* 1.3676	* 1.1062	* 1.2003	* 1.1674	* 2.0337 *
12	* 1.1430	* 1.3830	* 1.2500	* 1.3900	* 1.0640	* 1.3200	* 1.0720	*
	* 1.2958	* 1.0933	* 1.2282	* 1.1071	* 1.3927	* 1.1474	* 1.4017	*
13	* 1.1340	* 1.1530	* 1.3790	* 1.2710	* 1.3200	* 1.0350	* .7280	*
	* 1.2857	* 1.2851	* 1.1217	* 1.2003	* 1.1474	* 1.4349	* 2.0299	*
14	* 1.1030	* 1.2720	* 1.0270	* 1.3030	* 1.0720	* .7270	*	*
	* 1.3090	* 1.1515	* 1.4494	* 1.1683	* 1.4029	* 2.0301	*	*
15	* 1.0570	* .8960	* .7670	* .7210	* F-DEL-H			
	* 1.3496	* 1.5899	* 1.8650	* 2.0336	* M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 137 of 143

TABLE 5 (CONTINUED)

F-DEL-H & M-DEL-H VALUES - NORMAL OPERATION

AT 100% POWER, 350 EFFD

	H	G	F	E	D	C	B	A
8	* 1.0460	* 1.3090	* 1.1320	* 1.3320	* 1.1060	* 1.0980	* 1.0750	* 1.0630
	* 1.3917	* 1.1699	* 1.3201	* 1.1267	* 1.3139	* 1.3083	* 1.3535	* 1.3581
9	* 1.3090	* 1.1570	* 1.0780	* 1.1600	* 1.3480	* 1.1250	* 1.2390	* .0080
	* 1.1699	* 1.2872	* 1.3768	* 1.2691	* 1.1174	* 1.2952	* 1.1886	* 1.5886
10	* 1.1320	* 1.0780	* 1.0600	* 1.3460	* 1.2030	* 1.3440	* 1.0200	* .8140
	* 1.3201	* 1.3774	* 1.3961	* 1.1385	* 1.2496	* 1.1415	* 1.4281	* 1.7814
11	* 1.3320	* 1.1600	* 1.3460	* 1.1010	* 1.3590	* 1.2080	* 1.2350	* .7500
	* 1.1267	* 1.2691	* 1.1390	* 1.3531	* 1.1247	* 1.2360	* 1.2345	* 1.9685
12	* 1.1060	* 1.3480	* 1.2020	* 1.3580	* 1.0530	* 1.2790	* 1.0340	*
	* 1.3139	* 1.1174	* 1.2505	* 1.1255	* 1.3708	* 1.1804	* 1.4289	*
13	* 1.0980	* 1.1250	* 1.3440	* 1.2080	* 1.2790	* 1.0340	* .7730	*
	* 1.3083	* 1.2952	* 1.1415	* 1.2367	* 1.1804	* 1.4133	* 1.8834	*
14	* 1.0750	* 1.2390	* 1.0200	* 1.2350	* 1.0340	* .7730	*	*
	* 1.3535	* 1.1886	* 1.4281	* 1.2348	* 1.4292	* 1.8856	*	*
15	* 1.0630	* .9080	* .8130	* .7490	* F-DEL-H			
	* 1.3581	* 1.5885	* 1.7813	* 1.9700	* M-DEL-H			

AT 75% POWER, 4 EFFD

	H	G	F	E	D	C	B	A
8	* 1.0240	* 1.3370	* 1.2470	* 1.3880	* 1.1630	* 1.1790	* 1.1650	* 1.0990
	* 1.7107	* 1.4127	* 1.4706	* 1.3090	* 1.5354	* 1.4920	* 1.5144	* 1.5884
9	* 1.3370	* 1.2260	* 1.1580	* 1.2140	* 1.3800	* 1.1820	* 1.3220	* .9440
	* 1.4127	* 1.5067	* 1.6009	* 1.4928	* 1.3285	* 1.5009	* 1.3514	* 1.8429
10	* 1.2470	* 1.1580	* 1.0620	* 1.3610	* 1.2550	* 1.3770	* 1.0770	* .7790
	* 1.4706	* 1.6009	* 1.7150	* 1.3709	* 1.4697	* 1.3539	* 1.6935	* 2.2268
11	* 1.3880	* 1.2130	* 1.3600	* 1.0830	* 1.3640	* 1.2920	* 1.3600	* .7410
	* 1.3090	* 1.4933	* 1.3718	* 1.7307	* 1.3887	* 1.4604	* 1.3675	* 2.3988
12	* 1.1630	* 1.3790	* 1.2530	* 1.3630	* 1.0370	* 1.3170	* 1.1160	*
	* 1.5354	* 1.3294	* 1.4719	* 1.3887	* 1.7288	* 1.3952	* 1.6618	*
13	* 1.1790	* 1.1820	* 1.3760	* 1.2920	* 1.3170	* 1.0190	* .7100	*
	* 1.4920	* 1.4997	* 1.3549	* 1.4611	* 1.3958	* 1.7478	* 2.5294	*
14	* 1.1650	* 1.3220	* 1.0760	* 1.3590	* 1.1150	* .7100	*	*
	* 1.5144	* 1.3508	* 1.6920	* 1.3684	* 1.6626	* 2.5292	*	*
15	* 1.0990	* .9440	* .7780	* .7410	* F-DEL-H			
	* 1.5884	* 1.8410	* 2.2278	* 2.4001	* M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 138 of 143

TABLE 5 (CONTINUED)

F-DEL-H & M-DEL-H VALUES - NORMAL OPERATION

AT 75% POWER, 100 EFPD

	H	G	F	E	D	C	B	A
8	* .9910	* 1.3260	* 1.2120	* 1.4070	* 1.2640	* 1.1560	* 1.1270	* 1.0790
	* 1.7209	* 1.4103	* 1.5153	* 1.2940	* 1.5377	* 1.5262	* 1.5658	* 1.6202
9	* 1.3260	* 1.1940	* 1.1250	* 1.2200	* 1.4110	* 1.1730	* 1.3020	* .9120
	* 1.4103	* 1.5405	* 1.5957	* 1.4646	* 1.2986	* 1.5269	* 1.3705	* 1.9115
10	* 1.2120	* 1.1250	* 1.0770	* 1.4010	* 1.2640	* 1.4010	* 1.0330	* .7750
	* 1.5153	* 1.5977	* 1.6591	* 1.3322	* 1.4592	* 1.3264	* 1.7273	* 2.2419
11	* 1.4070	* 1.2200	* 1.3990	* 1.1070	* 1.3950	* 1.2710	* 1.3110	* .7190
	* 1.2940	* 1.4651	* 1.3331	* 1.6861	* 1.3588	* 1.4745	* 1.4061	* 2.4504
12	* 1.1640	* 1.4110	* 1.2620	* 1.3930	* 1.0030	* 1.2880	* 1.0590	*
	* 1.5377	* 1.2994	* 1.4605	* 1.3598	* 1.7157	* 1.4100	* 1.7379	*
13	* 1.1560	* 1.1730	* 1.4000	* 1.2700	* 1.2880	* .9920	* .7030	*
	* 1.5262	* 1.5266	* 1.3273	* 1.4746	* 1.4100	* 1.7787	* 2.5428	*
14	* 1.1270	* 1.3020	* 1.0330	* 1.3100	* 1.0580	* .7020	*	*
	* 1.5658	* 1.3705	* 1.7277	* 1.4061	* 1.7378	* 2.5427	*	*
15	* 1.0790	* .9120	* .7740	* .7190	F-DEL-H			
	* 1.6202	* 1.9113	* 2.2438	* 2.4503	M-DEL-H			

AT 75% POWER, 350 EFPD

	H	G	F	E	D	C	B	A
8	* .9240	* 1.2700	* 1.1460	* 1.3780	* 1.1430	* 1.1370	* 1.1160	* 1.1050
	* 1.7638	* 1.4478	* 1.5679	* 1.2994	* 1.5446	* 1.5419	* 1.5741	* 1.5953
9	* 1.2700	* 1.1140	* 1.0880	* 1.1900	* 1.3940	* 1.1590	* 1.2870	* .9400
	* 1.4478	* 1.6256	* 1.6415	* 1.4952	* 1.2898	* 1.5355	* 1.3820	* 1.8662
10	* 1.1460	* 1.0870	* 1.0740	* 1.3770	* 1.2270	* 1.3700	* 1.0450	* .8340
	* 1.5679	* 1.6430	* 1.6629	* 1.3210	* 1.4675	* 1.3227	* 1.6910	* 2.0987
11	* 1.3780	* 1.1890	* 1.3760	* 1.0930	* 1.3460	* 1.2010	* 1.2410	* .7540
	* 1.2994	* 1.4952	* 1.3220	* 1.6781	* 1.3842	* 1.5249	* 1.4521	* 2.3204
12	* 1.1430	* 1.3940	* 1.2260	* 1.3450	* .9530	* 1.2050	* 1.0080	*
	* 1.5446	* 1.2898	* 1.4686	* 1.3844	* 1.7362	* 1.4699	* 1.8196	*
13	* 1.1370	* 1.1590	* 1.3700	* 1.2010	* 1.2050	* .9580	* .7310	*
	* 1.5419	* 1.5255	* 1.3227	* 1.5249	* 1.4688	* 1.8164	* 2.4521	*
14	* 1.1160	* 1.2880	* 1.0450	* 1.2410	* 1.0080	* .7300	*	*
	* 1.5741	* 1.3820	* 1.6910	* 1.4526	* 1.8206	* 2.4551	*	*
15	* 1.1050	* .9400	* .8330	* .7530	F-DEL-H			
	* 1.5953	* 1.8678	* 2.0986	* 2.3232	M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 139 of 143

TABLE 5 (CONTINUED)

F-DEL-H & M-DEL-H VALUES - NORMAL OPERATION

AT 50% POWER, 4 WFPD

	H	G	F	E	D	C	B	A
8	.9840	1.3300	1.2550	1.4160	1.1820	1.2010	1.1880	1.1200
	2.2143	1.8751	1.9190	1.7321	2.0009	1.9804	2.0079	2.1253
9	1.3300	1.2050	1.1540	1.2300	1.4060	1.2040	1.3510	.9590
	1.8751	1.9568	2.0842	1.9407	1.7652	1.9585	1.7899	2.4707
10	1.2550	1.1540	1.0660	1.3780	1.2680	1.3960	1.0820	.7860
	1.9190	2.0859	2.2251	1.7988	1.9323	1.8089	2.2632	3.0116
11	1.4160	1.2290	1.3760	1.0810	1.3670	1.2920	1.3680	.7380
	1.7321	1.9423	1.8013	2.2337	1.8233	1.9170	1.8236	3.2631
12	1.1820	1.4050	1.2670	1.3650	.9970	1.2900	1.1030	
	2.0009	1.7664	1.9350	1.8244	2.2622	1.8230	2.1914	
13	1.2010	1.2050	1.3950	1.2910	1.2900	.9790	.6870	
	1.9804	1.9569	1.8102	1.9171	1.8232	2.2891	3.3461	
14	1.1880	1.3510	1.0820	1.3670	1.1020	.6870		
	2.0079	1.7898	2.2631	1.8236	2.1929	3.3459		
15	1.1200	.9600	.7850	.7380	F-DEL-H			
	2.1253	2.4681	3.0115	3.2630	M-DEL-H			

AT 50% POWER, 100 WFPD

	H	G	F	E	D	C	B	A
8	.9240	1.3110	1.2290	1.4540	1.2010	1.1930	1.1480	1.1110
	2.2238	1.8345	1.9515	1.6620	1.9739	1.9668	2.0187	2.1596
9	1.3110	1.1610	1.1290	1.2500	1.4550	1.2060	1.3470	.9380
	1.8345	1.9961	2.0923	1.9055	1.6741	1.9681	1.7758	2.4923
10	1.2290	1.1280	1.0700	1.4270	1.2920	1.4300	1.0550	.7920
	1.9515	2.0957	2.1750	1.7191	1.8741	1.7223	2.2436	2.9468
11	1.4540	1.2500	1.4250	1.1000	1.3940	1.2670	1.3200	.7210
	1.6620	1.9055	1.7202	2.1695	1.7544	1.8969	1.7789	3.1757
12	1.2010	1.4540	1.2910	1.3920	.9390	1.2340	1.0360	
	1.9739	1.6750	1.8756	1.7568	2.1925	1.8481	2.2512	
13	1.1930	1.2060	1.4290	1.2660	1.2330	.9220	.6660	
	1.9668	1.9682	1.7235	1.8970	1.8482	2.2889	3.3022	
14	1.1480	1.3470	1.0560	1.3190	1.0350	.6660		
	2.0187	1.7747	2.2432	1.7802	2.2511	3.3063		
15	1.1110	.9380	.7910	.7210	F-DEL-H			
	2.1596	2.4921	2.9501	3.1796	M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report

Appendix A

Page 140 of 143

TABLE 5 (CONTINUED)

F-DEL-H & M-DEL-H VALUES - NORMAL OPERATION

AT 50% POWER, 350 EFPD

	H	G	F	E	D	C	B	A
8	* .8340	* 1.2320	* 1.1560	* 1.4370	* 1.7890	* 1.1670	* 1.0390	* 1.0720
	* 2.2570	* 1.8511	* 2.0587	* 1.6817	* 2.0070	* 2.0111	* 2.0597	* 2.1075
9	* 1.2320	* 1.0700	* 1.0700	* 1.2220	* 1.4590	* 1.2040	* 1.3230	* .9350
	* 1.8511	* 2.0848	* 2.1175	* 1.9417	* 1.6645	* 1.9833	* 1.7989	* 2.4665
10	* 1.1560	* 1.0690	* .9770	* 1.4060	* 1.2710	* 1.4320	* 1.0810	* .8510
	* 2.0587	* 2.1193	* 2.1323	* 1.7108	* 1.8643	* 1.6654	* 2.1937	* 2.7945
11	* 1.4370	* 1.2220	* 1.4050	* 1.0900	* 1.3640	* 1.2260	* 1.2850	* .7790
	* 1.6817	* 1.9417	* 1.7120	* 2.1493	* 1.7360	* 1.8741	* 1.7819	* 2.9274
12	* 1.1890	* 1.4590	* 1.2700	* 1.3640	* .8900	* 1.1810	* 1.0180	*
	* 2.0070	* 1.6649	* 1.8656	* 1.7370	* 2.1754	* 1.8409	* 2.2077	*
13	* 1.1670	* 1.2040	* 1.4320	* 1.2260	* 1.1810	* .9160	* .7190	*
	* 2.0111	* 1.9827	* 1.6653	* 1.8740	* 1.8408	* 2.2870	* 3.0736	*
14	* 1.0390	* 1.3230	* 1.0810	* 1.2840	* 1.0180	* .7180	*	*
	* 2.0597	* 1.7989	* 2.1936	* 1.7819	* 2.2076	* 3.0747	*	*
15	* 1.0720	* .9350	* .8510	* .7780	* F-DEL-H			
	* 2.1075	* 2.4664	* 2.7944	* 2.9296	* M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 141 of 143

TABLE 6

F-DEL-H & M-DEL-H VALUES - POWER ESCALATION

AT 100% POWER, 4 EFPD

	H	G	F	E	D	C	B	A
8	* 1.0680 *	* 1.3420 *	* 1.2400 *	* 1.3670 *	* 1.1480 *	* 1.1620 *	* 1.1460 *	* 1.0820 *
	* 1.3790 *	* 1.1424 *	* 1.2253 *	* 1.1042 *	* 1.2932 *	* 1.2550 *	* 1.3195 *	* 1.3787 *
9	* 1.3420 *	* 1.2460 *	* 1.1610 *	* 1.2010 *	* 1.3590 *	* 1.1630 *	* 1.2970 *	* .9310 *
	* 1.1424 *	* 1.2170 *	* 1.3130 *	* 1.2507 *	* 1.1159 *	* 1.2621 *	* 1.1796 *	* 1.5376 *
10	* 1.2400 *	* 1.1610 *	* 1.0610 *	* 1.3480 *	* 1.2480 *	* 1.3600 *	* 1.0710 *	* .7740 *
	* 1.2253 *	* 1.3132 *	* 1.4157 *	* 1.1799 *	* 1.2747 *	* 1.1648 *	* 1.4635 *	* 1.8522 *
11	* 1.3670 *	* 1.2010 *	* 1.3460 *	* 1.0890 *	* 1.3600 *	* 1.2910 *	* 1.3490 *	* .7440 *
	* 1.1042 *	* 1.2506 *	* 1.1908 *	* 1.3994 *	* 1.1642 *	* 1.2267 *	* 1.1618 *	* 2.0518 *
12	* 1.1480 *	* 1.3580 *	* 1.2460 *	* 1.3590 *	* 1.0690 *	* 1.3360 *	* 1.1240 *	
	* 1.2932 *	* 1.1167 *	* 1.2768 *	* 1.1651 *	* 1.4058 *	* 1.1745 *	* 1.3930 *	
13	* 1.1620 *	* 1.1640 *	* 1.3590 *	* 1.2900 *	* 1.3370 *	* 1.0510 *	* .7290 *	
	* 1.2550 *	* 1.2610 *	* 1.1652 *	* 1.2273 *	* 1.1747 *	* 1.4170 *	* 2.0288 *	
14	* 1.1460 *	* 1.2970 *	* 1.0710 *	* 1.3490 *	* 1.1230 *	* .7280 *		
	* 1.3195 *	* 1.1796 *	* 1.4640 *	* 1.1623 *	* 1.3942 *	* 2.0306 *		
15	* 1.0820 *	* .9320 *	* .7740 *	* .7430 *	F-DEL-H			
	* 1.3787 *	* 1.5359 *	* 1.8543 *	* 2.0544 *	M-DEL-H			

AT 75% POWER, 4 EFPD

	H	G	F	E	D	C	B	A
8	* 1.0480 *	* 1.3420 *	* 1.2410 *	* 1.3770 *	* 1.1530 *	* 1.1650 *	* 1.1500 *	* 1.0830 *
	* 1.7107 *	* 1.4127 *	* 1.4706 *	* 1.3090 *	* 1.5354 *	* 1.4920 *	* 1.5144 *	* 1.5884 *
9	* 1.3420 *	* 1.2400 *	* 1.1580 *	* 1.2060 *	* 1.3710 *	* 1.1680 *	* 1.3060 *	* .9310 *
	* 1.4127 *	* 1.5067 *	* 1.6009 *	* 1.4928 *	* 1.3285 *	* 1.5009 *	* 1.3514 *	* 1.8429 *
10	* 1.2410 *	* 1.1580 *	* 1.0590 *	* 1.3570 *	* 1.2550 *	* 1.3720 *	* 1.0750 *	* .7710 *
	* 1.4706 *	* 1.6009 *	* 1.7150 *	* 1.3709 *	* 1.4697 *	* 1.3539 *	* 1.6935 *	* 2.2268 *
11	* 1.3770 *	* 1.2050 *	* 1.3560 *	* 1.0880 *	* 1.3690 *	* 1.2980 *	* 1.3590 *	* .7390 *
	* 1.3090 *	* 1.4933 *	* 1.3718 *	* 1.7307 *	* 1.3887 *	* 1.4604 *	* 1.3675 *	* 2.3988 *
12	* 1.1530 *	* 1.3690 *	* 1.2530 *	* 1.3680 *	* 1.0630 *	* 1.3390 *	* 1.1240 *	
	* 1.5354 *	* 1.3284 *	* 1.4719 *	* 1.3887 *	* 1.7288 *	* 1.3952 *	* 1.6618 *	
13	* 1.1650 *	* 1.1690 *	* 1.3710 *	* 1.2970 *	* 1.3390 *	* 1.0430 *	* .7200 *	
	* 1.4920 *	* 1.4997 *	* 1.3549 *	* 1.4611 *	* 1.3959 *	* 1.7478 *	* 2.5294 *	
14	* 1.1500 *	* 1.3070 *	* 1.0750 *	* 1.3580 *	* 1.1230 *	* .7200 *		
	* 1.5144 *	* 1.3508 *	* 1.6920 *	* 1.3684 *	* 1.6626 *	* 2.5292 *		
15	* 1.0830 *	* .9310 *	* .7700 *	* .7380 *	F-DEL-H			
	* 1.5884 *	* 1.8410 *	* 2.2278 *	* 2.4001 *	M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report
Appendix A

Page 142 of 143

TABLE 6 (CONTINUED)

F-DEL-H & M-DEL-H VALUES - POWER ESCALATION

AT 50% POWER, 4 EFPD

	H	G	F	E	D	C	B	A
8	* 1.0440	* 1.3440	* 1.2400	* 1.3840	* 1.1540	* 1.1640	* 1.1480	* 1.0790 *
	* 2.2143	* 1.8751	* 1.9190	* 1.7321	* 2.0009	* 1.9804	* 2.0079	* 2.1253 *
9	* 1.3440	* 1.2380	* 1.1530	* 1.2080	* 1.3810	* 1.1690	* 1.3110	* .9260 *
	* 1.8751	* 1.9568	* 2.0842	* 1.9407	* 1.7652	* 1.9585	* 1.7899	* 2.4707 *
10	* 1.2400	* 1.1530	* 1.0560	* 1.3660	* 1.2630	* 1.3840	* 1.0780	* .7640 *
	* 1.9190	* 2.0859	* 2.2251	* 1.7988	* 1.9323	* 1.8089	* 2.2632	* 3.0116 *
11	* 1.3840	* 1.2080	* 1.3650	* 1.0890	* 1.3810	* 1.3070	* 1.3670	* .7330 *
	* 1.7321	* 1.9423	* 1.8013	* 2.2337	* 1.8233	* 1.9170	* 1.8236	* 3.2631 *
12	* 1.1540	* 1.3800	* 1.2610	* 1.3790	* 1.0660	* 1.3480	* 1.1260	* .7150 *
	* 2.0009	* 1.7664	* 1.9350	* 1.8244	* 2.2622	* 1.8230	* 2.1914	* 3.3459 *
13	* 1.1640	* 1.1700	* 1.3830	* 1.3060	* 1.3480	* 1.0430	* .7150	* .7150 *
	* 1.9804	* 1.9569	* 1.8102	* 1.9171	* 1.8232	* 2.2891	* 3.3461	* 3.3461 *
14	* 1.1480	* 1.3110	* 1.0780	* 1.3670	* 1.1250	* .7150	* .7150	* .7150 *
	* 2.0079	* 1.7898	* 2.2631	* 1.8236	* 2.1929	* 3.3459	* 3.3459	* 3.3459 *
15	* 1.0790	* .9260	* .7630	* .7320	* F-DEL-H			
	* 2.1253	* 2.4681	* 3.0115	* 3.2630	* M-DEL-H			

AT 30% POWER, 4 EFPD

	H	G	F	E	D	C	B	A
8	* 1.0400	* 1.3450	* 1.2390	* 1.3910	* 1.1550	* 1.1630	* 1.1470	* 1.0750 *
	* 2.2143	* 1.8751	* 1.9190	* 1.7321	* 2.0009	* 1.9804	* 2.0079	* 2.1253 *
9	* 1.3450	* 1.2350	* 1.1500	* 1.2110	* 1.3890	* 1.1700	* 1.3140	* .9210 *
	* 1.8751	* 1.9568	* 2.0842	* 1.9407	* 1.7652	* 1.9585	* 1.7899	* 2.4707 *
10	* 1.2390	* 1.1490	* 1.0540	* 1.3740	* 1.2700	* 1.3940	* 1.0810	* .7590 *
	* 1.9190	* 2.0859	* 2.2251	* 1.7988	* 1.9323	* 1.8089	* 2.2632	* 3.0116 *
11	* 1.3910	* 1.2100	* 1.3730	* 1.0920	* 1.3910	* 1.3140	* 1.3740	* .7280 *
	* 1.7321	* 1.9423	* 1.8013	* 2.2337	* 1.8233	* 1.9170	* 1.8236	* 3.2631 *
12	* 1.1550	* 1.3880	* 1.2680	* 1.3890	* 1.0690	* 1.3560	* 1.1290	* .7110 *
	* 2.0009	* 1.7664	* 1.9350	* 1.8244	* 2.2622	* 1.8230	* 2.1914	* 3.3459 *
13	* 1.1630	* 1.1710	* 1.3930	* 1.3130	* 1.3560	* 1.0430	* .7110	* .7110 *
	* 1.9804	* 1.9569	* 1.8102	* 1.9171	* 1.8232	* 2.2891	* 3.3461	* 3.3461 *
14	* 1.1470	* 1.3150	* 1.0800	* 1.3730	* 1.1270	* .7110	* .7110	* .7110 *
	* 2.0079	* 1.7898	* 2.2631	* 1.8236	* 2.1929	* 3.3459	* 3.3459	* 3.3459 *
15	* 1.0750	* .9220	* .7580	* .7270	* F-DEL-H			
	* 2.1253	* 2.4681	* 3.0115	* 3.2630	* M-DEL-H			

McGuire 1 Cycle 10 Core Operating Limits Report

Table 7

Maximum Allowable Radial Peaking MARP Limits

X/L	1.1 Axial Peak	1.2 Axial Peak	1.3 Axial Peak	1.4 Axial Peak	1.5 Axial Peak
<u>Elev. (ft)</u>	<u>MARP</u>	<u>MARP</u>	<u>MARP</u>	<u>MARP</u>	<u>MARP</u>
0.12	1.605	1.652	1.698	1.738	1.775
1.20	1.605	1.651	1.694	1.735	1.771
2.40	1.604	1.647	1.687	1.724	1.734
3.60	1.601	1.642	1.679	1.711	1.689
4.80	1.597	1.634	1.667	1.686	1.641
6.00	1.593	1.624	1.652	1.630	1.592
7.20	1.586	1.613	1.626	1.585	1.538
8.40	1.578	1.596	1.578	1.533	1.489
9.60	1.565	1.561	1.521	1.481	1.440
10.80	1.545	1.515	1.472	1.429	1.388
12.00	1.514	1.469	1.428	1.388	1.350

X/L	1.6 Axial Peak	1.7 Axial Peak	1.8 Axial Peak	1.9 Axial Peak	2.1 Axial Peak
<u>Elev. (ft)</u>	<u>MARP</u>	<u>MARP</u>	<u>MARP</u>	<u>MARP</u>	<u>MARP</u>
0.12	1.760	1.731	1.669	1.608	1.564
1.20	1.729	1.705	1.644	1.586	1.539
2.40	1.682	1.664	1.606	1.552	1.498
3.60	1.636	1.616	1.564	1.515	1.452
4.80	1.591	1.572	1.521	1.472	1.411
6.00	1.546	1.528	1.481	1.433	1.366
7.20	1.491	1.476	1.434	1.392	1.327
8.40	1.445	1.429	1.388	1.348	1.282
9.60	1.401	1.388	1.349	1.313	1.250
10.80	1.353	1.344	1.308	1.273	1.209
12.00	1.314	1.308	1.275	1.244	1.189