

Revision Instructions
Callaway Plant Cycle 5
Core Operating Limits Report


REMOVE

page 11 (Figure 5)
page 12 (Figure 6)

INSERT

page 11, Rev. 1 (Figure 5)
page 12, Rev. 1 (Figure 6)

NOTE: This attachment includes the revision instructions
and the replacement pages.

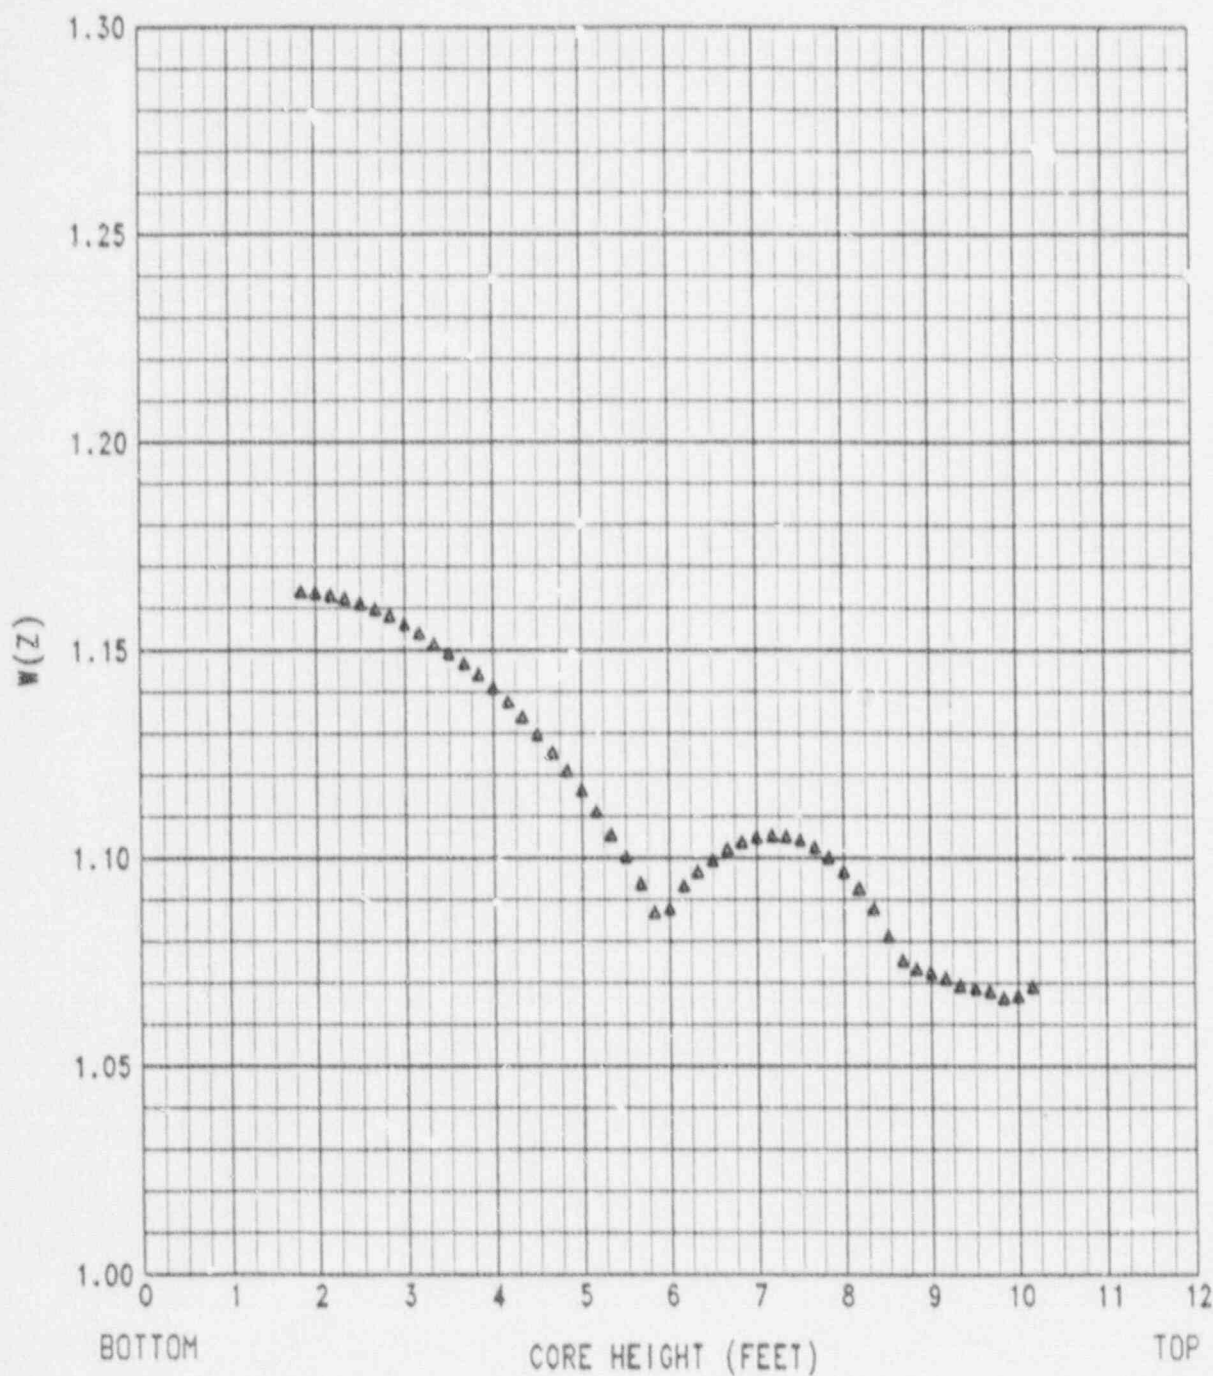


HEIGHT (FEET)	SOL W(Z)
* 0.000	1.0000
* 0.167	1.0000
* 0.333	1.0000
* 0.500	1.0000
* 0.667	1.0000
* 0.833	1.0000
* 1.000	1.0000
* 1.167	1.0000
* 1.333	1.0000
* 1.500	1.0000
* 1.667	1.0000
1.833	1.1641
2.000	1.1638
2.167	1.1632
2.333	1.1624
2.500	1.1613
2.667	1.1599
2.833	1.1583
3.000	1.1564
3.167	1.1541
3.333	1.1516
3.500	1.1492
3.667	1.1469
3.833	1.1442
4.000	1.1411
4.167	1.1377
4.333	1.1340
4.500	1.1298
4.667	1.1254
4.833	1.1211
5.000	1.1164
5.167	1.1112
5.333	1.1056
5.500	1.1003
5.667	1.0939
5.833	1.0871
6.000	1.0879
6.167	1.0934
6.333	1.0988
6.500	1.0998
6.667	1.1022
6.833	1.1039
7.000	1.1051
7.167	1.1055
7.333	1.1053
7.500	1.1044
7.667	1.1028
7.833	1.1002
8.000	1.0988
8.167	1.0927
8.333	1.0879
8.500	1.0813
8.667	1.0755
8.833	1.0734
9.000	1.0725
9.167	1.0712
9.333	1.0694
9.500	1.0687
9.667	1.0680
9.833	1.0666
10.000	1.0670
10.167	1.0692
* 10.333	1.0000
* 10.500	1.0000
* 10.667	1.0000
* 10.833	1.0000
* 11.000	1.0000
* 11.167	1.0000
* 11.333	1.0000
* 11.500	1.0000
* 11.667	1.0000
* 11.833	1.0000
* 12.000	1.0000

FIGURE 5

CALLAWAY UNIT 1 CYCLE 5

W(Z) AT 150 MWD/MTU
NO

* Top and bottom 15% excluded as per Tech Spec 4.2.2.2G

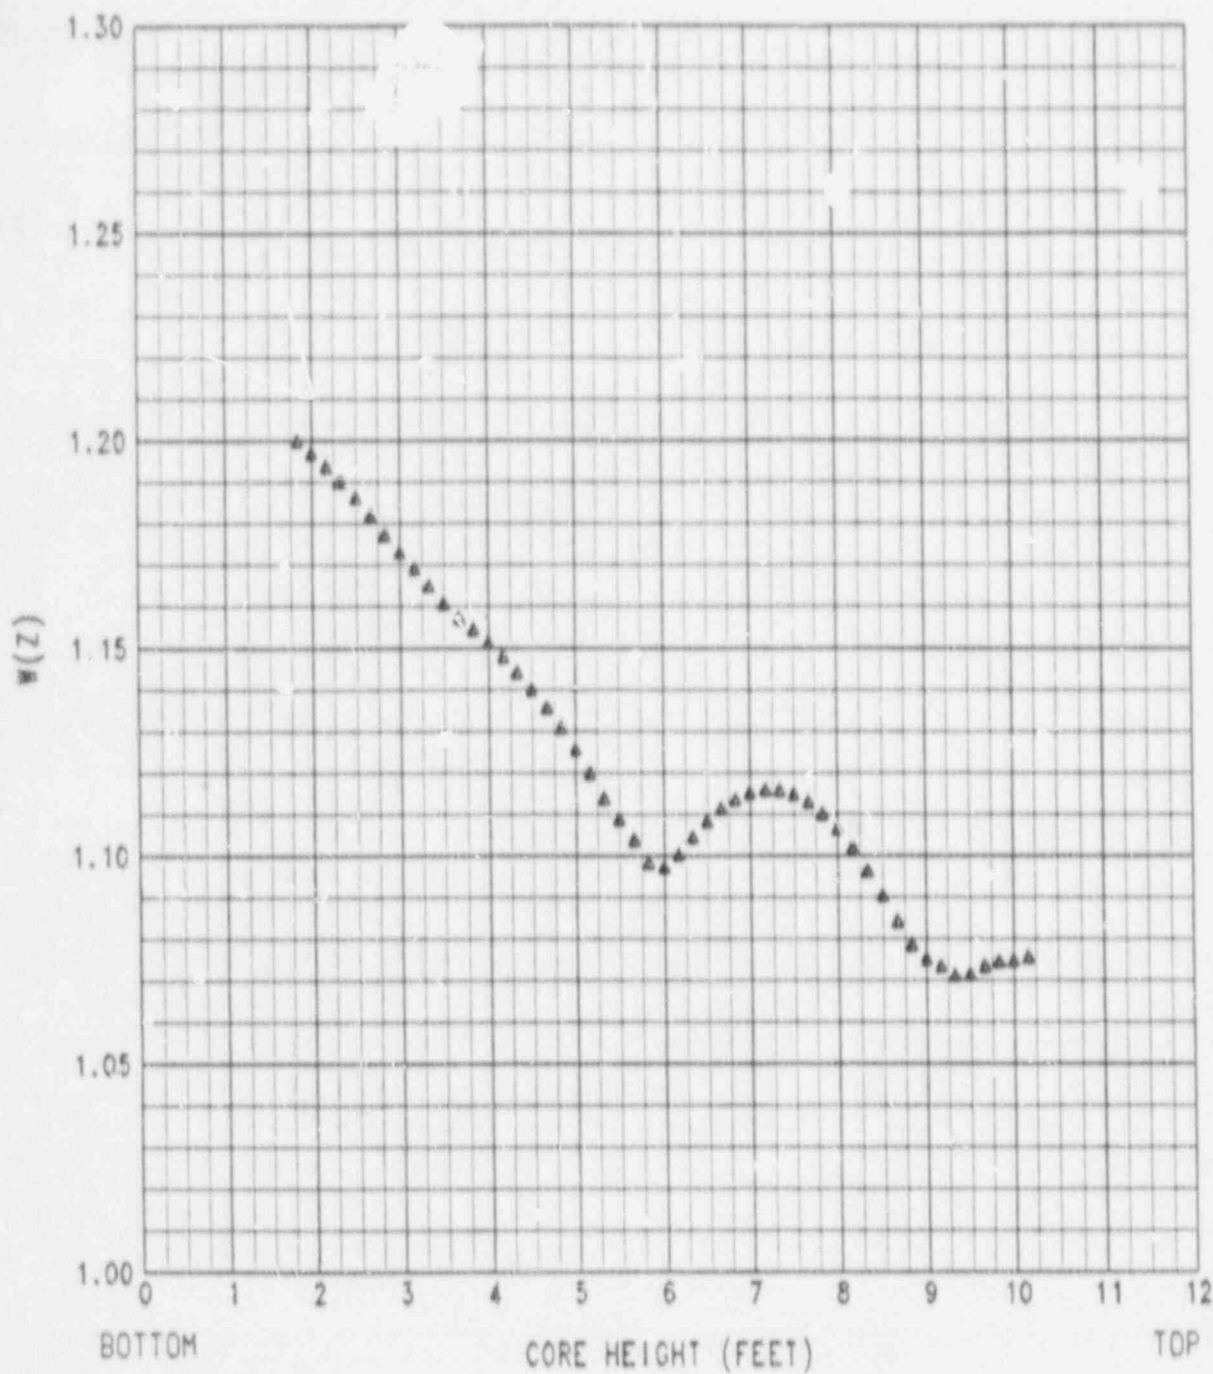

HEIGHT (FEET)	W(Z)
* 0.000	1.0000
* 0.167	1.0000
* 0.333	1.0000
* 0.500	1.0000
* 0.667	1.0000
* 0.833	1.0000
* 1.000	1.0000
* 1.167	1.0000
* 1.333	1.0000
* 1.500	1.0000
* 1.667	1.0000
1.833	1.2001
2.000	1.1871
2.167	1.1838
2.333	1.1802
2.500	1.1863
2.667	1.1820
2.833	1.1773
3.000	1.1731
3.167	1.1692
3.333	1.1651
3.500	1.1609
3.667	1.1573
3.833	1.1546
4.000	1.1515
4.167	1.1480
4.333	1.1442
4.500	1.1401
4.667	1.1357
4.833	1.1308
5.000	1.1257
5.167	1.1200
5.333	1.1139
5.500	1.1088
5.667	1.1039
5.833	1.0984
6.000	1.0973
6.167	1.1003
6.333	1.1046
6.500	1.1084
6.667	1.1114
6.833	1.1138
7.000	1.1152
7.167	1.1158
7.333	1.1158
7.500	1.1148
7.667	1.1130
7.833	1.1102
8.000	1.1086
8.167	1.1020
8.333	1.0966
8.500	1.0905
8.667	1.0843
8.833	1.0786
9.000	1.0753
9.167	1.0734
9.333	1.0713
9.500	1.0716
9.667	1.0735
9.833	1.0746
10.000	1.0748
10.167	1.0757
* 10.333	1.0000
* 10.500	1.0000
* 10.667	1.0000
* 10.833	1.0000
* 11.000	1.0000
* 11.167	1.0000
* 11.333	1.0000
* 11.500	1.0000
* 11.667	1.0000
* 11.833	1.0000
* 12.000	1.0000

FIGURE 6

CALLAWAY UNIT 1 CYCLE 5

 $W(Z)$ AT 8000 MWD/MTU
NO

* Top and bottom 15% excluded as per Tech Spec 4.2.2.2G