

VIRGINIA ELECTRIC AND POWER COMPANY

REVISIONS TO
SURRY POWER STATION EMERGENCY PLAN IMPLEMENTING PROCEDURES

Enclosed are recently revised pages to the Surry Power Station Emergency Plan Implementing Procedures. Please take the following actions in order to keep your manual updated with the most recent revisions.

| | | |
|------------------|--|---|
| <u>EPIP 4.21</u> | <u>Evacuation and Remote Assembly Area Monitoring</u> | |
| | <u>Remove and Destroy</u> | <u>Enter</u> |
| | Page 1 of 9, Page 4 of 9; Attachment 1, Page 1 of 1 | Page 1 of 9, 4 of 9; Attachment 1, Page 1 of 1 |
| <u>EPIP 5.03</u> | <u>Personnel Accountability</u> | |
| | <u>Remove and Destroy</u> | <u>Enter</u> |
| | Pages 1 of 7, 2 of 7; Att. 1, Pgs. 1, 2 & 3 | Pages 1 of 7, 2 of 7; Att. 1, Pgs. 1, 2 & 3 |
| <u>EPIP 5.04</u> | <u>Access Control</u> | |
| | <u>Remove and Destroy</u> | <u>Enter</u> |
| | Entire Old Procedure | Entire Procedure |
| <u>EPIP 5.05</u> | <u>Site Evacuation</u> | |
| | <u>Remove and Destroy</u> | <u>Enter</u> |
| | Pages 1, 2, 3, 4, 5 | Pages 1, 2, 3, 4, 5 |

VIRGINIA ELECTRIC AND POWER COMPANY
SURRY POWER STATION
EMERGENCY PLAN IMPLEMENTING PROCEDURE

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|---|----------------|
| EPIP-4.21 | EVACUATION AND REMOTE ASSEMBLY AREA MONITORING (With 3 Attachments) | 02 |
| | | PAGE 1 of 9 |

PURPOSE

Collect personnel dosimetry, monitor station personnel evacuating from the site, and decontaminate as necessary.

USER

Evacuation and remote assembly area monitoring.

ENTRY CONDITIONS

Any of the following:

1. Initiation by EPIP-4.01, Radiological Assessment Director Controlling Procedure;
OR
2. Initiation by EPIP-4.02, Radiation Protection Supervisor Controlling Procedure.

REVISION RECORD

| | | |
|---------|--|-------------------|
| REV. 00 | PAGE(S): Entire Procedure | DATE: 07-29-82 |
| REV. 01 | PAGE(S): 1 of 9, 4 of 9 | DATE: 02-24-83 |
| REV. 02 | PAGE(S): 1 of 9, 4 of 9; Attachment 1, page 1 of 1 | DATE: AUG 15 1983 |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |

APPROVAL RECOMMENDED

QC REVIEW

APPROVED

DATE

AUG 15 1983

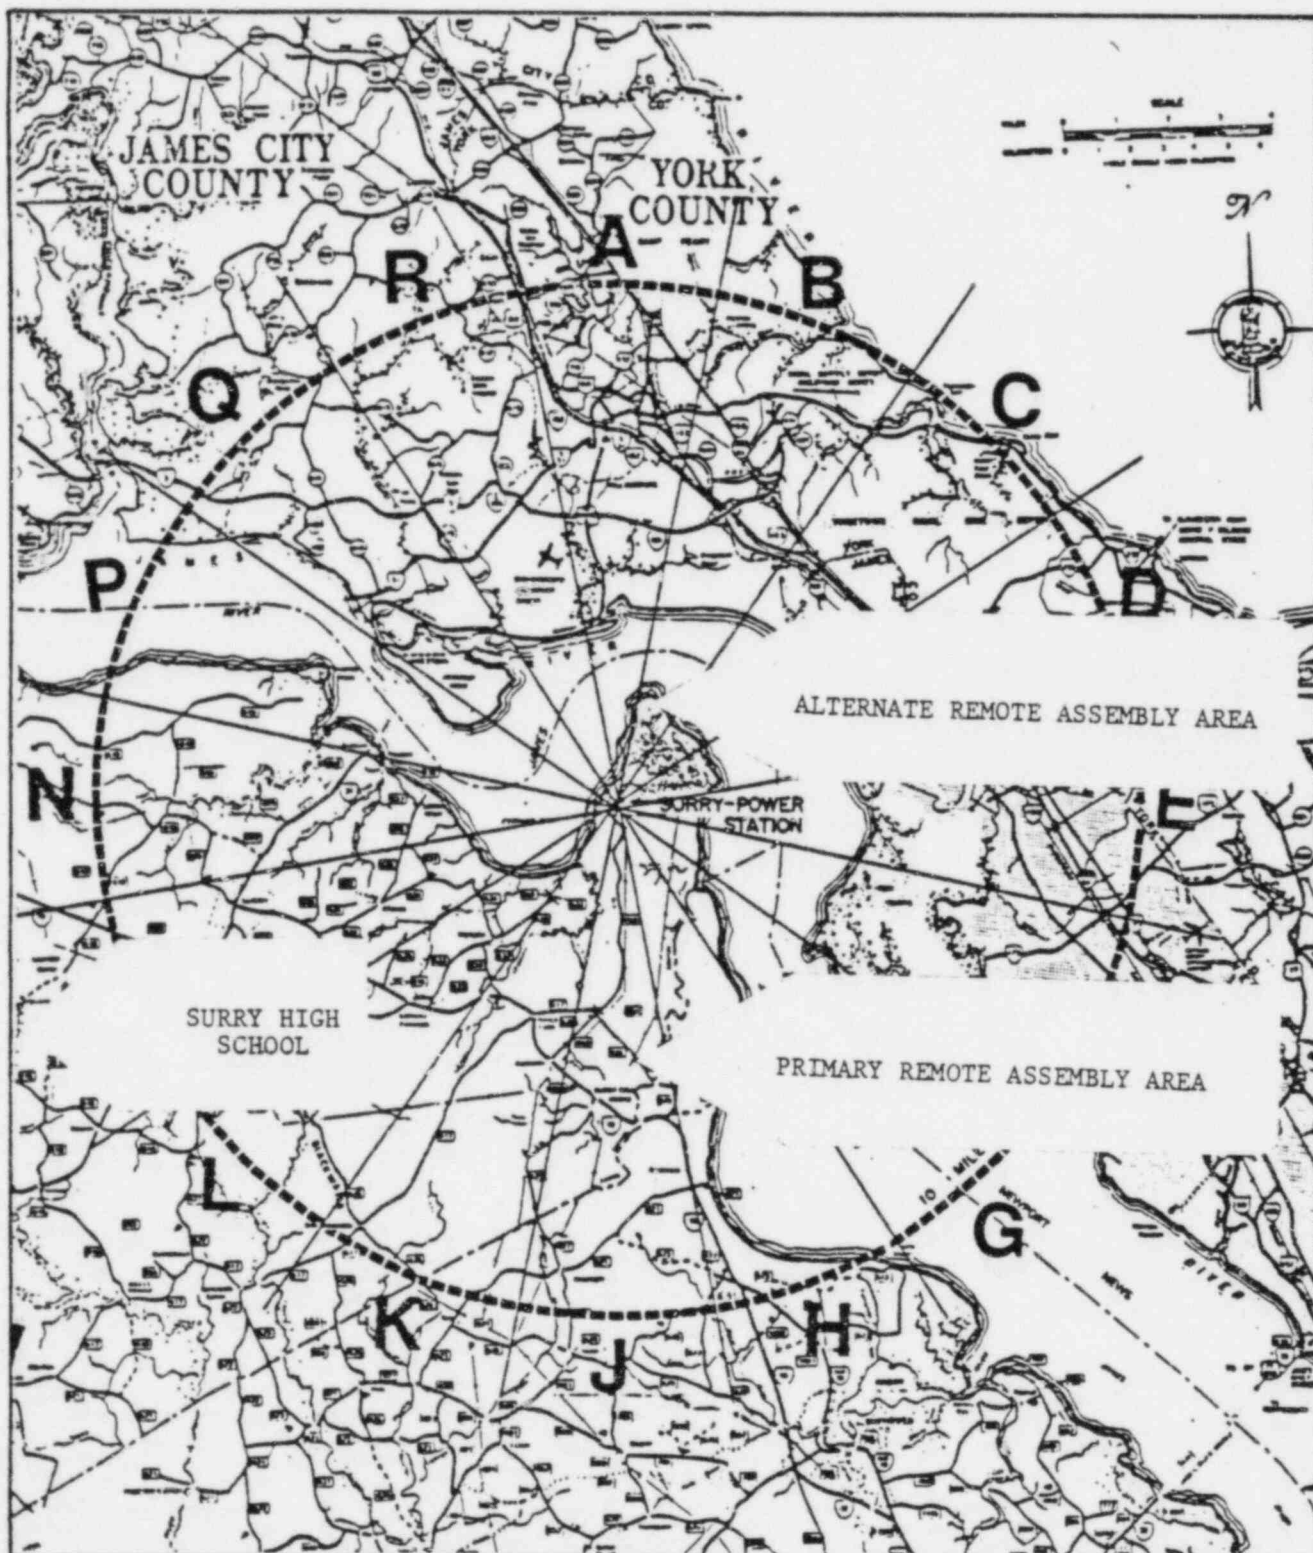
CHAIRMAN STATION NUCLEAR SAFETY
AND OPERATING COMMITTEE

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|---|----------------|
| EPIP-4.21 | EVACUATION AND REMOTE ASSEMBLY AREA MONITORING | 02 |
| | | PAGE 4 of 9 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|---|---|
| 6. | PROCEED TO REMOTE ASSEMBLY AREA: | |
| | a) Using Attachment 1, proceed on Route 650 to intersection of Routes 650 and 628, turn left and go 1.1 miles to remote assembly area parking lot on right. | a) Proceed on Rt. 650 to Hog Island wildlife management area if instructed. <u>GO TO Step 7.</u> |
| 7. | EVACUATION WITHOUT RADIOLOGICAL EMERGENCY: | |
| | a) <u>IF</u> emergency is non-radio-logical in nature: | a) <u>IF</u> emergency <u>IS</u> radiological in nature: |
| | 1) Continue with this pro-cedure | <u>GO TO Step 8.</u> |
| | b) Collect all dosimetry: | |
| | 1) Securely fastening the self-reading dosimeters to TLD's | |
| | c) Release individuals after collection of dosimetry | |
| | d) <u>GO TO Step 15</u> | |
| 8. | EVACUATION WITH RADIOLOGICAL EMERGENCY: | |
| | a) Collect all dosimetry: | |
| | 1) Securely fastening the self-reading dosimeters to the TLD's | |
| | b) Instruct individuals: | |
| | 1) Remain in vehicles until survey complete | |

AUG 15 1983

| | | |
|---------------------|---|----------------|
| NUMBER EPIP-4.21 | ATTACHMENT TITLE LOCATION OF REMOTE ASSEMBLY AREA | REVISION 02 |
| ATTACHMENT 1 | | PAGE 1 of 1 |



AUG 15 1983

VIRGINIA ELECTRIC AND POWER COMPANY
SURREY POWER STATION
EMERGENCY PLAN IMPLEMENTING PROCEDURE

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|---|----------|
| EPIP-5.03 | PERSONNEL ACCOUNTABILITY (With 1 Attachment) | 02 |
| | | PAGE |
| | | 1 of 7 |

PURPOSE

1. To determine the personnel who are inside the protected area and unaccounted for within 30 minutes following declaration of Site Emergency, or General Emergency.
2. To provide a periodically updated list of all personnel inside the protected area.

USER

Security Team Leader.

ENTRY CONDITIONS

Any one of the following:

1. Activation by another EPIP;
OR
2. Declaration of a Site Emergency, or General Emergency;
OR
3. Any time deemed necessary by the Station Emergency Manager.

REVISION RECORD

| | | |
|---------|---|-------------------|
| REV. 00 | PAGE(S): Entire Procedure | DATE: 07-29-82 |
| REV. 01 | PAGE(S): 1 of 7, 2 of 7, 6 of 7 | DATE: 02-24-83 |
| REV. 02 | PAGE(S): 1 of 7, 2 of 7; Att. 1, pg. 1, 2 & 3 | DATE: AUG 15 1983 |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |

APPROVAL RECOMMENDED

QC REVIEW

APPROVED

DATE

AUG 15 1983

CHAIRMAN STATION NUCLEAR SAFETY
AND OPERATING COMMITTEE

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|--------------------------|----------------|
| EPIP-5.03 | PERSONNEL ACCOUNTABILITY | 02 |
| | | PAGE 2 of 7 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|--|--|---|
| 1. | INITIATE EPIP-5.03: | |
| | a) INITIATED BY: _____ | |
| | TIME: _____ | |
| | DATE: _____ | |
| 2. | VERIFY EVACUATION STATUS: | |
| | a) Evacuation - NOT ORDERED | a) <u>IF</u> evacuation ordered, <u>GO TO</u> Step <u>10</u> . |
| <p>NOTE: Each Emergency Assembly Area will have an Emergency Assembly Area Leader. This person will be a supervisor or other cognizant person normally working in the Emergency Assembly Area.</p> <p>Each Emergency Assembly Area Leader will immediately take steps to determine who is missing from their Emergency Assembly Area that should be there, and who is present that should not be there.</p> <p>Each Emergency Assembly Area Leader will record the above information and forward it to Security.</p> | | |
| 3. | INITIATE ACCOUNTABILITY WITHOUT EVACUATION: | |
| | a) Make announcement on station Gai-Tronics system as follows: | |
| | 1) "Emergency Assembly Area Leaders - TAKE ACCOUNT-ABILITY" | |
| | 2) "Emergency Assembly Area Leaders deliver results of accountability to security" | |
| | 3) "Warehouse, Environmental lab & South Annex call exts. 345 or 346 and report results of accountability to security" | |

AUG 15 1963

AUG 15 1963

| | | |
|---------------------|--|----------------|
| NUMBER EPIP-5.03 | ATTACHMENT TITLE PERSONNEL ACCOUNTABILITY | REVISION 02 |
| ATTACHMENT 1 | | PAGE 1 of 3 |

| ASSEMBLY AREA | Column 1 - those missing from their assembly area (Name) | Column 2 - those present that should not be here (Name and Badge No.) |
|---|--|---|
| ADMINISTRATION BLDG: | | |
| Station Management Front Office Admin. Xerox Trailer Records - QC Trailer Projects Personnel Westinghouse Start-up Personnel NRC Trailer | | |
| SECURITY: | | |
| Security Dept. Visitors (non-Vepco) CPTS Safety H.P. Dose Control Trailer Emerg. Planning | | |
| TRAINING AUDITORIUM: | | |
| Training Department Students | | |
| WAREHOUSE: | | |
| Warehouse Personnel | | |
| ENVIRONMENTAL LAB: | | |
| Environmental Dept. Drawing Update Dept. Performance Engrs. STA Q.C. Trailers NDT | | |

AUG 15 1983

| | | |
|------------|--------------------------|----------|
| NUMBER | ATTACHMENT TITLE | REVISION |
| EPiP-5.03 | PERSONNEL ACCOUNTABILITY | 02 |
| ATTACHMENT | | PAGE |
| 1 | | 2 of 3 |

| ASSEMBLY AREA | <u>Column 1 - those missing from their assembly area (Name)</u> | <u>Column 2 - those present that should not be here (Name and Badge No.)</u> |
|------------------------|---|--|
| SOUTH ANNEX: | | |
| Engineers | | |
| Q. C. Department | | |
| Reproductions | | |
| Station Records | | |
| Medical Department | | |
| W. B. Count Room | | |
| INSTRUMENT CAL LAB: | | |
| Instrument Cal Lab | | |
| Personnel | | |
| CONTROL ROOM: | | |
| Operations Dept. | | |
| INSTRUMENT SHOP: | | |
| Instrument Dept. | | |
| HEALTH PHYSICS OFFICE: | | |
| H.P. Department | | |
| Dose Control | | |
| Clean Change Room | | |
| CHEMISTRY LAB: | | |
| Chemistry Dept. | | |
| OLD ELECTRIC SHOP: | | |
| Maintenance Services | | |

| | | |
|------------|--------------------------|----------|
| NUMBER | ATTACHMENT TITLE | REVISION |
| EPIP-5.03 | PERSONNEL ACCOUNTABILITY | 02 |
| ATTACHMENT | | PAGE |
| 1 | | 3 of 3 |

| ASSEMBLY AREA | <u>Column 1</u> - those missing from their assembly area (Name) | <u>Column 2</u> - those present that should not be here (Name and Badge No.) |
|---|---|--|
| CONDENSATE POLISHING: | | |
| Operations Dept. Tool Room | | |
| 1st Floor NEW MACHINE SHOP: | | |
| Mechanical Maintenance Electrical Maintenance Weld Shop Planning | | |
| #1 TURBINE BLDG. BASEMENT: | | |
| Non VEPCO Construction | | |
| STOREROOM: | | |
| Storeroom Personnel Fire Marshal and Staff | | |
| MPP | | |
| | | |

AUG 15 1983

VIRGINIA ELECTRIC AND POWER COMPANY
SURRY POWER STATION
EMERGENCY PLAN IMPLEMENTING PROCEDURE

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|--|----------------|
| EPIP-5.04 | ACCESS CONTROL (With 2 Attachments) | 01 |
| | | PAGE 1 of 4 |

PURPOSE

To insure that under emergency conditions only personnel with an emergency response function have access to the site.

USER

Security Team Leaders.

ENTRY CONDITIONS

Any one of the following:

1. Activation by another EPIP;

OR

2. Any time deemed necessary by the Station Emergency Manager;

REVISION RECORD

| | | |
|---------|---------------------------|-------------------|
| REV. 00 | PAGE(S): Entire Procedure | DATE: 07-29-82 |
| REV. 01 | PAGE(S): Entire Procedure | DATE: AUG 15 1983 |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |
| REV. | PAGE(S): | DATE: |

APPROVAL RECOMMENDED

QC REVIEW

APPROVED

DATE

AUG 15 1983

CHAIRMAN STATION NUCLEAR SAFETY
AND OPERATING COMMITTEE

| | | |
|-----------|-----------------|----------|
| NUMBER | PROCEDURE TITLE | REVISION |
| EPIP-5.04 | ACCESS CONTROL | 01 |
| | | PAGE |
| | | 2 of 4 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|--|--|
| 1. | INITIATE EPIP-5.04: a) INITIATED BY: _____ TIME: _____ DATE: _____ | |
| 2. | VERIFY EVACUATION STATUS: a) Evacuation - ORDERED | a) IF Evacuation <u>NOT</u> ordered, <u>GO TO</u> Step <u>5</u> . |
| 3. | MAN MOTORIZED GATES: a) Open motorized gate 1 and gate 3 if required b) Collect security badges as personnel evacuate c) Remind evacuating person- nel to keep their pocket dosimeters and TLDs | |
| 4. | CONTROL TRAFFIC: a) Dispatch Security personnel control b) Request Surry County Sheriff set-up roadblock 1) Station PBX - #9-1-294-3156 <u>OR</u> #9-1-294-3157 | 1) Use Security radio link |

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|-----------------|----------|
| EPIP-5.04 | ACCESS CONTROL | 01 |
| | | PAGE |
| | | 3 of 4 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|---|--|
| 4. | (CONTINUED) | |
| | c) Dispatch Security personnel to intersections of Rt. 650 and Rt. 617 and Rt. 650 and Rt. 628 with EPIP-5.04, Attachment 1, <u>Security Duties at Roadblock</u> | c) Dispatch Security personnel to Entrance to Hog Island gate with EPIP-5.04, Attachment 2, <u>Security Duties at Alternate Remote Assembly Area (Hog Island).</u> |
| | d) Dispatch Security personnel to remote assembly area on Rt. 628 with keys. | |
| | e) Unlock remote assembly area | |
| | f) Control traffic entering, within, and exiting remote assembly area. | |
| | <u>NOTE:</u> No Security personnel are to evacuate the site unless directed by the Station Emergency Manager, except security confidential clerk and security administrative assistant. | |
| 5. | NOTIFY VISITORS: | |
| | a) Notify visitors site is closed and they must leave | a) <u>IF</u> visitors have an emergency response function have Station Emergency Manager authorize them. |
| 6. | EXPEDITE MOVEMENT OF EMERGENCY VEHICLES AND PERSONNEL: | |
| | a) Quickly move emergency response vehicles and personnel to the area where emergency exists | |

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|-----------------|----------|
| EPIP-5.04 | ACCESS CONTROL | 01 |
| | | PAGE |
| | | 4 of 4 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|--|---|
| 6. | (CONTINUED) | |
| | b) Assist H.P. personnel in distribution of dosimetry to emergency response visitors | |
| | c) Allow H.P. monitoring personnel quick access to offsite and onsite areas | |
| 7. | VERIFY EMERGENCY: | |
| | a) Alert, Site Emergency or General Emergency - EXISTS | a) <u>IF NOT</u> , <u>GO TO</u> Step <u>8</u> . |
| | b) <u>GO TO</u> Step <u>2</u> of this procedure | <u>AND</u> Await instructions from Station Emergency Manager |
| 8. | TERMINATE EPIP-5.04: | |
| | a) Close-Out | |
| | 1) COMPLETED BY: _____ | |
| | DATE: _____ | |
| | TIME: _____ | |
| | b) Forward EPIP-5.04, with all attachments to SNSOC for review | |
| | END | |

| NUMBER | ATTACHMENT TITLE | REVISION |
|------------|------------------------------|----------|
| EPIP-5.04 | SECURITY DUTIES AT ROADBLOCK | 01 |
| ATTACHMENT | | PAGE |
| 1 | | 1 of 2 |

1. VERIFY ROADBLOCK REQUESTED:

- a) Check with Security Shift Supervisor to see if roadblock was requested from LLEA at intersection of Rt. 650 and Rt. 617

- a) If required, check with Station Emergency Manager.

2. PROCEED TO ROADBLOCK:

- a) Proceed to intersections of Rt. 650 and Rt. 617, and Rt. 650 and Rt. 628

3. AID IN CONTROLLING TRAFFIC:

- a) Assist LLEA in controlling road block
- b) Direct station evacuees toward remote assembly area on Rt. 628.
- c) Keep intersections and Rt. 650 passable for emergency response personnel

4. IDENTIFY EMERGENCY RESPONSE PERSONNEL:

- a) By personal recognition
- b) By VEPCO identification
- c) State identification
- d) NRC identification
- e) Fire or rescue affiliation

| | | |
|---------------------|--|----------------|
| NUMBER EPIP-5.04 | ATTACHMENT TITLE SECURITY DUTIES AT ROADBLOCK | REVISION 01 |
| ATTACHMENT 1 | | PAGE 2 of 2 |

NOTE: Access to the station is to be limited to those individuals responding in accordance with the Emergency Plan i.e., Surry Power Station employees, Vepco corporate personnel, local fire or rescue units and personnel, NRC employees and State employees.

5. DETAIN PERSONNEL WITH NO IDENTIFICATION:
 - a) IF doubt exists pertaining to identity and response purpose of an individual:
 - 1) Do not allow passage through roadblock
 - 2) Seek authorization to proceed from the Station Emergency Manager in the TSC or Control Room
6. TERMINATE ATTACHMENT 1:
 - a) Close Out
 - 1) COMPLETED BY: _____
 - DATE: _____
 - TIME: _____
 - b) Affix this Attachment 1 to EPIP-5.04

END

| | | |
|---------------------|---|----------------|
| NUMBER EPIP-5.04 | ATTACHMENT TITLE SECURITY DUTIES AT ALTERNATE REMOTE ASSEMBLY AREA (HOG ISLAND) | REVISION 01 |
| ATTACHMENT 2 | | PAGE 1 of 2 |

1. VERIFY EVACUATION
ORDERED TO HOG ISLAND:
 - a) Verify with Security Shift Supervisor
 - a) IF required, check with Station Emergency Manager

2. ENTRANCE TO HOG ISLAND
GATE:
 - a) Obtain keys to Hog Island gate from Security Shift Supervisor
 - b) Take bolt cutters in the event keys do not work

3. DIRECT TRAFFIC TO HOG ISLAND:
 - a) Direct traffic from station site

AND

 - b) Construction site

4. EVACUATION TO HOG ISLAND:
 - a) Insure orderly evacuation to Hog Island by the following:
 - 1) Evacuees continue to end of road
 - 2) Evacuees do not block the road
 - 3) Evacuees remain in vehicles for further instruction

| | | |
|---------------------|---|----------------|
| NUMBER EPIP-5.04 | ATTACHMENT TITLE SECURITY DUTIES AT ALTERNATE REMOTE ASSEMBLY AREA (HOG ISLAND) | REVISION 01 |
| ATTACHMENT 2 | | PAGE 2 of 2 |

5. DETAIN EVACUEES:
- a) For Health Physics Monitoring
 - b) For further instructions from
Security Shift Supervisor/
Station Emergency Manager
6. TERMINATE ATTACHMENT 2:
- a) Close Out
 - 1) COMPLETED BY: _____
 - DATE: _____
 - TIME: _____
 - b) Affix this Attachment 2 to
EPIP-5.04

END

AUG 15 1983

VIRGINIA ELECTRIC AND POWER COMPANY
SURRY POWER STATION
EMERGENCY PLAN IMPLEMENTING PROCEDURE

| NUMBER | PROCEDURE TITLE | REVISION |
|-----------|--|----------------------|
| EPIP-5.05 | SITE EVACUATION (With No Attachments) | 02 PAGE 1 of 5 |

PURPOSE

Insure steps are taken to provide for a quick and orderly evacuation.

USER

Station Emergency Manager OR Emergency Administrative Director.

ENTRY CONDITIONS

Any one of the following conditions exist:

1. Activation by another EPIP;

OR

2. Upon determining evacuation is imminent;

OR



3. At any time deemed necessary by the Station Emergency Manager.

REVISION RECORD


REV. 00 PAGE(S): Entire Procedure
REV. 01 PAGE(S): 1 of 5, 3 of 5
REV. 02 PAGE(S): Entire Procedure
REV. PAGE(S):
REV. PAGE(S):
REV. PAGE(S):
REV. PAGE(S):

DATE: 07-29-82
DATE: 02-24-83
DATE: AUG 15 1983
DATE:
DATE:
DATE:

APPROVAL RECOMMENDED


QC REVIEW


APPROVED


CHAIRMAN STATION NUCLEAR SAFETY
AND OPERATING COMMITTEE

DATE

AUG 15 1983

| | | |
|-----------|-----------------|----------|
| NUMBER | PROCEDURE TITLE | REVISION |
| EPIP-5.05 | SITE EVACUATION | 02 |
| | | PAGE |
| | | 2 of 5 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|--|-----------------------|
| 1. | INITIATE EPIP-5.05: | |
| | a) BY: _____ | |
| | TIME: _____ | |
| | DATE: _____ | |
| 2. | DETERMINE WIND DIRECTION: | |
| | a) IF wind from NNW, N, or NNE use alternate remote assembly area (Hog Island) | |
| | b) IF wind from any other compass direction, use primary remote assembly area (on Rt. 628) | |
| 3. | NOTIFY STATION SECURITY: | |
| | a) Notify Security Shift Supervisor by Station PBX - #346 | a) Use Gai-Tronics. |
| | b) Advise that evacuation is about to be ordered | |
| | c) Advise which assembly area to be used | |
| | d) Verify EPIP-5.04, <u>Access Control</u> has been activated | |
| 4. | NOTIFY MPP: | |
| | a) Notify MPP Security by Station PBX - #84-456 | |
| | b) Inform evacuation ordered | |
| | c) Advise which assembly area is to be used | |

AUG 15 1983

| | | |
|-----------|-----------------|----------|
| NUMBER | PROCEDURE TITLE | REVISION |
| EPIP-5.05 | SITE EVACUATION | 02 |
| | | PAGE |
| | | 3 of 5 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|--|---|
| 5. | CALL TRAINING CENTER: a) Notify training personnel by Station PBX - #270, 271, or 272 b) Inform evacuation ordered c) Advise which assembly area is to be used | |
| 6. | INPLANT NOTIFICATION: a) Verify primary remote assembly area to be used (Rt. 628) b) Sound Emergency Alarm c) Make announcement on station Gai-Tronics as follows: 1) "Personnel <u>NOT</u> responding to emergency evacuate the station" 2) "Turn in security badge, keep pocket dosimeter and TLD" 3) "Proceed to intersection of Routes 650 and 628, turn left and go 1.1 miles to remote assembly area parking lot on right" 4) "Remain in vehicle for further instructions" d) Repeat Steps <u>6</u> <u>THEN</u> , <u>GO TO</u> Step <u>8</u> | a) <u>IF NOT</u> , <u>GO TO</u> Step <u>7</u> . |

| | | |
|-----------|-----------------|----------|
| NUMBER | PROCEDURE TITLE | REVISION |
| EPIP-5.05 | SITE EVACUATION | 02 |
| | | PAGE |
| | | 4 of 5 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|---|-----------------------|
| 7. | INPLANT NOTIFICATION: | |
| | a) Verify alternate remote assembly area to be used (Hog Island) | |
| | b) Sound Emergency Alarm | |
| | c) Make announcement on station Gai-Tronics system as follows: | |
| | 1) "Personnel <u>NOT</u> responding to emergency evacuate the station" | |
| | 2) "Turn in security badge, keep pocket dosimeters and TLD" | |
| | 3) "Proceed on Rt. 650 to Hog Island Wildlife Management Area" | |
| | 4) "Continue to end of road" | |
| | 5) "Remain in vehicle for further instructions" | |
| | d) Repeat Step 7, <u>THEN</u> continue with this instruction | |
| 8. | VERIFY EPIP-4.21: | |
| | a) Verify EPIP-4.21 <u>Evacuation Remote Assembly Area Monitoring - ACTIVATED</u> | |
| | 1) Check with Radiological Assessment Director | |

| | | |
|-----------|-----------------|----------|
| NUMBER | PROCEDURE TITLE | REVISION |
| EPIP-5.05 | SITE EVACUATION | 02 |
| | | PAGE |
| | | 5 of 5 |

| STEP | ACTION/EXPECTED RESPONSE | RESPONSE NOT OBTAINED |
|------|--|-----------------------|
| 9. | TERMINATE EPIP-5.05: | |
| a) | Close-Out | |
| | 1) COMPLETED BY: _____ | |
| | TIME: _____ | |
| | DATE: _____ | |
| b) | Forward EPIP-5.05 to SNSOC for review | |

END