

3. Unit 1 and 2 Technical Specification 4.7.11.1.2 c.

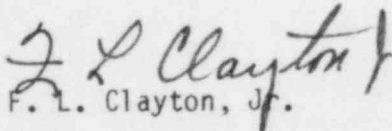
The fire suppression water system surveillance requirement 4.7.11.1.2.c requires that every 18 months, during shutdown, the fire pump diesel must be subjected to an inspection. Since the inspection can be performed independent of the operating mode of the plant without affecting the validity of the test or plant operation, the requirement to perform the inspection during shutdown is not appropriate. Therefore, the proposed change is to delete the words "during shutdown" which will allow better scheduling of this surveillance requirement. This change is administrative in nature since it does not affect the extent, frequency or validity of the surveillance requirement.

These proposed changes are administrative in nature such that a significant hazards consideration is not involved, as defined in 10CFR50.92, and is consistent with item (i) of the "Examples of Amendments that are Considered Not Likely to Involve Significant Hazards Consideration" listed on page 14870 of the April 6, 1983 issue of the Federal Register. The Plant Operations Review Committee has reviewed this proposed change. The Nuclear Operations Review Board will review this change at a future meeting.

The class of this change is designated as Class II for Unit 1 and Class I for Unit 2 according to 10CFR170.22 requirements. A check for \$1,600.00 to cover the total amount of fees required is enclosed with this letter.

In accordance with 10CFR50.30(c)(1)(i) three signed originals and forty (40) additional copies of this proposed change are enclosed.


Yours very truly,


F. L. Clayton, Jr.

FLCJr/GGY:lsh-D2
Attachment

cc: Mr. R. A. Thomas
Mr. G. F. Trowbridge
Mr. J. P. O'Reilly
Mr. E. A. Reeves
Mr. W. H. Bradford
Dr. I. L. Myers

SWORN TO AND SUBSCRIBED BEFORE ME
THIS 26th DAY OF August, 1983


Notary Public

My Commission Expires: 1-10-87

ATTACHMENT

Proposed Technical Specification Changes

Unit 1

Page 3/4 7-84

Unit 2

Page 3/4 7-54

Page 3/4 7-57

Page 3/4 7-61