



LOUISIANA
POWER & LIGHT

142 DELARONDE STREET
P. O. BOX 6008 • NEW ORLEANS, LOUISIANA 70174 • (504) 366-2345

January 11, 1984


W3K84-0062
Q-3-A35.07.132

Mr. John T. Collins
Regional Administrator, Region IV
U. S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76012

REFERENCE: Telecon C. Hooper (LP&L) and W. Crossman (NRC IV) on
December 5, 1984

Dear Mr. Collins:

SUBJECT: Waterford SES Unit No. 3
Docket No. 50-382
Potentially Reportable Deficiency No. 132
"Diesel Generator "A" Lube Oil System"
Final Report

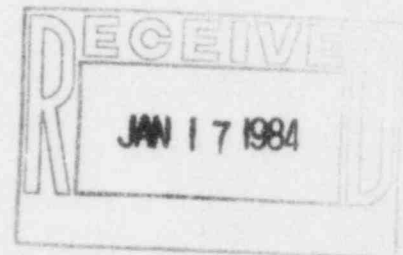

On December 5, 1984 a problem with the Lube Oil System of Diesel Generator "A" was reported as Potentially Reportable Deficiency No. 132. Further evaluation of the previously described condition indicates this condition is not considered reportable pursuant to the requirement of 10CFR50.55(e).

EVALUATION

CIWA's 83D308 and 83D684 are not reportable because the water in the oil was caused by a maintenance error which was immediately detected during a test run by a safety related differential pressure device and corrective action was taken through normal maintenance activities.

CIWA 83A966 is not reportable because the Airpac unit does not affect the diesel generator in the emergency mode.

Very truly yours,

T. F. Gerrets
Quality Assurance Manager

TFG:CNH:JC

8401240469 840111
PDR ADOCK 05000382
S PDR

IE-27 1/1

Mr. J. T. Collins

January 11, 1984

W3K84-0062

Page 2

cc: Director
Office of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555
(15 copies)

Director
Office of Management
Information and Program Control
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Mr. E. L. Blake
Shaw, Pittman, Potts, & Trowbridge
1300 M Street, N.W.
Washington, D.C. 20036

Mr. W. M. Stevenson
Monroe & Lemann
1424 Whitney Building
New Orleans, Louisiana 70130

Records Center
Institute of Nuclear Power Operations
1100 Circle 75 Parkway, Suite 1500
Atlanta, Georgia 30339