

LICENSEE EVENT REPORT (LER)

APPROVED OMB NO. 3150-004
EXPIRES 8/31/95FACILITY NAME (1)
Virgil C. Summer Nuclear Station

DOCKET NUMBER (2)

0500101

PAGE

1 OF 1

TITLE (4)
Missed Fire Watch Patrol

EVENT DATE (5)			LER NUMBER (6)			REPORT DATE (7)			OTHER FACILITIES INVOLVED (8)												
MONTH	DAY	YEAR	YEAR	SEQUENTIAL NUMBER	REVISION NUMBER	MONTH	DAY	YEAR	FACILITY NAMES		DOCKET NUMBER (3)										
0	1	1	8	4	8	4	0	0	2	0	0	0	2	8	4	0	5	0	0	0	1
OPERATING MODE (9)		1		THIS REPORT IS SUBMITTED PURSUANT TO THE REQUIREMENTS OF 10 CFR § 42.49. Check one or more of the following: (11)																	
POWER LEVEL (10)		100		20.402(a)		20.402(b)		60.73(a)(2)(i)		73.71(a)											
				20.402(a)(1)(i)		60.36(a)(1)		60.73(a)(2)(ii)		73.71(a)											
				20.402(a)(1)(ii)		60.36(a)(2)		60.73(a)(2)(iii)		OTHER: Specify in Attachment and in Title, NRC Form 366A											
				20.402(a)(1)(iii)		60.73(a)(2)(iv)		60.73(a)(2)(v)													
				20.402(a)(1)(iv)		60.73(a)(2)(vi)		60.73(a)(2)(vii)													
				20.402(a)(1)(v)		60.73(a)(2)(viii)		60.73(a)(2)(ix)													
				20.402(a)(1)(vi)		60.73(a)(2)(x)		60.73(a)(2)(xi)													

LICENSEE CONTACT FOR THIS LER (12)

NAME

Richard J. Bouknight

Richard J. Bouknight /s/

TELEPHONE NUMBER

AREA CODE

803

345-5209

COMPLETE ONE LINE FOR EACH COMPONENT FAILURE DESCRIBED IN THIS REPORT (13)

CAUSE	SYSTEM	COMPONENT	MANUFACTURER	REPORTABLE TO NRC	CAUSE	SYSTEM	COMPONENT	MANUFACTURER	REPORTABLE TO NRC
A	I	C		N					

SUPPLEMENTAL REPORT EXPECTED (14)

YES (If yes, complete EXPECTED SUBMISSION DATE)	NO	EXPECTED SUBMISSION DATE (15)	MONTH	DAY	YEAR
	X				

ABSTRACT (Limit to 1400 words; i.e., approximately fifteen single-space typewritten lines) (16)

At 0800, January 11, 1984, it was identified that the hourly roving fire watch patrol for the Auxiliary Building (West Penetration), Room 63-03, had not been performed during the previous eight (8) hours as required by Technical Specification 3.7-10, "Fire Rated Assemblies." The cause of this event was personnel error. The applicable information was not transferred from the previous daily fire watch log to that of January 11th. Probable consequences of this event were minimal. The area is protected by smoke detectors, and the zone fire loading for the area is 8,800 btu/ft². The following action has been taken to preclude recurrence. The roving fire watches on midshift are now verifying required checks, per the Removal and Restoration Log, daily with the Shift Supervisor at midnight.

IE22
11

SOUTH CAROLINA ELECTRIC & GAS COMPANY

POST OFFICE 764

COLUMBIA, SOUTH CAROLINA 29218

O. W. DIXON, JR.
VICE PRESIDENT
NUCLEAR OPERATIONS

February 2, 1984

Mr. James P. O'Reilly
Regional Administrator
U.S. Nuclear Regulatory Commission
Region II, Suite 2900
101 Marietta Street, N.W.
Atlanta, Georgia 30303


SUBJECT: Virgil C. Summer Nuclear Station
Docket No. 50/395
Operating License No. NPF-12
LER 84-002

Dear Mr. O'Reilly:

Please find attached Licensee Event Report #84-002 for the Virgil C. Summer Nuclear Station. This Report is submitted pursuant to the requirements of 10 CFR 50.73(a)(2)(i).

Should there be any questions, please call us at your convenience.

Very truly yours,

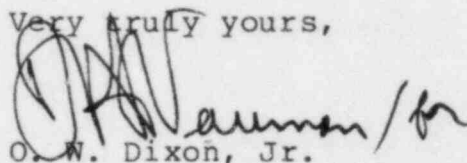

O. W. Dixon, Jr.

RBJ:OWD/dwf/fjc
Attachment

cc: V. C. Summer
T. C. Nichols, Jr./O. W. Dixon, Jr.
E. H. Crews, Jr.
E. C. Roberts
W. A. Williams, Jr.
D. A. Nauman
Group Managers
O. S. Bradham
C. A. Price
D. A. Lavigne
J. F. Heilman

C. L. Ligon (NSRC)
G. J. Braddick
D. J. Richards
NRC Res. Inspector
J. B. Knotts, Jr.
I&E (Washington)
Document Management
Branch
INPO Records Center
NPCF
File

OFFICIAL COPY

IE22

11