




KANSAS GAS AND ELECTRIC COMPANY

GLENN L. KOESTER
VICE PRESIDENT - NUCLEAR

October 7, 1983

Mr. W.C. Seidle, Chief
Reactor Projects Branch 2
U.S. Nuclear Regulatory Commission
Region IV
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

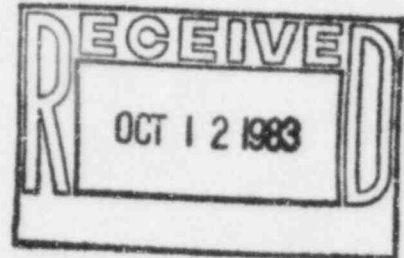

KMLNRC 83-127

Re: Docket No. STN 50-482

Ref: Interim Report KMLNRC 83-094 dated 7/20/83 from
GLKoester, KG&E, to WCSeidle, NRC

Subj: Withdrawal of Potential 10CFR50.55(e) - General
Electric AKR Breakers

Dear Mr. Seidle:

On June 20, 1983, Kansas Gas and Electric Company (KG&E) reported a potential 10CFR50.55(e) item concerning cracked insulated couplings in General Electric AKR breakers. Additional information was subsequently provided in the Reference.

The Architect/Engineer has completed the evaluation of this matter and has determined that the identified concern would not have adversely affected the safety of operations had it gone uncorrected. Therefore, KG&E has concluded that this matter is not reportable pursuant to 10CFR50.55(e).

Please contact me or Mr. Otto Maynard of my staff if you have any questions concerning this subject.

Yours very truly,

Glenn L. Koester

GLK:bb

cc: RCDeYoung
WSchum/ASmith

8310180256 831007
PDR ADOCK 05000482
S PDR

IE-27 1/0