

LICENSEE EVENT REPORT

CONTROL BLOCK: 1 (PLEASE PRINT OR TYPE ALL REQUIRED INFORMATION)

0 1 F L S L S 2 2 0 0 - 0 0 0 0 0 0 - 0 0 3 4 1 1 1 1 4 5  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30  
LICENSEE CODE LICENSE NUMBER LICENSE TYPE JO 57 CAT 58

CON'T  
0 1 REPORT SOURCE L 6 0 5 0 0 0 3 8 9 7 1 1 2 4 8 3 8 1 2 2 7 8 3 9  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30  
DOCKET NUMBER EVENT DATE REPORT DATE

EVENT DESCRIPTION AND PROBABLE CONSEQUENCES (10)  
0 2 While at 100% power, fire doors were found open. Action was taken in  
0 3 accordance with T.S. 3.7.12. This event, the fourth of its type, has no  
0 4 effect on the health and safety of the public. This event covers the  
0 5 time period from 11-24-83 to 12-24-83. (Previous event 389-83-46, 83-58  
0 6 and 83-69). There were three occurrences of this event during this  
0 7 period.  
0 8  
0 9

SYSTEM CODE CAUSE CODE CAUSE SUBCODE COMPONENT CODE COMP SUBCODE VALVE SUBCODE  
A B 11 X 12 Z 13 Z Z Z Z Z 14 Z 15 Z 16  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30  
LER/RO REPORT NUMBER EVENT YEAR SEQUENTIAL REPORT NO. OCCURRENCE CODE REPORT TYPE REVISION NO.  
17 8 3 0 7 5 0 3 L 0  
21 22 23 24 25 26 27 28 29 30 31 32

ACTION TAKEN FUTURE ACTION EFFECT ON PLANT SHUTDOWN METHOD HOURS ATTACHMENT SUBMITTED NPD-4 FORM SUB PRIME COMP SUPPLIER COMPONENT MANUFACTURER  
G 18 Z 19 Z 20 Z 21 0 0 0 0 N 23 N 24 Z 25 Z 9 9 9 25  
33 34 35 36 37 38 39 40 41 42 43 44 45 46 47

CAUSE DESCRIPTION AND CORRECTIVE ACTIONS (27)  
1 0 These doors were open primarily while construction was in progress with  
1 1 hoses or cables running through the doors. A continuous fire patrol has  
1 2 been in place since unit startup.  
1 3  
1 4

FACILITY STATUS % POWER OTHER STATUS (30) METHOD OF DISCOVERY DISCOVERY DESCRIPTION (32)  
1 5 E 23 1 0 0 29 NA 31 Operator Observation  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30

ACTIVITY CONTENT RELEASED OF RELEASE AMOUNT OF ACTIVITY (35) LOCATION OF RELEASE (36)  
1 6 Z 33 Z 34 NA 35 NA 36  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30

PERSONNEL EXPOSURES NUMBER TYPE DESCRIPTION (39)  
1 7 0 0 0 37 Z 38 NA 39  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30

PERSONNEL INJURIES NUMBER DESCRIPTION (41)  
1 8 0 0 0 40 NA 41  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30


LOSS OF OR DAMAGE TO FACILITY TYPE DESCRIPTION (43)  
1 9 Z 42 NA 43  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30

PUBLICITY ISSUED DESCRIPTION (45)  
2 0 N 44 NA 45  
7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30

NAME OF PREPARER Lamar McLaughlin PHONE: 465-3550 X 3574

TEZZ 11

8401040420 831227  
PDR ADOCK 05000389  
S PDR

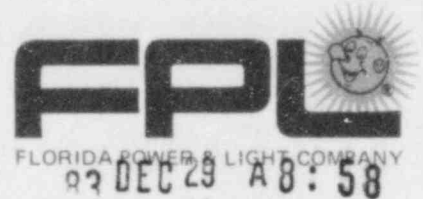

December 27, 1983

PNS-LI-83-755

Mr. James P. O'Reilly  
Regional Administrator, Region II  
U.S. Nuclear Regulatory Commission  
101 Marietta Street, Suite 2900  
Atlanta, Georgia 30303

Dear Mr. O'Reilly:

REPORTABLE OCCURRENCE 389-83-75


ST. LUCIE UNIT 2  
DATE OF OCCURRENCE: NOVEMBER 24, 1983

TECHNICAL SPECIFICATION 3.7.12

FIRE DOORS

The attached Licensee Event Report is being submitted in accordance with Technical Specification 6.9 to provide 30 day notification of the subject occurrence.

Very truly yours,

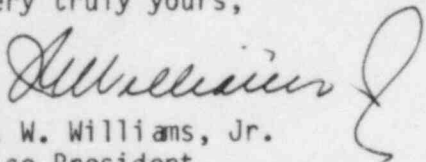  
J. W. Williams, Jr.  
Vice President  
Nuclear Energy

PLP/mvt

Attachment

cc: Director, Office of Inspection and Enforcement (30)  
Harold F. Reis, Esquire  
File 933.1 SL

OFFICIAL COPY

IE 22

PEOPLE... SERVING PEOPLE