



GULF STATES UTILITIES COMPANY

POST OFFICE BOX 2951 • BEAUMONT, TEXAS 77704


AREA CODE 713 838-6631

January 25, 1983

RBG-14,216

File Nos. G9.5, G9.25.1.1

Mr. John T. Collins, Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV, Office of Inspection and Enforcement
611 Ryan Plaza Drive, Suite 1000
Arlington, Texas 76011

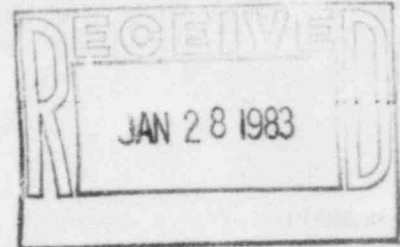

Dear Mr. Collins:

River Bend Station Unit 1
Docket No. 50-458
Final Report/DR-88

On December 22, 1982, Gulf States Utilities Company (GSU) notified the Nuclear Regulatory Commission's Region IV Office of a condition potentially reportable under 10CFR50.55(e) concerning the violation of Specification No. 228.310 documentation requirements. Some ASME Code Class 1, 2, & 3 integral attachment materials were received at the River Bend site with Certificates of Compliance instead of Certified Material Test Reports (CMTR).

The integral attachment materials were examined and found to be in compliance with ASME requirements. Therefore, GSU concludes that had this condition gone undetected it would not have adversely affected the safe operations of the plant and is not reportable under 10CFR50.55(e). This concludes our response on this subject.

Sincerely,

J E Booker

J. E. Booker
Manager-Engineering,
Nuclear Fuels & Licensing
River Bend Nuclear Group

JEB
JEB/PJD/kt

cc: Director of Inspection & Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

R. L. Brown (SRI)

8302030379 830125
PDR ADOCK 05000458
PDR
S

IE 27