

LICENSEE EVENT REPORT

CONTROL BLOCK: 1 2 3 4 5 6

[PLEASE PRINT ALL REQUIRED INFORMATION]

LICENSEE NAME: 01 ILDRS2 LICENSE NUMBER: 00-000000-00 LICENSE TYPE: 41111 EVENT TYPE: 03

CONT: 01 CATEGORY: 57 58 REPORT TYPE: 59 60 REPORT SOURCE: 61 62 DOCKET NUMBER: 050-02377 EVENT DATE: 042376 REPORT DATE: 052176

EVENT DESCRIPTION

02 DURING SURVEILLANCE TESTING, LABORATORY ANALYSIS SHOWED THE "A" SGT TRAIN IODINE REMOVAL EFFICIENCY TO BE $94.46 \pm .03$ PERCENT. THIS PERCENTILE IS BELOW THE PERMISSIBLE LIMIT OF 99.0 PERCENT SPECIFIED IN SECTION 4.7.B.1.b.2 OF THE TECH SPECS. THE REDUNDANT "B" SGT TRAIN WAS AVAILABLE FOR SERVICE. A SIMILAR EVENT OCCURRED ON 6/25/74 (SEE REPORT NO. 50-237/1974-23). CORRECTIVE ACTION WAS (SEE ATTACHED SHEET)

SYSTEM CODE: 07 SC CAUSE CODE: E COMPONENT CODE: FILTER PRIME COMPONENT SUPPLIER: A COMPONENT MANUFACTURER: B075 VIOLATION: Y

CAUSE DESCRIPTION

08 HIGH USAGE OF THE "A" TRAIN APPARENTLY ACCELERATED THE NORMAL DETEIORATION OF THE CHARCOAL BED. A MODIFICATION HAS BEEN ISSUED TO INSTALL ELAPSED-TIME METERS ON BOTH "A" & "B" TRAINS WHICH WILL ALLOW THE EQUALIZATION OF (SEE ATTACHED SHEET)

FACILITY STATUS: I % POWER: 075 OTHER STATUS: UNIT-2 - RITEL UNIT-3 - 100 MIN METHOD OF DISCOVERY: B DISCOVERY DESCRIPTION: NA

FORM OF ACTIVITY RELEASED: Z CONTENT OF RELEASE: Z AMOUNT OF ACTIVITY: NA LOCATION OF RELEASE: NA

PERSONNEL EXPOSURES

NUMBER: 000 TYPE: Z DESCRIPTION: NA

PERSONNEL INJURIES

NUMBER: 000 DESCRIPTION: NA

OFFSITE CONSEQUENCES

15 NA

LOSS OR DAMAGE TO FACILITY

TYPE: Z DESCRIPTION: NA

PUBLICITY

17 NA

ADDITIONAL FACTORS

18 NA

19

NAME: R.W. COEN

PHONE: EXT 443

EVENT DESCRIPTION (Continued)

to replace the filter media in the "A" SBT system train.

CAUSE DESCRIPTION (Continued)

operating time.

In view of current testing standards, the requisite iodine removal efficiency would be only 90% for the conditions used for this test. A pending Tech. Spec. revision will permit acceptance of a 90% removal efficiency.




Commonwealth Edison
Dresden Nuclear Power Station
R.R. #1
Morris, Illinois 60450
Telephone 815/942-2920

BBS Ltr. #396-76

May 20, 1976

Mr. James G. Keppler, Regional Director
Directorate of Regulatory Operations - Region III
U. S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

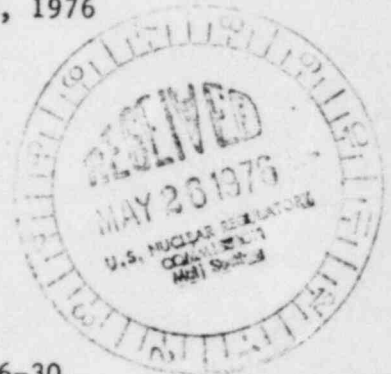

Enclosed please find Reportable Occurrence number 50-237/1976-30.
This report is being submitted to your office in accordance with the
Dresden Nuclear Power Station Technical Specifications, Section 6.6.B.

Arthur M. Roberts
for B. B. Stephenson
Station Superintendent
Dresden Nuclear Power Station

BBS:smp

Enclosure

cc: Director of Inspection & Enforcement
Director of Management Information & Program Control

File/NRC

5287

COPY SENT REGION III