

LICENSEE EVENT REPORT

CONTROL BLOCK:

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE NAME 01 N Y R E G 1	LICENSE NUMBER 0 0 - 0 0 0 0 0 - 0 0	LICENSE TYPE 4 1 1 1 1	EVENT TYPE 0 1
CATEGORY 01 CONT M I	REPORT TYPE T	REPORT SOURCE L	DOCKET NUMBER 0 5 0 - 0 2 4 4
EVENT DATE 0 6 1 7 7 5	REPORT DATE 0 6 3 0 7 5		

EVENT DESCRIPTION

02 During normal power escalation after shutdown RCS gross activity increased to 10.6% of the limit. Frequency of gross activity analysis was not immediately increased to daily until a steady activity level was established. Daily degassed analysis showed steady state except during a subsequent outage. During the following escalation gross analysis showed decrease until a later stage of escalation when daily gross analysis was started.

(Abnormal Occurrence 50-244/75-11)

SYSTEM CODE Z Z	CAUSE CODE A	COMPONENT CODE Z Z Z Z Z Z	PRIME COMPONENT SUPPLIER Z	COMPONENT MANUFACTURER Z 9 9 9	VIOLATION Y
--	---	---	---	---	--

CAUSE DESCRIPTION

08 Not increasing the gross activity analysis frequency was due to observation that steady state had been reached based on degassed activity analysis. Sampling requirements were reviewed with the technicians and added to the sampling schedule and analysis log sheets.

FACILITY STATUS E	% POWER 0 8 0	OTHER STATUS NA	METHOD OF DISCOVERY Z	DISCOVERY DESCRIPTION Supt. review of sample results
FORM OF ACTIVITY RELEASED Z	CONTENT OF RELEASE Z	AMOUNT OF ACTIVITY NA	LOCATION OF RELEASE NA	

PERSONNEL EXPOSURES

NUMBER 0 0 0	TYPE Z	DESCRIPTION NA
---	---	-------------------

PERSONNEL INJURIES

NUMBER 0 0 0	DESCRIPTION NA
---	-------------------

OFFSITE CONSEQUENCES

15 NA

LOSS OR DAMAGE TO FACILITY

TYPE Z	DESCRIPTION NA
---	-------------------

PUBLICITY

17 NA


8304050581 750630
 PDR ADOCK 05000244
 S PDR

ADDITIONAL FACTORS

18 Reactor coolant gross activity has averaged 15-20% of the limit for the past three years due to tramp uranium and is proportional to power level.

NAME: Bernard R. Quinn

PHONE: 716-546-2700, ext. 291-221




ROCHESTER GAS AND ELECTRIC CORPORATION • 89 EAST AVENUE, ROCHESTER, N.Y. 14649

LEON D. WHITE, JR.
VICE PRESIDENT

TELEPHONE
AREA CODE 716 546-2700

June 30, 1975

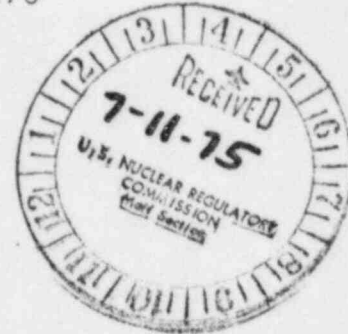

Mr. James P. O'Reilly, Director
U. S. Nuclear Regulatory Commission
Office of Inspection and Enforcement
Region I
631 Park Avenue
King of Prussia, Pennsylvania 19406

Subject: Abnormal Occurrence 75-11, Failure to increase reactor coolant sample test for gross radioactivity concentration to a minimum of once per day when gross radioactivity concentration exceeds 10% of the limit specified in Technical Specification 3.1.4.1a. R. E. Ginna Nuclear Power Plant, Unit No. 1
Docket No. 50-244

Dear Mr. O'Reilly:

In accordance with Technical Specifications, Article 6.6.2a, the attached report of Abnormal Occurrence 75-11 is hereby submitted. Two additional copies of this letter and the attachment are enclosed.

Very truly yours,

L. D. White, Jr.
L. D. White, Jr.

Attachment

cc: Mr. Donald F. Knuth (40)

*50-244
inquiry*

COPY SENT REGION

7412