

LICENSEE EVENT REPORT

CONTROL BLOCK:

--	--	--	--	--	--

1 6

[PLEASE PRINT ALL REQUIRED INFORMATION]

LICENSEE NAME										LICENSE NUMBER										LICENSE TYPE					EVENT TYPE		
01	N	Y	N	M	P	1					-					-				4	1	1	1	1		0	3
7	8	9				14	15									25			26				30			31	32

CATEGORY		REPORT TYPE	REPORT SOURCE	DOCKET NUMBER							EVENT DATE					REPORT DATE											
01	CON'T	-	-	L	L	0	5	0	-	0	2	2	0	0	3	0	4	7	7	0	4	0	1	7	7		
7	8	57	58	59	60	61						68	69				74						75				80

[illegible]

02	During routine surveillance testing, found reactor low-low-low- instrument level	80
03	set point at 119". Required was 125" +2.0"-2.6". Reset to 125.5". Setting was in	80
04	conservative direction. Redundant sensors were operable and safety function would	80
05	have actuated if required.	80
06	LER 77-03	80
	PRIME	80

7 8 9 10 11 12 13 14 15 16 17 43 44 45 46 47 48

SYSTEM CODE CAUSE CODE COMPONENT CODE PRIME COMPONENT SUPPLIER COMPONENT MANUFACTURER VIOLATION

07 I A E I N S T R U N G O 8 0 N

CAUSE DESCRIPTION

08	Instrument set point change.	
7 8 9		80
09		
7 8 9		80
10		
7 8 9		80

FACILITY STATUS		% POWER		OTHER STATUS		METHOD OF DISCOVERY		DISCOVERY DESCRIPTION	
11	E	0	9	8	NA	B	See event description		
7	8	9	10	12	13	44	45	46	80

FORM OF ACTIVITY RELEASED		CONTENT OF RELEASE		AMOUNT OF ACTIVITY		LOCATION OF RELEASE	
12	Z	Z	NA	NA			
7	8	9	10	11	44	45	80

PERSONNEL EXPOSURES

NUMBER				TYPE	DESCRIPTION
1	3	0	0	0	NA

PERSONNEL INJURIES

NUMBER				DESCRIPTION	
1	4	0	0	0	NA

~~XXXXXX~~ CONSEQUENCES PROBABLE

15 | NONE

LOSS OR DAMAGE TO FACILITY

TYPE			DESCRIPTION
1	5	2	NA
7	8	9	10

770401

8304080375
PDR ADOCK 05000220
S PDR

PUBLICITY

17 NA

7 8 9

ADDITIONAL FACTORS

13 | NA

7 8 9


NIAGARA MOHAWK POWER CORPORATION

NIAGARA MOHAWK

300 ERIE BOULEVARD, WEST
SYRACUSE, N. Y. 13202

FILE COPY

April 1, 1977

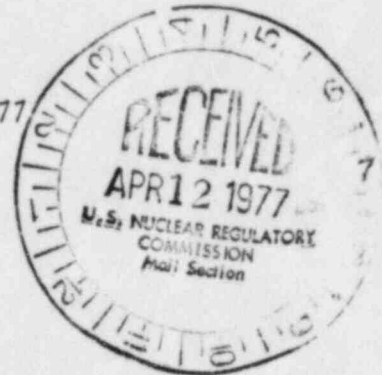

Mr. James P. O'Reilly
Director
United States Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, PA. 19406

RE: Docket No. 50-220

Dear Mr. O'Reilly:

In accordance with Nine Mile Point Nuclear Station Unit #1 Technical Specification, we hereby submit Licensee Event Report LER 77-03.

This report was completed in the format designated in the Licensee Event Report Instruction Booklet 00E-SS-001, dated October 1974, revised December 8, 1975.

Very truly yours,

R.R. Schneider

R.R. Schneider
Vice President -
Electric Production

MAS/mtm

Enc.

771050225