

LICENSEE EVENT REPORT

CONTROL BLOCK:

--	--	--	--	--	--

1 6

(PLEASE PRINT ALL REQUIRED INFORMATION)

LICENSEE NAME						LICENSE NUMBER						LICENSE TYPE					EVENT TYPE							
0	1	N	Y	N	M	P	1			-					-		4	1	1	1	1	0	3	
7	8	9					14	15								25	26					30	31	32

01		CONT		CATEGORY		REPORT TYPE		REPORT SOURCE		DOCKET NUMBER				EVENT DATE				REPORT DATE							
7	8	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80
		-	-	L	L	0	5	0	-	0	2	2	0	1	0	1	5	7	6	1	1	0	5	7	6

EVENT DESCRIPTION

During routine surveillance testing, one Lo-Lo-Lo Reactor Water Level Switch (RE-18A)

03 failed to provide a trip at the required 124, +2, -2.6 indicated inches. It was 80

04 found to trip at 118" and was reset at 126 inches. All redundant components

05 were operable. 80

7 8 9

0 5 | LER 76-36 . BO

7 8 9

SYSTEM CODE CAUSE CODE COMPONENT CODE PRIME COMPONENT SUPPLIER COMPONENT MANUFACTURER VIOLATION

07 I B E I N S T R U N B O S O -

7 8 9 10 11 12 17 43 44 47 48

CAUSE DESCRIPTION

09 | Apparent set point drift. The device was inspected and recalibrated

09 80

7	8	9
10		
7	8	9

11		E		095			OTHER STATUS		b		DISCOVERY DESCRIPTION		80
7	8	9	10	11	12	13	14	15	16	17	18	19	20

FORM OF ACTIVITY RELEASED		CONTENT OF RELEASE	AMOUNT OF ACTIVITY	LOCATION OF RELEASE
1	2	Z	N/A	N/A
7	8	9	10	11
				44
				45

PERSONNEL EXPOSURES

NUMBER			TYPE	DESCRIPTION
13	0	0	0	Z
7	8	9	11	12
13				

PERSONNEL INJURIES

NUMBER			DESCRIPTION
14	0	0	N/A

XXXXXX CONSEQUENCES PROBABLE

13 | None - had the signal been required, redundant sensors would provide the desired action!

LOSS OR DAMAGE TO FACILITY

TYPE		DESCRIPTION
13	2	N/A

7 8 9 10

0000000000 7/11/05

PUBLICITY
None
S PDR

ADDITIONAL FACTORS

7 u 9 1 4 | None

100

NIAGARA MOHAWK POWER CORPORATION

NIAGARA  MOHAWK

300 ERIE BOULEVARD, WEST
SYRACUSE, N. Y. 13202

November 5, 1976

Mr. James P. O'Reilly
Directorate of Regulatory Operations
United States Nuclear Regulatory Commission
Region I
631 Park Avenue
King of Prussia, PA. 19406

RE: Docket No. 50-220

Dear Mr. O'Reilly:

In accordance with Nine Mile Point Nuclear Station Unit #1
Technical Specifications 6.9, we hereby submit Licensee Event
Report 76-36.

This report was completed within the intent of the Licensee
Event Report Instruction Booklet 00E-SS-001, dated October 1974,
revised December 24, 1974.


Very truly yours,

ORIGINAL SIGNED BY R.R. SCHNEIDER

R.R. Schneider
Vice President -
Electric Production

TJD/mtm

Enc.

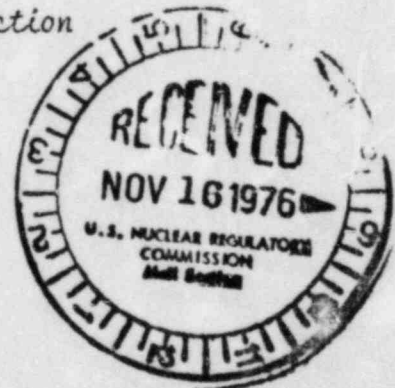

11663