



Commonwealth Edison
Quad-City Generating Station
Post Office Box 216
Cordova, Illinois 61242
Telephone 309/654-2241

50-234
50-265



NJK-74-25

April 4, 1974

Mr. J. G. Keppler, Regional Director
Directorate of Regulatory Operations
Region III
U. S. Atomic Energy Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

Dear Mr. Keppler:

In discussions with regulatory operations personnel on April 4, 1974, the following agreement was made:

Any isolation valves or testable penetrations failing to meet the acceptance criteria of Technical Specification 4.7.A.2.i will be reported as an abnormal occurrence according to Technical Specification 1.0.A.5. Immediate notification of these abnormal occurrences will be according to Technical Specification 6.6.B.1.a. The immediate written notification will be identified as also fulfilling the 10 day reporting requirement. A follow-up report for these occurrences will be submitted 10 days after the completion of repairs necessary to resolve all deficient items. This composite report will contain the details of all abnormal occurrences reported under the provisions of this agreement. In effect, we will submit one abnormal occurrence report upon the conclusion of our leak rate testing which will contain the resolution of all deficiencies found.

The information provided in this composite report will be as outlined in Technical Specification 6.6.B.1.a.

8305200622 740521
PDR ADDCK 05000254
S PDR

Handwritten: 50-254/265

3065

COPY SENT REGION

Mr. J. G. Keppler


-2-

April 4, 1974

In accordance with this agreement, details of the abnormal occurrence reported to you on April 1, 1974 related to Main Steam Isolation Valve leakage will be reported in a summary report at a later date.

Very truly yours,

COMMONWEALTH EDISON COMPANY
QUAD-CITIES NUCLEAR POWER STATION

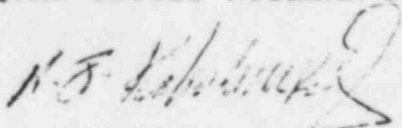

N. J. Kalivianakis
Station Superintendent

NJK/lk

cc: Directorate of Licensing
J. S. Abel