

Georgia Power Company
333 Piedmont Avenue
Atlanta, Georgia 30308
Telephone 404 526-6526

Mailing Address:
Post Office Box 4545
Atlanta, Georgia 30302

L. T. Gucwa
Manager Nuclear Engineering
and Chief Nuclear Engineer



May 7, 1984

Director of Nuclear Reactor Regulation
Attention: Mr. John F. Stolz, Chief
Operating Reactors Branch No. 4
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

NRC DOCKETS 50-321, 50-366
OPERATING LICENSES DPR-57, NPF-5
EDWIN I. HATCH NUCLEAR PLANT UNITS 1, 2
NUREG-0737 ITEM II.E.4.2(7), PURGE AND VENT VALVE ISOLATION

Gentlemen:

Our submittal dated April 10, 1984 provided a description of the modifications planned to satisfy the subject requirement. Figures 1 and 2 of that submittal were inadvertently omitted and are hereby transmitted for your use.

We regret any inconvenience caused by this delay. Please contact us if you require further information.

Very truly yours,

L. T. Gucwa

L. T. Gucwa

JH/mb

Enclosure

xc (w/encl): J. T. Beckham, Jr.
H. C. Nix, Jr.
J. P. O'Reilly (NRC-Region II)
Senior Resident Inspector

8405140437 840507
PDR ADOCK 05000321
P PDR

4046
1/1

GEORGIA POWER COMPANY ATLANTA, GEORGIA
GENERAL ENGINEERING DEPARTMENT

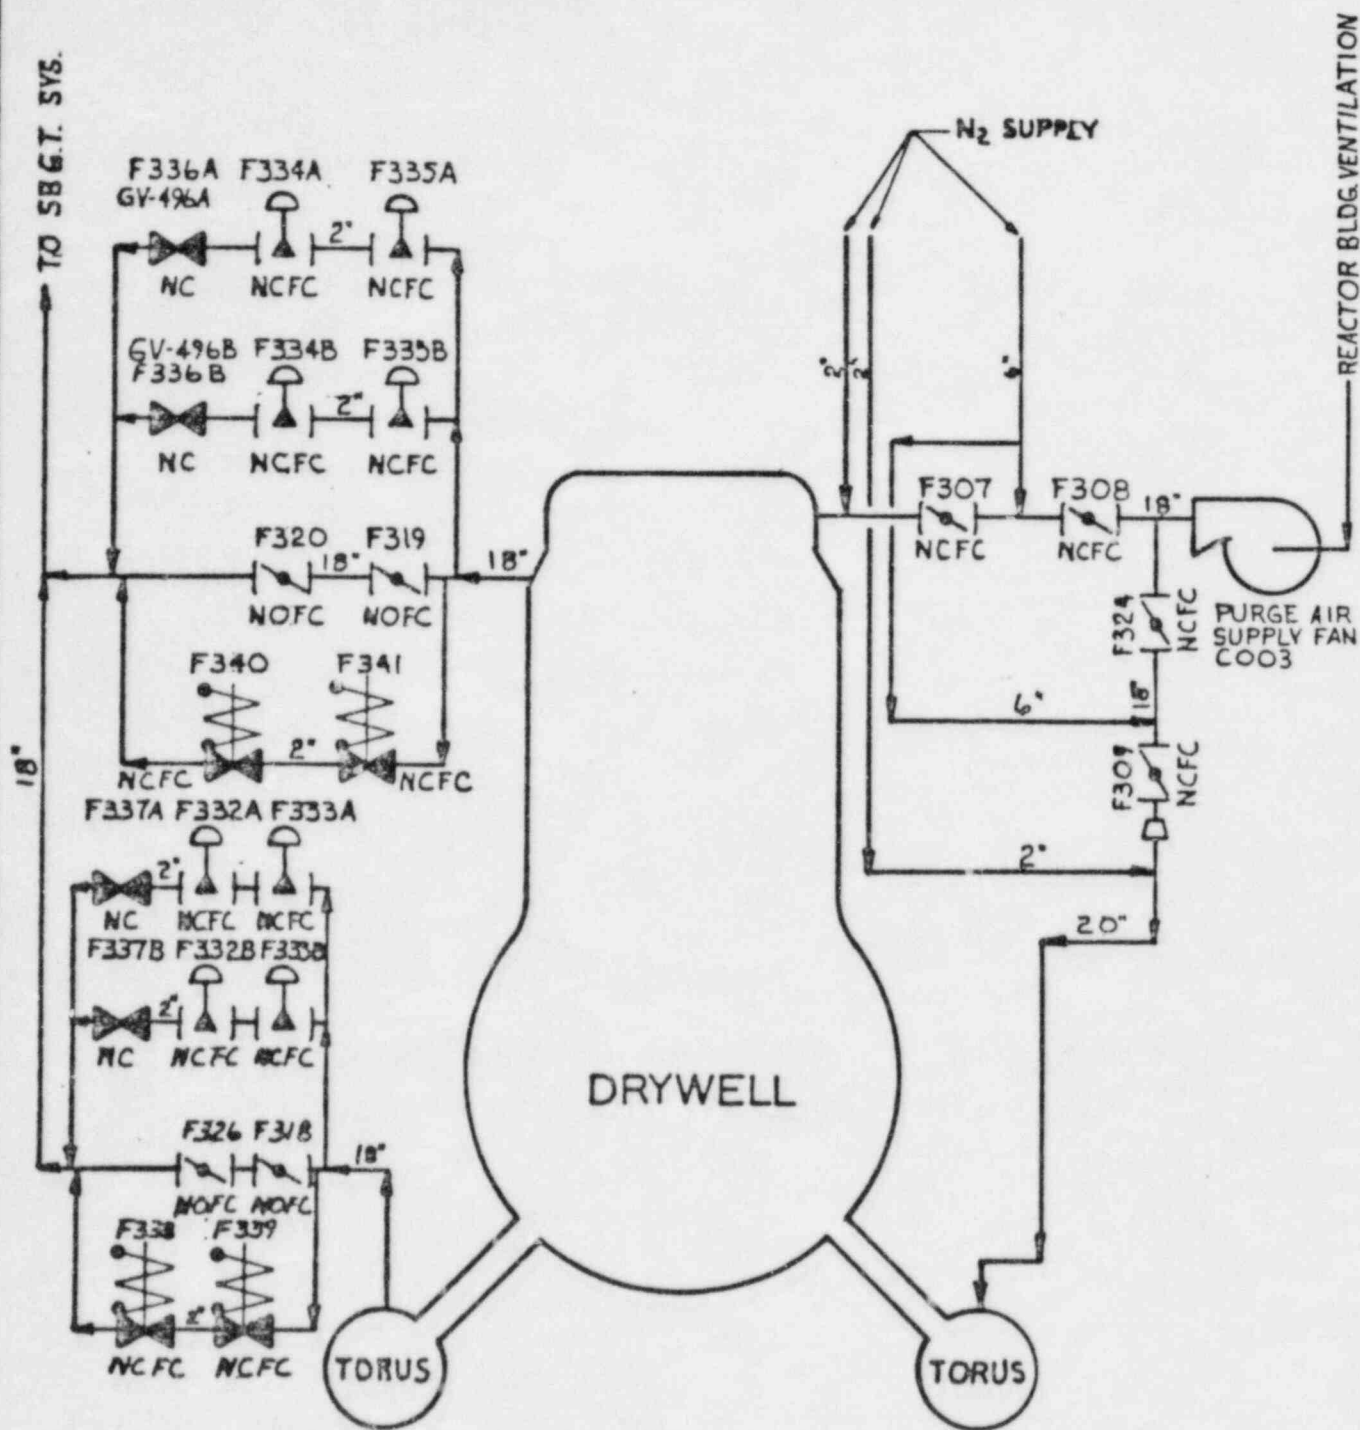


FIGURE 1

UNIT 1

GEORGIA POWER COMPANY ATLANTA, GEORGIA

GENERAL ENGINEERING DEPARTMENT

NOTE: ALL VALVES SHOWN ARE NCFC.

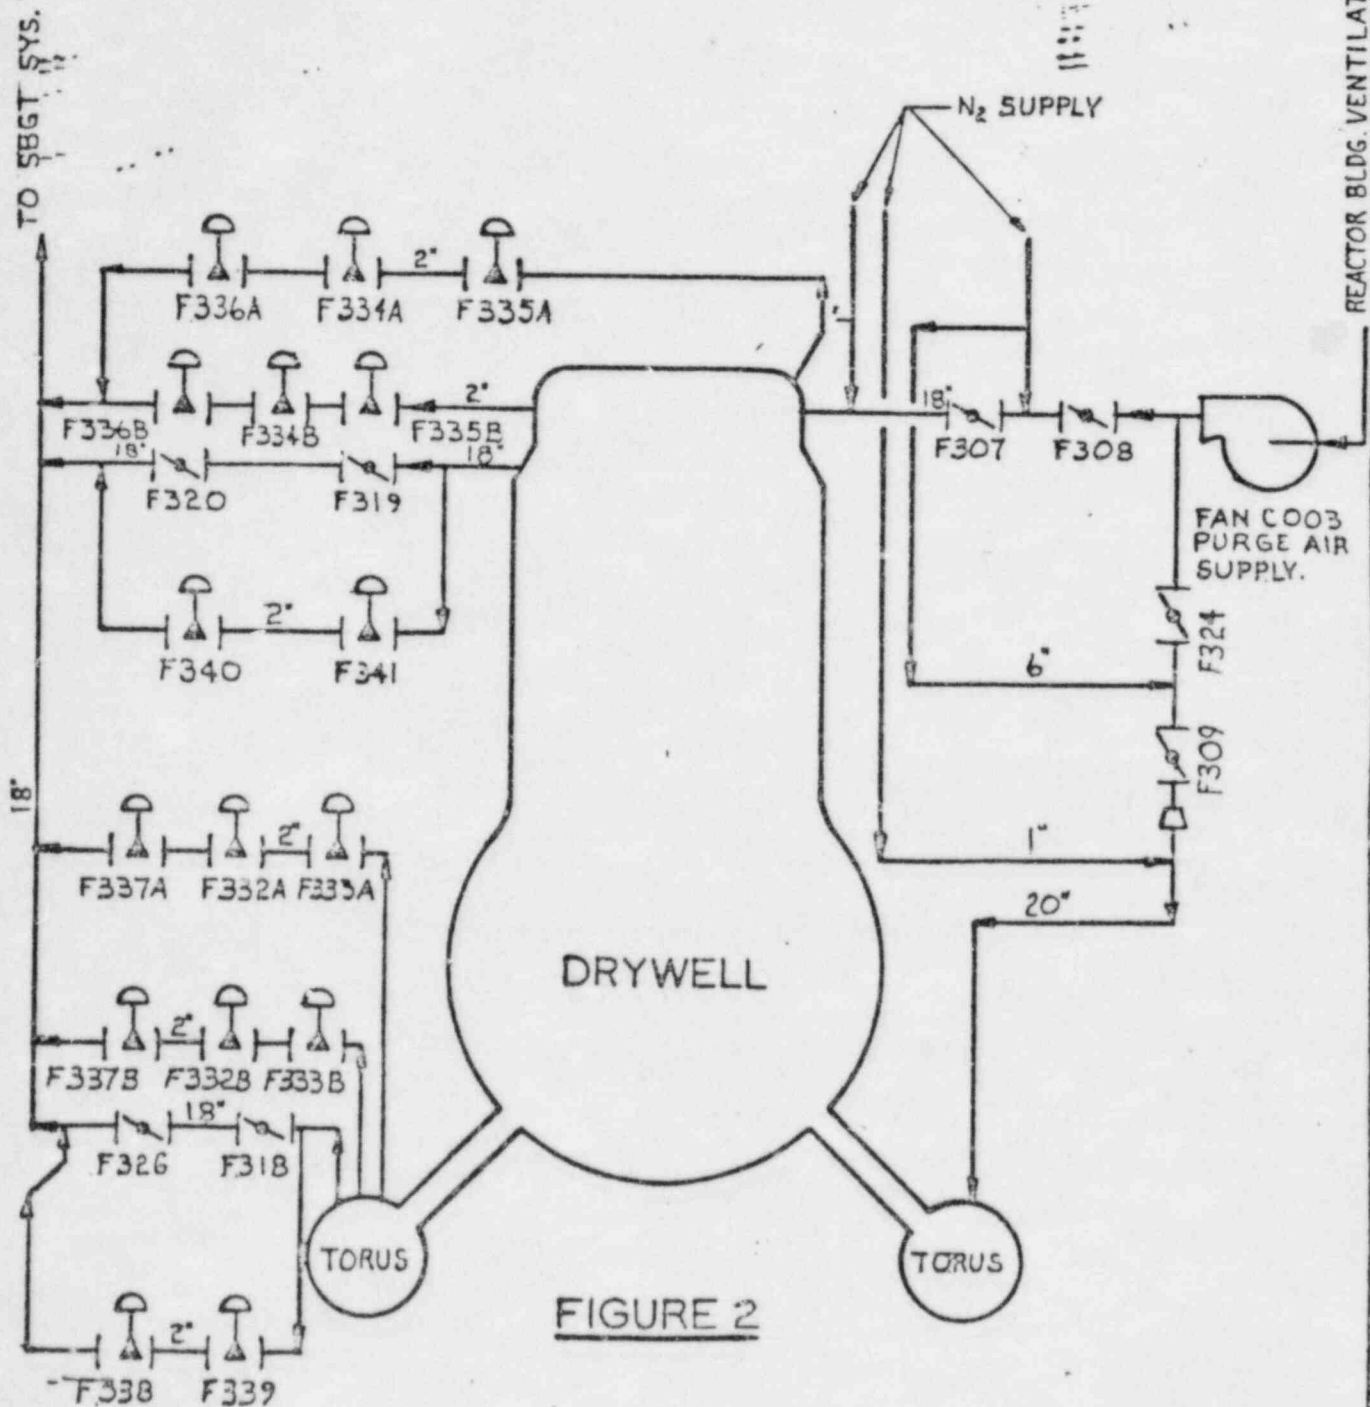


FIGURE 2