



Commonwealth Edison
Quad-Cities Generating Station
Post Office Box 216
Cordova, Illinois 61242
Telephone 309/654-2241

NJK-75-396

Telecopy: Region III, Attention: Mr. C. Feierabend

August 5, 1975

J. Keppler, Regional Director
Directorate of Regulatory Operations
Region III
U.S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

Reference: Quad-Cities Nuclear Power Station, Unit 1
Docket No. 50-254, DPR-29
Appendix A, Sections 1.0.A.4, 3.1.a., 6.6.B.1.a

Dear Mr. Keppler:

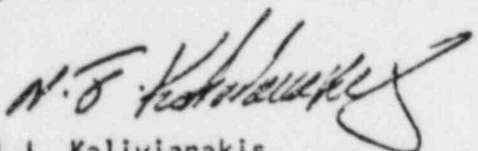
The purpose of this letter is to provide you with notification of an Abnormal Occurrence as required by Technical Specification 6.6.B.1.a within 24 hours of the occurrence.

At 1430 hrs on August 5, 1975, while performing monthly surveillance calibration of the Reactor High Pressure scram switches, it was discovered that PS-1-263-55A was still valved out from the last month's surveillance. The switch was calibrated and valved in service. The other three switches were tested and found to have trip points within limits.

This occurrence was discussed by telephone with Mr. Knop of your office on August 5, 1975. Further information will be provided by Abnormal Occurrence Report AO 50-254/75-19 which will be submitted within 10 days of the date of this occurrence.

Very truly yours,

COMMONWEALTH EDISON COMPANY
QUAD-CITIES NUCLEAR POWER STATION


N.J. Kalivianakis
Station Superintendent

NJK/RAR/vmb

cc Directorate of Licensing

B306160349 750805
PDR ADDCK 05000254
S PDR

AUG 5 1975