



Commonwealth Edison
Quad-Cities Generating Station
Post Office Box 216
Cordova, Illinois 61242
Telephone 309/654-2241

NJK-75-512

TELECOPY: Region III, Attention: Mr. C. Feierabend

October 17, 1975



J. Keppler, Regional Director
Office of Inspection and Enforcement
Region III
U. S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, IL 60137

REFERENCE: Quad-Cities Nuclear Power Station, Unit 2
Docket No. 50-265, DPR-30
Appendix A, Sections 1.0.A.2, 3.6.1.1, 6.6.B.1.a.

Dear Mr. Keppler:

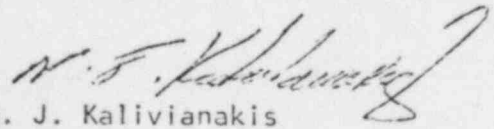
The purpose of this letter is to provide you with notification of an Abnormal Occurrence as required by Technical Specification 6.6.B.1.a. within 24 hours of the occurrence.

On October 16, 1975, during an inspection of hydraulic snubbers, being conducted in accordance with Technical Specification 4.6.1.3., two Grinnell snubbers, one on the reactor clean-up system and one on a main steam drain line and one Bergen-Patterson snubber on recirculation system were found defective. A work request was issued for their repair.

This occurrence was discussed by telephone with Mr. Knop of your office on October 16, 1975. Further information will be provided by Abnormal Occurrence Report AO 50-265/75-39 which will be submitted within 10 days of the date of this occurrence.

Very truly yours,

COMMONWEALTH EDISON COMPANY
QUAD-CITIES NUCLEAR POWER STATION


N. J. Kalivianakis
Station Superintendent

NJK:HGL/dkp

cc: Office of Nuclear Reactor Regulation
G. A. Abrell

8306170164 751024
PDR ADOCK 05000265
S PDR

