



Commonwealth Edison
Quad-Cities Generating Station
Post Office Box 216
Cordova, Illinois 61242
Telephone 309/854-2241

NJK-75-267

TELECOPY: Region III, Attention: Mr. C. Feierabend

May 8, 1975

J. Keppler, Regional Director
Directorate of Regulatory Operations - Region III
U. S. NUCLEAR REGULATORY COMMISSION
799 Roosevelt Road
Glen Ellyn, IL 60137

REFERENCE: Quad-Cities Nuclear Power Station, Unit 1
Docket No. 50-254, DPR-29
Appendix A, Sections 1.0.A.2, 3.5.E.1, 6.6.B.1.a.

Dear Mr. Keppler:

The purpose of this letter is to provide you with notification of an Abnormal Occurrence as required by Technical Specification 6.6.B.1.a within 24 hours of the occurrence.

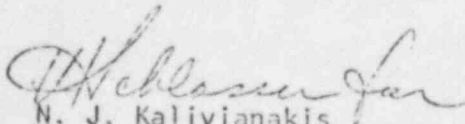
On May 5, 1975, with Unit 1 operating at 393 MWe, while performing the RCIC Monthly Operability Surveillance Test, it was discovered that the RCIC condensate pump motor drew excessive amperage. At 5:37 p.m., the RCIC condensate pump was taken out of service for inspection. This inspection revealed that the pump motor was defective.

Safety implications are minimal since the HPCI Monthly Operability Surveillance Test had been run successfully earlier in the day. Subsequently, the HPCI system was found to be inoperable and a reactor shutdown was initiated.

This occurrence was discussed by telephone with Mr. C. Feierabend of your office on May 8, 1975. Further information will be provided by Abnormal Occurrence Report AO 50-254/75-12 which will be submitted within 10 days of the date of this occurrence.

Very truly yours,

COMMONWEALTH EDISON COMPANY
QUAD-CITIES NUCLEAR POWER STATION


N. J. Kalivianakis
Station Superintendent

NJK:PC/dkp

cc: Directorate of Licensing
J. S. Abel

8306170175 750515
PDR ADDCK 05000254
S PDR

5256