



Commonwealth Edison  
Quad-Cities Generating Station  
Post Office Box 216  
Cordova, Illinois 61242  
Telephone 309/654-2241

NJK-75-

Telecopy: Region III, Attention: Mr. C. Feierabend

January 3, 1975

J. Keppler, Regional Director  
Directorate of Regulatory Operations  
Region III  
U. S. Atomic Energy Commission  
799 Roosevelt Road  
Glen Ellyn, Illinois 60137



Reference: Quad-Cities Nuclear Power Station, Unit 2  
Docket No. 50-265, DPR-30  
Appendix A, Sections 1.0.A.2, 4.7.A.3.b, 6.6.B.1.A

Dear Mr. Keppler:

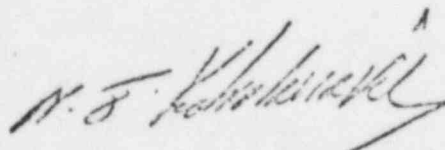
The purpose of this letter is to provide you with notification of an Abnormal Occurrence as required by Technical Specification 6.6.B.1.a within 24 hours of the occurrence.

With Unit 2 in the cold shutdown condition for the current re-fueling outage, the reactor building to torus vacuum breakers 2-1601-31A and 2-1601-31B failed to open with less than 50 ft. lbs. of force.

This occurrence was discussed by telephone with Mr. Feierabend of your office on January 3, 1975. Further information will be provided by Abnormal Occurrence Report AO 50-265/75-2 which will be submitted within 10 days of the date of this occurrence.

Very truly yours,

COMMONWEALTH EDISON COMPANY  
QUAD-CITIES NUCLEAR POWER STATION

  
N. J. Kalivianakis  
Station Superintendent

NJK/PC/vm

cc: Directorate of Licensing  
J. S. Abel

8306290208 750207  
PDR ADDCK 05000265  
S PDR