



Commonwealth Edison  
Quad-Cities Generating Station  
Post Office Box 216  
Cordova, Illinois 61242  
Telephone 309/654-2241



NJK-74-371

Telecopy: Region III, Attention: Mr. C. Feierabend

November 6, 1974

J. Keppler, Regional Director  
Directorate of Regulatory Operations  
Region III  
U. S. Atomic Energy Commission  
799 Roosevelt Road  
Glen Ellyn, Ill. 60137

Reference: Quad-Cities Nuclear Power Station, Unit 1  
Docket No. 50-254, DPR-29  
Appendix A, Sections 1.0.A.2, 3.2.A, Table 3.2.1,  
6.6.B.1.a

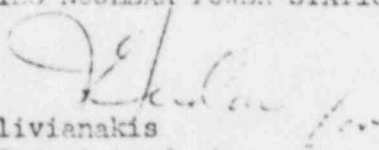
Dear Mr. Keppler:

The purpose of this letter is to provide you with notification of an Abnormal Occurrence as required by Technical Specification 6.6.B.1.a within 24 hours of the occurrence. While doing routine surveillance calibration of the main steam line high flow switches, two of them, FS-1-261-2A&K, were found to trip at 111 and 112 psid respectively. The tech spec LCO is  $\leq 109$  psid ( $\leq 120\%$  of rated flow). The "A" switch is on the "A" steam line and the "K" switch is on the "C" line. The Primary Containment Isolation trip system would have performed its intended function if it were needed.

This occurrence was discussed by telephone with Mr. C. Feierabend of your office on November 6, 1974. Further information will be provided by Abnormal Occurrence Report AO 50-254/74-36 which will be submitted within 10 days of the date of this occurrence.

Very truly yours,

COMMONWEALTH EDISON COMPANY  
QUAD-CITIES NUCLEAR POWER STATION

  
N. J. Kalivianakis  
Station Superintendent

NJK/ZAR/rhb

cc: Directorate of Licensing  
J. S. Abel

11517

8307130199 741115  
PDR ADOCK 05000254  
S PDR

COPY SENT REGION 



Commonwealth Edison  
Quad-Cities Generating Station  
Post Office Box 216  
Condoia, Illinois 61242  
Telephone 309/854-2241

NJK-74-387

Teletype: Region III, Attention: Mr. C. Peierabend

November 6, 1974

J. Keppler, Regional Director  
Directorate of Regulatory Operations  
Region III  
U. S. Atomic Energy Commission  
799 Roosevelt Road  
Glen Ellyn, Ill. 60137

Reference: Quad-Cities Nuclear Power Station, Unit 1  
Docket No. 50-254, DPR-29  
Appendix A, Sections 1.0.A.2, 3.2.A, Table 3.2.1,  
6.6.B.1.a

Dear Mr. Keppler:

The purpose of this letter is to provide you with notification of an Abnormal Occurrence as required by Technical Specification 6.6.B.1.a within 24 hours of the occurrence. While doing routine surveillance calibration of the main steam line high flow switches, two of them, PS-1-261-2AAK, were found to trip at 111 and 112 psid respectively. The tech spec LCO is  $\leq 109$  psid ( $\leq 120\%$  of rated flow). The "A" switch is on the "A" steam line and the "K" switch is on the "C" line. The Primary Containment Isolation trip system would have performed its intended function if it were needed.

This occurrence was discussed by telephone with Mr. C. Peierabend of your office on November 6, 1974. Further information will be provided by Abnormal Occurrence Report AO 50-254/74-36 which will be submitted within 10 days of the date of this occurrence.

Very truly yours,

COMMONWEALTH EDISON COMPANY  
QUAD-CITIES NUCLEAR POWER STATION

N. J. Kalivis  
Station Supervisor

NJK/ZAR/rno

cc: Directorate of Licensing  
J. S. Abel

*Dupe*  
*8307120199*  
*50-254 incident*

*11-6-74*  
*346*