

PBAPS

LIMITING CONDITIONS FOR OPERATIONSURVEILLANCE REQUIREMENTS3.14.D Fire Barrier Penetrations4.14.D Fire Barrier Penetrations

1. Fire barrier penetrations including cable penetration barriers, fire doors and fire dampers, protecting the following areas shall be functional*:
 - 1) Cable Spreading Room
 - 2) Emergency Switchgear Rooms
 - 3) Diesel Generator Rooms
 - 4) Battery Rooms
 - 5) Control Room
2. All fire barrier penetrations including cable penetration barriers, fire doors and fire dampers separating portions of safety related systems, required to ensure safe shutdown capability shall be functional.**
3. If the requirements of 3.14.D.1 or 3.14.D.2 cannot be met, within one hour establish a continuous fire watch on at least one side of the affected fire barrier, or verify the operability of fire detectors on at least one side of the inoperable fire barrier and establish an hourly fire watch patrol. Reactor startup and continued reactor operation is permissible.

* Delete when the provisions of 3.14.D.2 become effective.

** Effective upon return to power following the Unit 2 refueling outage commencing in 1984.

8403210063 840316
PDR ADDCK 05000277
P PDR

PBAPS

LIMITING CONDITIONS FOR OPERATIONSURVEILLANCE REQUIREMENTS3.14.D Fire Barrier Penetrations4.14.D Fire Barrier Penetrations

1. Fire barrier penetrations including cable penetration barriers, fire doors and fire dampers, protecting the following areas shall be functional*:

- 1) Cable Spreading Room
- 2) Emergency Switchgear Rooms
- 3) Diesel Generator Rooms
- 4) Battery Rooms
- 5) Control Room

2. All fire barrier penetrations including cable penetration barriers, fire doors and fire dampers separating portions of safety related systems, required to ensure safe shutdown capability shall be functional.**

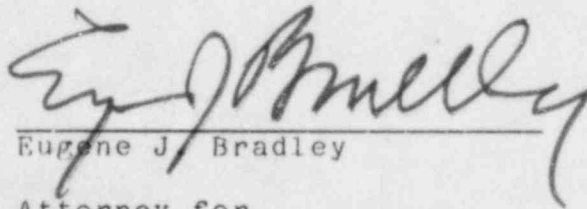
3. If the requirements of 3.14.D.1 or 3.14.D.2 cannot be met, within one hour establish a continuous fire watch on at least one side of the affected fire barrier, or verify the operability of fire detectors on at least one side of the inoperable fire barrier and establish an hourly fire watch patrol. Reactor startup and continued reactor operation is permissible.

* Delete when the provisions of 3.14.D.2 become effective.

** Effective on Unit 3 upon completion of licensee's fire barrier upgrade program, or September 15, 1984, whichever comes first.

CERTIFICATE OF SERVICE

I certify that service of the foregoing Application was made upon the Commonwealth of Pennsylvania, by mailing a copy thereof, via first-class mail, to Thomas R. Gerusky, Director, Bureau of Radiological Protection, P. O. Box 2062, Harrisburg, PA 17120; all this 16th day of March, 1984.

A handwritten signature in dark ink, appearing to read "Eugene J. Bradley", is written over a horizontal line.

Eugene J. Bradley

Attorney for
Philadelphia Electric Company