

RADIOLOGICAL EMERGENCY PLAN

Revision Date: IP-5 PORC 3/6/84 (Issued MAR 16 1984)

This log sheet must be retained as the last page of the Sequoyah Implementing Procedures Document.

Reason for revision: Commitment to NRC in response to IE Notice 83-28.

Inserted by: _____

Date Inserted: _____

<u>Pages to be Removed</u>			<u>New Pages to be Inserted</u>		
<u>Part</u>	<u>Page Number</u>	<u>Revision</u>	<u>Part</u>	<u>Page Number</u>	<u>Revision</u>
Table of Contents	1 of 1	1/31/84	Table of Contents	1 of 1	3/6/84
IP-5	Cover Sheet	7	IP-5	Cover Sheet	8
	2 of 3	7		2 of 3	8
			Attachment	1 of 1	8

8403260277 840316
PDR ADOCK 05000327
F PDR

IMPLEMENTING PROCEDURES INDEX

<u>Instr.</u>	<u>Revision</u>	<u>Title</u>
SQN-IP-1	5	Emergency Plan Classification Logic
SQN-IP-2	5	Notification of Unusual Event
SQN-IP-3	7	Alert
SQN-IP-4	7	Site Emergency
* SQN-IP-5	8	Emergency - General Emergency
SQN-IP-6	8	Activation of the Technical Support Center
SQN-IP-7	1	Activation of the Operations Support Center
SQN-IP-8	8	Personnel Accountability and Evacuation
SQN-IP-9	0	Accountability and Evacuation of the Power Operation Training Center
SQN-IP-10	6	Medical Emergency Procedure
SQN-IP-11	5	Security and Access Control
SQN-IP-13	5	Call Lists
SQN-IP-14	8	Health Physics Procedure
SQN-IP-15	2	Emergency Exposure Guidelines
SQN-IP-16	0	Recovery Procedure
SQN-IP-17	7	Emergency Equipment and Supplies
SQN-IP-18	4	Plant Release Rate Calculations (Cancelled)
SQN-IP-19	1	Radiological Emergency Plan Training
SQN-IP-20	1	Environmental Monitoring During A Radiological Emergency

Revised 03/06/84

Sequoyah Nuclear Plant

DISTRIBUTION

SQN REP - IMPLEMENTING
PROCEDURES DOCUMENT

SQN, IP-5

GENERAL EMERGENCY

Prepared By: J.R. Walker

Revised By: D. E. Crawley

Submitted By: *D. E. Crawley*
Supervisor

PORC Review: 3/6/84
Date

Approved By: *L. M. Nobles*
Pwr Plt Superintendent

Date Approved: 3/6/84

1C	81 Plant Master File
1C	83 Asst. Power Plant Supt. (Oper.)
1C	84 Asst. Power Plant Supt. (Maint.)
1C	86 Maintenance Supervisor (M)
1C	87 Maintenance Supervisor (E)
1C	88 Maintenance Supervisor (I)
1C	89 Results Supervisor
1C	90 Operations Supervisor
1C	92 Health Physics Director
1C	93 Public Safety Services Supv.
1C	95 Outage Director
1C	96 Emergency Cabinet Control Room
1C	97 Emergency Cabinet Communications Room
1C	98 Emergency Van
1C	102 Shift Engineer's Office
1C	103 Unit Control Room
1C	105 Health Physics Laboratory
1C	106 Medical Office
1C	107 Resident NRC Inspector - SNP
1C	108 Technical Support Center
1C	109 Assistant HP Supervisor
1C	EP&P - Eric Sliger, 1470 CST2-C
1C	Records Manual Control Unit, 1570 CST2-C
1C	Technical Support

<u>Rev. No.</u>	<u>Date</u>	<u>Revised Pages</u>	<u>Rev. No.</u>	<u>Date</u>	<u>Revised Pages</u>
<u>0</u>	<u>8/5/80</u>	<u>All</u>	<u>4</u>	<u>10/26/82</u>	<u>2</u>
<u>1</u>	<u>10/21/80</u>	<u>2</u>	<u>5</u>	<u>12/29/82</u>	<u>All</u>
<u>2</u>	<u>12/2/81</u>	<u>1</u>	<u>6</u>	<u>2/9/83</u>	<u>1</u>
<u>3</u>	<u>3/11/82</u>	<u>1</u>	<u>7</u>	<u>03/10/83</u>	<u>All</u>
			<u>8</u>	<u>MAR 6 1984</u>	<u>2, Added 4</u>

The last page of this instruction is Number 4.

g. Emergency Situation: _____ (1) Does not involve a radiation
release from the plant.
_____ (2) Involves a radiation
release from the plant.
_____ (3) Radiation release information
is not known.

h. Radiation Release Is: _____ (1) Ground Level - Airborne
_____ (2) Elevated - Airborne
_____ (3) Water Borne
_____ (4) Other

i. Wind Direction Is From: _____ °(degrees)

j. Wind Speed _____ (miles/hr)

k. Recommend Protective Action:

(Determine recommended protective action from Attachment 1.)

_____ Recommendation 1

_____ Recommendation 2

_____ Recommendation 3

_____ Recommendation 4


(Initials)

_____ 3. Notify the health physics laboratory.

_____ 4. Notify Plant Duty Supervisor and provide the same information
given to Operations Duty Specialist (see duty list for telephone
number).

_____ 5. During off shifts the Shift Engineer Clerk will contact one individual
in each section of the call list in IP-6.

PLANT

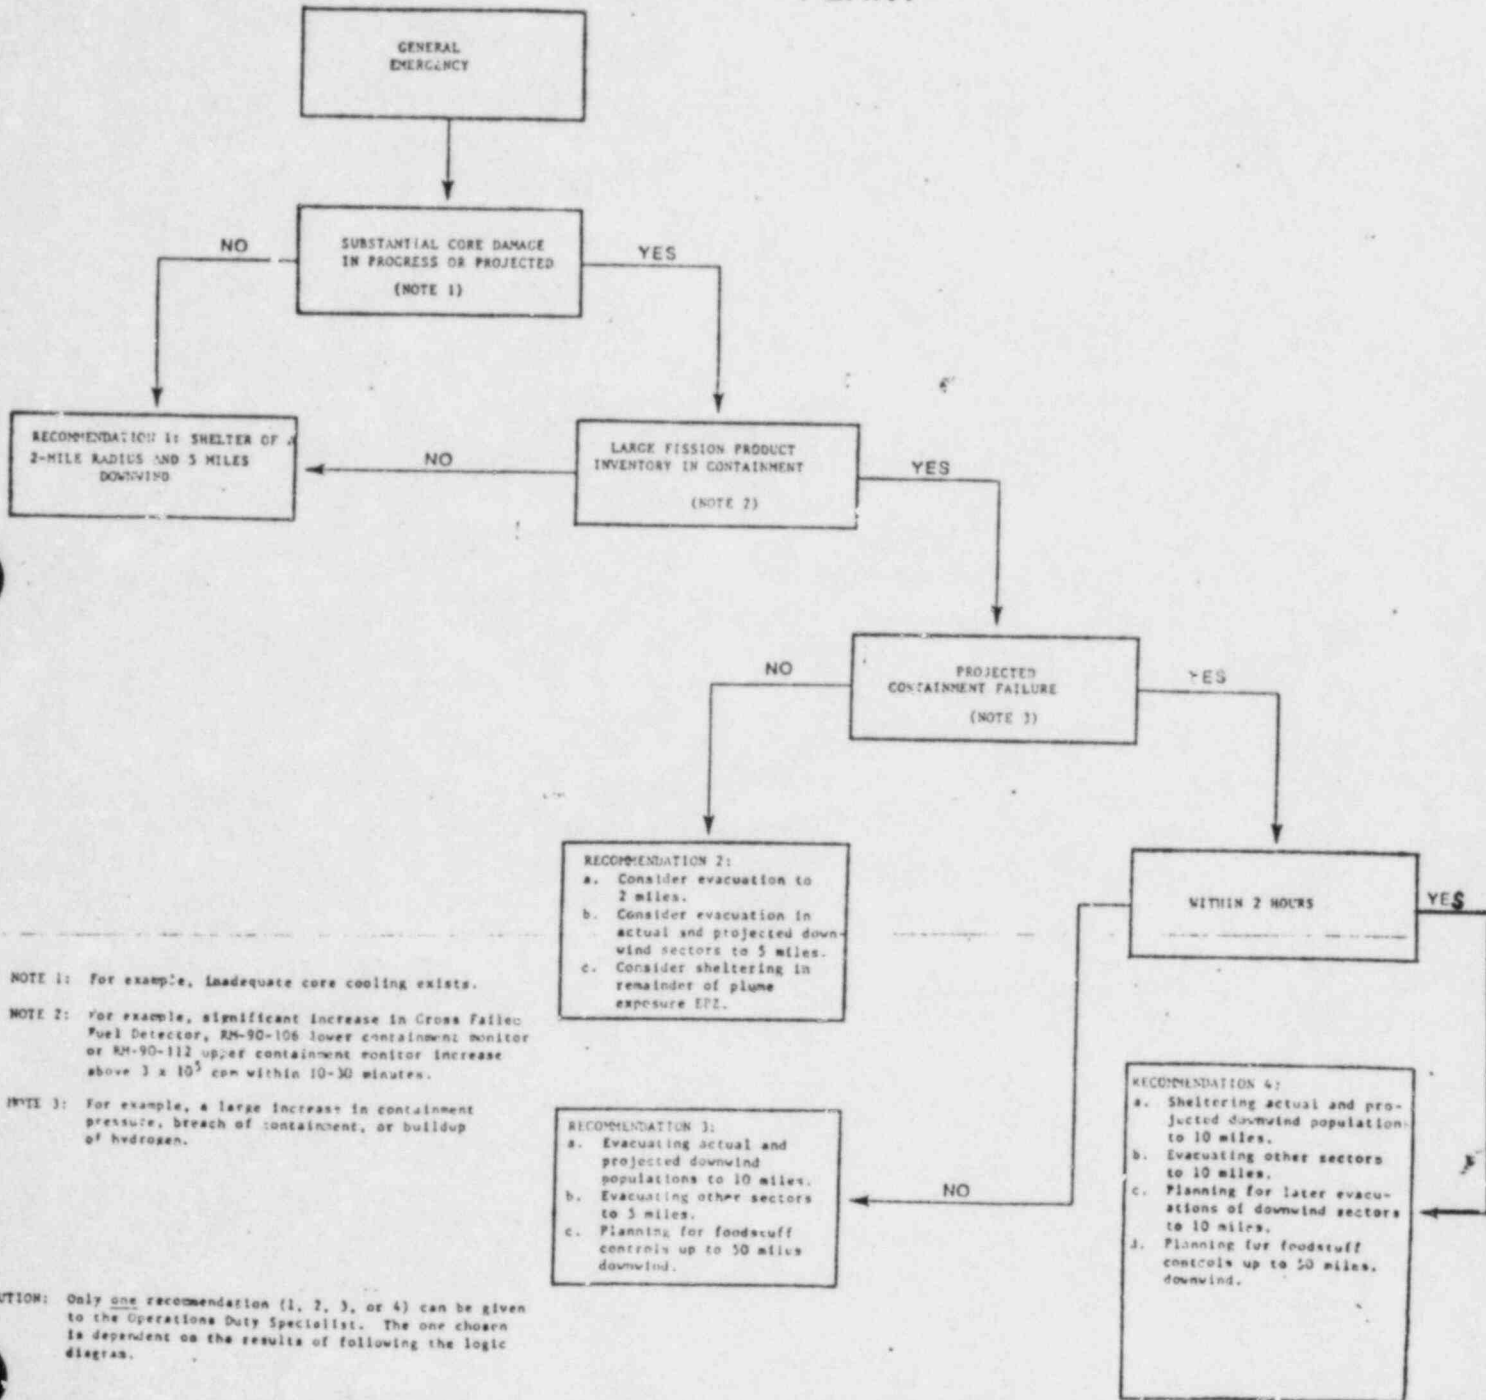

TENNESSEE VALLEY AUTHORITY

CHATTANOOGA, TENNESSEE 37401

400 Chestnut Street Tower II

March 20, 1984

U.S. Nuclear Regulatory Commission
Region II
Attn: Mr. James P. O'Reilly, Regional Administrator
101 Marietta Street, NW, Suite 2900
Atlanta, Georgia 30303

Dear Mr. O'Reilly:

SEQUOYAH NUCLEAR PLANT UNITS 1 AND 2 - RADIOLOGICAL EMERGENCY PLAN
IMPLEMENTING PROCEDURES DOCUMENT REVISION - DATED MARCH 16, 1984

In accordance with the requirements of 10 CFR 50.54(q), enclosed is a
revision to the Sequoyah Nuclear Plant Radiological Emergency Plan
Implementing Procedures Document dated March 16, 1984.

If you have any questions, please get in touch with R. H. Shell at
FTS 858-2688.

Very truly yours,

TENNESSEE VALLEY AUTHORITY

L. M. Mills, Manager
Nuclear Licensing

Enclosure

cc: Office of Nuclear Reactor Regulation (Enclosure 2) ✓
Attn: Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

54-327
54-328

A045
1/1